
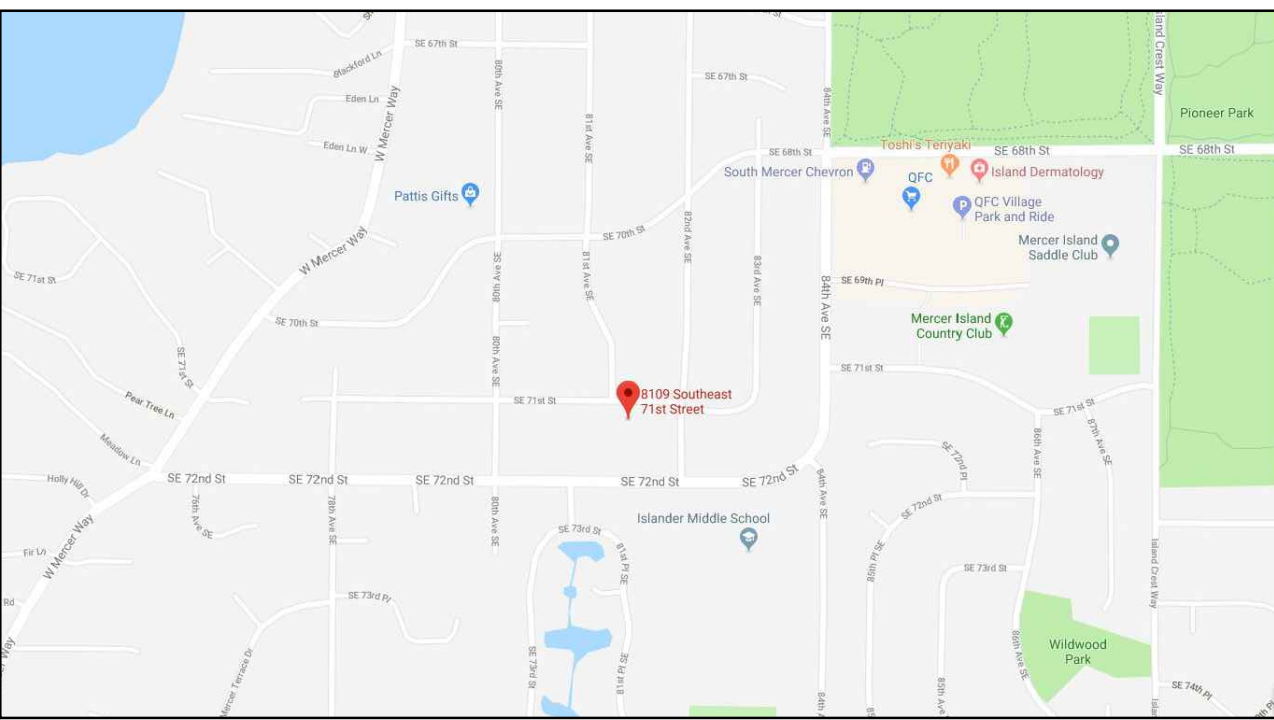


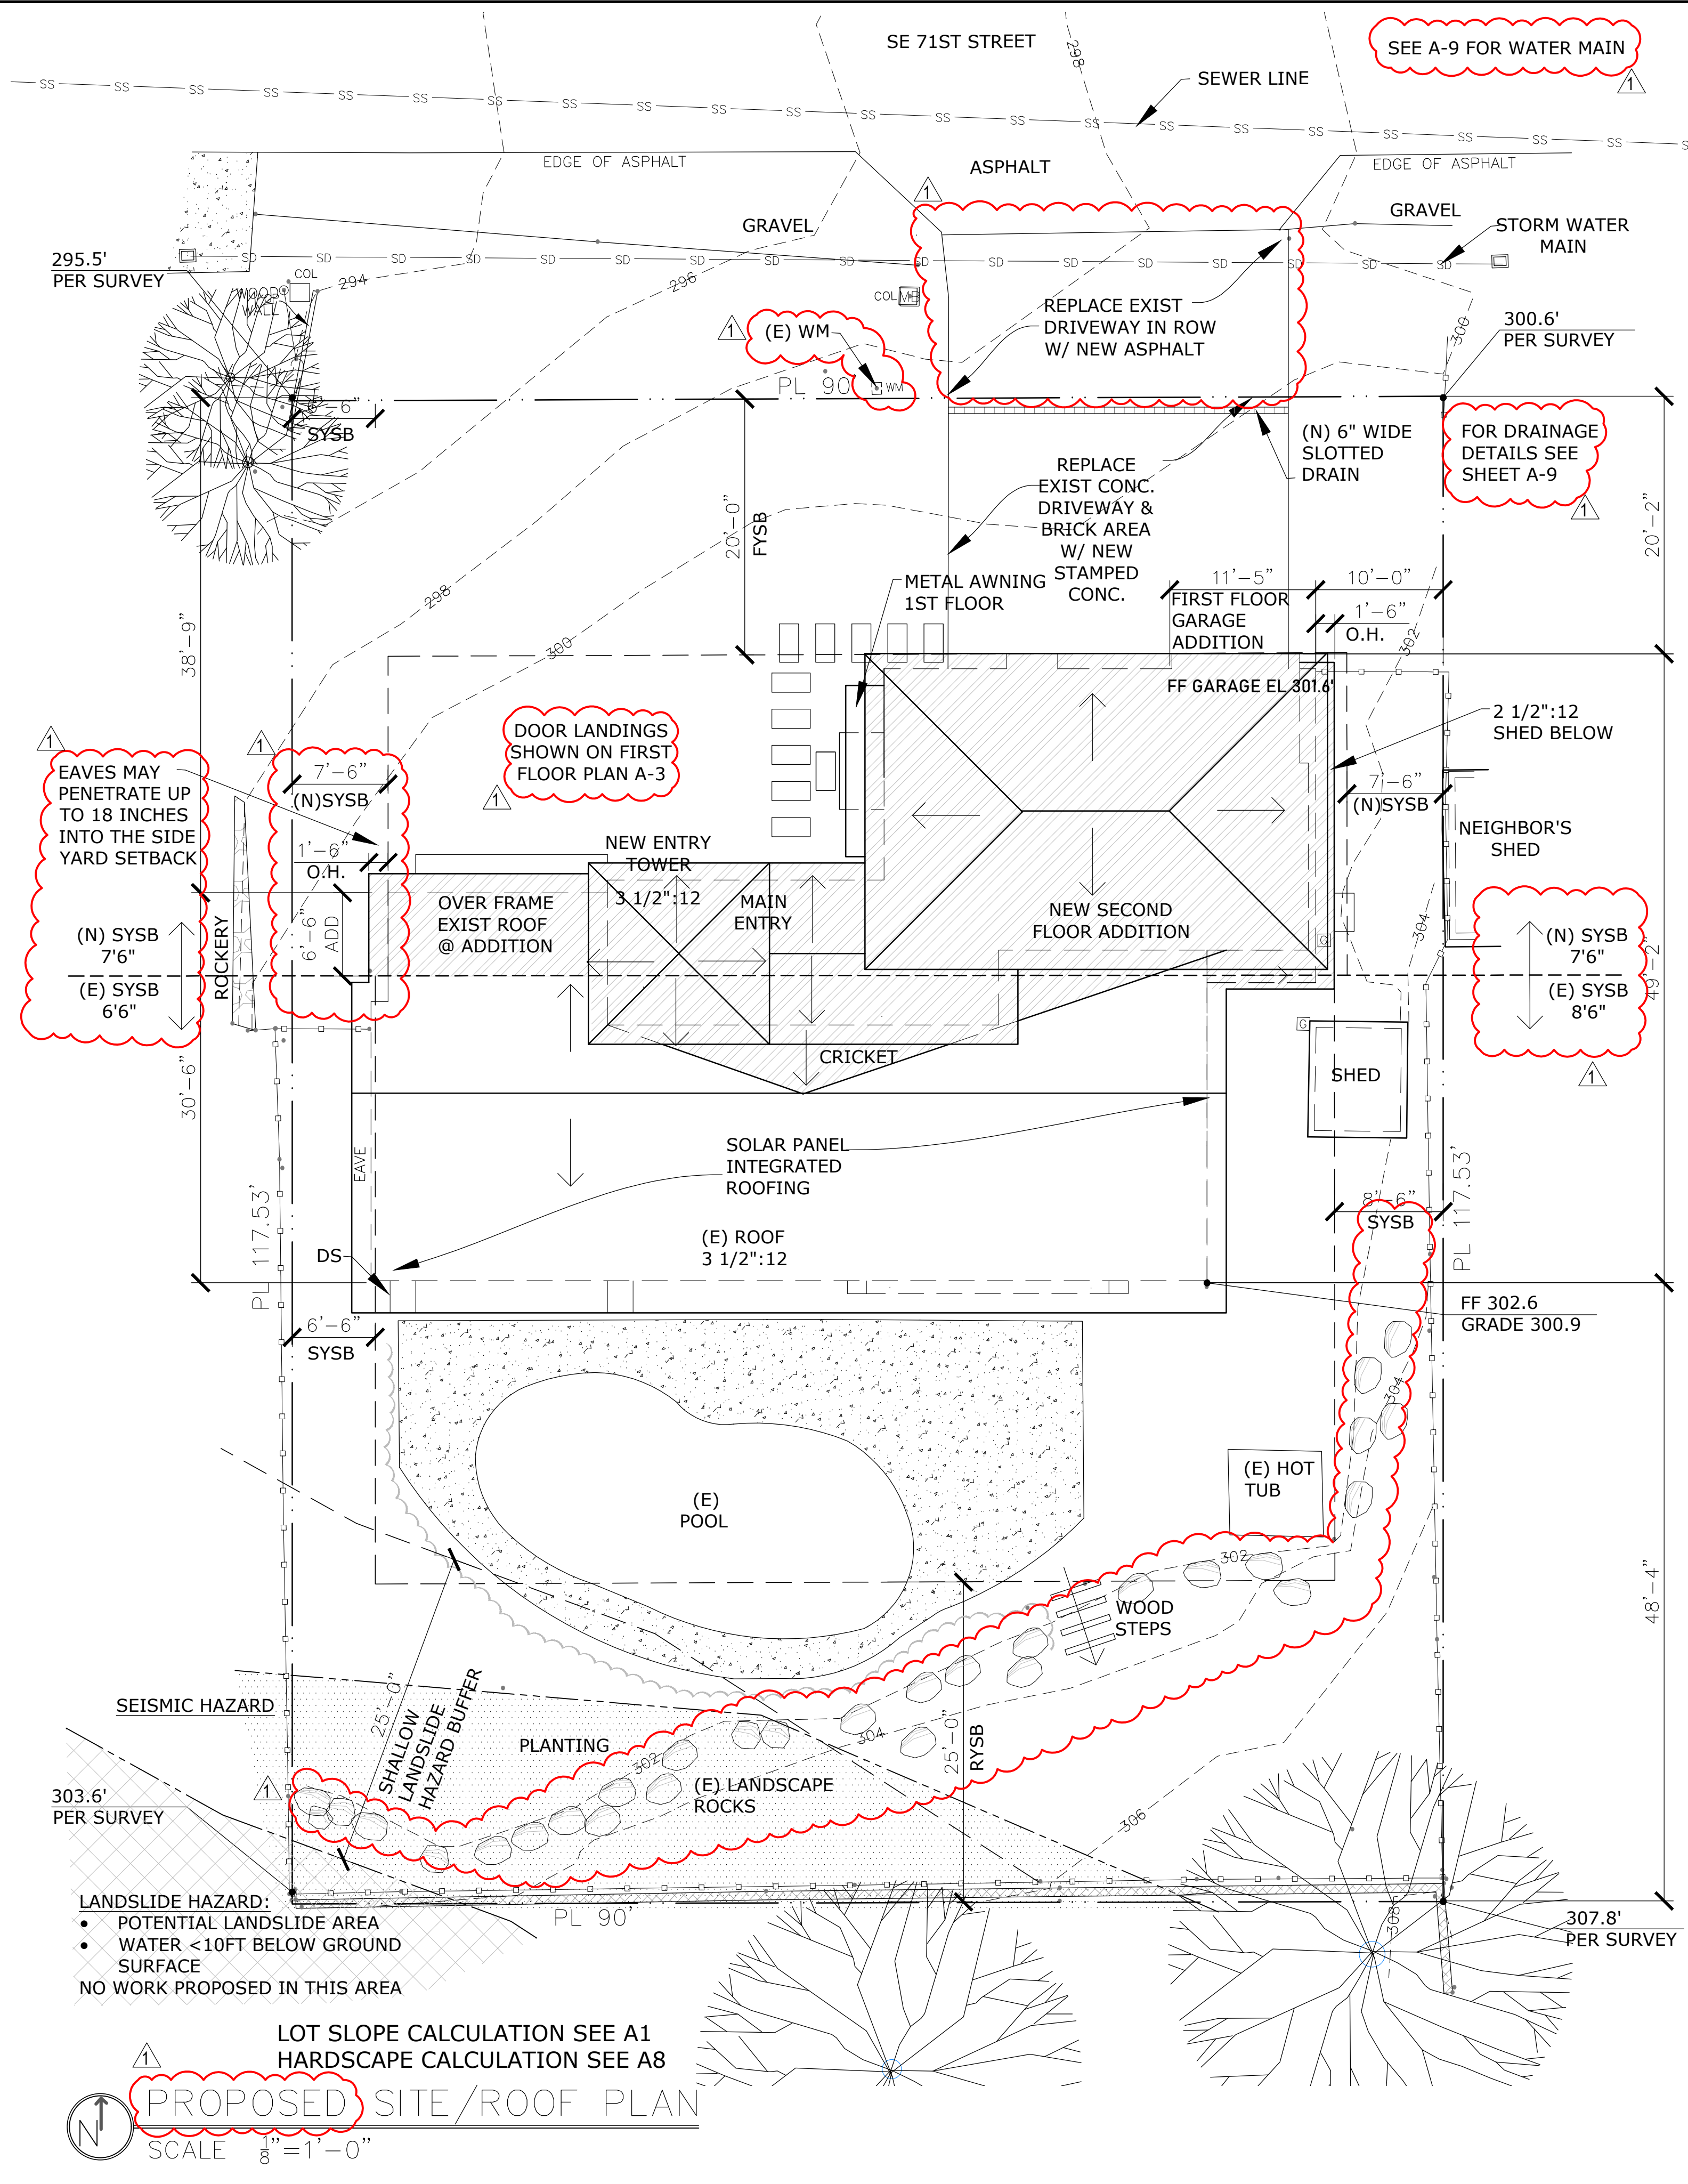


VICINITY MAP

ENERGY EQUALIZATION & ENERGY CREDITS

TOTAL SF: 2,600 SF	TOTAL: 8.5 PT
MEDIUM DWELLING - 8 CREDITS REQUIRED	
R406.2 ENERGY EQUALIZATION CREDITS	
4. FOR HEATING SYSTEM USING A HEAT PUMP THAT MEETS FEDERAL STANDARDS FOR THE EQUIPMENT LISTED IN TABLE C403.3.2(2) OR C403.3.2(9) 3 PT	
R406.3 ENERGY CREDITS	
2.1 AIR LEAKAGE CONTROL	
COMPLIANCE BASED ON SECTION R402.4.1.2; REDUCE THE TESTED AIR LEAKAGE TO 2.0 AIR CHANGES PER HOUR MAXIMUM AT 50 PASCALS.	
ALL WHOLE HOUSE VENTILATION REQUIREMENTS AS DETERMINED BY SECTION M1505.3 OF THE INTERNATIONAL RESIDENTIAL CODE OR SECTION 403.8 OF THE INTERNATIONAL MECHANICAL CODE SHALL BE MET WITH A HEAT RECOVERY VENTILATION SYSTEM WITH MINIMUM SENSIBLE HEAT RECOVERY EFFICIENCY OF 0.65.	
1.0 PT	
3.3 HIGH EFFICIENT HVAC EQUIPMENT	
AIR-SOURCE, CENTRALLY DUCTED HEAT PUMP WITH MINIMUM HSPF2 OF 8.1 (HSPF OF 9.5).	
0.5 PT	
5.6 EFFICIENT WATER HEATING	
WATER HEATING SYSTEM SHALL INCLUDE ONE OF THE FOLLOWING: ELECTRIC HEAT PUMP WATER HEATER MEETING THE STANDARDS FOR TIER III OF NEEA'S ADVANCED WATER HEATING SPECIFICATION	
2.0 PT	
6.1 RENEWABLE ELECTRIC ENERGY	
2.0 PT	

HIGHEST ELEVATION POINT OF LOT: 307.8 FEET
LOWEST ELEVATION POINT OF LOT: 295.3 FEET
ELEVATION DIFFERENCE: 12.5 FEET
HORIZONTAL DISTANCE BETWEEN HIGH AND LOW POINTS: 138.5'
LOT SLOPE: 9.03'

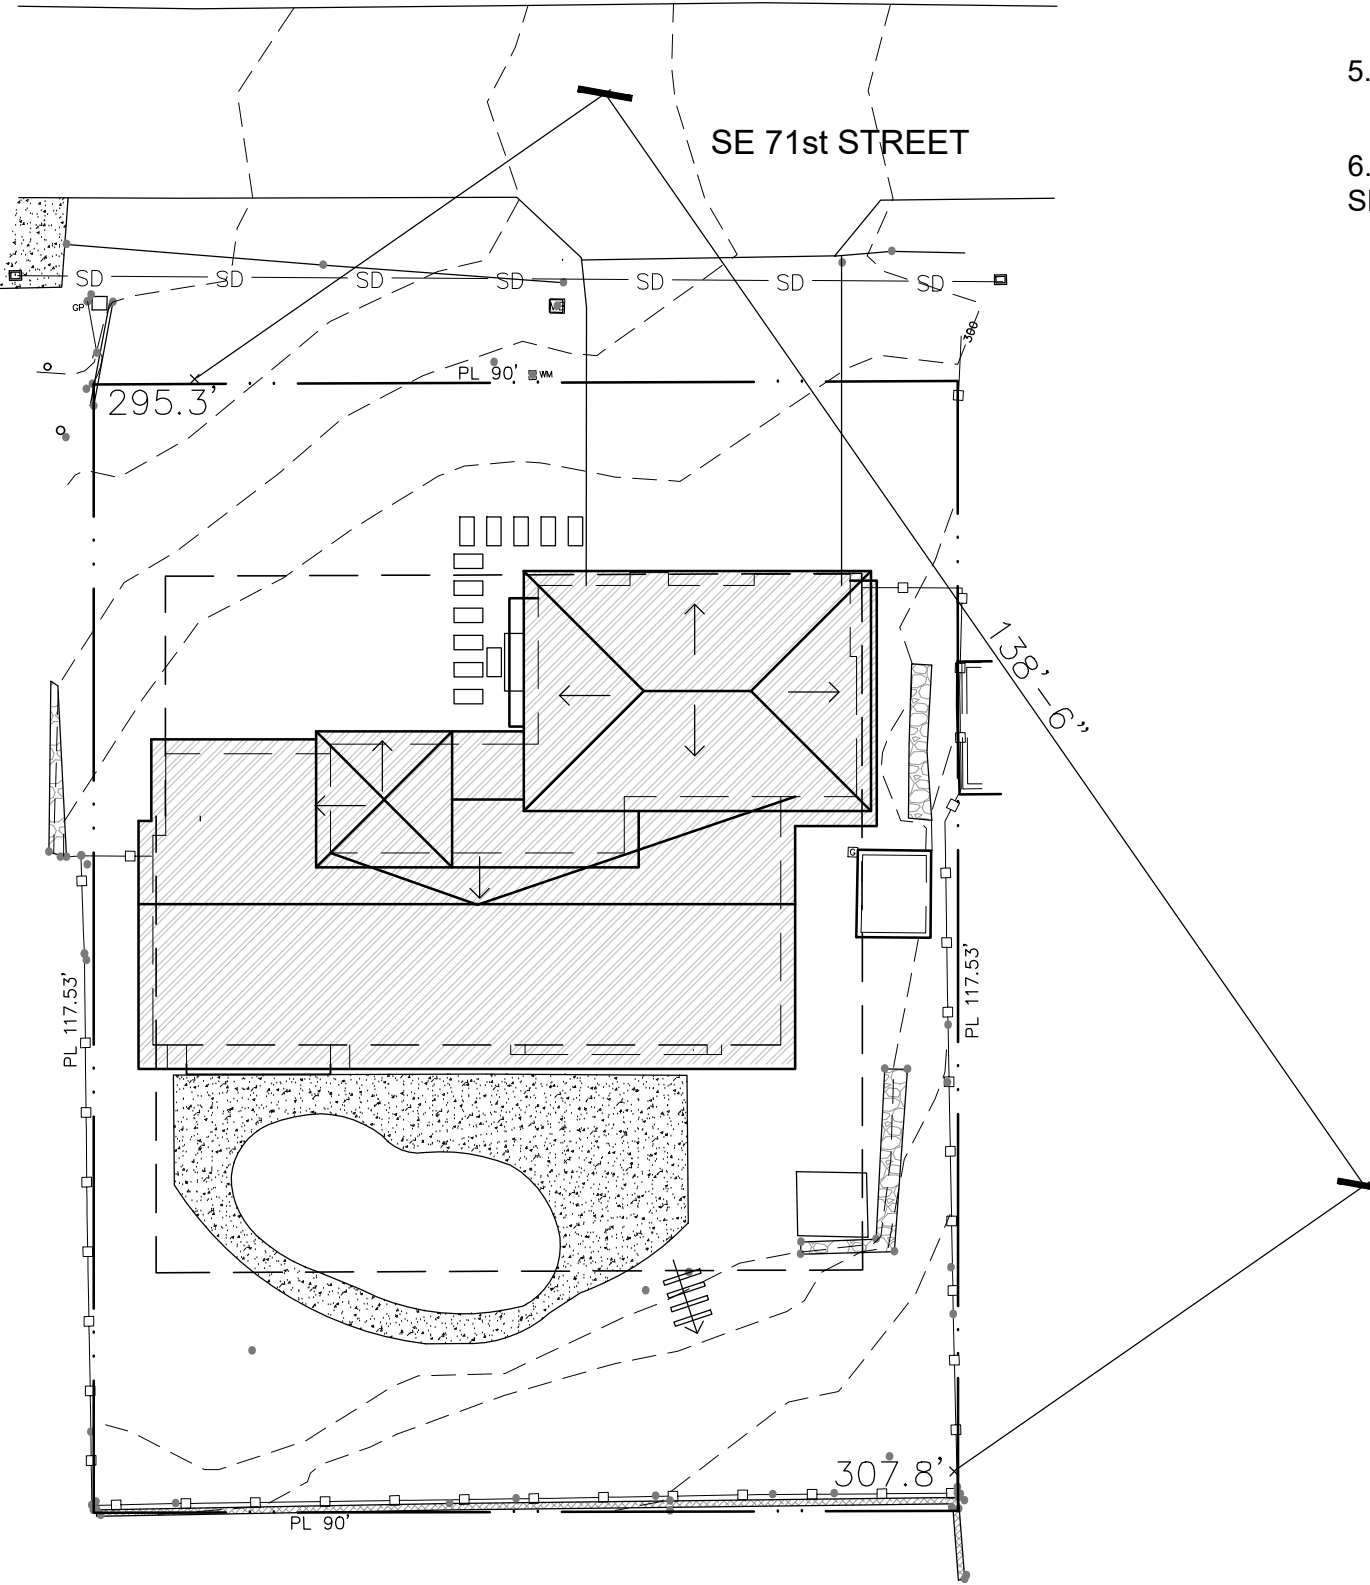

LOT SLOPE CALCULATION
SCALE 1"=20'-0"

PROJECT INFORMATION:

ADDRESS: 8109 SE 71ST STREET, MERCER ISLAND, WA 98040
OWNER: THYGESEN
PHONE: 206-335-7477
E-MAIL: DAN_THYGESEN@MSN.COM
PIERCE CO. A.P.N.: 283600-0130
LEGAL: GOODBODYS TO MER ISLAND PLAT OF PLAT BLOCK: 2 PLAT LOT:6
ZONING R-9.6
LOT: 10,578 SF
PROJECT DESCRIPTION:
REMODEL AND ADDITIONS TO EXISTING SINGLE FAMILY RESIDENCE, INCLUDES NEW ENTRY, EXPANDING THE GARAGE AND CONVERTING A PORTION OF IT TO HABITABLE SPACE FOR EXERCISE ROOM. SECOND FLOOR ADDITION OF MASTER BEDROOM SUITE WITH BATHROOM AND NEW MEDIA ROOM. SITE LANDSCAPE WORK INCLUDES REMOVING OLD SURFACING AND RETAINING WALLS, REPLACING THE OLD DAMAGED DRIVEWAY WITH NEW CONCRETE, CLEANING UP DISTURBED PLANTING AREAS WITH NEW PLANTS
NFPA 13D FIRE SPRINKLER SYSTEM IN COMPLIANCE WITH NFPA 13D AND COMI STANDARDS SHALL BE INSTALLED THROUGHOUT THE RESIDENCE. A SEPARATE FIRE PERMIT IS REQUIRED. THE FIRE PERMIT WILL BE PROVIDED AS DEFERRED SUBMITTAL.

GENERAL NOTES

- ALL CONSTRUCTION SHALL BE IN ACCORDANCE WITH THE RESIDENTIAL BUILDING CODES AND ADDENDUMS AS ADOPTED BY THE CITY OF MERCER ISLAND, WA. NOTHING IN THESE DRAWINGS SHALL BE CONSTRUED TO PERMIT WORK NOT CONFORMING WITH GOVERNING CODES. CONTRACTOR SHALL COORDINATE WITH CITY OF EDGWOOD DEPT. OF PLANNING & DEVELOPMENT TO OBTAIN ALL REQUIRED INSPECTIONS.
- WORK TO COMPLY WITH WASHINGTON STATE CODE FOR RESIDENTIAL ENERGY EFFICIENCY SECTIONS INDICATED AS "MANDATORY" AND WITH EITHER SECTIONS IDENTIFIED AS "PRESCRIPTIVE" OR THE PERFORMANCE APPROACH IN SECTION R405. AND SECTION R406 OF THE INTERNATIONAL RESIDENTIAL CODE.
ALL NEW INSULATION R-21 IN EXIST WALLS, R-49 IN ATTIC, R-30 IN RAISED FLOOR JOINTS, R-10 @ CONC. SLAB IN HEATED AREA.
SEAL, CAULK AND/OR WEATHER-STRIP AROUND ALL NEW WINDOWS, DOORS, AND ANY PENETRATIONS OF THE BUILDING ENVELOPE. PROVIDE INSULATION TO THE FULL DEPTH OF THE FRAMING CAVITY IN ALL CAVITIES EXPOSED DURING CONSTRUCTION. MINIMUM INSULATION REQUIREMENTS: EXTERIOR WALLS:R-21; HEADERS MIN 2" RIGID @ EXTERIOR SIDE OF HEADER.
- THE CONTRACTOR SHALL FIELD VERIFY DIMENSIONS; CLEARANCES, BUILDING AND SITE CONDITIONS BEFORE COMMENCING WORK. REPORT ALL DISCREPANCIES, ERRORS, AMBIGUITIES AND/OR OMISSIONS TO THE ARCHITECT.
WRITTEN DIMENSIONS GOVERN. WHERE THERE IS A DISCREPANCY BETWEEN WRITTEN DIMENSIONS AND ACTUAL DIMENSIONS OR CONDITIONS, CONTACT ARCHITECT FOR INTERPRETATION PRIOR TO BEGINNING WORK. PLAN DIMENSIONS ARE TO FACE OF FINISHED WALL OR FACE OF CONCRETE, U.N.O.
- SECURITY REQUIREMENTS: MIN. 1/2" THROW DEADBOLT OR DEAD LATCH FOR EXTERIOR DOORS. ALL LOCKS MUST BE ABLE TO BE OPENED FROM THE INSIDE WITHOUT THE USE OF A KEY OR ANY SPECIAL KNOWLEDGE OR EFFORT. WINDOWS WITHIN 10' OF GRADE OR ACCESSIBLE DECK CAPABLE OF BEING LOCKED.
- ALL SMOKE AND CARBON MONOXIDE DETECTORS SHALL RECEIVE THEIR PRIMARY POWER FROM THE BUILDING WIRING AND BE EQUIPPED WITH A BATTERY BACK-UP.
- WHOLE HOUSE VENT SYSTEM PER URC TABLE M 1507.3.3(1)
SEE A-3 FOR CALCULATION & LOCATION ON FLOOR PLAN

GOVERNING CODE

2021 INTERNATIONAL BUILDING CODE (IBC)
2021 INTERNATIONAL RESIDENTIAL CODE (IRC)
2021 INTERNATIONAL MECHANICAL CODE (IMC)
2021 INTERNATIONAL FUEL GAS CODE (IFGC)
2021 UNIFORM PLUMBING CODE (UPC)
2021 INTERNATIONAL FIRE CODE (IFC)
2021 INTERNATIONAL EXISTING BUILDING CODE
2021 INTERNATIONAL SWIMMING POOL AND SPA CODE
WASHINGTON STATE ENERGY CODE (WSEC)
WASHINGTON CITIES ELECTRICAL CODE (WCEC)
ICC/ANSI A117.1-17, ACCESSIBLE AND USABLE BUILDINGS AND FACILITIES, WITH STATEWIDE AND CITY AMENDMENTS

SHEET INDEX

- A-1 SITE/ROOF PLANS, PROJECT INFORMATION, LOT SLOPE CALCULATION
- A-2 RECORD FLOOR PLAN, GFA & AVERAGE GRADE CALCULATION
- A-3 FIRST FLOOR PLAN, WINDOW & DOOR SCHEDULE
- A-4 SECOND FLOOR PLAN
- A-5 ELEVATIONS
- A-6 ELEVATIONS, DETAILS
- A-7 SECTIONS, DETAILS
- A-8 LOT COVERAGE & HARDSCAPE CALCULATIONS
- A-9 DRAINAGE PLAN
- A-10 LANDSCAPE PLAN

- 1 SURVEY
- S1.1 GENERAL STRUCTURAL NOTES
- S2.1 FOUNDATION PLAN
- S2.2 2ND FLOOR FRAMING PLAN
- S2.3 ROOF FRAMING PLAN
- S3.1 TYP CONC SECTIONS & DETAILS
- S4.1 SECTIONS & DETAILS
- S4.2 TYP LATERAL SECTIONS & DETAILS
- S4.3 TYP LATERAL SECTIONS & DETAILS
- S4.4 SECTIONS & DETAILS

STAMPS

Donna Jean Brown Architect
10751 - 4th Ave NW Seattle, WA 98177
206.949.9939 mobile 206.547.7860 land/ fax
Donna@DJBArchitect.com

THYGESEN RESIDENCE
8109 SE 71ST STREET
MERCER ISLAND, WA 98040

SUBMIT

DATE: 10/31/2024



SITE PLAN
GENERAL NOTES
PROJECT INFORMATION
LOT SLOPE CALCULATION

REVISIONS

1	3-11-2025
2.	
3.	
4.	

A-1

SHEET 1 OF 10

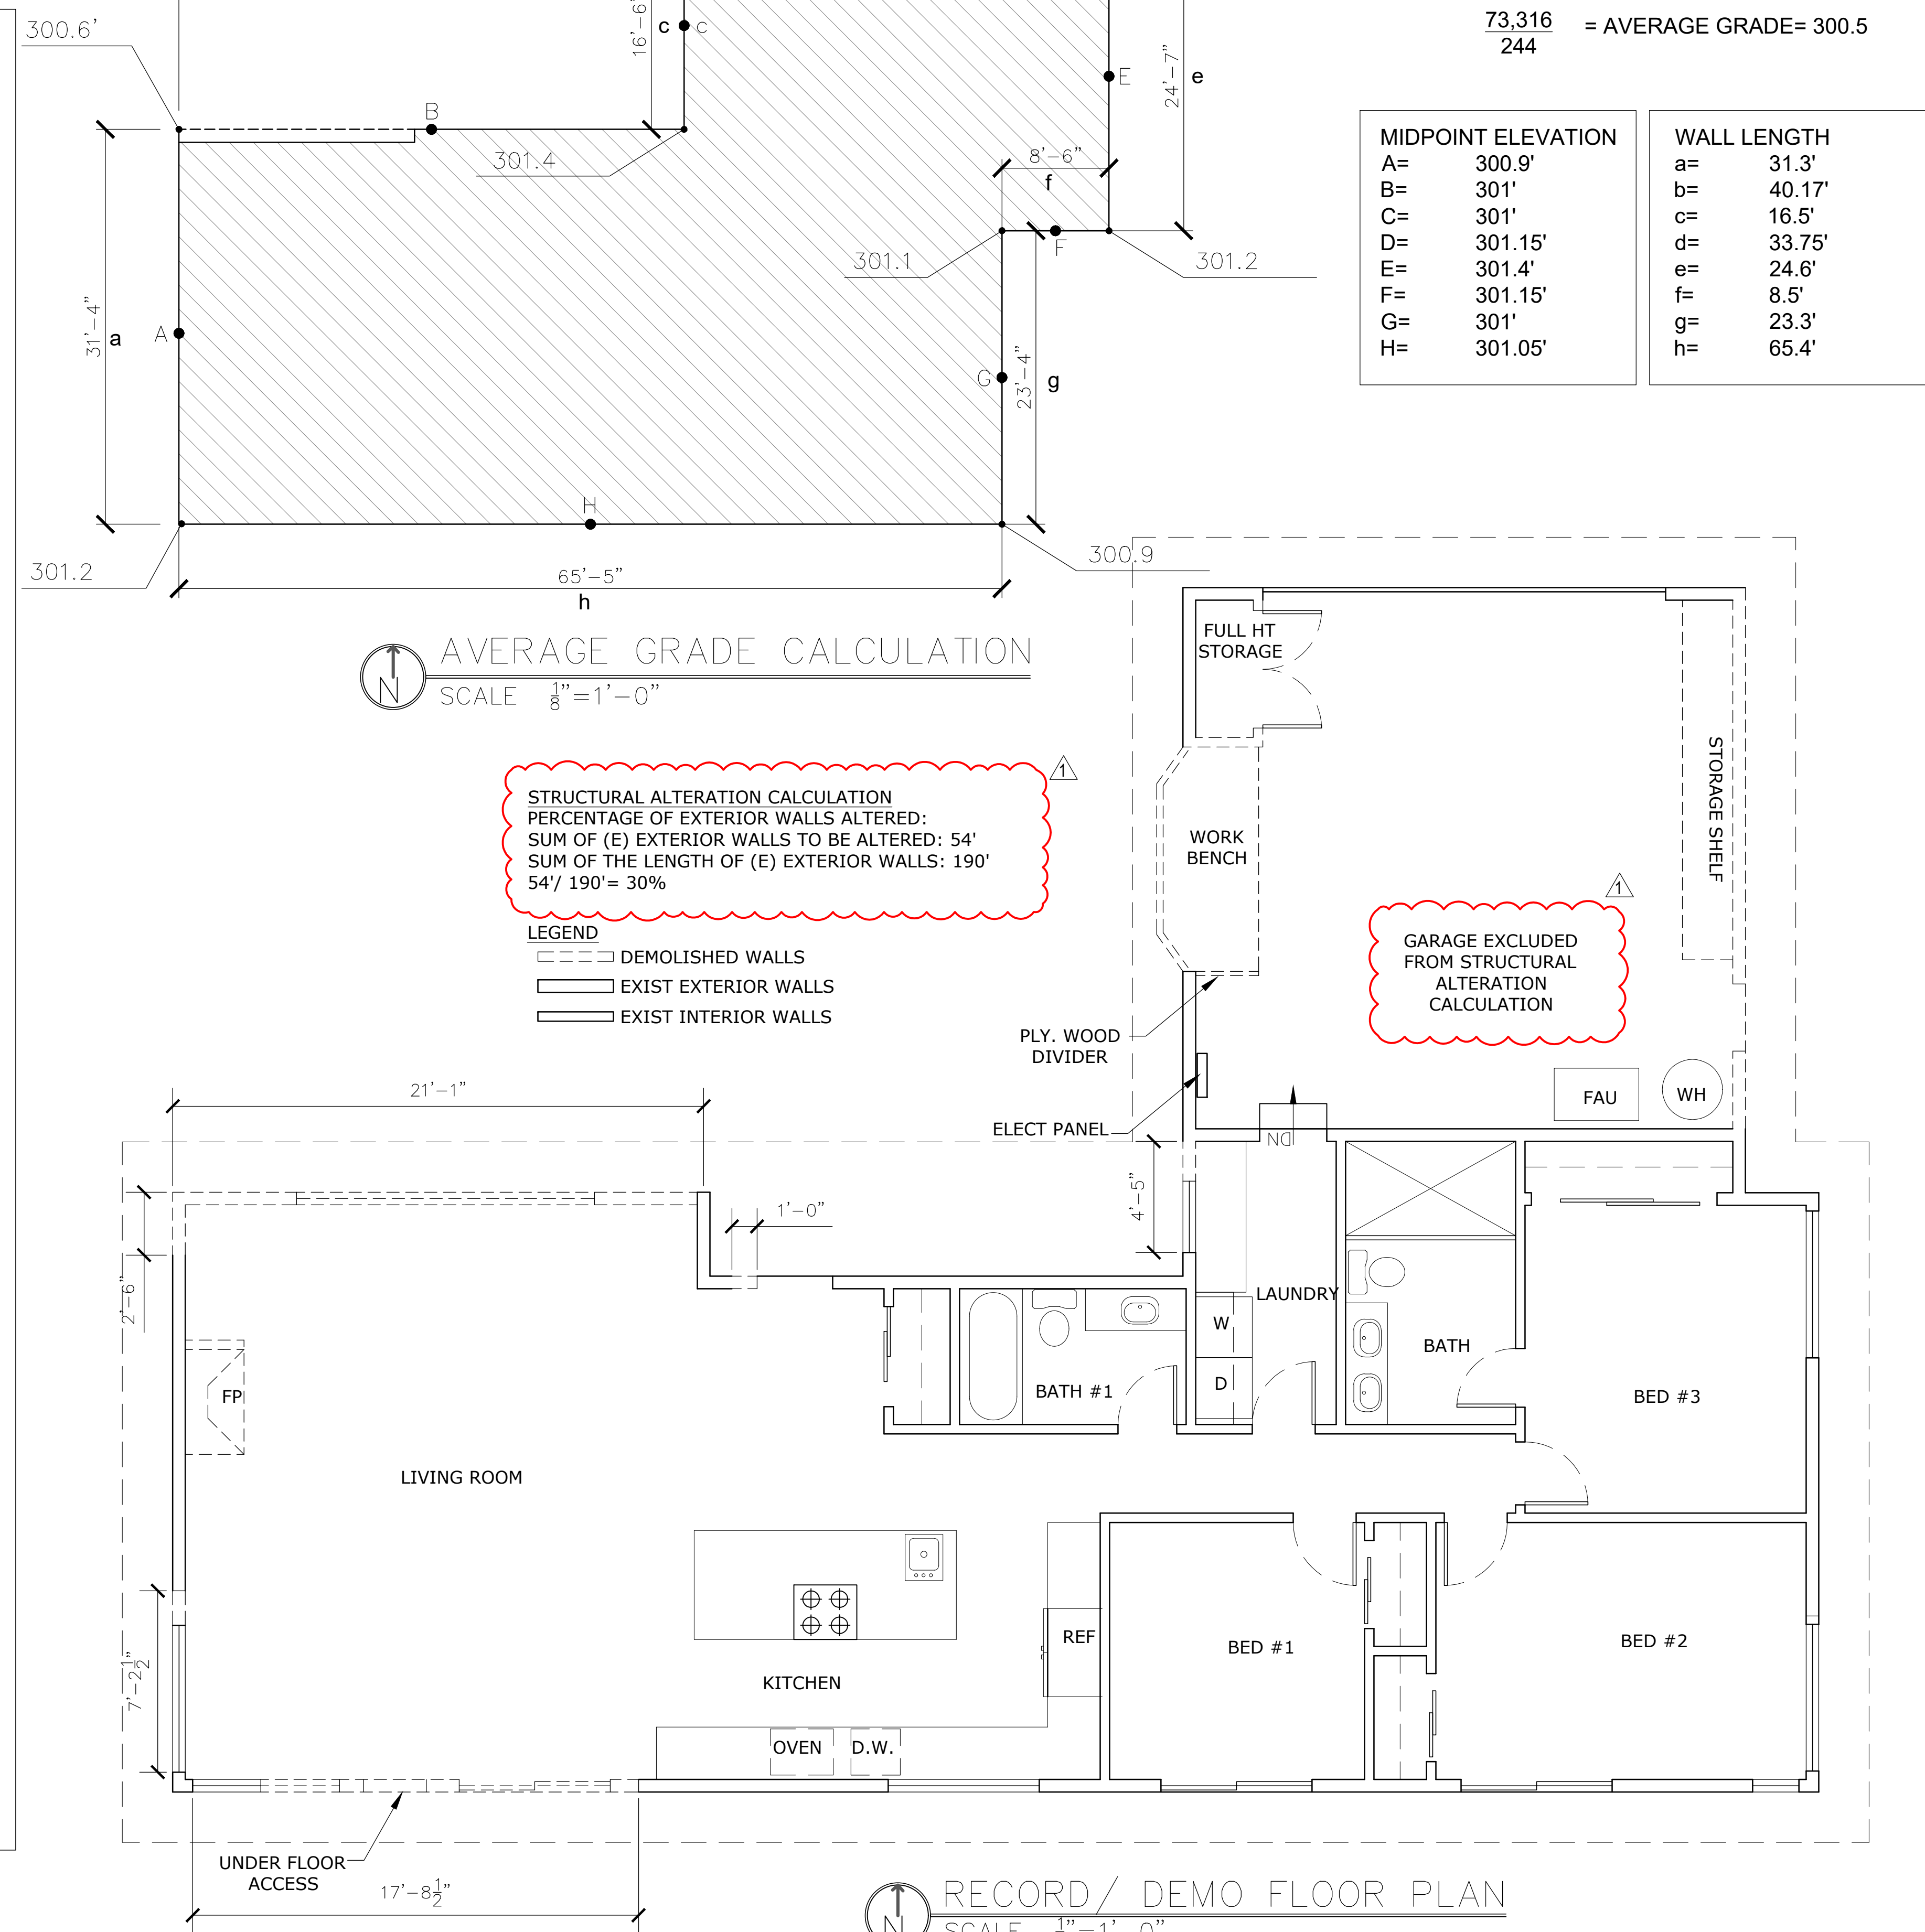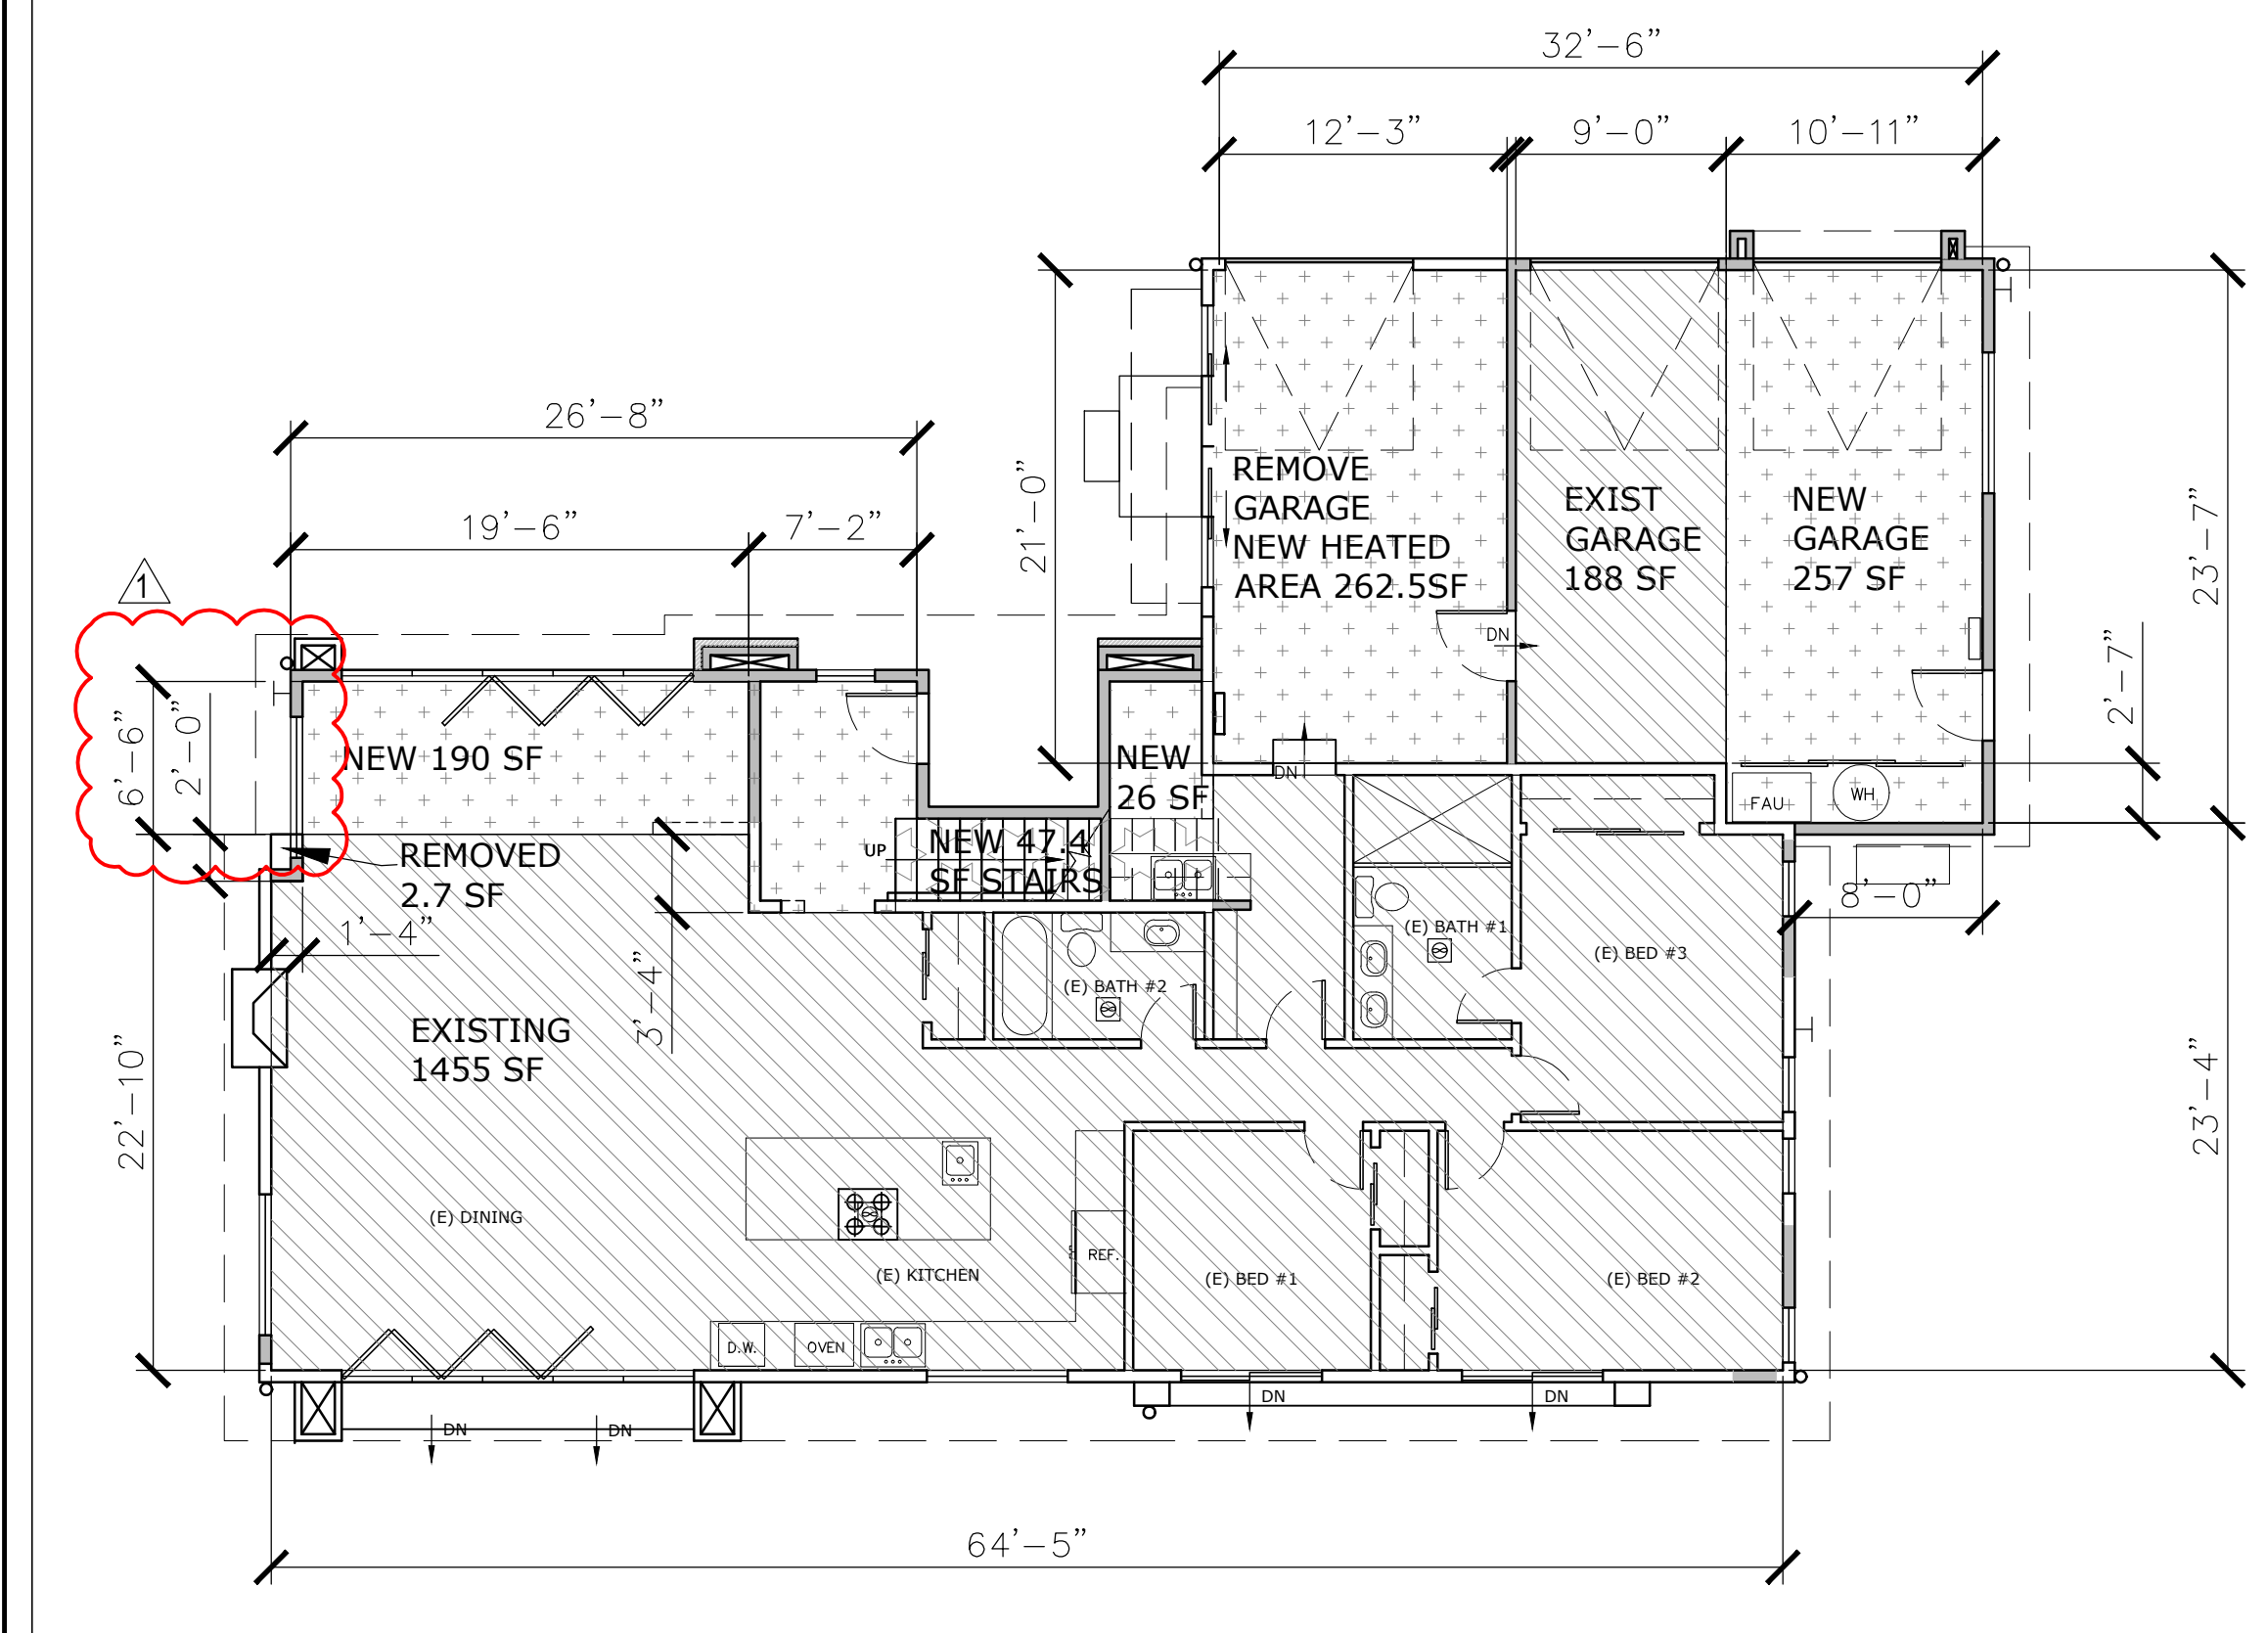

 EXIST EXTERIOR WALLS
 EXIST INTERIOR WALLS
 NEW INTERIOR WALLS
 2x4@16" O.C. W/1/2"

EXHAUST FAN 80 CFM MIN

(SD) SMOKE DETECTOR

**SD
CM** SMOKE & CARBON MONOXIDE
DETECTOR

ALL SMOKE ALARMS & CARBON
MONOXIDE ALARMS ARE
HARDWIRED AND
INTERCONNECTED


OUTSIDE DIMENSIONS
TO FACE OF FRAMING

ALL EXISTING ROOF WALL & FLOOR CAVITIES
EXPOSED DURING CONSTRUCTION SHALL BE
FILLED WITH INSULATION 2x4 WALLS TO MIN
R-15. R-21 IN 2x6 WALLS

ALL NEW HEATING & COOLING SYSTEMS TO
MEET WSEC SECTION 403

CONTINUOUS WHOLE-HOUSE VENTILATION CALCULATION
FLOOR AREA = 3522.9 SF
NUMBER OF BEDROOMS = 4
MIN. AIRFLOW 90 CFM

(HD) A HEAT DETECTOR OR HEAT ALARM RATED FOR THE AMBIENT OUTDOOR TEMPERATURES AND HUMIDITY SHALL BE INSTALLED IN NEW GARAGES THAT ARE ATTACHED TO OR LOCATED UNDER NEW AND EXISTING DWELLINGS. HEAT DETECTORS AND HEAT ALARMS SHALL BE INSTALLED IN A CENTRAL LOCATION AND IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS. HEAT DETECTORS AND HEAT ALARMS SHALL BE CONNECTED TO AN ALARM OR A SMOKE ALARM THAT IS INSTALLED IN THE ADU ABOVE. ALARMS AND SMOKE ALARMS THAT ARE INSTALLED FOR THIS PURPOSE SHALL BE LOCATED IN A HALLWAY, ROOM, OR OTHER LOCATION THAT WILL PROVIDE OCCUPANT NOTIFICATION.

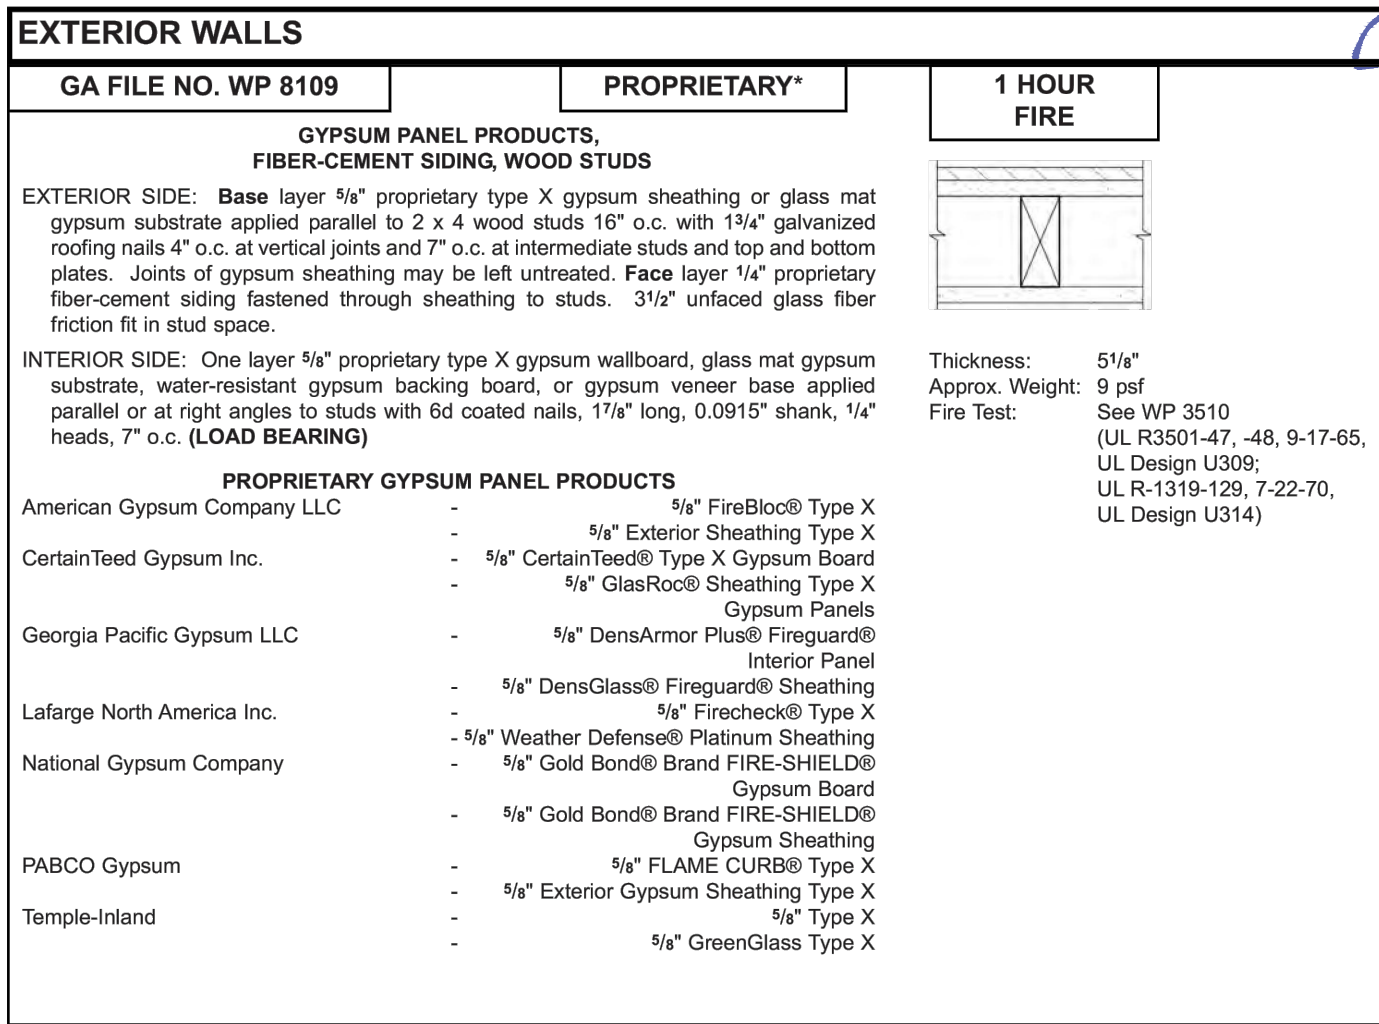

SAFETY AND SECURITY NOTES:

STAIRWAYS TO MEET THE FOLLOWING REQUIREMENTS :
OCCUPANCIES LESS THAN 10

STAIR WIDTH:	36" (MINIMUM)
TREAD WIDTH	10" (MINIMUM)
RISER HEIGHT	7 ¾" (MAXIMUM)
HEADROOM	80" (MINIMUM)
HANDRAIL HEIGHT	34" TO 38" ABOVE NOSING
HANDRAIL GRASP	1-¼" (MIN.) TO 2" (MAX.)

HANDRAIL AND GUARDRAIL INTERMEDIATE MEMBERS SHALL BE CONFIGURED AS TO PROHIBIT PASSING A 4" DIAMETER SPHERE THROUGH ANY OPENING.

GUARDRAILS SHALL BE A MINIMUM OF 36" ABOVE FINISH FLOOR

EXTERIOR DOOR & WINDOW SCHEDULE/ GLAZING CALCULATIONS										
WINDOWS TO BE NFRC CERTIFIED WITH ATTACHED LABELS; GLAZING TO BE DOUBLE-PANED, ARGON FILLED, U = 0.22, DOORS U = 0.20, U.N.O. EGRESS: MIN. CLR. OPEN 5.7 SF. MIN. NET CLEAR HT. 24", W. 20"; 44" MAX. SILL HT.										
SYM.	LOCATION	DESCRIPTION	TEMPERATURE	SIZE			QTY.	GLAZING AREA		
				D	W	SF				
①	MAIN ENTRY	FULL LIGHT SWING	X	3	7	21	1	21		
②	DINING & LIVING ROOM	NANO FOLDING GLASS DOOR	X	15	7	105	2	210		
③	BED #1	FULL LIGHT SLIDING	X	6	7	42	1	42		
④	GARAGE	SWING	X	3	7	21	1	21		
⑤	GARAGE	O.H. DOORS	X	8	8	64	2	128		
⑥	PILATES STUDIO	O.H. DOORS	X	8	7.5	60	1	60		
⑦	PILATES STUDIO	WINDOW W/ 6" FULL LIGHT SLIDING	X	12	7.5	90	1	90		
A	ENTRY	SINGLE HUNG, FIXED	X	2.5	3.5	8.75	1	8.75		
C	LIVING ROOM, DINING, GARAGE	SLIDING		6	2	12	3	36		
E	BED #2 & #3	CASEMENT, EGRESS		2.33	4	9.32	4	37.28		
F	ENTRY TOWER	FIXED		5	6	30	3	90		
J	BATH #3	DOUBLE HUNG	X	2	4	8	1	8		
J	CLOSET, BATH #3, MEDIA ROO.	FIXED		2	2	4	4	16		
K	BED #4	SLIDING	X	6	8.67	52.02	2	104.04		
L	BATH #3	SLIDING	X	4.5	3	13.5	1	13.5		
M	BED #4	SLIDING		4	2	8	1	8		
N	MEDIA ROOM	SLIDING		6	2	12	1	12		
TOTAL NEW GLAZING AREA								864.57		
EXISTING GLAZING TO REMAIN								99.5		
TOTAL GLAZING IN HEATED AREA:								964.07		
GLAZING AREA: 892.92 SF/ 3,498 SF FLOOR AREA = 25.5 % GLAZING										

DOOR HARDWARE: MINIMUM 1" THROW ON DEADBOLT OR DEAD LATCH FOR ALL EXTERIOR DOORS. ALL LOCKS MUST BE ABLE TO BE OPENED FROM THE INSIDE WITHOUT THE USE OF A KEY OR ANY SPECIAL EFFORT. DOOR ROUGH OPENINGS TO BE 4-1/2" MIN. FROM ADJACENT WALL U.N.O.

DOOR HARDWARE: MINIMUM 1" THROW ON DEADBOLT OR DEAD LATCH FOR ALL EXTERIOR DOORS. ALL LOCKS MUST BE ABLE TO BE OPENED FROM THE INSIDE WITHOUT THE USE OF A KEY OR ANY SPECIAL EFFORT. DOOR ROUGH OPENINGS TO BE 4-1/2" MIN. FROM ADJACENT WALL U.NO.

Donna Jean Brown Architect
10751 - 4th Ave NW Seattle, WA 98177
206.949.9939 mobile 206.547.7860 land
Donna@DJBArchitect.com



THYGESEN RESIDENCE
8109 SE 71ST STREET
MERCER ISLAND, WA 98

SUBMIT

DATE: 10/31/2024

FIRST FLOOR
PLAN, DOOR
& WINDOW
SCHEDULE

REVISIONS

1. 2-19-2025

2.

3.

4.


5

A-3

SHEET 3 OF 9

FIRST FLOOR PLAN

SCALE $\frac{1''}{4} = 1' - 0''$

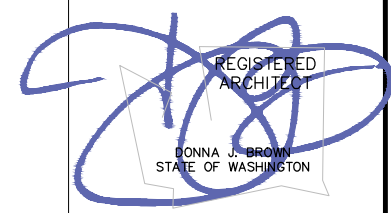

Donna Jean Brown Architect
10751 - 4th Ave NW Seattle, WA 98177
206.949.9939 mobile 206.547.7860 land/ fax
Donna@DJBArchitect.com



THYGESEN RESIDENCE
8109 SE 71ST STREET
MERCER ISLAND, WA 98040

SUBMIT

DATE: 10/31/2024

SECOND FLOOR PLAN

REVISIONS



1.	2-19-2025
2.	
3.	
4.	
5.	

A-4

SHEET 4 OF 9

LEGEND:


- EXIST EXTERIOR WALLS
- EXIST INTERIOR WALLS
- NEW INTERIOR WALLS
2x4@16" O.C. W/1/2"
- (E) EXISTING
- EXHAUST FAN 80 CFM MIN
- SMOKE DETECTOR
- CARBON MONOXIDE DETECTOR

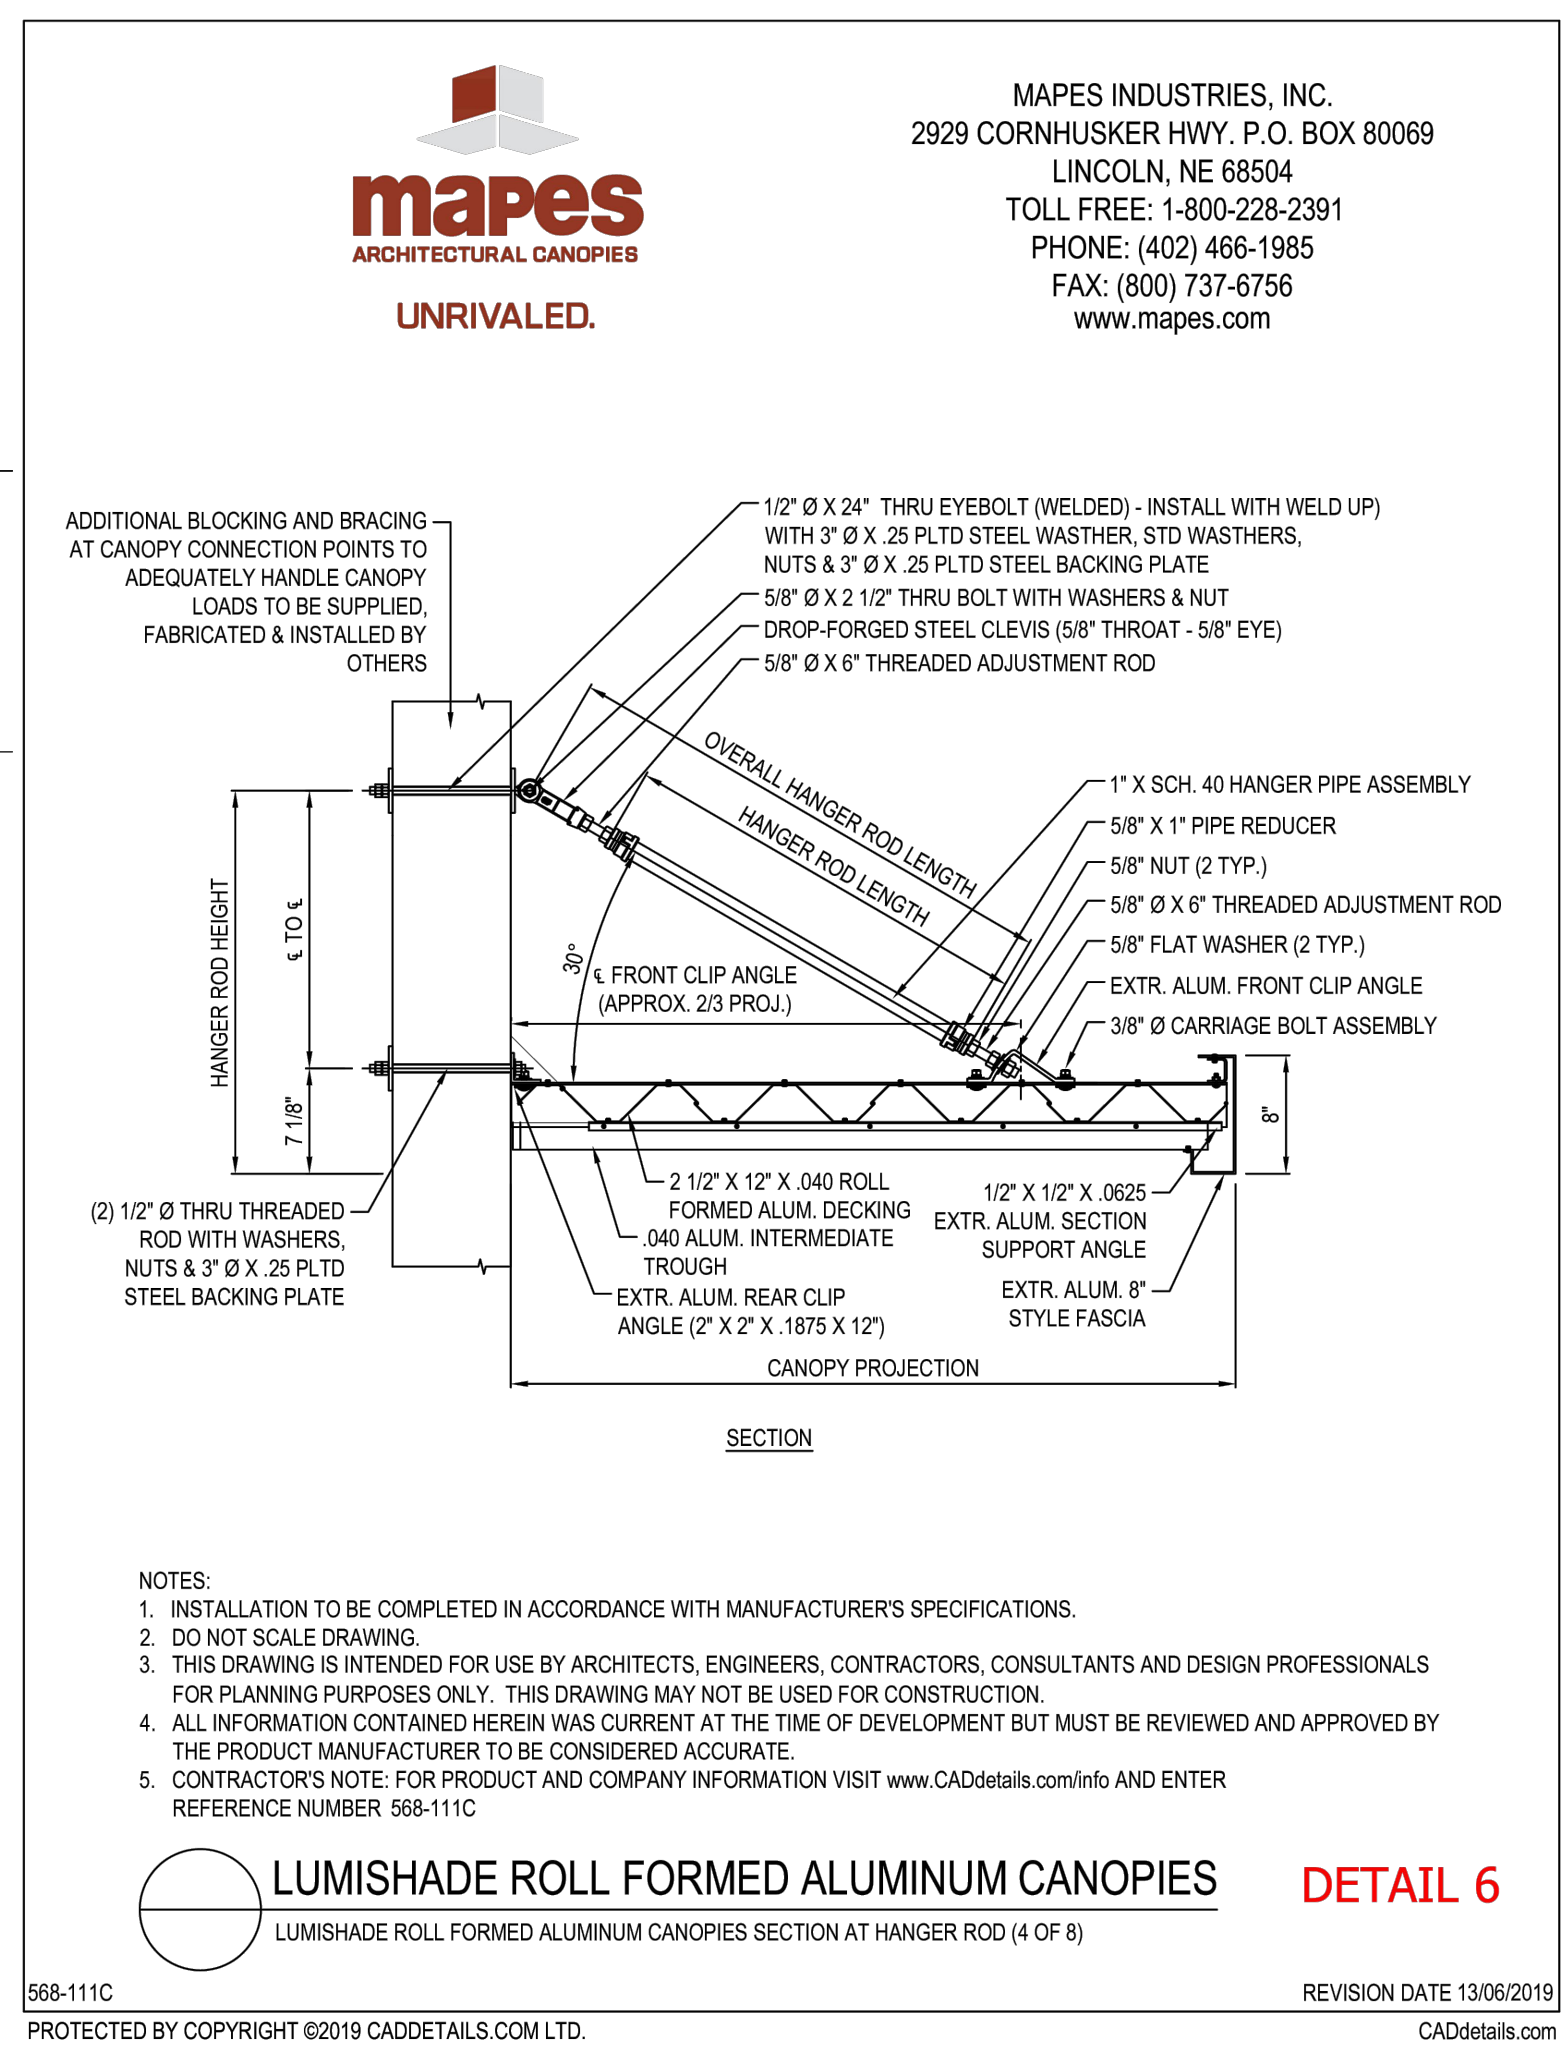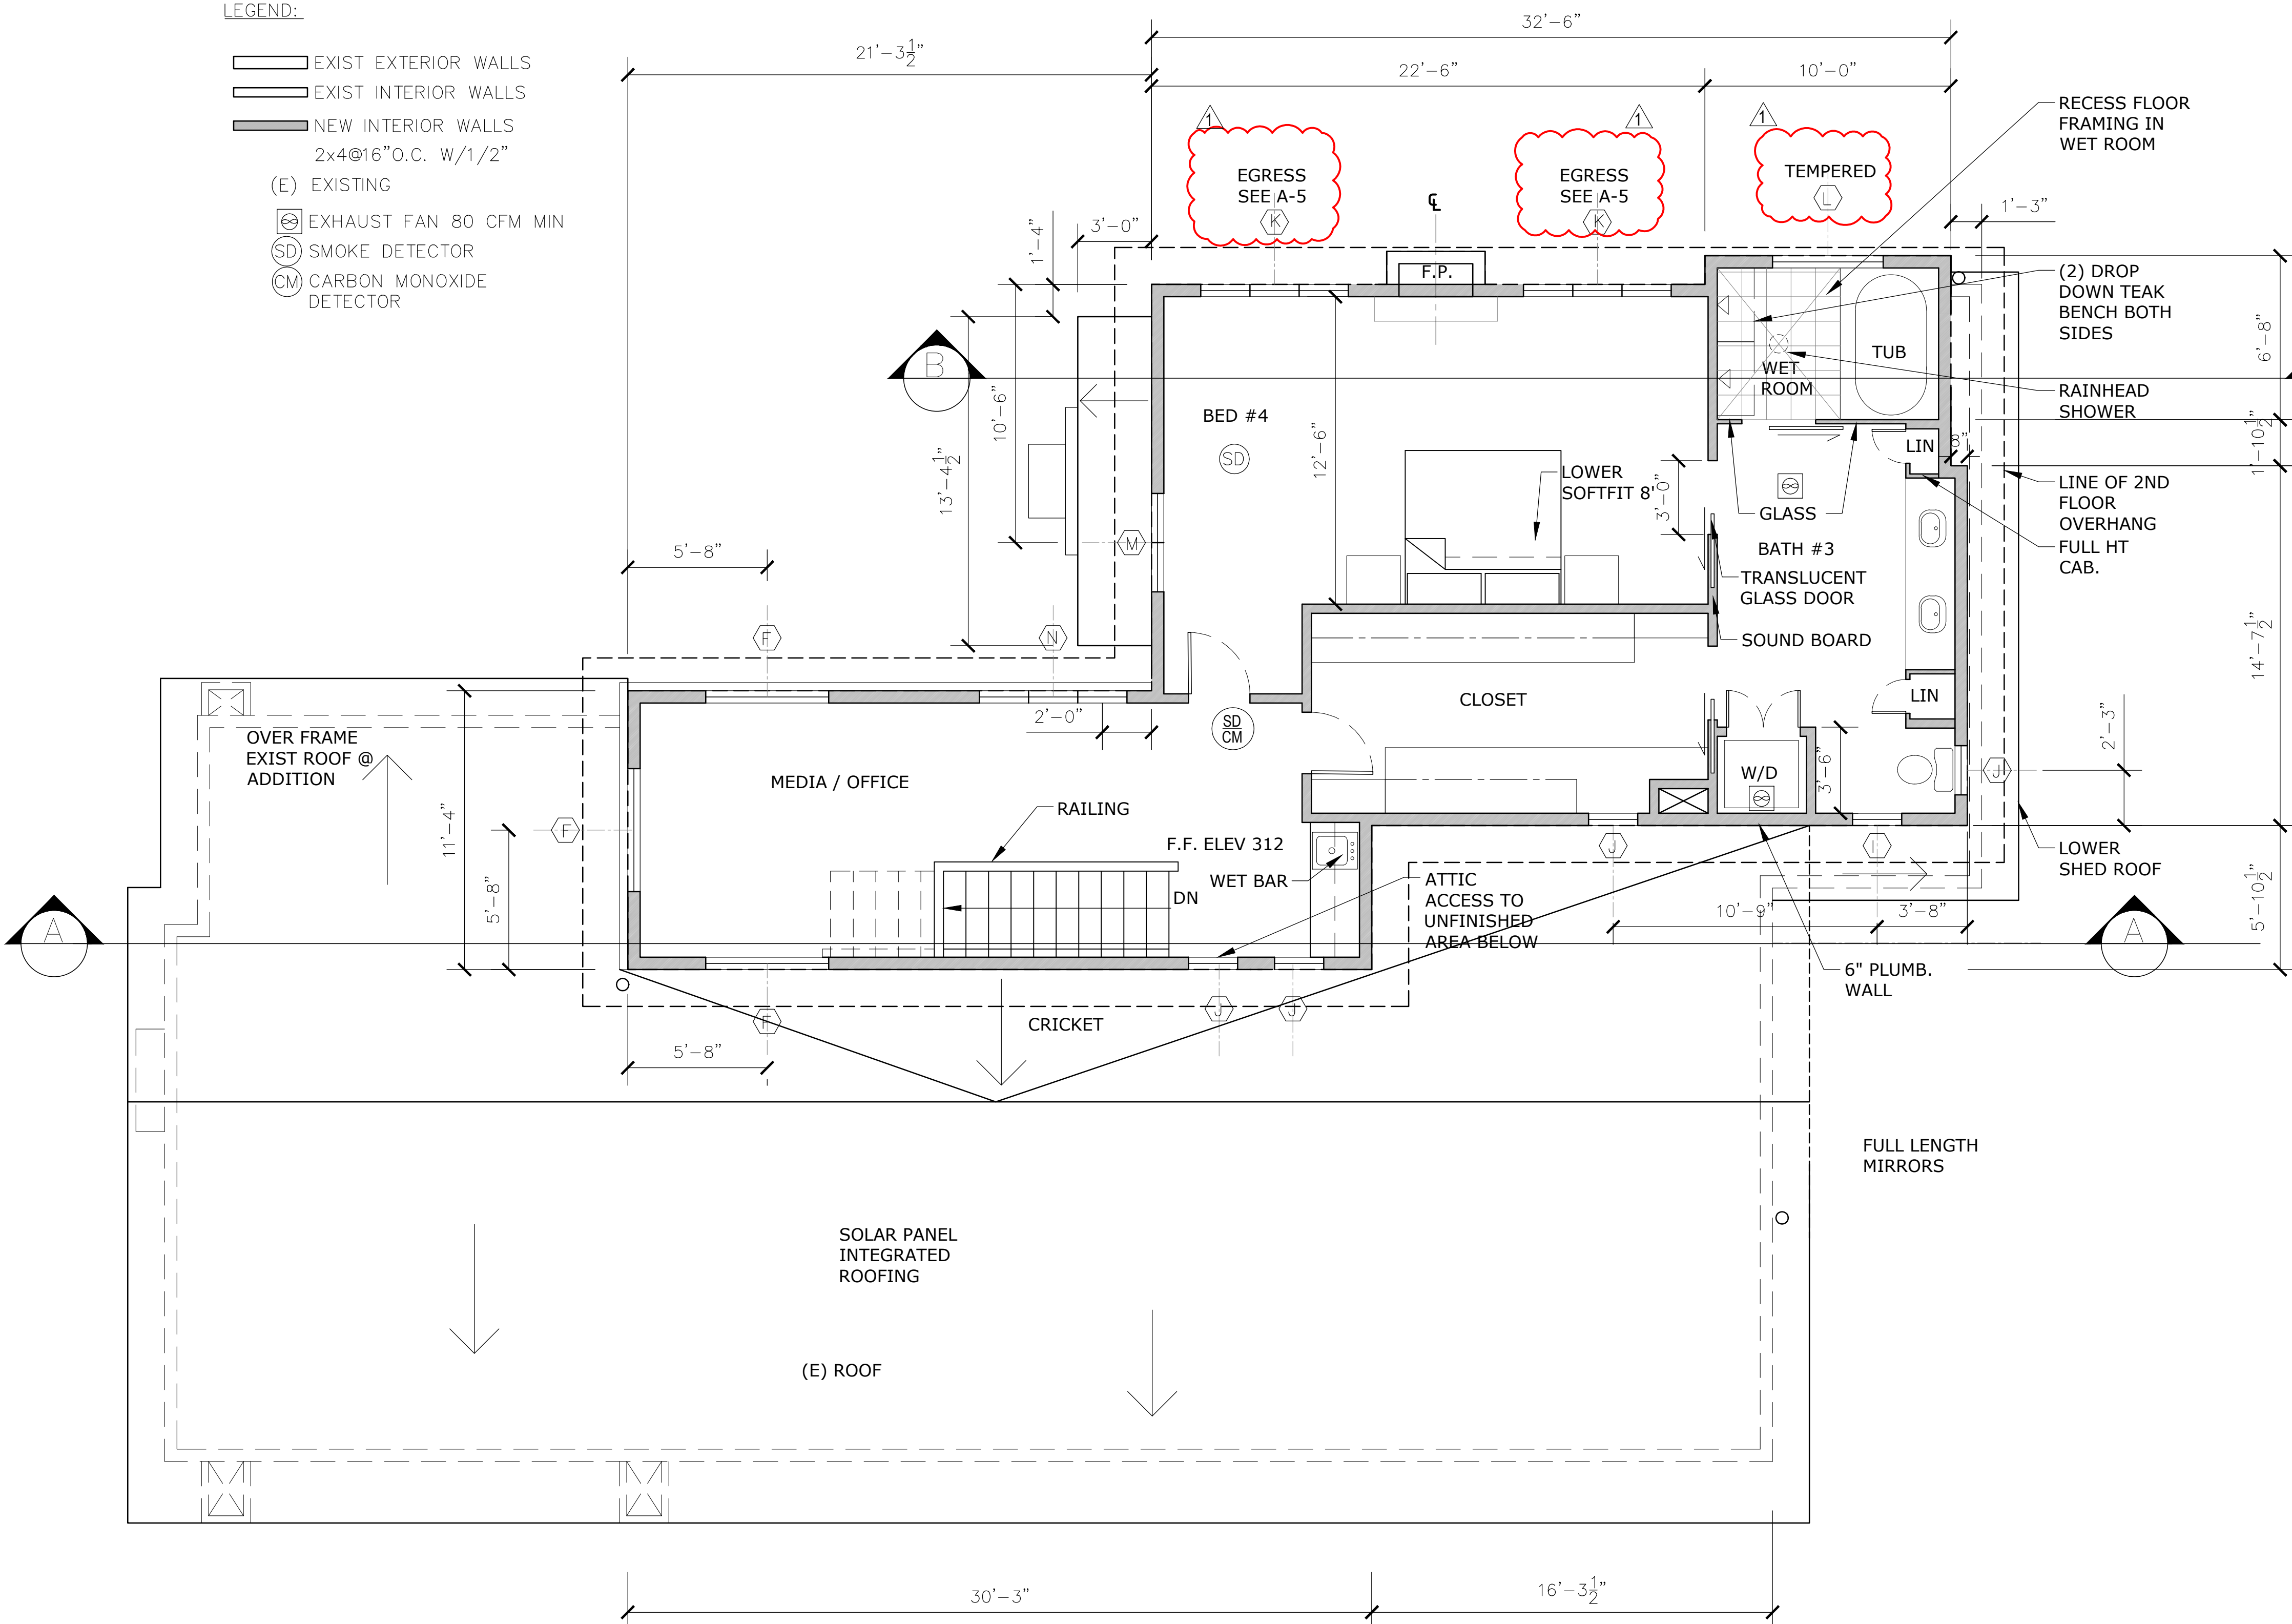

SECOND FLOOR PLAN
SCALE 1/4" = 1'-0"

6 METAL CANOPIES
SCALE 1/4" = 1'-0"

LUMISHADE ROLL FORMED ALUMINUM CANOPIES
LUMISHADE ROLL FORMED ALUMINUM CANOPIES SECTION AT HANGER ROD (4 OF 8)
REVISION DATE 13/06/2019
CADdetails.com

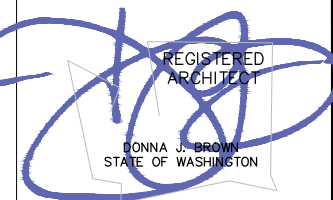

Donna Jean Brown Architect
10751 - 4th Ave NW Seattle, WA 98177
206.949.9939 mobile 206.547.7860 land/ fax
Donna@DJBArchitect.com



THYGESEN RESIDENCE
8109 SE 71ST STREET
MERCER ISLAND, WA 98040

SUBMIT

DATE: 10-31-2024

ELEVATIONS

REVISIONS

2-19-2025


2.

3.

4.


A-5

SHEET 5 OF 9

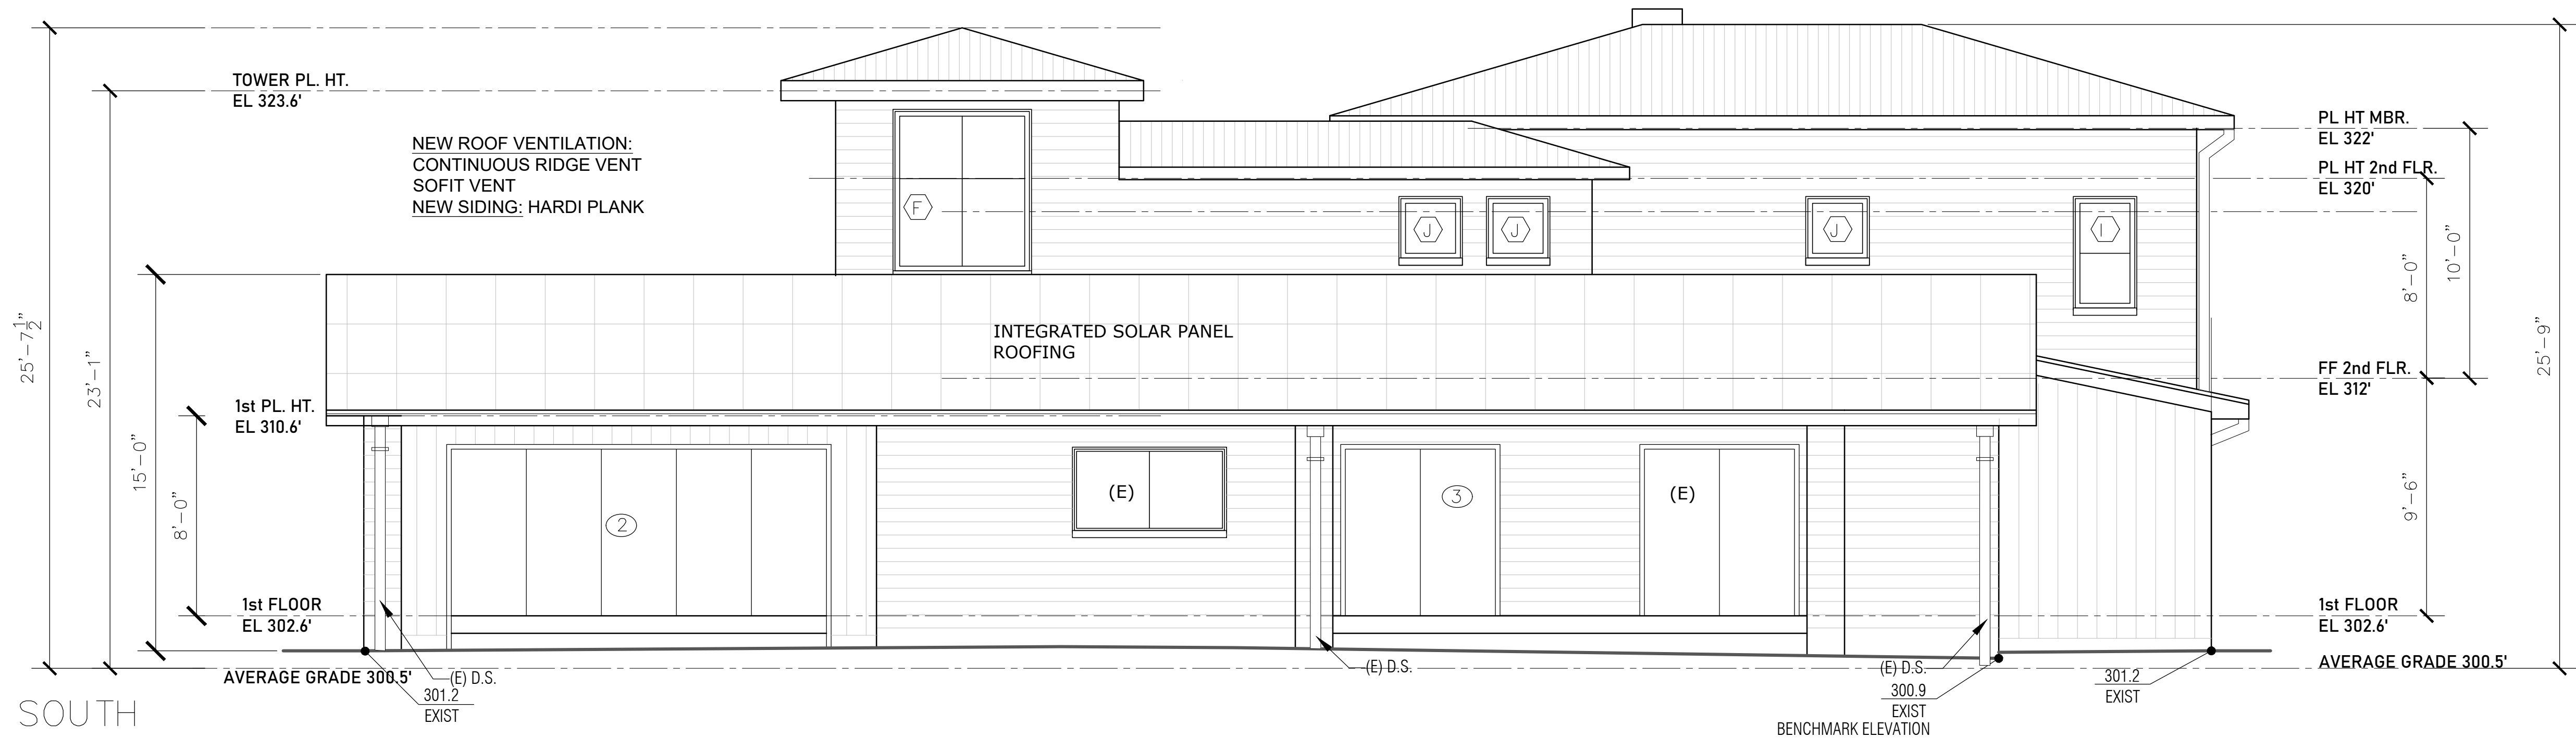

ELEVATION SOUTH

SCALE 1/4"=1'

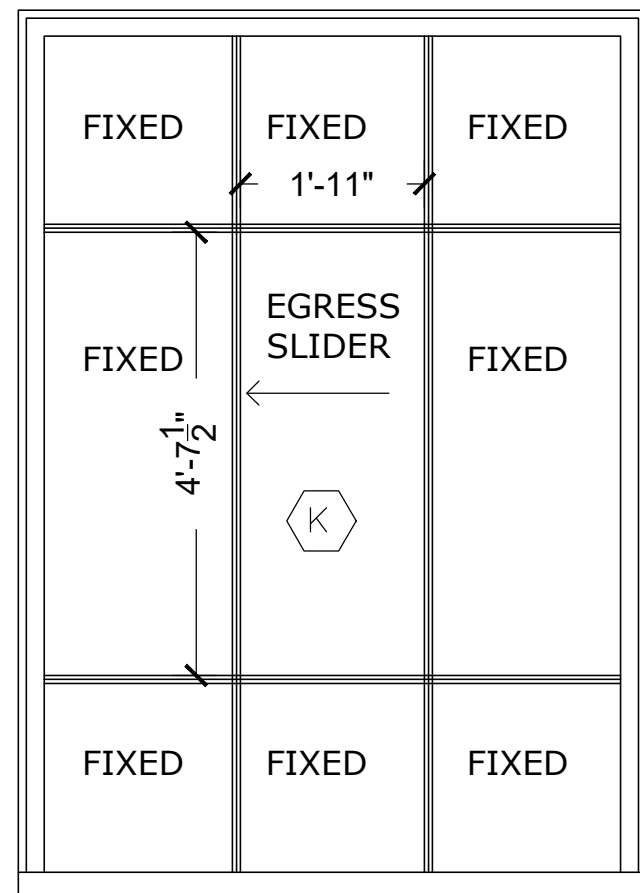




DETAIL EGRESS WINDOW K FOR BED #4

SCALE 1/2"=1'

ELEVATION NORTH


SCALE 1/4"=1'

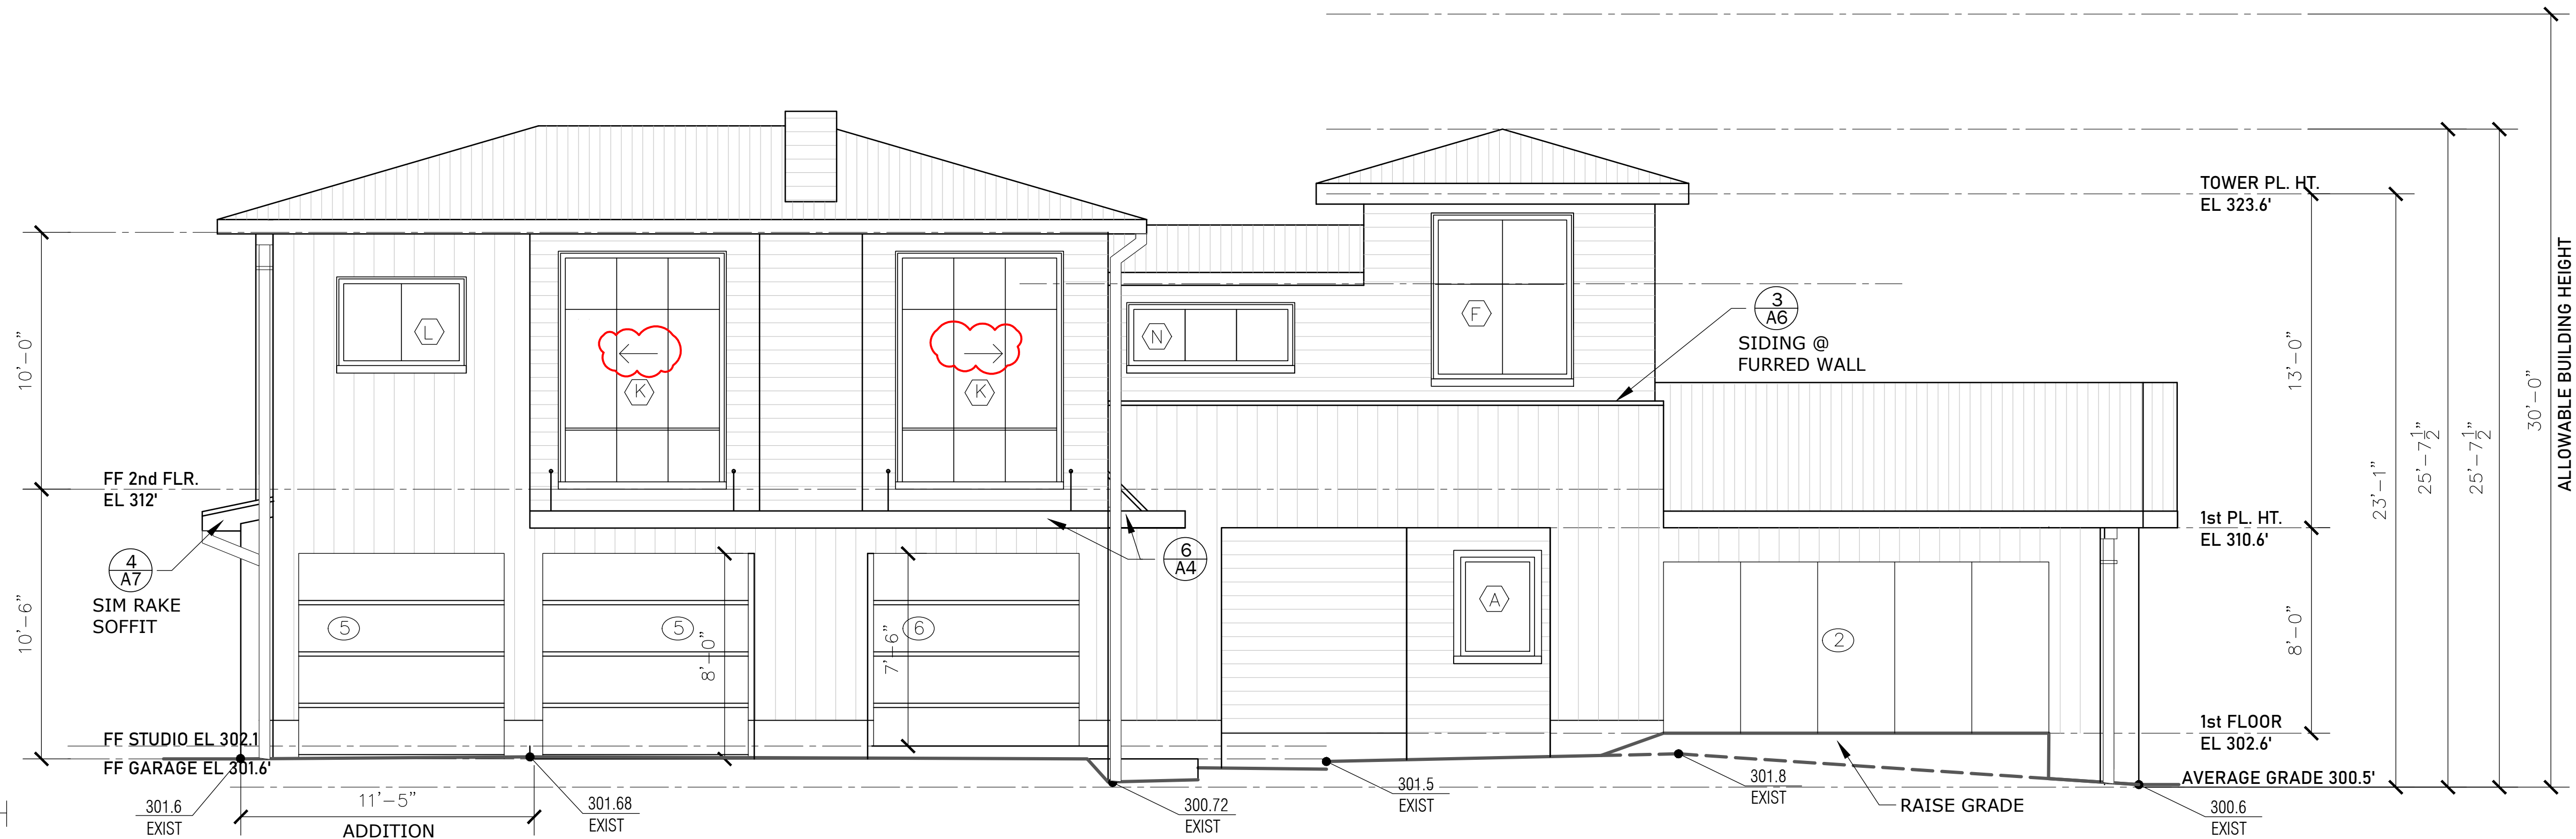


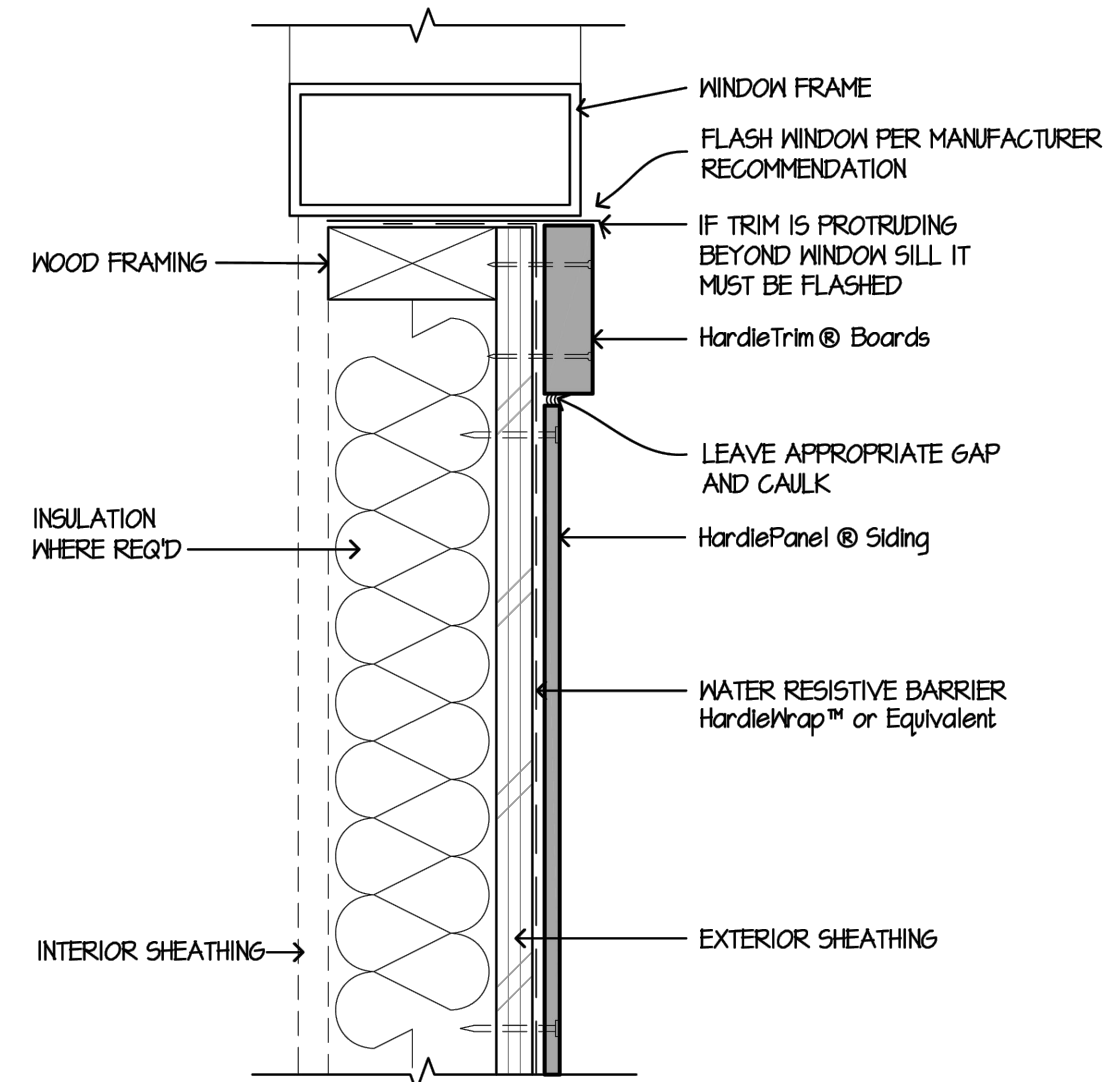
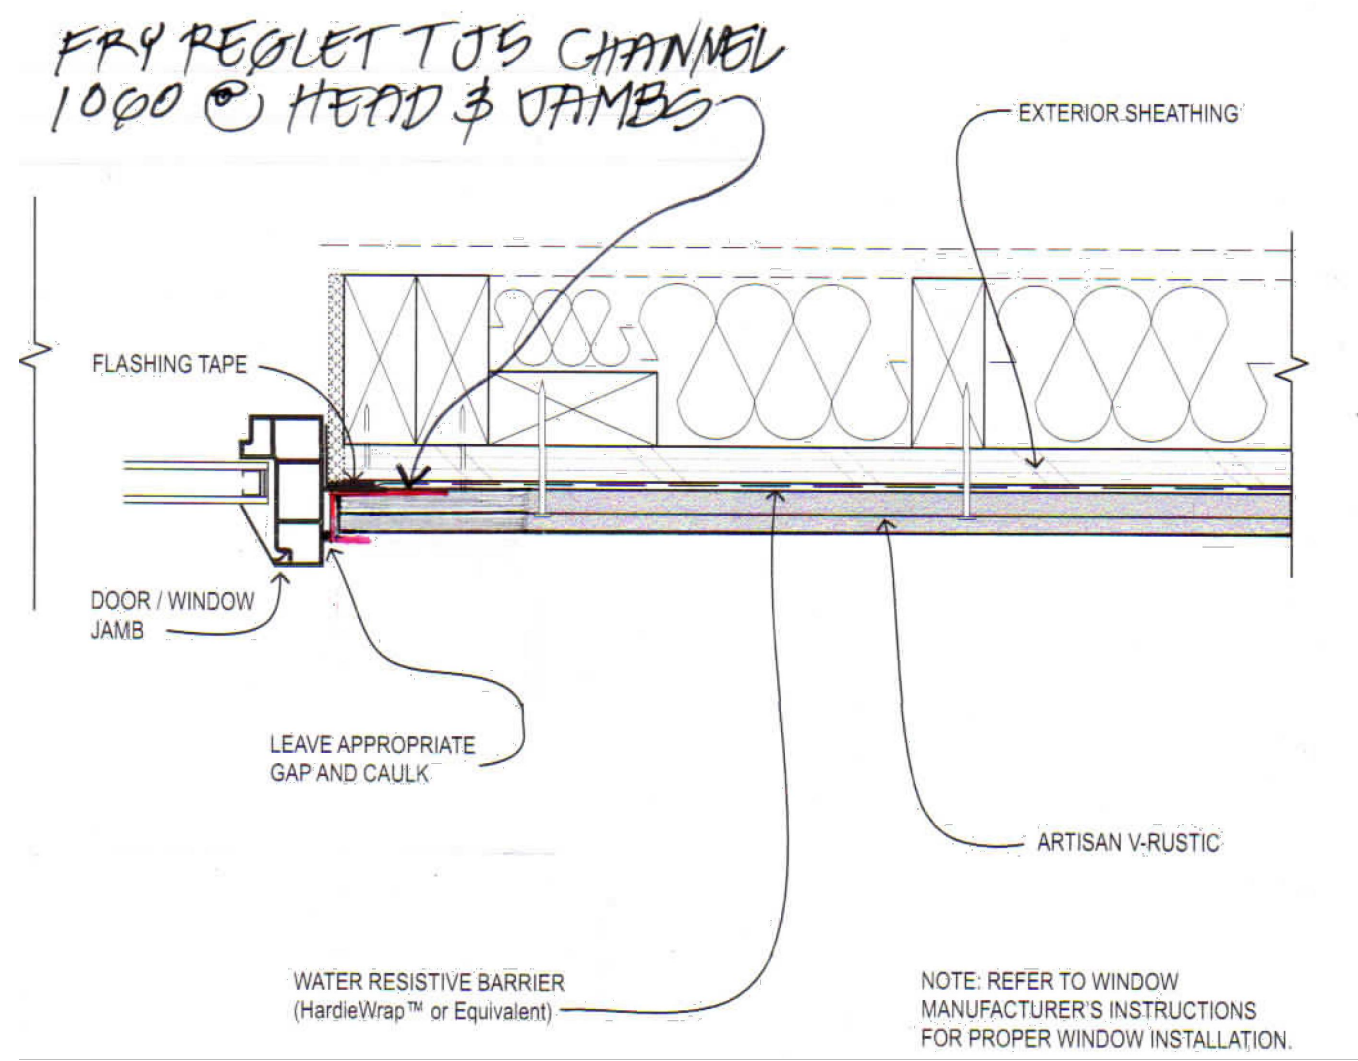


1 DOOR / WINDOW JAMB
W/ METAL J CHANNEL
N.T.S.

2 WINDOW SILL
N.T.S.

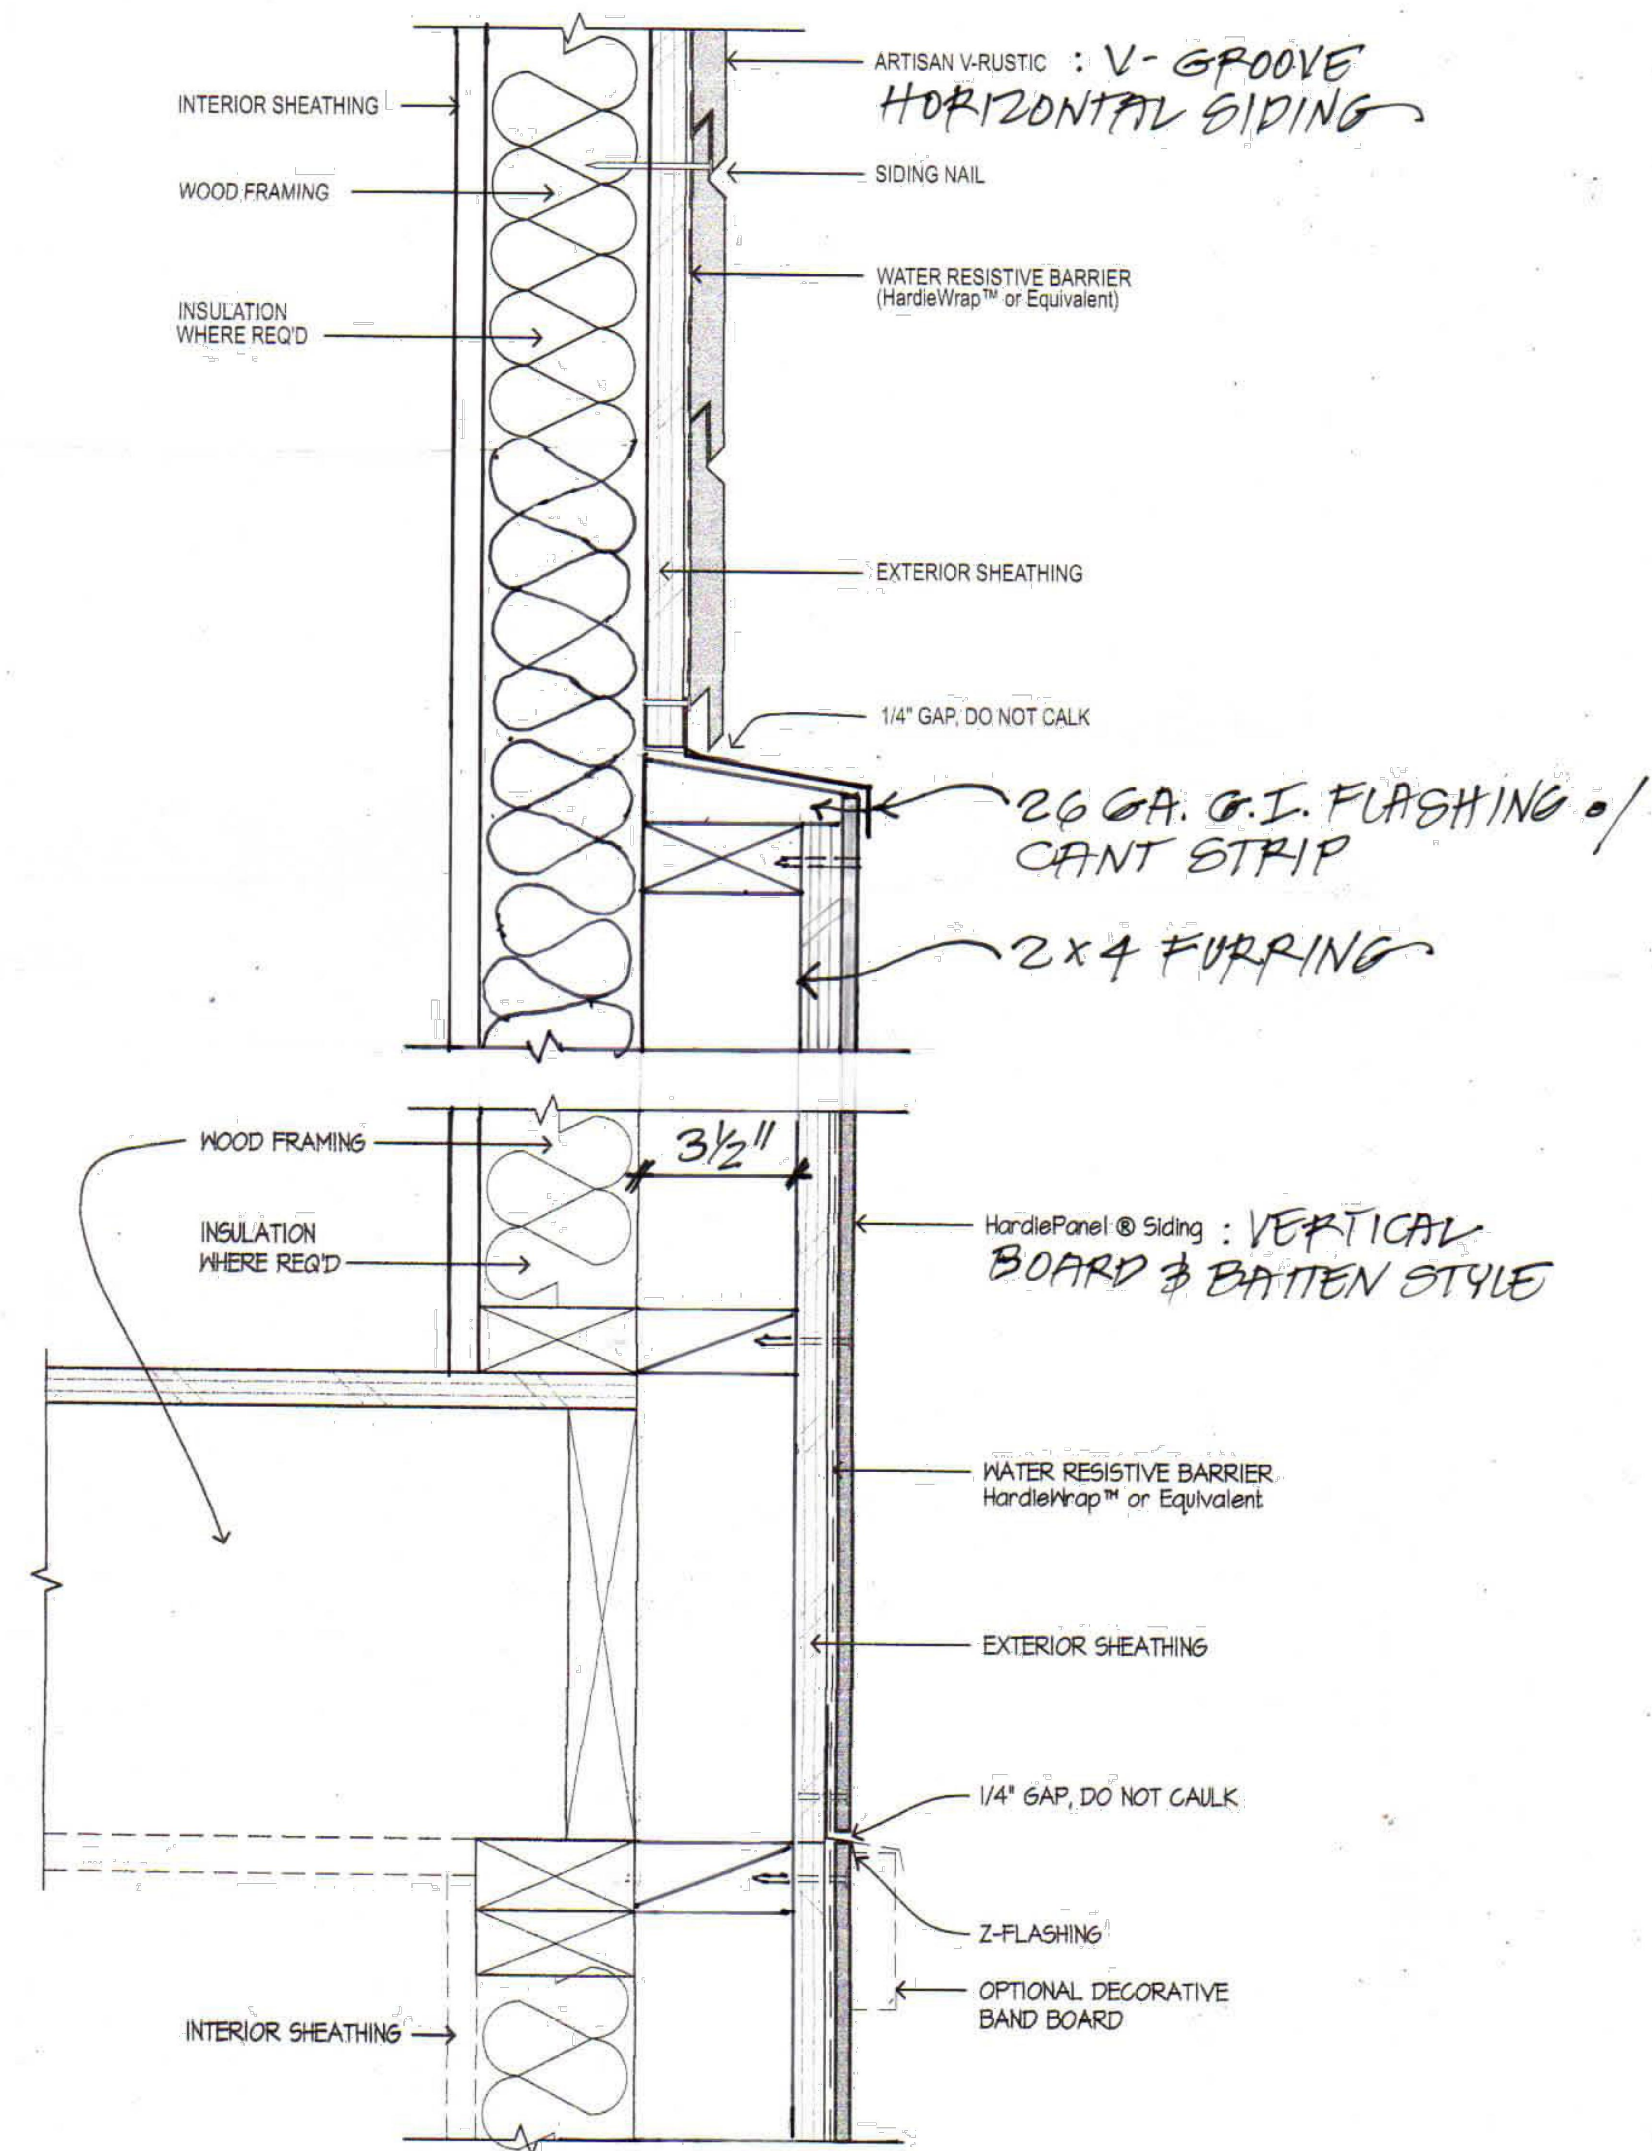

3 SIDING @ FURRED WALL
N.T.S.

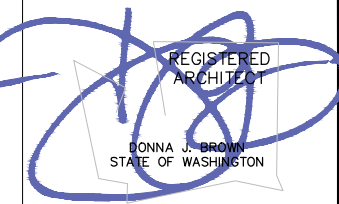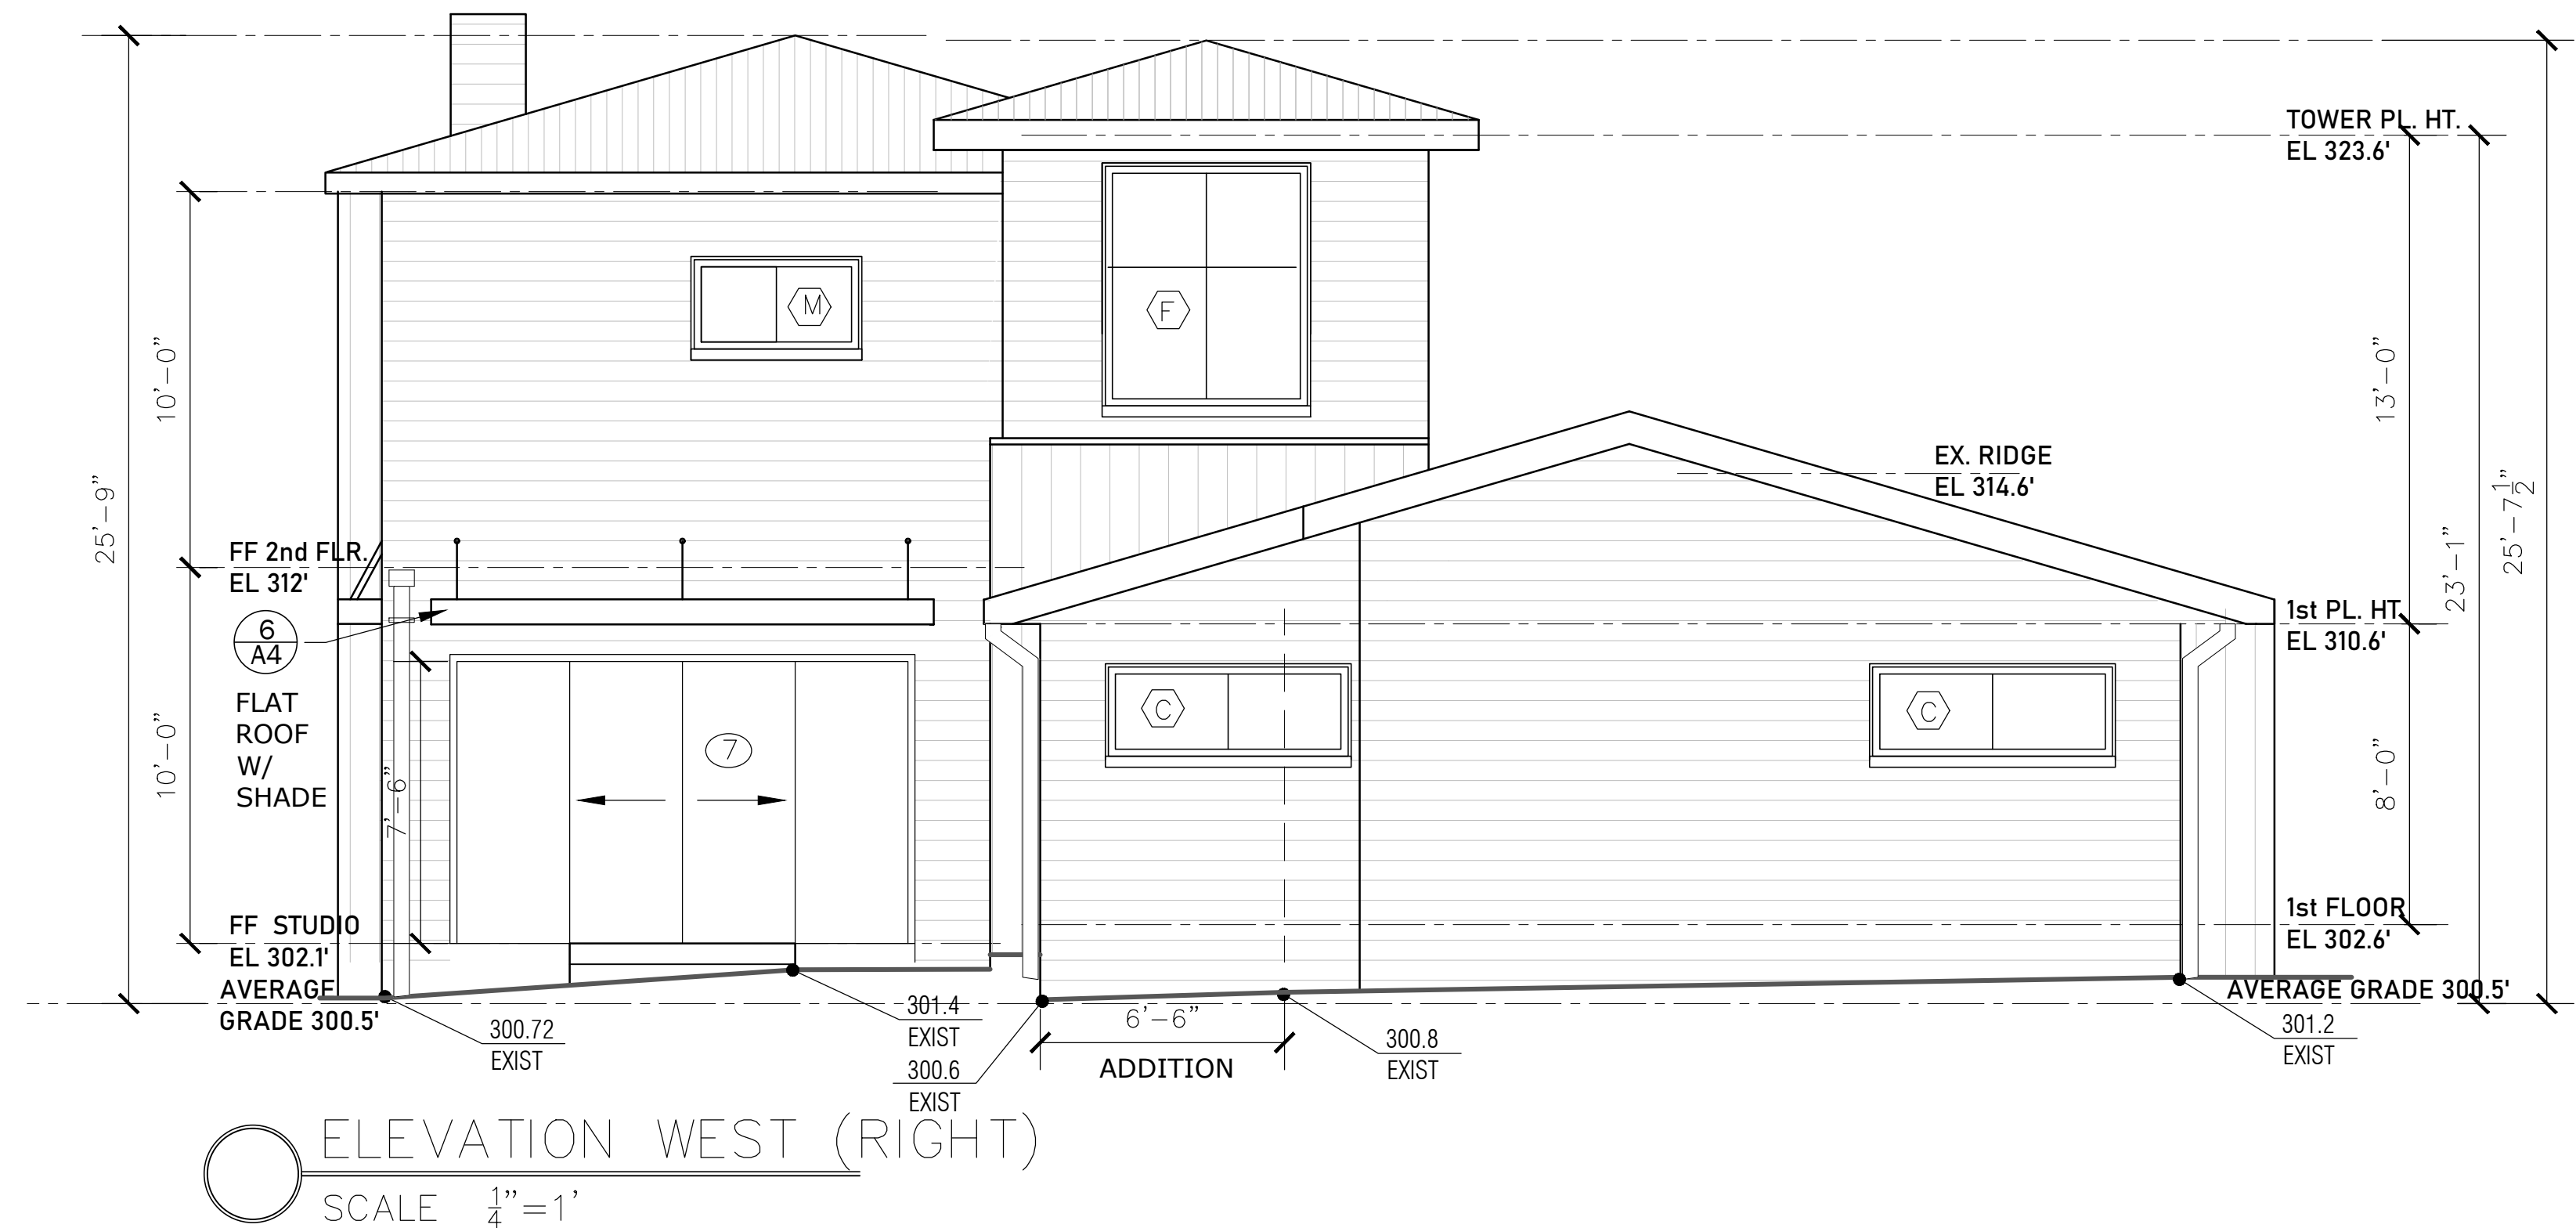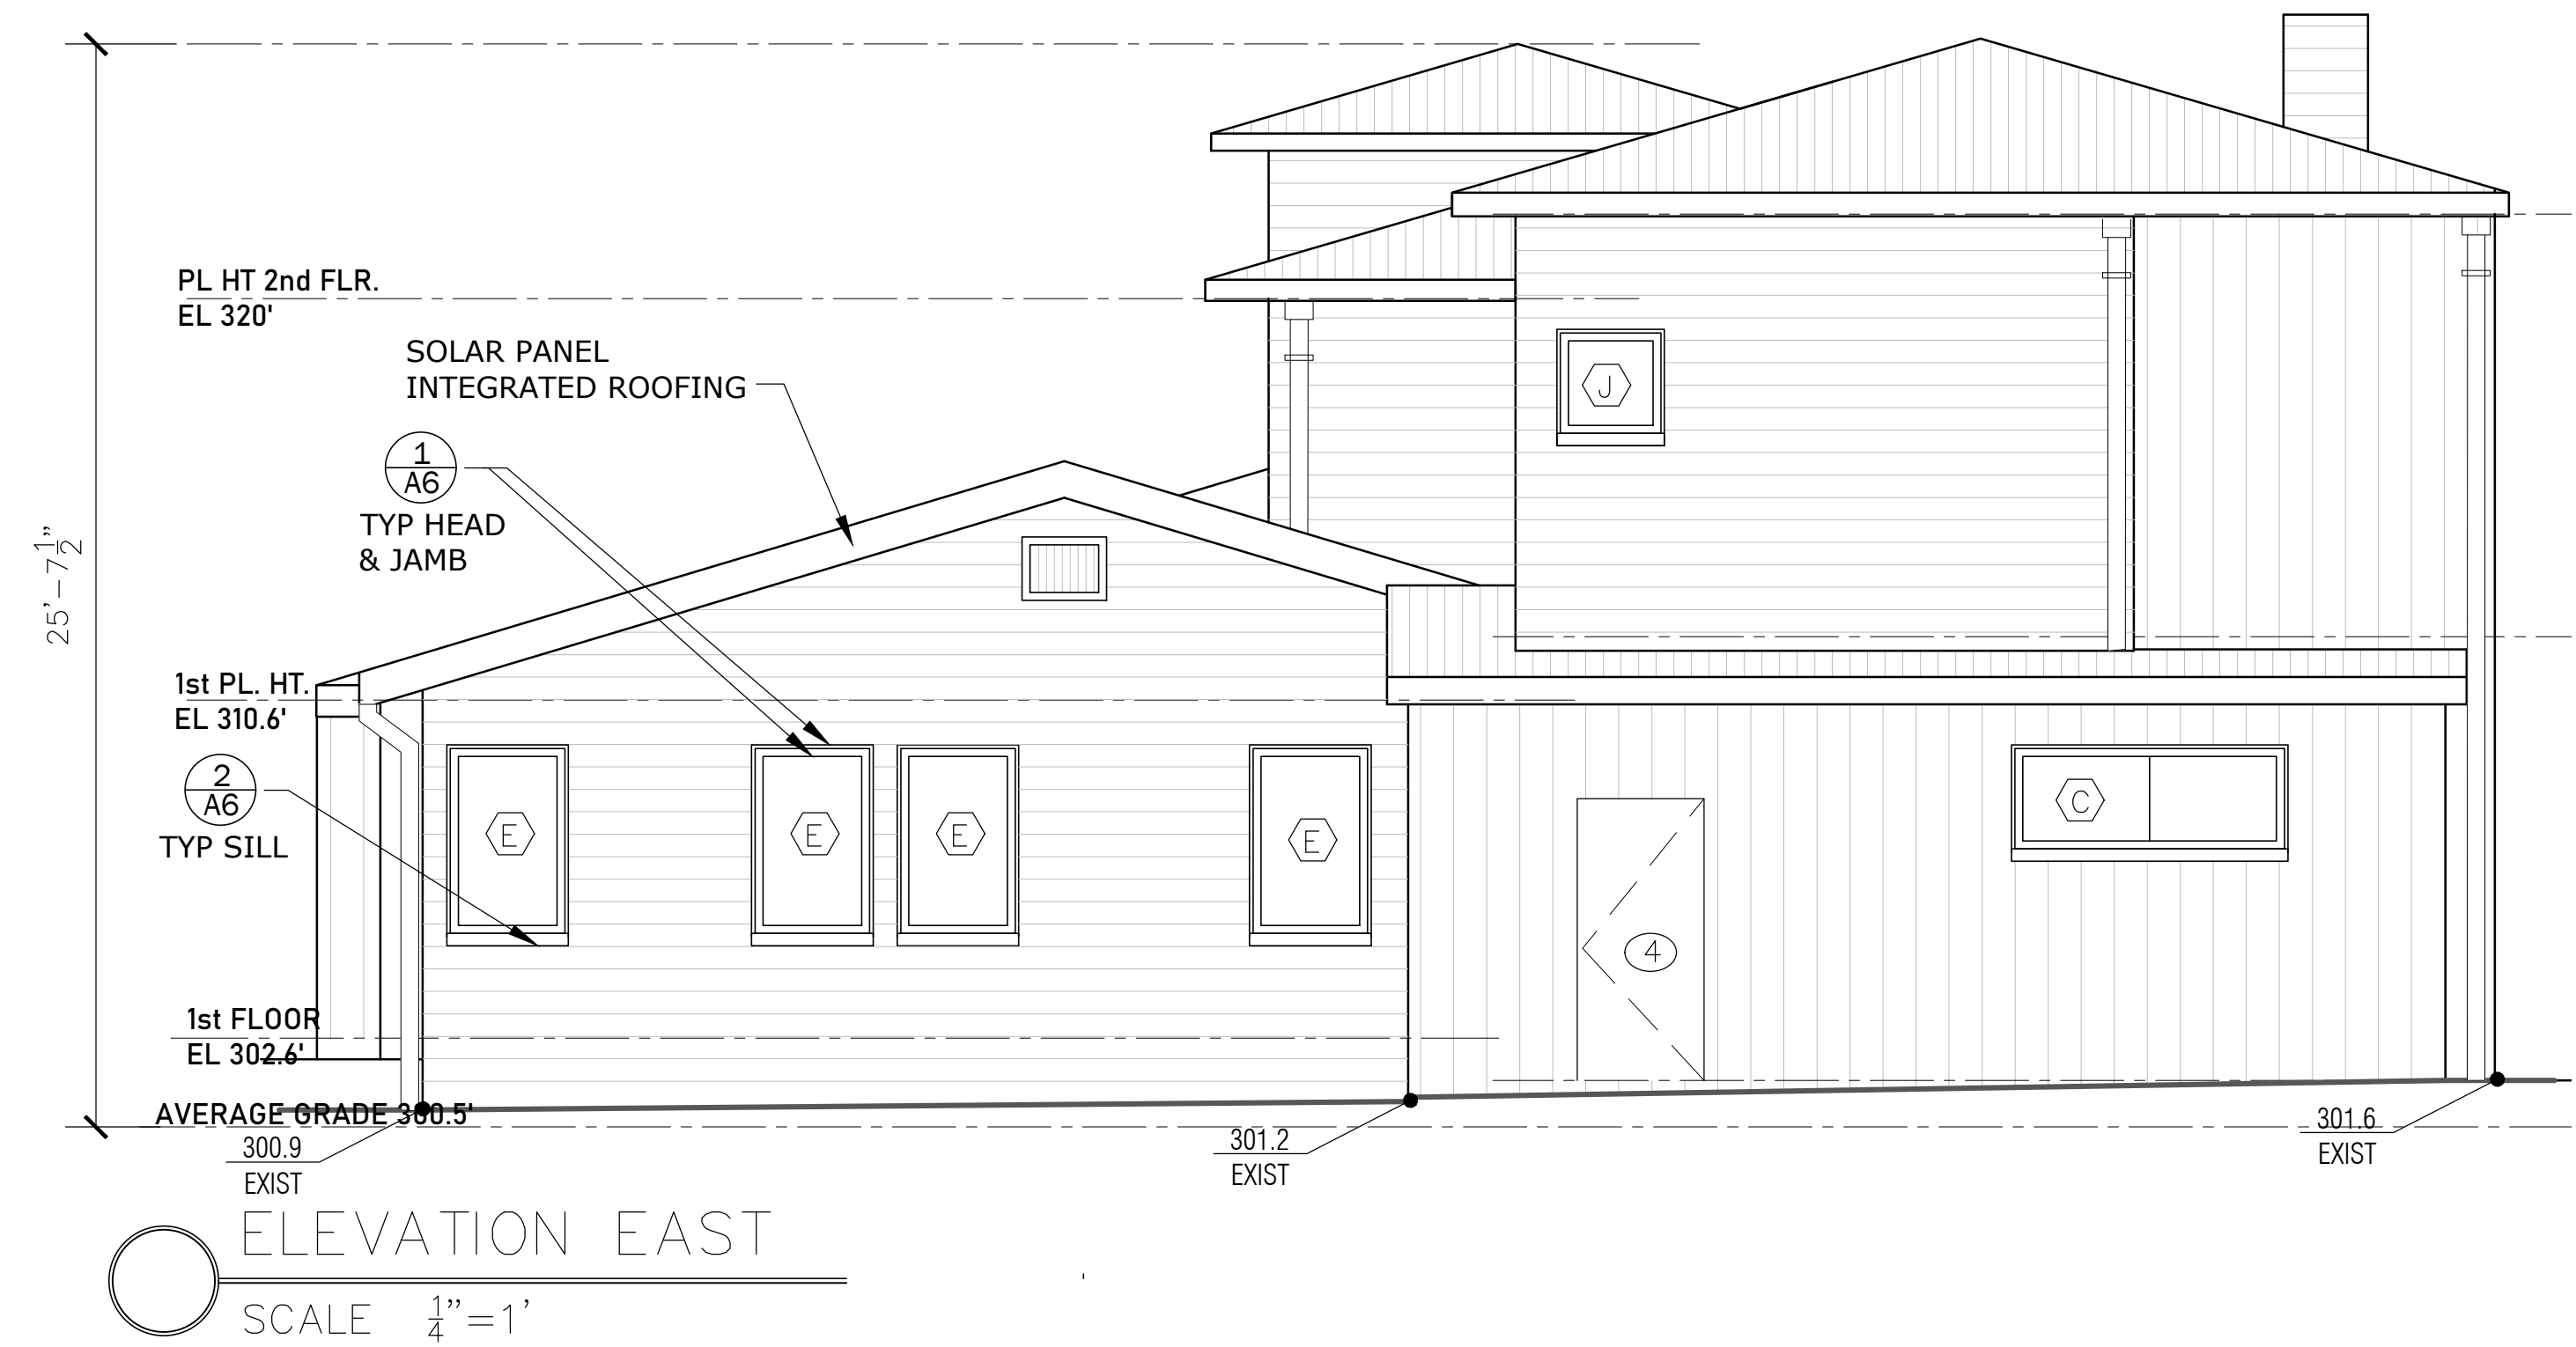

Donna Jean Brown Architect
10751 - 4th Ave NW Seattle, WA 98177
206.949.9939 mobile 206.547.7860 land/ fax
Donna@DJBArchitect.com



THYGESEN RESIDENCE
8109 SE 71ST STREET
MERCER ISLAND, WA 98040

SUBMIT

DATE: 7-31-2024

ELEVATIONS
DETAILS

REVISIONS

2-19-2025




2.

3.

4.

A-6


SHEET 6 OF 9

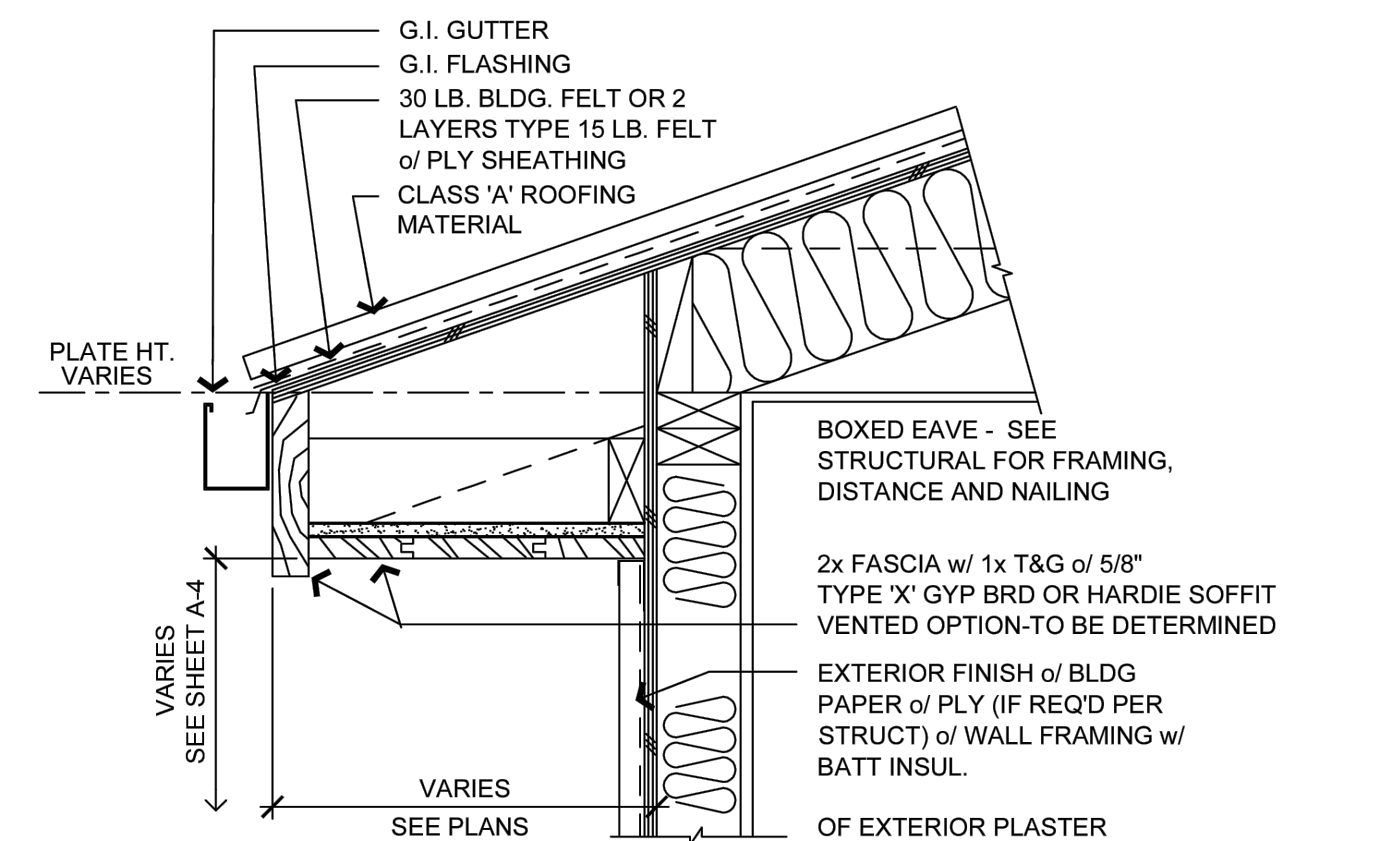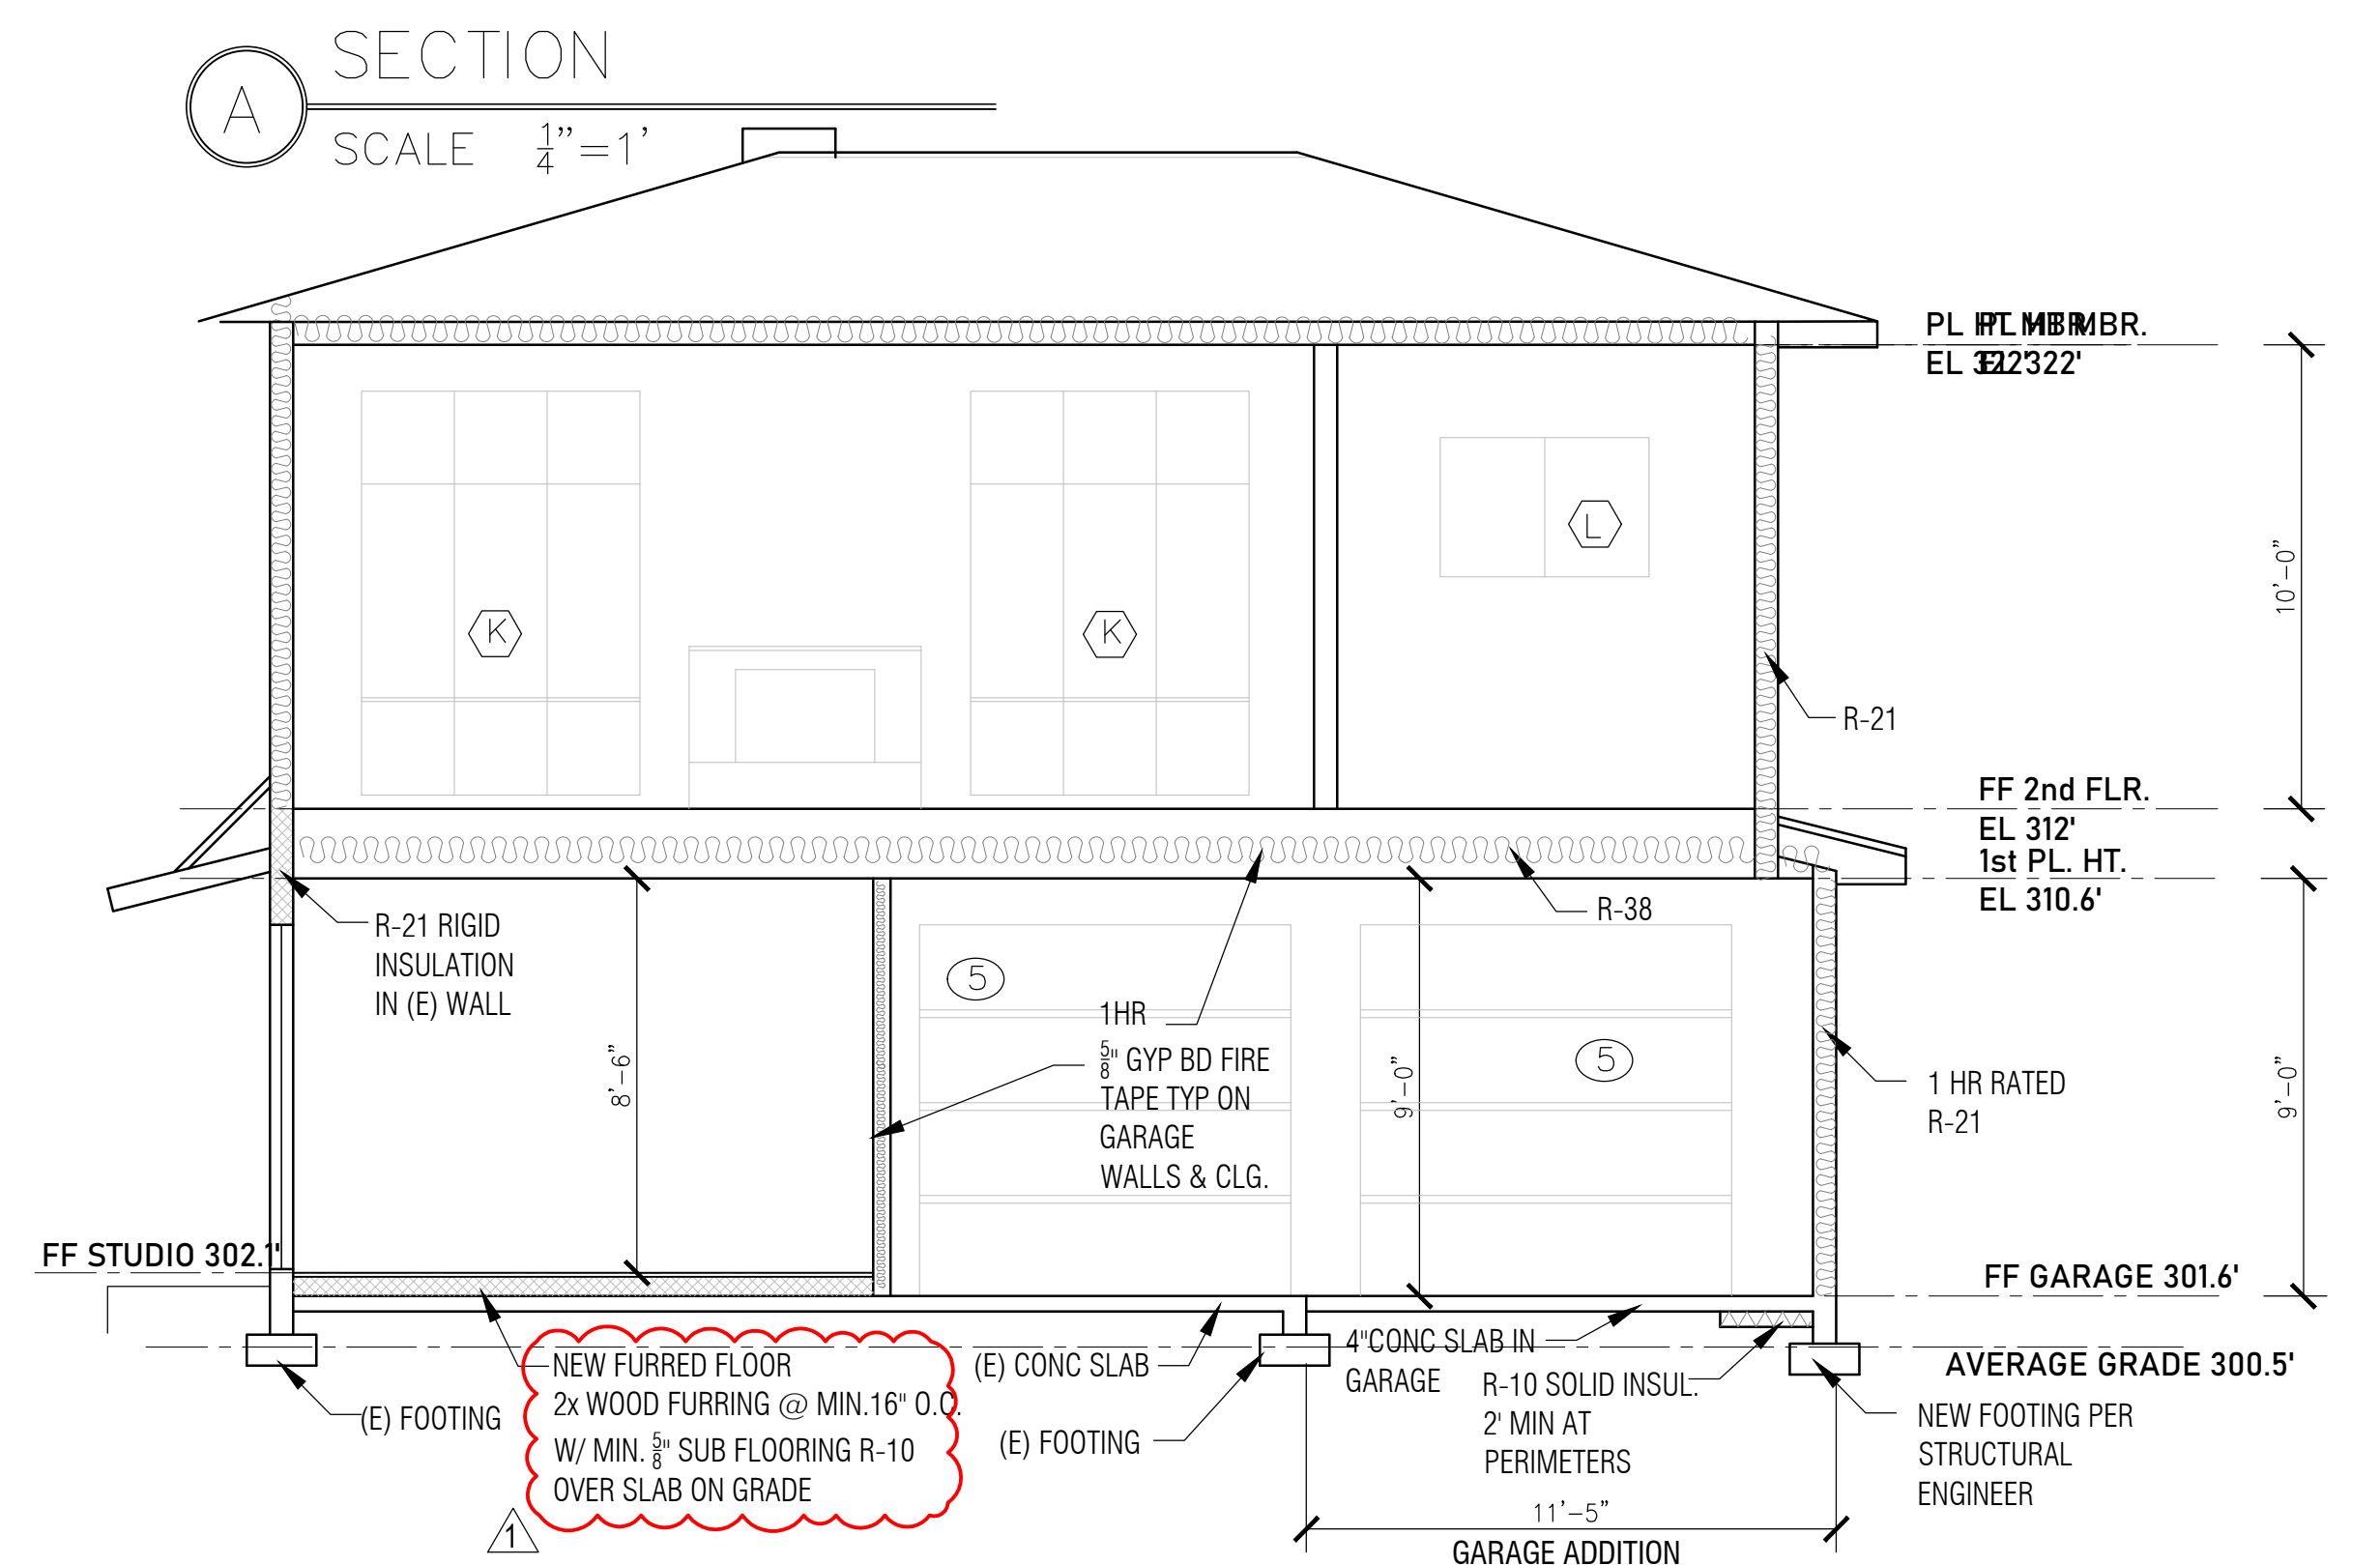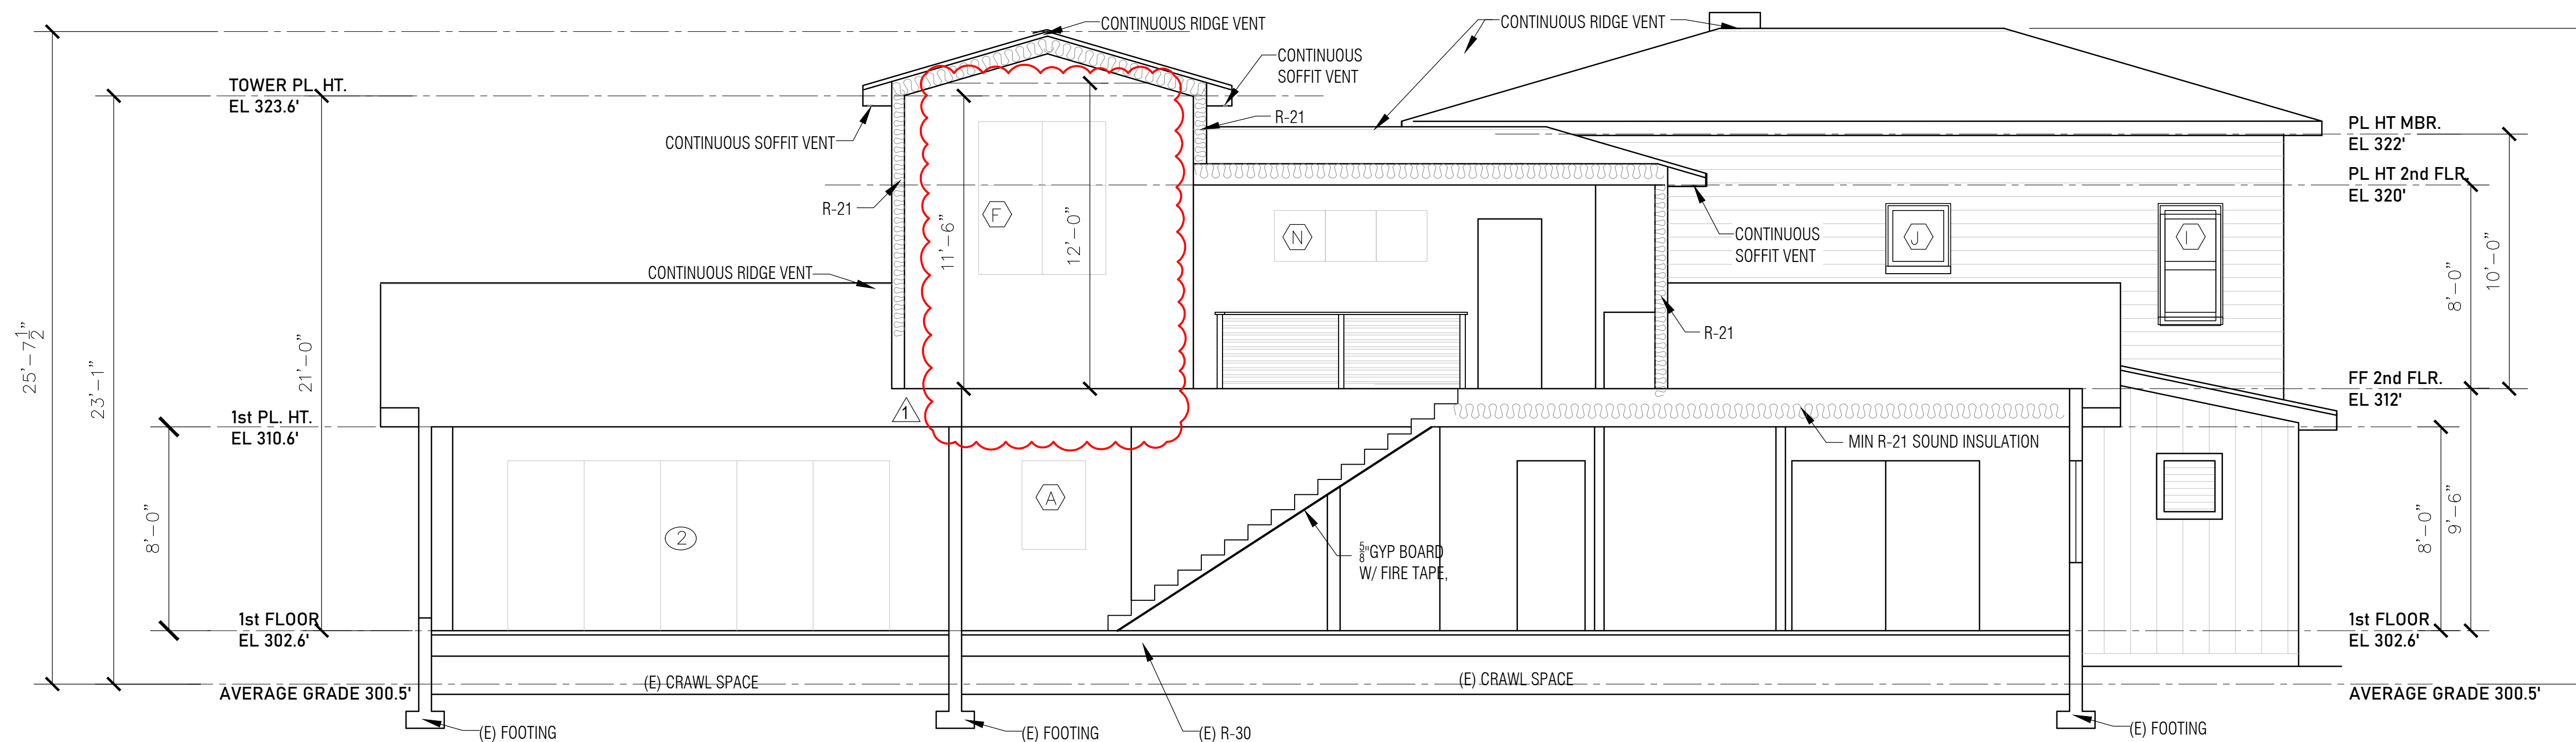

TYPICAL WALL DETAIL

NO SCALE

- 1A
- * ROOFING PER STRUCTURAL PLAN
 - * R-49 BATT INSULATION
 - * VENTILATION: 15F/150SF NEW ROOF @ ATTIC
 - * CONT RIDGE VENT AND LINER SHINGLE CONT VENT NO EAVE SOFFIT VENT, TYP.
 - * MIN 1" AIRSPACE BETWEEN INSULATION AND ROOF SHEATHING TYPICAL
 - * (2) LAYERS 30# ROOFING FELT
 - * 25 YEAR CLASS "A" RATED ASPHALT SHINGLE ROOFING
 - * METAL DRIP EDGE
- EAVE ASSEMBLY:
- 2
- * EXTEND LAST COURSE OF ROOF SHEATHING $\frac{5}{8}$ " FRX OR OTHER APPROVED 1-HOUR FIRE RESISTIVE PRESSURE TREATED PLYWOOD SHEATHING
 - * (1) LAYER $\frac{5}{8}$ " CertainTeed's M2Tech® Moisture Resistant GWB
 - * (1) LAYER HARDIE SOFFIT CEMENTIOUS BEAD BOARD
 - * EXPOSED RAFTER TAILS TO BE 2x FRX OR OTHER FIRE RESISTIVE PRESSURE TREATED WOOD
 - * CAULK/SEAL/TAPE ALL JOINTS
- TYP FLOORING SYSTEM:
- 3
- * 2x10 @ 16" O.C.
 - * R-13 SOUND INSULATION
 - * $\frac{3}{4}$ " PLYWOOD SUBFLOOR
 - * WOOD FINISH FLOORING
 - * $\frac{1}{2}$ " GWB CEILING OR
 - * $\frac{3}{8}$ " CDX GYP BOARD, FIRE TAPED TO MEET 1 HR RATED (GARAGE)
- TYPICAL EXTERIOR WALL SYSTEM
- 4
- * 1/2" INTERIOR GWB OR
 - * $\frac{3}{8}$ " CDX GYP BOARD, FIRE TAPED TO MEET 1 HR RATED (GARAGE)
 - * 2x FRAMING @ 16" o.c. (OR PER SHEAR WALL SCHED.)
 - * R-10 MIN RIGID INSUL @ DOOR/WINDOW HEADERS
 - * R-21 INSULATION
 - * SHEATHING PER SHEAR WALL SCHED.
 - * (SHEAR PLY ON OUTSIDE @ NEW)
 - * (2) LAYERS 15# BUILDING PAPER
 - * DRIP SCREED OF 26 GA. METAL w/31/2" FLANGE TO TOP OF CONCRETE (IF APPLICABLE)
 - * HARDI PLANK SIDING
- FLOORING SYSTEM
- 5
- * CONC. FOOTINGS PER PLAN
 - * EX. 4" CONCRETE SLAB ON GRADE
 - * SLAB OVER 4" SAND
 - * R-10 SOLID INSULATION
 - * SAND OVER 6-MIL VISQUEEN VAPOR BARRIER
 - * ENGINEERED FLOORING
 - * P.T. SILL PLATE @ ALL WOOD/CONC. CONTACT POINTS

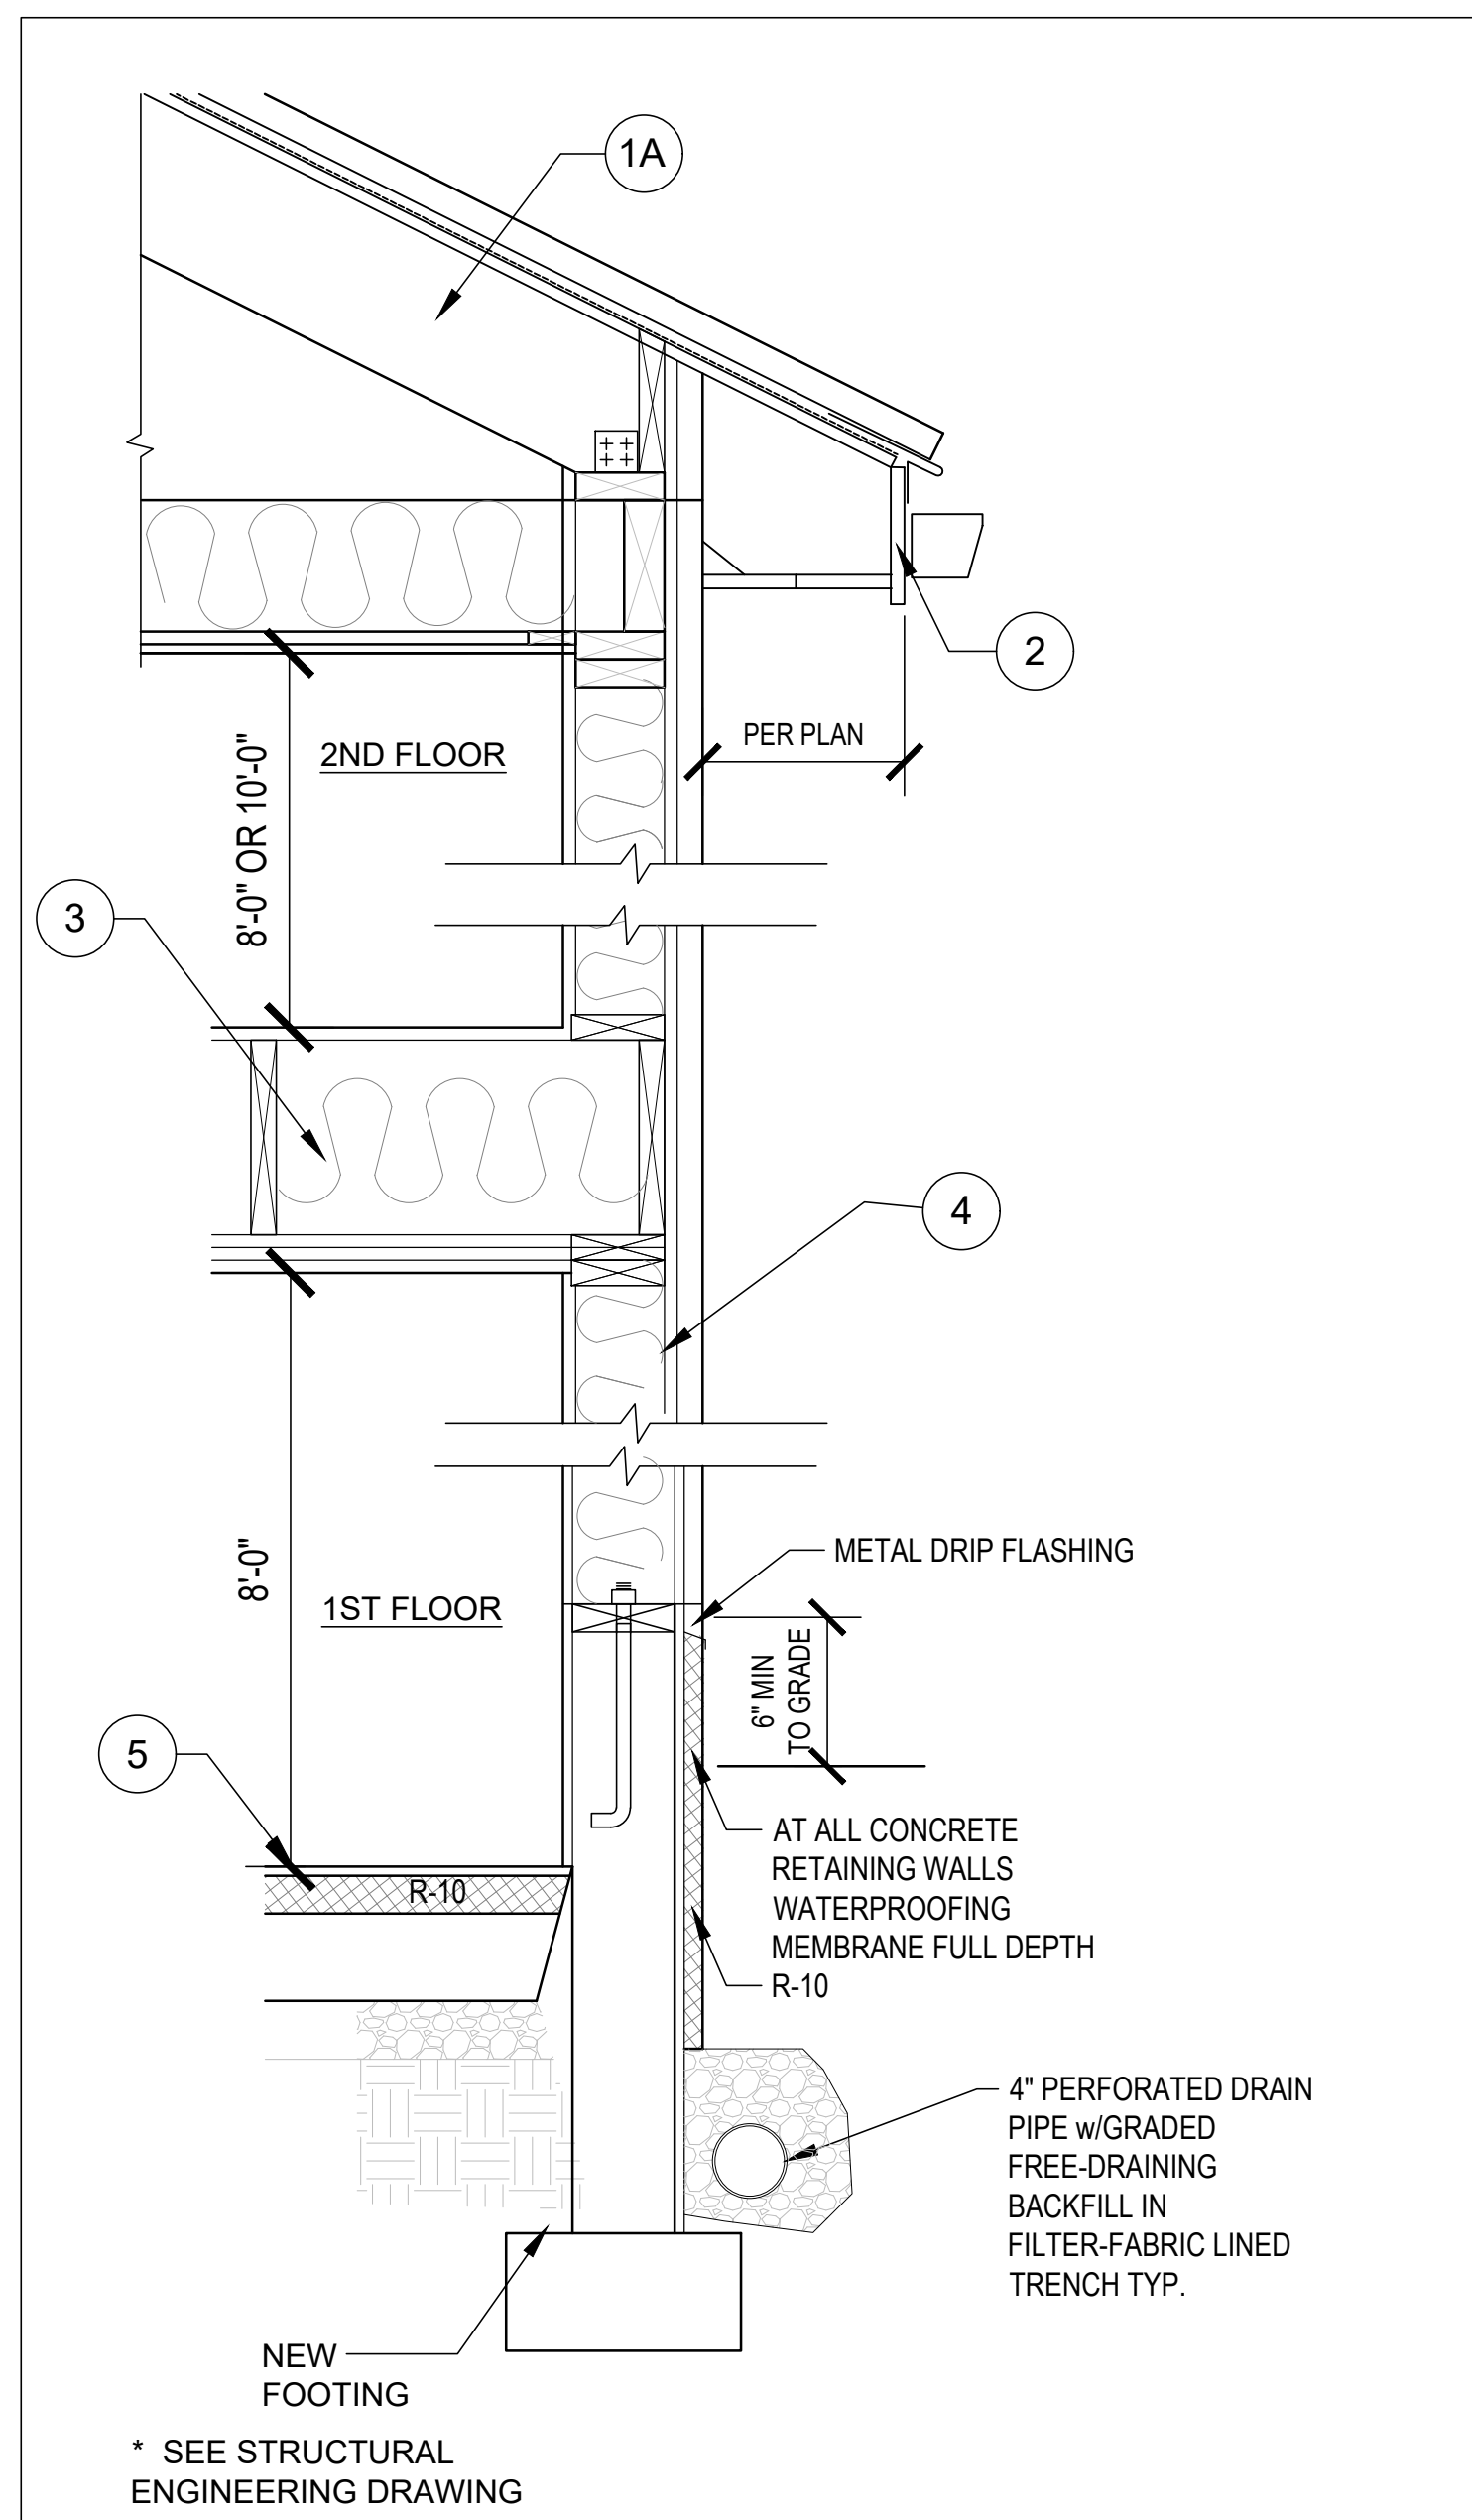

* SEE STRUCTURAL
ENGINEERING DRAWING

REGISTERED
ARCHITECT

DONNA J. BROWN
STATE OF WASHINGTON

10751 - 4th Ave NW Seattle, WA 98177
206.949.9939 mobile 206.547.7860 land/ fax
Donna@DJBArchitect.com



HYGESEN RESIDENCE
8109 SE 71ST STREET
MERCER ISLAND, WA 98040

BMIT

TE:10-31-2024


SECTIONS DETAILS

REVISIONS

2-19-2025


A-7

SHEET 7 OF 9

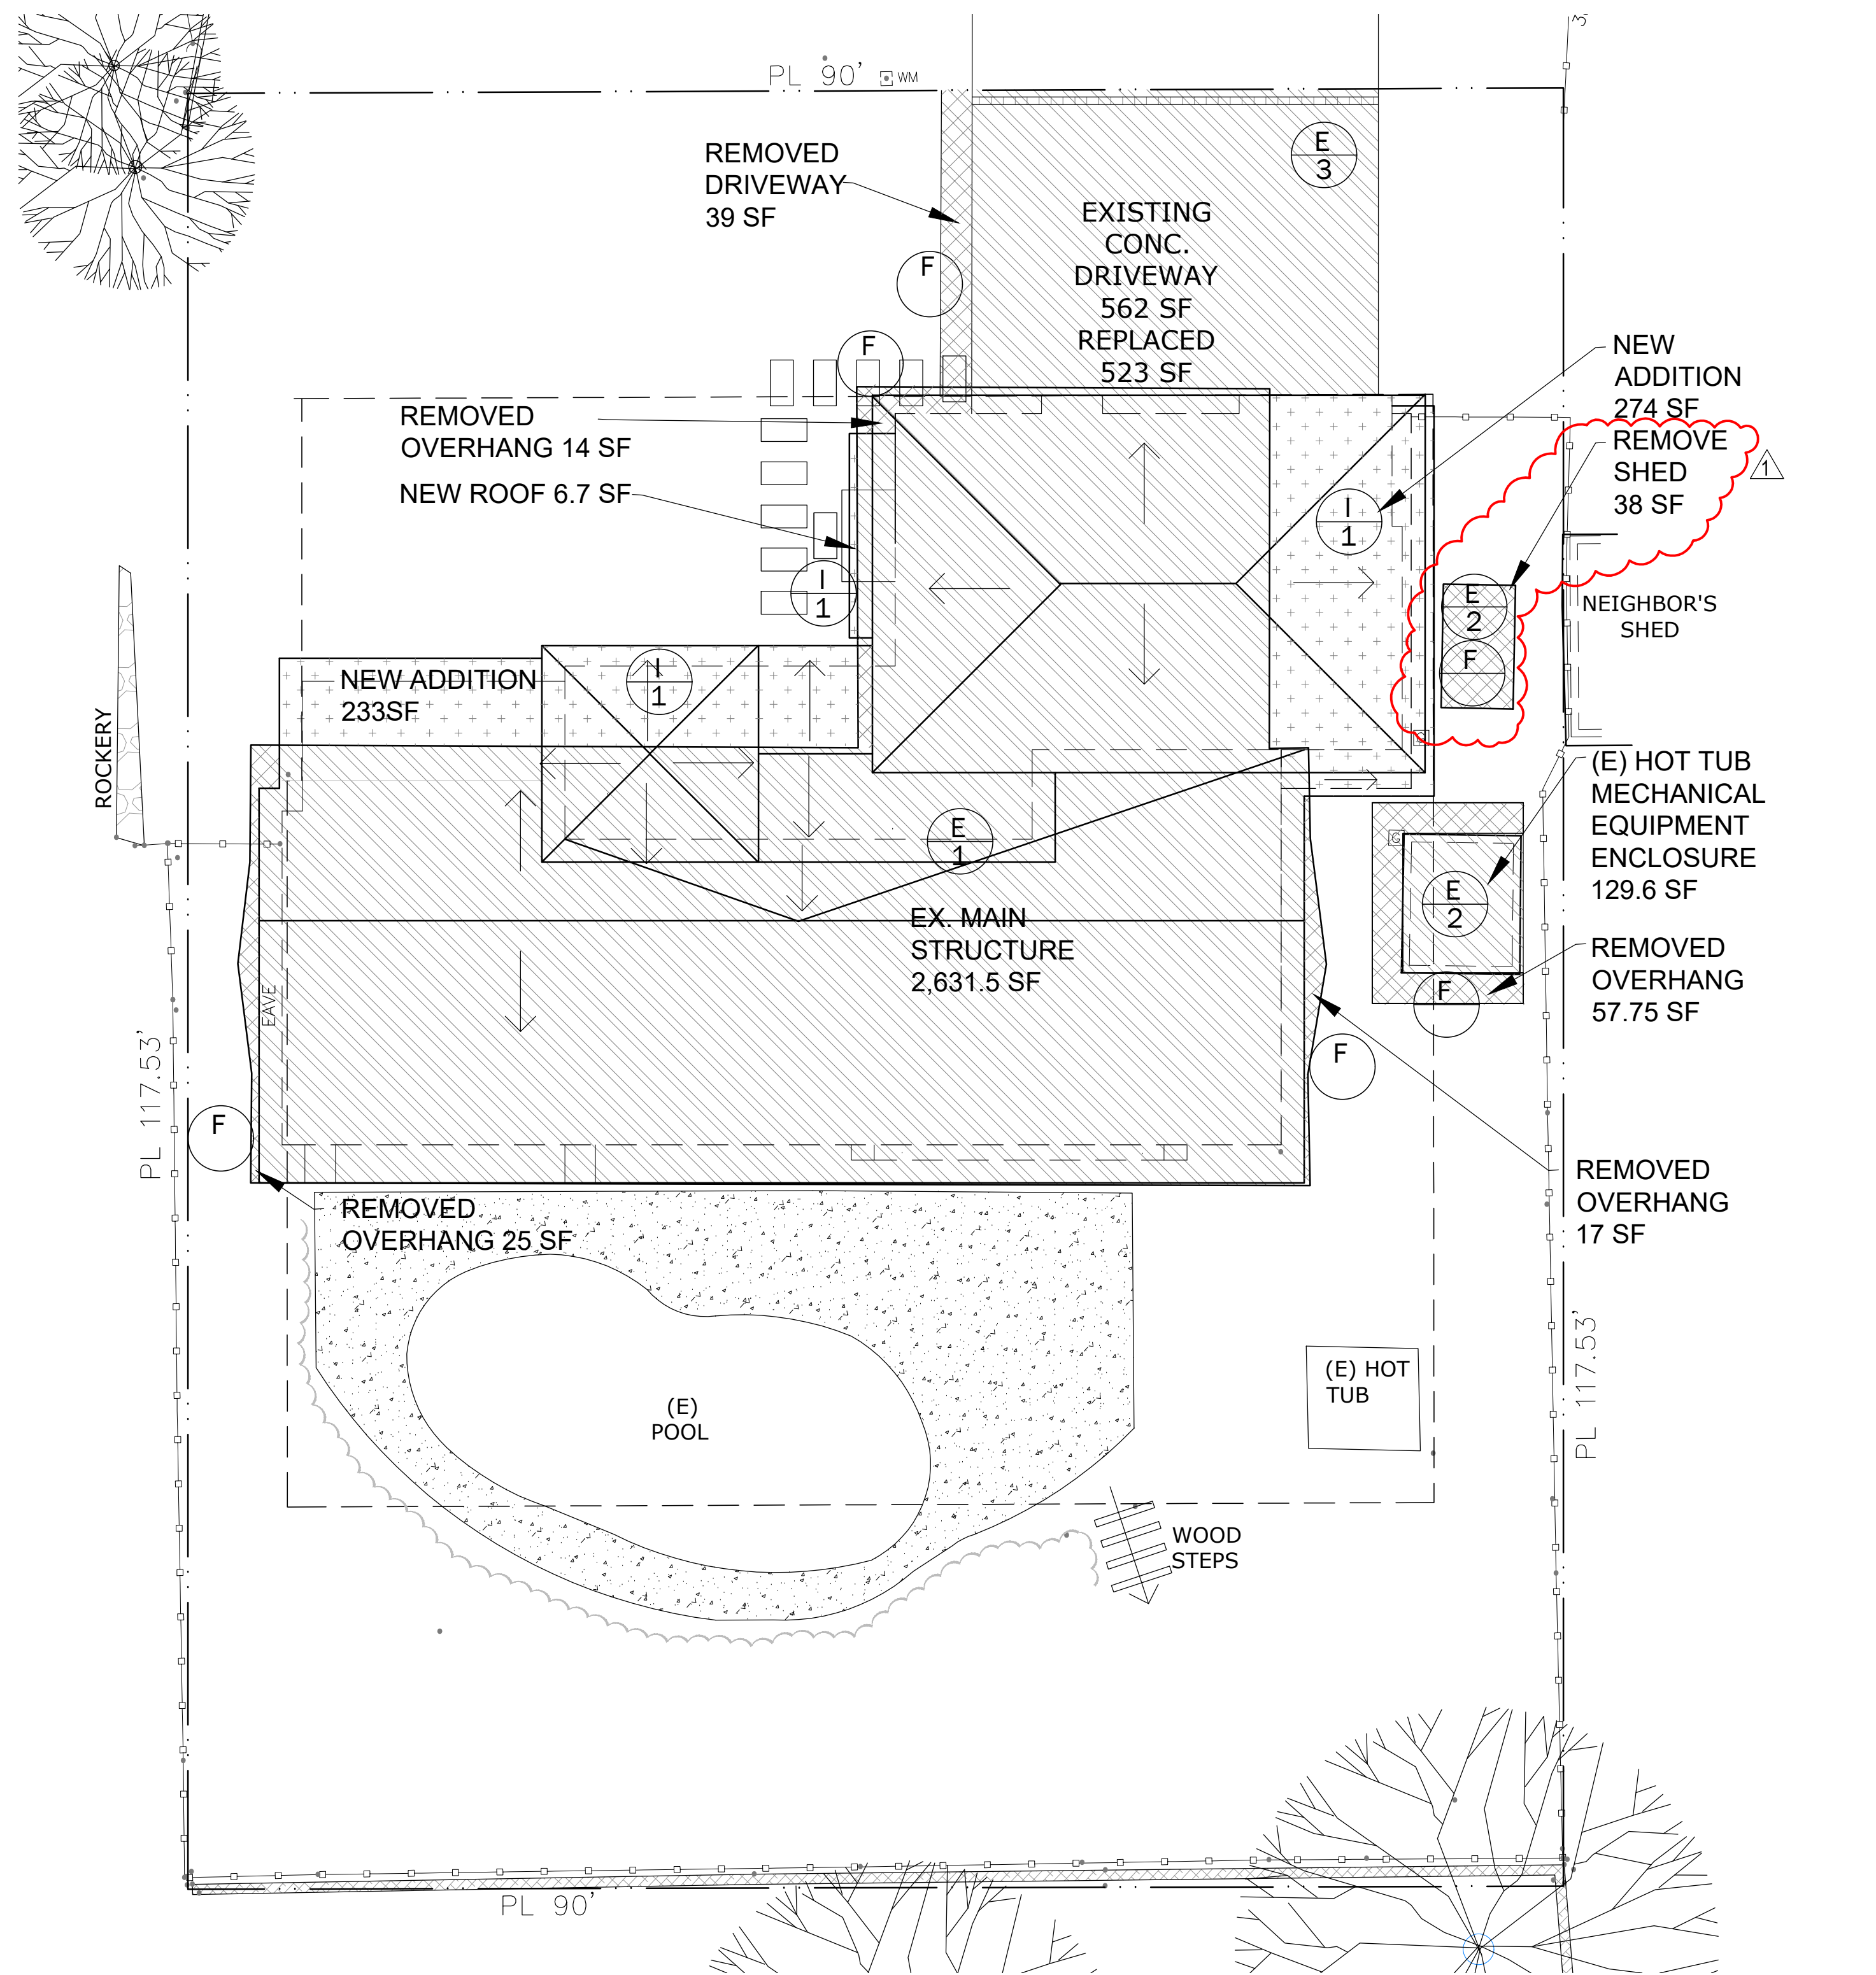


	E EXISTING	
	E.1 MAIN STRUCTURE	2,631.5 SF
	E.2 ACCESSORY BUILDING	167.6 SF
	E.3 DRIVEWAY	562 SF
	TOTAL EXISTING	3,361.1 SF
	F REMOVED	- 190.75 SF
	I NEW LOT COVERAGE	
	I.1 MAIN STRUCTURE	513.7 SF
	TOTAL:	3,684 SF
	3,684 SF / 10,578 SF =	35%
	ALLOWED 40%	

LOT COVERAGE CALCULATION
SCALE 1/8"=1'-0"

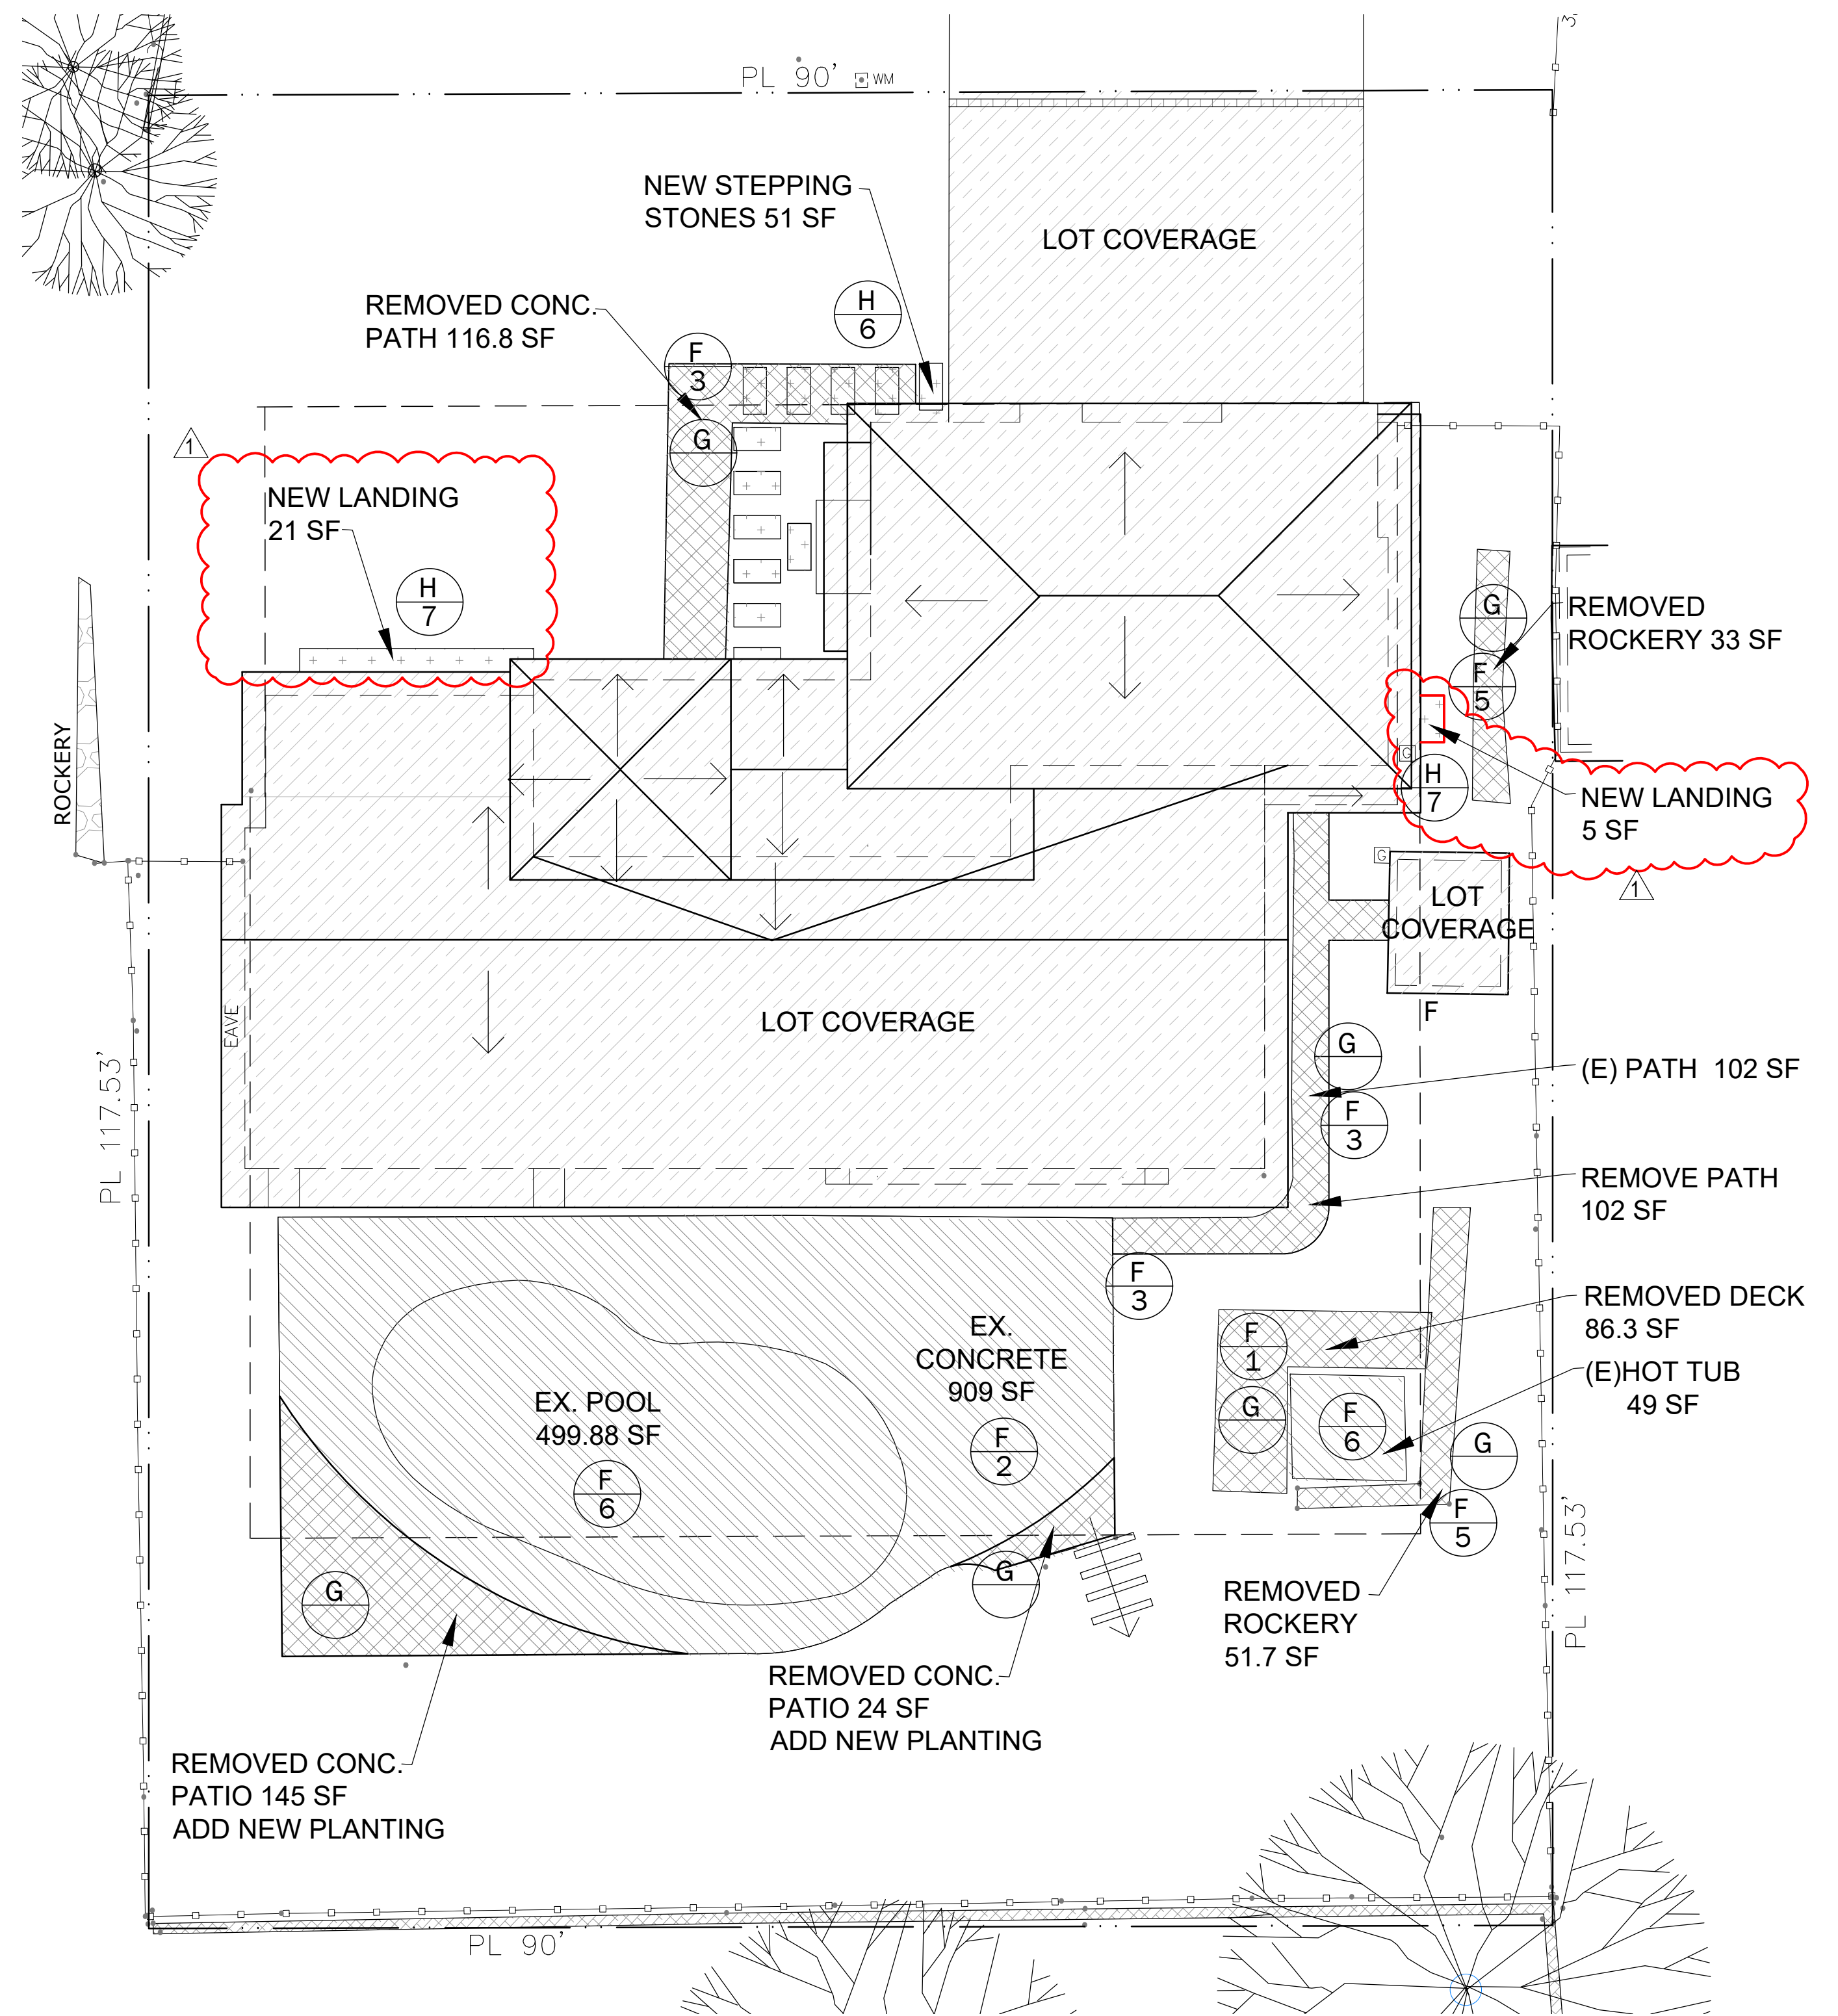

	F EXISTING HARDSCAPE	
	F.1 UNCOVERED DECKS	86.3 SF
	F.2 UNCOVERED PATIOS	909 SF
	F.3 WALKWAYS	218.8 SF
	F.5 ROCKERY	84.7 SF
	F.6 HOT TUB, POOL	548.9 SF
	TOTAL EXISTING	1,847.7 SF
	G REMOVED	- 558.8 SF
	H NEW HARDSCAPE	
	H.6 STEPPING STONES	51.0 SF
	H.7 LANDINGS	26.0 SF
	TOTAL:	1,365.9 SF
	1,366SF / 10,578 SF =	12.9%

HARDSCAPE CALCULATION
SCALE 1/8"=1'-0"

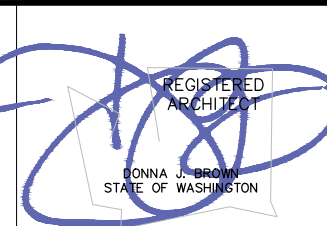

Donna Jean Brown Architect
10751 - 4th Ave NW Seattle, WA 98177
206.949.9939 mobile 206.547.7860 land/ fax
Donna@DJBArchitect.com



THYGESEN RESIDENCE
8109 SE 71ST STREET
MERCER ISLAND, WA 98040

SUBMIT

DATE: 10-31-2024

LOT COVERAGE & HARDSCAPE CALCULATIONS

REVISIONS

2-19-2025

2.

3.

4.

A-8

SHEET 8 OF 9

1. A FIRST GROUND DISTURBANCE INSPECTION IS REQUIRED PRIOR TO START OF WORK ON ALL SITES WITH LAND DISTURBING ACTIVITY.
2. THE APPLICANT SHALL DESIGNATE AN EROSION AND SEDIMENT CONTROL (ESC) SUPERVISOR WHO SHALL BE RESPONSIBLE FOR THE INSTALLATION AND MAINTENANCE OF EROSION AND SEDIMENT CONTROL BEST MANAGEMENT PRACTICES (BMPs). FOR LARGE CONSTRUCTION PROJECTS, THE ESC SUPERVISOR SHOULD BE A CERTIFIED EROSION AND SEDIMENT CONTROL LEAD (CESCL). (CESCL PROVIDE THE NAME AND PHONE NUMBER OF THE ESC SUPERVISOR TO THE SITE INSPECTOR AT THE FIRST GROUND DISTURBANCE INSPECTION.
3. BMPs SHALL BE INSTALLED PRIOR TO STARTING CONSTRUCTION TO ENSURE SEDIMENT-LADEN WATER DOES NOT LEAVE THE PROJECT SITE OR ENTER ROADSIDE DITCHES, STORM DRAINS, SURFACE WATERS, OR WETLANDS.
4. THE BMPs INCLUDED IN THIS PLAN ARE THE MINIMUM REQUIREMENTS FOR ANTICIPATED SITE CONDITIONS. THE APPLICANT IS RESPONSIBLE FOR ENSURING THAT BMPs ARE MODIFIED AS NEEDED FOR UNEXPECTED STORM EVENTS OR OTHER UNFORESEEN CIRCUMSTANCES, AND TO ACCOUNT FOR CHANGING SITE CONDITIONS.
5. ANY AREAS OF DISTURBED SOIL THAT WILL NOT BE WORKED FOR TWO CONSECUTIVE DAYS DURING THE WET SEASON (OCT 1 TO APRIL 30) OR SEVEN DAYS DURING THE DRY SEASON (MAY 1 TO SEPT 30) SHALL BE IMMEDIATELY STABILIZED WITH APPROVED BMP METHODS (E.G. STRAW, MULCH, PLASTIC COVERING, COLD MIX, ETC.).
6. GRADING AND/OR SOIL DISTURBING ACTIVITIES MAY BE LIMITED OR PROHIBITED FOR CERTAIN SITES SUBJECT TO ECA STANDARDS (I.E. ECA STEEP SLOPES, LANDSLIDE PRONE AREAS, ETC.) BETWEEN OCTOBER 1ST AND APRIL 1ST. IF NOTED IN THE GEOTECHNICAL SPECIAL INSPECTIONS REQUIREMENTS, A GRADING SEASON EXTENSION LETTER (GSEL) ISSUED BY SOEL IS REQUIRED FOR ALL GRADING AND/OR SOIL DISTURBING ACTIVITIES. HOWEVER, THE GEOTECHNICAL SPECIAL INSPECTOR MUST SUBMIT ELECTRONIC APPLICATIONS FOR A GSEL USING THE SOEL PORTAL. ALLOW FOUR TO SIX WEEKS FOR PROCESSING. FAILURE TO OBTAIN THE GSEL PRIOR TO OCTOBER 31 MAY RESULT IN A WORK STOPPAGE.
7. CITY STREETS AND SIDEWALKS SHALL BE KEPT CLEAN AT ALL TIMES. NO MATERIAL SHALL BE STORED ON CITY STREETS OR SIDEWALKS WITHOUT A STREET USE PERMIT FROM THE SEATTLE DEPARTMENT OF TRANSPORTATION (SDOT).
8. POLLUTION CONTROL MEASURES SHALL BE FOLLOWED TO ENSURE THAT NO LIQUID PRODUCTS OR CONTAMINATED WATER ENTERS ANY STORM DRAINAGE FACILITIES OR OTHERWISE LEAVES THE PROJECT SITE. ANY HAZARDOUS MATERIALS OR LIQUID PRODUCTS THAT HAVE THE POTENTIAL TO POLLUTE RUNOFF SHALL BE STORED AND DISPOSED OF PROPERLY.
9. ENSURE THAT WASHOUT FROM CONCRETE TRUCKS IS PERFORMED OFF-SITE OR IN DESIGNATED CONCRETE WASHOUT AREAS ONLY. DO NOT WASH OUT CONCRETE TRUCKS ONTO THE GROUND, OR TO STORM DRAINS OR OPEN DITCHES. DO NOT DUMP EXCESS CONCRETE ONSITE, EXCEPT IN DESIGNATED CONCRETE WASHOUT AREAS.
10. ALL AREAS OF DISTURBED SOIL SHALL BE FULLY STABILIZED WITH THE APPROPRIATE SOIL AMENDMENT AND COVER MEASURES AT COMPLETION OF THE PROJECT. TYPICAL COVER MEASURES INCLUDE LANDSCAPING OR HYDROSEED WITH MULCH.

THIS PLAN IS REQUIRED FOR ALL PROJECTS WITH GREATER THAN 750 SQUARE FEET OF LAND DISTURBING ACTIVITIES.

SHOW TEMPORARY AND PERMANENT BEST MANAGEMENT PRACTICES (BMPs) IN THE PLAN VIEW OF THIS SHEET THAT WILL ACCOMPLISH THE MINIMUM REQUIREMENTS DESCRIBED IN THE NARRATIVE BELOW.

THE BMPs SHOWN IN THE PLAN VIEW OF THIS PLAN ARE THE MINIMUM REQUIRED. ADDITIONAL BMPs ARE REQUIRED WHEN MINIMUM CONTROLS ARE NOT SUFFICIENT TO PREVENT EROSION OR TRANSPORT OF SEDIMENT OR OTHER POLLUTANTS FROM THE SITE.

- MARK CLEARING LIMITS
- DELINEATE ENVIRONMENTALLY CRITICAL AREAS
- RETAIN TOP LAYER AND NATIVE VEGETATION
- ESTABLISH CONSTRUCTION ACCESS
- PROTECT DOWNSTREAM PROPERTIES AND RECEIVING WATERS
- PREVENT EROSION AND SEDIMENT TRANSPORT FROM THE SITE
- STABILIZE SOILS
- PROTECT SLOPES
- PROTECT STORM DRAINS
- STABILIZE CHANNELS AND OUTLETS
- CONTROL POLLUTANTS
- CONTROL DEWATERING
- MAINTAIN AND INSPECT BMPs
- EXECUTE CONSTRUCTION STORMWATER CONTROL PLAN
- MINIMIZE OPEN TRENCHES
- PHASE THE PROJECT
- INSTALL PERMANENT FLOW CONTROL AND WATER QUALITY FACILITIES
- PROTECT STORMWATER BMPs PRIOR TO, DURING, AND AFTER CONSTRUCTION

COMPLETE CONSTRUCTION STORMWATER CONTROL BMP DETAILS AND REQUIREMENTS ARE LOCATED IN DIRECTOR'S RULE OPD 21-0125, CHAPTER 2: CONSTRUCTION STORMWATER CONTROL, OF THE SEATTLE STORMWATER MANUAL. SHOW ALL BMPs ON THIS PLAN SHEET THAT WILL BE USED TO ACHIEVE THE REQUIREMENTS ABOVE.

AT THE END OF PROJECT, ALL AREAS DISTURBED AND NOT COVERED WITH A HARD SURFACE MUST BE AMENDED PER THE SOIL AMENDMENT DETAIL BELOW AND PROBE TO 12-INCHES AT THE SITE FINAL INSPECTION.

- LABEL ALL AREAS DISTURBED AND NOT COVERED WITH A HARD SURFACE WITHIN THE SITE AS ONE OF THE FOLLOWING: SA (SOIL AMENDMENT AREA) or ND (NON-DISTURBED AREA). SEE DEFINITIONS BELOW. DO NOT REFERENCE AN ALTERNATE PLAN SHEET.
- AN ESTIMATE OF THE VOLUME OF COMPOST REQUIRED IS AUTOMATICALLY CALCULATED ON THE SITE AND DRAINAGE CONTROL SUMMARY SHEET REQUIRED ON THE DRAINAGE AND WASTEWATER CONTROL PLAN (DWG PLAN). THE ACTUAL VOLUME OF COMPOST REQUIRED WILL BE DETERMINED IN THE FIELD.

- **NO-DISTURBED AREA (ND):** VEGETATED AREAS THAT WILL NOT BE SUBJECT TO LAND DISTURBING ACTIVITY (SEE D) DO NOT REQUIRE SOIL AMENDMENT IF THEY ARE FENCED AND CONTINUOUSLY PROTECTED THROUGHOUT CONSTRUCTION. THE FENCING MUST BE IN PLACE AT THE FIRST POST-CONSTRUCTION INSPECTION. THIS WILL BE MONITORED BY THE DPO SITE INSPECTOR. NO DISTURBANCE, INCLUDING VEHICLE TRAFFIC OR MATERIAL STORAGE, IS ALLOWED IN THESE AREAS UNTIL FINAL INSPECTION. LABEL THESE AREAS AS (ND) IN THE PLAN VIEW.
- **SOIL AMENDMENT AREA (SA):** VEGETATED OR COMPOST AREAS (TURF AND LANDSCAPE) MUST BE AMENDED PER THE SOIL AMENDMENT DETAIL AND THE SUBSOL MUST BE LOOSENOED SO IT WILL PROBE TO A DEPTH OF 12 INCHES PRIOR TO SITE FINAL INSPECTION. THIS INCLUDES AREAS IMPACTED BY CLEARING AND GRADING, STOCKPILING, SITE ACCESS, PATHWAYS AND MATERIALS OR EQUIPMENT STORAGE. LABEL THESE AREAS AS (SA) IN THE PLAN VIEW.

ONLY COMPLETE THE FOLLOWING CALCULATION IF A DRAINAGE AND WASTEWATER CONTROL PLAN (DWC PLAN) IS NOT REQUIRED (E.G. SUBJECT TO FIELD INSPECTION (STFI) DEMOLITION PERMITS)

(SQUARE FEET) X 0.0062 = (CUBIC YARDS)
 AREA REQUIRING AMENDMENT (SA) REQUIRED COMPOST


The diagram illustrates two cross-sections of soil layers for different areas:

- PLANTING BEDS:**
 - Top layer: 2"-4" MULCH
 - Second layer: 3" OF COMPOST INCORPORATED INTO SOIL TO 8" DEPTH OR 8" OF IMPORT TOPSOIL SEE NOTE 3
 - Third layer: 6"
 - Bottom layer: SUBSOIL SCARIFIED 4" BELOW COMPOST AMENDED LAYER (12" BELOW SOIL SURFACE), OR AS DETERMINED BY THE CITY
- TURF (LAWN) AREAS:**
 - Top layer: GRASS: SEED OR SOD
 - Second layer: 1 3/4" OF COMPOST INCORPORATED INTO SOIL TO 8" DEPTH OR 8" OF IMPORT TOPSOIL SEE NOTE 3
 - Third layer: 6"
 - Bottom layer: SUBSOIL SCARIFIED 4" BELOW COMPOST AMENDED LAYER (12" BELOW SOIL SURFACE), OR AS DETERMINED BY THE CITY

NOTES:

1. POST CONSTRUCTION SOIL AMENDMENT IS REQUIRED ON ALL AREAS NOT COVERED BY IMPERVIOUS SURFACE WHERE SOIL IS DISTURBED DURING CONSTRUCTION.
2. SOIL AMENDMENT MUST PASS A 12 INCH MINIMUM PROBE TEST.
3. IMPORT TOPSOIL, IF USED, MUST MEET THE REQUIREMENTS OF THE 2016 SEATTLE STORMWATER MANUAL, VOL. 1, SECTIONS 5.1.5.1 AND 5.1.5.3.

SYMBOL: (SA) AREA REQUIRING SOIL AMENDMENT (ND) NON-DISTURBED AREA (SOIL AMENDMENT NOT REQUIRED)

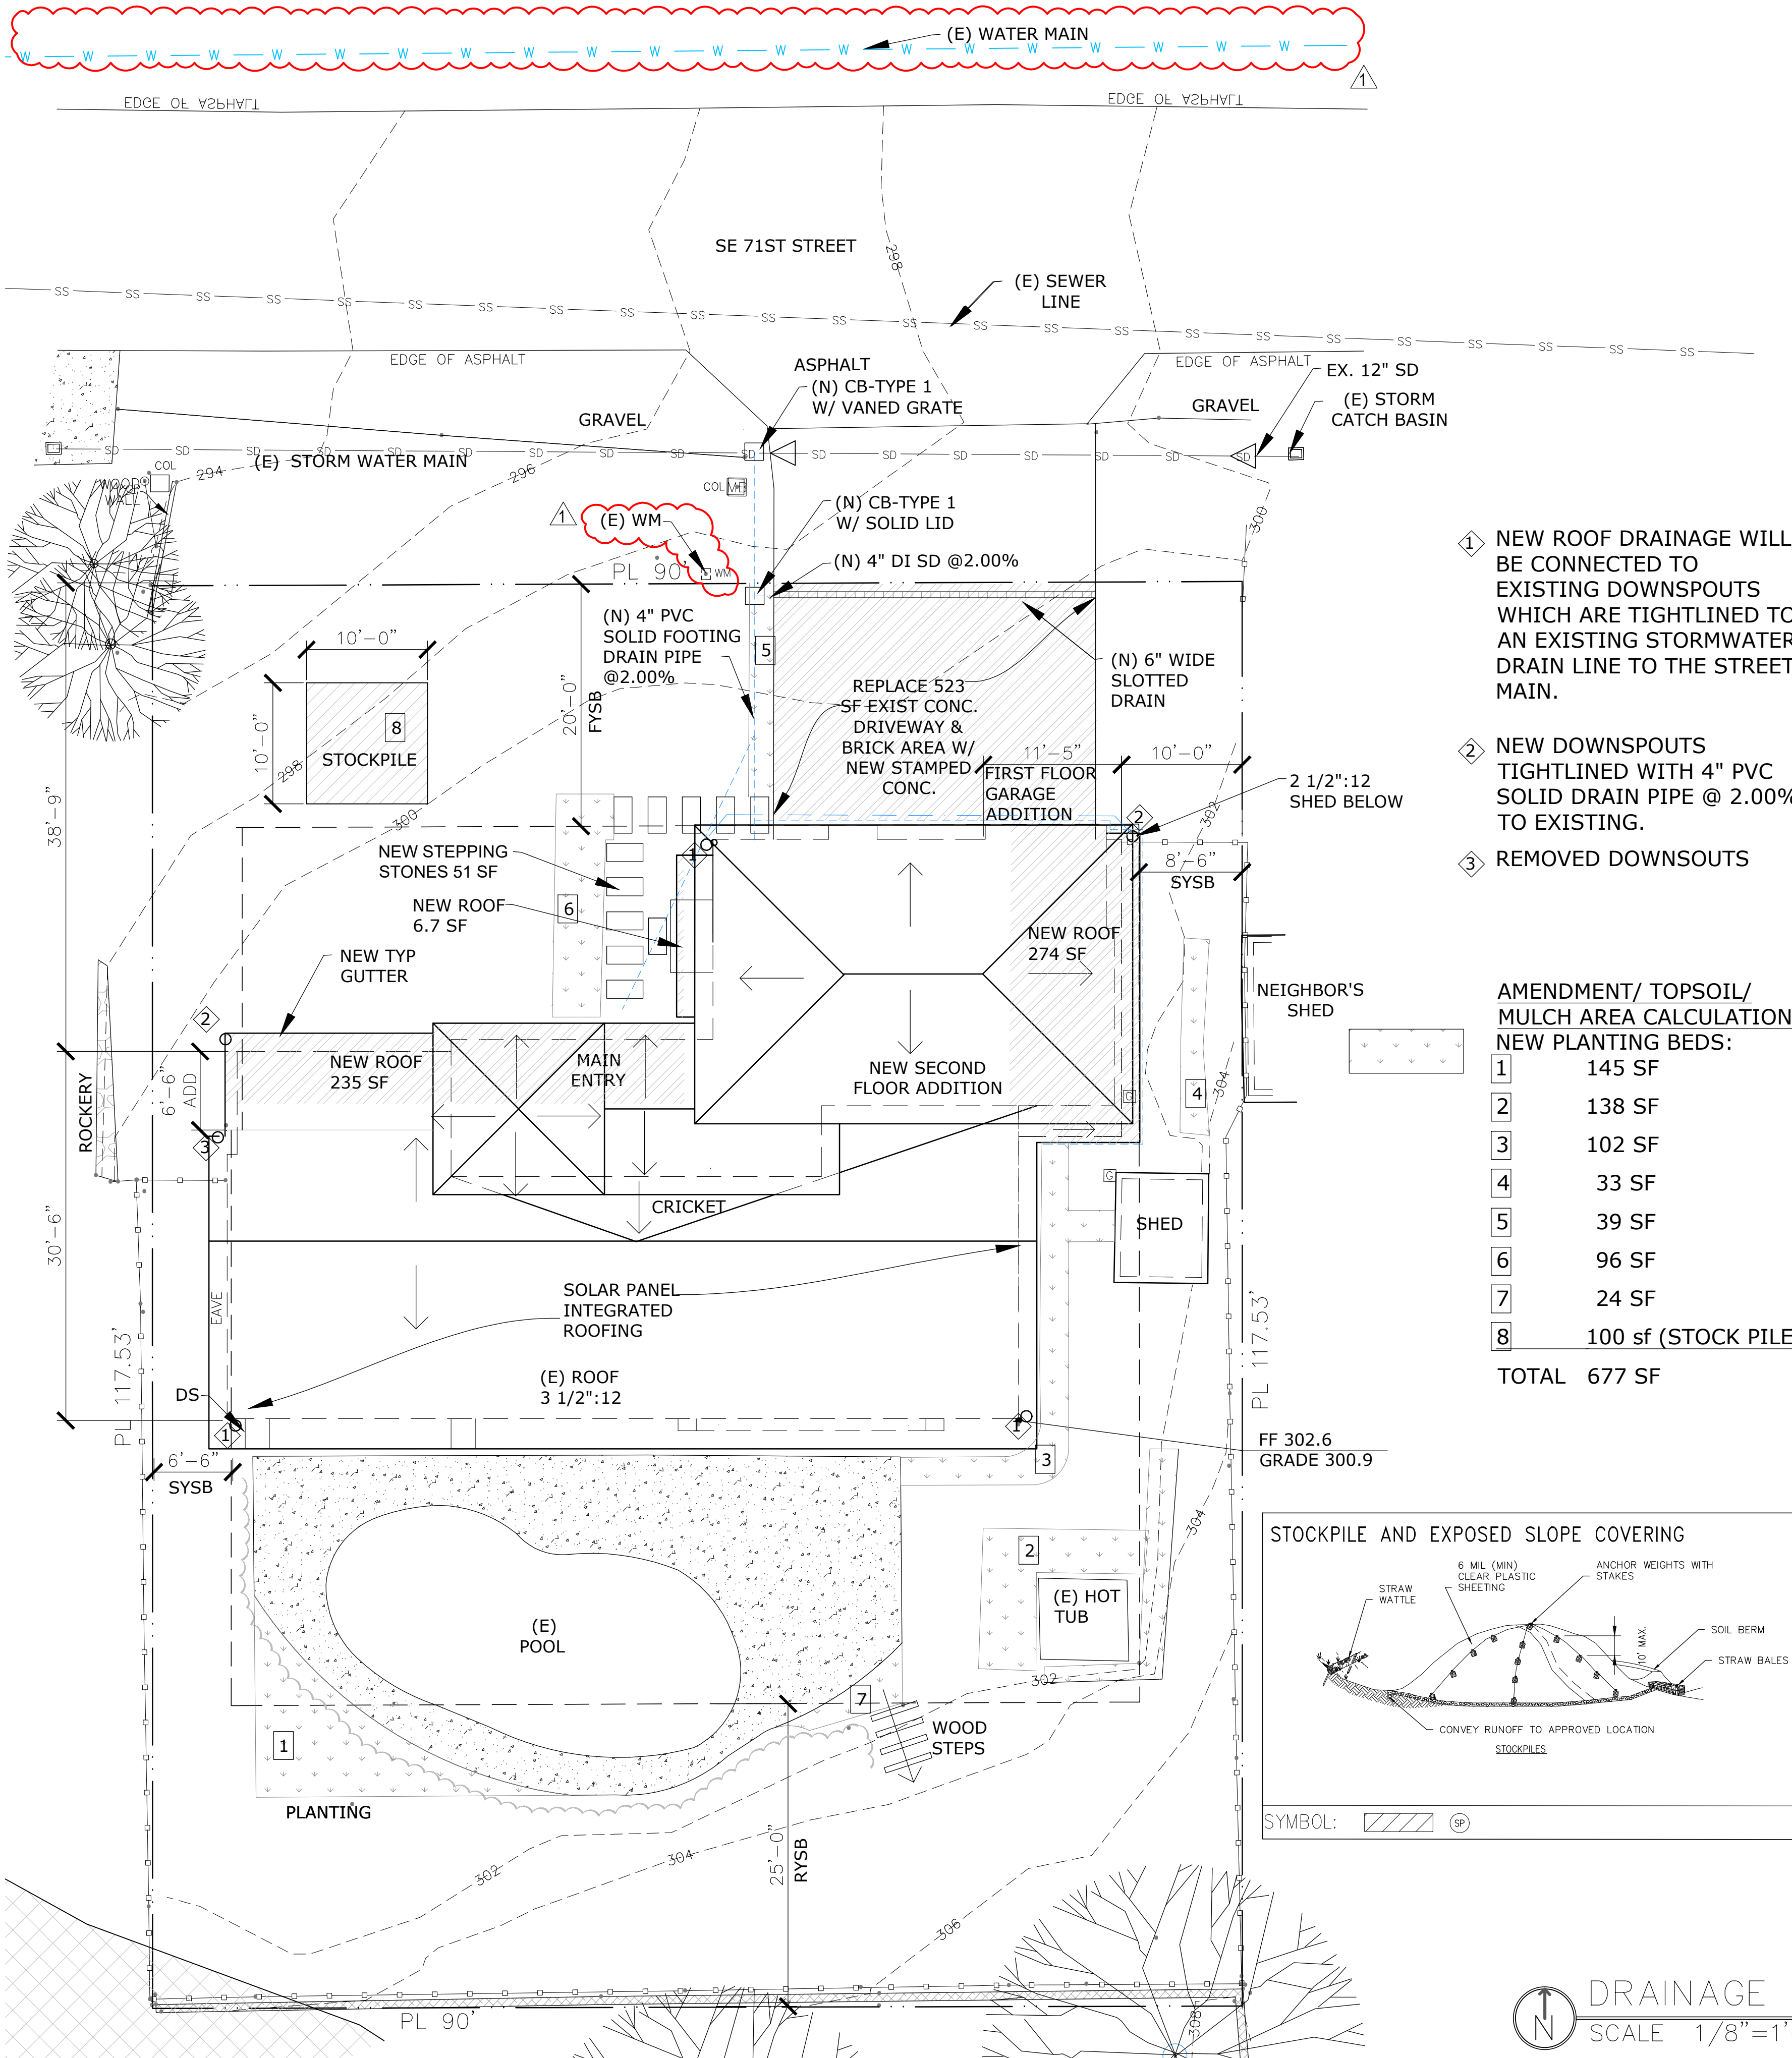


- ① NEW ROOF DRAINAGE WILL BE CONNECTED TO EXISTING DOWNSPOUTS WHICH ARE TIGHTLINED TO AN EXISTING STORMWATER DRAIN LINE TO THE STREET MAIN.
- ② NEW DOWNSPOUTS TIGHTLINED WITH 4" PVC SOLID DRAIN PIPE @ 2.00% TO EXISTING.
- ③ REMOVED DOWNSPOUTS

AMENDMENT/ TOPSOIL/ MULCH AREA CALCULATION:	
NEW PLANTING BEDS:	
1	145 SF
2	138 SF
3	102 SF
4	33 SF
5	39 SF
6	96 SF
7	24 SF
8	100 sf (STOCK PILE)
TOTAL	677 SF

NEW PROPOSED HARD
SURFACE AREA:

ROOFS:	571 SF
WALKWAY:	51 SF
TOTAL:	568 SF

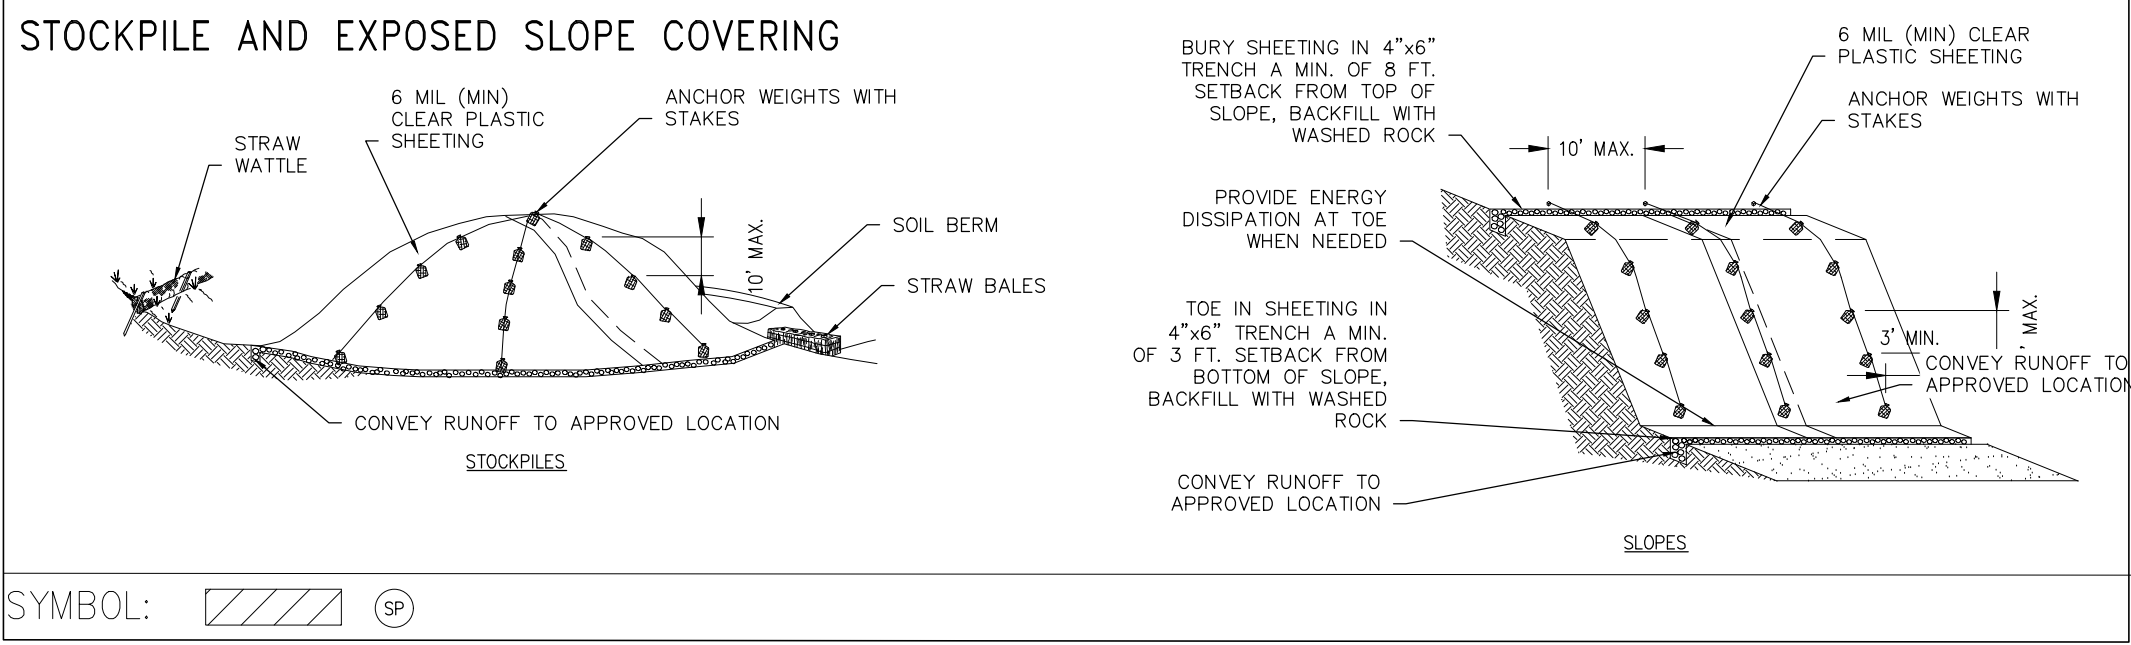

REGISTERED
ARCHITECT
DONNA J. BROWN
STATE OF WASHINGTON

Donna Jean Brown Architect
10751 - 4th Ave NW Seattle, WA 98177
206.949.9939 mobile 206.547.7860 land/ fax
Donna@DJBArchitect.com



THYGESEN RESIDENCE
8109 SE 71ST STREET
MERCER ISLAND, WA 98040

SUBMIT

DATE 10-31-2024

DRAINAGE
PLAN

REVISIONS

1. 2-19-2025


2.

3.

4.


A-9

SHEET 9 OF 9

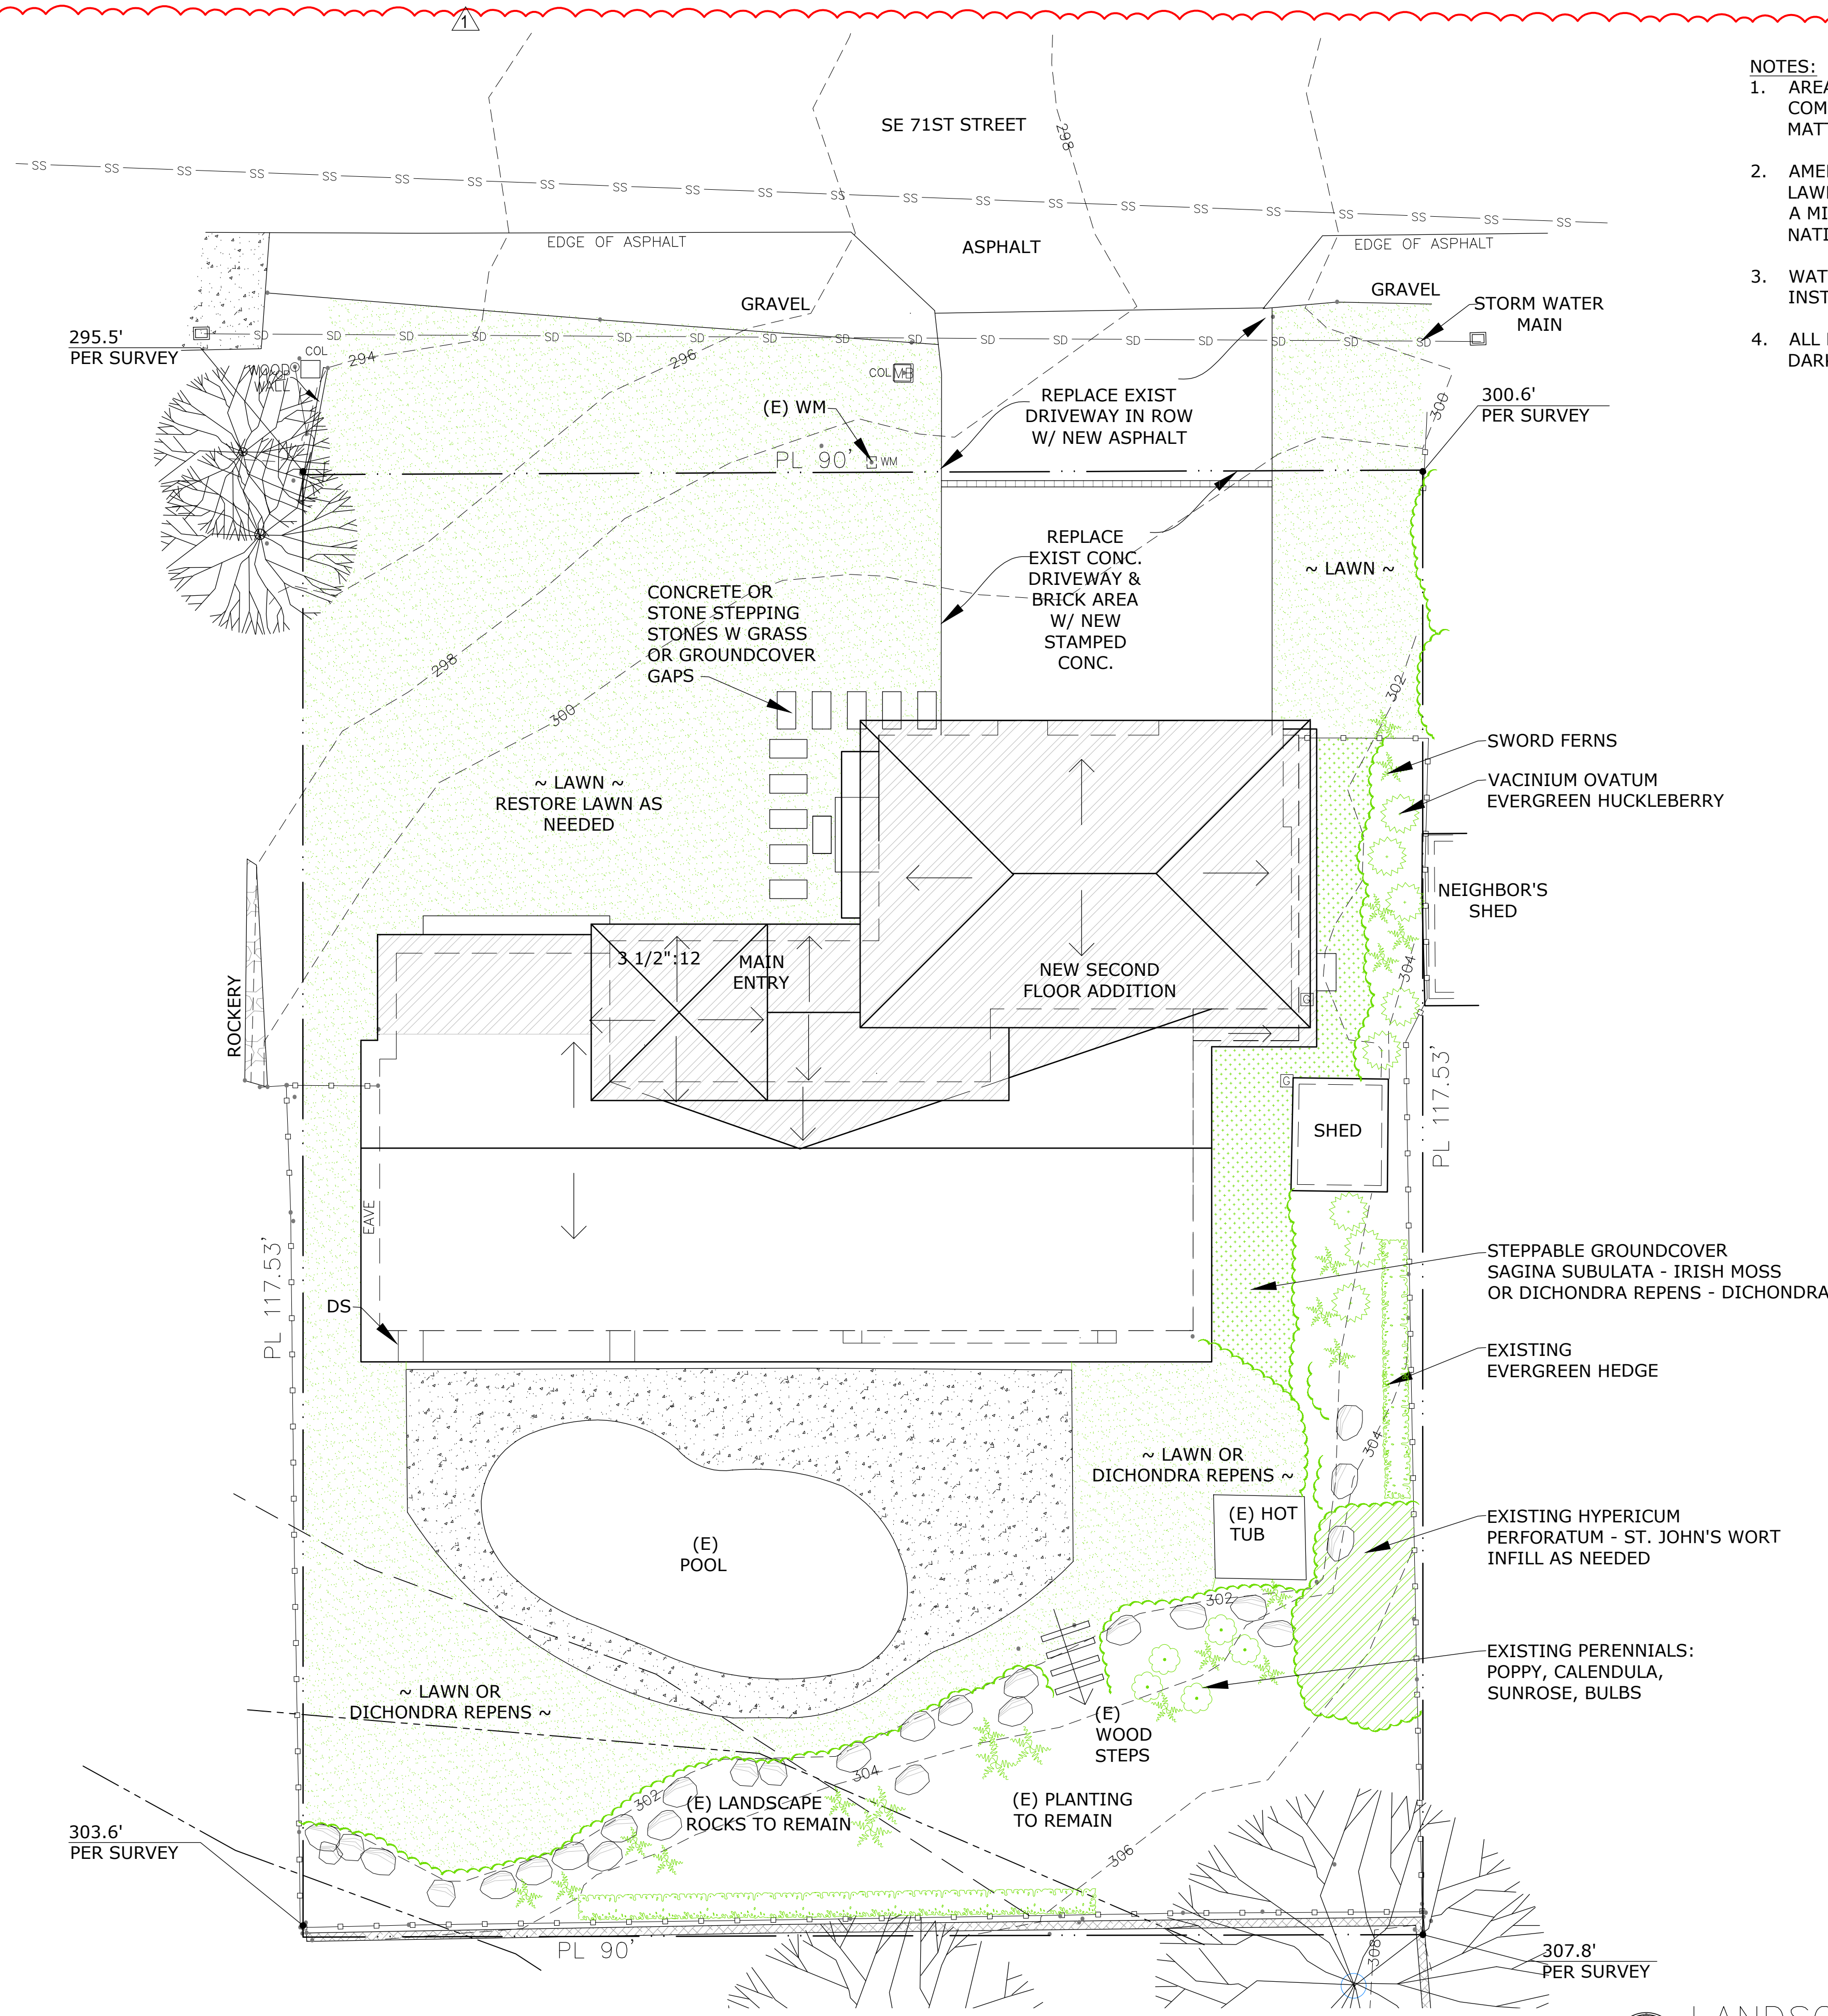

- NOTES:
1. AREAS THAT HAVE BEEN CLEARED, GRADED OR COMPACTED ARE TO BE AMENDED WITH ORGANIC MATTER PRIOR PLANTING.
 2. AMEND SOILS IN ALL NEW PLANTING BED AREAS AND LAWNS TO 6" DEPTH (OR AS NEEDED). SOIL SHALL BE A MIX OF IMPORTED 3-WAY TOPSOIL MIXED WITH NATIVE SOIL/ FILL
 3. WATER ALL PLANTINGS IMMEDIATELY FOLLOWING INSTALLATION.
 4. ALL PLANTING BEDS TO RECEIVE 2" TOP-DRESS OF DARK-FINE MULCH (CEDAR GROVE OR EQUIVALENT).

LANDSCAPE PLAN
SCALE 1/8"=1'-0"

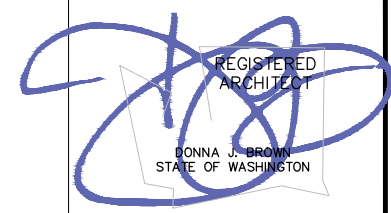

Donna Jean Brown Architect
10751 - 4th Ave NW Seattle, WA 98177
206.949.9939 mobile 206.547.7860 land/ fax
Donna@DJBArchitect.com



THYGESSEN RESIDENCE
8109 SE 71ST STREET
MERCER ISLAND, WA 98040

SUBMIT

DATE 03-04-2025

LANDSCAPE PLAN

REVISIONS

1. 3-11-2025
- 2.
- 3.
- 4.

A-10

SHEET 10 OF 10

LEGAL DESCRIPTION

(PER STATUTORY WARRANTY DEED RECORDING #20170131000972)

LOT 6, BLOCK 2, GOODBODY'S ADDITION TO MERCER ISLAND, ACCORDING TO THE PLAT THEREOF, RECORDED IN VOLUME 64 OF PLATS, PAGE(S) 9, IN KING COUNTY, WASHINGTON.

SITUATE IN THE COUNTY OF KING, STATE OF WASHINGTON.

BASIS OF BEARINGS

THE CENTERLINE OF SE 71ST STREET
BEARING = NORTH 88°41'04" WEST PER R1.

REFERENCES

R1. PLAT OF GOODBODY'S ADDITION TO MERCER ISLAND, VOL.64, PG.9, RECORDS OF KING COUNTY, WASHINGTON.

R2. RECORD OF SURVEY, REC. NO. 20111223900003.

VERTICAL DATUM

NAVD88, PER GPS OBSERVATIONS.

SURVEYOR'S NOTES

1. THE TOPOGRAPHIC SURVEY SHOWN HEREON WAS PERFORMED IN OCTOBER OF 2019. THE FIELD DATA WAS COLLECTED AND RECORDED ON MAGNETIC MEDIA THROUGH AN ELECTRONIC THEODOLITE. THE DATA FILE IS ARCHIVED ON DISC OR CD. WRITTEN FIELD NOTES MAY NOT EXIST. CONTOURS ARE SHOWN FOR CONVENIENCE ONLY. DESIGN SHOULD RELY ON SPOT ELEVATIONS.

2. ALL MONUMENTS SHOWN HEREON WERE LOCATED DURING THE COURSE OF THIS SURVEY UNLESS OTHERWISE NOTED.

3. THE TYPES AND LOCATIONS OF ANY UTILITIES SHOWN ON THIS DRAWING ARE BASED ON INFORMATION PROVIDED TO US, BY OTHERS OR GENERAL INFORMATION READILY AVAILABLE IN THE PUBLIC DOMAIN INCLUDING, AS APPLICABLE, IDENTIFYING MARKINGS PLACED BY UTILITY LOCATE SERVICES AND OBSERVED BY TERRANE IN THE FIELD. AS SUCH, THE UTILITY INFORMATION SHOWN ON THESE DRAWINGS ARE FOR INFORMATIONAL PURPOSES ONLY AND SHOULD NOT BE RELIED ON FOR DESIGN OR CONSTRUCTION PURPOSES; TERRANE IS NOT RESPONSIBLE OR LIABLE FOR THE ACCURACY OR COMPLETENESS OF THIS UTILITY INFORMATION. FOR THE ACCURATE LOCATION AND TYPE OF UTILITIES NECESSARY FOR DESIGN AND CONSTRUCTION, PLEASE CONTACT THE SITE OWNER AND THE LOCAL UTILITY LOCATE SERVICE (800-424-5555).

4. SUBJECT PROPERTY TAX PARCEL NO. 283600-0130.

5. SUBJECT PROPERTY AREA PER THIS SURVEY IS 10,578 ± S.F. (0.24 ACRES)

6. THIS SURVEY WAS PERFORMED WITHOUT THE BENEFIT OF A TITLE REPORT. EASEMENTS AND OTHER ENCUMBRANCES MAY EXIST THAT ARE NOT SHOWN HEREON.

7. FIELD DATA FOR THIS SURVEY WAS OBTAINED BY DIRECT FIELD MEASUREMENTS WITH A CALIBRATED ELECTRONIC 5-SECOND TOTAL STATION AND/OR SURVEY GRADE GPS OBSERVATIONS. ALL ANGULAR AND LINEAR RELATIONSHIPS ARE ACCURATE AND MEET THE STANDARDS SET BY WAC 332-130-090.

LEGEND

ASPHALT SURFACE

BRICK SURFACE

BUILDING

CENTERLINE ROW

CONCRETE SURFACE

RETAINING WALL

DECK

FENCE LINE (CHAIN LINK)

FENCE LINE (WOOD)

GAS LINE

GAS METER

GRAVEL SURFACE

GUY ANCHOR

GUY POLE

HEDGE FOLIAGE LINE

INLET (TYPE 1)

IRON PIPE (FOUND)

MAILBOX (RESIDENTIAL)

MONUMENT IN CASE (FOUND)

POWER METER

POWER POLE

REBAR AS NOTED (FOUND)

REBAR & CAP (SET)

ROCKERY

SEWER LINE

SEWER MANHOLE

TREE (AS NOTED)

WATER METER

YARD LIGHT

COLUMN

VICINITY MAP

N.T.S.

8109 Southeast 71st Street

Islander Middle School

SE 71st St

SE 72nd St

SE 73rd St

SE 74th St

SE 75th St

SE 76th St

SE 77th St

SE 78th St

SE 79th St

SE 80th St

SE 81st St

SE 82nd St

SE 83rd St

SE 84th St

SE 85th St

SE 86th St

SE 87th St

SE 88th St

SE 89th St

SE 90th St

SE 91st St

SE 92nd St

SE 93rd St

SE 94th St

SE 95th St

SE 96th St

SE 97th St

SE 98th St

SE 99th St

SE 100th St

SE 101st St

SE 102nd St

SE 103rd St

SE 104th St

SE 105th St

SE 106th St

SE 107th St

SE 108th St

SE 109th St

SE 110th St

SE 111th St

SE 112th St

SE 113th St

SE 114th St

SE 115th St

SE 116th St

SE 117th St

SE 118th St

SE 119th St

SE 120th St

SE 121st St

SE 122nd St

SE 123rd St

SE 124th St

SE 125th St

SE 126th St

SE 127th St

SE 128th St

SE 129th St

SE 130th St

SE 131st St

SE 132nd St

SE 133rd St

SE 134th St

SE 135th St

SE 136th St

SE 137th St

SE 138th St

SE 139th St

SE 140th St

SE 141st St

SE 142nd St

SE 143rd St

SE 144th St

SE 145th St

SE 146th St

SE 147th St

SE 148th St

SE 149th St

SE 150th St

SE 151st St

SE 152nd St

SE 153rd St

SE 154th St

SE 155th St

SE 156th St

SE 157th St

SE 158th St

SE 159th St

SE 160th St

SE 161st St

SE 162nd St

SE 163rd St

SE 164th St

SE 165th St

SE 166th St

SE 167th St

SE 168th St

SE 169th St

SE 170th St

SE 171st St

SE 172nd St

SE 173rd St

SE 174th St

SE 175th St

SE 176th St

SE 177th St

SE 178th St

SE 179th St

SE 180th St

SE 181st St

SE 182nd St

SE 183rd St

SE 184th St

SE 185th St

SE 186th St

SE 187th St

SE 188th St

SE 189th St

SE 190th St

SE 191st St

SE 192nd St

SE 193rd St

SE 194th St

SE 195th St

SE 196th St

SE 197th St

SE 198th St

SE 199th St

SE 200th St

SE 201st St

SE 202nd St

SE 203rd St

SE 204th St

SE 205th St

SE 206th St

SE 207th St

SE 208th St

SE 209th St

SE 210th St

SE 211st St

SE 212nd St

SE 213rd St

SE 214th St

SE 215th St

SE 216th St

SE 217th St

SE 218th St

SE 219th St

SE 220th St

SE 221st St

SE 222nd St

SE 223rd St

SE 224th St

SE 225th St

SE 226th St

SE 227th St

SE 228th St

SE 229th St

SE 230th St

SE 231st St

SE 232nd St

SE 233rd St

SE 234th St

SE 235th St

SE 236th St

SE 237th St

SE 238th St

SE 239th St

SE 240th St

SE 241st St

SE 242nd St

SE 243rd St

SE 244th St

SE 245th St

SE 246th St

SE 247th St

SE 248th St

SE 249th St

SE 250th St

SE 251st St

SE 252nd St

SE 253rd St

SE 254th St

SE 255th St

SE 256th St

SE 257th St

SE 258th St

SE 259th St

SE 260th St

SE 261st St

SE 262nd St

SE 263rd St

SE 264th St

SE 265th St

SE 266th St

SE 267th St

SE 268th St

SE 269th St

SE 270th St

SE 271st St

SE 272nd St

SE 273rd St

SE 274th St

SE 275th St

SE 276th St

SE 277th St

SE 278th St

SE 279th St

SE 280th St

SE 281st St

SE 282nd St

SE 283rd St

SE 284th St

SE 285th St

SE 286th St

SE 287th St

SE 288th St

SE 289th St

SE 290th St

SE 291st St

SE 292nd St

SE 293rd St

SE 294th St

SE 295th St

SE 296th St

SE 297th St

SE 298th St

SE 299th St

SE 300th St

SE 301st St

SE 302nd St

SE 303rd St

SE 304th St

SE 305th St

SE 306th St

SE 307th St

SE 308th St

SE 309th St

SE 310th St

SE 311st St

SE 312nd St

SE 313rd St

SE 314th St

SE 315th St

SE 316th St

SE 317th St

SE 318th St

SE 319th St

SE 320th St

SE 321st St

SE 322nd St

SE 323rd St

SE 324th St

SE 325th St

SE 326th St

SE 327th St

SE 328th St

SE 329th St

SE 330th St

SE 331st St

SE 332nd St

SE 333rd St

SE 334th St

SE 335th St

SE 336th St

SE 337th St

SE 338th St

SE 339th St

SE 340th St

SE 341st St

SE 342nd St

SE 343rd St

SE 344th St

SE 345th St

SE 346th St

SE 347th St

SE 348th St

SE 349th St

SE 350th St

SE 351st St

SE 352nd St

SE 353rd St

SE 354th St

SE 355th St

SE 356th St

SE 357th St

SE 358th St

SE 359th St

SE 360th St

SE 361st St

SE 362nd St

SE 363rd St

SE 364th St

SE 365th St

SE 366th St

SE 367th St

SE 368th St

SE 369th St

SE 370th St

SE 371st St

SE 372nd St

SE 373rd St

SE 374th St

SE 375th St

SE 376th St

SE 377th St

SE 378th St

SE 379th St

SE 380th St

SE 381st St

SE 382nd St

SE 383rd St

SE 384th St

SE 385th St

SE 386th St

SE 387th St

SE 388th St

SE 389th St

SE 390th St

SE 391st St

SE 392nd St

SE 393rd St

SE 394th St

SE 395th St

SE 396th St

SE 397th St

SE 398th St

SE 399th St

SE 400th St

SE 401st St

SE 402nd St

SE 403rd St

SE 404th St

SE 405th St

SE 406th St

SE 407th St

SE 408th St

SE 409th St

SE 410th St

SE 411st St

SE 412nd St

SE 413rd St

SE 414th St

SE 415th St

SE 416th St

SE 417th St

SE 418th St

SE 419th St

SE 420th St

SE 421st St

SE 422nd St

SE 423rd St

SE 424th St

SE 425th St

SE 426th St

SE 427th St

SE 428th St

SE 429th St

SE 430th St

SE 431st St

SE 432nd St

SE 433rd St

SE 434th St

SE 435th St

SE 436th St

SE 437th St

SE 438th St

SE 439th St

SE 440th St

SE 441st St

SE 442nd St

SE 443rd St

SE 444th St

SE 445th St

SE 446th St

SE 447th St

SE 448th St

SE 449th St

SE 450th St

SE 451st St

SE 452nd St

SE 453rd St

SE 454th St

SE 455th St

SE 456th St

SE 457th St

SE 458th St

SE 459th St

SE 460th St

SE 461st St

SE 462nd St

SE 463rd St

SE 464th St

SE 465th St

SE 466th St

SE 467th St

SE 468th St

SE 469th St

SE 470th St

SE 471st St

SE 472nd St

SE 473rd St

SE 474th St

SE 475th St

SE 476th St

SE 477th St

SE 478th St

SE 479th St

SE 480th St

SE 481st St

SE 482nd St

SE 483rd St

SE 484th St

SE 485th St

SE 486th St

SE 487th St

SE 488th St

SE 489th St

SE 490th St

SE 491st St

SE 492nd St

SE 493rd St

SE 494th St

SE 495th St

SE 496th St

SE 497th St

SE 498th St

SE 499th St

SE 500th St

SE 501st St

SE 502nd St

SE 503rd St

SE 504th St

SE 505th St

SE 506th St

SE 507th St

SE 508th St

SE 509th St

SE 510th St

SE 511st St

SE 512nd St

SE 513rd St

SE 514th St

SE 515th St

SE 516th St

SE 517th St

SE 518th St

SE 519th St

SE 520th St

SE 521st St

SE 522nd St

SE 523rd St

SE 524th St

SE 525th St

SE 526th St

SE 527th St

SE 528th St

SE 529th St

SE 530th St

SE 531st St

SE 532nd St

SE 533rd St

SE 534th St

SE 535th St

SE 536th St

SE 537th St

SE 538th St

SE 539th St

SE 540th St

SE 541st St

SE 542nd St

SE 543rd St

SE 544th St

SE 545th St

SE 546th St

SE 547th St

SE 548th St

SE 549th St

SE 550th St

SE 551st St

SE 552nd St

SE 553rd St

SE 554th St

SE 555th St

SE 556th St

SE 557th St

SE 558th St

SE 559th St

SE 560th St

SE 561st St

SE 562nd St

SE 563rd St

SE 564th St

SE 565th St

SE 566th St

SE 567th St

SE 568th St

SE 569th St

SE 570th St

SE 571st St

SE 572nd St

SE 573rd St

SE 574th St

SE 575th St

SE 576th St

SE 577th St

SE 578th St

SE 579th St

SE 580th St

SE 581st St

SE 582nd St

SE 583rd St

SE 584th St

SE 585th St

SE 586th St

SE 587th St

SE 588th St

SE 589th St

SE 590th St

SE 591st St

SE 592nd St

SE 593rd St

SE 594th St

SE 595th St

SE 596th St

SE 597th St

SE 598th St

SE 599th St

SE 600th St

SE 601st St

SE 602nd St

SE 603rd St

SE 604th St

SE 605th St

SE 606th St

SE 607th St

SE 608th St

SE 609th St

SE 610th St

SE 611st St

SE 612nd St

SE 613rd St

SE 614th St

SE 615th St

SE 616th St

SE 617th St

SE 618th St

SE 619th St

SE 620th St

SE 621st St

SE 622nd St

SE 623rd St

SE 624th St

SE 625th St

SE 626th St

SE 627th St

SE 628th St

SE 629th St

SE 630th St

SE 631st St

SE 632nd St

SE 633rd St

SE 634th St

SE 635th St

SE 636th St

SE 637th St

SE 638th St

SE 639th St

SE 640th St

SE 641st St

SE 642nd St

SE 643rd St

SE 644th St

SE 645th St

SE 646th St

SE 647th St

SE 648th St

SE 649th St

SE 650th St

SE 651st St

SE 652nd St

SE 653rd St

SE 654th St

SE 655th St

SE 656th St

SE 657th St

SE 658th St

SE 659th St

SE 660th St

SE 661st St

SE 662nd St

SE 663rd St

SE 664th St

SE 665th St

SE 666th St

SE 667th St

SE 668th St

SE 669th St

SE 670th St

SE 671st St

SE 672nd St

SE 673rd St

SE 674th St

SE 675th St

SE 676th St

SE 677th St

SE 678th St

SE 679th St

SE 680th St

SE 681st St

SE 682nd St

SE 683rd St

SE 684th St

SE 685th St

SE 686th St

SE 687th St

SE 688th St

SE 689th St

SE 690th St

SE 691st St

SE 692nd St

SE 693rd St

SE 694th St

SE 695th St

SE 696th St

SE 697th St

SE 698th St

SE 699th St

SE 700th St

SE 701st St

SE 702nd St

SE 703rd St

SE 704th St

SE 705th St

SE 706th St

SE 707th St

SE 708th St

SE 709th St

SE 710th St

SE 711st St

SE 712nd St

SE 713rd St

SE 714th St

SE 715th St

SE 716th St

SE 717th St

SE 718th St

SE 719th St

SE 720th St

SE 721st St

SE 722nd St

SE 723rd St

SE 724th St

SE 725th St

SE 726th St

SE 727th St

SE 728th St

SE 729th St

SE 730th St

SE 731st St

SE 732nd St

SE 733rd St

SE 734th St

SE 735th St

SE 736th St

SE 737th St

SE 738th St

SE 739th St

SE 740th St

SE 741st St

SE 742nd St

SE 743rd St

SE 744th St

SE 745th St

SE 746th St

SE 747th St

SE 748th St

SE 749th St

SE 750th St

SE 751st St

SE 752nd St

SE 753rd St

SE 754th St

SE 755th St

SE 756th St

SE 757th St

SE 758th St

SE 759th St

SE 760th St

SE 761st St

SE 762nd St

SE 763rd St

SE 764th St

SE 765th St

SE 766th St

SE 767th St

SE 768th St

SE 769th St

SE 770th St

SE 771st St

SE 772nd St

SE 773rd St

SE 774th St

SE 775th St

SE 776th St

SE 777th St

SE 778th St

SE 779th St

SE 780th St

SE 781st St

SE 782nd St

SE 783rd St

SE 784th St

SE 785th St

SE 786th St

SE 787th St

SE 788th St

SE 789th St

SE 790th St

SE 791st St

SE 792nd St

SE 793rd St

SE 794th St

SE 795th St

SE 796th St

SE 797th St

SE 798th St

SE 799th St

SE 800th St

SE 801st St

SE 802nd St

SE 803rd St

SE 804th St

SE 805th St

SE 806th St

SE 807th St

SE 808th St

SE 809th St

SE 810th St

SE 811st St

SE 812nd St

SE 813rd St

SE 814th St

SE 815th St

SE 816th St

SE 817th St

SE 818th St

SE 819th St

SE 820th St

SE 821st St

SE 822nd St

SE 823rd St

SE 824th St

SE 825th St

SE 826th St

SE 827th St

SE 828th St

SE 829th St

SE 830th St

SE 831st St

SE 832nd St

SE 833rd St

SE 834th St

SE 835th St

SE 836th St

SE 837th St

SE 838th St

SE 839th St

SE 840th St

SE 841st St

SE 842nd St

SE 843rd St

SE 844th St

SE 845th St

SE 846th St

SE 847th St

SE 848th St

SE 849th St

SE 850th St

SE 851st St

SE 852nd St

SE 853rd St

SE 854th St

SE 855th St

SE 856th St

SE 857th St

SE 858th St

SE 859th St

SE 860th St

SE 861st St

SE 862nd St

SE 863rd St

SE 864th St

SE 865th St

SE 866th St

SE 867th St

SE 868th St

SE 869th St

SE 870th St

SE 871st St

SE 872nd St

SE 873rd St

SE 874th St

SE 875th St

SE 876th St

SE 877th St

SE 878th St

SE 879th St

SE 880th St

SE 881st St

SE 882nd St

SE 883rd St

SE 884th St

SE 885th St

SE 886th St

SE 887th St

SE 888th St

SE 889th St

SE 890th St

SE 891st St

SE 892nd St

SE 893rd St

SE 894th St

SE 895th St

SE 896th St

SE 897th St

SE 898th St

SE 899th St

SE 900th St

SE 901st St

SE 902nd St

SE 903rd St

SE 904th St

SE 905th St

SE 906th St

SE 907th St

SE 908th St

SE 909th St

SE 910th St

SE 911st St

SE 912nd St

SE 913rd St

SE 914th St

SE 915th St

SE 916th St

SE 917th St

SE 918th St

SE 919th St

SE 920th St

SE 921st St

SE 922nd St

SE 923rd St

SE 924th St

SE 925th St

SE 926th St

SE 927th St

SE 928th St

SE 929th St

SE 930th St

SE 931st St

SE 932nd St

SE 933rd St

SE 934th St

SE 935th St

SE 936th St

SE 937th St

SE 938th St

SE 939th St

SE 940th St

SE 941st St

SE 942nd St

SE 943rd St

SE 944th St

SE 945th St

SE 946th St

SE 947th St

SE 948th St

SE 949th St

SE 950th St

SE 951st St

SE 952nd St

SE 953rd St

SE 954th St

SE 955th St

SE 956th St

SE 957th St

SE 958th St

SE 959th St

SE 960th St

SE 961st St

SE 962nd St

SE 963rd St

SE 964th St

SE 965th St

SE 966th St

SE 967th St

SE 968th St

SE 969th St

SE 970th St

SE 971st St

SE 972nd St

SE 973rd St

SE 974th St

SE 975th St

SE 976th St

SE 977th St

SE 978th St

SE 979th St

SE 980th St

SE 981st St

SE 982nd St

SE 983rd St

SE 984th St

SE 985th St

SE 986th St

SE 987th St

SE 988th St

SE 989th St

SE 990th St

SE 991st St

SE 992nd St

SE 993rd St

SE 994th St

SE 995th St


SE 996th St

SE 997th St

SE 998th St

SE 999th St

SE 1000th St

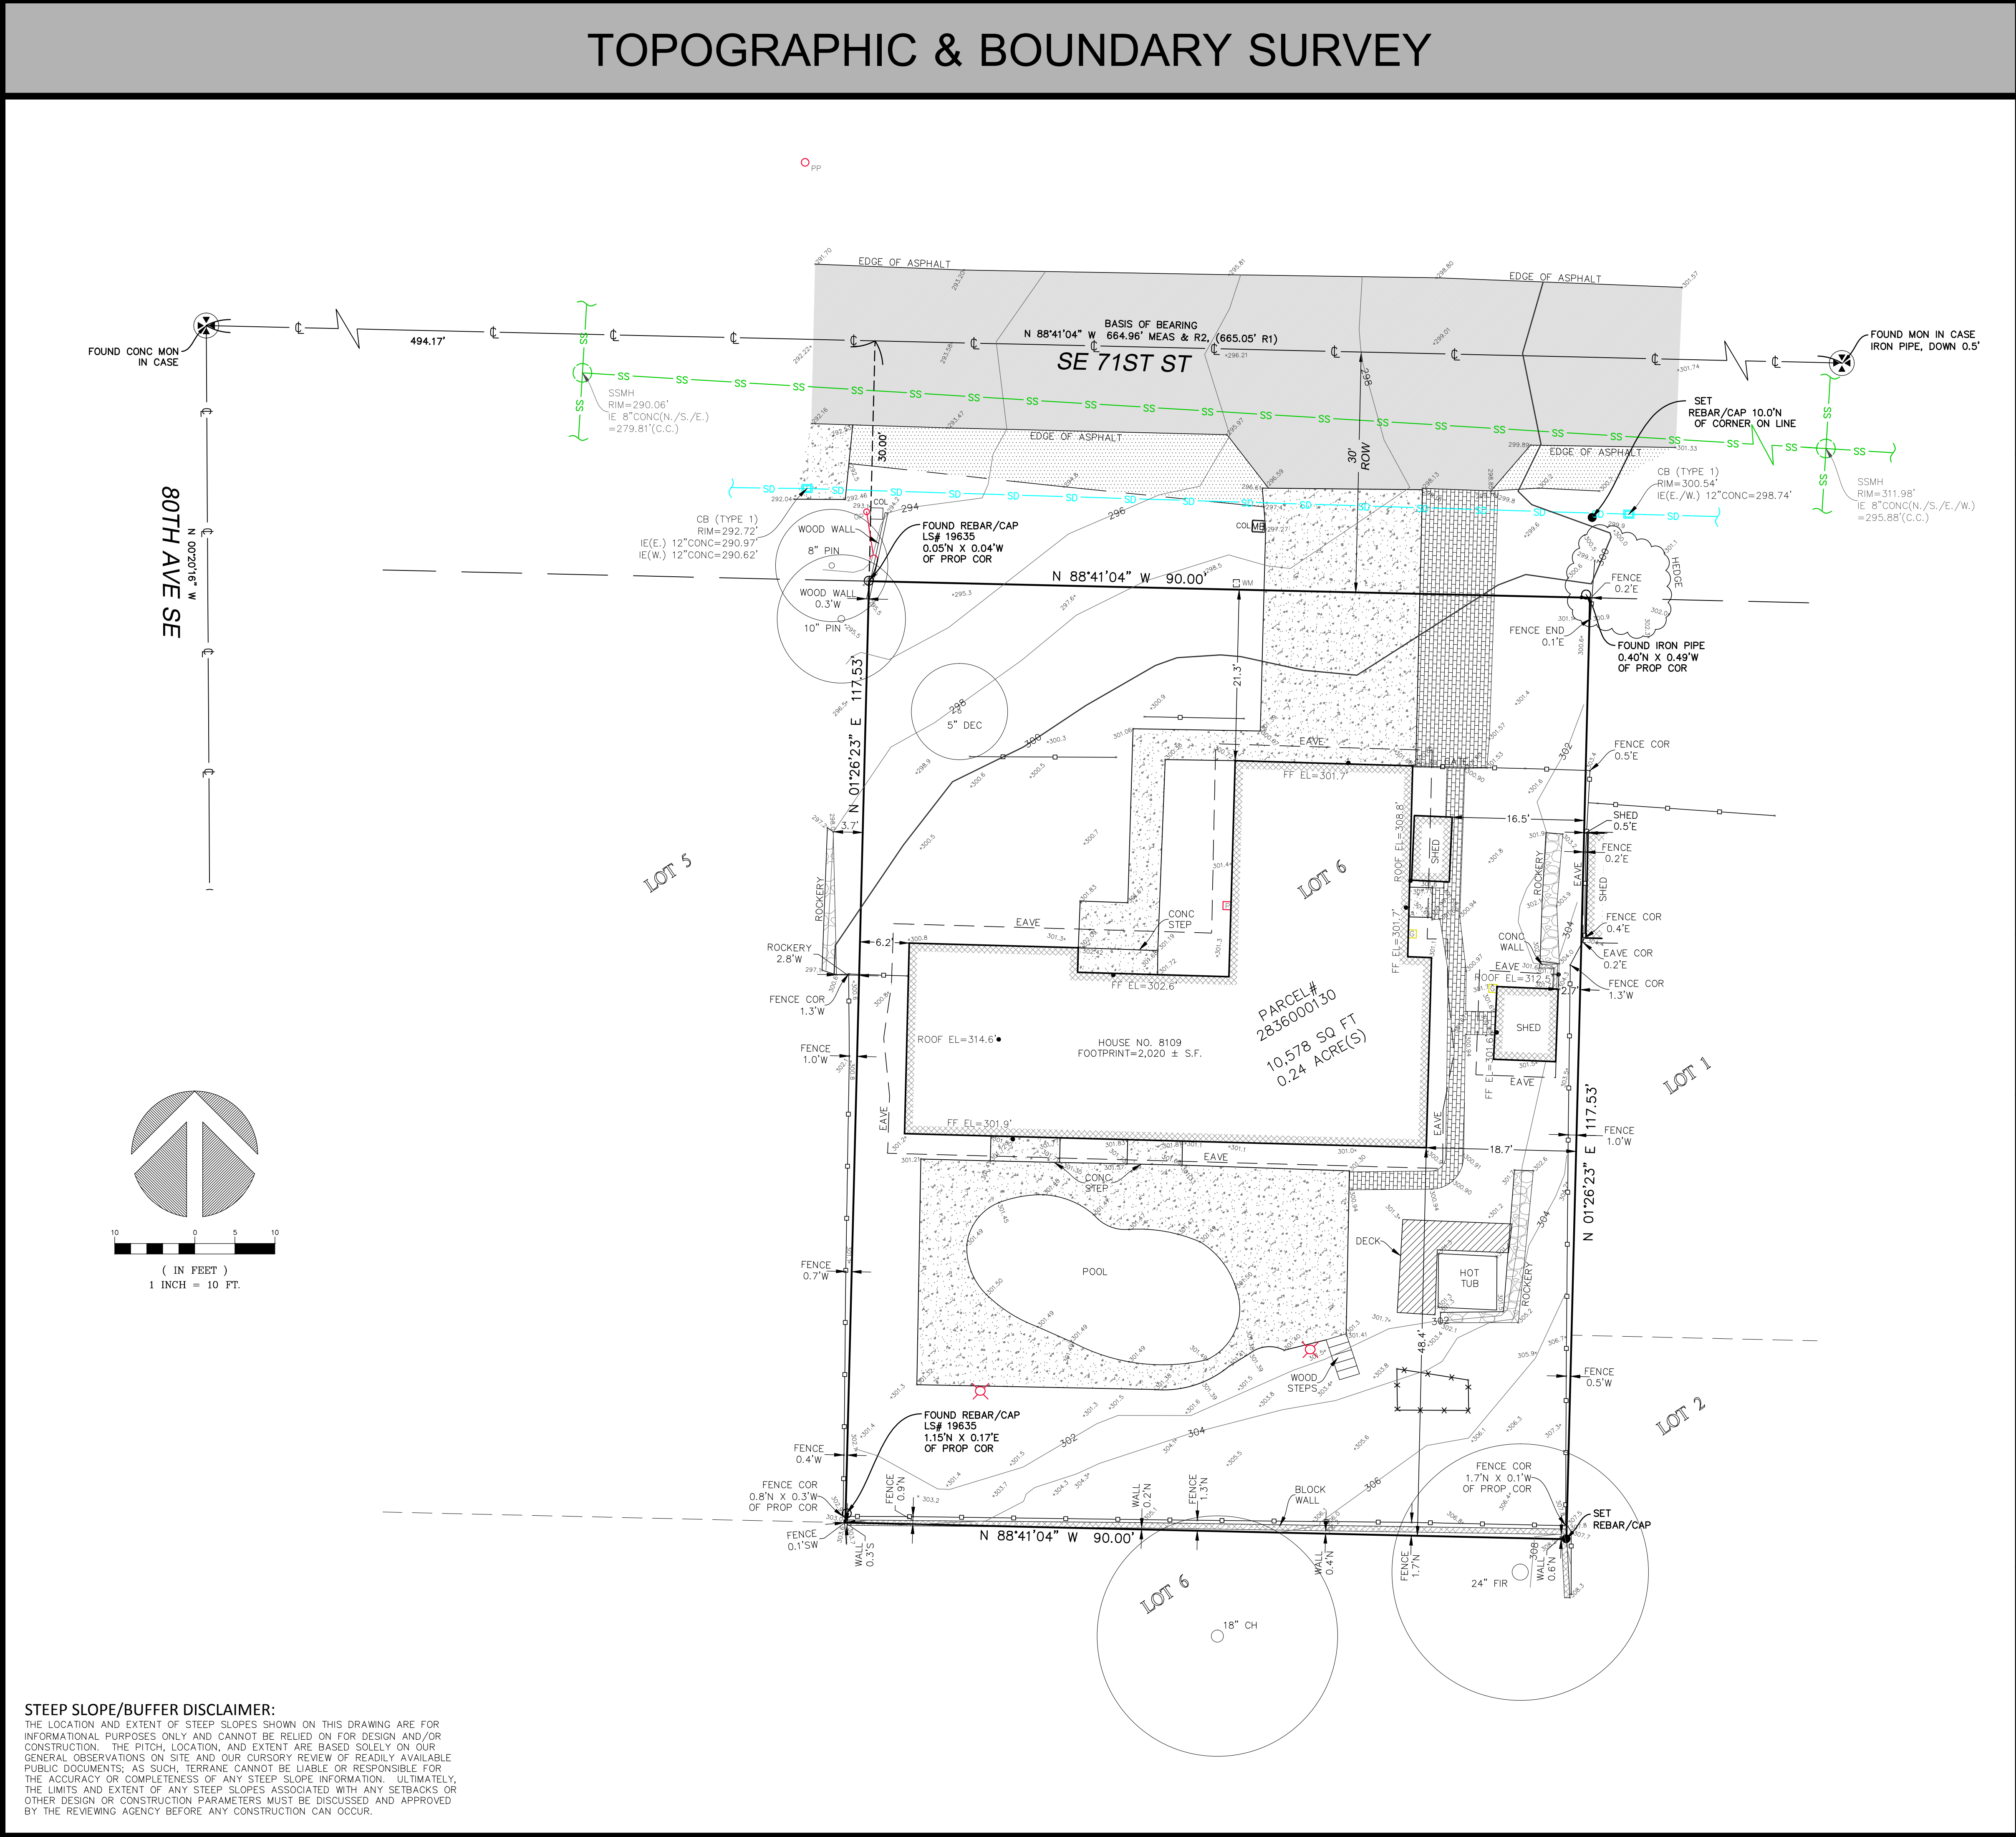

GENERAL STRUCTURAL NOTES
(THE FOLLOWING APPLY UNLESS SHOWN OTHERWISE ON THE PLANS.)

A. GENERAL

1. ALL MATERIALS, WORKMANSHIP, DESIGN, AND CONSTRUCTION FOR NEW CONSTRUCTION SHALL CONFORM TO THE DRAWINGS, SPECIFICATIONS, AND THE INTERNATIONAL BUILDING CODE (IBC), 2021 EDITION.

2. STRUCTURAL DRAWINGS SHALL BE USED IN CONJUNCTION WITH ARCHITECTURAL DRAWINGS FOR BIDDING AND CONSTRUCTION. CONTRACTOR SHALL VERIFY DIMENSIONS AND CONDITIONS FOR COMPATIBILITY AND SHALL NOTIFY ARCHITECT OF ANY DISCREPANCIES PRIOR TO CONSTRUCTION. SEE ARCHITECTURAL DRAWINGS FOR EXACT LOCATIONS AND DIMENSIONS OF DOOR AND WINDOW OPENINGS. SEE MECHANICAL DRAWINGS FOR SIZE AND LOCATION OF MISCELLANEOUS MECHANICAL OPENINGS.

3. CONTRACTOR SHALL VERIFY ALL EXISTING DIMENSIONS, MEMBER SIZES, AND CONDITIONS PRIOR TO COMMENCING ANY WORK. ALL DIMENSIONS OF EXISTING CONSTRUCTION SHOWN ON THE DRAWINGS ARE INTENDED AS GUIDELINES ONLY AND MUST BE VERIFIED.

4. DEMOLITION: CONTRACTOR SHALL VERIFY ALL EXISTING CONDITIONS BEFORE COMMENCING ANY DEMOLITION. SHORING SHALL BE INSTALLED TO SUPPORT EXISTING CONSTRUCTION AS REQUIRED AND IN A MANNER SUITABLE TO THE WORK SEQUENCE. EXISTING REINFORCING SHALL BE SAVED WHERE AND AS NOTED ON THE PLANS. SAW CUTTING, IF AND WHERE USED, SHALL NOT CUT EXISTING REINFORCING THAT IS TO BE SAVED. DEMOLITION DEBRIS SHALL NOT BE ALLOWED TO DAMAGE OR OVERLOAD THE EXISTING STRUCTURE. LIMIT CONSTRUCTION LOADING (INCLUDING DEMOLITION DEBRIS) ON EXISTING FLOOR SYSTEMS TO 40 PSF.

4.1 CONTRACTOR SHALL VERIFY ALL EXISTING CONDITIONS AND LOCATION OF MEMBERS PRIOR TO CUTTING ANY OPENINGS.

4.2 WHERE NEW REINFORCING TERMINATES AT EXISTING CONCRETE, DOWEL BARS SHALL BE DRILLED AND EPOXIED INTO EXISTING CONCRETE TO MATCH NEW HORIZONTAL REINFORCING AS NOTED ON PLANS.

5. CONTRACTOR SHALL CHECK FOR DRYROT AT ALL EXTERIOR WALLS, EXISTING TOILET ROOM FLOORS AND WALLS, AREAS SHOWING WATER STAINS, AND ALL WOOD MEMBERS IN THE BASEMENT AND CRAWL SPACES. ALL ROT SHALL BE REMOVED AND DAMAGED MEMBERS SHALL BE REPLACED OR REPAIRED AS DIRECTED BY THE STRUCTURAL ENGINEER OR ARCHITECT.

6. CONTRACTOR SHALL PROVIDE TEMPORARY BRACING FOR THE STRUCTURE AND STRUCTURAL COMPONENTS OF THE NEW CONSTRUCTION UNTIL ALL FINAL CONNECTIONS HAVE BEEN COMPLETED IN ACCORDANCE WITH THE PLANS. THE CONTRACTOR SHALL ALSO PROVIDE TEMPORARY BRACING AND SHORING OF THE EXISTING BUILDING(S) IN WHICH PORTIONS OF THE EXISTING STRUCTURE ARE TO BE REMOVED OR MODIFIED. THIS TEMPORARY BRACING AND SHORING SHALL REMAIN IN PLACE UNTIL NEW CONSTRUCTION AND/OR STRUCTURAL MODIFICATIONS ARE COMPLETED. THE CONTRACTOR SHALL DESIGN, PROVIDE MATERIALS FOR AND INSTALL (AND REMOVE IF NECESSARY) SUCH TEMPORARY WORK.

7. CONTRACTOR SHALL BE RESPONSIBLE FOR ALL SAFETY PRECAUTIONS AND THE METHODS, TECHNIQUES, SEQUENCES OR PROCEDURES REQUIRED TO PERFORM HIS WORK. STRUCTURAL DESIGN OF THE BUILDING IS BASED ON RESISTANCE TO DEAD LOADS, CODE SPECIFIED LATERAL LOADS, AND MAXIMUM EXPECTED SERVICE LOADS. NO CONSIDERATION HAS BEEN GIVEN TO LOADS WHICH WILL BE INDUCED BY ERECTION PROCEDURES. THE CONTRACTOR SHALL VERIFY, TO THE SATISFACTION OF HIM/HERSELF AND THE OWNER, THE ABILITY OF THE STRUCTURE TO RESIST ALL ERECTION LOADS WITHOUT EXCEEDING THE ALLOWABLE STRESSES OF THE MATERIALS USED.

8. CONTRACTOR–INITIATED CHANGES SHALL BE SUBMITTED IN WRITING TO THE ARCHITECT AND STRUCTURAL ENGINEER FOR APPROVAL PRIOR TO FABRICATION OR CONSTRUCTION. CHANGES SHOWN ON SHOP DRAWINGS ONLY WILL NOT SATISFY THIS REQUIREMENT.

9. DRAWINGS INDICATE GENERAL AND TYPICAL DETAILS OF CONSTRUCTION. WHERE CONDITIONS ARE NOT SPECIFICALLY INDICATED, BUT ARE OF SIMILAR CHARACTER TO DETAILS SHOWN, SIMILAR DETAILS OF CONSTRUCTION SHALL BE USED, SUBJECT TO REVIEW AND APPROVAL BY THE ARCHITECT AND THE STRUCTURAL ENGINEER.

10. ALL STRUCTURAL SYSTEMS WHICH ARE TO BE COMPOSED OF COMPONENTS TO BE FIELD ERECTED SHALL BE SUPERVISED BY THE SUPPLIER DURING MANUFACTURING, DELIVERY, HANDLING, STORAGE AND ERECTION IN ACCORDANCE WITH INSTRUCTIONS PREPARED BY THE SUPPLIER.

11. INSPECTIONS: INSPECTIONS OF THE WOOD FRAMING, THE STEEL REBAR AND WOOD FORMS FOR CONCRETE FOOTINGS & FOUNDATIONS, AND CONCRETE SLABS ARE REQUIRED PER IBC SECTION 110.3.

12. SPECIAL INSPECTION: SHALL BE PERFORMED BY A CERTIFIED TESTING AGENCY, DESIGNATED BY THE ARCHITECT OR ENGINEER, AND APPROVED BY THE OWNER.

THE SPECIAL INSPECTION AGENCIES SHALL PRODUCE REPORTS AND KEEP RECORDS PER IBC SECTION 1704.2.4.

THE SPECIAL INSPECTION AGENCIES SHALL INSPECT FABRICATORS PER IBC SECTION 1704.2.5. IF FABRICATOR IS REGISTERED & APPROVED TO PERFORM THE WORK WITHOUT SPECIAL INSPECTION PER IBC 1704.2.5.1, FABRICATOR SHALL SUBMIT A CERTIFICATE OF COMPLIANCE TO THE BUILDING OFFICIAL PER IBC SECTION 1704.2.5.1. AT COMPLETION OF FABRICATION.

THE SPECIAL INSPECTION AGENCIES DUTIES SHALL INCLUDE THE FOLLOWING:

12.1 SOILS:
SPECIAL INSPECTION IS REQUIRED OF THE EXISTING SITE SOIL CONDITIONS, FILL PLACEMENT, AND LOAD-BEARING REQUIREMENTS PER IBC SECTION 1705.6.

12.2 PILE & PIER FOUNDATIONS:
SPECIAL INSPECTIONS OF PIER OR PILE FOUNDATIONS ARE REQUIRED PER IBC SECTIONS 1705.7 AND 1705.8.

13. SHOP DRAWINGS FOR REINFORCING STEEL, CONNECTOR PLATE WOOD ROOF TRUSSES, AND PRE-ENGINEERED METAL COMPONENTS SHALL BE SUBMITTED TO THE ARCHITECT AND STRUCTURAL ENGINEER FOR REVIEW PRIOR TO FABRICATION OF THESE ITEMS.

ENGINEER OF RECORD SHALL REVIEW SHOP DRAWINGS FOR DESIGN INTENT ONLY. DIMENSIONS AND QUANTITIES ARE NOT GUARANTEED BY THE ENGINEER OF RECORD, AND THEREFORE, MUST BE VERIFIED BY THE GENERAL CONTRACTOR. DRAWINGS FOR COMPONENTS DESIGNED PRIMARILY BY OTHERS SHALL BE APPROVED BY THE COMPONENT DESIGNER PRIOR TO CURSORY REVIEW BY THE ENGINEER OF RECORD FOR LOADS IMPOSED ON THE BASIC STRUCTURE. SUBMITTALS SHALL INCLUDE A REPRODUCIBLE AND A COPY; REPRODUCIBLE WILL BE REVIEWED AND RETURNED. SHOP DRAWINGS MUST BE REVIEWED AND STAMPED BY CONTRACTOR PRIOR TO REVIEW BY ENGINEER.

14. PRE-MANUFACTURED, PRE-ENGINEERED STRUCTURAL COMPONENTS SHALL BE DESIGNED BASED ON THE CRITERIA PRESENTED IN THE CONTRACT DOCUMENTS. THE COMPONENT DESIGNER IS RESPONSIBLE FOR CODE CONFORMANCE, TEMPORARY AND PERMANENT BRACING AND ALL NECESSARY CONNECTIONS, INCLUDING CONNECTIONS TO THE PRIMARY STRUCTURE, NOT SPECIFICALLY CALLED OUT ON THE ARCHITECTURAL OR STRUCTURAL DRAWINGS. SHOP DRAWINGS SHALL INDICATE THE MAGNITUDE AND DIRECTION OF ALL LOADS IMPOSED ON THE PRIMARY STRUCTURE. SHOP DRAWINGS AND CALCULATIONS SHALL BE SUBMITTED PER PARAGRAPH "A.13." OF THESE NOTES.

15. DEFERRED SUBMITTALS – THE FOLLOWING ITEMS ARE CONSIDERED TO BE DEFERRED SUBMITTALS UNDER SECTION 107.3.4.1 OF THE INTERNATIONAL BUILDING CODE AND MUST BE SUBMITTED TO THE ARCHITECT OR THE ENGINEER FOR REVIEW. THESE ITEMS WILL THEN BE FORWARDED TO THE BUILDING OFFICIAL FOR APPROVAL. THE DEFERRED SUBMITTAL ITEMS SHALL NOT BE INSTALLED UNTIL THEIR DESIGN AND SUBMITTAL DOCUMENTS HAVE BEEN APPROVED BY THE BUILDING OFFICIAL. DESIGN SUBMITTALS SHALL BEAR THE STAMP AND SIGNATURE OF A REGISTERED STRUCTURAL ENGINEER IN THE STATE OF WASHINGTON

- * PRE-ENGINEERED WOOD TRUSSES
- PRE-ENGINEERED CANOPIES

B. DESIGN CRITERIA

1. DESIGN LOADS

ROOF LIVE LOAD 25 PSF (SNOW*, Is=1.0)
ROOF DEAD LOAD 15 PSF
FLOOR LIVE LOAD (RESIDENTIAL) 40 PSF (REDUCIBLE)
FLOOR LIVE LOAD (BALCONIES\DECKS) 60 PSF (REDUCIBLE)
FLOOR DEAD LOAD 15 PSF

WIND (ASCE 7–16) $V_{ULT} = 97$ MPH, $V_{ASD} = 75$ MPH, (3 sec gust)
ENCLOSED BUILDING, EXPOSURE "B", $I_w=1.0$, $K_{zt} = 1.6$

EARTHQUAKE (ASCE 7–16) SITE CLASS D
OCCUPANCY CATEGORY II ($I_e = 1.0$)
SEISMIC DESIGN CATEGORY D
 $S_s = 1.467g$, $S_1 = 0.507g$
 $S_{ds} = 1.174g$, $S_{d1} = 0.608g$
 $R=6.5$, $r = 1.3$
 $V_{ULT} = C_S W = 0.235W = 25.9$ KIPS
EQUIVALENT LATERAL FORCE PROCEDURE
LATERAL LOADS ARE RESISTED BY STRUCTURAL WOOD
PANEL SHEAR WALLS & DIAPHRAGMS

ALLOWABLE SOIL PRESSURE** 2000 PSF
LATERAL EARTH PRESSURE** 35 PCF ACTIVE\100 PSF SURCHARGE\7H SEISMIC
55 PCF AT-REST\14H SEISMIC
250 PSF PASSIVE
0.35 COEFFICIENT OF FRICTION

**SOILS REPORT REFERENCE: "GEOTECHNICAL REPORT PROPOSED REMODEL, 8109 SOUTHEAST 71ST ST, MERCER ISLAND, WA", PREPARED BY, PANGEO INC, FILE # 24–093, DATED, NOVEMBER 1, 2024

C. FOUNDATION

1. FOUNDATION EXCAVATION, BACKFILL AND COMPACTION SHALL CONFORM TO SPECIFICATION REQUIREMENTS. THIS CONSTRUCTION WORK, INCLUDING DRAINAGE, SHORING AND SUCH OTHER RELATED WORK AS REQUIRED, SHALL BE CONDUCTED BY THE CONTRACTOR UNDER THE OBSERVATION AND DIRECTION OF THE GEOTECHNICAL ENGINEER.

2. FOOTINGS SHALL BEAR ON SOLID UNDISTURBED EARTH (CONTROLLED, COMPACTED STRUCTURAL FILL OR BOTH) AT LEAST 18" BELOW LOWEST ADJACENT FINISHED GRADE. MATERIAL TO BE COMPACTED TO 95% MINIMUM OF MAXIMUM DRY DENSITY AS DETERMINED BY ASTM D1557.

3. FOOTINGS MAY BE POURED IN NEAT EXCAVATIONS PROVIDED SIZE IS INCREASED 3" AT EACH INTERFACE WITH SOIL.

4. ALL FOOTING EXCAVATIONS SHALL BE HAND CLEANED PRIOR TO PLACING CONCRETE.

5. ALL ABANDONED FOOTINGS, UTILITIES, ETC. THAT INTERFERES WITH NEW CONSTRUCTION SHALL BE REMOVED.

6. CONTRACTOR SHALL PROVIDE FOR DESIGN AND INSTALLATION OF ALL CRIBBING, SHEATHING, AND SHORING REQUIRED TO SAFELY RETAIN EXCAVATIONS.

7. BACKFILL BEHIND ALL WALLS WITH WELL DRAINING, GRANULAR FILL MATERIAL, AND PROVIDE PERFORATED PIPE DRAINS AS DESCRIBED IN THE SOILS REPORT. BACKFILL BEHIND WALLS SHALL NOT BE PLACED BEFORE THE WALL IS PROPERLY SUPPORTED BY THE FLOOR SLAB, OR TEMPORARY BRACING. ALL FOOTINGS SHALL BE CENTERED BELOW CENTERLINE OF COLUMNS OR WALLS ABOVE, UNLESS NOTED OTHERWISE.

C.1. PIN PILE FOUNDATION

- PIN PILE TO BE 2" DIAMETER SCHEDULE 80 PIPE. PIN PILE DESIGN CAPACITY IS 4 KIPS
- PIN PILES ARE TO BE DRIVEN USING A 90-POUND PNEUMATIC JACKHAMMER UNTIL REFUSAL. REFUSAL IS DEFINED AS A PENETRATION RESISTANCE OF LESS THAN 1 INCH OF PENETRATION PER MINUTE OF SUSTAINED DRIVING.
- PIN PILE TO EXTEND 6" MINIMUM INTO PILE CAP. PROVIDE COMPRESSION FIT CAP.
- PIPE PILE TO BE SPLICED WITH COMPRESSION FIT SLEEVED COUPLER OR COMPLETE PENETRATION WELD.
- THE GEOTECHNICAL ENGINEER OF RECORD OR HIS/HER REPRESENTATIVE SHALL PROVIDE FULL-TIME OBSERVATION OF PILE INSTALLATION AND TESTING TO VERIFY THE DRIVING REFUSAL CRITERIA.
- IT IS RECOGNIZED THAT THE IBC REQUIRES 8-INCH MINIMUM DIAMETER PIPE FOR PIPE PILE INSTALLATION. APPROPRIATE ANALYSIS/EVALUATION AND TESTING REQUIREMENTS ARE PROVIDED TO ALLOW FOR USE OF PILES LESS THAN 8-INCHES IN DIAMETER AS REQUIRED BY SECTION 1810.3.5.3. OF THE IBC.
- A MINIMUM OF 3% OF THE PILES (1 MINIMUM AND UP TO 5 PILES MAXIMUM) SHOULD BE LOAD TESTED TO VERIFY DESIGN LOAD CAPACITIES. ALL LOAD TESTS SHALL BE PERFORMED IN ACCORDANCE WITH THE PROCEDURE OUTLINED IN ASTM D1143. THE MAXIMUM TEST LOAD SHALL BE 2X THE DESIGN LOAD. TEST LOAD = 12 KIPS FOR 2 INCH PILE. VERIFY WITH GEOTECHNICAL REPORT AND SPECIAL INSPECTION IF LOAD TESTING IS REQUIRED.

D. CONCRETE

1. ULTIMATE STRENGTH DESIGN PER INTERNATIONAL BUILDING CODE AND ACI 318–14.

2. CONCRETE SHALL MEET THE FOLLOWING MINIMUM REQUIREMENTS

2.1. CONCRETE SHALL ATTAIN A 28-DAY STRENGTH OF $f'_c = 3,500$ PSI (2,500 PSI DESIGN) AND MIX SHALL CONTAIN NOT LESS THAN 5-1/2 SACKS OF CEMENT PER CUBIC YARD AND SHALL BE PROPORTIONED TO PRODUCE A SLUMP OF 5" OR LESS. EXPOSURE CLASS F1, SO, WO & CO.

3. THE MINIMUM AMOUNTS OF CEMENT AND MAXIMUM AMOUNTS OF WATER MAY BE CHANGED IF A CONCRETE DESIGN MIX IS SUBMITTED TO THE STRUCTURAL ENGINEER AND THE BUILDING DEPARTMENT FOR APPROVAL TWO WEEKS PRIOR TO PLACING ANY CONCRETE. THE CONCRETE PERFORMANCE MIX SHALL INCLUDE THE AMOUNTS OF CEMENT, FINE AND COARSE AGGREGATE, WATER AND ADMIXTURES AS WELL AS THE WATER CEMENT RATIO, SLUMP, CONCRETE YIELD AND SUBSTANTIATING STRENGTH DATA IN ACCORDANCE WITH ACI 318, CHAPTERS 19 AND 26.

ALL CONCRETE EXPOSED TO FREEZING TEMPERATURES WHILE CURING AND ALL CONCRETE PERMANENTLY EXPOSED TO WEATHER SHALL BE AIR-ENTRAINED WITH AN AIR-ENTRAINING AGENT CONFORMING TO ACI 318. TOTAL AIR CONTENT SHALL BE 6% IN ACCORDANCE WITH TABLE 19.3.3.1.

NO ADMIXTURES, OTHER THAN FOR AIR-ENTRAINMENT AS NOTED ABOVE, SHALL BE USED WITHOUT PRIOR REVIEW BY THE STRUCTURAL ENGINEER.

4. REINFORCING

REINFORCING STEEL SHALL BE DEFORMED BARS CONFORMING TO ASTM A615 (INCLUDING SUPPLEMENT S1), GRADE 60, $f_y = 60,000$ PSI.

WELDED WIRE REINFORCEMENT: ASTM A82 AND ASTM A185, SPLICE WITH AT LEAST ONE FULL MESH. PLACE AT MID-DEPTH, OR SLIGHTLY ABOVE, OF SLAB. MATERIAL TO BE SUPPLIED IN FLAT SHEETS.

5. REINFORCING STEEL SHALL BE DETAILED (INCLUDING HOOKS AND BENDS) IN ACCORDANCE WITH ACI 318 (LATEST EDITION). LAP ALL CONTINUOUS REINFORCEMENT PER NOTE D.6. PROVIDE CORNER BARS AT ALL WALL INTERSECTIONS. LAP CORNER BARS PER NOTE D.6. LAP ADJACENT MATS OF WELDED WIRE REINFORCEMENT A MINIMUM OF 8" AT SIDES AND ENDS.

NO BARS PARTIALLY EMBEDDED IN HARDENED CONCRETE SHALL BE FIELD BENT UNLESS SPECIFICALLY SO DETAILED OR APPROVED BY THE STRUCTURAL ENGINEER.

6. REINFORCING STEEL LAPS AND EMBEDMENT SHALL BE AS NOTED BELOW, UNLESS NOTED OTHERWISE:

DEVELOPMENT LENGTH 48 BAR DIAM. – 24" MINIMUM

LAP SPLICE LENGTH 64 BAR DIAM. – 24" MINIMUM

ALL HOOKS SHALL BE "STANDARD" IN ACCORDANCE WITH ACI 318. REINFORCING SHALL NOT BE TACK WELDED. DO NOT WELD GRADE 60 REINFORCING.

7. CONCRETE PROTECTION (COVER) FOR REINFORCING STEEL SHALL BE AS FOLLOWS:

FOOTINGS AND OTHER UNFORMED SURFACES, EARTH FACE 3"
FORMED SURFACES EXPOSED TO EARTH (i.e. WALLS BELOW GROUND) OR WEATHER (#5 BARS OR SMALLER) 1-1/2"

8. CONCRETE WALL REINFORCING – PROVIDE THE FOLLOWING UNLESS DETAILED OTHERWISE:

6" WALLS #4 @ 13 HORIZ. #4 @ 13 VERTICAL 1 CURTAIN @ CENTER
8" WALLS #5 @ 15 HORIZ. #5 @ 15 VERTICAL 1 CURTAIN @ CENTER

9. NON-SHRINK GROUT SHALL BE FURNISHED BY AN APPROVED MANUFACTURER AND SHALL BE MIXED AND PLACED IN STRICT ACCORDANCE WITH THE MANUFACTURER'S PUBLISHED RECOMMENDATIONS. GROUT SHALL BE NON-SHRINK, CEMENT-BASED AND HAVE A MINIMUM COMPRESSIVE STRENGTH AT 28 DAYS OF $f'_c = 5000$ PSI WHEN TESTED IN ACCORDANCE WITH ASTM C109.

10. ADHESIVE ANCHOR SYSTEM SHALL BE SET-XP OR SET-3G EPOXY BY SIMPSON STRONG-TIE, HIT-HY 200-A OR HIT-RE 500 V3 BY HILTI, AC208+ BY DEWALT, OR APPROVED EQUAL.

11. ALL WOOD PLATES IN DIRECT CONTACT WITH CONCRETE OR MASONRY SHALL BE PRESSURE-TREATED (SEE WOOD SECTION).

E. CARPENTRY

1. GLUED LAMINATED MEMBERS SHALL BE FABRICATED IN CONFORMANCE WITH ANSI STANDARD A190.1. EACH MEMBER SHALL BEAR AN AITC OR APA EWS IDENTIFICATION MARK AND SHALL BE ACCOMPANIED BY AN AITC OR APA EWS CERTIFICATE OF CONFORMANCE. ALL SIMPLE SPAN BEAMS SHALL BE DOUGLAS FIR COMBINATION 24F–V4, $F_b = 2,400$ PSI, $F_v = 240$ PSI. ALL CANTILEVERED BEAMS SHALL BE DOUGLAS FIR COMBINATION 24F–V8, $F_b = 2,400$ PSI, $F_v = 240$ PSI. CAMBER ALL GLULAM BEAMS TO 2,000' RADIUS, UNLESS SHOWN OTHERWISE ON THE PLANS.

2. FRAMING LUMBER SHALL BE GRADED AND MARKED IN CONFORMANCE WITH WCLB STANDARD GRADING RULES FOR WEST COAST LUMBER, LATEST EDITION. FURNISH TO THE FOLLOWING MINIMUM STANDARDS:

MEMBER	SIZE	SPECIES	GRADE	MIN. BASIC DESIGN STRESS
JOISTS AND RAFTERS:	2x, 3x	HEM.FIR	#2	$F_b = 850$ PSI
	4x	HEM.FIR	#2	$F_b = 850$ PSI

BEAMS AND STRINGERS:	6x and LARGER	HEM.FIR	#1	$F_b = 1050$ PSI
----------------------	---------------	---------	----	------------------

POSTS AND TIMBERS:	6x6, 6x8	HEM.FIR	#1	$F_c = 850$ PSI
TOP AND BOTTOM PLATES AT SHEAR WALLS AND BEARING WALLS:		HEM.FIR	#2	$F_b = 850$ PSI

STUDS, PLATES, & MISC. LIGHT FRAMING:		HEM.FIR	#2	$F_b = 850$ PSI
---------------------------------------	--	---------	----	-----------------

ALL LUMBER WITH A LEAST DIMENSION OF 2" (NOMINAL) SHALL BE STAMPED SURFACE-DRY AND SHALL HAVE A MOISTURE CONTENT WHEN SURFACED AND WHEN INSTALLED OF NOT MORE THAN 19 PERCENT. LUMBER WITH A LEAST DIMENSION OF 4" (NOMINAL) OR GREATER SHALL BE STAMPED SURFACE-GREEN AND AIR-DRIED TO A MOISTURE CONTENT OF NOT MORE THAN 19 PERCENT PRIOR TO ITS USE IN FRAMING THE STRUCTURE.

3. MANUFACTURED LUMBER SHALL BE AS MANUFACTURED BY TRUS JOIST OR APPROVED EQUAL. REQUESTS FOR APPROVAL AS EQUAL WILL REQUIRE SUBMITTAL OF ICC REPORT EQUIVALENT TO ESR-1387 FOR LAMINATED STRAND LUMBER (LSL), LAMINATED VENEER LUMBER (LVL), OR PARALLEL STRAND LUMBER (PSL). THE MINIMUM ALLOWABLE DESIGN VALUES ARE AS FOLLOWS:

LSL – $F_b = 2,250$; $F_v = 400$ PSI; $E = 1,550,000$ PSI
LVL – $F_b = 2,600$; $F_v = 285$ PSI; $E = 1,800,000$ PSI
PSL – $F_b = 2,900$; $F_v = 290$ PSI; $E = 2,000,000$ PSI

4. PREFABRICATED CONNECTOR PLATE WOOD ROOF TRUSSES SHALL BE DESIGNED BY THE MANUFACTURER IN ACCORDANCE WITH THE "NATIONAL DESIGN STANDARD FOR METAL PLATE CONNECTED WOOD TRUSS CONSTRUCTION," ANSI/TPI 1–2014" BY TRUSS PLATE INSTITUTE FOR THE SPANS AND CONDITIONS SHOWN ON THE PLANS. MINIMUM LOADING SHALL BE AS FOLLOWS:

TOP CHORD LIVE LOAD 25 PSF (SNOW)
TOP CHORD DEAD LOAD 10 PSF
BOTTOM CHORD DEAD LOAD 10 PSF
TOTAL LOAD 45 PSF

ADDITIONAL LIVE LOAD CASES SHALL BE ANALYZED FOR UNBALANCED SNOW LOADS & SNOW DRIFTS PER ASCE 7–16, SECTIONS 7.6 & 7.7.

5. WOOD TRUSSES SHALL UTILIZE APPROVED CONNECTOR PLATES (GANGNAIL OR EQUAL). SUBMIT SHOP DRAWINGS AND DESIGN CALCULATIONS (COMPLETE WITH STRESS DIAGRAM) TO THE ARCHITECT AND STRUCTURAL ENGINEER FOR REVIEW PRIOR TO FABRICATION. SUBMITTED DOCUMENTS SHALL BEAR THE STAMP AND SIGNATURE OF A REGISTERED STRUCTURAL ENGINEER IN THE STATE OF WASHINGTON. PROVIDE FOR SHAPES, BEARING POINTS, INTERSECTIONS, HIPs, VALLEYS, ETC., SHOWN ON THE DRAWINGS. EXACT COMPOSITION OF SPECIAL HIP, VALLEY, AND INTERSECTION AREAS (USE OF GIRDER TRUSSES, JACK TRUSSES, STEP-DOWN TRUSSES, ETC.) SHALL BE DETERMINED BY THE MANUFACTURER UNLESS SPECIFICALLY INDICATED ON THE PLANS. PROVIDE ALL TRUSS TO TRUSS AND TRUSS TO GIRDER TRUSS CONNECTION DETAILS AND REQUIRED CONNECTION MATERIALS. PROVIDE FOR ALL TEMPORARY AND PERMANENT TRUSS BRACING AND BRIDGING.

6. SHEATHING SHALL BE APA PERFORMANCE RATED PANELS PER APA "PLYWOOD DESIGN SPECIFICATION", INCLUDING APPLICABLE SUPPLEMENTS, UNLESS NOTED OTHERWISE. PLYWOOD OR ORIENTED-STRAND BOARD (OSB) PANELS SHALL BE GRADE CD AND ALSO CONFORM TO DOC PS–1 & PS–2. ALL PANELS SHALL BE IDENTIFIED AS EXPOSURE 1 UNLESS NOTED OTHERWISE. PANEL RATING TO BE AS FOLLOWS UNLESS NOTED OTHERWISE:

ROOF: 19/32" (OR 5/8") THICK, 40/20
WALLS: 15/32" THICK, 32/16, OR 1/2" THICK, 24/0
FLOORS: 23/32" (OR 3/4") THICK, TONGUE & GROOVE, (48/24)

UNLESS NOTED OTHERWISE ON THE PLANS, ROOF AND FLOOR SHEATHING SHALL BE LAID UP WITH GRAIN PERPENDICULAR TO SUPPORTS AND NAILED WITH 8d NAILS @ 6"oc TO FRAMED PANEL EDGES AND OVER STUD WALLS SHOWN ON PLANS AND @ 12"oc (10"oc AT FLOORS) TO INTERMEDIATE SUPPORTS. PROVIDE APPROVED SHEATHING EDGE CLIPS @ 16"oc AT UNLOCKED ROOF SHEATHING EDGES. ALL FLOOR SHEATHING EDGES SHALL HAVE APPROVED TONGUE-AND-GROOVE JOINTS AND EDGE CLIPS. PROVIDE SOLID BLOCKING AT ALL EDGES ONLY WHERE NOTED ON PLANS. TOENAIL BLOCKING TO SUPPORTS WITH 16d NAILS, UNLESS NOTED OTHERWISE.

UNLESS NOTED OTHERWISE ON THE PLANS, WALL SHEATHING MAY BE LAID UP HORIZONTALLY OR VERTICALLY, UNSUPPORTED EDGES SHALL BE BLOCKED AND ALL EDGES SHALL BE NAILED WITH 8d @ 6"oc, NAIL WITH 8d @ 12"oc AT INTERMEDIATE SUPPORTS. NAIL SHEAR WALL SHEATHING TO ALL HOLDOWN STUDS USING EDGE NAIL SPACING WHEN HOLDOWN STUD DOES NOT OCCUR AT PANEL EDGES.

SHEATHING NAILS SHALL BE DRIVEN FLUSH BUT SHALL NOT FRACTURE THE SURFACE OF THE SHEATHING.

BARTLEY PAWLAK

STRUCTURAL ENGINEERS

2731 77th Ave SE #100
Mercer Island, WA 98040
Phone:206.456.3071
Fax:206.456.3076
www.BP-SE.com

PROJECT

THYGESEN RESIDENCE
8109 SE 71ST STREET
MERCER ISLAND, WA 98040

REVISIONS	
NO.	DATE
PERMIT	11/05/2024
 PERMIT REV	03/07/2025

12/20/23	23-195
DATE	JOB #
MT	TCB
DESIGN	CHECKED
BDS	AS NOTED
DRAWN	SCALE

SHEET TITLE

GENERAL
STRUCTURAL
NOTES

SHEET NO.

S1.1

GENERAL STRUCTURAL NOTES

3

7. INTERIOR WOOD MEMBERS IN DIRECT CONTACT WITH CONCRETE OR MASONRY SHALL BE PRESSURE-TREATED WITH SODIUM BORATE (SBX). WOOD MEMBERS EXPOSED TO WEATHER (UNPAINTED) OR IN DIRECT CONTACT WITH SOIL SHALL BE PRESSURE-TREATED WITH ALKALINE COPPER QUATERNARY (ACQ). NOTE THAT ACQ IS EXTREMELY CORROSIVE TO METALS. SBX IS NONTOXIC TO THE ENVIRONMENT. PROVIDE TWO LAYERS OF ASPHALT IMPREGNATED BUILDING PAPER BETWEEN UNTREATED LEDGERS, BLOCKING, ETC., AND CONCRETE OR MASONRY. ALL METAL CONNECTORS IN CONTACT WITH "ACQ" PRESSURE-TREATED LUMBER OR FIRE-RETARDANT-TREATED LUMBER SHALL BE TYPE 304 OR 316 STAINLESS STEEL. THIS INCLUDES WASHERS, SCREWS, NAILS, HANGERS, AND ANY OTHER MISCELLANEOUS LT. GAGE METAL CONNECTORS. WHERE ACQ LUMBER IS MISTAKENLY USED OR FOR FIRE-RETARDANT-TREATED LUMBER USED IN INTERIOR CONDITIONS, ASTM A 653, TYPE G185 ("HOT-DIP" GALVANIZED TO 1.85 OUNCES PER SQUARE FOOT) METAL CONNECTORS MAY BE USED IN LIEU OF STAINLESS STEEL. METAL CONNECTORS 1/2" THICK OR GREATER NEED NOT BE GALVANIZED FOR INTERIOR USE, NOR DO THEY NEED TO BE STAINLESS STEEL FOR EXTERIOR USE. METAL CONNECTORS 1/2" THICK PLUS MUST BE GALVANIZED FOR EXTERIOR USE, UNLESS SPECIFIED OTHERWISE BY THE ARCHITECT.

8. WOOD FASTENER NOTES – THE FOLLOWING APPLY UNLESS OTHERWISE SHOWN ON THE PLANS:

8.1 NOTATIONS ON DRAWINGS RELATING TO FRAMING CLIPS, JOIST HANGERS AND OTHER CONNECTING DEVICES REFER TO CATALOG NUMBERS OF CONNECTORS MANUFACTURED BY THE SIMPSON STRONG-TIE COMPANY, DUBLIN, CALIFORNIA. EQUIVALENT DEVICES BY OTHER MANUFACTURERS MAY BE SUBSTITUTED, PROVIDED THEY HAVE ICC APPROVAL FOR EQUAL OR GREATER LOAD CAPACITIES. SUBMIT MANUFACTURER'S CATALOG AND ICC REPORTS TO ARCHITECT AND ENGINEER FOR REVIEW WHEN REQUESTING SUBSTITUTIONS. ALL SPECIFIED FASTENERS MUST BE USED AND PROPER INSTALLATION PROCEDURES MUST BE OBSERVED IN ORDER TO OBTAIN ICC APPROVED LOAD CAPACITIES. VERIFY THAT THE DIMENSIONS OF THE SUPPORTING MEMBER ARE SUFFICIENT TO RECEIVE THE SPECIFIED FASTENERS.

8.2 NAILS SHALL BE MANUFACTURED IN CANADA OR THE UNITED STATES IN SIZES AND TYPES AS FOLLOWS, UNLESS NOTED OTHERWISE:

PNEUMATIC NAILING – PLAIN SHANK, COATED OR GALVANIZED

8d = .131 DIAMETER x 2-1/2" MINIMUM LENGTH

10d = .148 DIAMETER x 3" MINIMUM LENGTH

16d = .162 DIAMETER x 3-1/4" MINIMUM LENGTH

20d = .192 DIAMETER x 4" MINIMUM LENGTH

HAND NAILING – SINKERS, COATED

8d = 11-1/2 GAGE x 2-3/8"

10d = 11 GAGE x 2-7/8"

16d = 9 GAGE x 3-1/4"

9. WOOD FRAMING NOTES – THE FOLLOWING APPLY UNLESS OTHERWISE SHOWN ON THE PLANS:

9.1 ALL WOOD FRAMING DETAILS NOT SHOWN OTHERWISE SHALL BE CONSTRUCTED TO THE MINIMUM STANDARDS OF THE INTERNATIONAL BUILDING CODE. MINIMUM NAILING, UNLESS OTHERWISE NOTED, SHALL CONFORM TO TABLE 2304.10.1 OF THE INTERNATIONAL BUILDING CODE. COORDINATE THE SIZE AND LOCATION OF ALL OPENINGS WITH MECHANICAL AND ARCHITECTURAL DRAWINGS.

9.2 WALL FRAMING: ALL STUD WALLS SHOWN AND NOT OTHERWISE NOTED SHALL BE 2x4 STUDS @ 16"oc AT INTERIOR WALLS AND 2x6 STUDS @ 16"oc AT EXTERIOR WALLS. TWO STUDS MINIMUM SHALL BE PROVIDED AT THE END OF ALL WALLS AND AT EACH SIDE OF ALL OPENINGS. UNLESS NOTED OTHERWISE A (2) 2x8 HEADER SHALL BE PROVIDED OVER ALL OPENINGS IN 2x4 STUD WALLS AND A (3) 2x8 HEADER OVER ALL OPENINGS IN 2x6 WALLS. SOLID BLOCKING FOR WOOD COLUMNS SHALL BE PROVIDED THROUGH FLOORS TO SUPPORT BELOW. PROVIDE CONTINUOUS SOLID BLOCKING AT MID-HEIGHT OF ALL STUD WALLS OVER 8'-0" IN HEIGHT.

ALL STUD WALLS SHOWN ON STRUCTURAL DRAWINGS SHALL HAVE THEIR LOWER PLATES ATTACHED TO WOOD FRAMING BELOW WITH 16d NAILS AT 12"oc STAGGERED OR BOLTED TO CONCRETE OR MASONRY WITH 5/8" DIAMETER BY 10" LONG ANCHOR BOLTS, EMBEDDED 7" AND SPACED AT 4'-0"oc MAXIMUM, UNLESS NOTED OTHERWISE (UNO) ON PLANS. SHEAR WALLS REQUIRE MINIMUM 3"x3"x1/4" SQUARE PLATE WASHERS AT ALL ANCHOR BOLTS. REFER TO THE STRUCTURAL PLANS AND SHEAR WALL SCHEDULE FOR REQUIRED SHEATHING AND NAILING.

9.3 FLOOR AND ROOF FRAMING: PROVIDE DOUBLE JOISTS UNDER ALL PARALLEL PARTITIONS AND AROUND ALL OPENINGS IN FLOORS OR ROOFS UNLESS OTHERWISE NOTED. PROVIDE BRIDGING @ 8'-0"oc AND SOLID BLOCKING AT ALL BEARING POINTS. COORDINATE THE SIZE AND LOCATION OF ALL OPENINGS WITH ARCHITECTURAL AND MECHANICAL DRAWINGS.

TOENAIL JOISTS TO BEARING SUPPORTS WITH 16d NAILS. UNLESS NOTED OTHERWISE, ATTACH JOISTS TO FLUSH HEADERS OR BEAMS WITH SIMPSON "LU" SERIES METAL JOIST HANGERS TO SUIT JOIST SIZE. ALL DOUBLE JOISTS, BEAMS, AND SLOPED AND/OR SKEWED JOISTS SHALL BE CONNECTED TO FLUSH MEMBERS WITH U-SERIES JOIST HANGERS UNLESS NOTED OTHERWISE. SKEW AND SLOPE ALL CONNECTORS AS REQUIRED. FACE-NAIL ALL MULTI-JOIST BEAMS TOGETHER WITH 16d SPIKES @ 24"oc STAGGERED.

BARTLEY

PAWLAK

STRUCTURAL

ENGINEERS


2731 77th Ave SE #100

Mercer Island, WA 98040

Phone:206.456.3071

Fax:206.456.3076

www.BP-SE.com

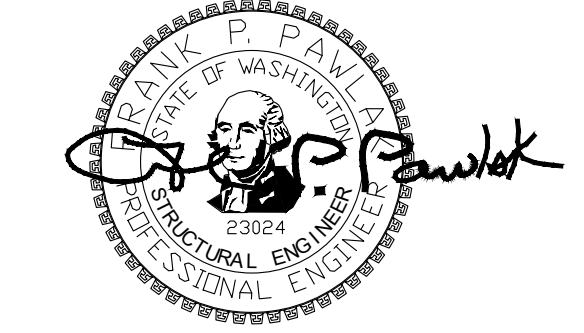

PROJECT

THYGESEN RESIDENCE
8109 SE 71ST STREET
MERCER ISLAND, WA 98040

REVISIONS

NO.	DATE
	PERMIT 11/05/2024
	PERMIT REV 03/07/2025


12/20/23	23-195
DATE	JOB #
MT	TCB
DESIGN	CHECKED
BDS	AS NOTED
DRAWN	SCALE

SHEET TITLE

GENERAL
STRUCTURAL
NOTES

SHEET NO.

S1.2

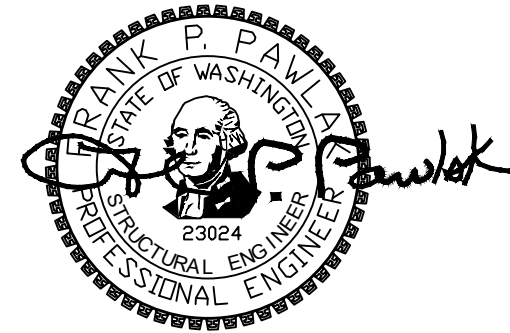

PROJECT

THYGESEN RESIDENCE
8109 SE 71ST STREET
MERCER ISLAND, WA 98040

REVISIONS

NO.	DATE
PERMIT	11/05/2024
PERMIT REV	03/07/2025

12/20/23	23-195
DATE	JOB #
MT	TCB
DESIGN	CHECKED
BDS	AS NOTED
DRAWN	SCALE

SHEET TITLE

FOUNDATION
PLAN


SHEET NO.

S2.1




1/4"=1'-0"

3

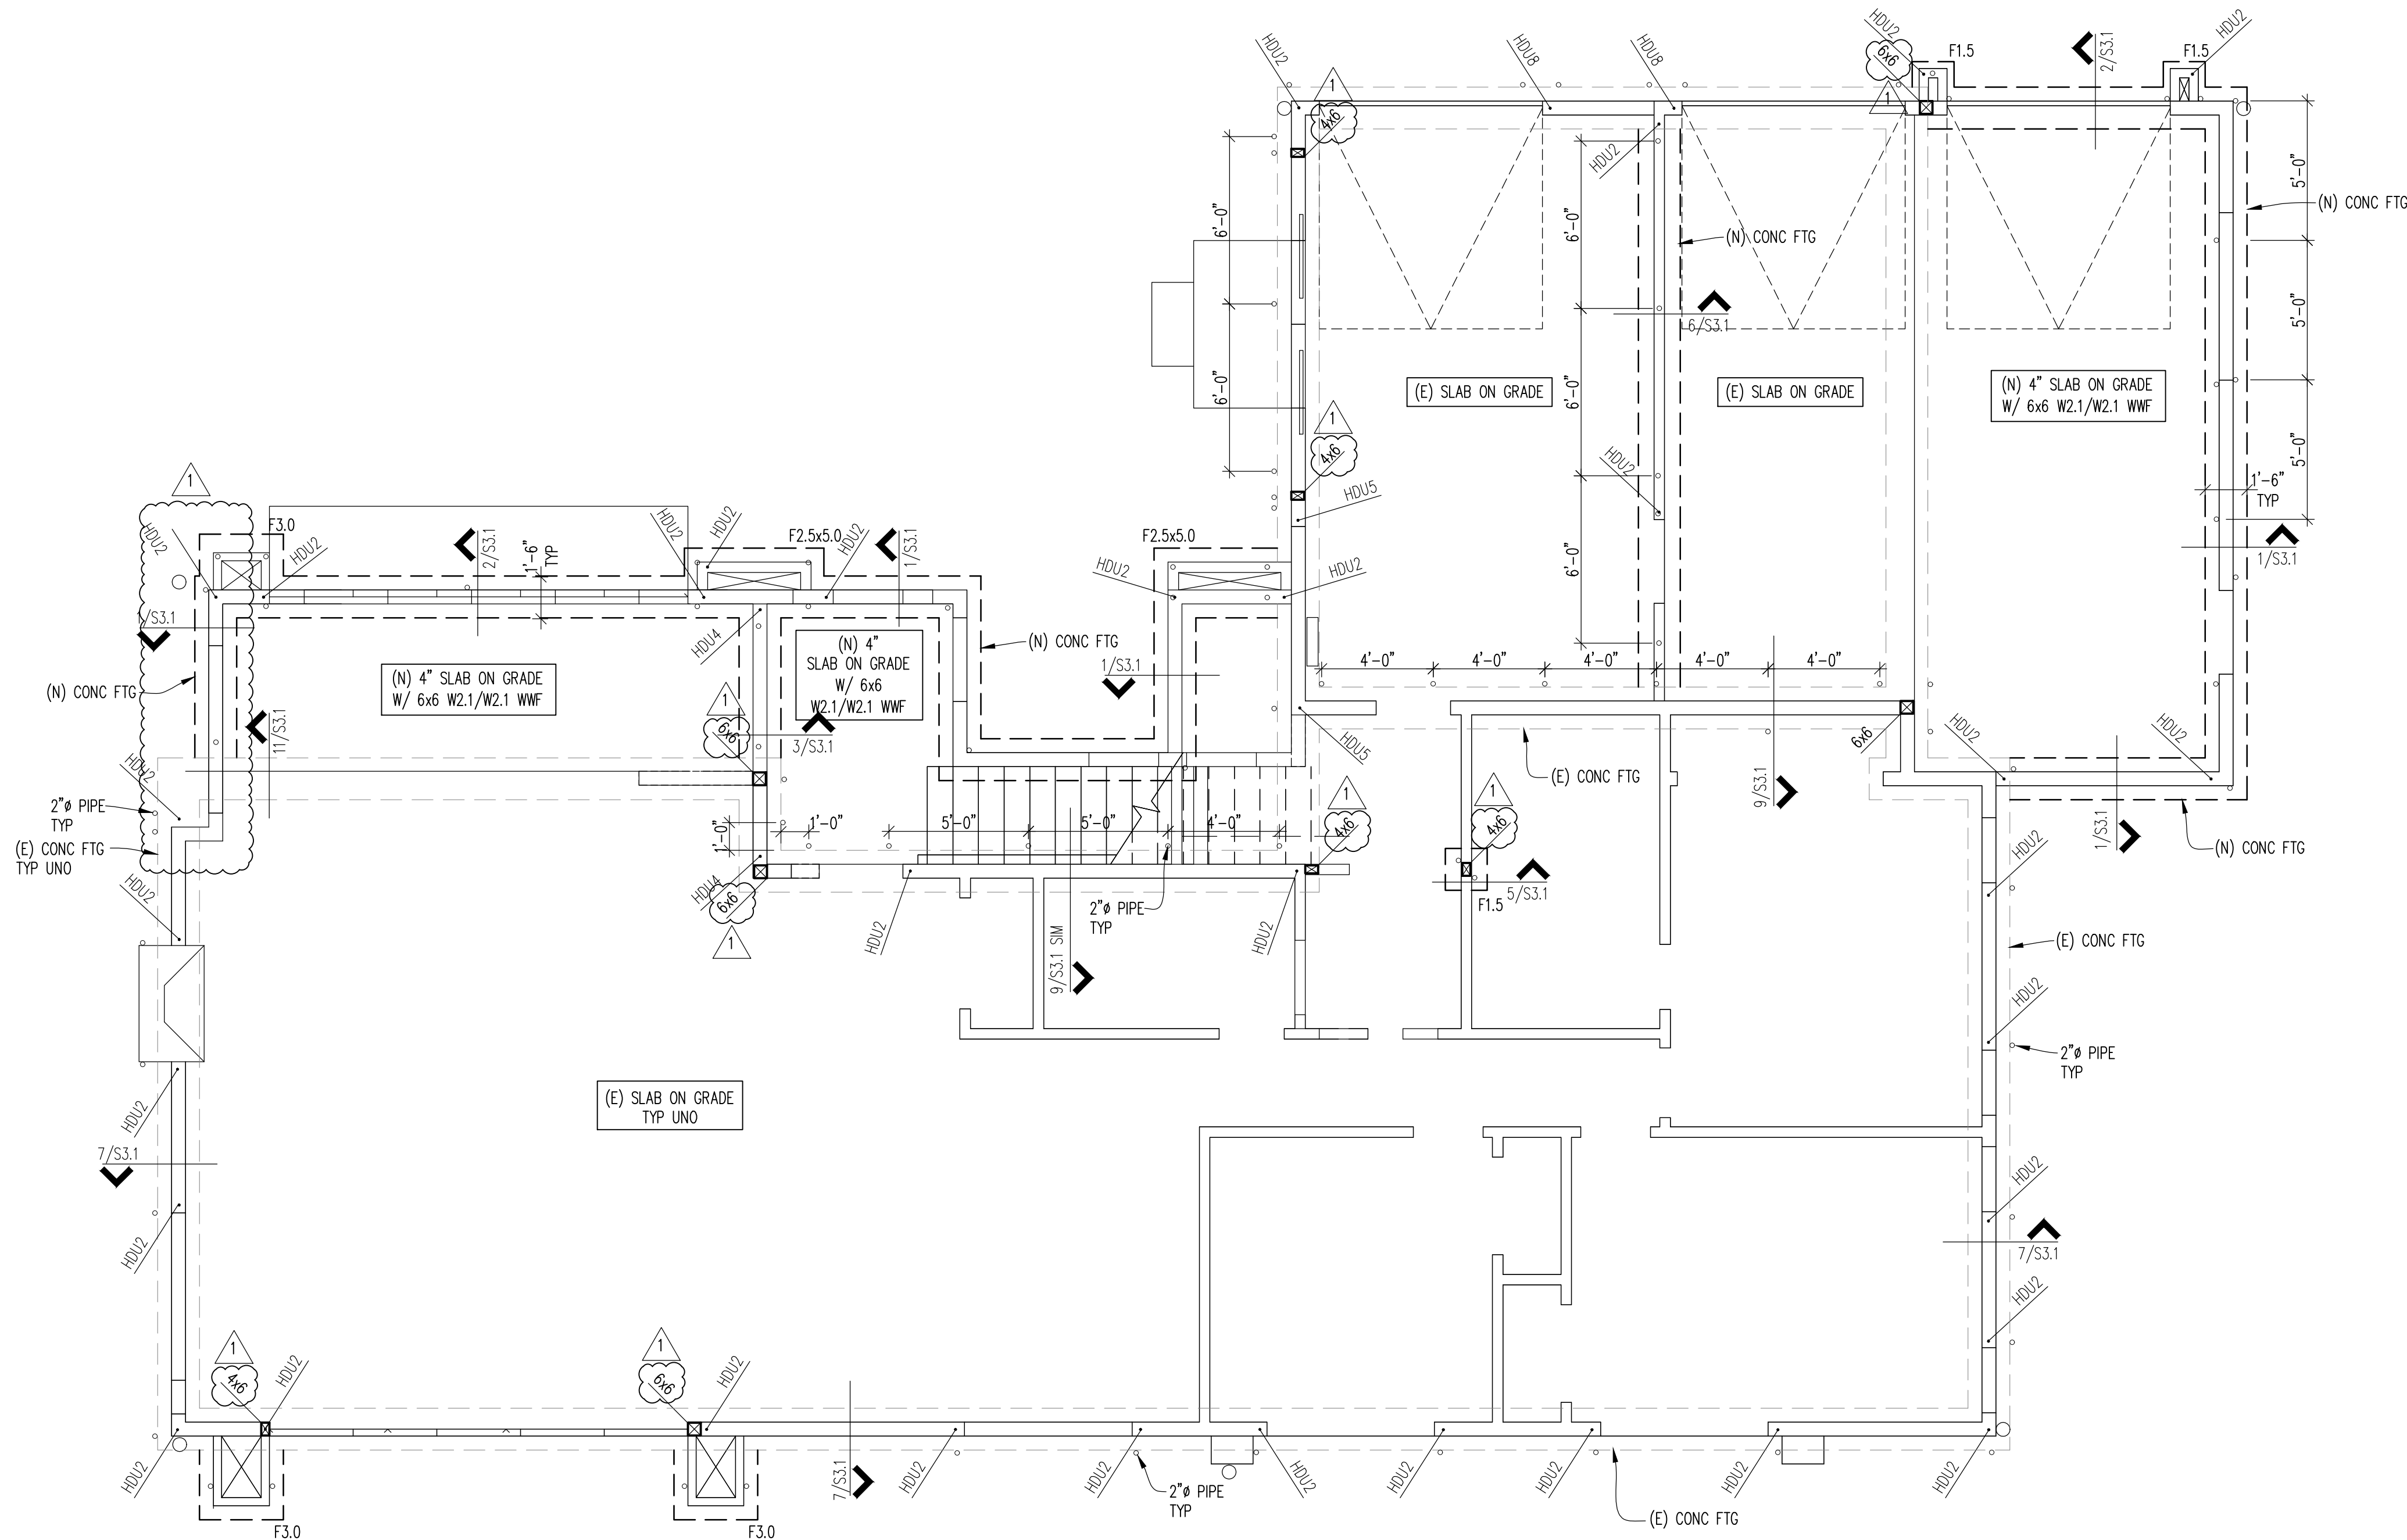

- NOTES:
- SEE ARCH FOR DIMENSIONS
 - SEE SHEETS S3.X FOR TYPICAL CONCRETE DETAILS;
SEE SHEETS S4.X FOR TYPICAL WOOD FRAMING DETAILS.
 - INDICATES HOLD-DOWN TYPE, SEE 12/S2.1 FOR HOLD-DOWN SCHEDULE.
 - SEE ARCH FOR INSULATION BELOW SLAB-ON-GRADE, IF APPLICABLE.
 - FOOTING SCHEDULE
F1.5 1'-6"x1'-6"x16"THK W/ (2) #4 EW BOT
F2.0 2'-0"x2'-0"x16"THK W/ (2) #4 EW BOT
F2.5 2'-6"x2'-6"x16"THK W/ (3) #4 EW BOT
F3.0 3'-0"x3'-0"x16"THK W/ (3) #4 EW BOT
F3.5 3'-6"x3'-6"x16"THK W/ (4) #4 EW BOT
F2.5x5.0 2'-6"x5'-0"x16"THK W/ (3) #4 TRAN & (6) #4 LONG BOT

INDICATES EXISTING (E) FOOTING
 INDICATES NEW (N) FOOTING

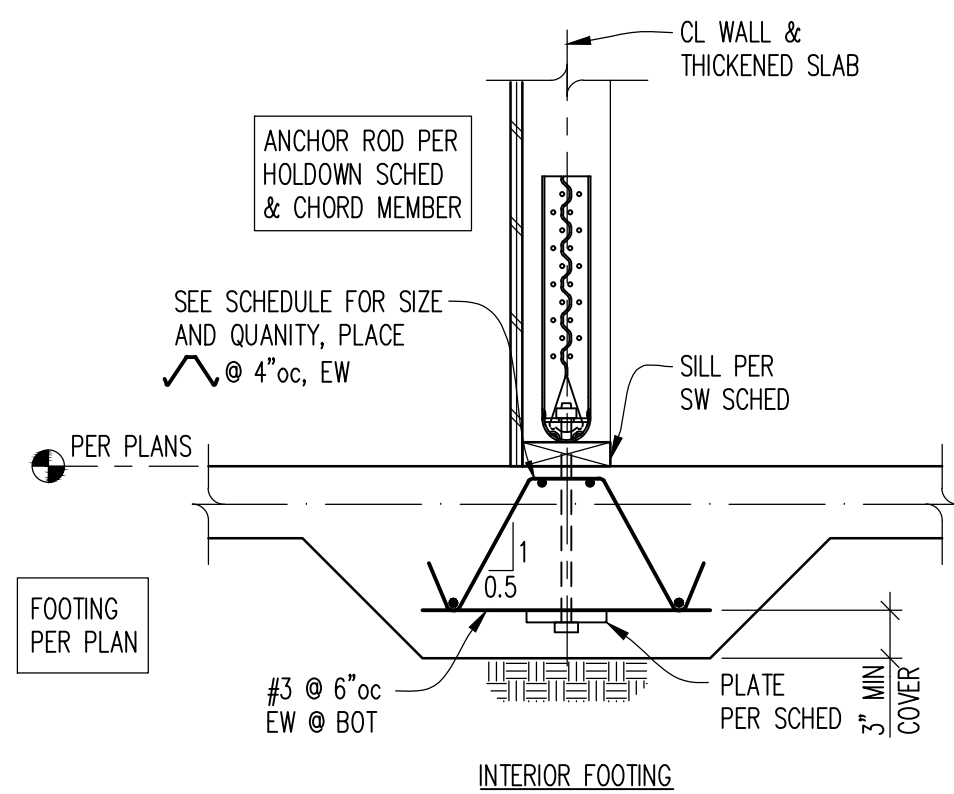

- NOTES:
- PROVIDE ASTM F1554 GR.105 HEADED ANCHORS FOR HOLDOWN ANCHORS.
 - CONNECT HOLDOWN TO CONCRETE WALL BELOW PER DETAIL.
 - QUANTITY OF NAILS FOR STRAPS ARE EVENLY DIVIDED BETWEEN ENDS OF STRAPS ABOVE AND BELOW THE DEPTH OF THE FLOOR SYSTEM, SEE X/S4.X. USE 16d COMMON NAILS.
 - WOOD MEMBERS (MIN) ABOVE AND BELOW WHERE OCCURS AT FLOOR LEVEL IF SHEAR WALL REQUIRES 3x STUDS, USE 3x INSTEAD OF 2x.
 - HOLDOWN DETAIL AT FLOOR-TO-FLOOR HOLDOWNS CONDITION PER 12/S4.3.
 - HOLDOWN SCHEDULE IS PROVIDED FOR GENERAL INSTALLATION INFORMATION. NOT ALL HARDWARE SCHEDULED IS REQUIRED. SEE PLANS FOR HOLDOWN CALL-OUTS AND LOCATIONS. CONSULT MANUFACTURER FOR ADDITIONAL INFORMATION.


HOLDOWN SCHEDULE(HF# FRAMING)


MARK	FASTENERS TO CONCRETE			FASTENERS TO WOOD STUDS OR POSTS				ASD ALLOWABLE LOAD (LBS)
	ANCHOR DIAMETER SEE NOTE 1	EMBEDMENT LENGTH INTO CONCRETE: WALL & HAIRPINS SLAB & HAIRPINS SEE NOTE 2	EMBED PLATE @ INT FTGS	SDS 1/4"x2 1/2" SCREWS	16d COMMON NAILS SEE NOTE 4	CHORD MEMBER SEE NOTE 5		
MSTC40	3" x 16 GA	-	-	-	(32) 16d	(3) 2x STUDS		2,650
MSTC48B3	3" x 14 GA	-	-	-	(54) 10d	(3) 2x STUDS		3,420
HDU2	3/8"	18" & 1-#4	2-#4	6	-	(3) 2x STUDS		2,215
HDU4	3/8"	18" & 1-#4	2-#4	10	-	(3) 2x STUDS		3,285
HDU8	7/8"	18" & 2-#4	2-#4	1/2x5x5	20	6x6		5,665

TYPICAL HOLDOWN DETAIL/FOUNDATION

12

FOUNDATION PLAN

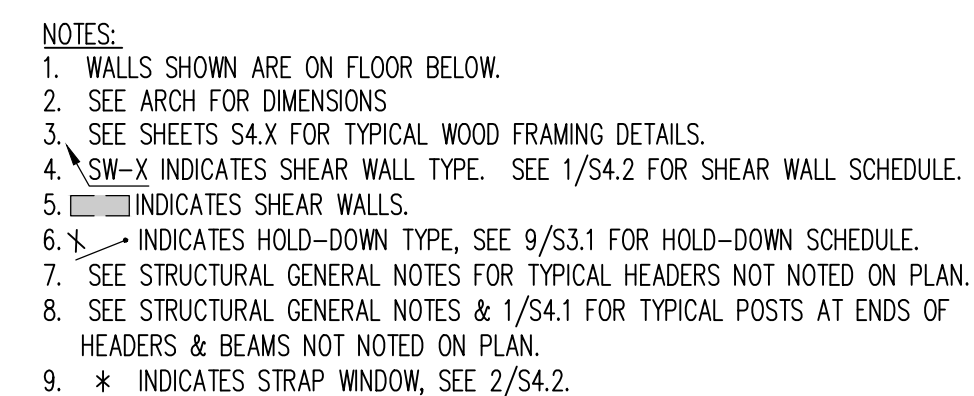

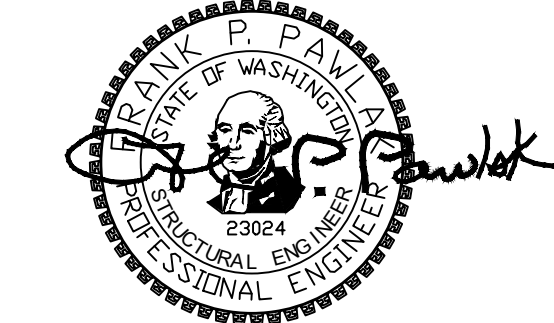

PROJECT

THYGESSEN RESIDENCE
8109 SE 71ST STREET
MERCER ISLAND, WA 98040

REVISIONS

NO.	DATE
PERMIT	11/05/2024
PERMIT REV	03/07/2025


12/20/23	23-195
DATE	JOB #
MT	TCB
DESIGN	CHECKED
BDS	AS NOTED
DRAWN	SCALE

SHEET TITLE


ROOF
FRAMING PLAN

SHEET NO.

S2.3

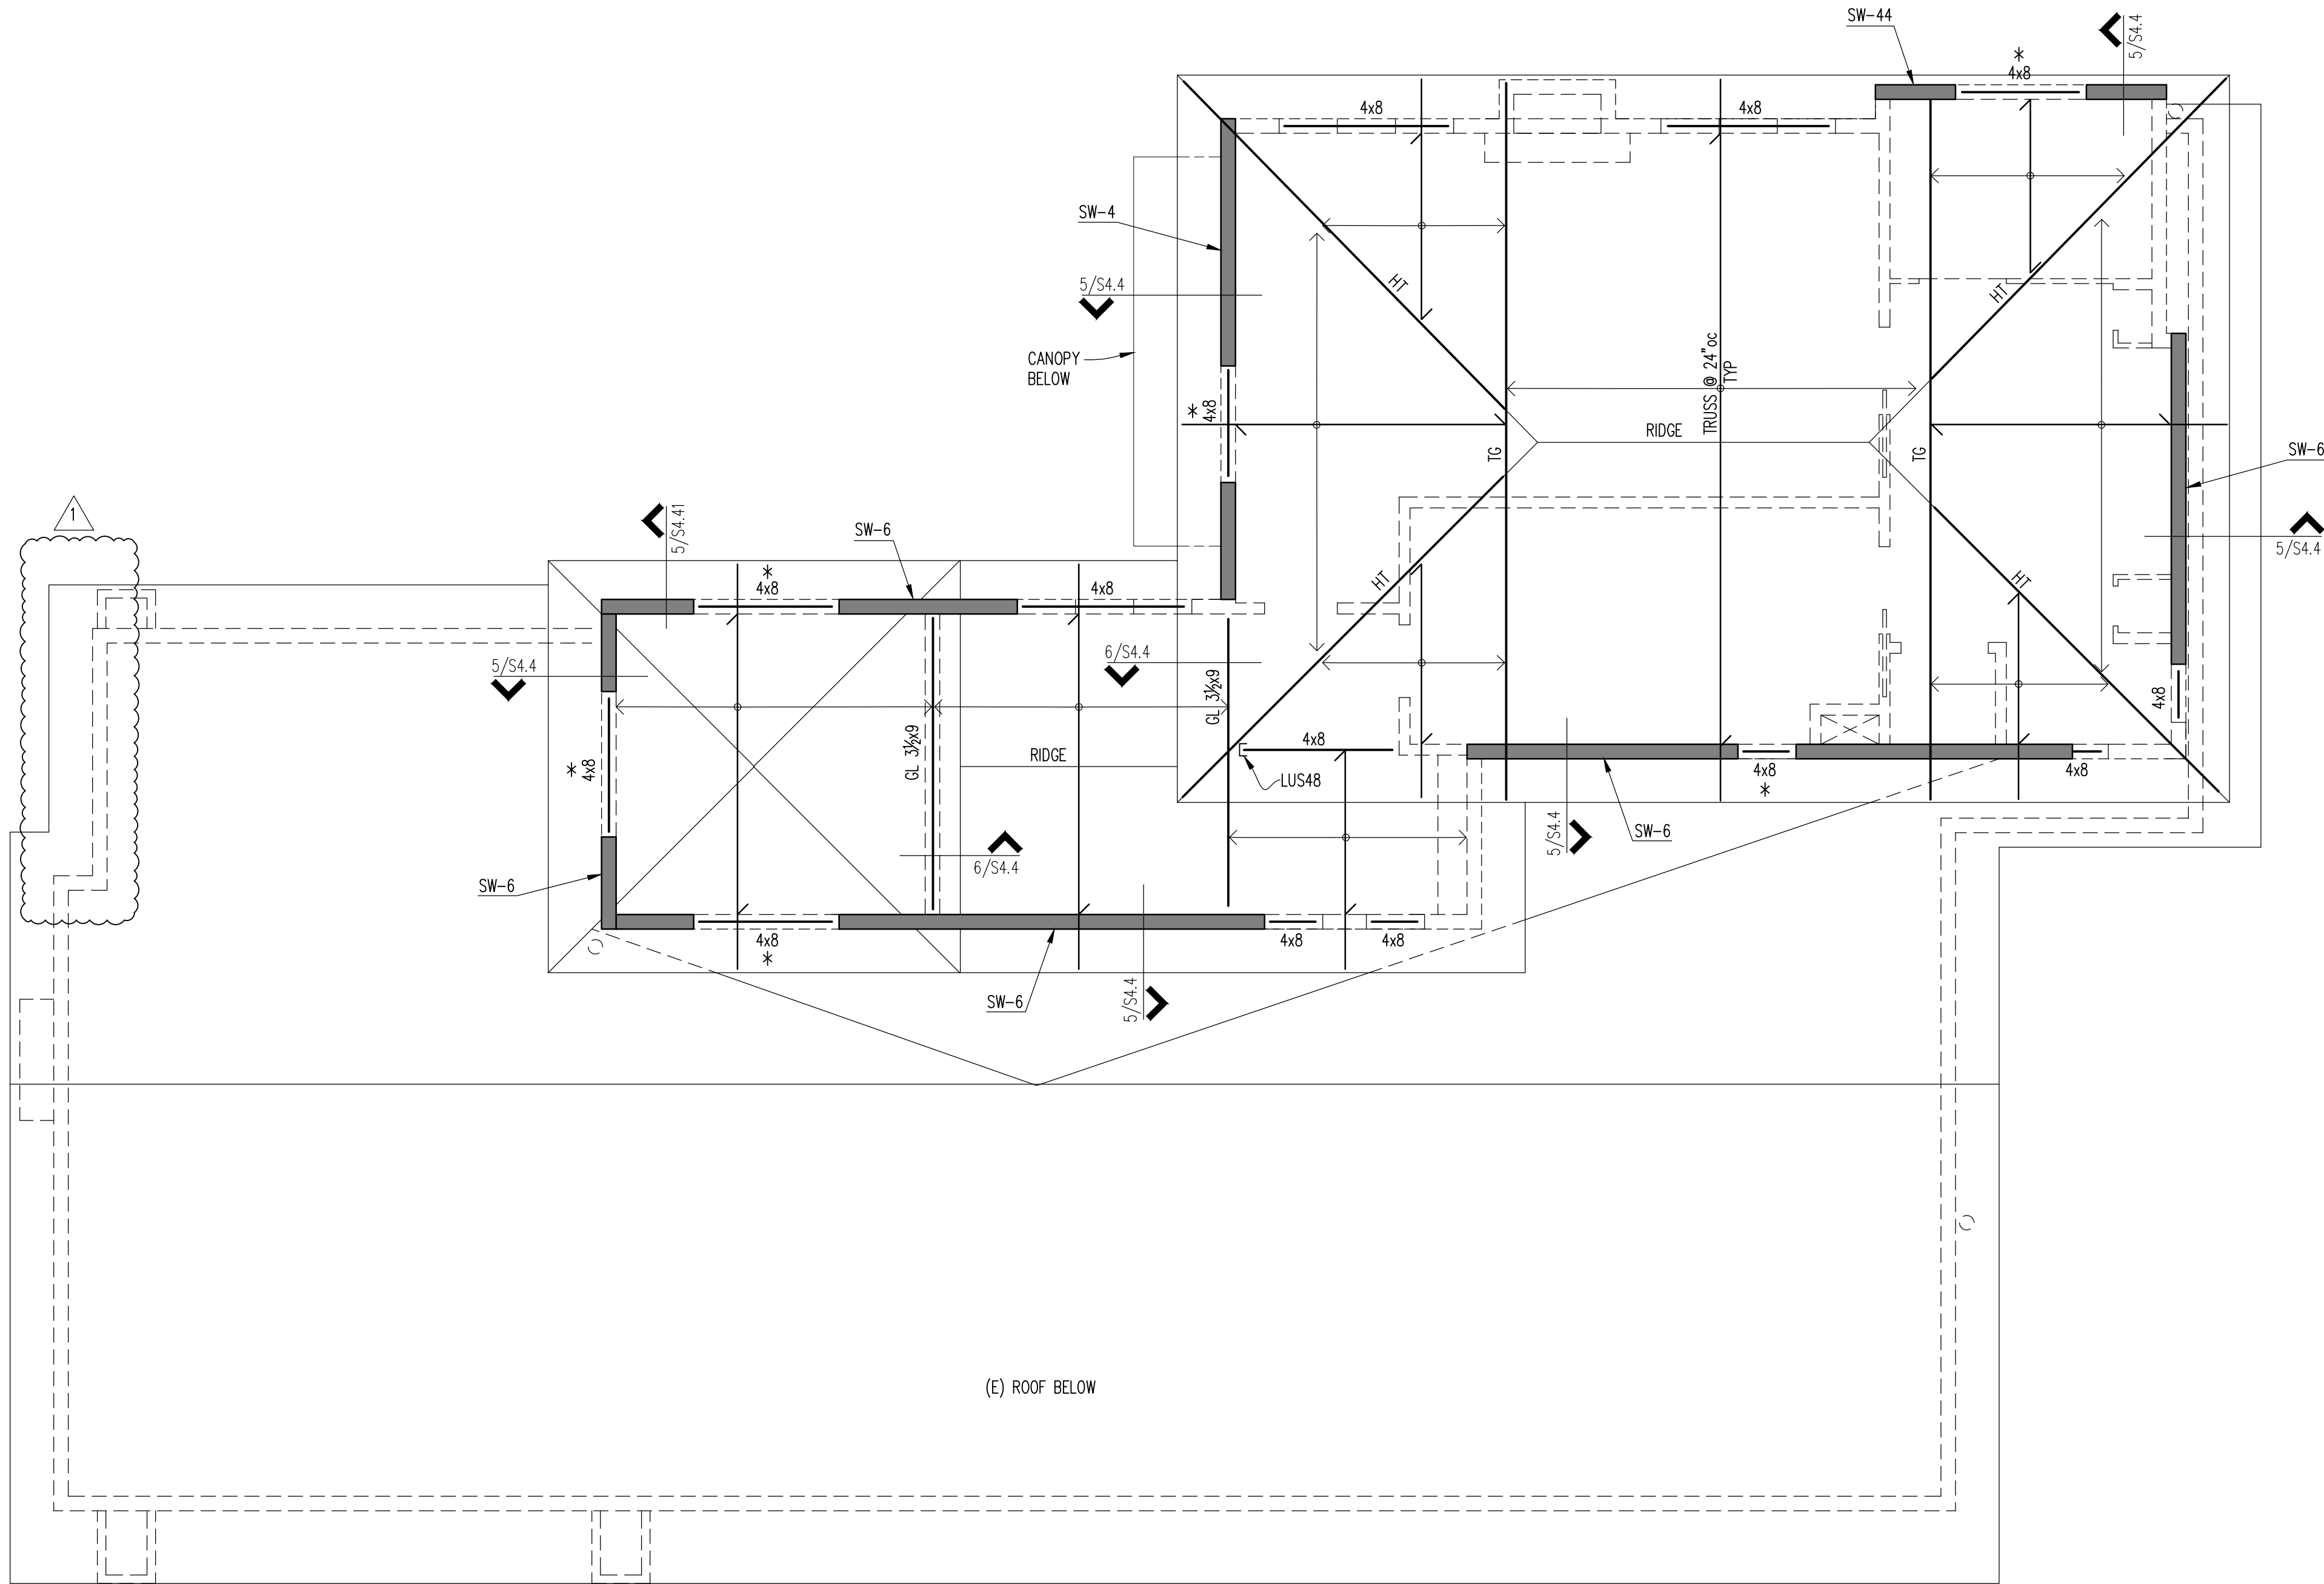

- NOTES:
- SEE ARCH FOR DIMENSIONS.
 - WALLS SHOWN ARE BELOW FRAMING.
 - SEE SHEETS S4.X FOR WOOD DETAILS.
 - SW-X INDICATES SHEAR WALL TYPE, SEE 1/S4.2 FOR SHEARWALL SCHEDULE.
 - INDICATES SHEAR WALLS.
 - SEE STRUCTURAL GENERAL NOTES FOR TYPICAL HEADERS NOT NOTED ON PLAN UNO.
 - TC INDICATES TRUSS GIRDER.
 - HT INDICATES HIP TRUSS.
 - INDICATES BEARING WALLS.
 - INDICATES NON-BEARING WALLS.
 - INDICATES STRAP WINDOW, SEE 2/S4.2.

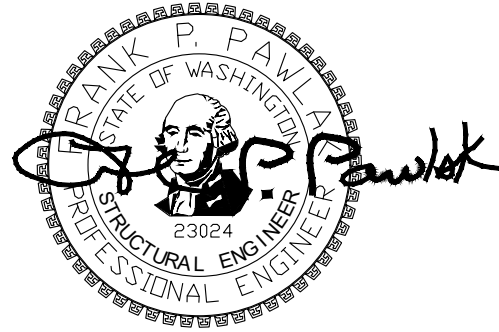

PROJECT

THYGESEN RESIDENCE
8109 SE 71ST STREET
MERCER ISLAND, WA 98040

REVISIONS

NO.	DATE
PERMIT	11/05/2024
PERMIT REV	03/07/2025





12/20/23	23-195
DATE	JOB #
MT	TCB
DESIGN	CHECKED
BDS	AS NOTED
DRAWN	SCALE

SHEET TITLE

TYP CONC
SECTIONS
& DETAILS


SHEET NO.

S3.1

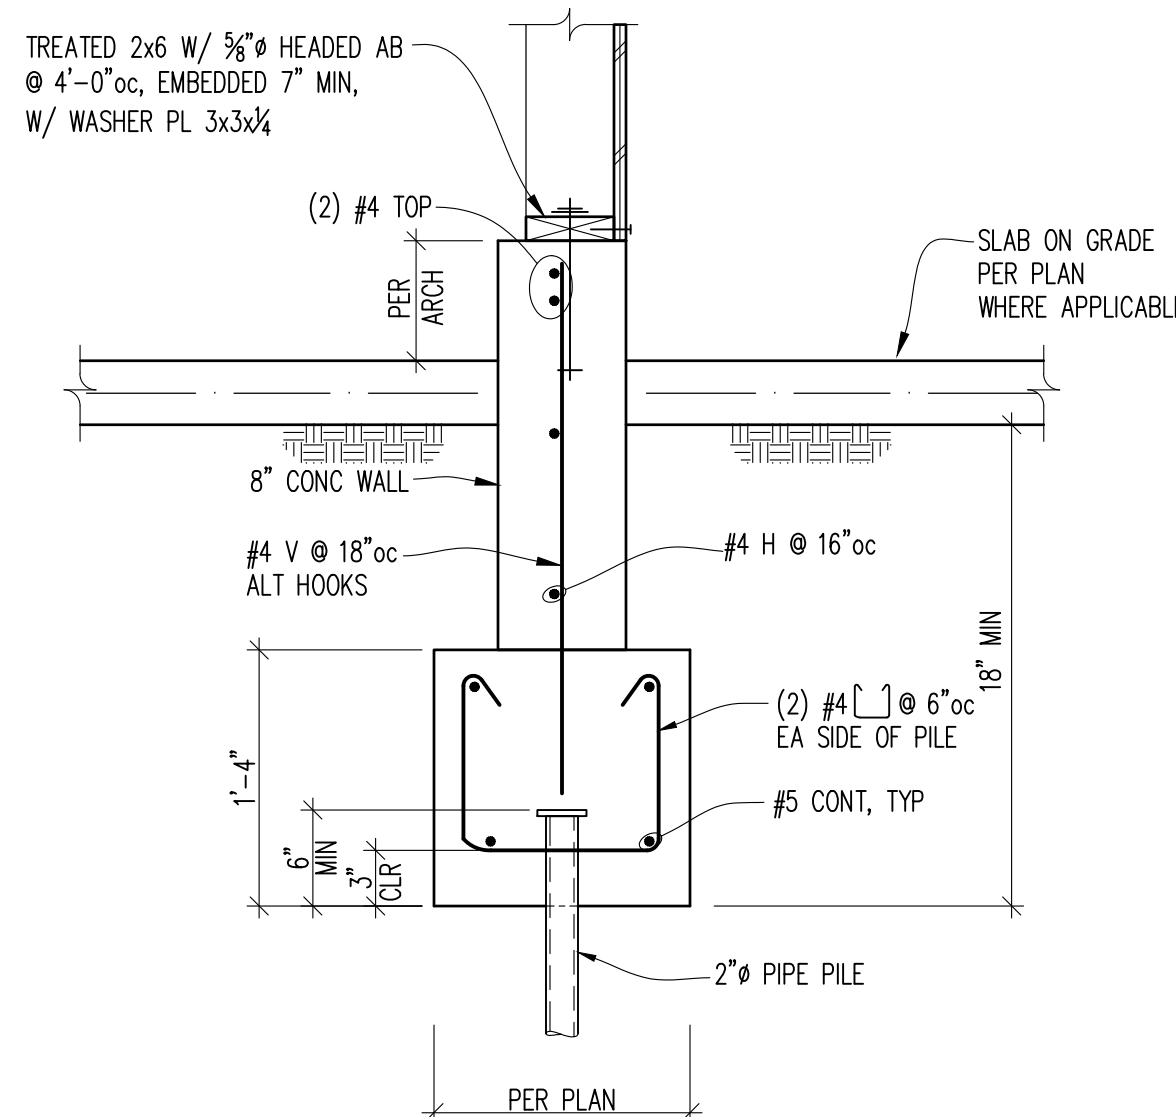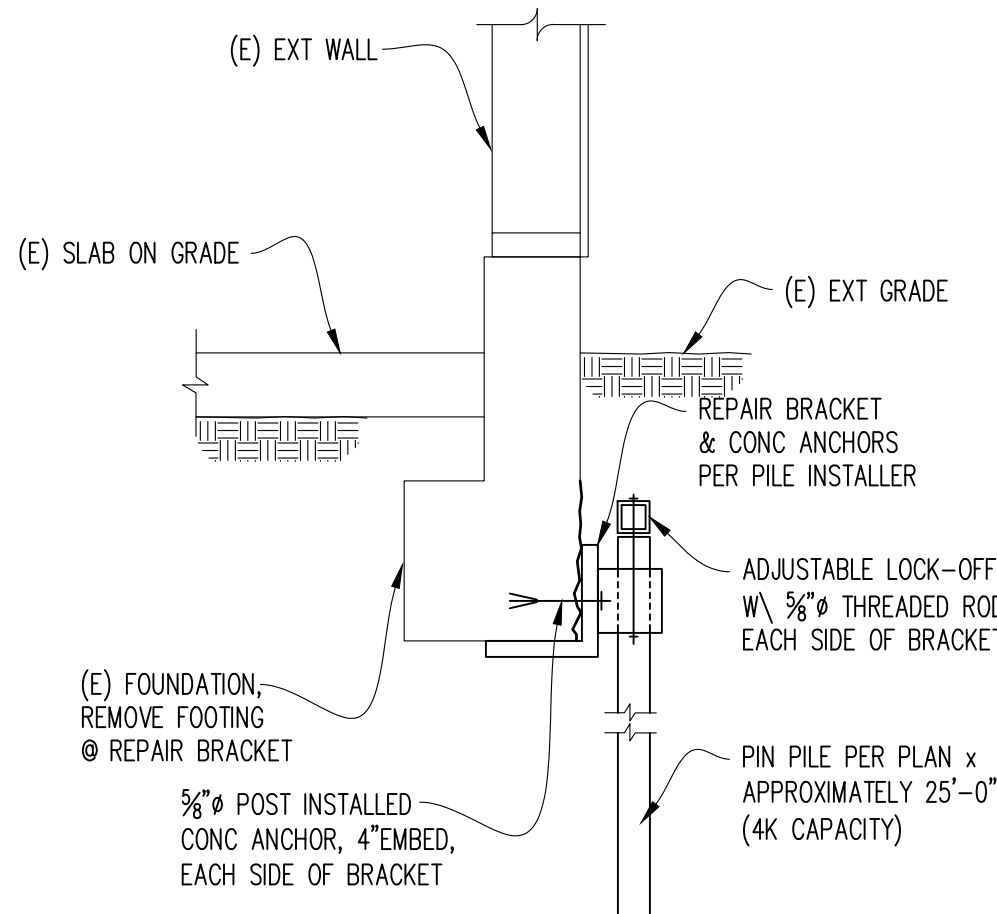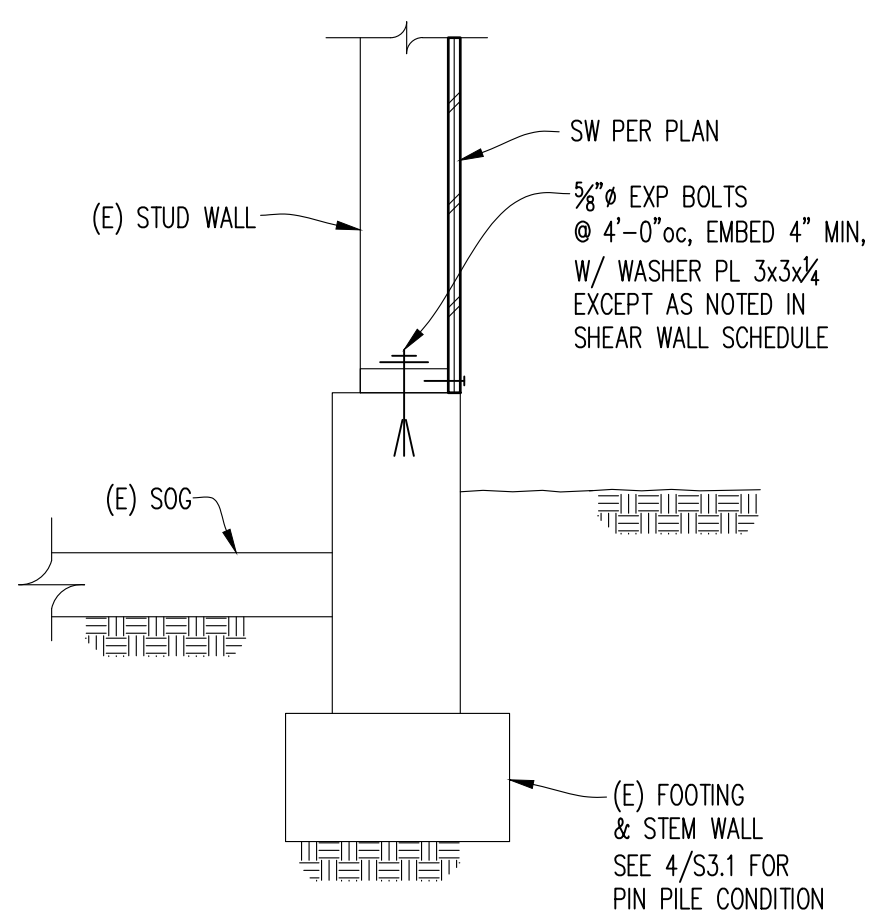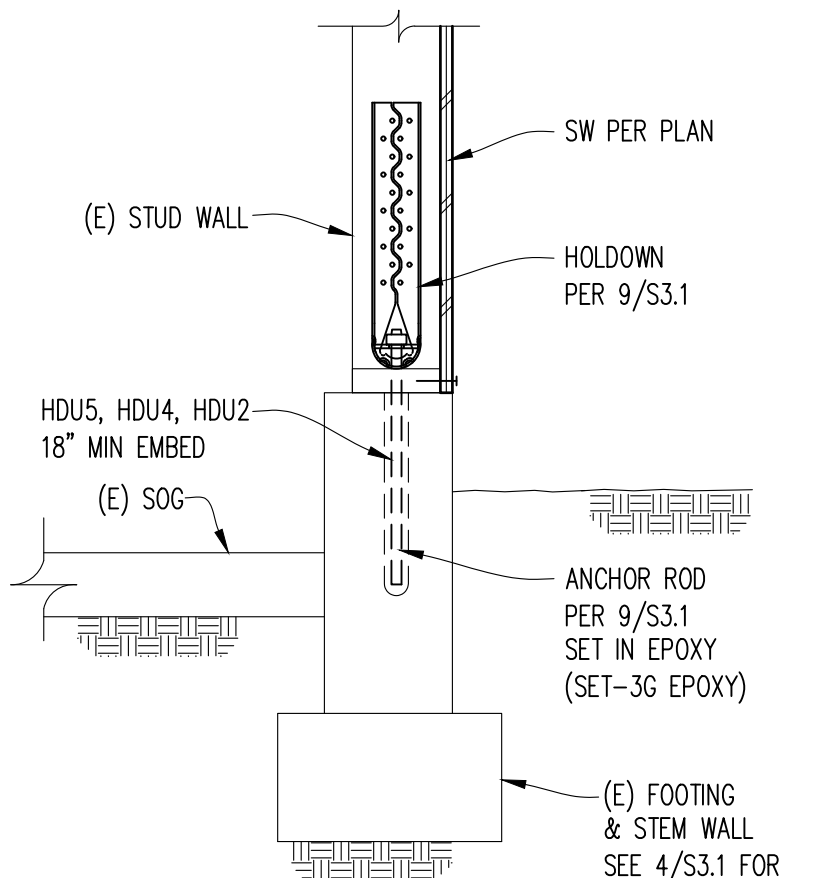


NOTE:
1. NOTIFY ENGINEER OF DATE AND TIME OF INSTALL.
2. NOTIFY ENGINEER IF CONDITIONS DIFFER THAN SHOWN.


HOLDOWN EMBED IN EXISTING FOOTING 10

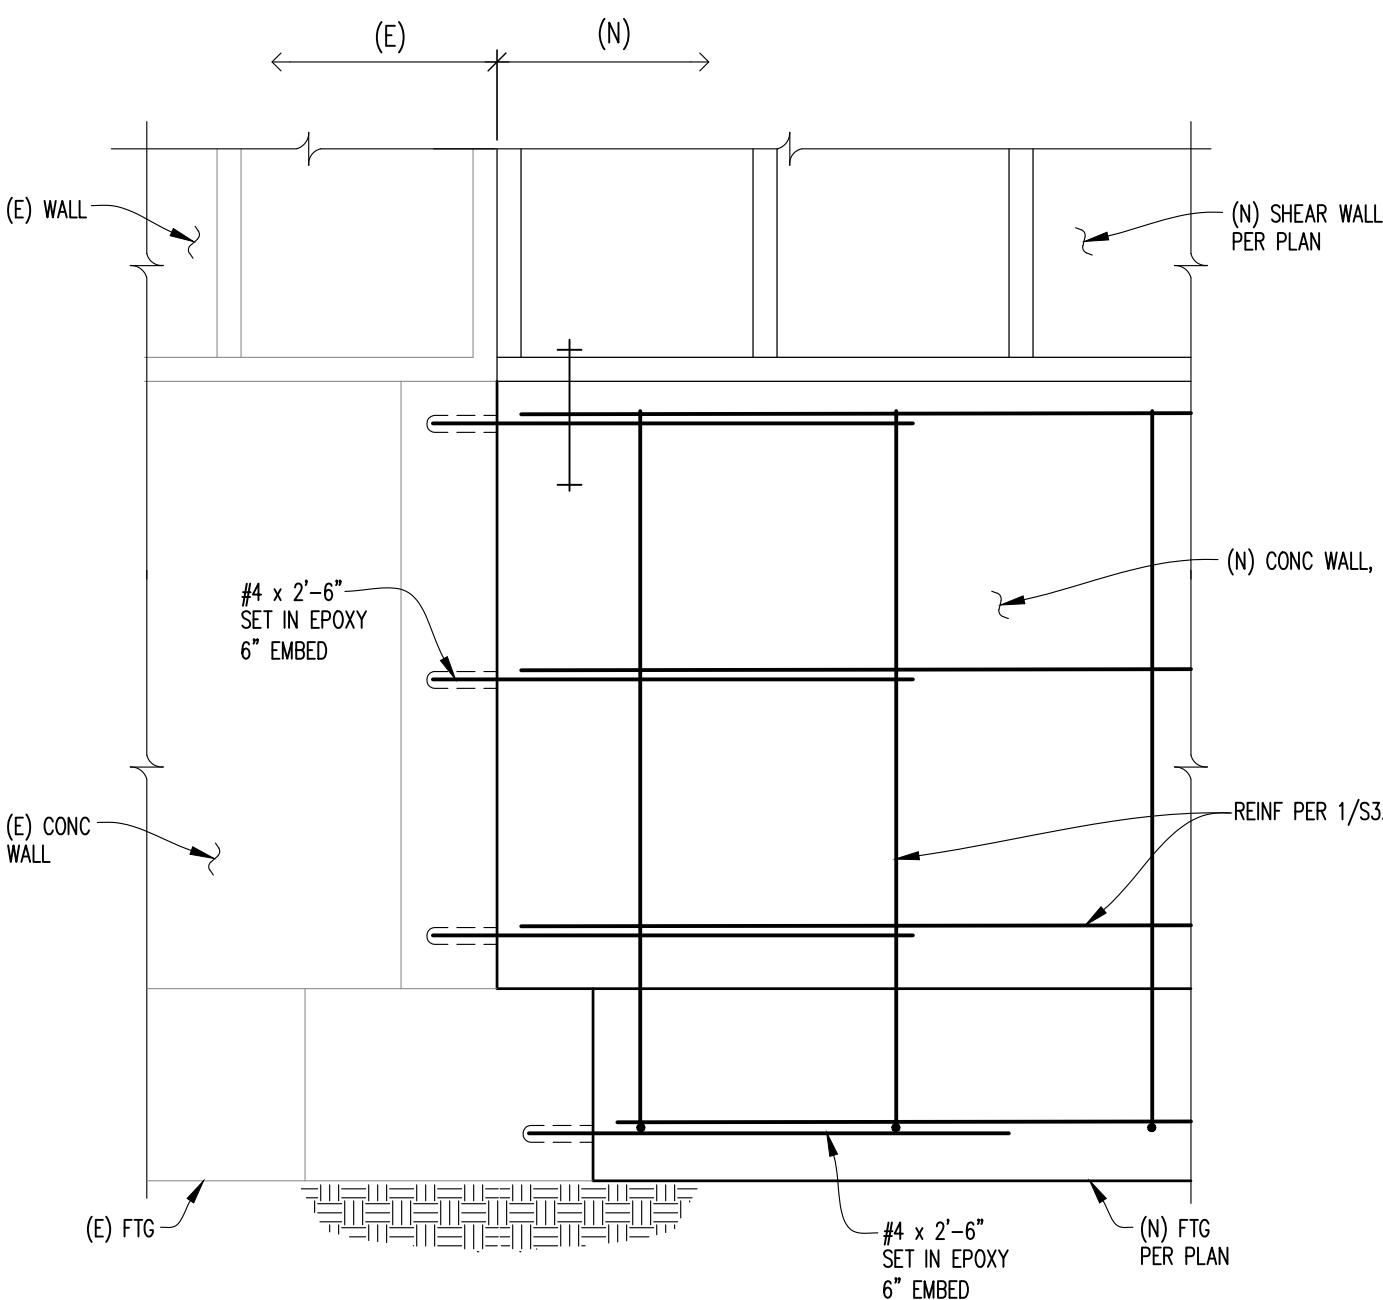


DETAIL 1"=1'-0" 7

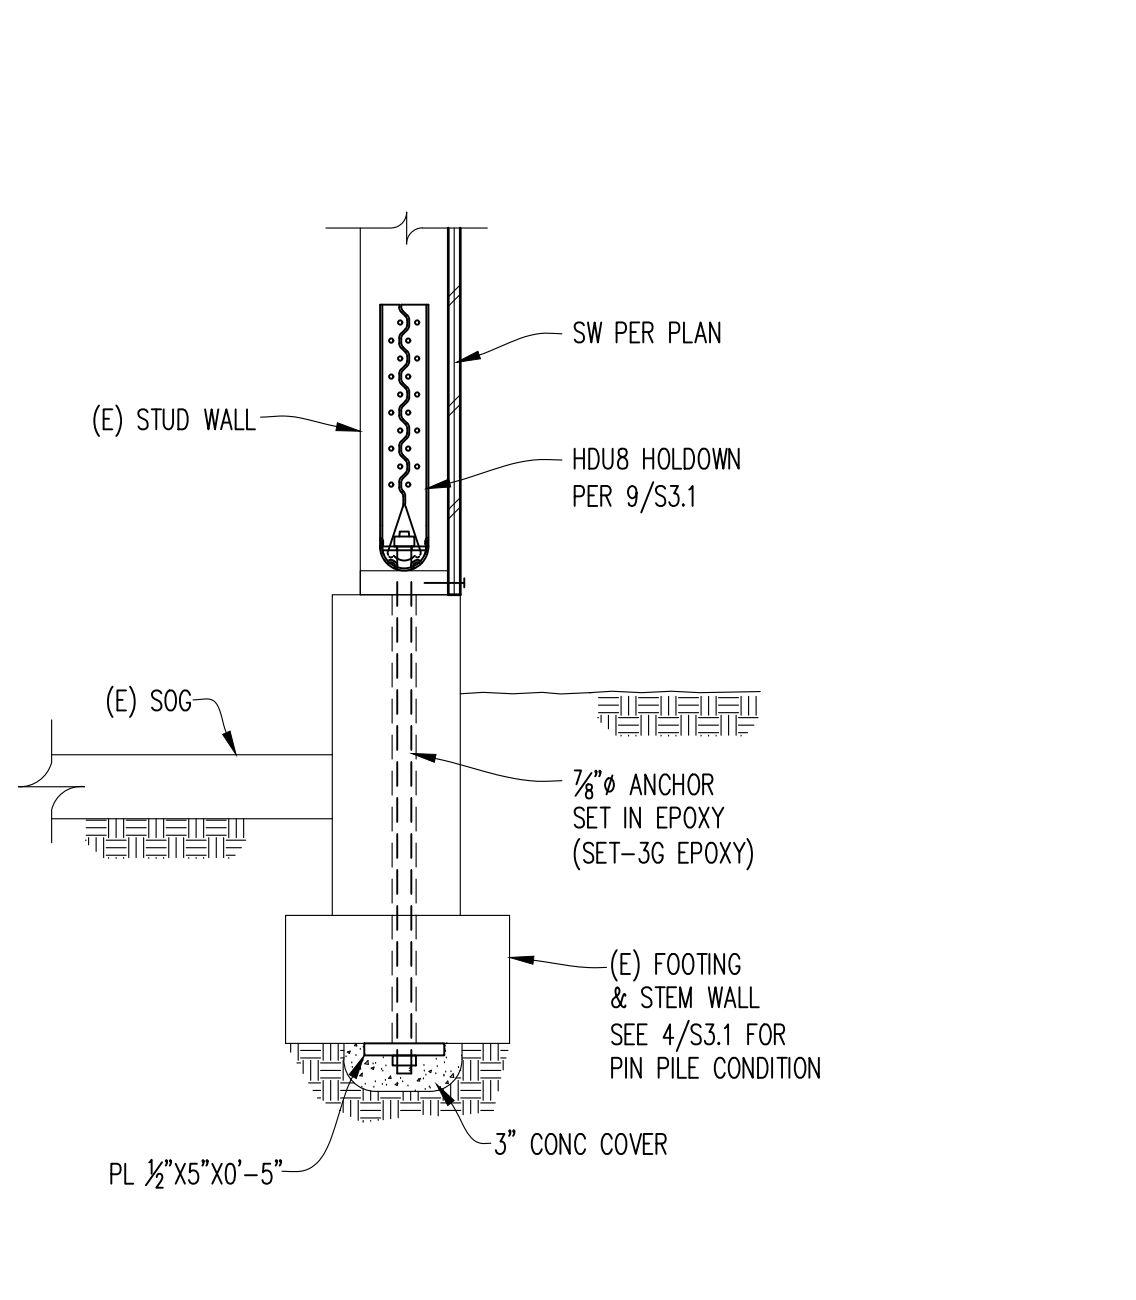

PIPE PILE AT EXTERIOR 1"=1'-0" 4

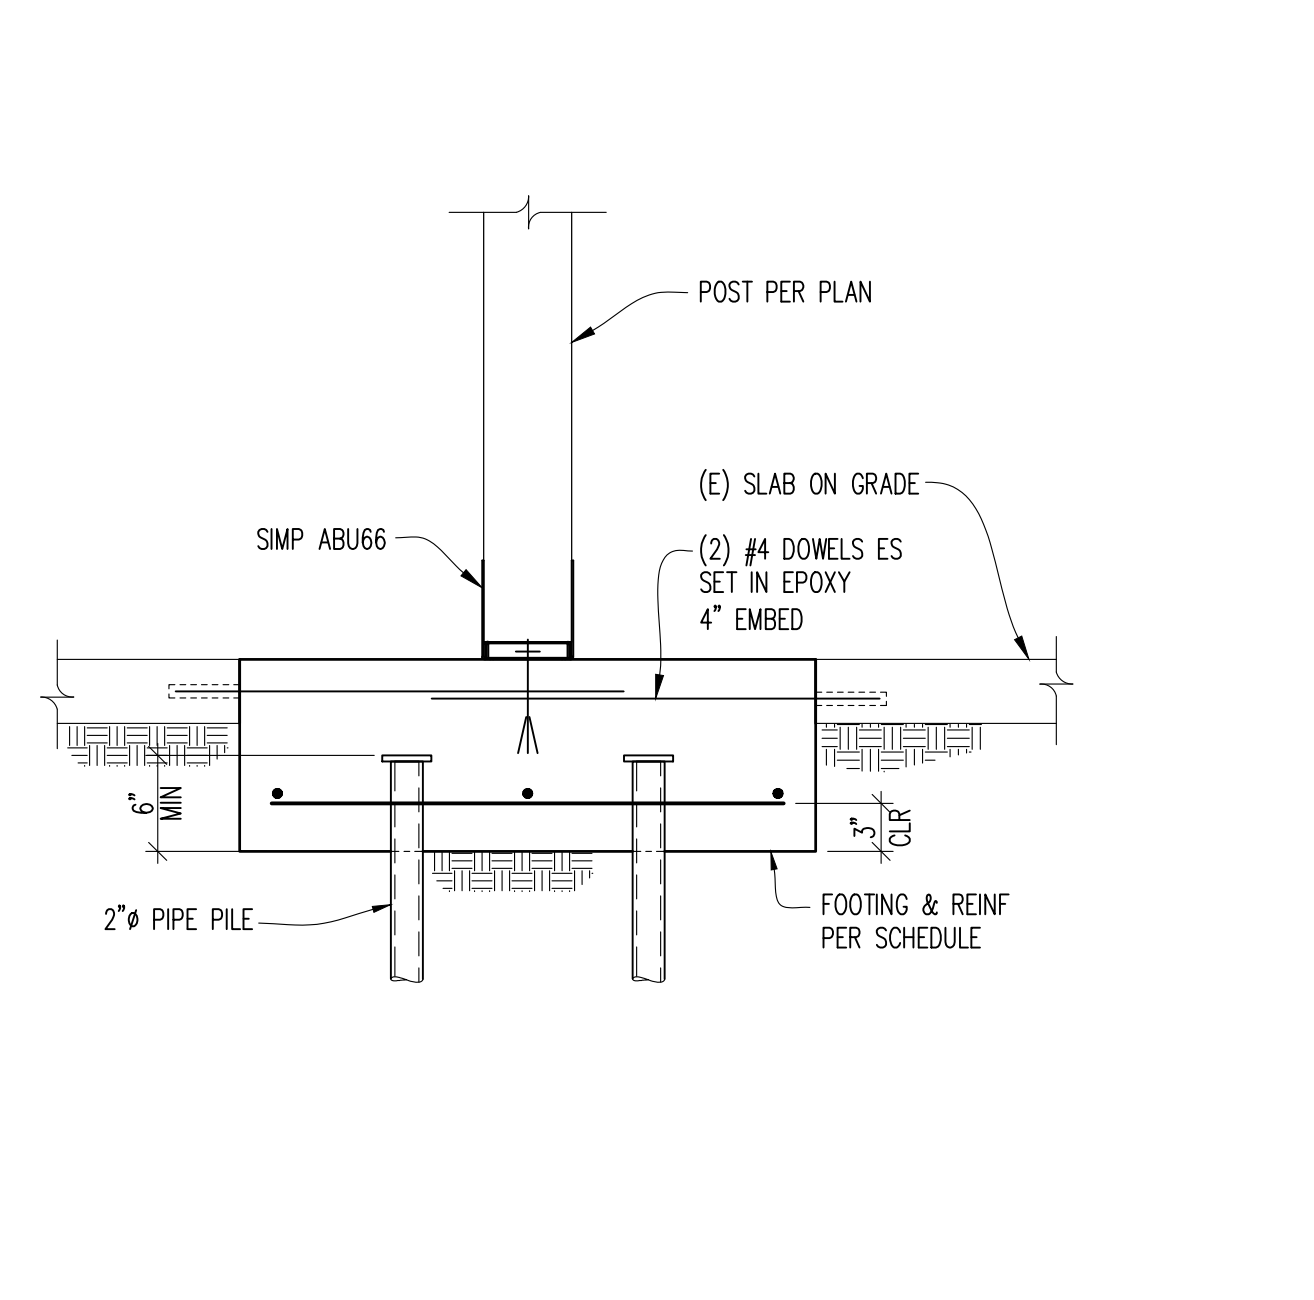


DETAIL 1"=1'-0" 1

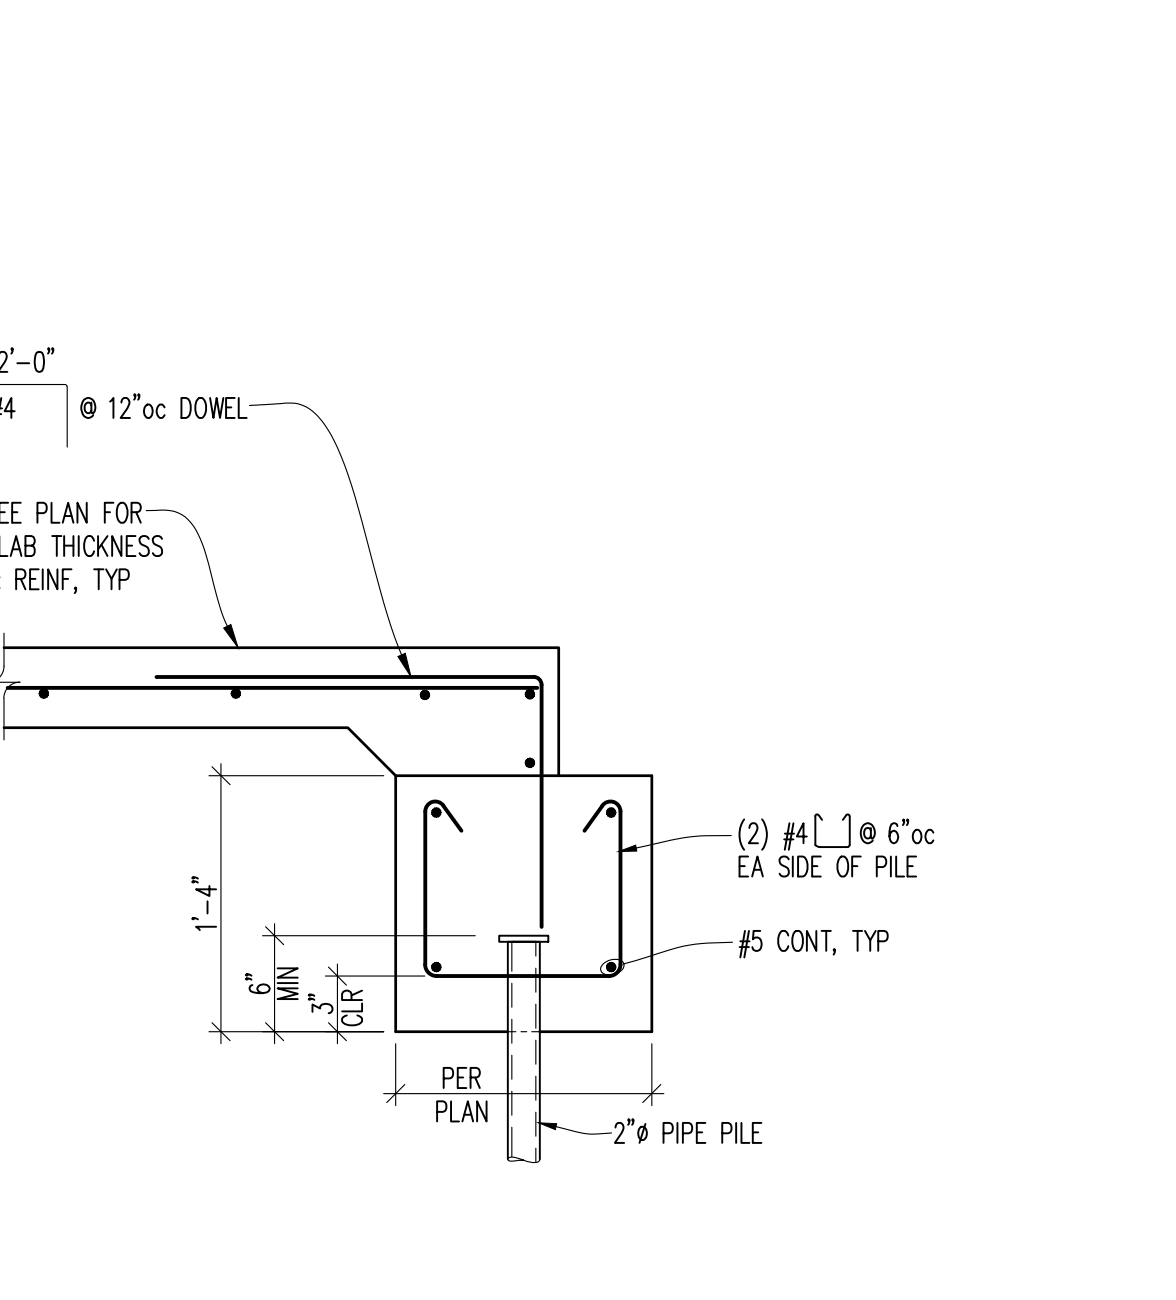


WALL DETAIL 1"=1'-0" 11




HDU8 HOLDOWN EMBED IN EXIST FOOTING 8

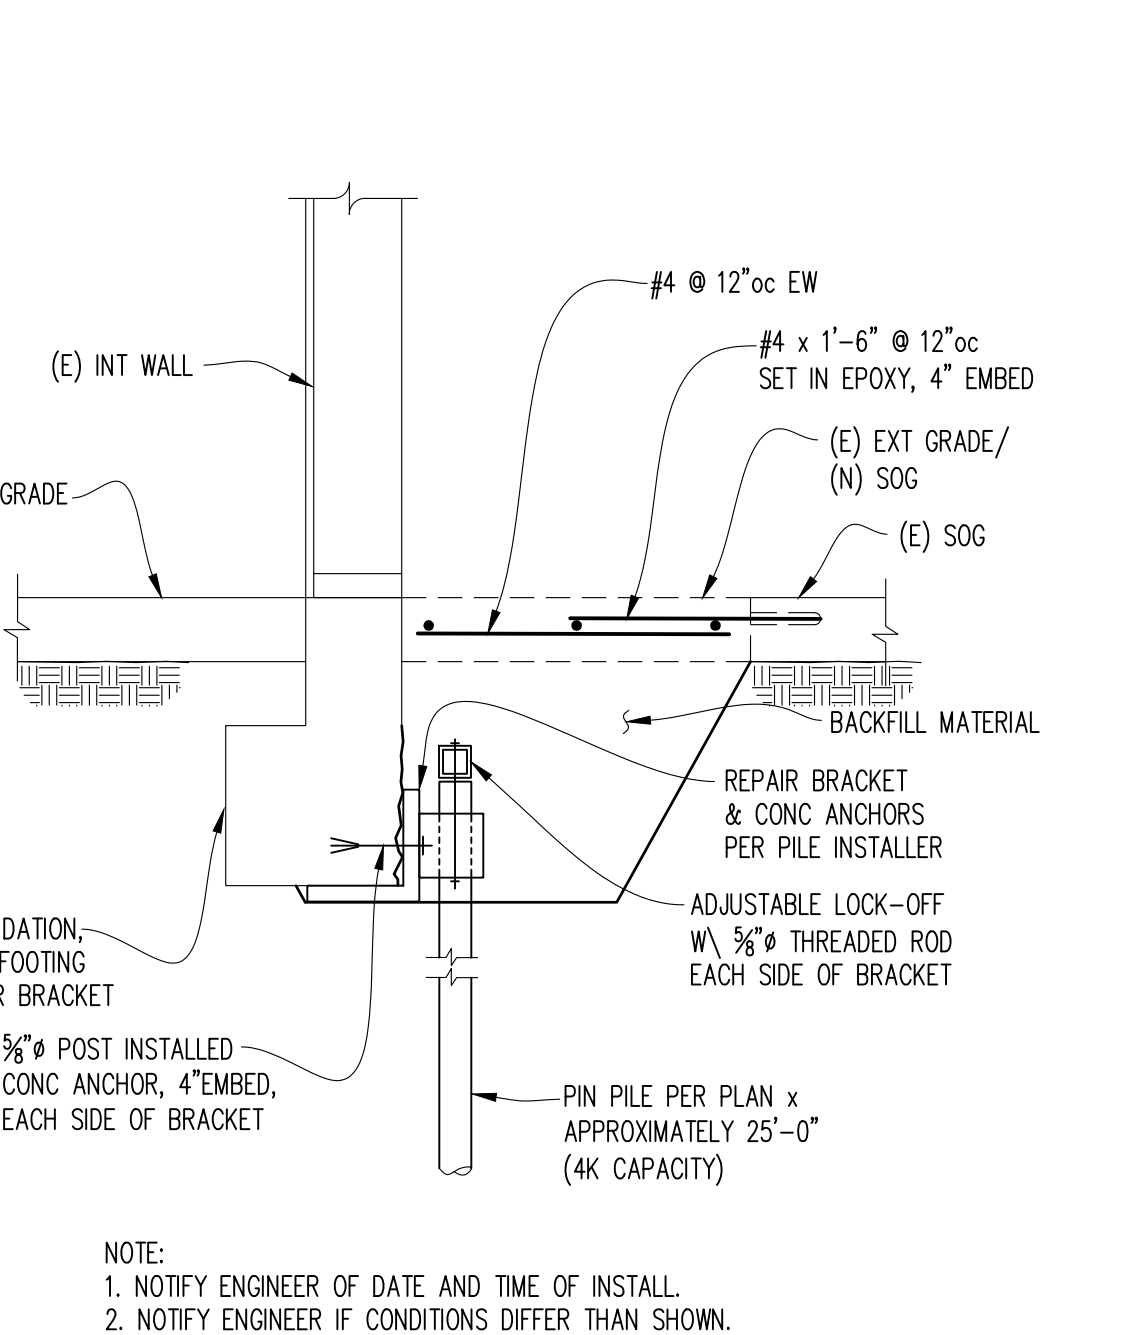

NEW FOOTING IN EXISTING SLAB 1"=1'-0" 5

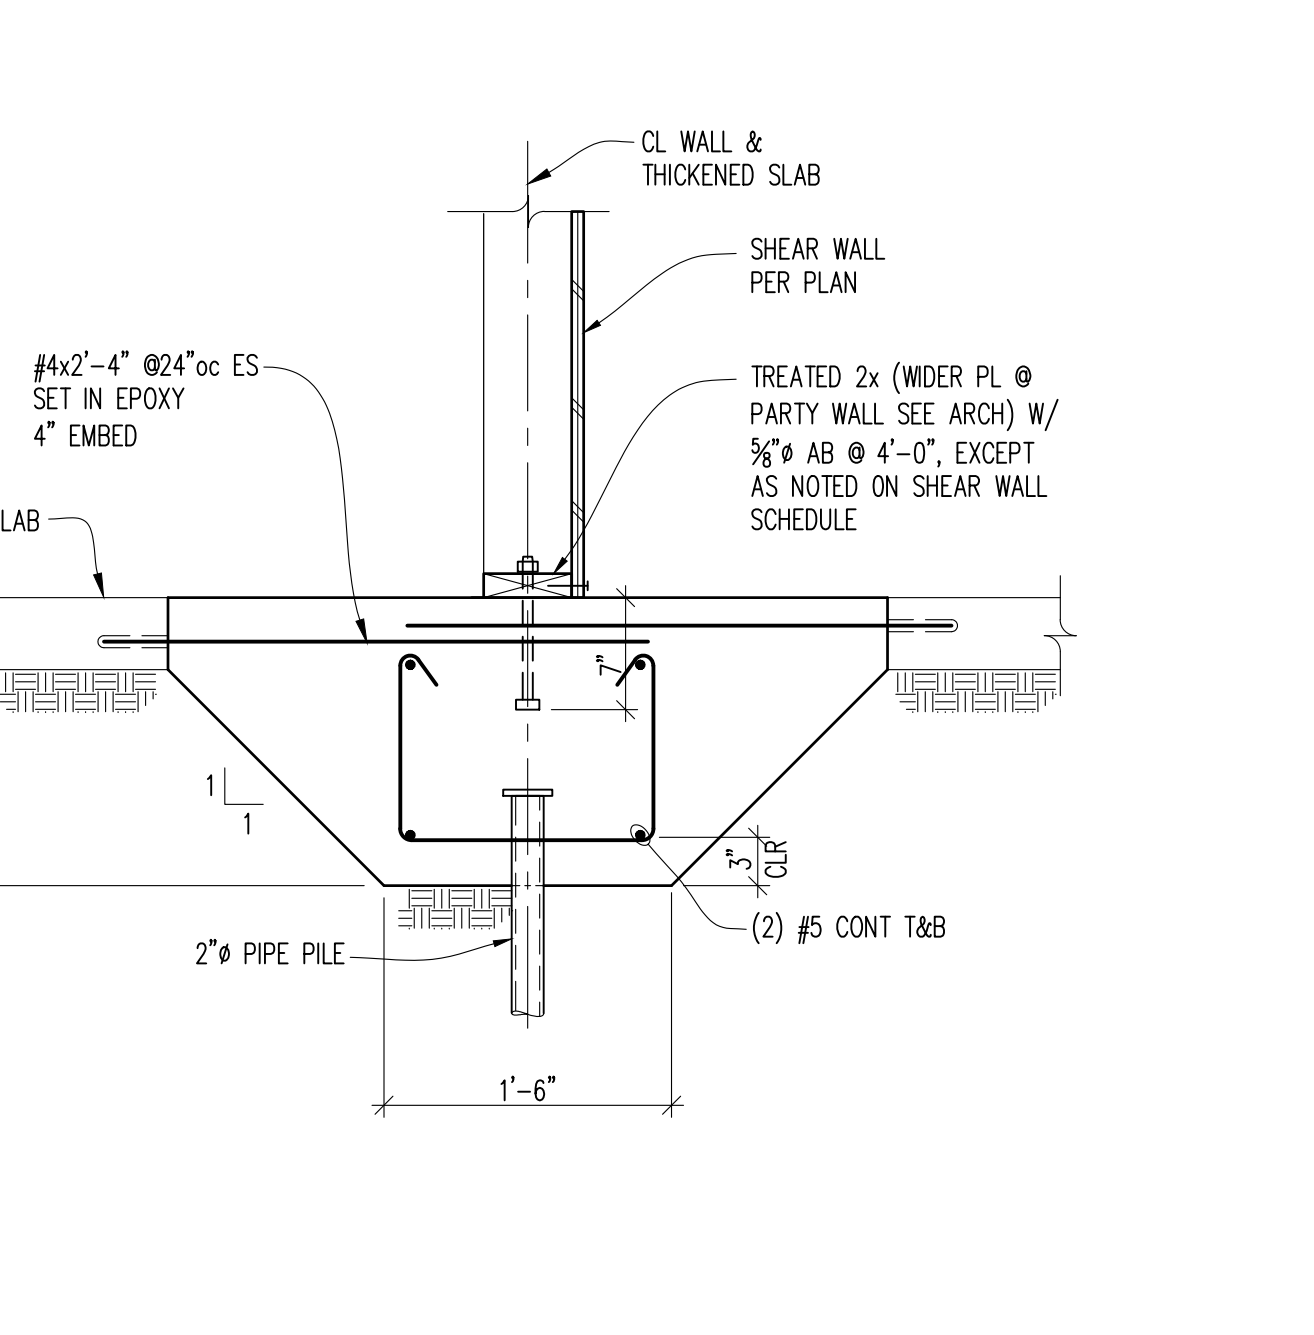

TYPICAL SLAB EDGE 1"=1'-0" 2

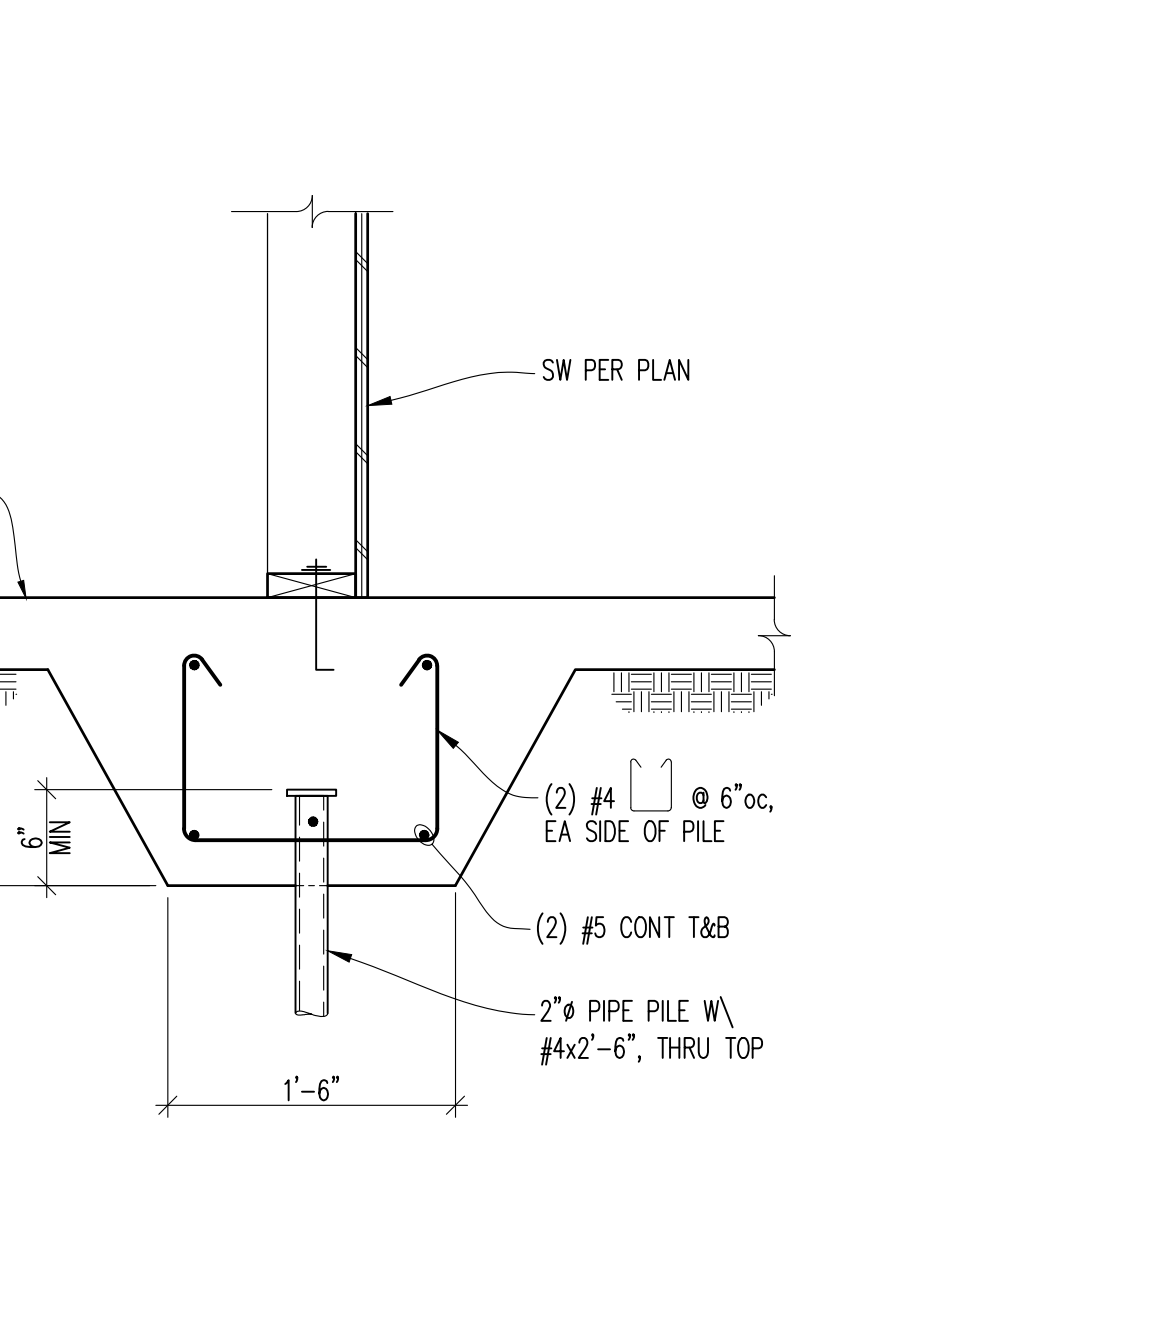

12

PIPE PILE AT INTERIOR 1"=1'-0" 9







PIPE PILE AT INTERIOR


TYPICAL INTERIOR FOOTING 1"=1'-0" 6

TYPICAL INTERIOR FOOTING


TYPICAL INTERIOR FOOTING 1"=1'-0" 3

TYPICAL INTERIOR FOOTING

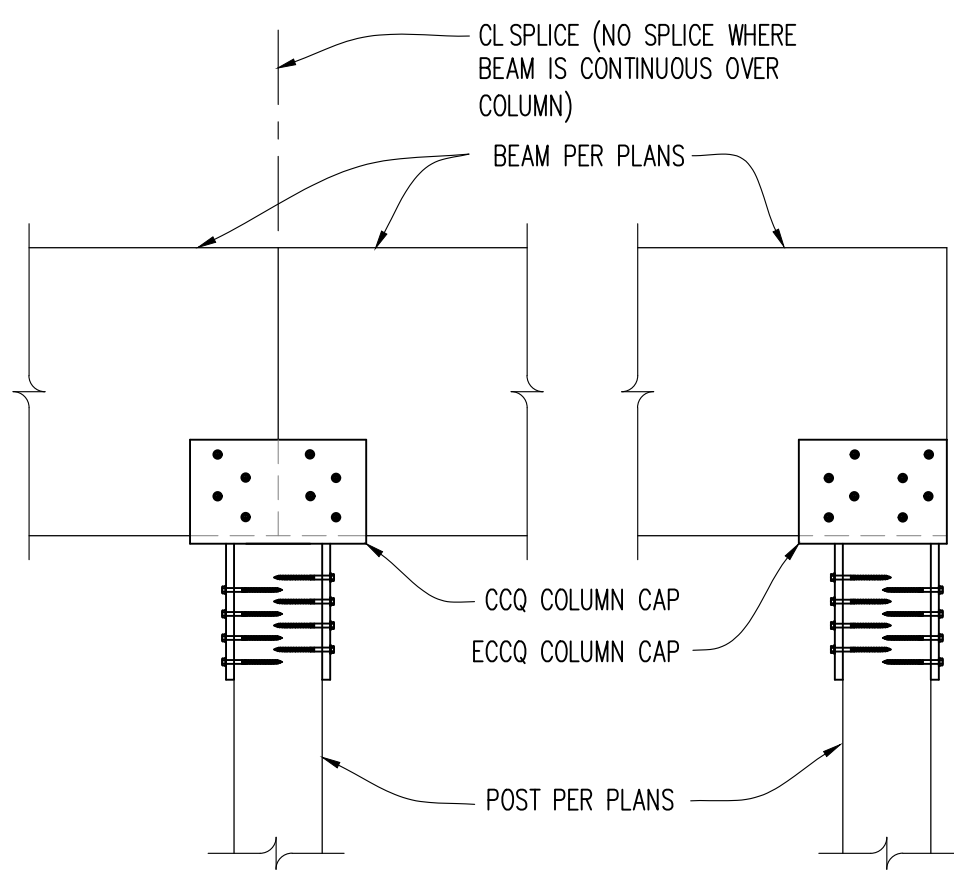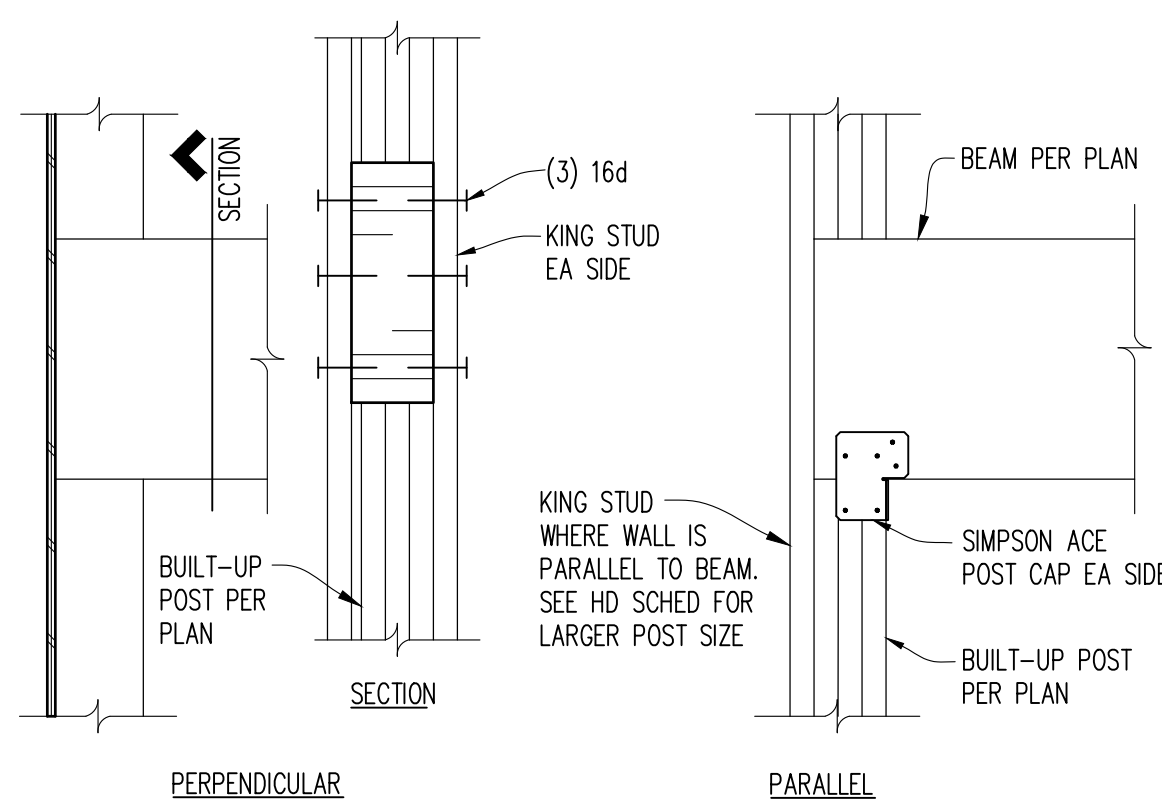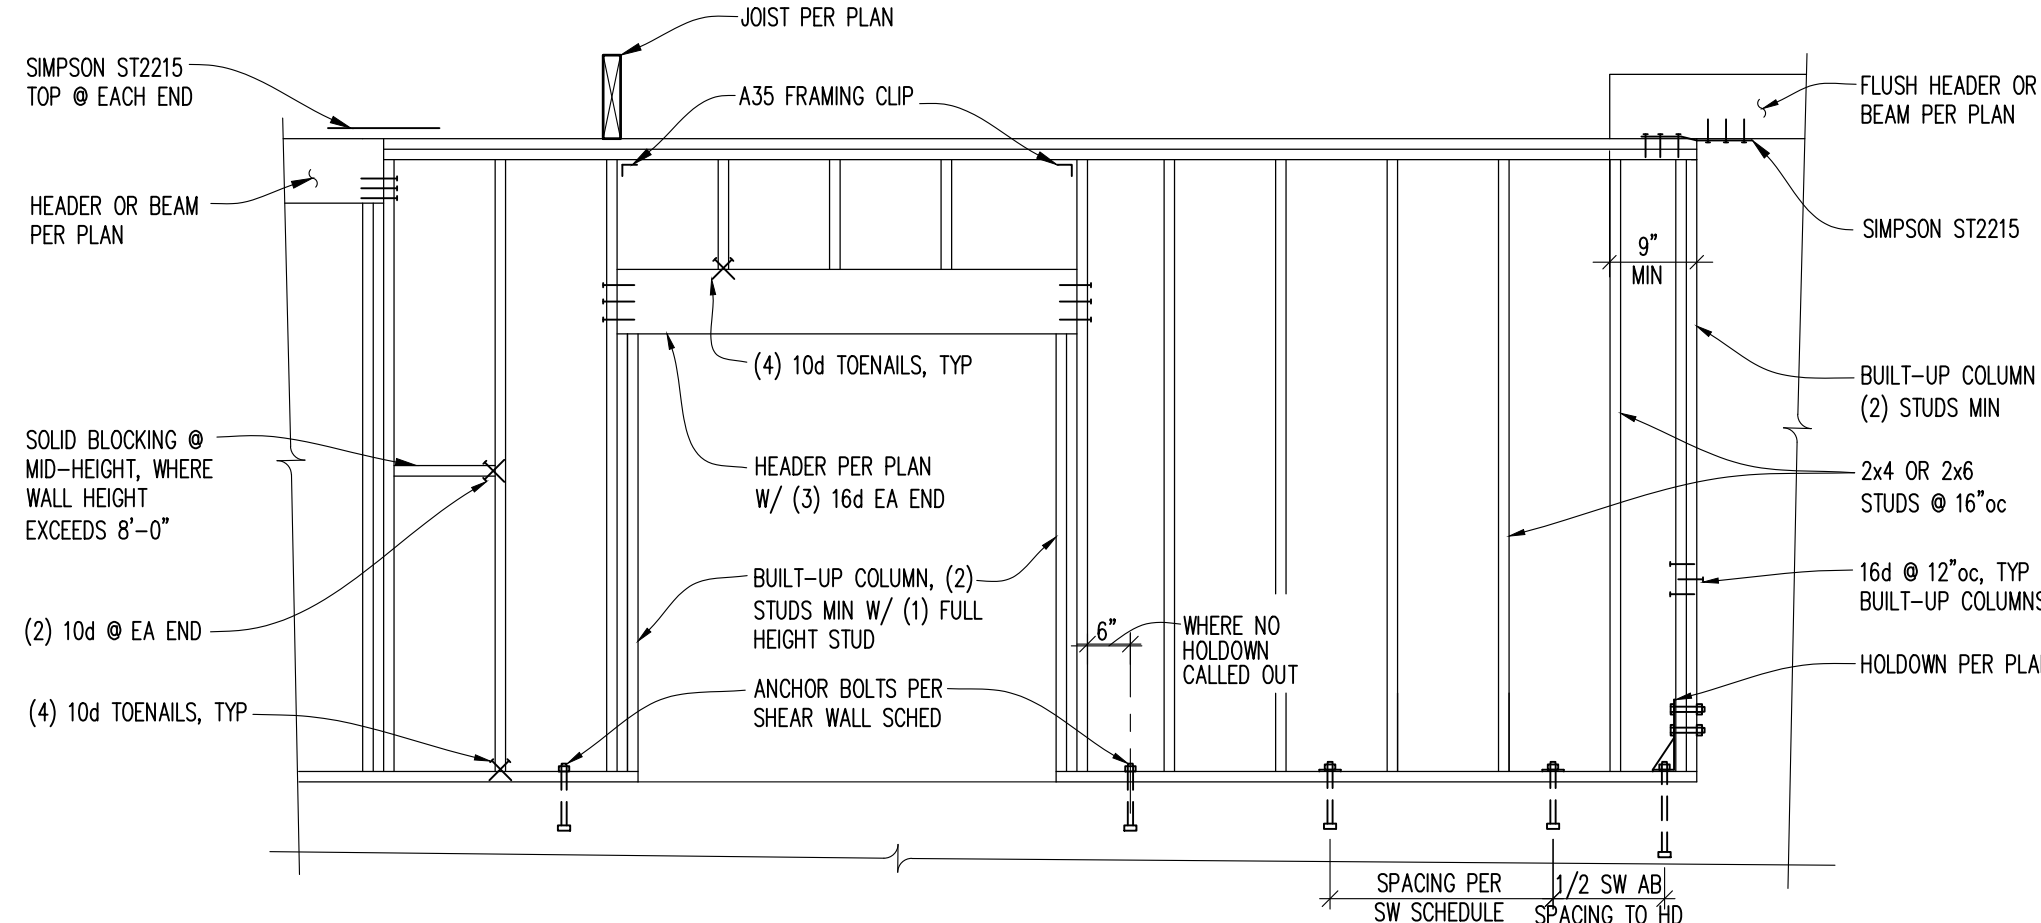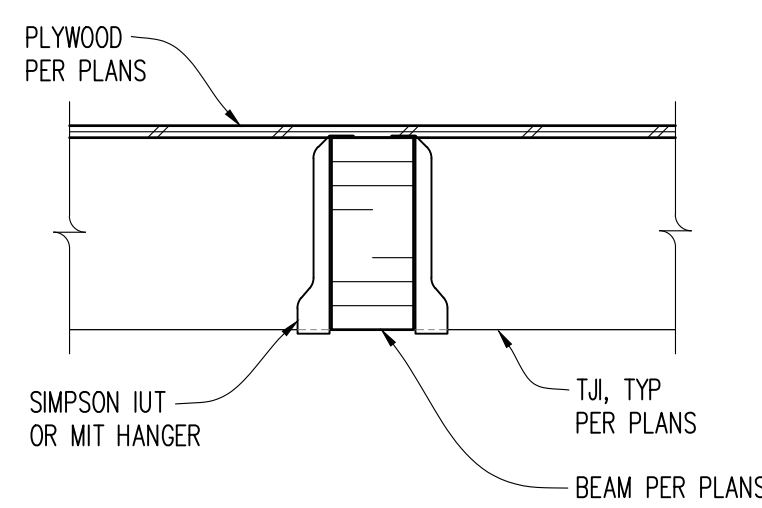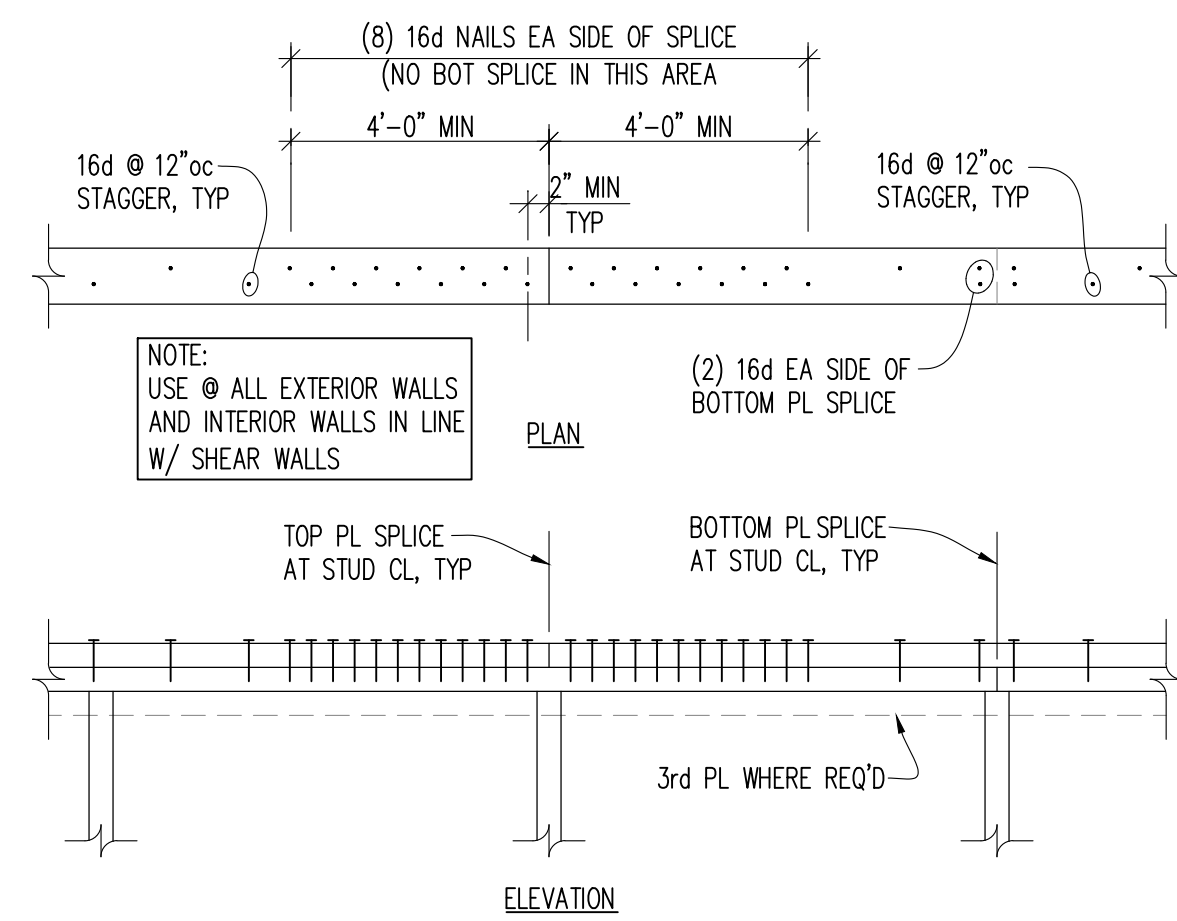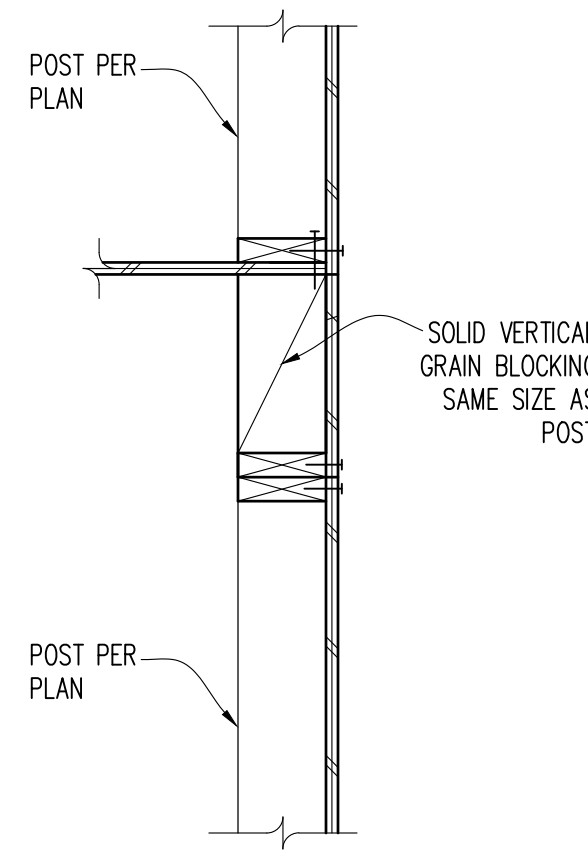					
TYPICAL BEAM TO WOOD POST	10	TYPICAL BM TO WALL CONNECTION	7	TYPICAL STUD FRAMING DETAIL	1
					
	11	TYP BEAM/JOIST CONNECTION	8	STUD WALL TOP PLATE SPLICE	5
				TYP POST FLOOR-TO-FLOOR	2
	12		9		6
					3

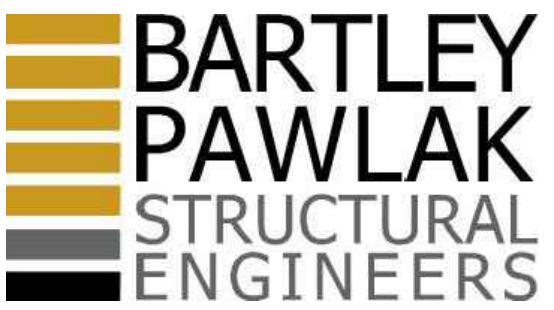

2731 77th Ave SE #100
Mercer Island, WA 98040
Phone: 206.456.3071
Fax: 206.456.3076
www.BP-SE.com

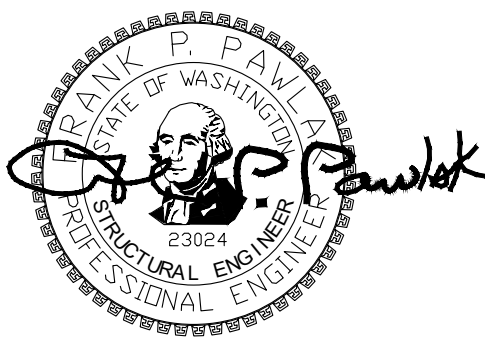

PROJECT

THYGESEN RESIDENCE

8109 SE 71ST STREET

MERCER ISLAND, WA 98040

REVISIONS

NO.	DATE
PERMIT	11/05/2024
PERMIT REV	03/07/2025


12/20/23	23-195
DATE	JOB #
MT	TCB
DESIGN	CHECKED
BDS	AS NOTED
DRAWN	SCALE

SHEET TITLE

SECTIONS & DETAILS

SHEET NO.

S4.1

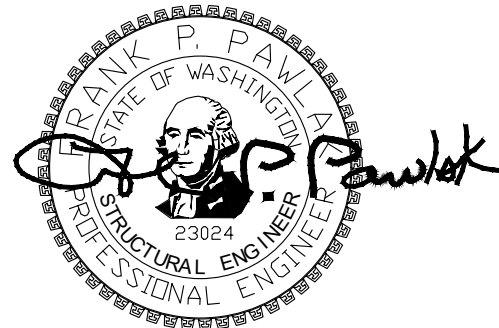

THYGESEN RESIDENCE
8109 SE 71ST STREET
MERCER ISLAND, WA 98040

REVISIONS

NO.	DATE
PERMIT	11/05/2024
PERMIT REV	03/07/2025

12/20/23	23-195
DATE	JOB #
MT	TCB
DESIGN	CHECKED
BDS	AS NOTED
DRAWN	SCALE

SHEET TITLE

TYP LATERAL
SECTIONS &
DETAILS

SHEET NO.

S4.2

SHEAR WALL SCHEDULE (HEM FIR LUMBER WITH 8d NAILS)

MARK	SHEATHING (NOTES 1,2,3,4,9) APPLICATION	PANEL EDGE NAIL SPACING (NOTE 5)	RIM/BLKG TO WALL TOP PLATE (NOTE 6)	WALL BOTTOM PLATE TO RIM/BLKG ATTACHMENT * (NOTE 6.13)		5/8" ANCHOR BOLTS TO CONCRETE (NOTES 9,10)	MIN PANEL EDGE STUDS & BLOCKING (NOTE 8)	FASTENING ALTERNATIVE (2)2x TOGETHER (NOTE 14)		ALLOWABLE SHEAR CAPACITY (PLF)(NOTE 8)
				16d NAILS	SDWS 0.220"x5"			10d NAILS	SDS 1/2"x3"	
SW-6	ONE SIDE	8d @ 6"oc	LTP4 @ 24"oc	11"oc	21"oc	48"oc	2x	N/A	N/A	242
SW-4	ONE SIDE	8d @ 4"oc	LTP4 @ 22"oc	7"oc	15"oc	46"oc	3x	5 1/2"oc	10"oc	353
SW-3	ONE SIDE	8d @ 3"oc	LTP4 @ 16"oc	5"oc	11"oc	36"oc	3x	4"oc	8"oc	456
SW-44	BOTH SIDES (NOTE 7)	8d @ 4"oc	LTP4 @ 11"oc	N/A	7"oc	23"oc	3x	(2) @ 5 1/2"oc	5 1/2"oc	706


* A35 OR LTP4 CAN BE USED ALTERNATIVELY

** USE MIN 2x 2x OF RIM BOARD AT THESE SHEARWALLS

*** FASTENERS SHALL BE STAGGERED

NOTES:

- SHEATHING SHALL BE 1/2" OR 5/8" PLY, TYP UNO. OSB SHALL NOT BE SUBSTITUTED FOR PLYWOOD. SHEATHING SHALL HAVE A MINIMUM SPAN RATING OF 24/0.
- SHEATHING SHALL BE APPLIED DIRECTLY TO FRAMING.
- PROVIDE SOLID BLOCKING AT ALL SHEATHING PANEL EDGES.
- PROVIDE 8d @ 12"oc AT ALL INTERMEDIATE SUPPORTS (FIELD NAIL), TYP UNO.
- NAILS PER GENERAL STRUCTURAL NOTES.
- LATERAL TIE PLATES OR WALL PLATE TO BLOCKING NAILING IS REQUIRED WHERE SHEATHING IS DISCONTINUOUS, I.E., WHERE ADJACENT SHEATHING EDGES ARE NOT NAILED TO THE SAME PIECE OF FRAMING. TIE NAILING IS NOT PERMITTED. LATERAL TIE PLATES MAY BE SUBSTITUTED FOR WALL PLATE TO BLOCKING NAILING. INSTALL LATERAL TIE PLATES OVER APA RATED SHEATHING PANELS. USE COMMON NAILS OR EQUIVALENT NAILS SUPPLIED BY CONNECTOR MANUFACTURER FOR LATERAL TIE PLATES. A35 FRAMING ANCHORS MAY BE SUBSTITUTED FOR LATERAL TIE PLATES AT SPACING SHOWN IN TABLE.
- WHERE SHEATHING IS APPLIED TO BOTH SIDES OF WALL, STAGGER PLYWOOD JOINTS SO THAT JOINTS ON EACH SIDE OF THE WALL DO NOT OCCUR AT THE SAME STUD. PROVIDE 3x BLOCKING FOR ALL DOUBLE SHEATHED WALLS.
- PROVIDE SHEAR WALL SHEATHING AND NAILING FOR ENTIRE LENGTH OF WALLS NOTED ON PLANS. ENDS OF WALLS ARE DESIGNATED BY EXTERIOR OF BUILDING, CORRIDORS, OR DOORWAYS. PROVIDE HOLDDOWNS PER PLANS AT EACH END OF WALL, UNO. PROVIDE EDGE NAILING TO STUD(S) GRIPPED BY HOLDOWN.
- CRITERIA: 2018 IBC
HEM FIR LUMBER
2500 psi CONCRETE MINIMUM
ASTM A307 ANCHOR BOLTS WITH 2 3/4" EDGE DISTANCE IN CONCRETE AND 7" MINIMUM EMBEDMENT
- INSTALL 3x3x1/4" PL WASHERS AT ALL ANCHOR BOLTS, BETWEEN THE NUT AND THE SILL PLATE. USE 4 1/2"x4 1/2"x1/4" PL WASHERS WHERE 2x6 STUD WALLS ARE SHEATHED ON BOTH SIDES. ALL PLATE WASHERS SHALL EXTEND TO WITHIN 1/2" OF THE EDGE OF THE BOTTOM PLATE ON THE SIDE(S) WITH SHEATHING.
- AT SHEARWALLS WHERE SHEATHING MAY EXTEND VERTICALLY TO OVERLAP WITH RIMBOARD/BLOCKING ABOVE, IT IS ACCEPTABLE TO NAIL SHEATHING TO RIMBOARD/BLOCKING WITH EDGE NAILING AS SPECIFIED IN TABLE ABOVE AND ELIMINATE THE A35 CLIPS BETWEEN THE RIMBOARD/BLOCKING AND WALL TOP PLATE.
- FASTENERS IN CONTACT WITH TREATED WOOD SHALL BE CORROSION RESISTANT.
- 1 1/2" MIN LSL RIM BOARD AND SINGLE SILL PLATE ARE ASSUMED. IF RIM MATERIAL IS DIFFERENT, NOTIFY ENGINEER FOR REVISED SPACING. IF (2)2x SILL PLATES ARE USED, USE SDWS 0.220"x6" SCREWS. CONTRACTOR CAN SELECT EITHER NAILS OR SCREWS.
- (2)2x STUDS AND SILL PLATES CAN BE USED INSTEAD OF 3x MEMBERS. (2)2x STUDS WILL NEED TO BE FASTENED TOGETHER WITH EITHER NAILS OR SCREWS AS CALLED OUT.

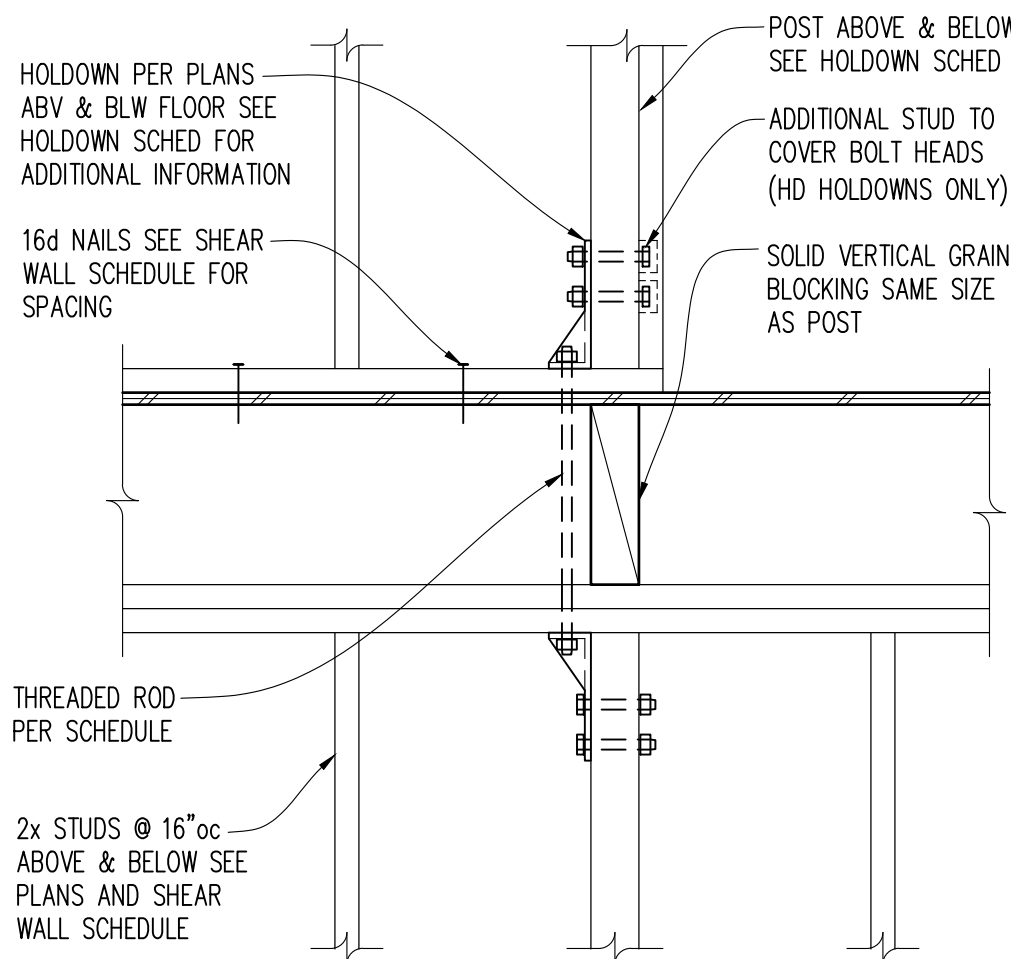


10

TYPICAL HOLDOWN: FLOOR TO FLOOR




7

SHEARWALL SCHEDULE

1

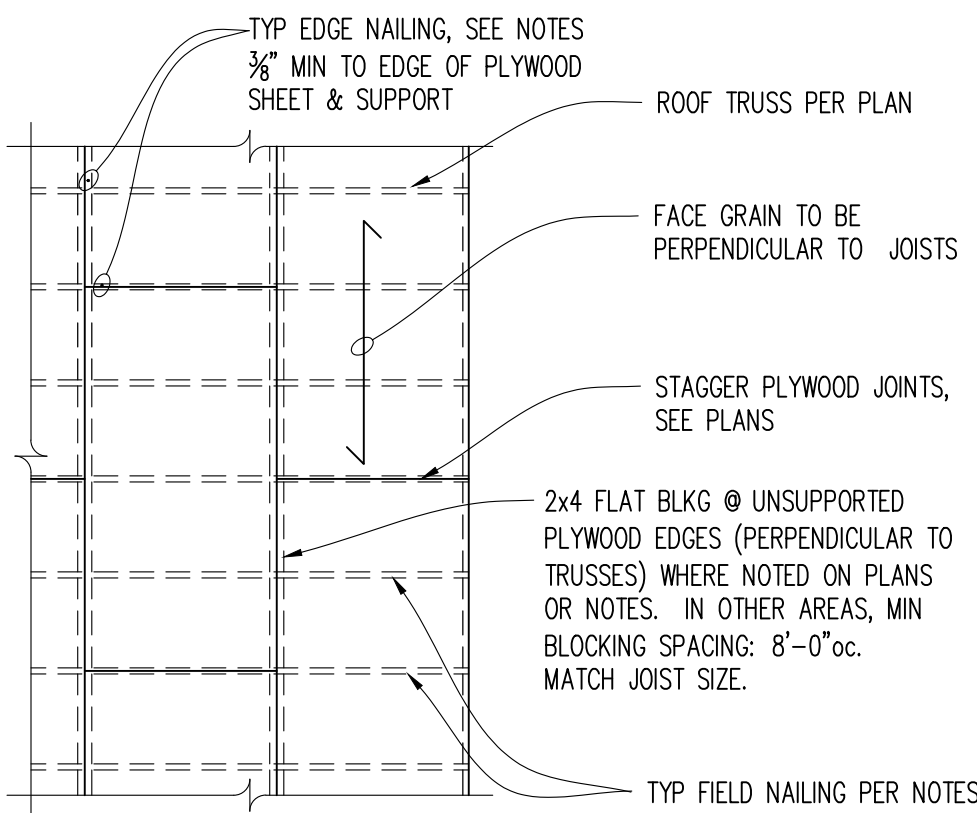

NOTE:
ALL ENDS OF PLYWOOD SHEETS TO SPLICE OVER CL JOISTS OR SUPPORTING MEMBERS.
PANELS LESS THAN 12" IN WIDTH SHALL BE BLOCKED AT ALL EDGES.

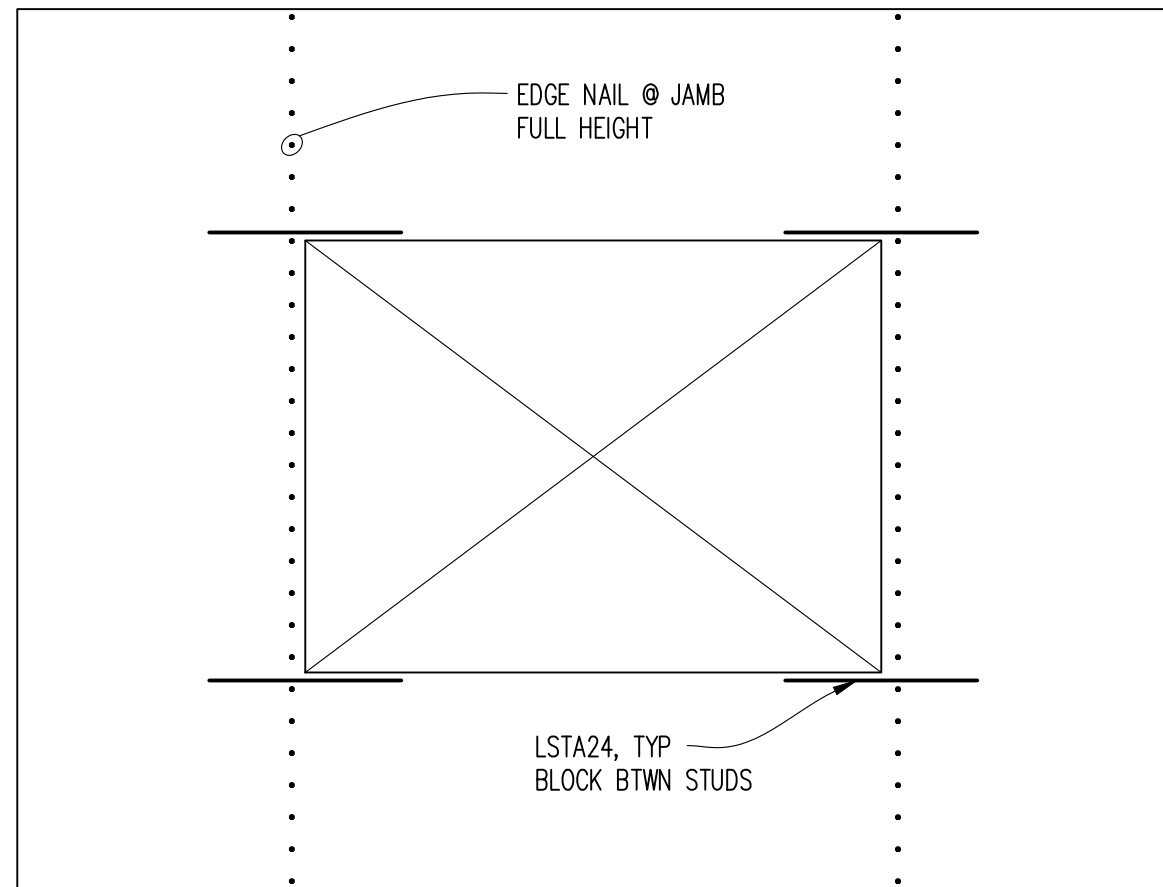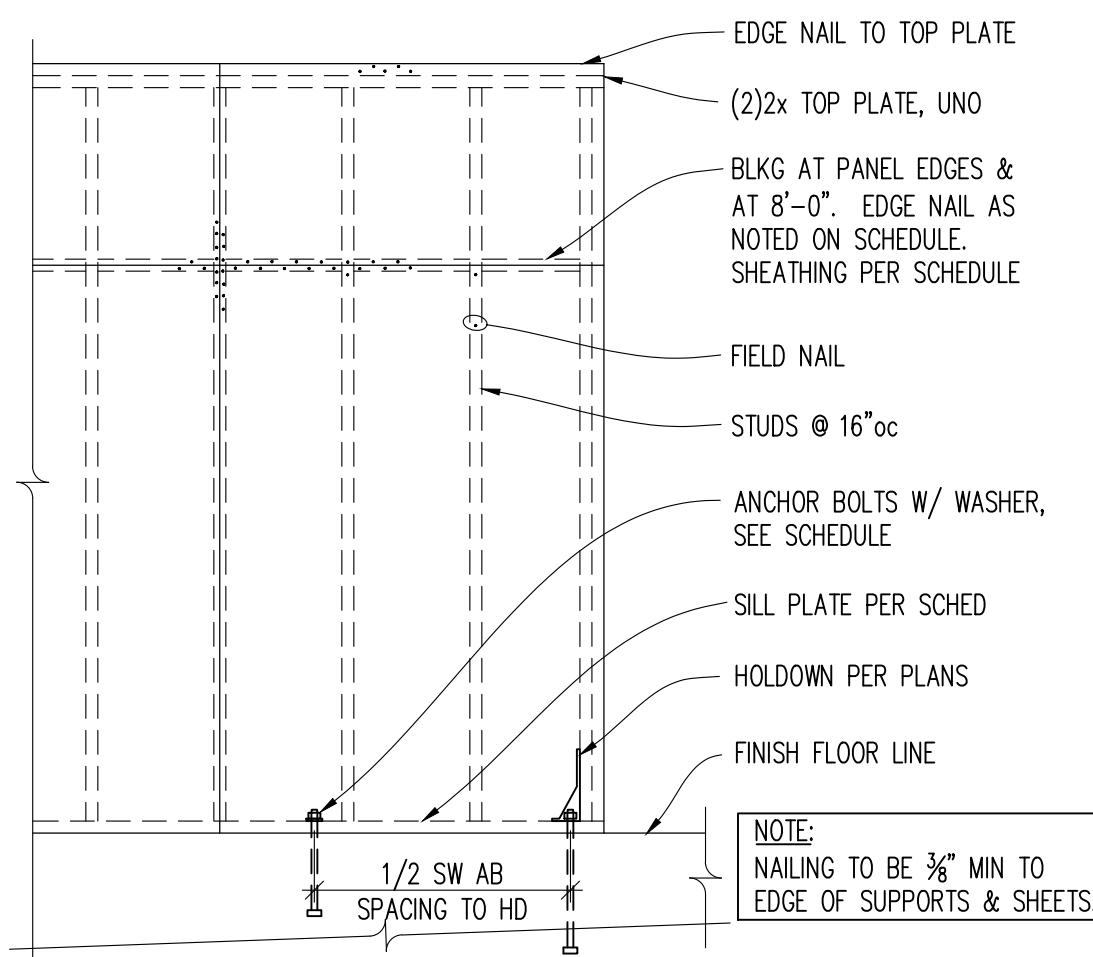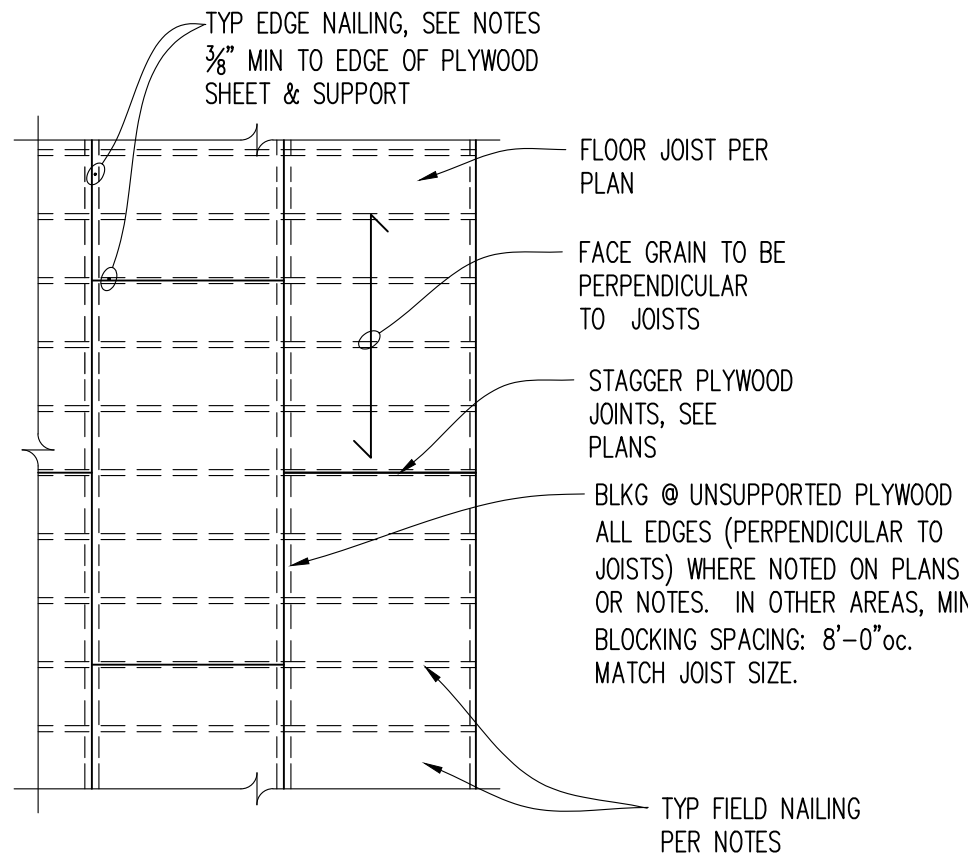

TYPICAL ROOF SHEATHING

11

TYPICAL FLOOR SHEATHING


8

TYPICAL SHEAR WALL SHEATHING

5


STRAP AT SHEAR WALL OPENING

2

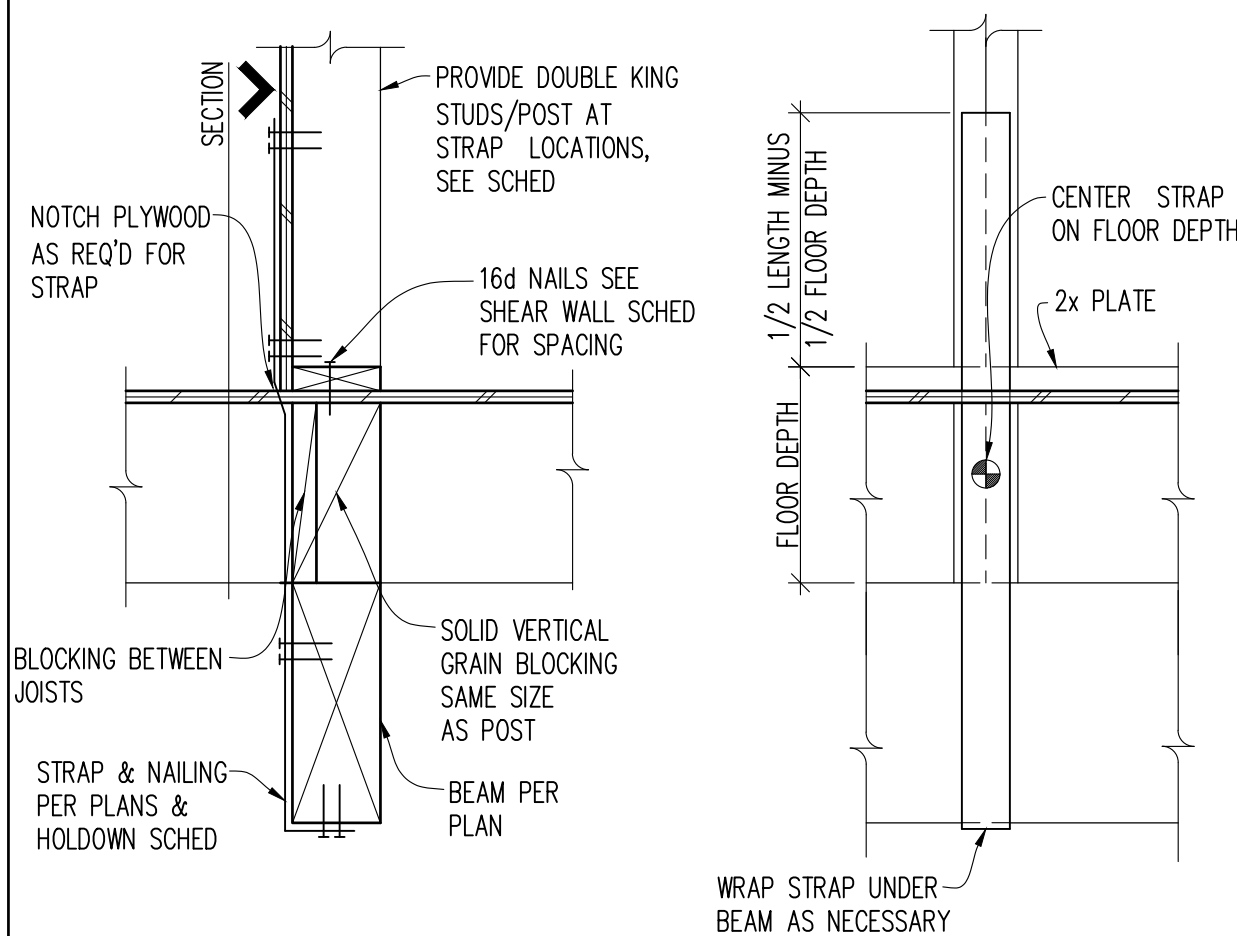


TYP FLR-TO-BM HOLDOWN STRAP

12

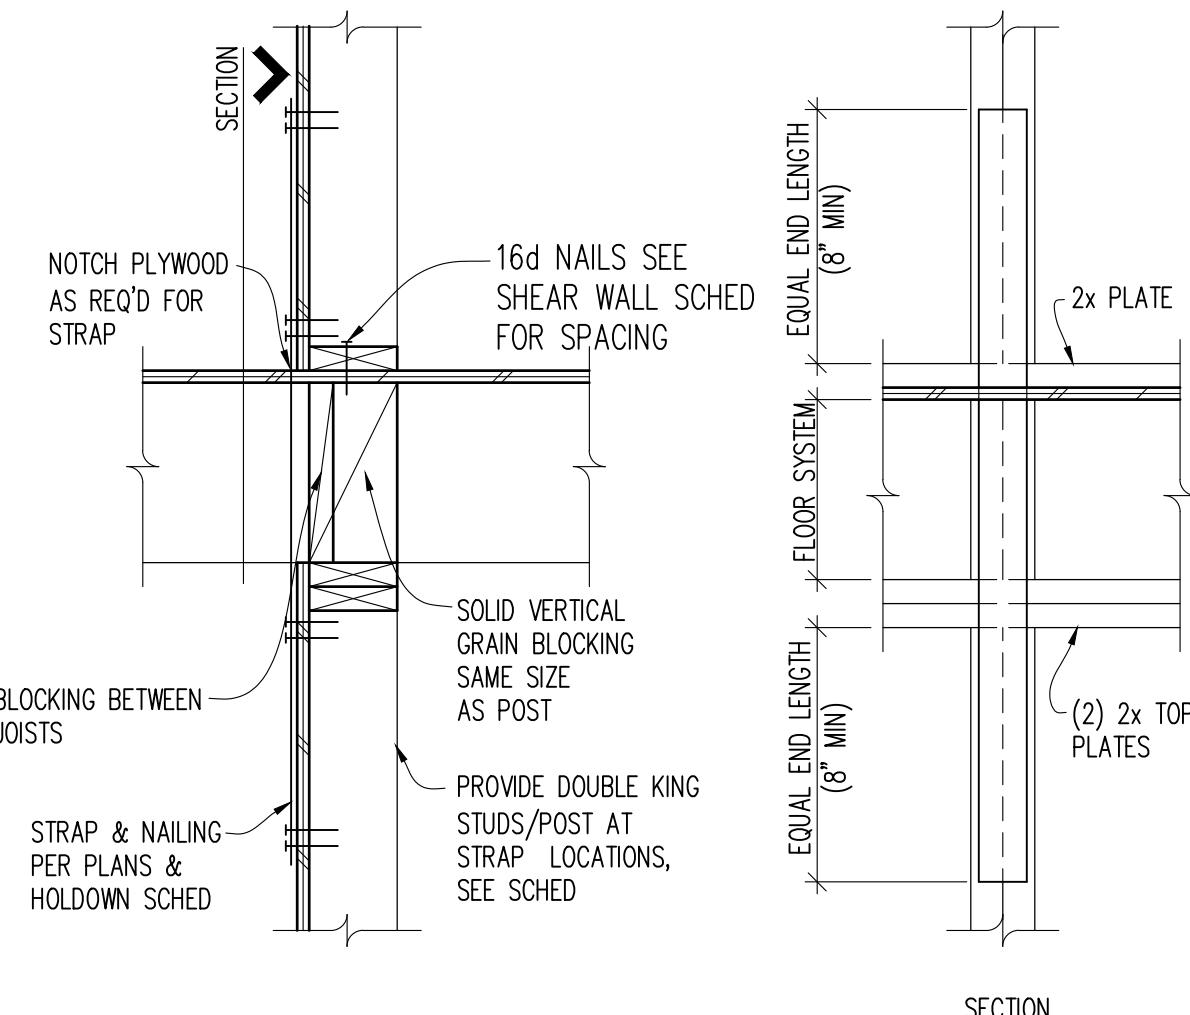


TYP FLR-TO-FLR HOLDOWN STRAP

9

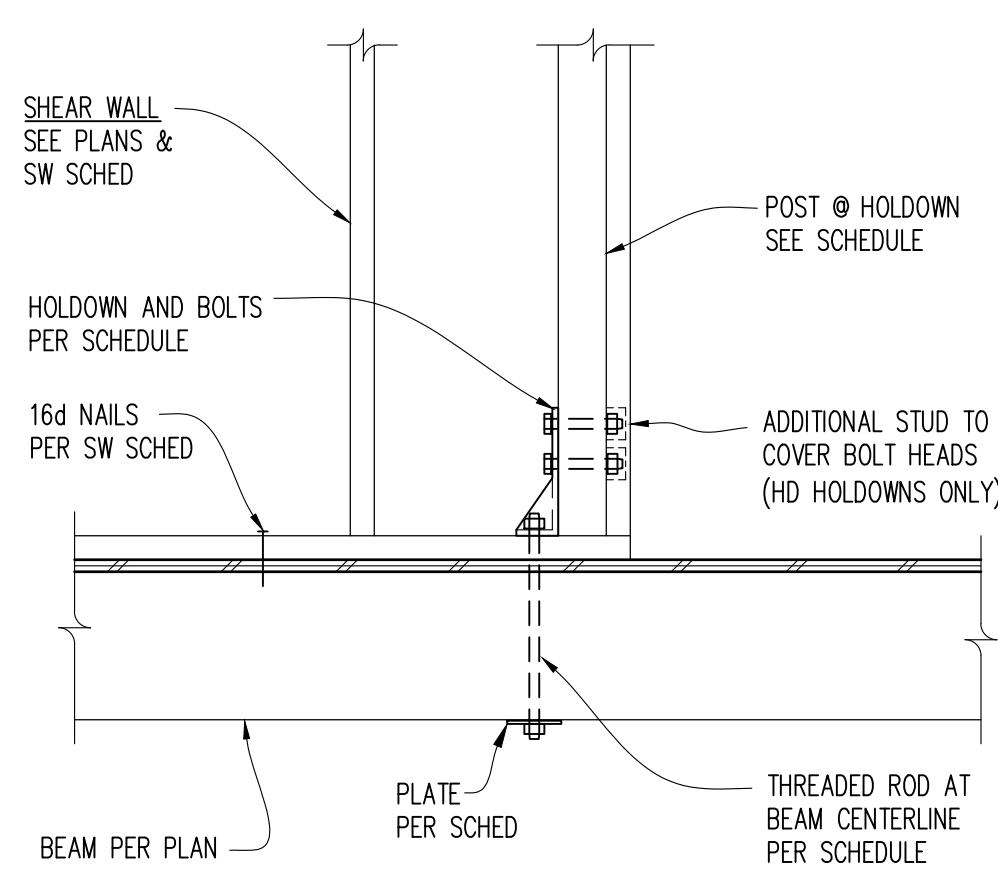


TYPICAL HOLDOWN TO BEAM

6

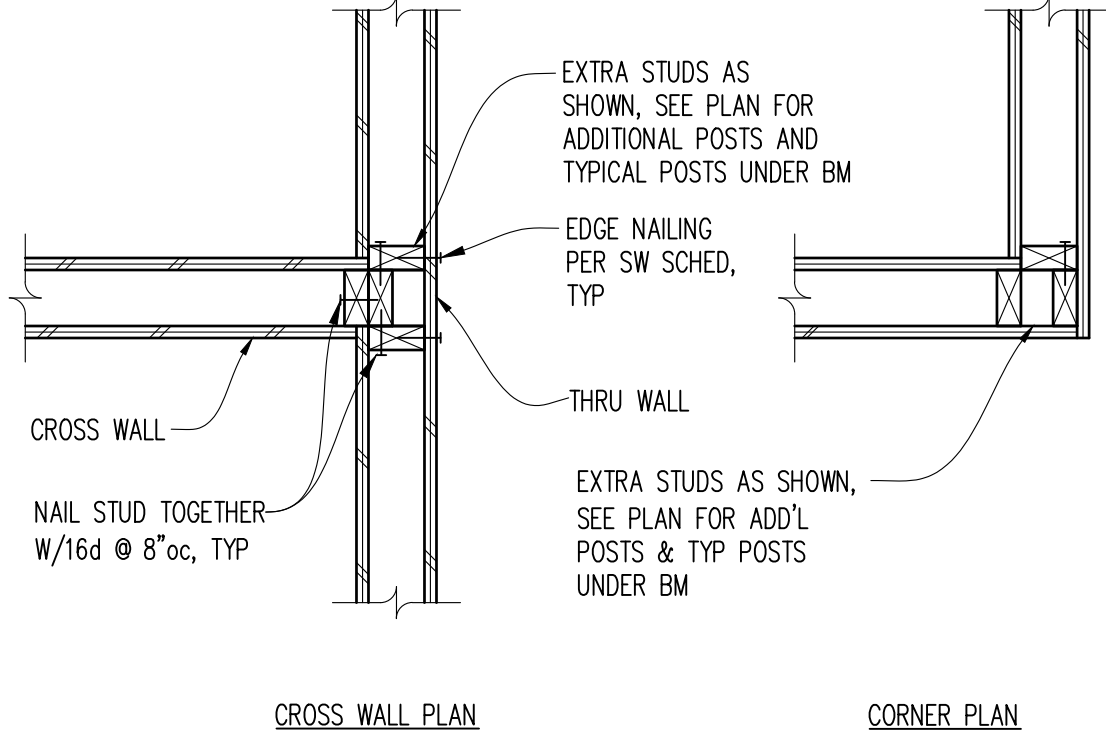

TYPICAL SHEAR WALL INTERSECTION

3

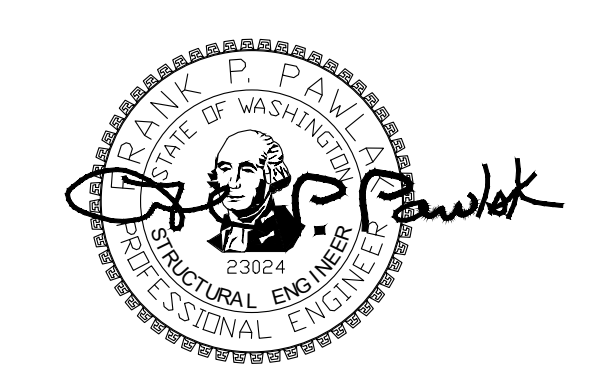

PROJECT

THYGESEN RESIDENCE
8109 SE 71ST STREET
MERCER ISLAND, WA 98040

REVISIONS

NO.	DATE
PERMIT	11/05/2024
PERMIT REV	03/07/2025



12/20/23	23-195
DATE	JOB #
MT	TCB
DESIGN	CHECKED
BDS	AS NOTED
DRAWN	SCALE

SHEET TITLE

TYP LATERAL
SECTIONS &
DETAILS





SHEET NO.

S4.3

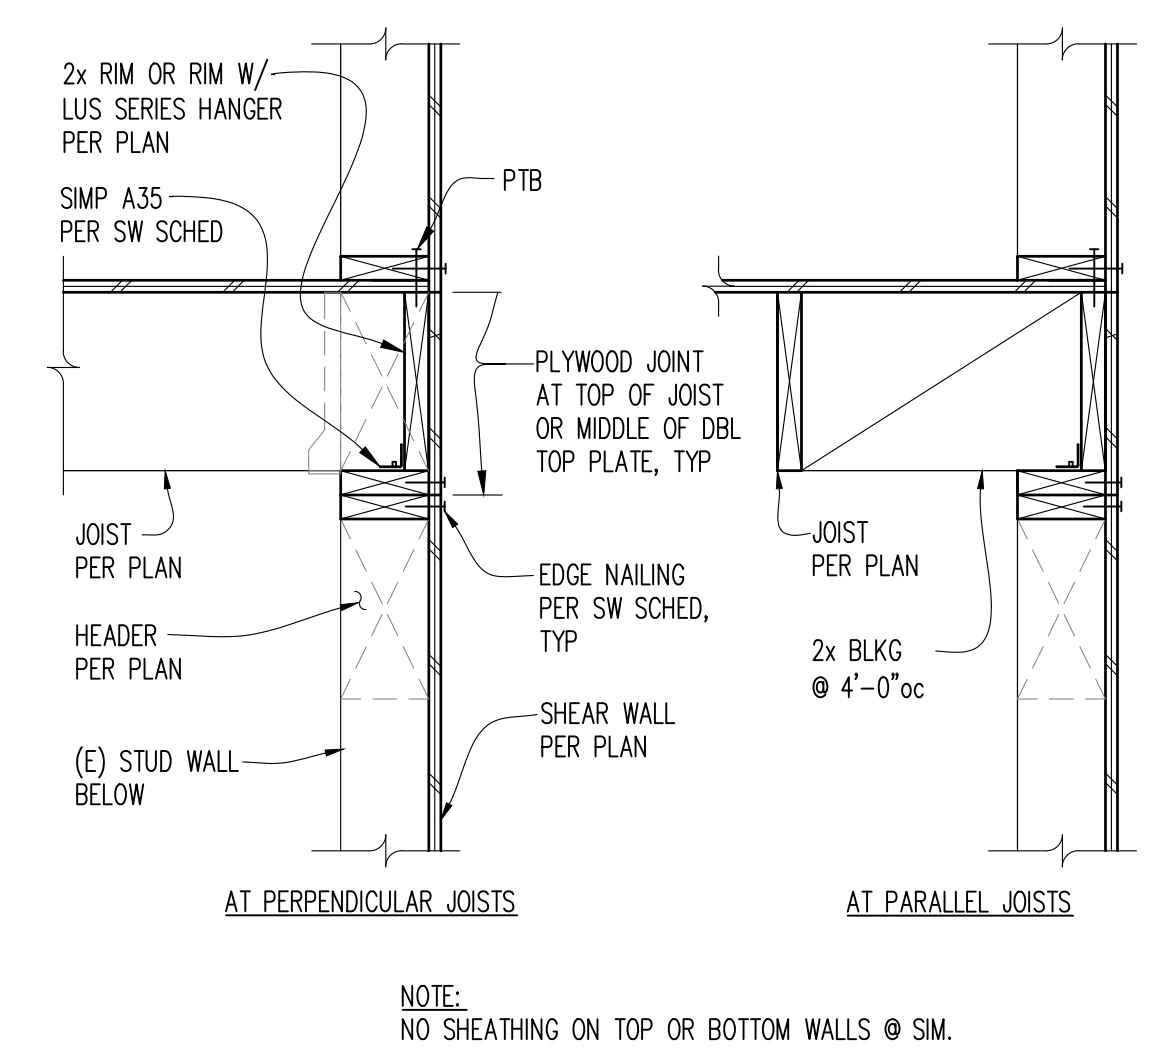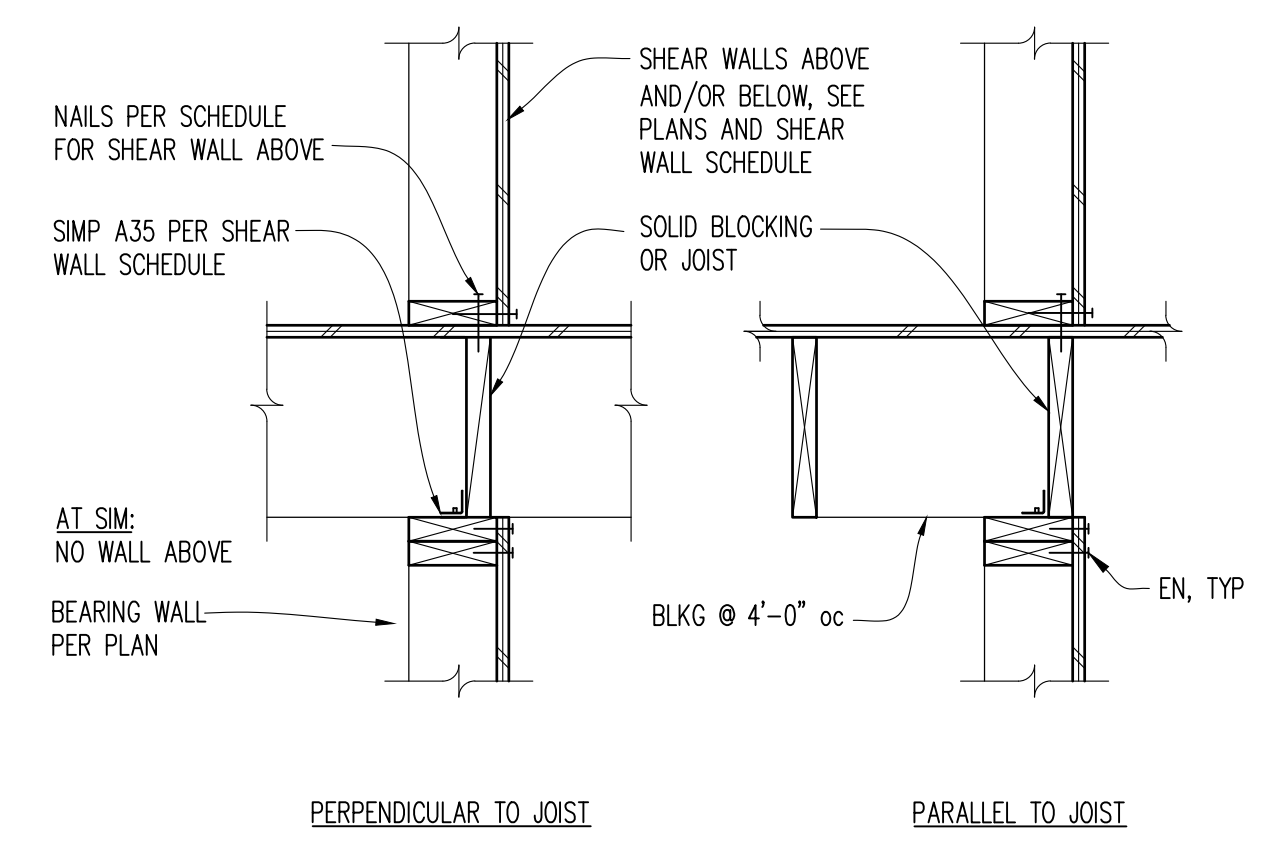

10	7	TYPICAL INTERIOR SHEAR WALL DETAIL	1"=1'-0"	4	TYPICAL EXTERIOR WALL	1"=1'-0"	1
----	---	------------------------------------	----------	---	-----------------------	----------	---

11	8	5	2
----	---	---	---

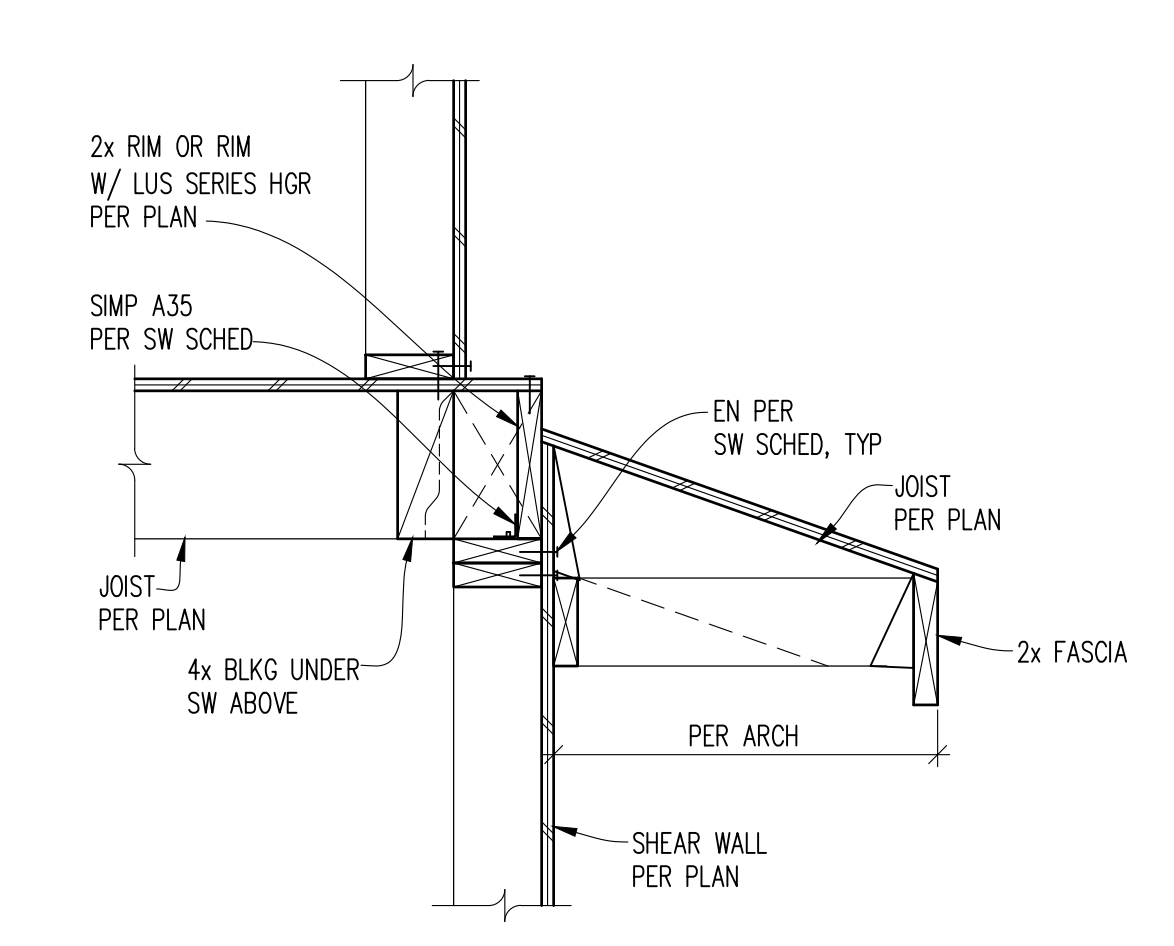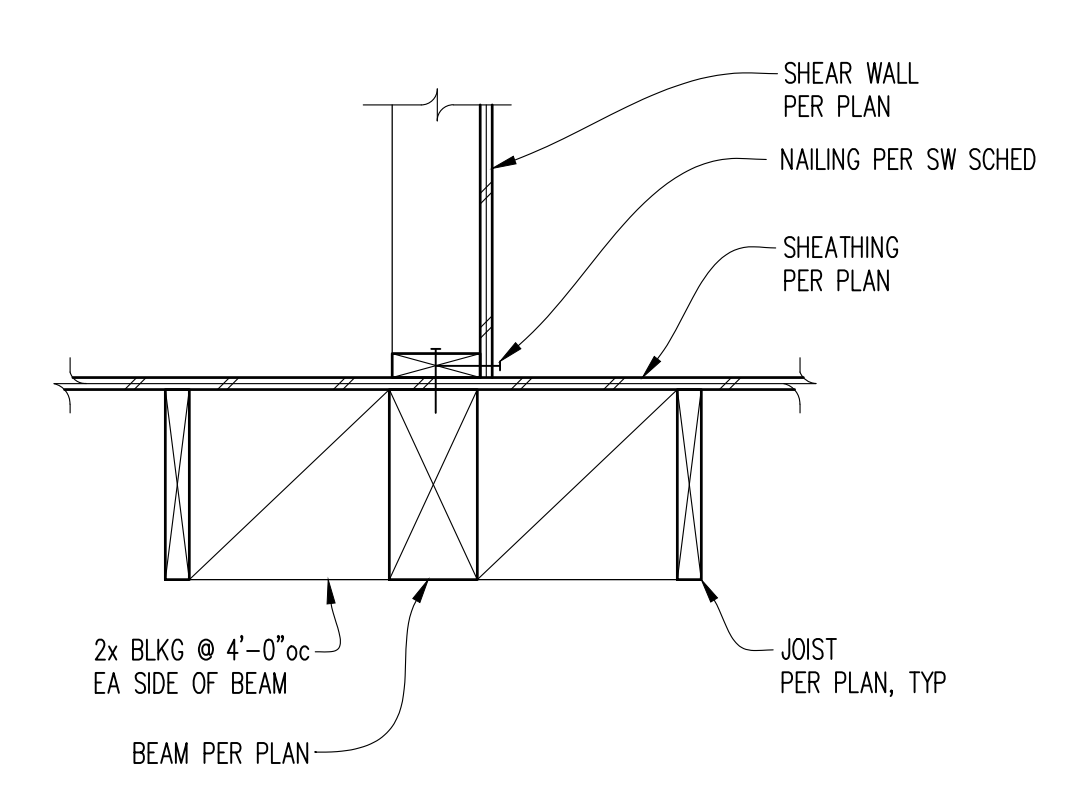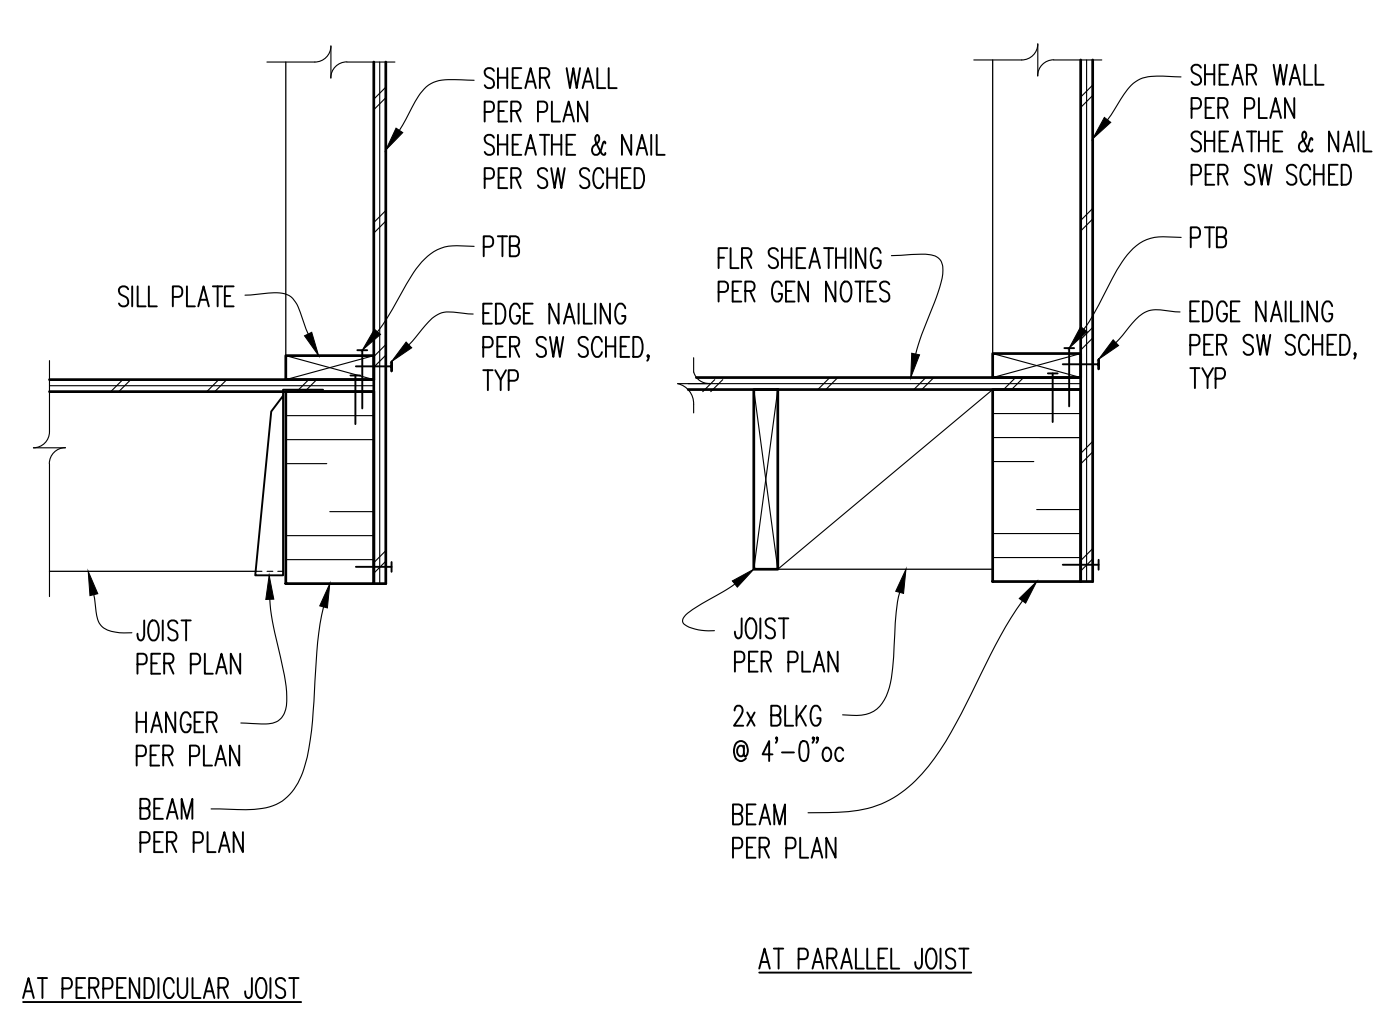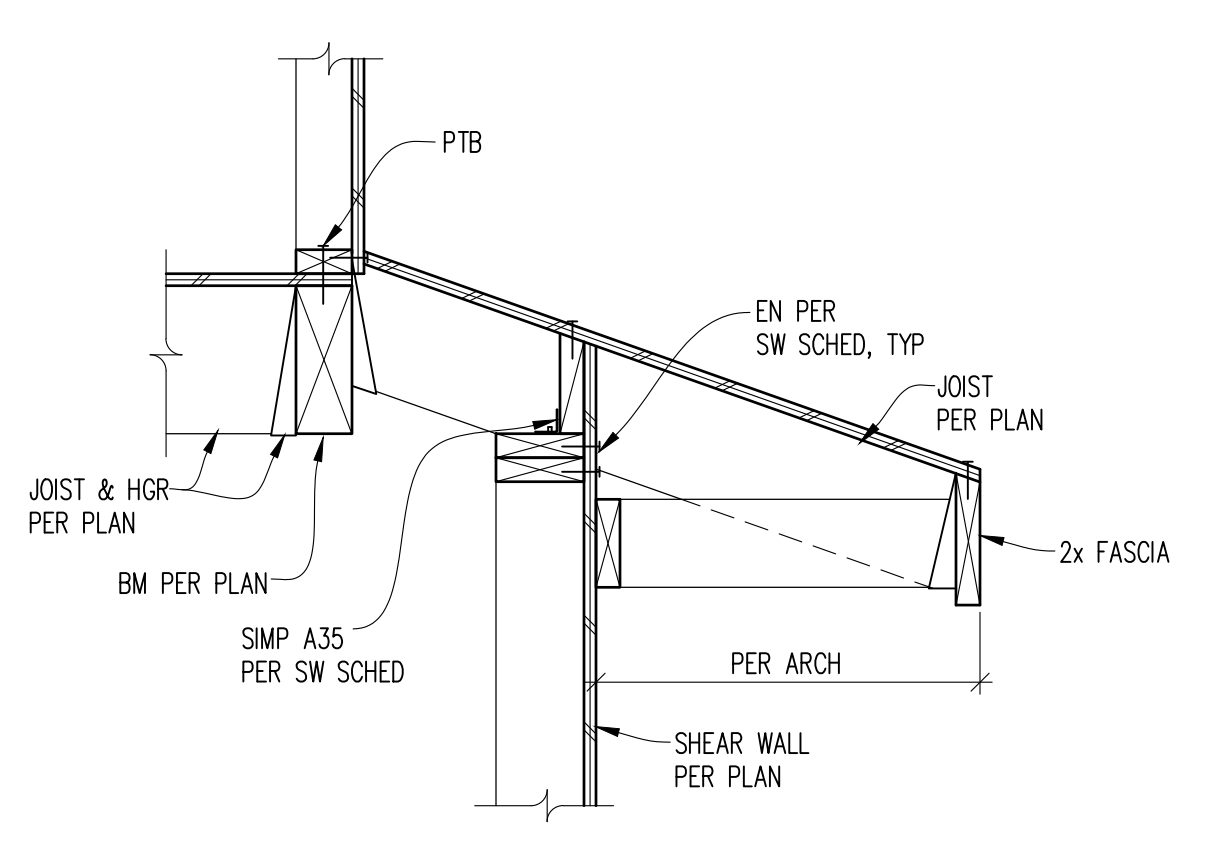

DETAIL	1"=1'-0"	12	FRAMING @ DISCONTINUOUS WALL	1"=1'-0"	9	INTERIOR SHEARWALL ABOVE	1"=1'-0"	6	DETAIL	1"=1'-0"	3
--------	----------	----	------------------------------	----------	---	--------------------------	----------	---	--------	----------	---

BARTLEY
PAWLAK

STRUCTURAL
ENGINEERS

2731 77th Ave SE #100
Mercer Island, WA 98040
Phone: 206.456.3071
Fax: 206.456.3076
www.BP-SE.com

PAUL
P. PAWLAK

23024

REGISTERED
STRUCTURAL ENGINEER
STATE OF WASHINGTON



PROJECT

THYGESEN RESIDENCE
8109 SE 71ST STREET
MERCER ISLAND, WA 98040

REVISIONS

NO.	DATE
PERMIT	11/05/2024
 PERMIT REV	03/07/2025

12/20/23	23-195
DATE	JOB #
MT	TCB
DESIGN	CHECKED
BDS	AS NOTED
DRAWN	SCALE

SHEET TITLE

SECTIONS &
DETAILS

SHEET NO.

S4.4

