

ELEVATION CALCULATION

	EL @ MIDPOINT	segment	wdt sgmt
1	64.40	24.33	1566.85
2	64.80	17.11	1108.73
3	64.40	3.00	193.20
4	64.30	12.83	824.97
5	64.30	3.00	192.90
6	64.10	11.17	716.00
7	63.00	27.33	1721.79
8	62.00	2.00	124.00
9	61.50	18.00	1107.00
10	61.50	28.00	1722.00
11	63.00	18.00	1134.00
12	64.60	11.92	770.03
		176.69	11181.47
AVG. EL =			63.28
BOLD = NEW EL LOWER THAN EXIST			

EXCEPTED BASEMENT FLOOR AREA

segment	length	%cover	wdt
a	24.33	100.0%	218.97
b	26.04	100.0%	234.36
c	3	100.0%	27.00
d	11.17	99.5%	100.03
e	27.33	86.0%	211.53
f	2	77.8%	14.00
g	18	60.0%	97.20
h	28	70.0%	176.40
i	18	100.0%	162.00
j	7.2	100.0%	64.80
perim=	165.07	wdt avg	1306.30
raw FAR	1442	full avg	1485.63
		%	87.93%
full cover =	9.0		
excepted area =	1267.9		

PERCENT COVERAGE IS THE PERCENT OF A BASEMENT WALL THAT IS BURIED BASED ON THE LOWER OF EXISTING OR FINAL GRADE

LOT COVERAGE (SHADED AREA)

House Roof to eaves = 1873 sf
driveway (shaded) = 247 sf
driveway (shaded) = 215 sf
TOTAL (shaded) = 2335 sf
allowable = 6000 x .4 =2400 sf

amount available for hardscape = 64.6 sf

F.A.R. CALCULATION

Main Floor GFA= 1555 sf (inc. gar)
Basement GFA = 1443 sf (88% below grade)
Upper Floor GFA = 1108 sf
4106 sf GFA

excepted FA for FAR calc = (1267.9 sf)
stairs = (70 sf x 2 = 140 sf)

TOTAL chargeable FA = 2698.1 sf = 44.87%
Lot is < 7500 sf therefore FAR = lesser of 3000 sf or, 45% of lot area
.45 x 6000 sf = 2700 sf, FAR limit = 2700 sf

A. SITE PLAN

1" = 10'-0"

ww = WINDOW WELL
— = PAVEMENT/DECK LINE
- - - = EAVE/ROOF LINE
- - - - - = EXTENT OF LIVING AREA
- - - - - = BUILDING FOOTPRINT (FOUNDATION EXTENTS)
- - - - - = GUTTER LINE
⊙ = WALL SEGMENT TAG FOR HEIGHT CALCULATION
① = WALL SEGMENT TAG FOR BASEMENT FAR EXCEPTION

LOT SLOPE

HIGH POINT = 67.3'
LOW POINT = 57.7'
LOT SLOPE = 9.6'/116.75' = 8.22%
LOT COVERAGE = 40%

HARDSCAPE

ENRTY WALK - 111 SF
SIDE PATIO - 264 SF
REAR DECK - 221.5
RET. WALLS/WW - 4.3
TOTAL = 600.8 sf

allowable = 600 sf x .09 = 540 sf
extra lot cov. =64.6 sf
TOTAL allow. = 606.4 sf

Code Data

2021 International Building Code (IBC) - struct.
2021 International Residential Code (IRC)
2021 International Mechanical Code (IMC)
2021 International Fuel Gas Code (IFGC)
2021 Uniform Plumbing Code (UPC)
2021 International Fire Code (IFC)
2021 International Existing Building Code
2021 International Swimming Pool and Spa Code
Washington State Energy Code (WCEC)
ICC/ANSI A117.1-09, Accessible and Usable Buildings and Facilities, with statewide and City amendments

A NFPA 72— Chapter 29 Monitored Fire Alarm System in compliance with NFPA 72 and CoMI standards shall be installed throughout the residence. A separate FIRE permit is required.

A NFPA 13R Fire Sprinkler System in compliance with NFPA 13R and CoMI standards shall be installed throughout the residence. A separate FIRE permit is required.

The sprinkler system requires a minimum of a 1.5" water meter and 2" water supply line.

All Japanese knotweed (*Polygonum cuspidatum*) and Regulated Class A, Regulated Class B, and Regulated Class C weeds identified on the King County Noxious Weed list, as amended, shall be removed from the property.

development proposals for a new single-family home shall remove japanese knotweed (*polygonum cuspidatum*) and regulated class a, regulated class b, and regulated class c weeds identified on the king county noxious weed list, as amended, from required landscaping areas established pursuant to subsection 19.02.020(f)(3)(a). new landscaping associated with new single-family home shall not incorporate any weeds identified on the king county noxious weed list, as amended. provided, that removal shall not be required if the removal will result in increased slope instability or risk of landslide or erosion.

Civil Engineer

Duffy Ellis
CES Civil Engineering
102 NW Canal St Seattle WA 98107
206.930.0342

Structural Engineer

Javid Abdi, PE, SE Atlas Consulting Structural Engineers
6810 NE 149th St Kenmore WA 98028
Phone: (206) 427-7233

Contractor

Aspen Homes NW
Mike Yeganeh
P.O. BOX # 1056
Mercer Island, WA 98040
Lic # ASPPENHN870MK

Project Description

Demolish existing and build new single family residence.

Parcel Number/Legal

Parcel # = 2174500520
Legal Description:
EAST SEATTLE ADD
PLat Block: 3
Plat Lot: 32-33
ZONING = R-8.4
lot size = 6,000 sf

Owner

SINA YEGANEH
3307 E PIKE ST
Seattle WA 98122

9317
REGISTERED
ARCHITECT
Chris Luth
STATE OF WASHINGTON

C

L

CENTERLINE
DESIGN
4737 37th Ave SW
SEATTLE
206.935.4654
www.Centerline-Design.com

Yeganeh Residence
3029 62nd Ave SE

CONTENTS
Site Plan

DRAWN BY
CRL
DATE
5.29.24
10.4.24


01

NOTES

[SD] = SMOKE DETECTOR, HARDWIRE, INTERCONNECTED w/ BATTERY BACK-UP
[CO] = CARBON MONOXIDE DETECTOR, HARDWIRE w/ BATTERY BACK-UP
[HD] = HEAT DETECTOR, HARDWIRE w/ BATTERY BACK-UP
DOORS ARE 3-0 x 6-8 (r.o. = 3'-2" x 6'-10") unless otherwise indicated
⊙ = FAN, 50 CFM UNLESS OTHERWISE INDICATED
FOR SHEAR WALL INFORMATION SEE STRUCTURAL PLANS
ALL INTERIOR WALLS TO BE 2x4, EXTERIOR WALLS 2x6, EXCEPT AS INDICATED, OR EXISTING
[E] = EGRESS WINDOWS
Contractor shall verify to Inspector all guards and railings shall be capable of resisting 200 lb load on top rail acting in any direction as required by IRC Table R301.5.
ALL WALLS FULL HEIGHT UNLESS OTHERWISE INDICATED
① = TEMPER/SAFETY GLAZE WINDOWS
ALL GAS F.P. TO BE APPROVED DIRECT VENT


EGRESS WINDOW REQUIREMENTS

Minimum of 5.7 square feet of net clear opening area. Minimum of 24 inches of net clear opening height. Minimum of 20 inches of net clear opening width. Opening must be max 44" above floor.

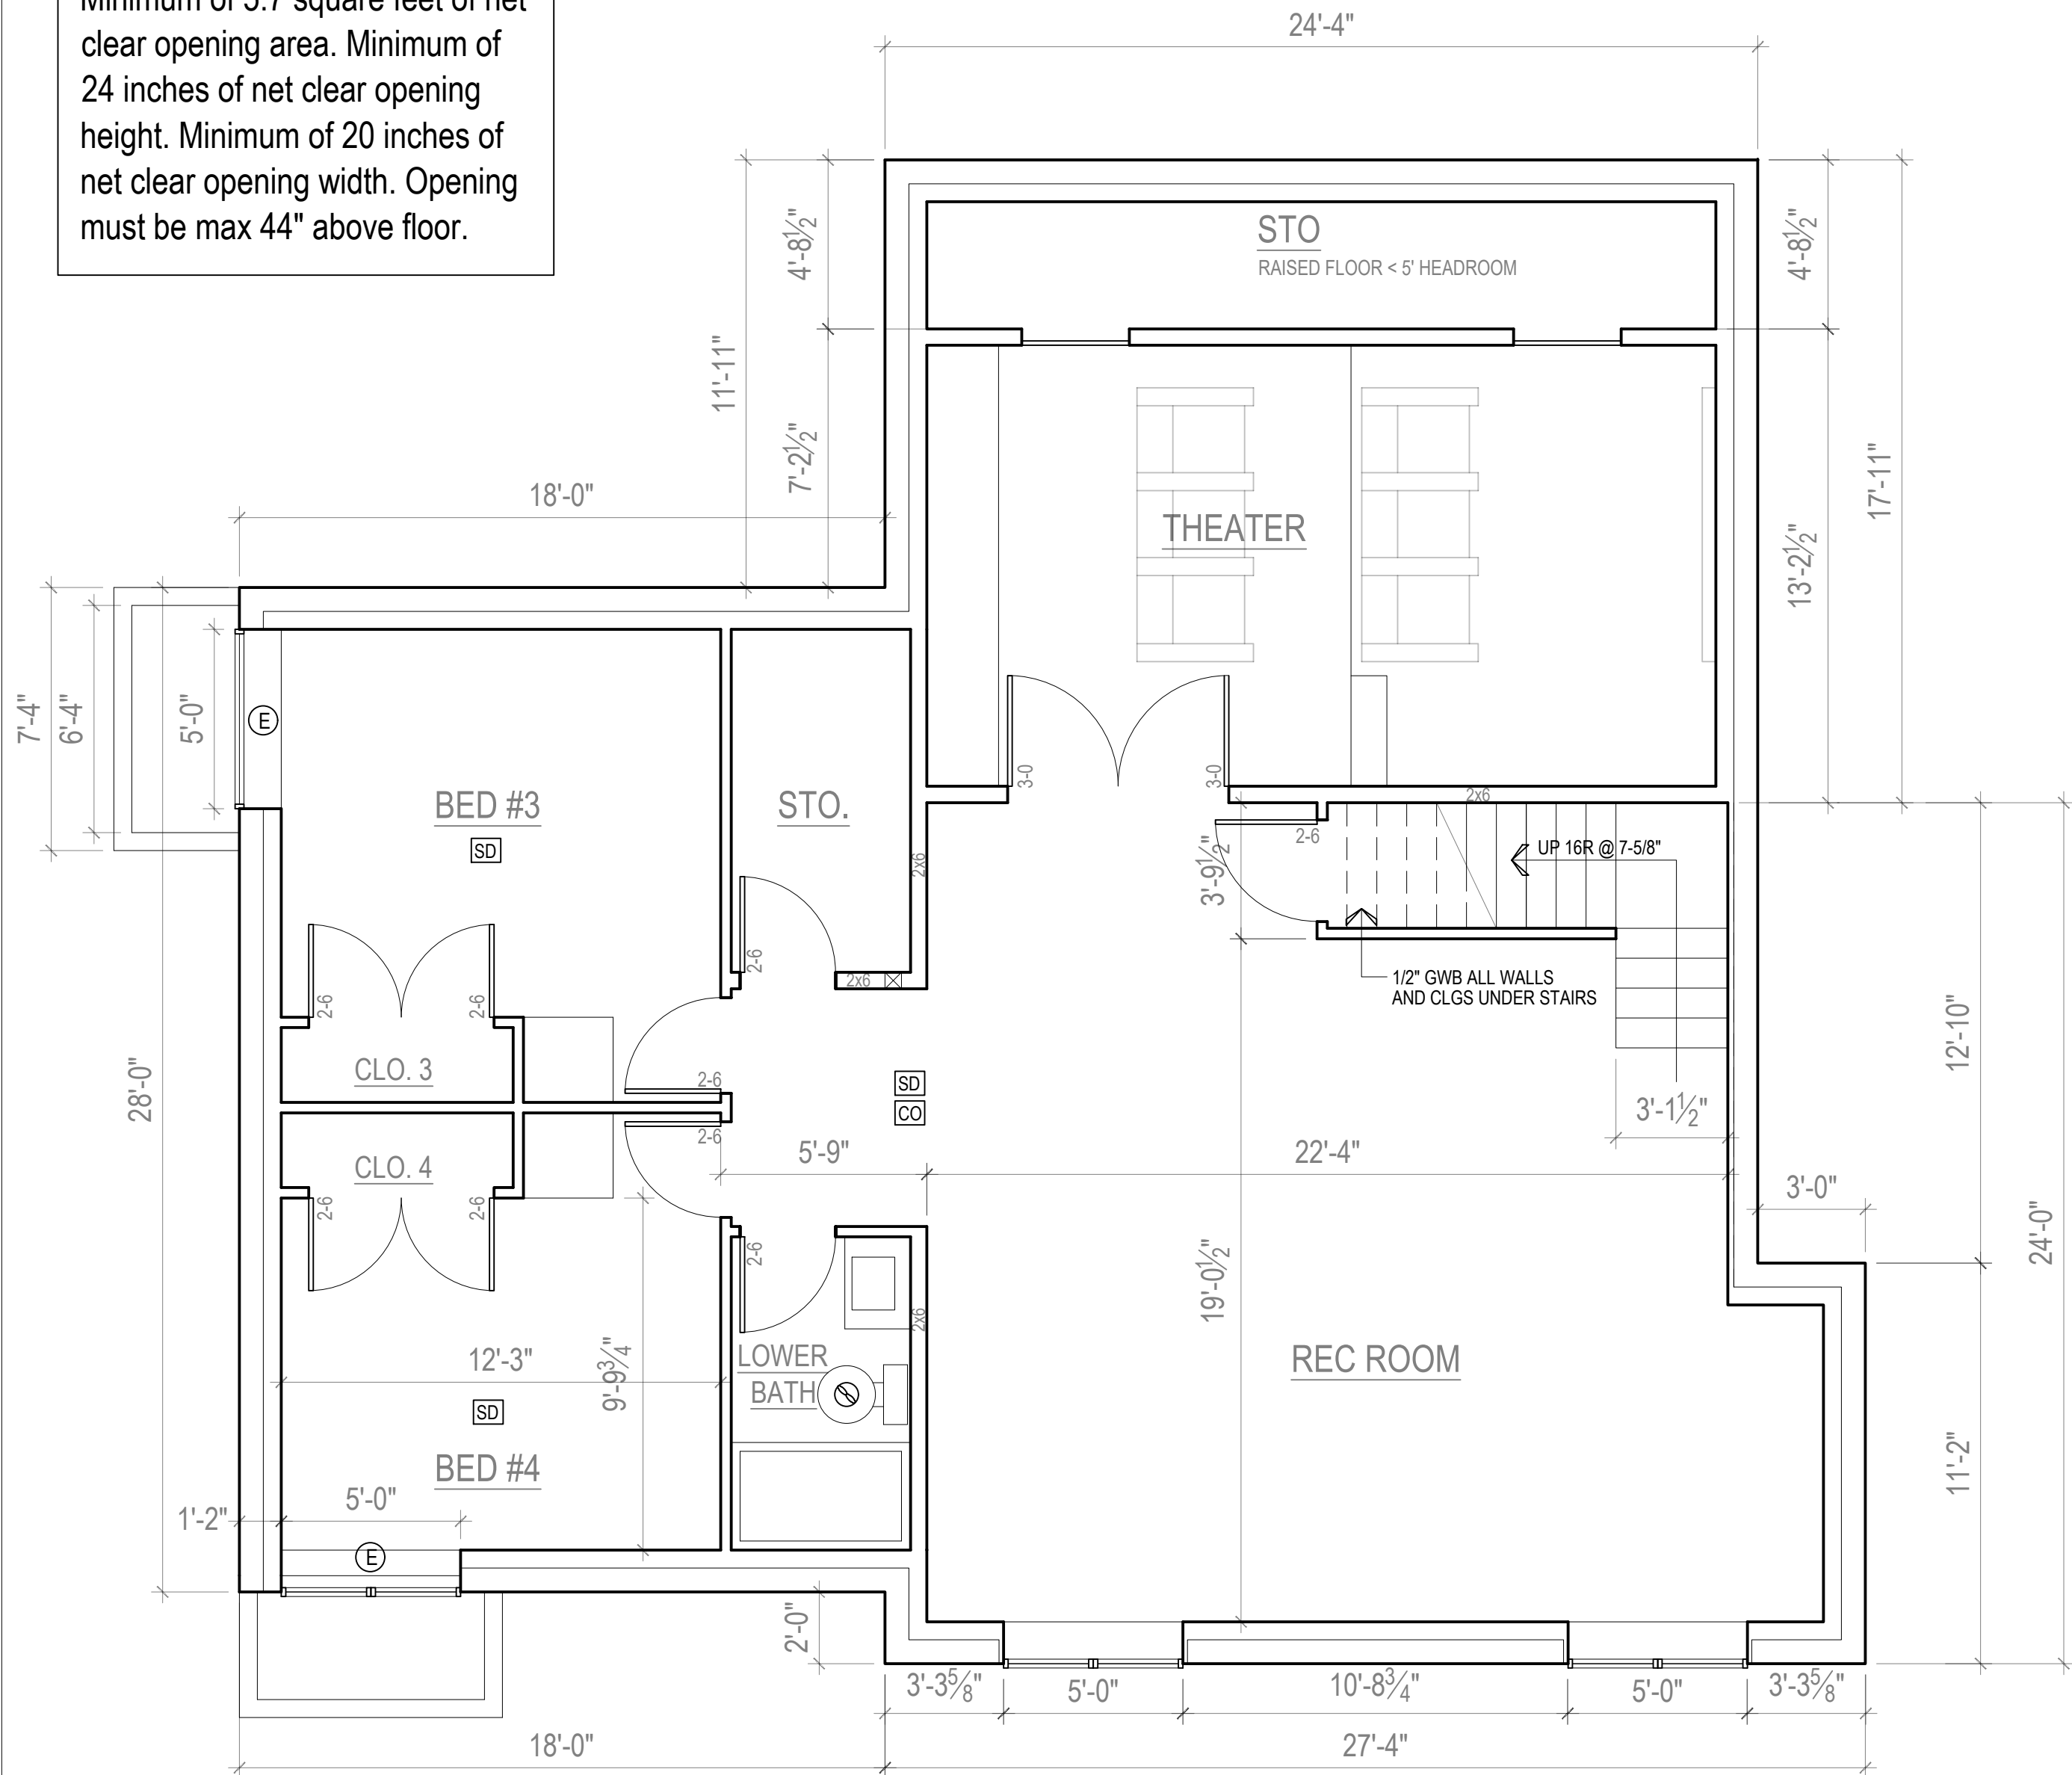

B. LOWER FLOOR PLAN
1/4" = 1'-0"
1443 sf
1443 sf - (1267.9 sf excepted area) = 175.1 sf chargeable FAR

RANGE VENTING NOTE:
160 Cfm intermittent electric range. 250 Cfm combustion range.

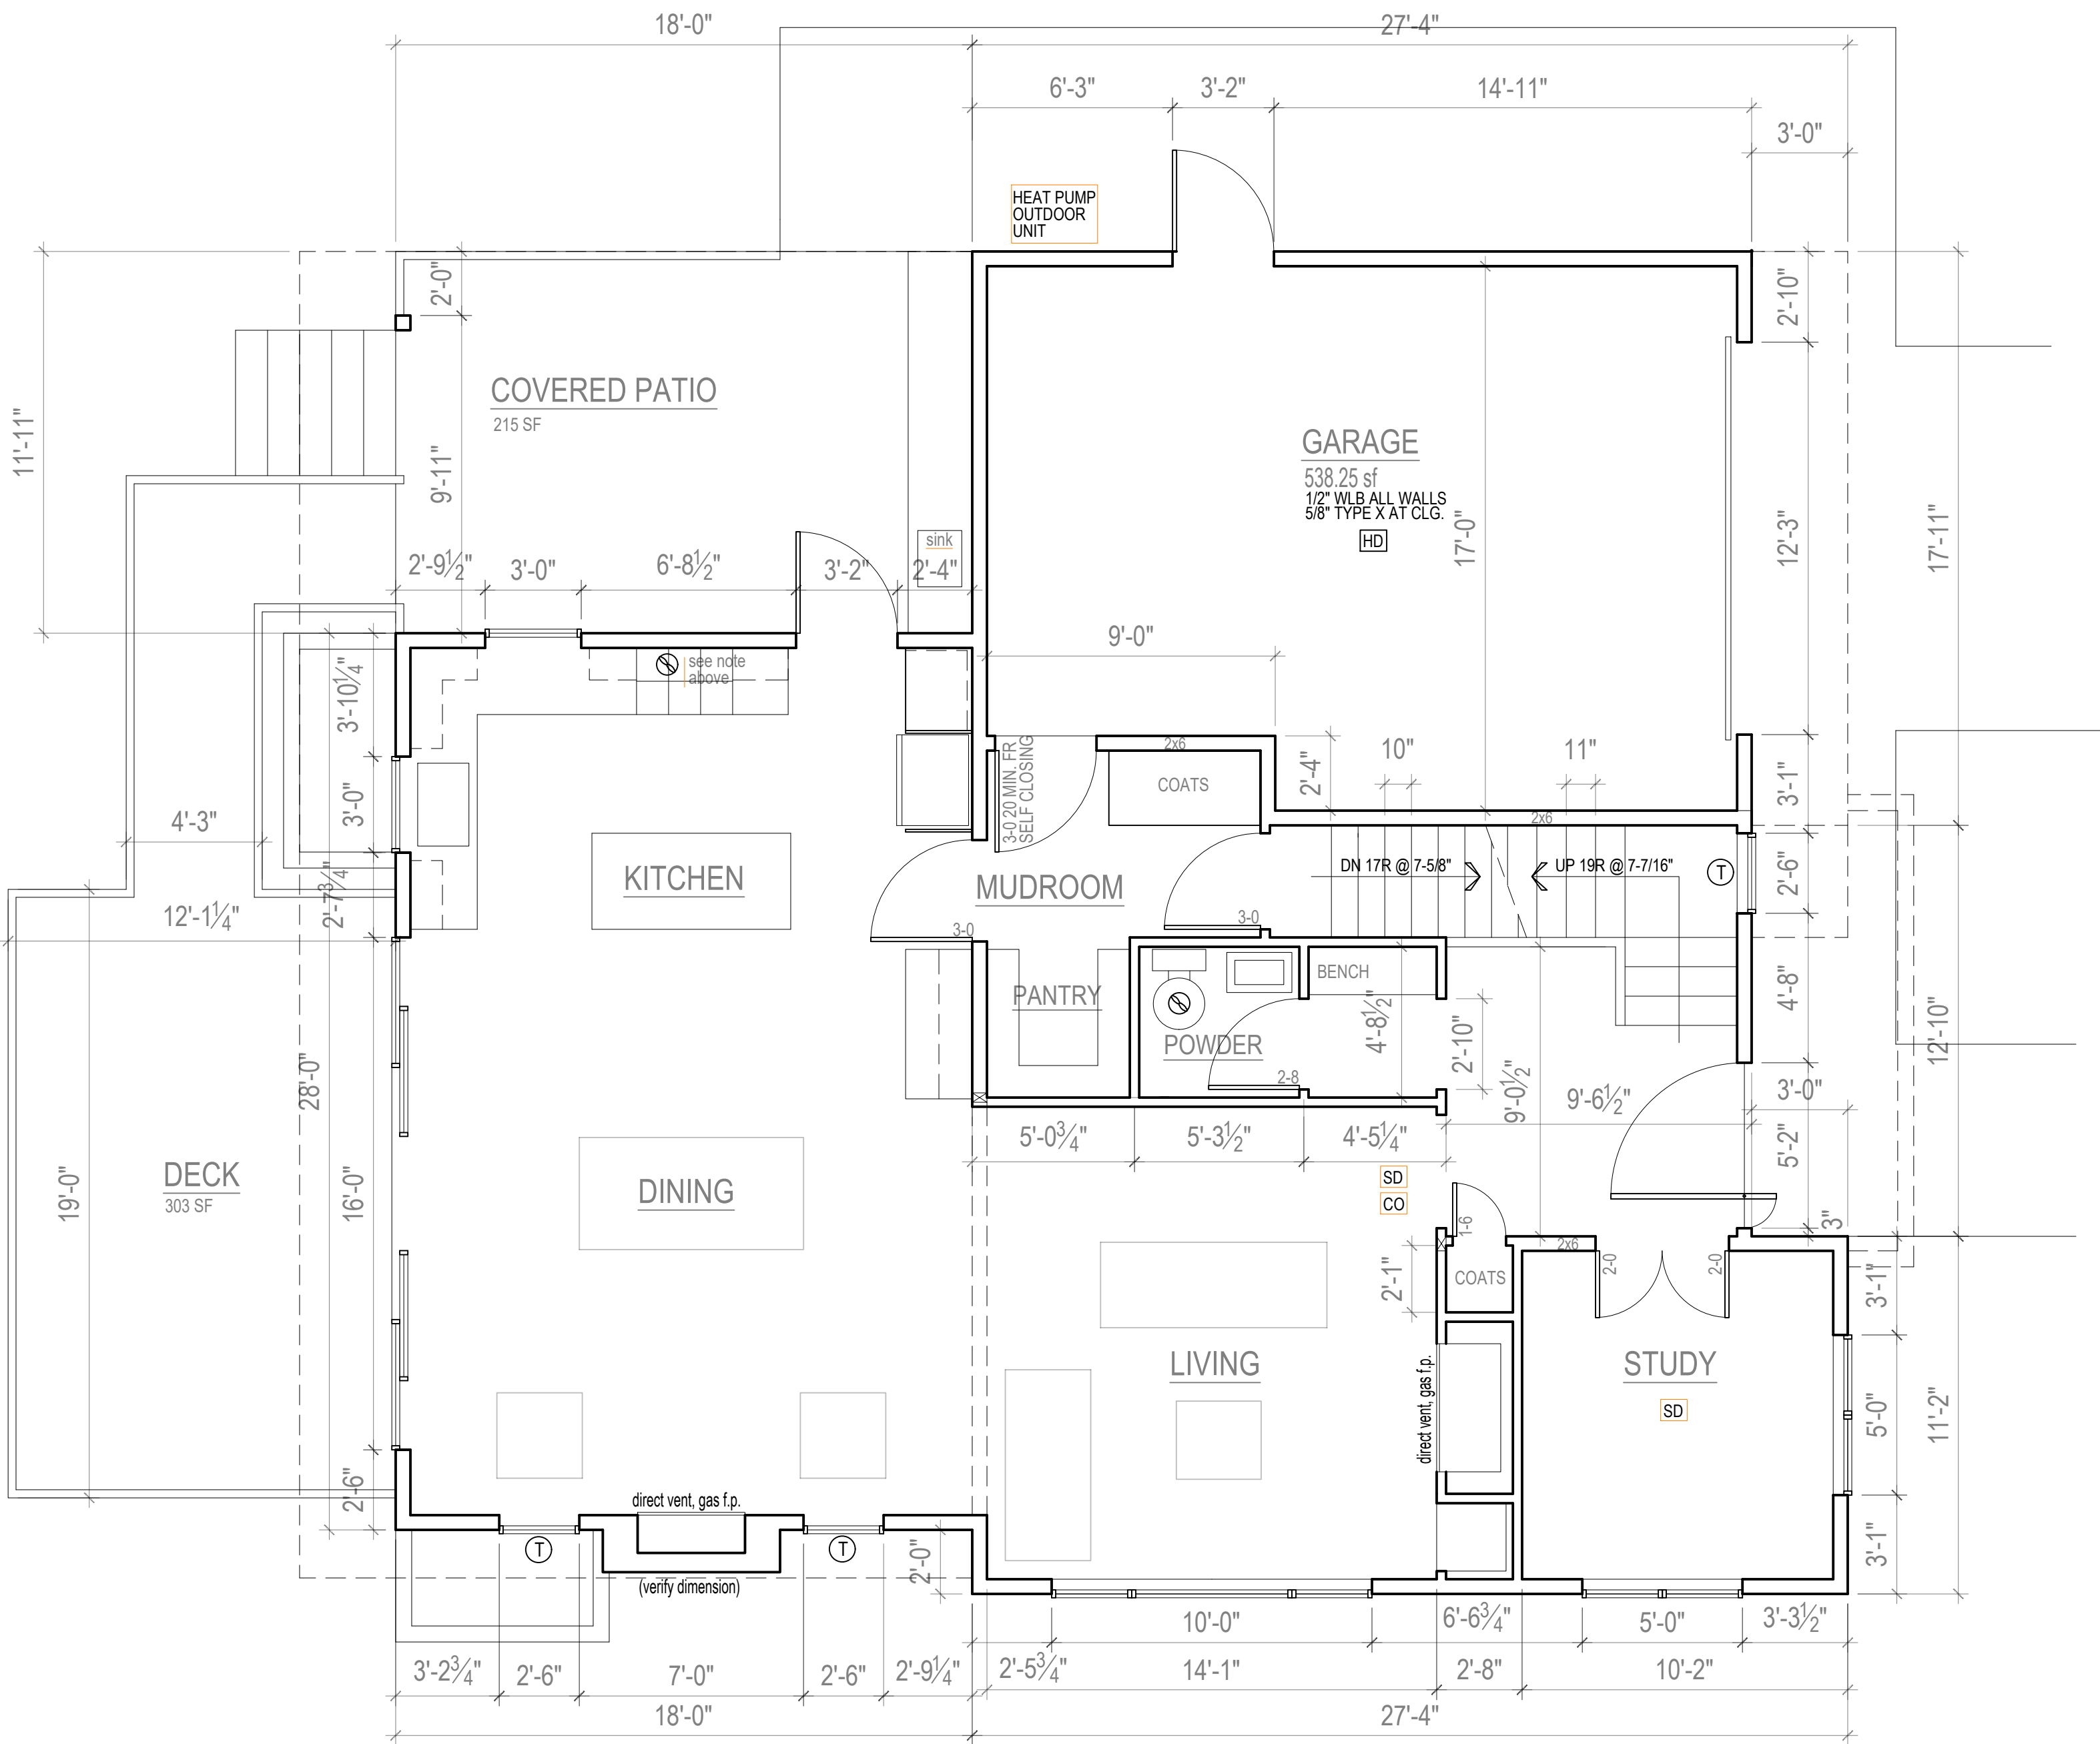

A. MAIN FLOOR PLAN
1/4" = 1'-0"
1016.75sf (house) + 538.25sf (gar) = 1555 sf

9317
REGISTERED ARCHITECT
Chris Latta
CHRIS LATTI
STATE OF WASHINGTON

Yeganeh Residence
3029 62nd Ave SE

CONTENTS
floor Plans

DRAWN BY
CRL

DATE
5.29.24
10.4.24

02

NOTES

SD

= SMOKE DETECTOR, HARDWIRE, INTERCONNECTED w/ BATTERY BACK-UP

CO

= CARBON MONOXIDE DETECTOR, HARDWIRE w/ BATTERY BACK-UP

HD

= HEAT DETECTOR, HARDWIRE w/ BATTERY BACK-UP

DOORS ARE 3-0 x 6-8 (r.o. = 3'-2" x 6'-10") unless otherwise indicated

= FAN, 50 CFM UNLESS OTHERWISE INDICATED

FOR SHEAR WALL INFORMATION SEE STRUCTURAL PLANS

ALL INTERIOR WALLS TO BE 2x4, EXTERIOR WALLS 2x6, EXCEPT AS INDICATED, OR EXISTING

E

=EGRESS WINDOWS

Contractor shall verify to Inspector all guards and railings shall be capable of resisting 200 lb load on top rail acting in any direction as required by IRC Table R301.5.

ALL WALLS FULL HIEGHT UNLESS OTHERWISE INDICATED


1

=TEMPER/SAFETY GLAZE WINDOWS



ALL GAS F.P. TO BE APPROVED DIRECT VENT

EGRESS WINDOW REQUIREMENTS


Minimum of 5.7 square feet of net clear opening area. Minimum of 24 inches of net clear opening height. Minimum of 20 inches of net clear opening width. Opening must be max 44" above floor.

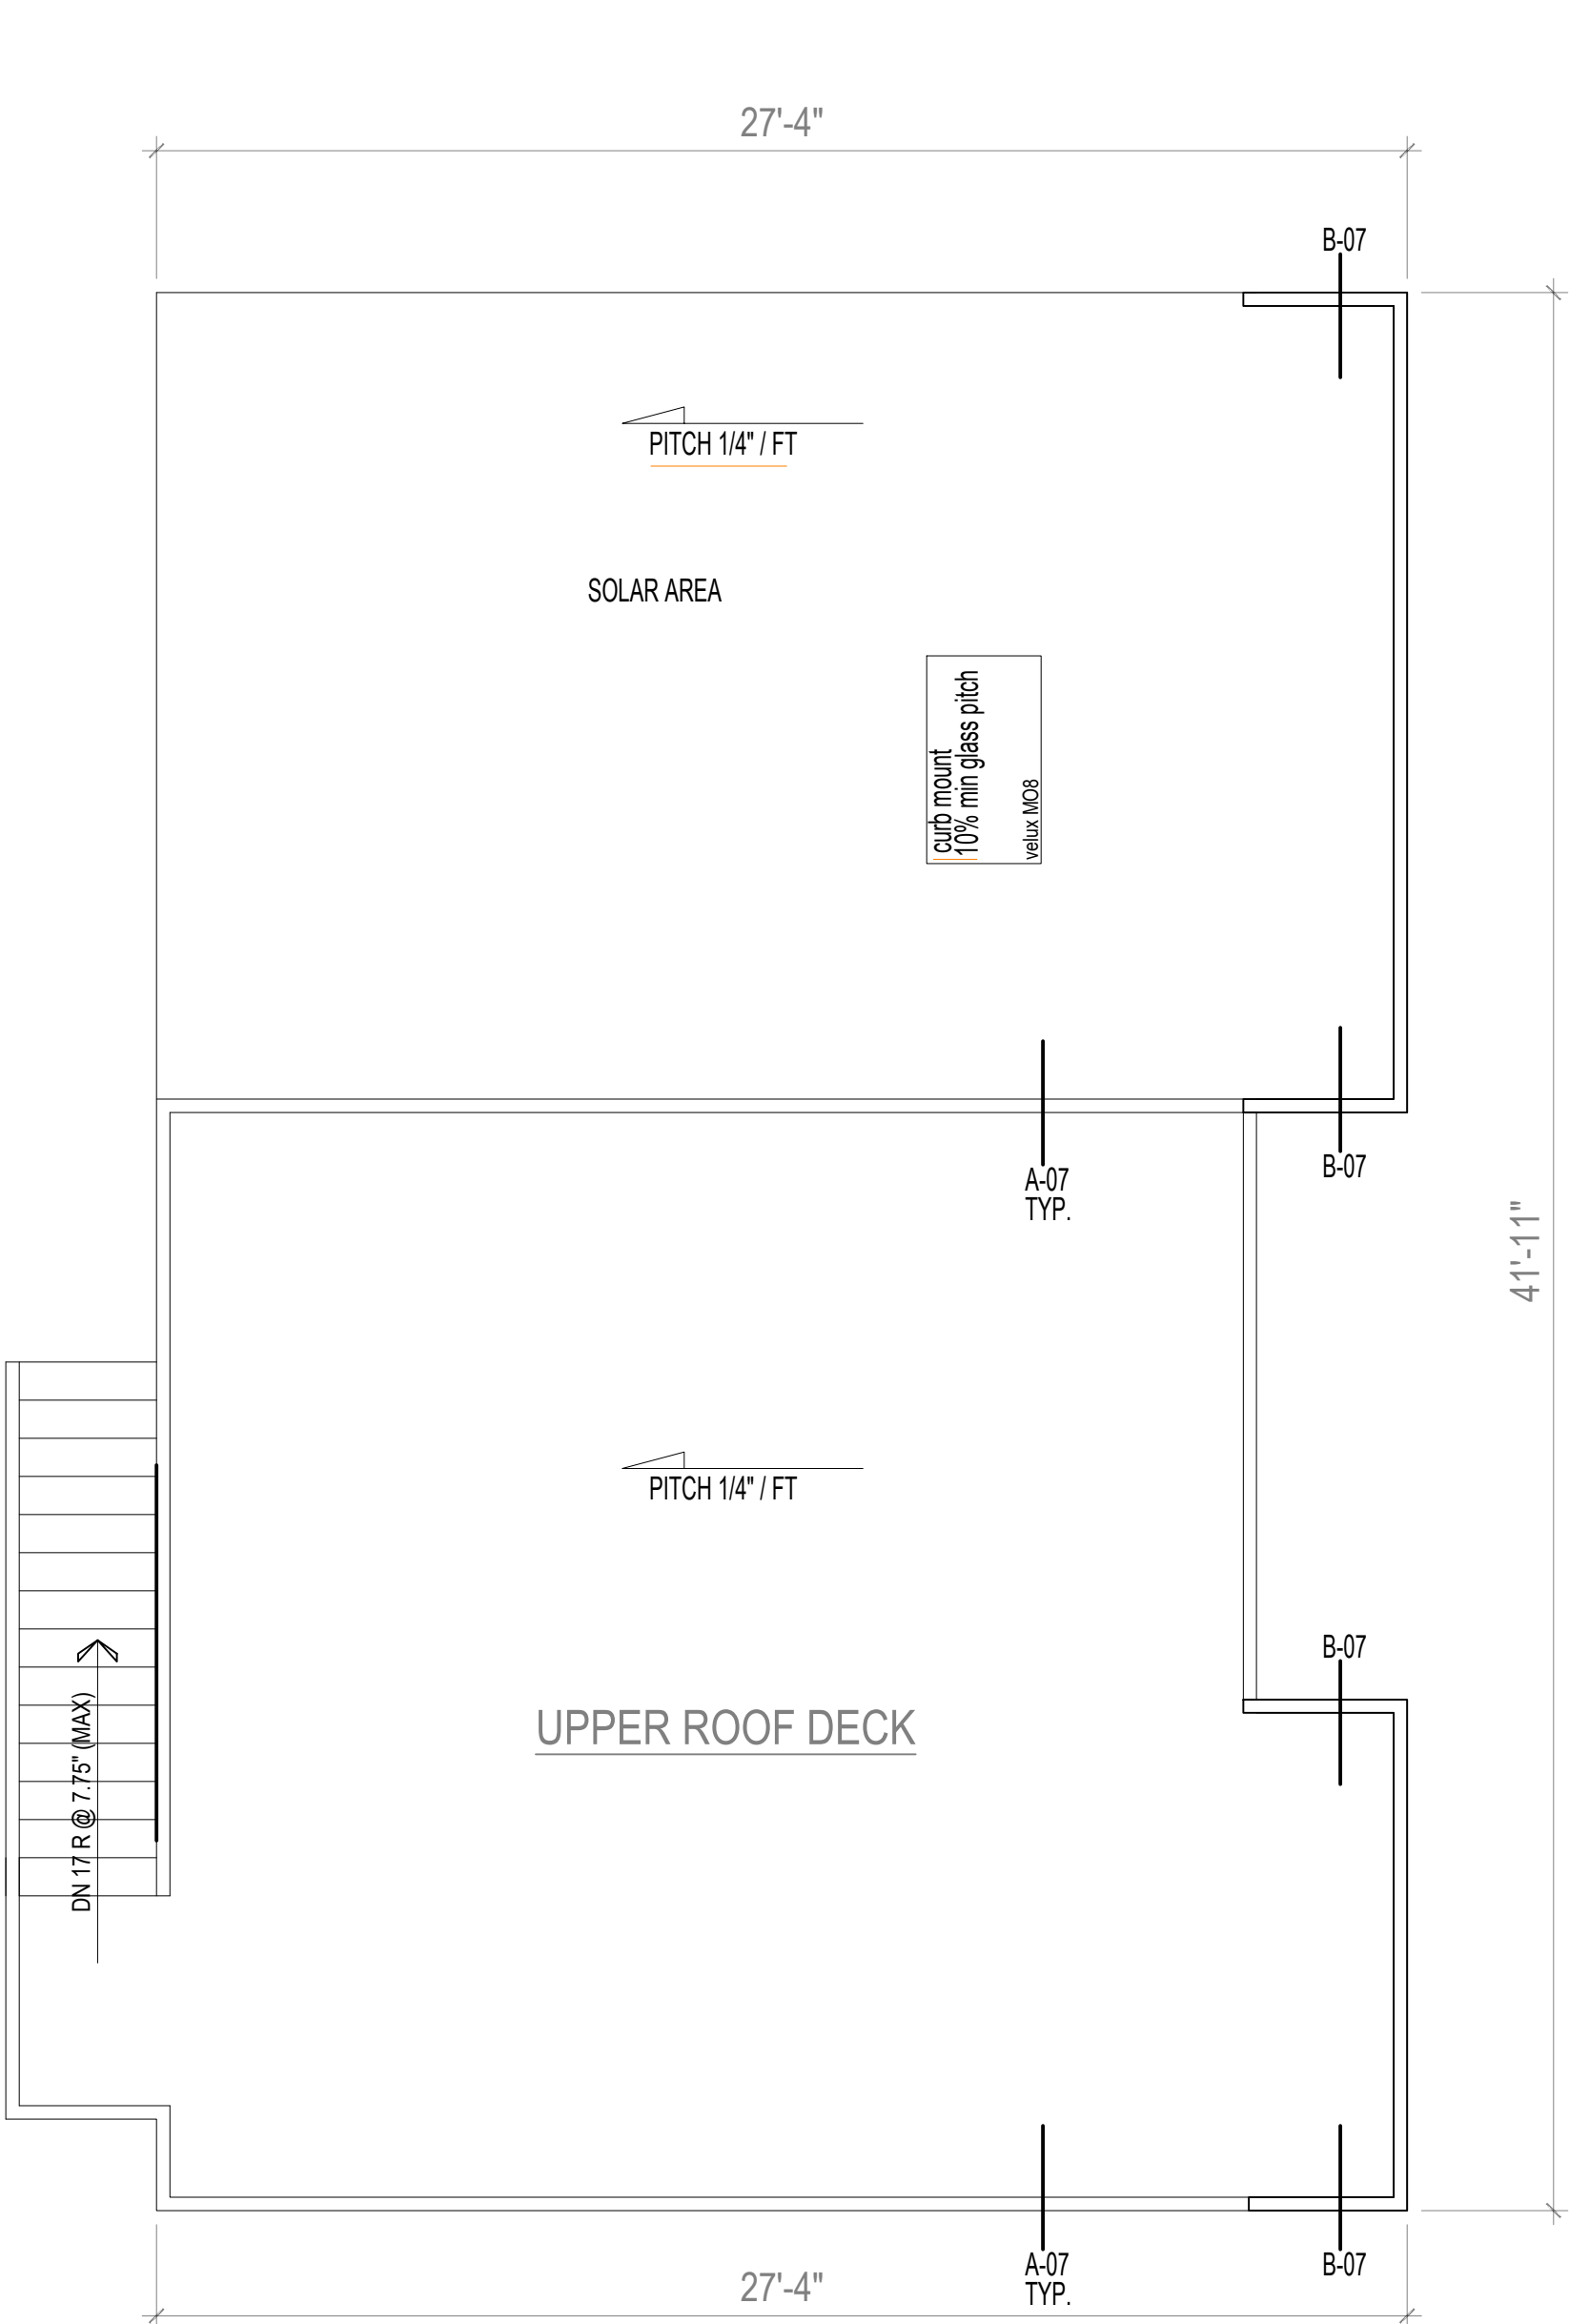

B. ROOF PLAN
1/4" = 1'-0"

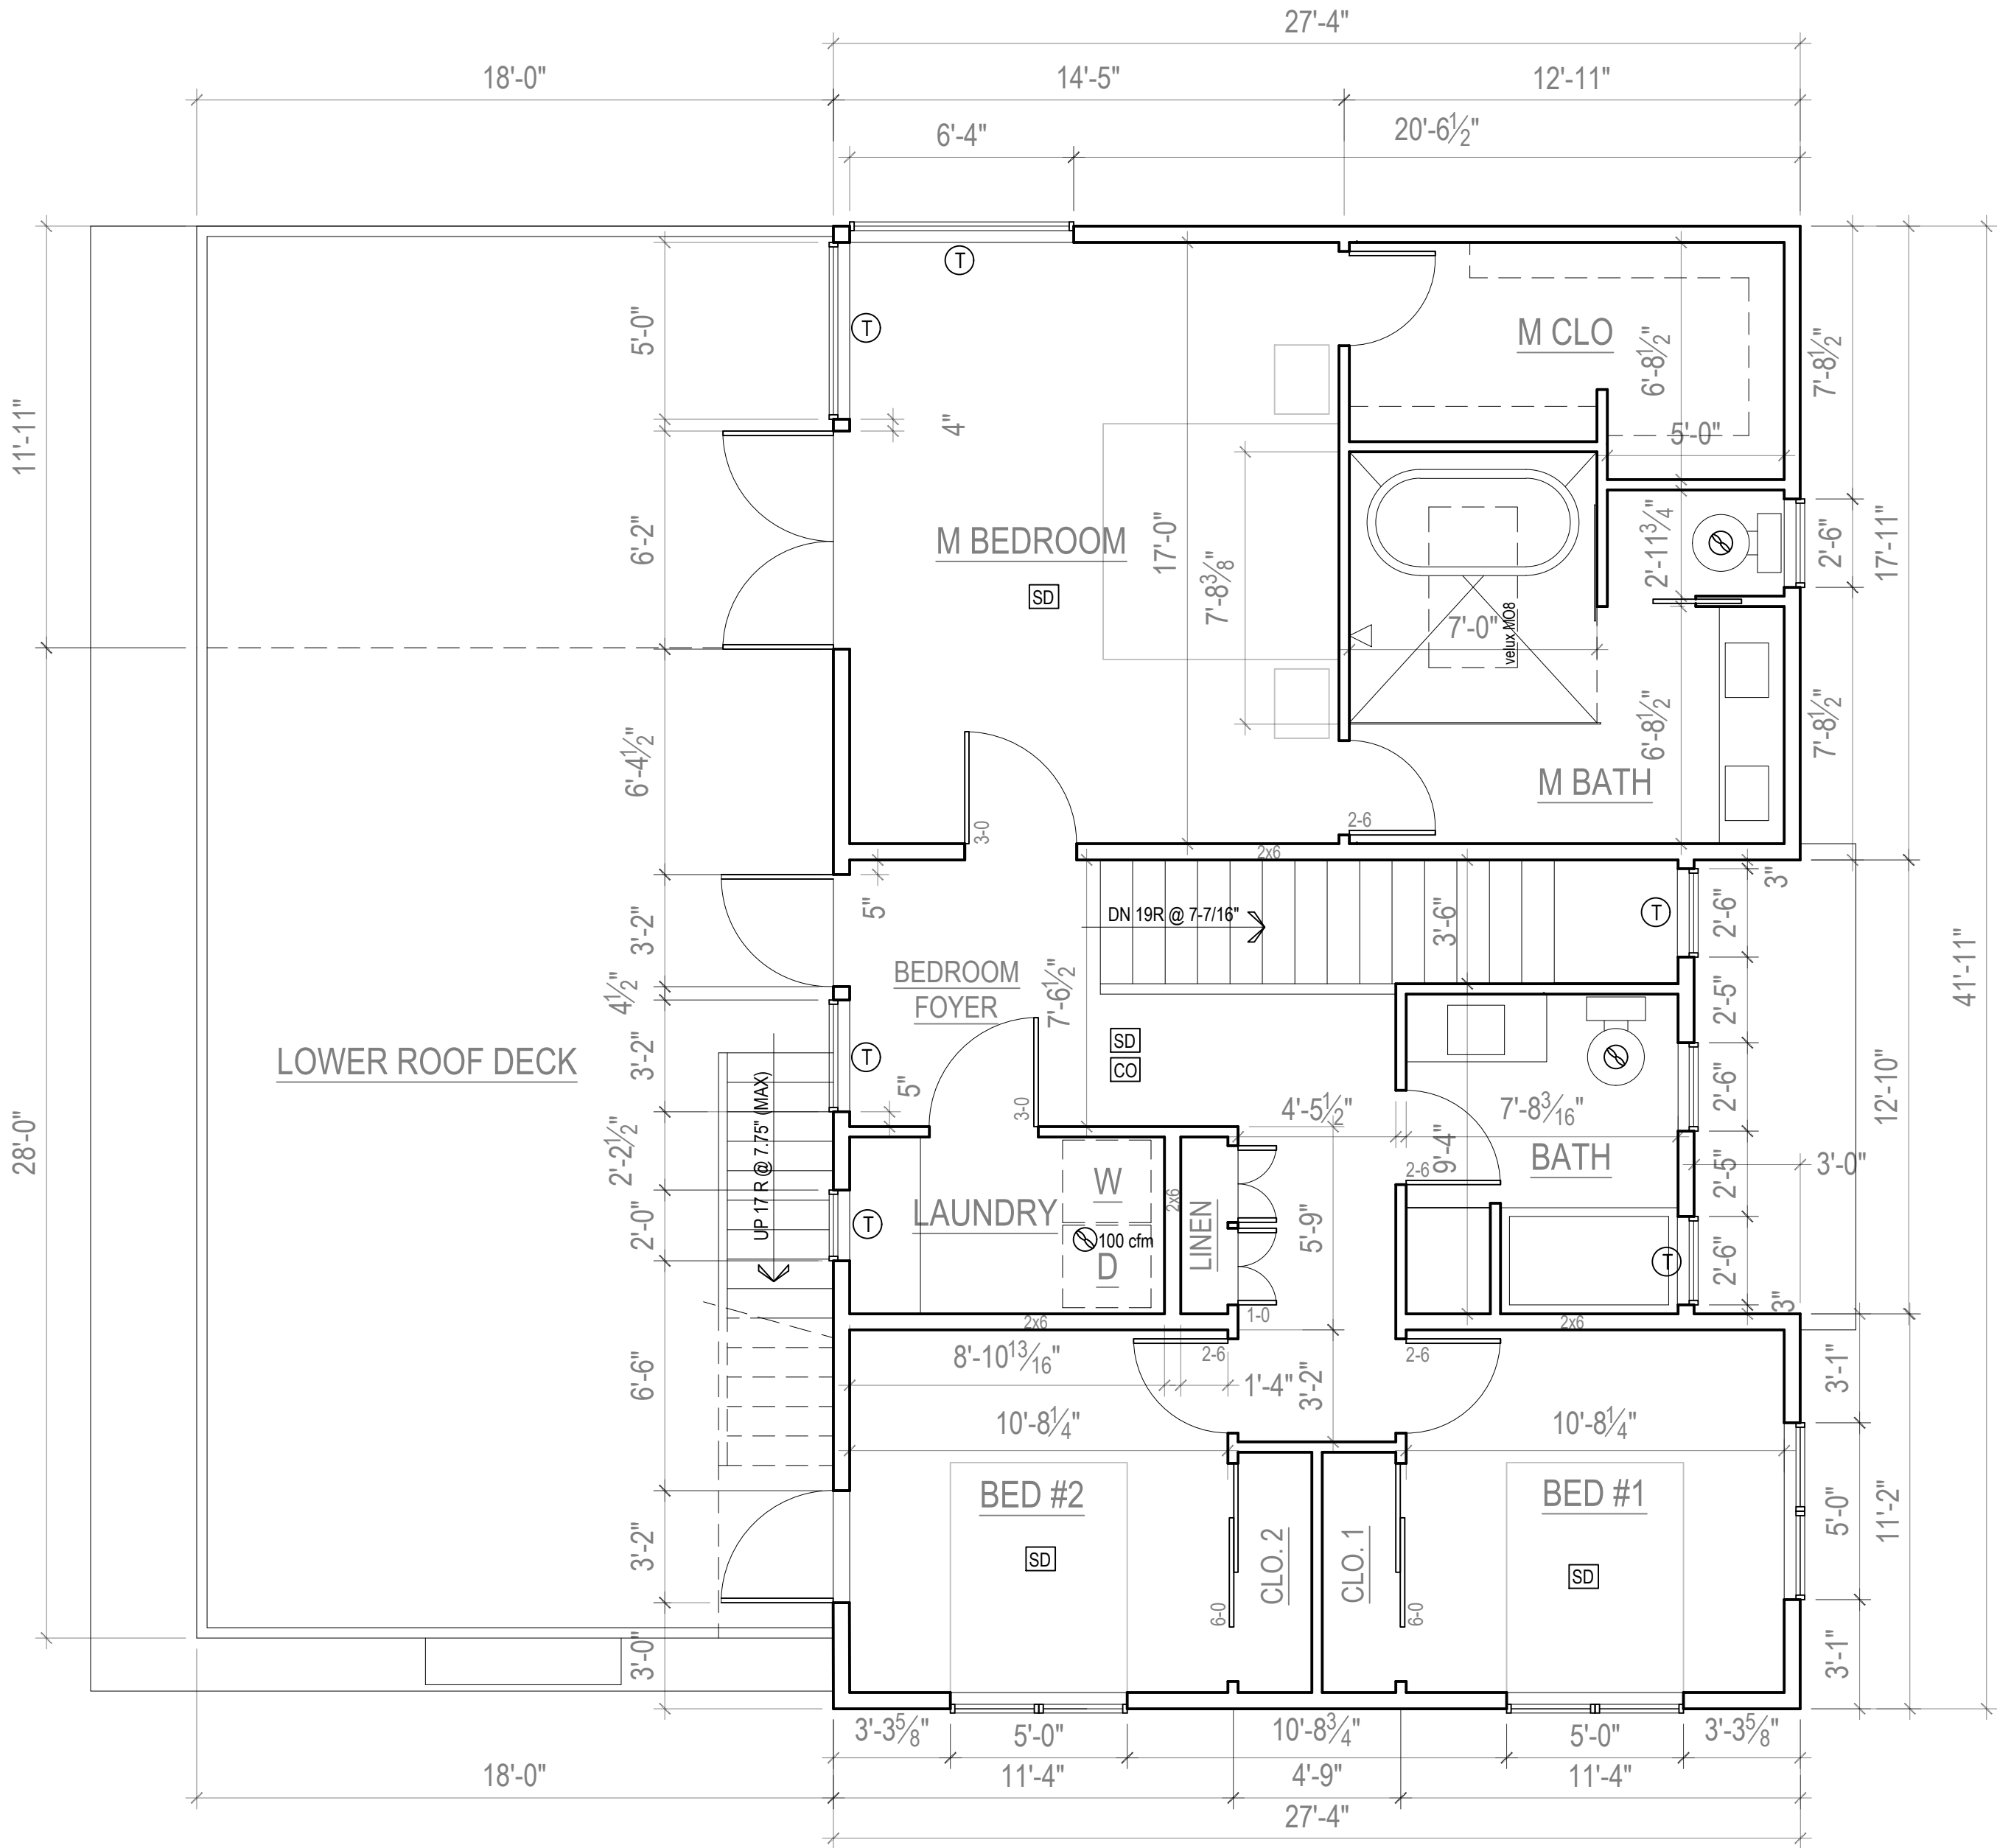

A. UPPER FLOOR PLAN
1/4" = 1'-0"
1108



9317

REGISTERED ARCHITECT

Chris Luth

CHRIS LUTH

STATE OF WASHINGTON

Yeganeh Residence

3029 62nd Ave SE

CONTENTS

floor Plans

DRAWN BY

CRL

DATE

5.29.24


10.4.24

03

EGRESS WINDOW REQUIREMENTS

Minimum of 5.7 square feet of net clear opening area. Minimum of 24 inches of net clear opening height. Minimum of 20 inches of net clear opening width. Opening must be max 44" above floor.

- (E) = EGRESS WINDOWS
(T) = TEMPER/SAFETY GLAZE WINDOWS
ALL DOORS TO HAVE TEMPERED GLAZING

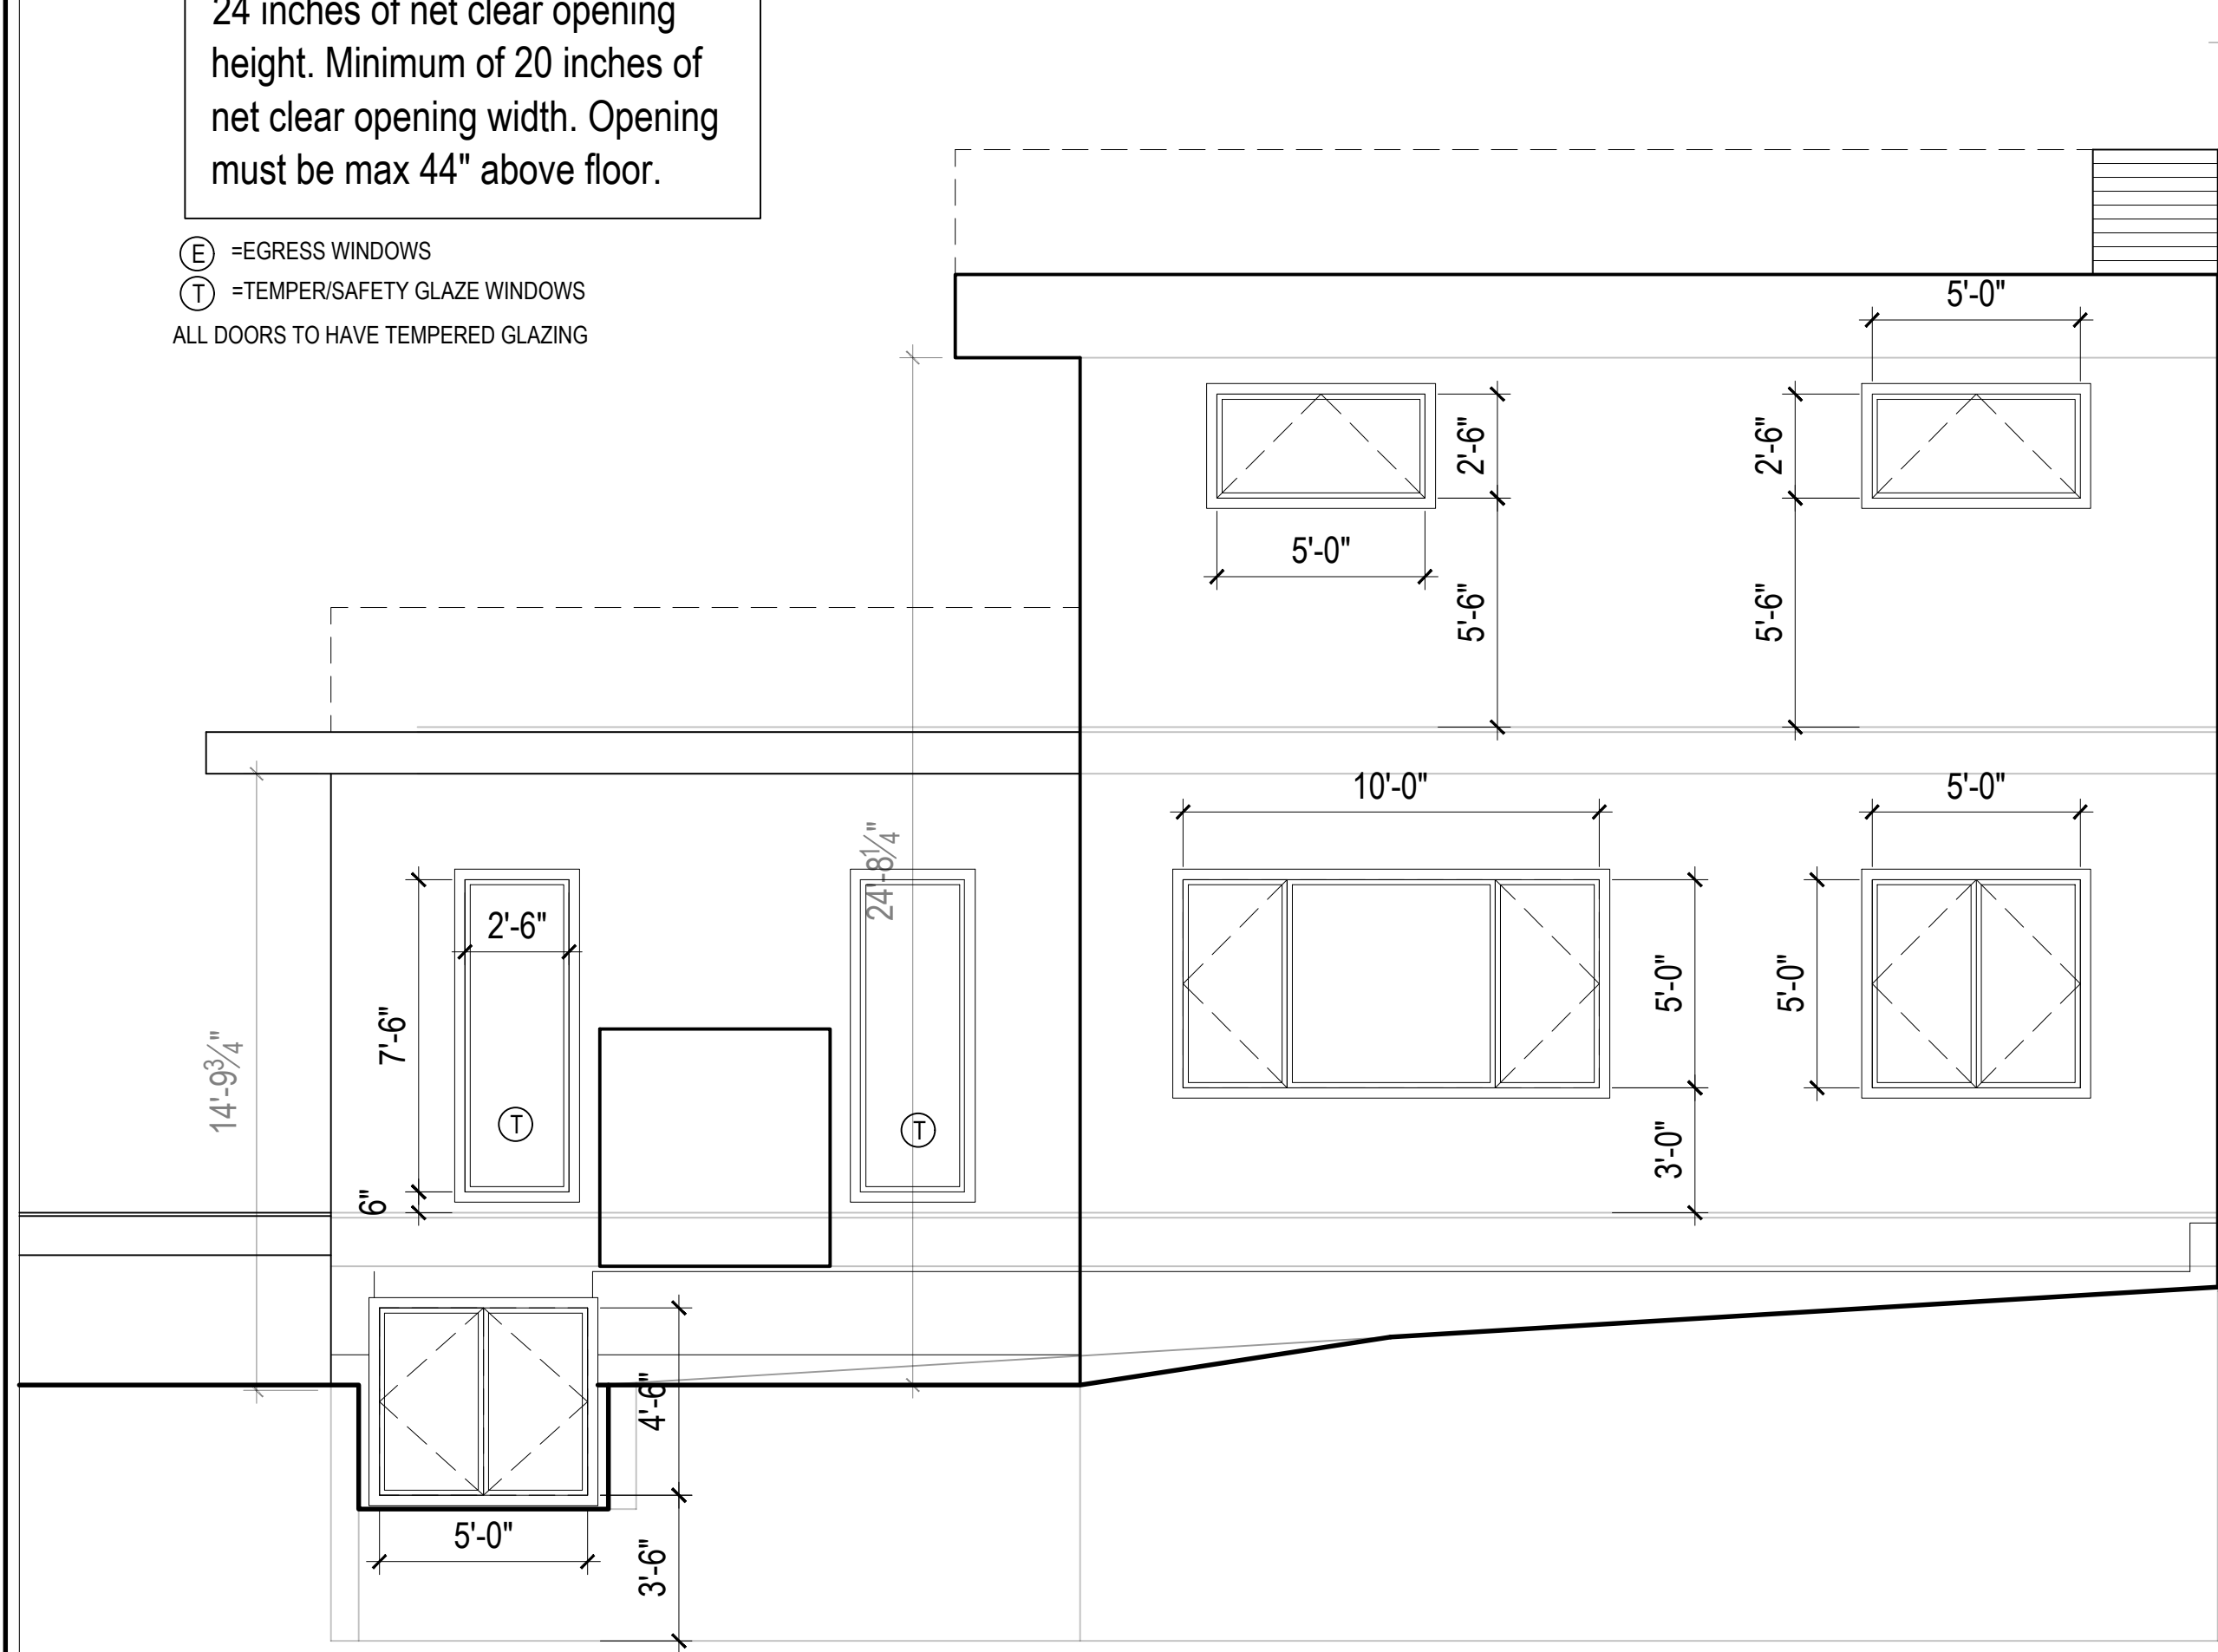


SOUTH ELEVATION

1/4" = 1'-0"




EAST ELEVATION

1/4" = 1'-0"

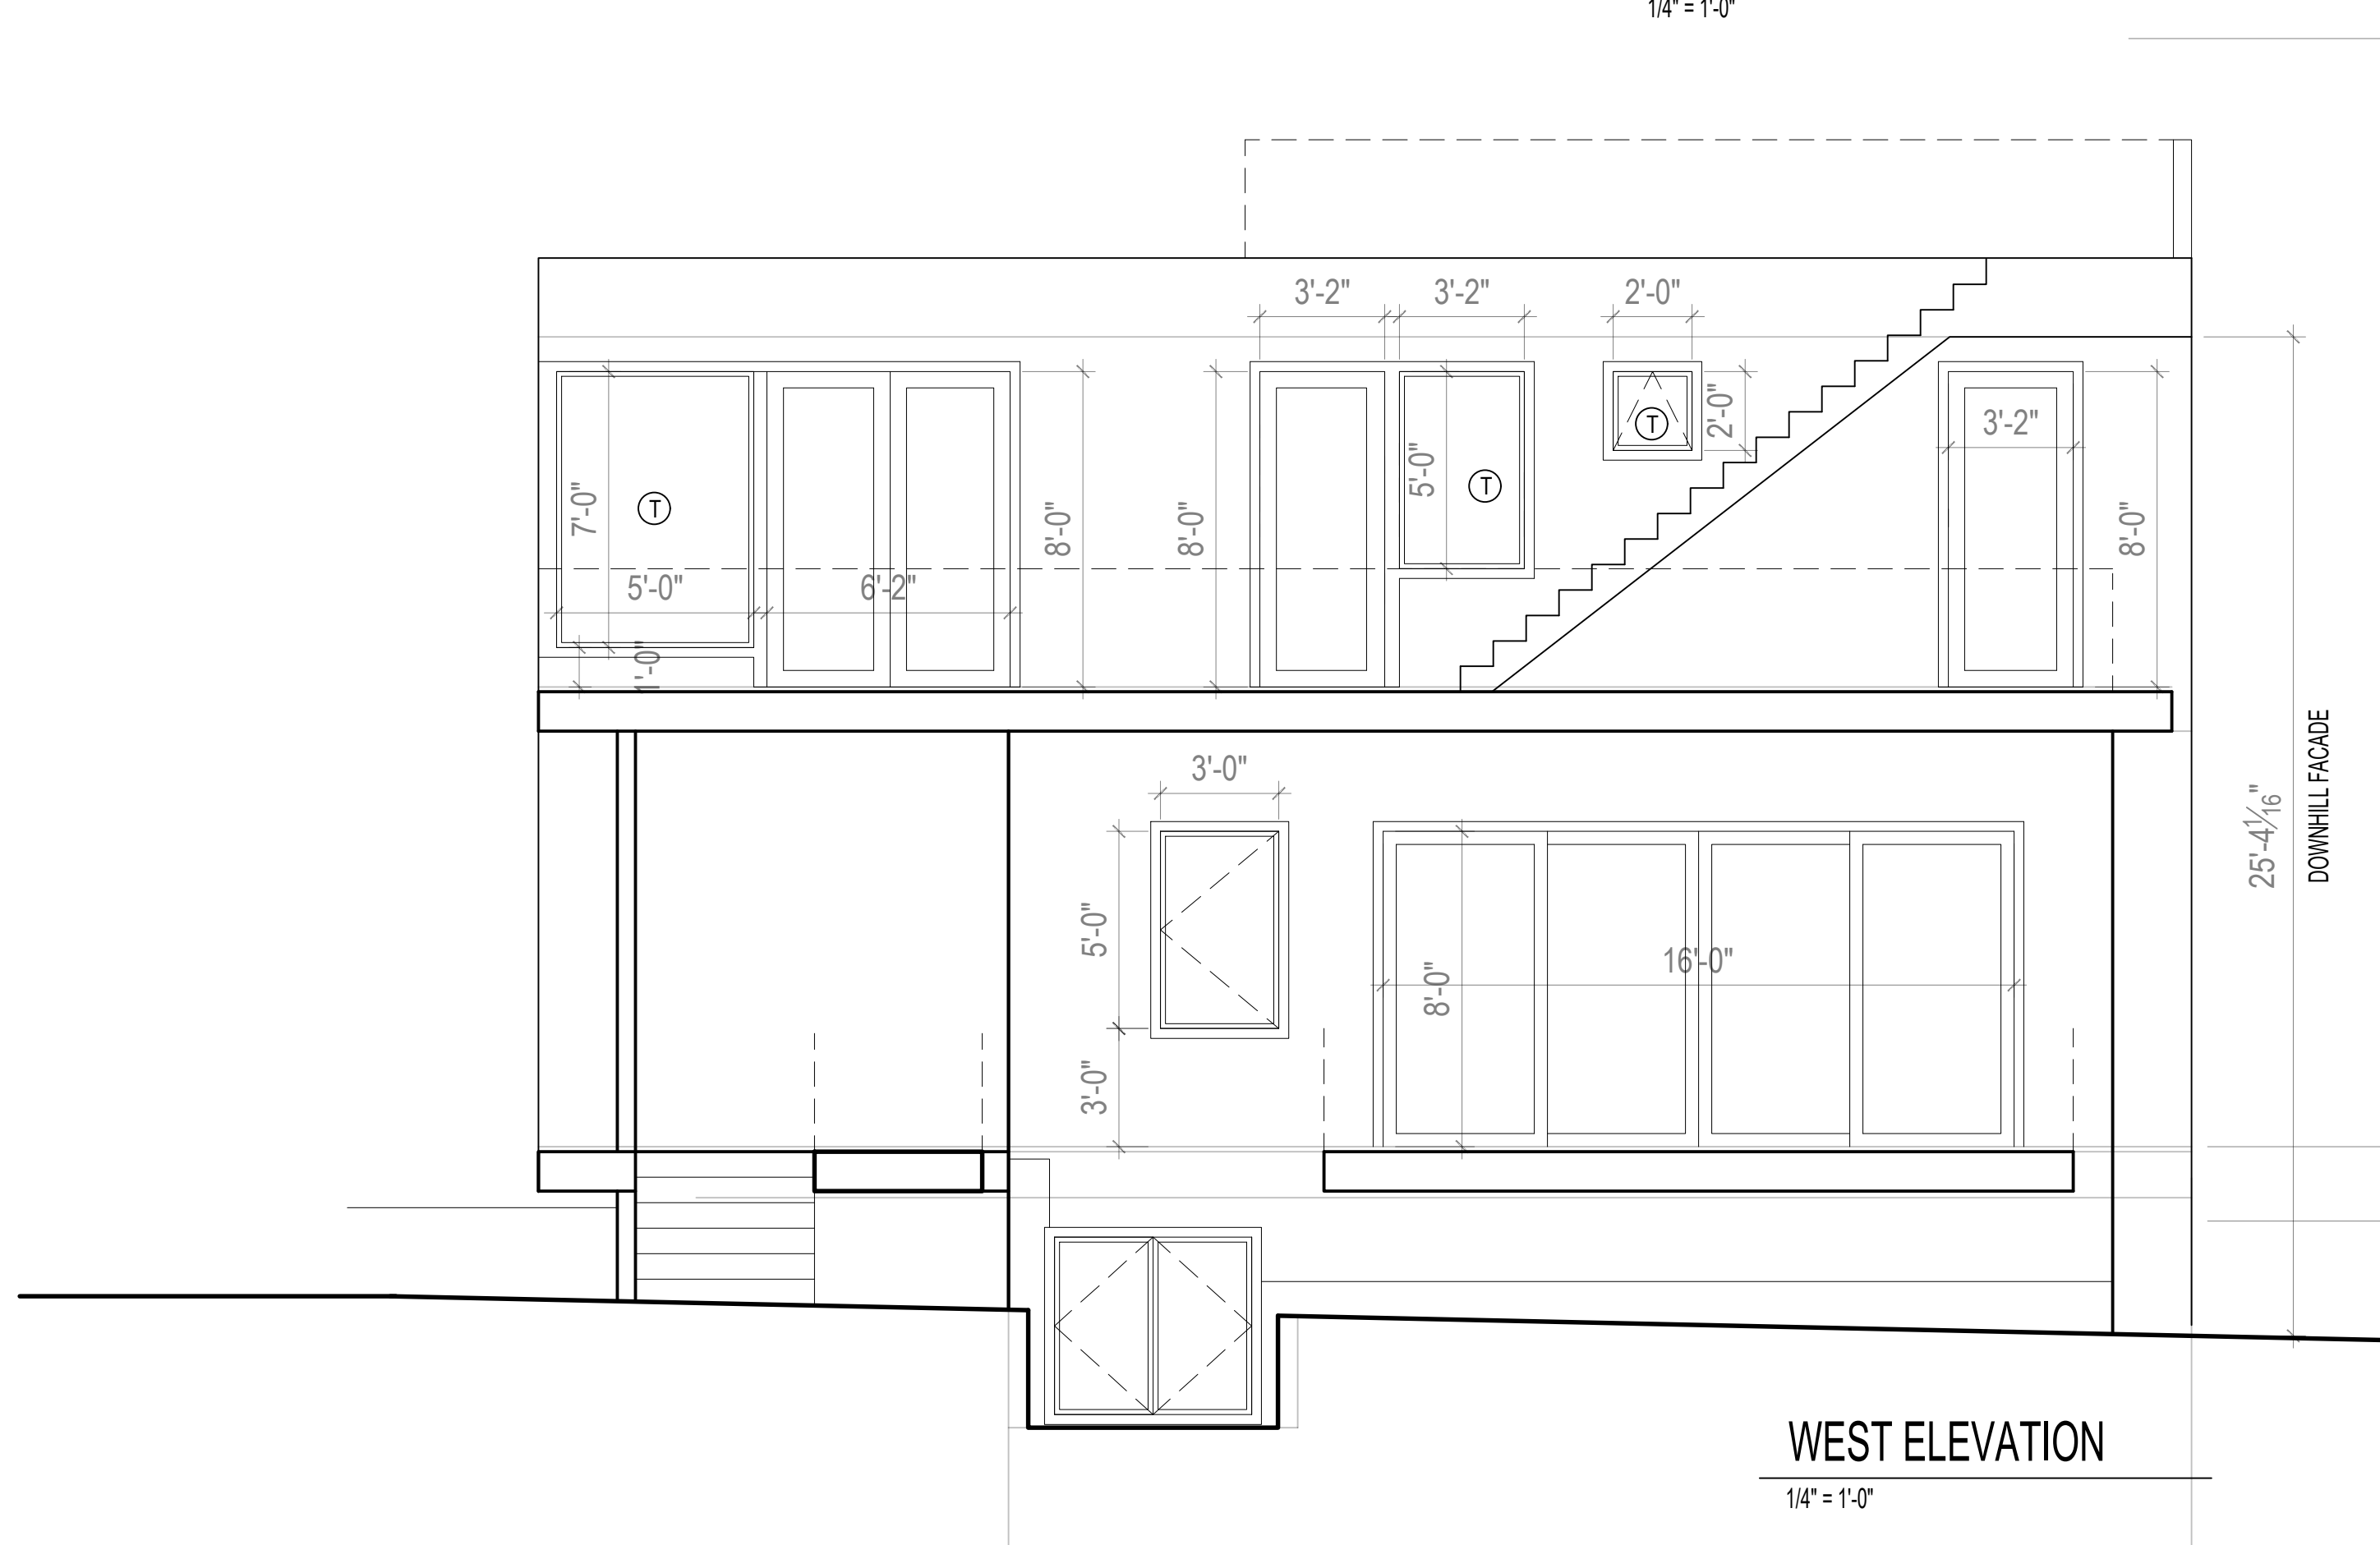


WEST ELEVATION

1/4" = 1'-0"

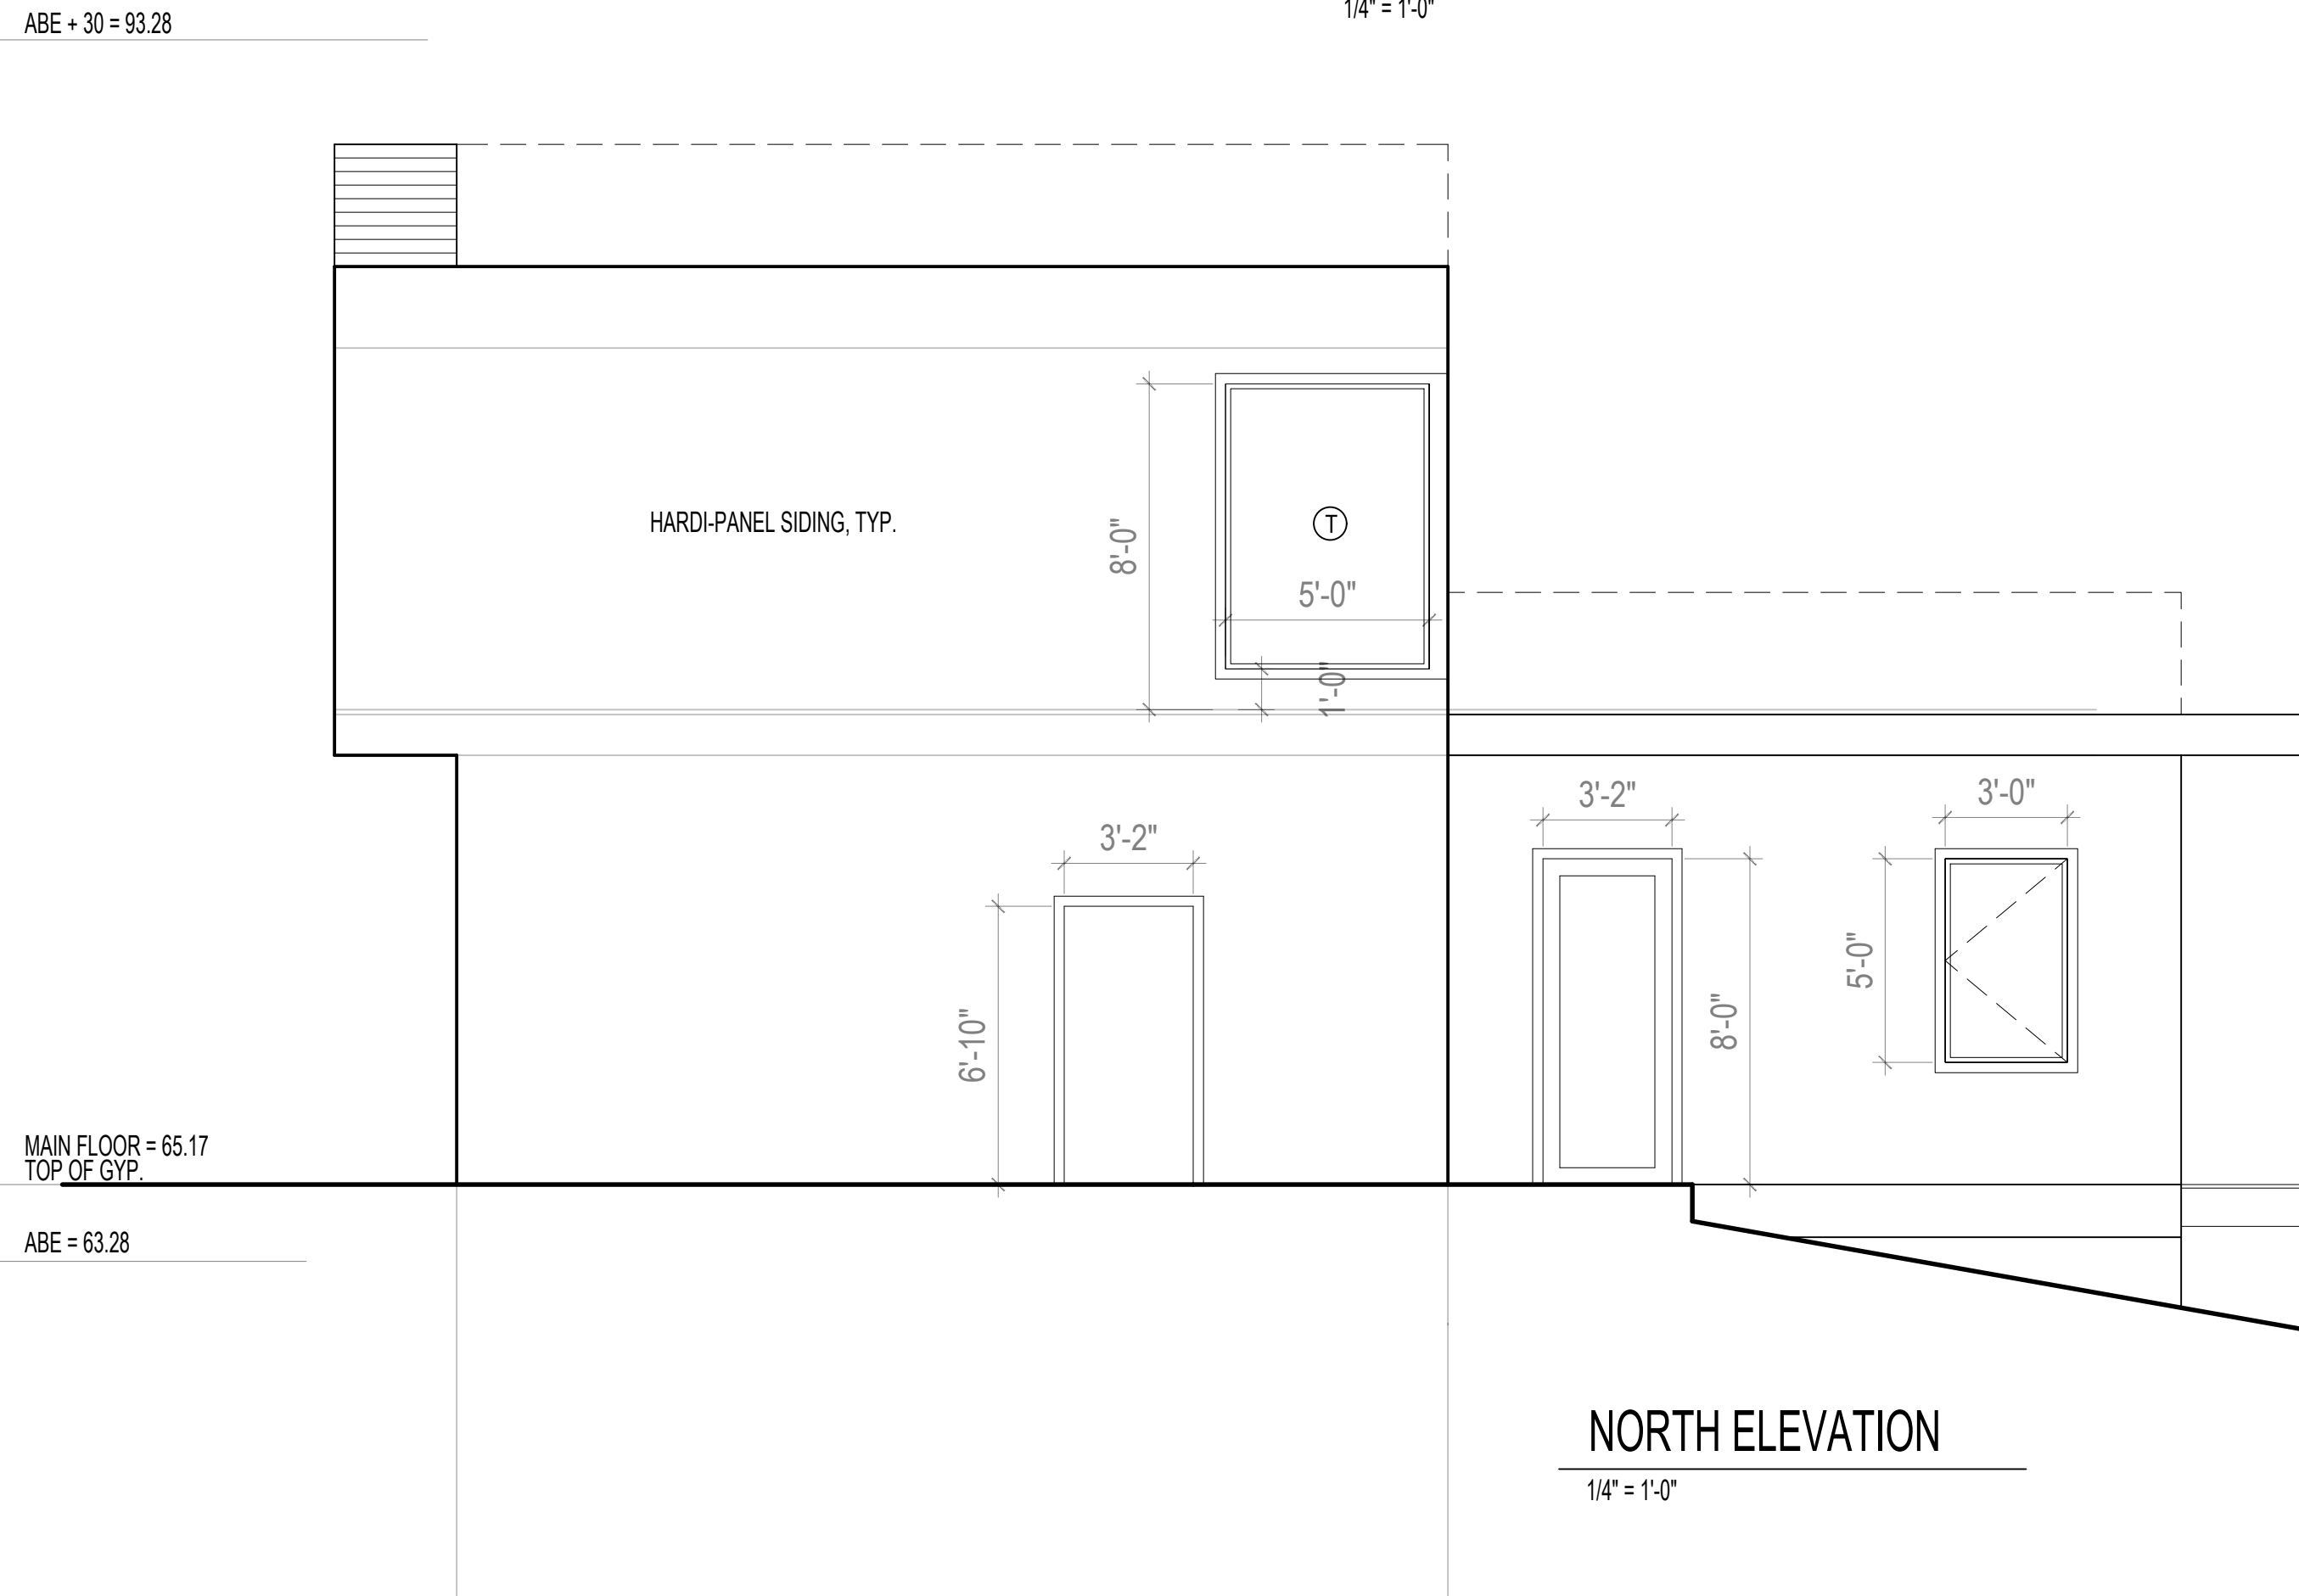

NORTH ELEVATION

1/4" = 1'-0"

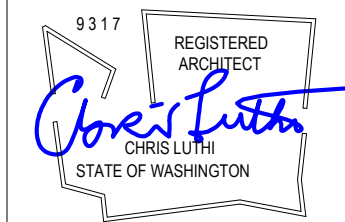

Yeganeh Residence
3029 62nd Ave SE

CONTENTS

floor Plans

DRAWN BY


CRL

DATE

5.29.24

Closed cell spray foam directly applied to underside of sheathing (min R-10)
+ batts to = R-60
Spray foam product to be "Spraytite 178" as manufactured by BASF (ESR-2642), or equal.
Spray foam insulation shall be installed per IRC 806.5.1.3.
A copy of the ICC ESR report for the product used must be provided on the job site for field inspector verification
The applied spray foam must be installed by a certified installer.

Membrane used as a walking surface must be IBC ES approved or be tested to the AC39 standard

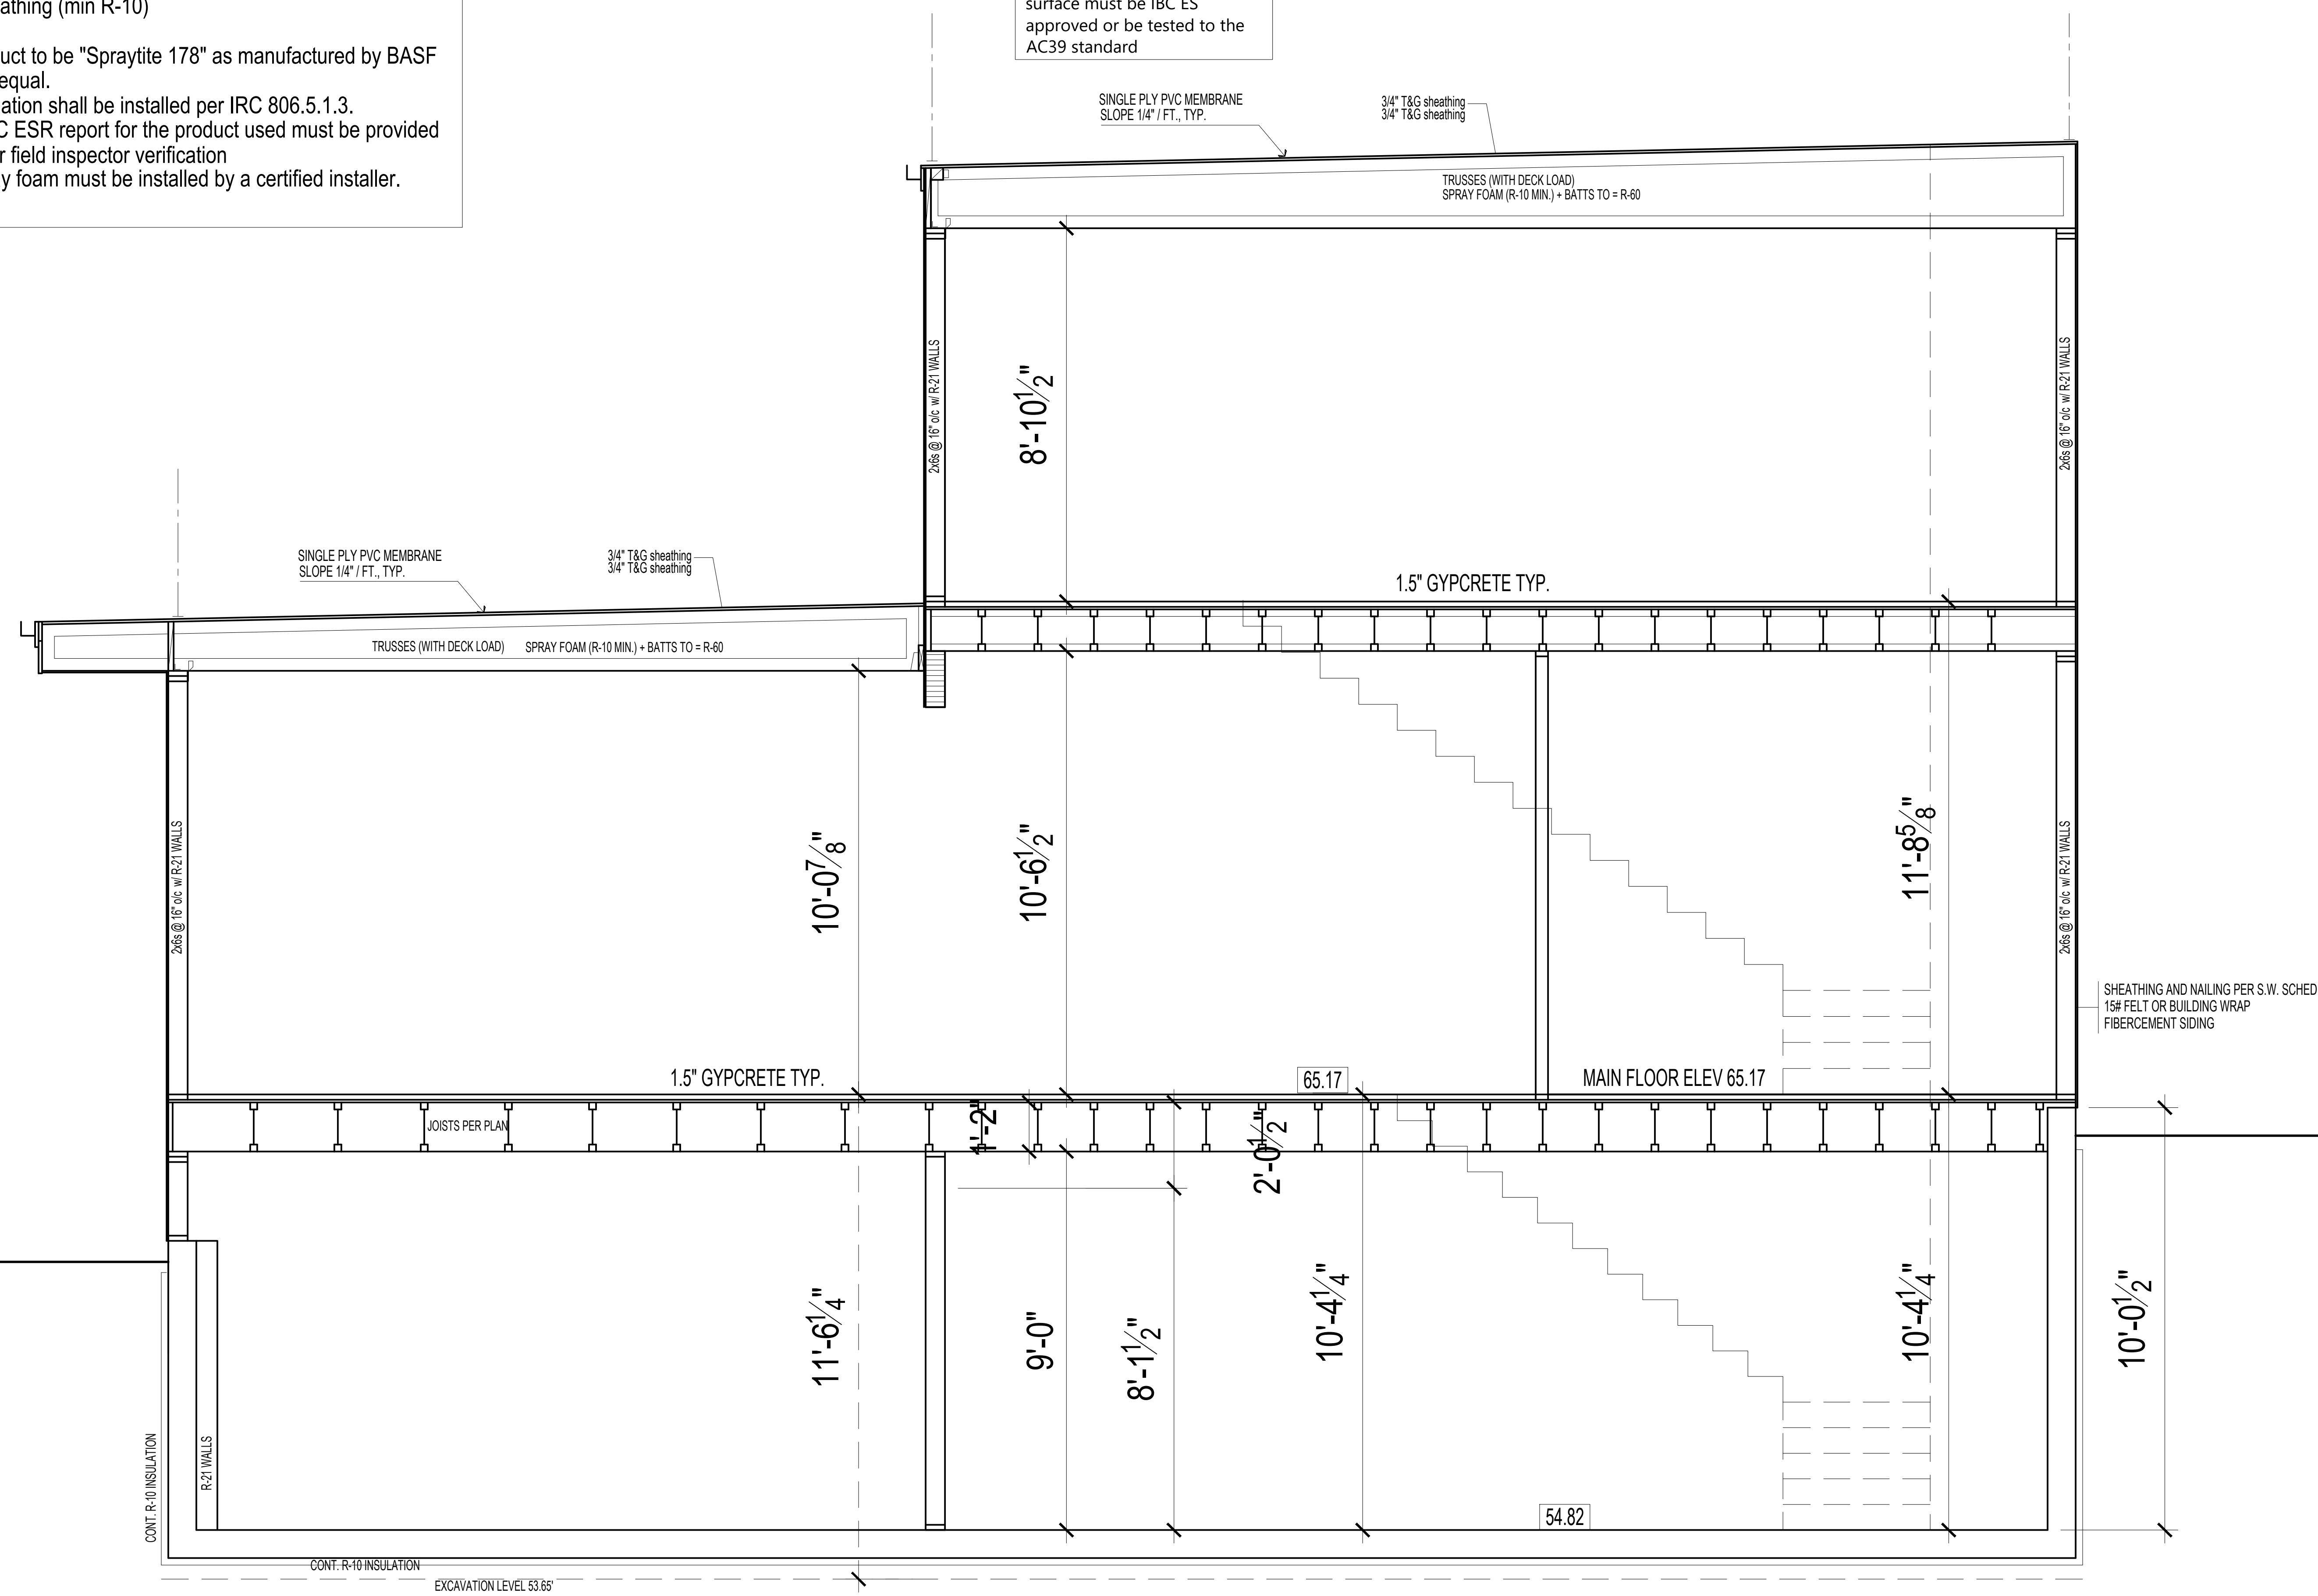

CROSS SECTION A.A.
1/2" = 1'-0"

9317 REGISTERED ARCHITECT
Chris Luth
CHRIS LUTH
STATE OF WASHINGTON

C

CENTERLINE DESIGN
4737 37th AVE SW
SEATTLE
206.935.4684
www.Centerline-Design.com

Yeganeh Residence
3029 62nd Ave SE


CONTENTS

Site Plan


DRAWN BY
CRL

DATE
5.29.24


05

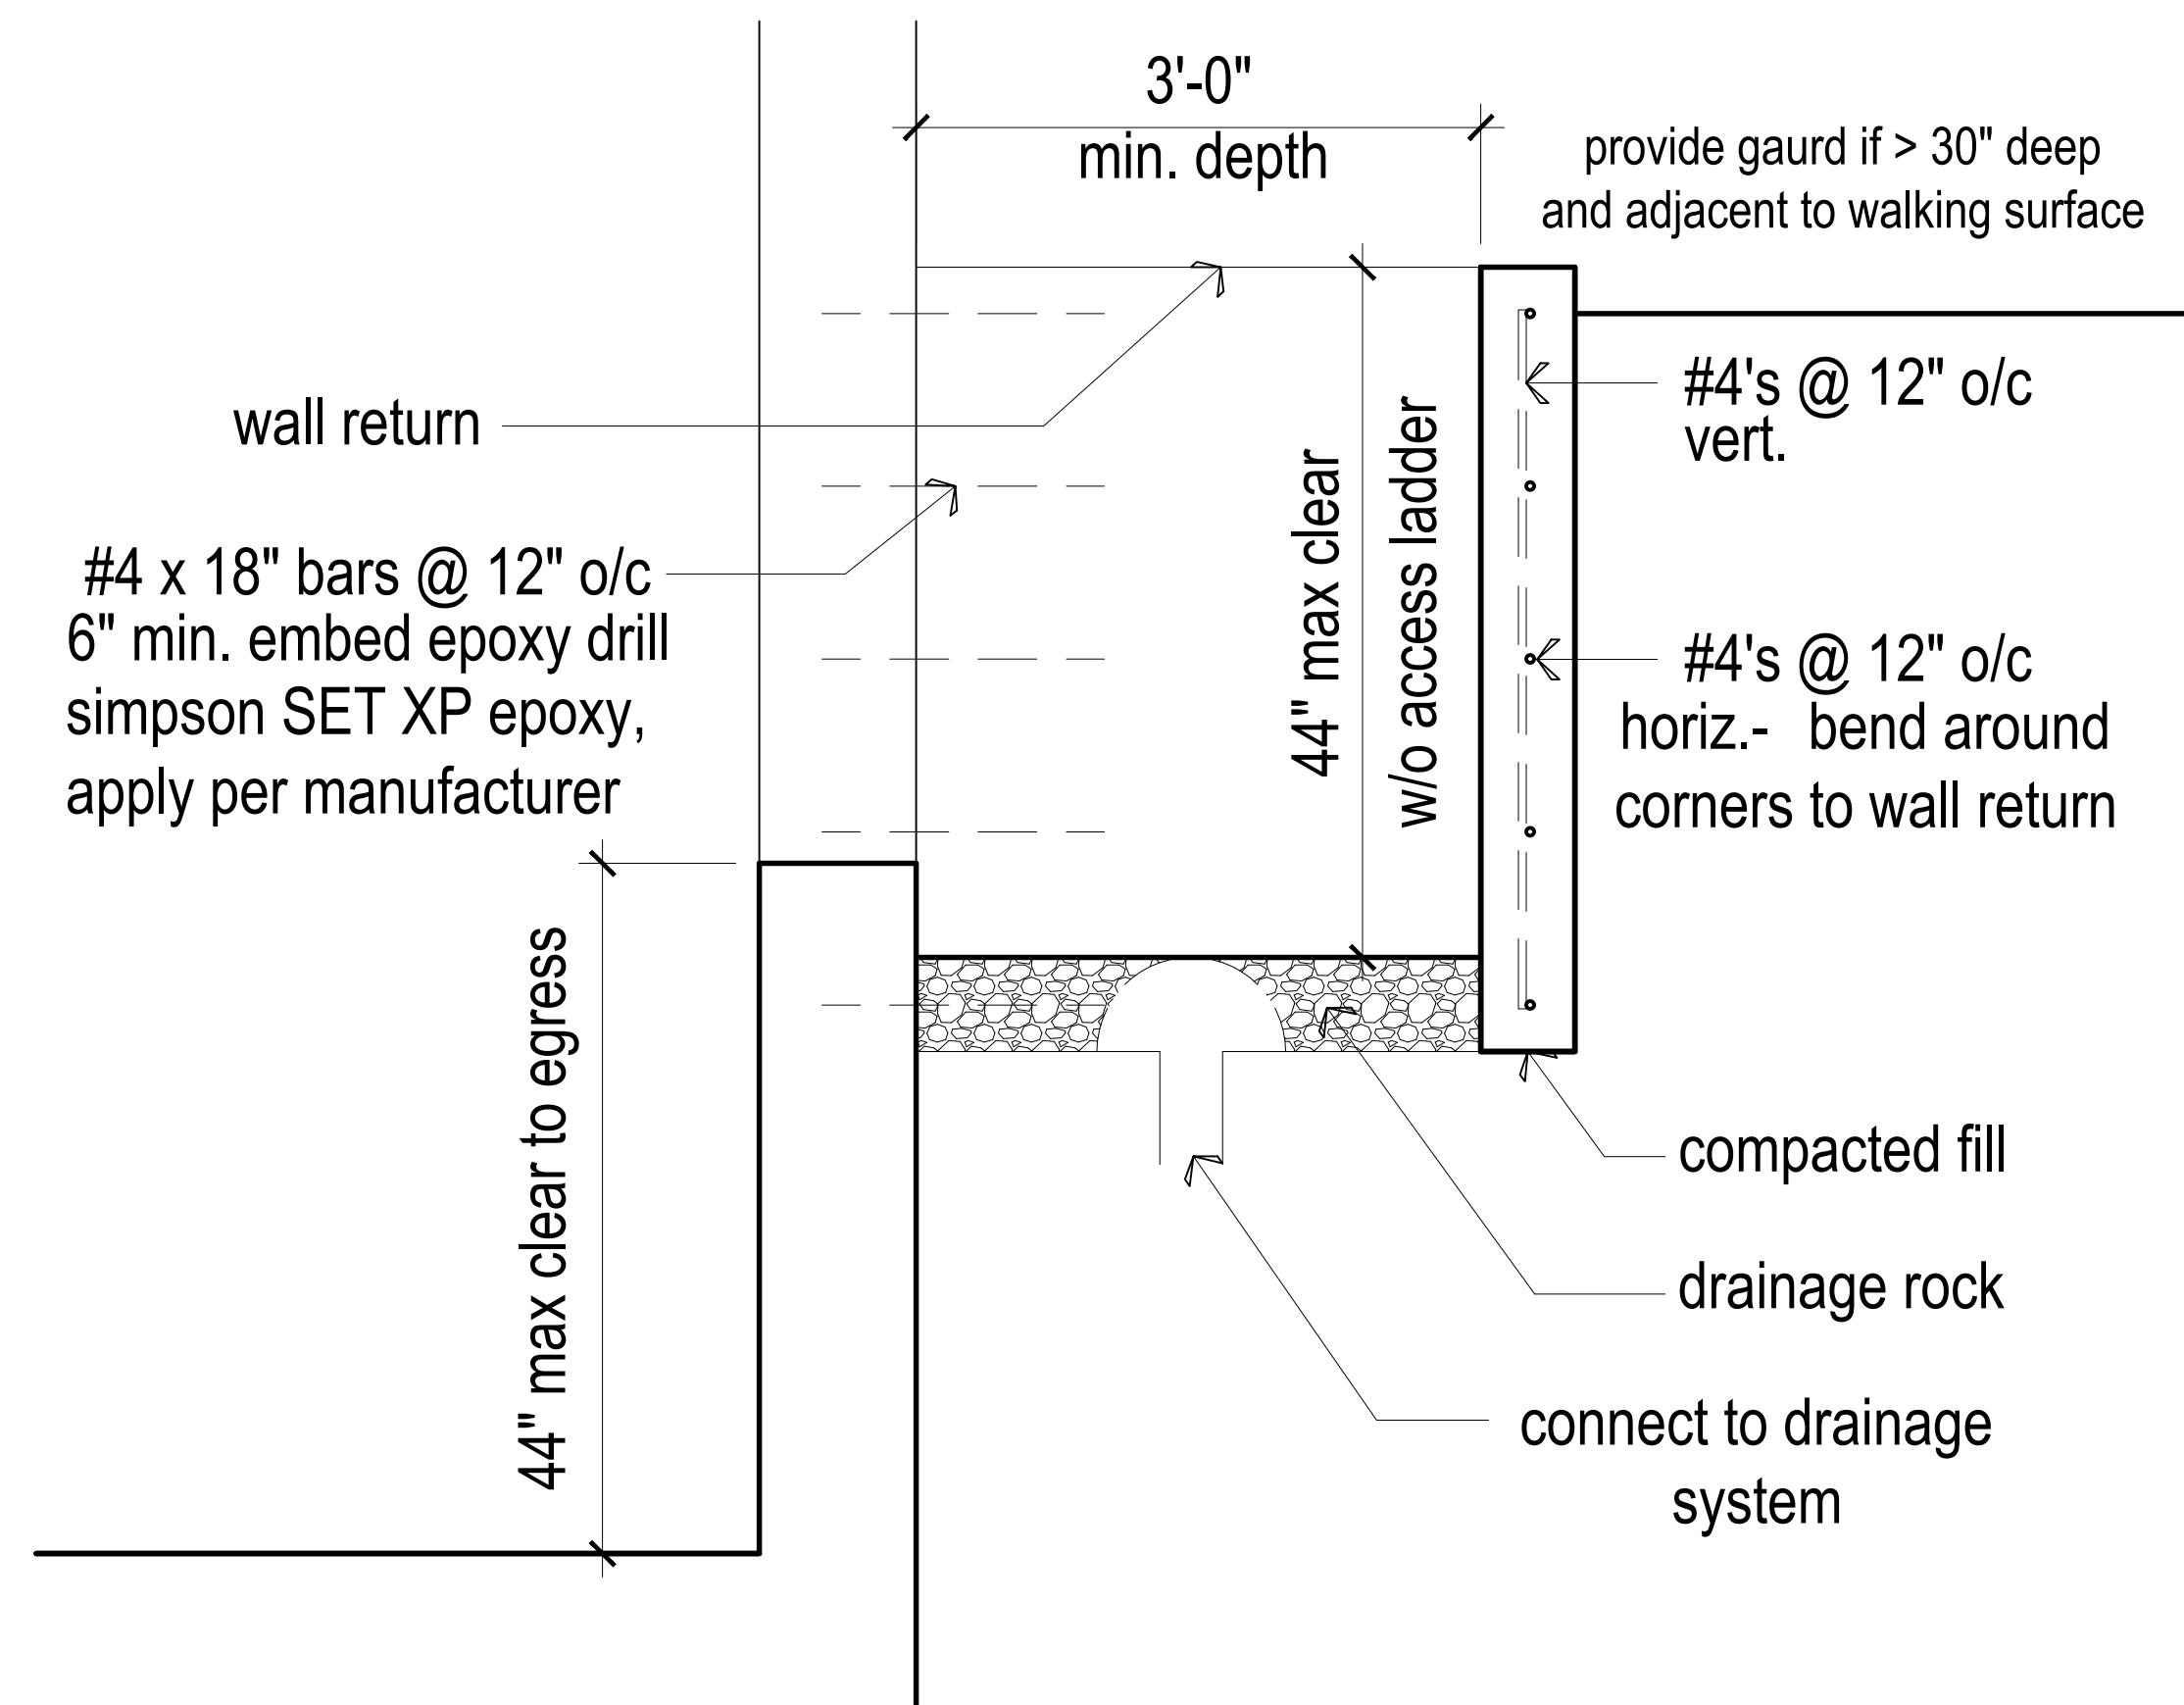


C. WINDOW WELL DETAIL
1" = 1'-0"

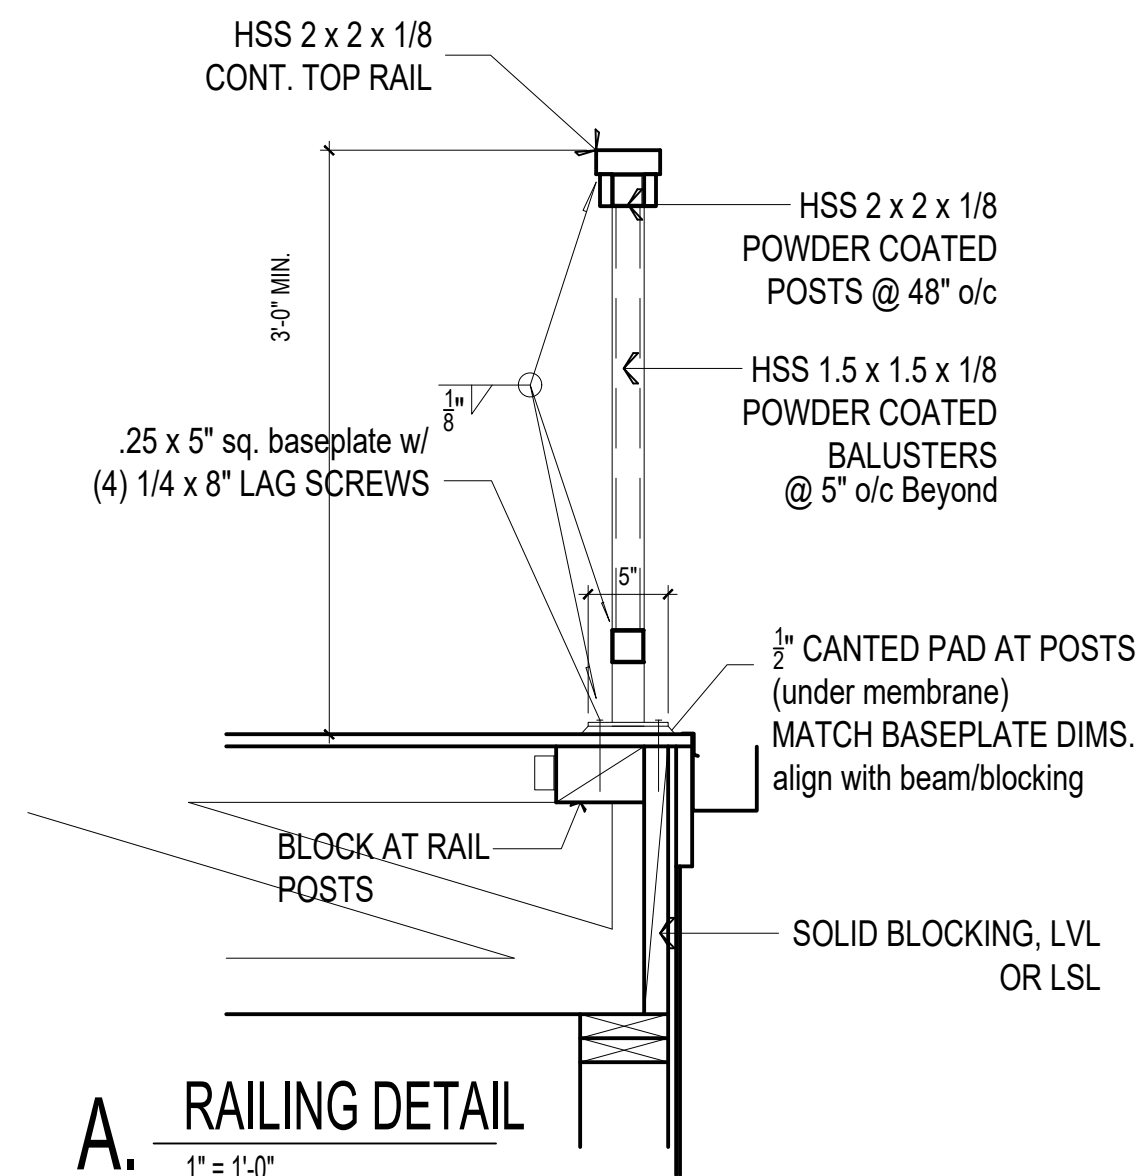

A. RAILING DETAIL
1" = 1'-0"

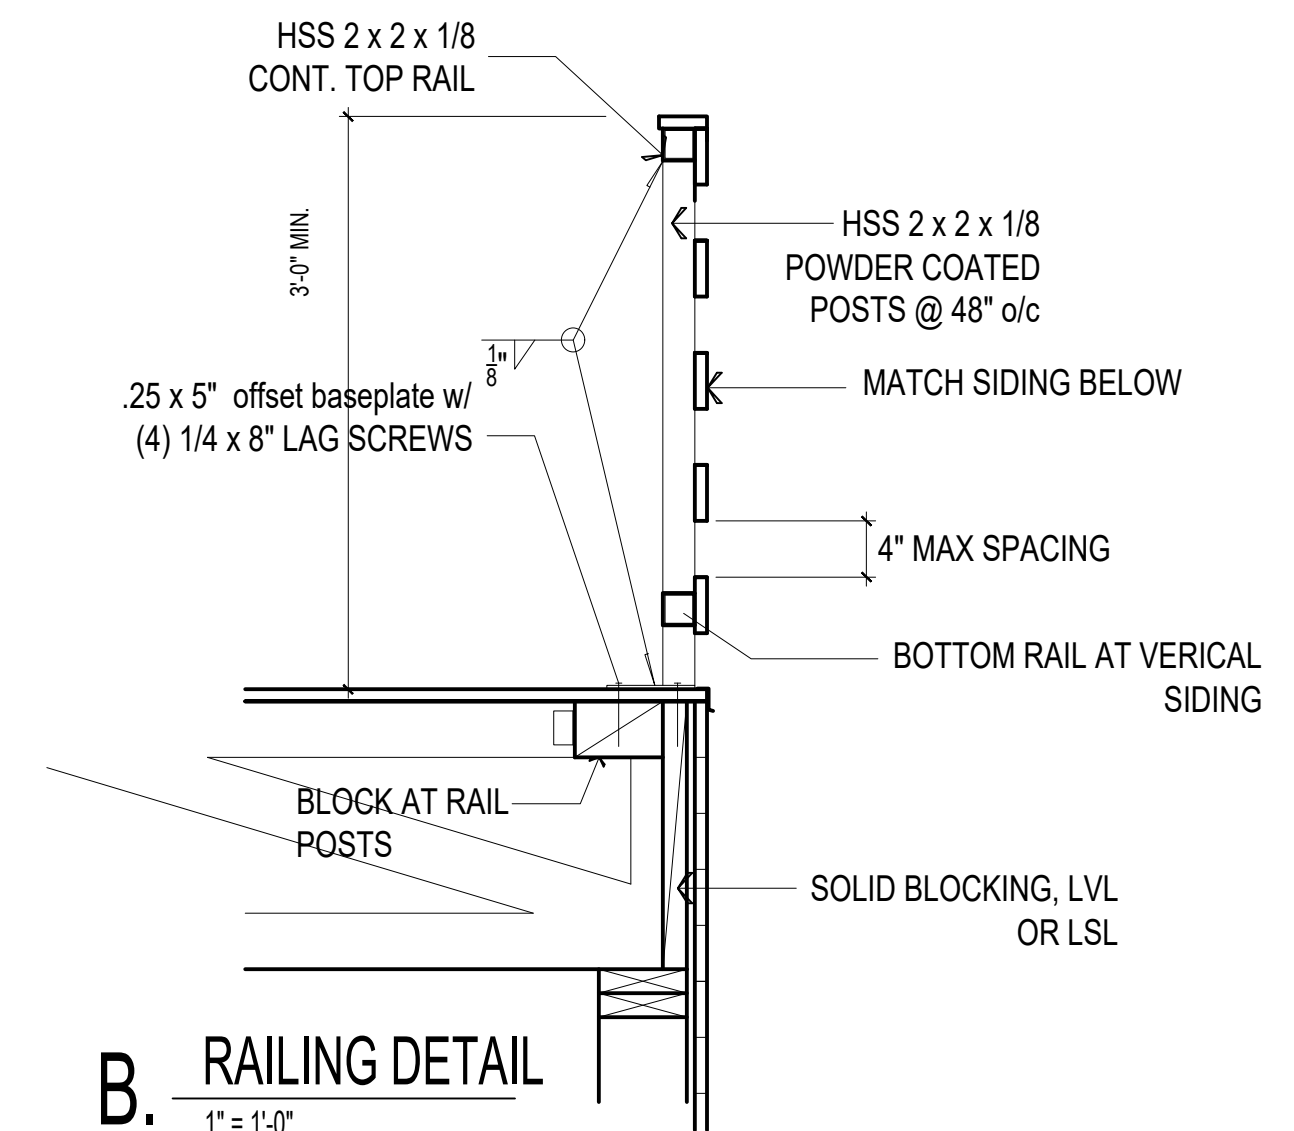

B. RAILING DETAIL
1" = 1'-0"

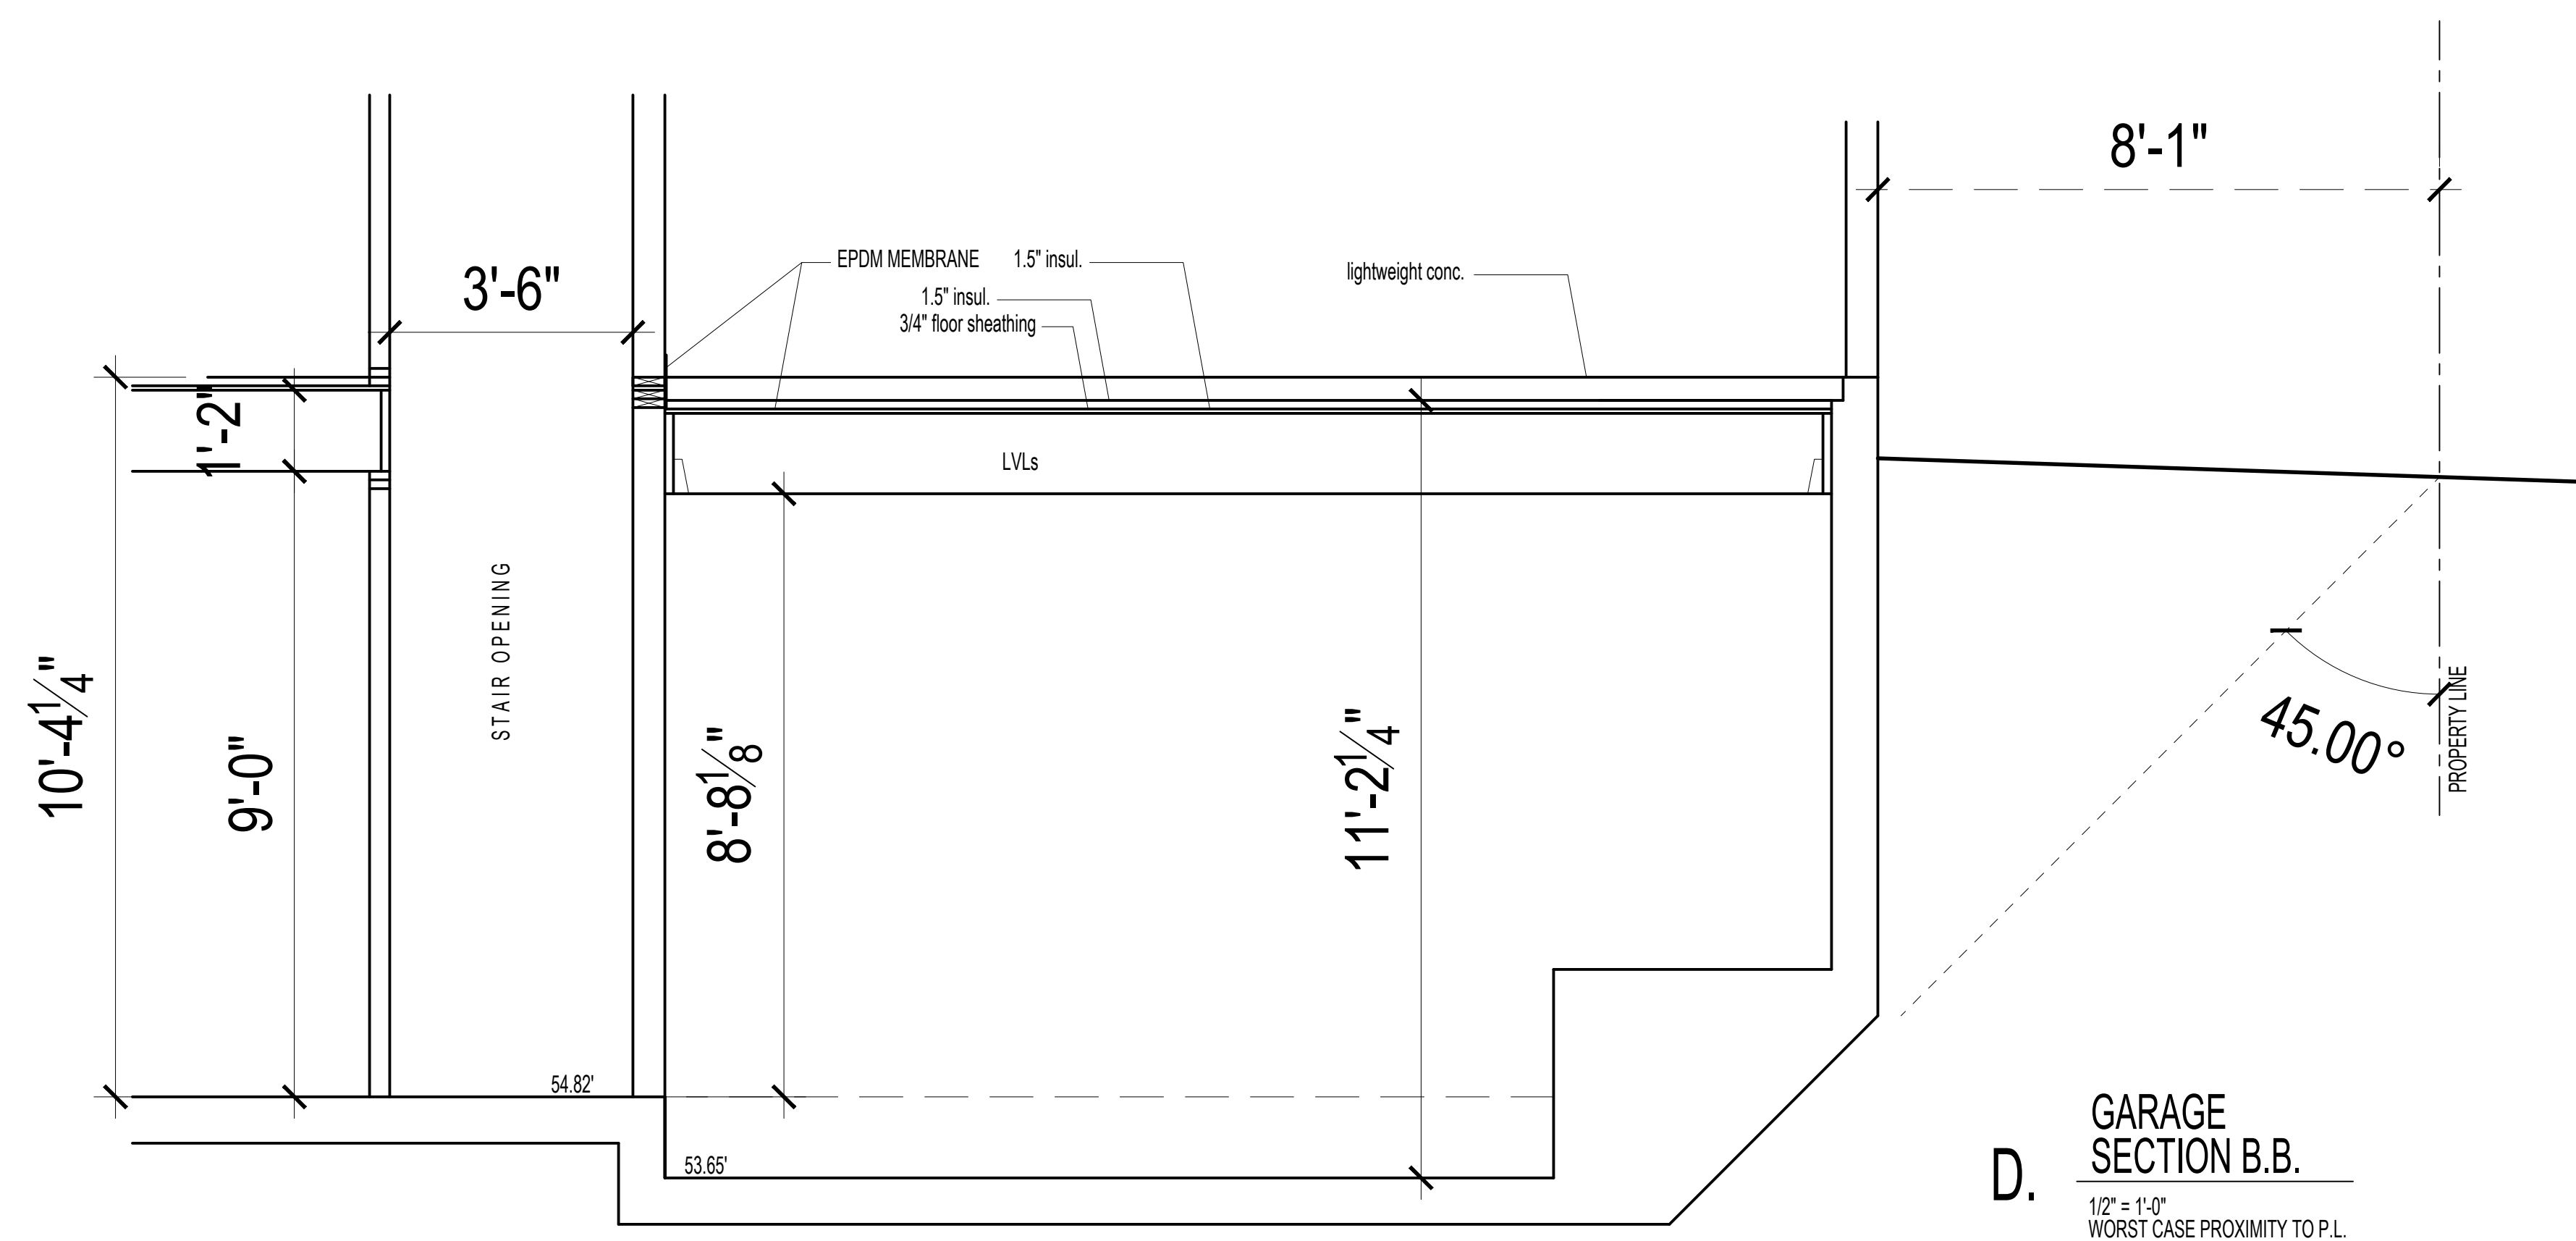

D. GARAGE SECTION B.B.
1/2" = 1'-0"
WORST CASE PROXIMITY TO P.L.

WSU Code Compliance Calculator, WSEC 2018

Project Information

Sina Yeganeh Residence

Contact Information

Chris Luhn

Messages / Results *

UA Reduction = 29.45, Proposed UA is better than baseline by 5%
Window area is 11% of floor area
Whole House Mechanical Ventilation Airflow Rate: 55 CFM with Run Time Percent of 100%, Balanced, Distributed
Maximum allowable total measured duct leakage: 285 CFM25
*Results assume your inputs are complete and correct. Results do not constitute an approval. Analysis should be reviewed by your AHJ.

ANALYSIS SET UP

What code compliance pathway are you using?

New Construction

Project Building Type?

R3 Single family homes and duplexes

Occupancy Type?

WSEC 2021

Code Version?

WSEC-R Rev: Oct. 2023, https://www.abcc.wa.gov/sites/default/files/2023-12/0

Classification:

Medium Dwelling Unit -- 3588 sq. ft.

Baseline Description:

Code Baseline - Baseline and proposed window areas are equal.

About Your Selection:

Up to 15 of exempt window and 24 of exempt door allowable

RESULTS - Comparison of Baseline and Proposed Design									
Component Performance, R-Assignments				Proposed Design					
	U *	Area	UA		U	Area	UA		
Doors U =	0.300	322	96.7	Doors U =	0.300	322	96.7		
Overhead Glazing U =	0.300	11	3.3	Overhead Glazing U =	0.300	11	3.3		
Vertical Glazing U =	0.300	384	115.3	Vertical Glazing U =	0.300	384	115.3		
Flat/Vaulted Ceilings U =	0.024	1,108	26.8	Flat/Vaulted Ceilings U =	0.020	1,108	22.2		
Wall (above grade) U =	0.056	3,250	182.0	Wall (above grade) U =	0.056	3,250	182.0		
Floors over Crawlspace U =	0.029	538	15.6	Floors over Crawlspace U =	0.029	538	15.6		
Slab on Grade F =	0.040	139	5.6	Slab on Grade F =	0.040	139	5.6		
Below Grade Wall U =	0.035	1,256	44.0	Below Grade Wall U =	0.035	1,256	44.0		
Below Grade Slab F =	0.000	157	0.0	Below Grade Slab F =	0.000	157	0.0		
* Values from Table R402.1.2 (Oct 2023)									
Baseline UA Total			642.3	Proposed UA Total			612.9		
Required Credits			8.0	Proposed Credits			8.0	from Tables 406.2 and 406.3	
UA Percent Reduction			4.8%	UA Percent Reduction			4.8%		
UA Reduction			29.5	UA Reduction			29.5		

If the Proposed UA ≤ the Target UA, and the Proposed Credits from Table 406 are ≥ those required in Section R406, then the home meets the WUE.

Table R406.2 Energy Equalization Credits					
System No.	Full Description	Select System Type	Fuel Normalization Credits (406.2)	Energy Credits (406.3)	Total Credits (406.2 & 406.3)
4	For heating system using a heat pump that meets federal standards for the equipment listed in Table C403.3.2(2) or Table C403.3.2(3) OR Air-to-Water heat pump units that are configured to provide both heating and cooling and are rated in accordance with AHR 550/590	Variable Refrigerant Heat Pump or Air-to-Water Heat Pump	3.0	5.0	8.0

Table R406.3 Energy Credits				
Option No.	Category	Select Options	Energy Credits	Brief Description of Selected Options*
1	Efficient Building Envelope	Not Selected	0.0	-
2	Air Leakage Control and Efficient Ventilation	Option 2.1	1.0	Per Section R402.4.1.2 / 2.0 ACH50 / For R-2, 0.25 cm per R2 at 50 Pa / 1 W/m ² with min SHG eff of 0.05 per IRC Section M1505.3 or IRC Section 403.6
3.1 - 3.10	High Efficiency HVAC	Option 3.6	1.0	Air source ducted Heat Pump w/ Min HSPF2 of 10 (HSPF of 11). If Htg design temp is 23°F or below, a cold climate variable capacity heat pump is required.
3.11	High Efficiency HVAC: Smart Thermostat	Option 3.11	0.5	Connected Energy Star Certified smart thermostat.
4	High Efficiency HVAC: Distribution System	Option 4.1	0.5	Duct/distribution system in conditioned space per R403.3.2 Electric, resistance, hydronic, ductless and gas fired systems < 80% AFUE systems not permitted

I:\2018 WSEC\2018 Compliance forms\2021Code Compliance Calculator\WSU_C32021_20240325-465692a.htm 3/26/2024

WSU Code Compliance Calculator, WSEC 2018

Thermal Envelope Details - Proposed Design

Conditioned Floor Area, Proposed Design 3,588 sq. ft.
Classification Medium Dwelling Unit
Notes

Exterior Doors									
Plan ID	Component Description	Ref.	Door U	Qt.	Width Feet	Height Feet	Area	UA	
Exempt	2021 U-factor Baseline (Table R402.1.2)	Table R402	0.30	1	8	10	80	24	0.0
Entry	2021 U-factor Baseline (Table R402.1.2)	Table R402	0.30	1	3	8	24	7.2	15.3
Mudroom	2021 U-factor Baseline (Table R402.1.2)	Table R402	0.30	1	3	8	24	7.2	7.6
Kitchen	2021 U-factor Baseline (Table R402.1.2)	Table R402	0.30	1	3	8	24	7.2	7.6
Living Room	2021 U-factor Baseline (Table R402.1.2)	Table R402	0.30	1	3	8	24	7.2	128
Bedroom	2021 U-factor Baseline (Table R402.1.2)	Table R402	0.30	1	3	8	24	7.2	41
Deck/Door	2021 U-factor Baseline (Table R402.1.2)	Table R402	0.30	2	3	8	48	14.4	51
Sum of Area and UA								222	96.7
Exterior Doors Area Weighted U								0	0.30

Overhead Glazing									
Plan ID	Component Description	Ref.	Glazing U	Qt.	Width Feet	Height Feet	Area	UA	
Exempt	2021 U-factor Baseline (Table R402.1.2)	Table R402	0.30	1	2	4	8	2.4	6
Garage	2021 U-factor Baseline (Table R402.1.2)	Table R402	0.30	1	2	4	8	2.4	-
Sum of Area and UA								11.3	6
Overhead Glazing Area Weighted U								0	0.30

Vertical Glazing Schedule									
Plan ID	Component Description	Ref.	Glazing U	Qt.	Width Feet	Height Feet	Area	UA	
Exempt	2021 U-factor Baseline (Table R402.1.2)	Table R402	0.30	1	2	4	8	2.4	-
1st floor	2021 U-factor Baseline (Table R402.1.2)	Table R402	0.30	1	2	4	8	2.4	33.2
2nd floor	2021 U-factor Baseline (Table R402.1.2)	Table R402	0.30	1	2	4	8	2.4	30.0
3rd floor	2021 U-factor Baseline (Table R402.1.2)	Table R402	0.30	1	2	4	8	2.4	37.5
4th floor	2021 U-factor Baseline (Table R402.1.2)	Table R402	0.30	1	2	4	8	2.4	50.0
5th floor	2021 U-factor Baseline (Table R402.1.2)	Table R402	0.30	1	2	4	8	2.4	22.50
6th floor	2021 U-factor Baseline (Table R402.1.2)	Table R402	0.30	1	2	4	8	2.4	18.8
7th floor	2021 U-factor Baseline (Table R402.1.2)	Table R402	0.30	1	2	4	8	2.4	80.0
8th floor	2021 U-factor Baseline (Table R402.1.2)	Table R402	0.30	1	2	4	8	2.4	15.8
9th floor	2021 U-factor Baseline (Table R402.1.2)	Table R402	0.30	1	2	4	8	2.4	4.0
10th floor	2021 U-factor Baseline (Table R402.1.2)	Table R402	0.30	1	2	4	8	2.4	5.0
11th floor	2021 U-factor Baseline (Table R402.1.2)	Table R402	0.30	1	2	4	8	2.4	13.50
Sum of Area and UA								394.3	118.3
Vertical Glazing Area Weighted U								0	0.30
Vertical Glazing and Doors Area Weighted U								0	0.30

Flat/Vaulted Ceilings									
Plan ID	Component Description	Ref.	Attic U	Area	UA				
Exempt	2021 U-factor Baseline (Table R402.1.2)	Table R402	0.020	1,108	22.2				
Sum of Area and UA								1,108	22.2

Walls (Above Grade)									
Plan ID	Component Description	Ref.	Wall U	Area	UA				
Exempt	2021 U-factor Baseline (Table R402.1.2)	Table R402	0.056	3,250	182				
Sum of Area and UA								3,250	182

I:\2018 WSEC\2018 Compliance forms\2021Code Compliance Calculator\WSU_C32021_20240325-465692a.htm 3/26/2024

WSU Code Compliance Calculator, WSEC 2018

Floor (over crawl or exterior)

Plan ID Component Description Ref. Floor U Area UA

Exempt R30 vented joist (Code Baseline) 10-3 0.029 538 15

Sum of Area and UA 538 15

Slab on Grade (less than 2 feet below grade)

Plan ID Component Description Ref. Slab F Slab Perim FP

Exempt R10 Fully Insulated (2018.1.3-1.9) 10-2 0.380 139 5.6

Sum of Perimeter and FP 139 5.6

Below Grade Walls and Slabs

Plan ID Component Description Slab Depth Ref. Wall U Wall Area Wall UA Slab F Slab Perim Slab UA

Exempt R21 Batt w/ TB 7 Depth WSU 0.04 1,256 44.0 0.500 157 0.0

Sum of Area, Length and UA 1,256 44.0 157 0.0

Links to Download Forms, Checklists and Other Resources

Compliance Certificate Insulation Certificate for Residential New Construction Duct Testing Affidavits Existing Construction Affixment, Existing Insulation Certificate New Construction Affixment, New Prescriptive Checklist Worksheet https://www.pacificenergyservices.com/wp-content/uploads/2023/04/2023-04-10-WSU-Code-Compliance-Calculator-Links-to-Download-Forms-Checklists-and-Other-Resources.pdf

Show Ventilation Calculator?

Ventilation Requirements Conditioned Floor Area 3,588 sq. ft. Number of Bedrooms 1 Run-Time Percent in Each 4-Hour Segment 100% Is the system Balanced? Balanced Verify system meets definition of 'Balanced Whole-House Ventilation' Is the system Distributed? Distributed Verify system meets definition of 'Distributed Whole-House Ventilation' Ventilation Code Section IRC, Chapter 15 Whole House Mechanical Ventilation Airflow Rate 55 CFM

Show Distribution System Calculator?

HVAC Thermal Distribution System Download R403.3.2 (2018) http://www.energy.wa.edu/Documents/Duct%20Leakage%20Standards%20R403.3.2.pdf Is this a hydronic heating system? No Location of Ducts Conditioned Space Location of Air Handler Conditioned Space Is Duct Testing Required? Yes

Show Heating System Sizing?

Heating System Sizing - Proposed Design Try Out BetterBuildW's HVAC Sizing Tool: https://betterbuildw.com/resources/hvac-sizing-tool/ Nearest Weather Station Mercer Island Indoor Design Temperature 70 F Outdoor Design Temperature 25 F Design Temperature Difference (ΔT) 45 F Conditioned Floor Area, Proposed Design 3,588 sq. ft. Conditioned Volume 28,543 cu. ft.

I:\2018 WSEC\2018 Compliance forms\2021Code Compliance Calculator\WSU_C32021_20240325-465692a.htm 3/26/2024

PRIMARY RESIDENCE HVAC NOTES

DUCTED HEAT PUMP (HSPF>11.0) INT. AIR HANDLER
HEAT RECOVERY VENTILATION
REQUIRED VENTING = CONTINUOUS 120CFM
SET TO OPERATE AT 240 CFM FOR 2 HOURS IN EA. 4 HR PERIOD (50%)
PROVIDED BY VARIABLE SPEED HIGH EFF. FAN (MAX. 35 WATTS/CFM)
CONTROLLED TO OPERATE AT LOW SPEED IN VENTILATION MODE ONLY.


A certificate is required to be posted on a wall in the space where the furnace is located, a utility room, or on an electrical panel per **WSEC R401.3** and include the following: predominate R-values, U-values of fenestration, results from duct system and building envelope air leakage testing, the results from the whole-house mechanical ventilation system flow rate test, and the types and efficiencies of heating/cooling/whole-house mechanical ventilation/water heating equipment.

Maximum flow rates for shower heads and kitchen sink - 1.75 GPM or less. All other lavatory faucets - 1.0 GPM or less.

Per WSEC R402.4, The building thermal Envelope shall be constructed to limit air leakage to 2.0 air changes per hour maximum. The results of the test shall be signed by the party conducting the test and provided to the code official (R402.4.1.2). Per WSEC R403.1.1, at least one thermostat per dwelling unit shall be capable of controlling the heating and cooling system on a daily schedule. Per WSEC R403.2.2, Ducts, air handlers, and filter boxes shall be sealed. Per WSEC R404.1, A minimum of 90 percent of the lamps in permanently installed lighting fixtures shall be high-efficacy lamps.

R404.2 Interior lighting controls. Permanently installed interior lighting fixtures shall be controlled with either a dimmer, an occupant sensor control or other control that is installed or built into the fixture. Exception: Lighting controls shall not be required for the following: 1. Bathrooms. 2. Hallways. 3. Lighting designed for safety or security.

R404.3 Exterior lighting controls. Where the total permanently installed exterior lighting power is greater than 30 watts, the permanently installed exterior lighting shall comply with the following: 1. Lighting shall be controlled by a manual on and off switch which permits automatic shut-off actions. Exception: Lighting serving multiple dwelling units. 2. Lighting shall be automatically shut off when daylight is present and satisfies the lighting needs. 3. Controls that override automatic shut-off actions shall not be allowed unless the override automatically returns automatic control to its normal operation within 24 hours.

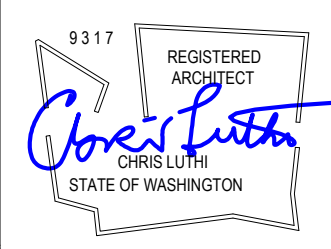

Yeganeh Residence
3029 62nd Ave SE

CONTENTS
C3 Energy Code

DRAWN BY
CRL
DATE

5.29.24
10.4.24

07

I:\2018 WSEC\2018 Compliance forms\2021Code Compliance Calculator\WSU_C32021_20240325-465692a.htm 3/26/2024

I:\2018 WSEC\2018 Compliance forms\2021Code Compliance Calculator\WSU_C32021_20240325-465692a.htm 3/26/2024

I:\2018 WSEC\2018 Compliance forms\2021Code Compliance Calculator\WSU_C32021_20240325-465692a.htm 3/26/2024

General Structural Notes (GSN's)

CRITERIA:

1. ALL MATERIALS, WORKMANSHIP, DESIGN, AND CONSTRUCTION SHALL CONFORM TO THE DRAWINGS, SPECIFICATIONS, AND THE INTERNATIONAL BUILDING CODE (IBC) WITH WASHINGTON STATE ADMINISTRATIVE CODE AMENDMENTS, 2018 EDITION.
2. DESIGN LOADING CRITERIA
RISK CATEGORY SBC TABLE 1604.5 II
ROOF SNOW LOAD 25 PSF ($l_g = 1.0$)
+ 5 PSF RAIN SURCHARGE
ROOF DEAD LOAD 25 PSF (@ DECK AND @ SOLAR AREA)
RESIDENTIAL LIVE LOAD 40 PSF
DECK LIVE LOAD 60 PSF
FLOOR DEAD LOAD 35 PSF (INCLUDES $1\frac{1}{2}"$ GYPCORETE)
DECK DEAD LOAD 15 PSF
- EARTHQUAKE SEISMIC DESIGN CATEGORY D
 $S_D = 1.57, S_L = 0.64, S_{DS} = 1.17, S_{D1} = 0.73$
EQUIVALENT LATERAL FORCE PROCEDURE
LIGHT FRAME (WOOD) WALLS AND ROOFS SHEATHED WITH WOOD STRUCTURAL PANELS RATED FOR SHEAR
 $R = 6.5, Q_h = 2\frac{1}{2}, l_e = 1.0, C_d = 4, C_e = 0.180$
BASE SHEAR $V = 38.4 \text{ K} - \text{LRFD}$
WIND 110 MPH, EXPOSURE "C", $K_{zt} = 1.0$
COMPONENTS & CLADDING -29.2/-17.5 PSF MAX. AT WALLS (LRFD/ASD)
-34.7/-20.8 GROSS UPLIFT AT ROOF (LRFD/ASD)
-29.2/-17.5 PSF MAX. AT WALLS (LRFD/ASD)
WIND PRESSURES BASED ON LESS THAN 10 SQUARE FOOT TRIBUTARY AREAS NEAR WALL CORNERS OR ROOF EDGES (EXCLUDING CORNER ZONES AT ROOF). REDUCED DESIGN PRESSURES MAY BE CALCULATED IN ACCORDANCE WITH ASCE 7-16 CHAPTER 30.

3. STRUCTURAL DRAWINGS SHALL BE USED IN CONJUNCTION WITH ALL OTHER CONTRACT DOCUMENTS FOR BIDDING AND CONSTRUCTION. CONTRACTOR SHALL VERIFY DIMENSIONS AND CONDITIONS FOR COMPATIBILITY AND SHALL NOTIFY ENGINEER OF ALL DISCREPANCIES PRIOR TO CONSTRUCTION. IT IS THE CONTRACTOR'S RESPONSIBILITY TO COORDINATE BUILDING LAYOUT DIMENSIONS (GRID LAYOUTS, SITE COORDINATES, ETC.) AMONGST ALL TRADES, INCLUDING SHOP FABRICATED ITEMS.
4. CONTRACTOR SHALL PROVIDE TEMPORARY BRACING, BOTH FOR VERTICAL LOADS AND LATERAL STABILITY, FOR THE STRUCTURE AND STRUCTURAL COMPONENTS UNTIL ALL FINAL CONNECTIONS HAVE BEEN COMPLETED IN ACCORDANCE WITH THE DRAWINGS.
5. CONTRACTOR SHALL BE RESPONSIBLE FOR ALL SAFETY PRECAUTIONS AND THE METHODS, TECHNIQUES, SEQUENCES OR PROCEDURES REQUIRED TO PERFORM THE WORK.
6. DRAWINGS INDICATE GENERAL AND TYPICAL DETAILS OF CONSTRUCTION. WHERE CONDITIONS ARE NOT SPECIFICALLY INDICATED BUT ARE OF SIMILAR CHARACTER TO DETAILS SHOWN, SIMILAR DETAILS OF CONSTRUCTION SHALL BE USED, SUBJECT TO REVIEW AND APPROVAL BY THE ARCHITECT AND THE STRUCTURAL ENGINEER.
7. ALL STRUCTURAL SYSTEMS COMPOSED OF COMPONENTS TO BE FIELD ERECTED SHALL BE SUPERVISED BY THE SUPPLIER DURING MANUFACTURING, DELIVERY, HANDLING, STORAGE AND ERECTION IN ACCORDANCE WITH INSTRUCTIONS PREPARED BY THE SUPPLIER.
8. SEISMIC BRACING AND/OR GRAVITY SUPPORT AND ANCHORAGE OF ALL MECHANICAL OR ELECTRICAL EQUIPMENT SHALL BE DESIGNED BY A PROFESSIONAL ENGINEER REGISTERED IN THE STATE OF WASHINGTON, EXCEPT FOR ELEMENTS SPECIFICALLY SHOWN AND DETAILED ON THE STRUCTURAL DRAWINGS. THE MECHANICAL/ELECTRICAL CONTRACTOR MUST HIRE THE ENGINEER AND IS RESPONSIBLE FOR ALL COSTS RELATED TO THE PURCHASE AND INSTALLATION OF NECESSARY SUPPORTS, BRACING AND ANCHORAGE. SEISMIC BRACING AND ANCHORAGE DESIGN AND CONSTRUCTION SHALL COMPLY WITH CHAPTER 13 OF ASCE 7-16.

9. SHOP DRAWING REVIEW: SHOP DRAWINGS FOR TRUSSES SHALL BE SUBMITTED TO THE CONTRACTOR, ARCHITECT, AND ENGINEER OF RECORD FOR REVIEW PRIOR TO FABRICATION OF THESE ITEMS. DIMENSIONS AND QUANTITIES ARE NOT REVIEWED BY THE ENGINEER OF RECORD, AND THEREFORE MUST BE VERIFIED BY THE CONTRACTOR. THE CONTRACTOR SHALL REVIEW AND STAMP DRAWINGS PRIOR TO REVIEW BY ENGINEER OF RECORD. SUBMITTALS SHALL INCLUDE A REPRODUCIBLE AND ONE COPY. THE REPRODUCIBLE SHALL BE MARKED AND RETURNED. SHOP DRAWING SUBMITTALS PROCESSED BY THE ENGINEER ARE NOT CHANGE ORDERS. THE PURPOSE OF SHOP DRAWING SUBMITTALS BY THE CONTRACTOR IS TO DEMONSTRATE TO THE ENGINEER THAT THE CONTRACTOR UNDERSTANDS THE DESIGN CONCEPT BY INDICATING WHICH MATERIAL IS INTENDED TO BE FURNISHED AND INSTALLED AND BY DETAILING THE INTENDED FABRICATION AND INSTALLATION METHODS. IF DEVIATIONS, DISCREPANCIES, OR CONFLICTS BETWEEN SHOP DRAWING SUBMITTALS AND THE CONTRACT DOCUMENTS ARE DISCOVERED EITHER PRIOR TO OR AFTER SHOP DRAWING SUBMITTALS ARE PROCESSED BY THE ENGINEER, THE DESIGN DRAWINGS AND SPECIFICATIONS SHALL CONTROL AND SHALL BE FOLLOWED.

10. DEFERRED SUBMITTALS SHALL BE DESIGNED BY AN ENGINEER REGISTERED IN THE STATE OF WASHINGTON. THE COMPONENT DESIGNER SHALL BE A REGISTERED STRUCTURAL ENGINEER IF REQUIRED BY THE BUILDING OFFICIAL OF THE LOCAL JURISDICTION. BUILDING COMPONENT SUBMITTALS SHALL INCLUDE THE DESIGNING PROFESSIONAL ENGINEER'S STAMP AND SHALL BE APPROVED BY THE COMPONENT DESIGNER PRIOR TO CURSORY REVIEW BY THE ENGINEER OF RECORD FOR LOADS IMPOSED ON THE BASIC STRUCTURE. THE COMPONENT DESIGNER IS RESPONSIBLE FOR CODE CONFORMANCE INCLUDING ACCOMMODATION FOR STRUCTURAL DISPLACEMENT PER ASCE 7-10 SECTION 13.3.2, AND ALL NECESSARY CONNECTIONS NOT SPECIFICALLY CALLED OUT ON ARCHITECTURAL OR STRUCTURAL DRAWINGS. DEFERRED SUBMITTALS SHALL INDICATE MAGNITUDE AND DIRECTION OF ALL LOADS IMPOSED ON BASIC STRUCTURE. DESIGN CALCULATIONS SHALL BE INCLUDED IN THE SUBMITTAL. THE CONTRACTOR SHALL FORWARD DEFERRED SUBMITTALS TO THE BUILDING OFFICIAL AND HAVE THE DEFERRED SUBMITTALS ON SITE FOR THE GOVERNING JURISDICTIONS INSPECTORS USE AND REFERENCE. THE FOLLOWING BUILDING COMPONENTS SHALL BE DEFERRED SUBMITTALS FOR THIS PROJECT:
- PREFABRICATED CONNECTOR PLATE WOOD TRUSSES (SEE GENERAL NOTE #22)

GEOTECHNICAL:

11. FOUNDATION NOTES: SUBGRADE PREPARATION INCLUDING DRAINAGE, EXCAVATION, COMPACTION, AND FILLING REQUIREMENTS SHALL CONFORM STRICTLY WITH THE SPECIFICATIONS OR AS DIRECTED BY THE OWNER APPOINTED GEOTECHNICAL ENGINEER. FOOTINGS SHALL BEAR ON FIRM, UNDISTURBED EARTH OR CONTROLLED, COMPACTED STRUCTURAL FILL AT LEAST 12" BELOW LOWEST ADJACENT FINISHED GRADE. THE OWNER APPOINTED GEOTECHNICAL ENGINEER SHALL APPROVE FOOTING EXCAVATION/PREPARATION PRIOR TO PLACEMENT OF ALL FOOTINGS.
ALLOWABLE SOIL PRESSURE 1,500 PSF
REFERENCE: ASSUMED PER IBC TABLE 1806.2
ALL BOTTOM OF EXTERIOR FOOTINGS, AND INTERIOR FOOTINGS IN AN UNCONDITIONED SPACE, SHALL BE SET 12" BELOW GRADE AT A MINIMUM TO REACH FROST DEPTH.

ANCHORAGE:

12. DRIVE PINS AND OTHER POWDER-ACTUATED FASTENERS SHALL BE ONE OF THE FOLLOWING INSTALLED IN STRICT ACCORDANCE WITH THE ICC-ES REPORTS INDICATED AND MANUFACTURER'S INSTRUCTIONS INCLUDING MINIMUM EMBED REQUIREMENTS: "E" SERIES" (0.157" DIAMETER) AS MANUFACTURED BY ITW RAMSET (ICC-ES NO. 1799); OR "X-U" (0.157" DIAMETER) AS MANUFACTURED BY HILTI, INC. (ICC-ES NO. 2269); OR "STRONG-TIE PDPA" (0.157" DIAMETER) AS MANUFACTURED BY SIMPSON STRONG-TIE COMPANY, INC. (ICC-ES NO. 2138); OR "CSI PM" (0.157" DIAMETER) AS MANUFACTURED BY DEWALT/POWERS (ICC-ES NO. 2024); OR AN APPROVED EQUIVALENT IN STRENGTH AND EMBEDMENT. MINIMUM EMBEDMENT IN CONCRETE SHALL BE 1" UNLESS OTHERWISE NOTED. MAINTAIN AT LEAST 3-1/2" TO NEAREST CONCRETE EDGE.

CONCRETE:

13. CONCRETE SHALL BE MIXED, PROPORTIONED, CONVEYED AND PLACED IN ACCORDANCE WITH ACI 318-19 CHAPTERS 20 AND 26 AND ACI 301. CONCRETE SHALL ATTAIN A 28-DAY STRENGTH OF $f_c = 4,000$ PSI. MAXIMUM WATER-CEMENTITIOUS MATERIAL RATIO FOR INTERIOR SLABS SHALL BE BETWEEN 0.40 AND 0.44. ALL CONCRETE SHALL BE EXPOSURE CLASSES F0, S0, W0, AND C0 PER ACI 318-19 TABLES 19.3.1.1 AND 19.3.2.1 EXCEPT AS NOTED BELOW.
ALL CONCRETE EXPOSED TO EARTH (FOUNDATIONS, ETC.): (F0, S0, W0, C1)
ALL CONCRETE EXPOSED TO WEATHER: (F1, S0, W0, C1)
CONCRETE MIXES SHALL MEET OR EXCEED THE REQUIREMENTS ABOVE.

14. REINFORCING STEEL SHALL CONFORM TO ASTM A615, GRADE 60, $f_y = 60,000$ PSI. GRADE 60 REINFORCING BARS WHICH ARE TO BE WELDED SHALL CONFORM TO ASTM A706. REINFORCEMENT COMPLYING WITH ASTM A615(S1) MAY BE WELDED ONLY IF MATERIAL PROPERTY REPORTS INDICATING CONFORMANCE WITH WELDING PROCEDURES SPECIFIED IN A.W.S. D1-4 ARE SUBMITTED. WELDED WIRE FABRIC SHALL CONFORM TO ASTM A1064.

15. REINFORCING STEEL SHALL BE DETAILED (INCLUDING HOOKS AND BENDS) IN ACCORDANCE WITH ACI 318-99 AND 318-14. LAP ALL CONTINUOUS REINFORCEMENT IN ACCORDANCE WITH "REINFORCEMENT SPLICE AND DEVELOPMENT LENGTH SCHEDULE" OF 10/5311. PROVIDE CORNER BARS AT ALL WALL AND FOOTING INTERSECTIONS. LAP ADJACENT MATS OF WELDED WIRE FABRIC A MINIMUM OF 12" AT SIDES AND ENDS. NO BARS PARTIALLY EMBEDDED IN HARDENED CONCRETE SHALL BE FIELD BENT UNLESS OTHERWISE NOTED ON THE DRAWINGS OR APPROVED BY THE STRUCTURAL ENGINEER.
16. CONCRETE PROTECTION (COVER) FOR REINFORCING STEEL SHALL BE AS FOLLOWS:
FOOTINGS AND OTHER UNFORMED SURFACES
CAST AGAINST AND PERMANENTLY EXPOSED TO EARTH 3"
FORMED SURFACES EXPOSED TO EARTH 1 1/2"
(I.E. WALLS BELOW GROUND)/OR WEATHER (#5 BARS OR SMALLER) 1 1/2"
17. BONDING AGENT SHALL BE "MASTEREMACO AD 326" BY BASF CORPORATION, OR EQUIVALENT, AND SHALL BE USED WHERE NEW CONCRETE IS PLACED AGAINST HARDENED CONCRETE. PLACE IN STRICT ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS, INCLUDING PREPARATION OF EXISTING SURFACES. CONCRETE SHALL BE CONSIDERED HARDENED AFTER 56 DAYS.
18. NON-SHRINK GROUT SHALL BE FURNISHED BY AN APPROVED MANUFACTURER AND SHALL BE MIXED AND PLACED IN STRICT ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS. GROUT STRENGTH SHALL BE AT LEAST EQUAL TO THE MATERIAL ON WHICH IT IS PLACED (6,000 PSI MINIMUM).

IBC TABLE 1705.3 REQUIRED SPECIAL INSPECTIONS AND TESTS OF CONCRETE CONSTRUCTION					
REQUIRED?	VERIFICATION & INSPECTION	CONTINUOUS/PERIODIC	REF. STD.	IBC REF.	
N/A	1. INSPECT REINFORCEMENT, INCLUDING PRESTRESSING TENDONS AND VERIFY PLACEMENT.	----	X	ACI 318 CH. 20, 25.2, 25.3, 26.1.1, 26.2.3.1	1908.4
N/A	2. REINFORCING BAR WELDING: A. VERIFY WELDABILITY OF REINFORCING BARS OTHER THAN ASTM A 706. B. INSPECT SINGLE-PASS FILLET WELDS, MAXIMUM 5/16", AND C. INSPECT ALL OTHER WELDS	----	X	AWS D1.4 ACI 318 26.5.4	----
N*	3. INSPECT ANCHORS CAST IN CONCRETE.	----	X	ACI 318: 17.8.2	----
N/A	4. INSPECT ANCHORS POST-INSTALLED IN HARDENED CONCRETE MEMBERS. A. ADHESIVE ANCHORS INSTALLED IN HORIZONTALLY OR UPWARDLY INCLINED ORIENTATIONS TO RESIST SUSTAINED TENSION LOADS B. MECHANICAL ANCHORS AND ADHESIVE ANCHORS NOT DEFINED IN 4.A	X	X	ACI 318: 17.8.2.4 ACI 318:17.8.2	----
N*	5. VERIFY USE OF REQUIRED DESIGN MIX.	----	X	ACI 318: CH. 19, 26.4.3, 26.4.4	1904.1, 1904.2, 1908.3
N*	6. PRIOR TO CONCRETE PLACEMENT, FABRICATE SPECIMENS FOR STRENGTH TESTS, PERFORM PLUMB AND AIR CONTENT TESTS, AND DETERMINE THE TEMPERATURE OF THE CONCRETE.	X	----	ASTM C 172 ASTM C 31 ACI 318: 26.4.4, 26.12	1908.10
N*	7. INSPECT CONCRETE AND SHOTCRETE PLACEMENT FOR PROPER APPLICATION TECHNIQUES.	X	----	ACI 318: 26.4.5	1908.6, 1908.7, 1908.8
N*	8. VERIFY MAINTENANCE OF SPECIFIED CURING TEMPERATURE AND TECHNIQUES.	----	X	ACI 318: 26.4.7-26.4.9	1908.9
N/A	9. INSPECT PRESTRESSED CONCRETE FOR: A. APPLICATION OF PRESTRESSING FORCES; AND B. GROUTING OF BONDED PRESTRESSING TENDONS	X	----	ACI 318: 26.9.2.1 ACI 218: 26.9.2.3	----
N/A	10. INSPECTION OF PRECAST CONCRETE MEMBERS.	----	X	ACI 318: CH. 26.8	----
N*	11. VERIFY IN-SITU CONCRETE STRENGTH, PRIOR TO STRESSING OF TENDONS IN POST-TENSIONED CONCRETE AND PRIOR TO REMOVAL OF SHORES AND FORMS FROM BEAMS AND STRUCT. SLABS.	----	X	ACI 318: 26.10.2	----
N*	12. INSPECT FORMWORK FOR SHAPE, LOCATION AND DIMENSIONS OF THE CONCRETE MEMBER BEING FORMED.	----	X	ACI 318: 26.10.1(b)	----

* EXCEPTIONS 1 PER IBC SECTION 1705.3 APPLIES TO CONCRETE WORK ON THIS PROJECT.

WOOD:

19. FRAMING LUMBER SHALL BE KILN DRIED OR MC-19, AND GRADED AND MARKED IN CONFORMANCE WITH W.C.L.B. STANDARD GRADING RULES FOR WEST COAST LUMBER NO. 17 OR W.W.P.A. WESTERN LUMBER GRADING RULES. FURNISH TO THE FOLLOWING MINIMUM STANDARDS:
PLATES, LEDGERS & MISC. DOUGLAS FIR NO. 3 OR STUD GRADE
LIGHT FRAMING: MIN. BASIC DESIGN STRESS, $F_b = 525$ PSI, $E = 1,400$ KSI
 $F_c = 775$ PSI, $F_t = 325$ PSI
JOISTS & RAFTERS: DOUGLAS FIR NO. 2
MIN. BASIC DESIGN STRESS, $F_b = 900$ PSI, $E = 1,600$ KSI
 $F_c = 1,350$ PSI, $F_t = 575$ PSI
BEAMS: DOUGLAS FIR NO. 1
MIN. BASIC DESIGN STRESS, $F_b = 1,000$ PSI, $E = 1,700$ KSI
 $F_c = 1,500$ PSI, $F_t = 675$ PSI
 $F_e = 1,500$ PSI, $F_t = 1,600$ KSI
MIN. BASIC DESIGN STRESS, $F_b = 925$ PSI, $F_t = 675$ PSI
COLUMNS: DOUGLAS FIR NO. 1
MIN. BASIC DESIGN STRESS, $F_b = 1,000$ PSI, $E = 1,700$ KSI
 $F_c = 1,500$ PSI, $F_t = 675$ PSI
MIN. BASIC DESIGN STRESS, $F_b = 1,200$ PSI, $E = 1,600$ KSI
 $F_c = 1,000$ PSI, $F_t = 825$ PSI

20. MANUFACTURED LUMBER SHALL BE AS MANUFACTURED BY TRUS JOIST OR APPROVED EQUAL. REQUESTS FOR APPROVAL AS EQUAL WILL REQUIRE SUBMITTAL OF ICC REPORT EQUIVALENT TO ESR-1387 FOR LAMINATED VENEER LUMBER (LVL, LAMINATED STRAND LUMBER (LSL), OR PARALLEL STRAND LUMBER (PSL)). THE MINIMUM ALLOWABLE DESIGN VALUES ARE AS FOLLOWS:
LVL - $F_b = 2,600$ $F_v = 290$ PSI $E = 2,000,000$ PSI
- $F_b = 1,900$ $F_v = 150$ PSI $E = 1,300,000$ PSI
LSL - $F_b = 2,600$ $F_v = 290$ PSI $E = 2,000,000$ PSI
- $F_b = 1,900$ $F_v = 150$ PSI $E = 1,300,000$ PSI

21. GLUED LAMINATED MEMBERS SHALL BE FABRICATED IN CONFORMANCE WITH ASTM AND A.I.T.C. STANDARDS IN ACCORDANCE WITH SBC SECTION 2303.1.3. EACH MEMBER SHALL BEAR AN A.I.T.C. IDENTIFICATION MARK AND SHALL BE ACCOMPANIED BY AN A.I.T.C. CERTIFICATE OF CONFORMANCE. HORIZONTAL MEMBERS AND INCLINED MEMBERS OF LESS THAN 1:1 SLOPE SHALL HAVE A RADIIUSED CAMBER OF 3,500 FT. UNLESS OTHERWISE NOTED.
SIMPLE SPAN BEAMS DOUGLAS FIR COMBINATION 24F-V4
 $F_b = 2,400$ PSI; $F_v = 265$ PSI; $E = 1,800,000$ PSI
CONTINUOUS OR CANTILEVERED BEAMS DOUGLAS FIR COMBINATION 24F-V8
 $F_b = 2,400$ PSI; $F_v = 265$ PSI; $E = 1,800,000$ PSI
THESE MEMBERS ARE NOTED AS "I" IN PLAN
GLUED LAMINATED MEMBERS EXPOSED TO WEATHER OR MOISTURE SHALL BE TREATED WITH A NON-CORROSIVE, APPROVED PRESERVATIVE.

22. PREFABRICATED CONNECTOR PLATE WOOD TRUSSES SHALL BE DESIGNED BY THE MANUFACTURER IN ACCORDANCE WITH ANSI/TPI 1-2007 AND IBC SECTION 2303.4 FOR THE SPANS AND CONDITIONS SHOWN ON THE DRAWINGS. DESIGN LOADS SHALL BE AS FOLLOWS:
ROOF TRUSSES
TOP CHORD LIVE LOAD 25 PSF, SNOW + 5 PSF, RAIN
TOP CHORD DEAD LOAD 20 PSF (INCLUDES 5 PSF FOR SOLAR)
BOTTOM CHORD DEAD LOAD 5 PSF
WIND UPLIFT (TOP CHORD) SEE NOTE#2 COMPONENTS & CLADDING ROOF LOADS
ROOF DECK TRUSSES
TOP CHORD LIVE LOAD 60 PSF LIVE
TOP CHORD DEAD LOAD 20 PSF
BOTTOM CHORD DEAD LOAD 5 PSF
WIND UPLIFT (TOP CHORD) SEE NOTE#2 COMPONENTS & CLADDING ROOF LOADS

THE TRUSS MANUFACTURER SHALL COORDINATE LOCATIONS AND SUPPORT CONFIGURATIONS OF PLUMBING, MECHANICAL UNITS, DUCTS, AND/OR OTHER MISCELLANEOUS ITEMS WITH THE CONTRACTOR PRIOR TO TRUSS FABRICATION. THE TRUSS MANUFACTURER SHALL DESIGN TRUSSES TO SUPPORT ALL LOADS ASSOCIATED WITH SUCH ITEMS. THE TRUSS SHOP DRAWINGS SHALL INCLUDE ALL DESIGN LOADS AND APPROVED HANGER CONNECTION DETAILS TO TRUSS CHORDS FOR SUPPORT OF HUNG MECHANICAL SYSTEM COMPONENTS AS APPLICABLE.
WOOD TRUSSES SHALL UTILIZE APPROVED CONNECTOR PLATES (GANGNAIL OR EQUAL). SHOP DRAWINGS AND CALCULATIONS SHALL BE PROVIDED AS A DEFERRED SUBMITTAL TO THE CONTRACTOR AND STRUCTURAL ENGINEER OF RECORD PER GENERAL STRUCTURAL NOTE 13. SHOP DRAWINGS SHALL INDICATE SHAPES, BEARING POINTS, INTERSECTIONS, HIPS, VALLEYS, ETC. EXACT COMPOSITION OF SPECIAL HIP, VALLEY, AND INTERSECTION AREAS USE OF CROWD TRUSSES, JACK TRUSSES, STEP-DOWN TRUSSES, ETC.) SHALL BE DETERMINED BY THE MANUFACTURER UNLESS OTHERWISE NOTED ON THE DRAWINGS. THE TRUSS MANUFACTURER SHALL PROVIDE ALL TRUSS-TO-TRUSS BEAM/JOIST CONNECTION DETAILS AND REQUIRED CONNECTION MATERIALS. THE TRUSS MANUFACTURER SHALL DESIGN AND PROVIDE DETAILS FOR ALL TEMPORARY AND PERMANENT TRUSS BRACING AND BRIDGING.

23. ROOF & WALL SHEATHING SHALL BE APA RATED, EXTERIOR OR EXPOSURE 1 PLYWOOD OR ORIENTED STRAND BOARD (OSB) IN CONFORMANCE WITH SBC SECTION 2303.1.5. SHEATHING SHALL BE MANUFACTURED UNDER THE PROVISIONS OF VOLUNTARY PRODUCT STANDARDS DOC PS 1-09, PS 2-10, OR APA PRP-108 PERFORMANCE STANDARDS AND POLICIES FOR STRUCTURAL USE PANELS. SEE DRAWINGS FOR THICKNESS, SPAN RATING, AND NAILING REQUIREMENTS.
24. AT NON-SHEARWALL EXTERIOR WALLS, UNLESS OTHERWISE NOTED, WALL SHEATHING SHALL BE $\frac{1}{2}"$ (NOMINAL) WITH SPAN RATING OF $\frac{1}{4}"$ WITH 8d @ 6" oc PANEL NAILING (APPLIES TO ALL SHEATHING PANEL EDGES); AND 8d @ 12" oc TO INTERMEDIATE FRAMING.
25. ALL PRESSURE-TREATED (P-T), WOOD MEMBERS SPECIFIED ON THE DRAWINGS THAT OCCUR ABOVE GROUND AND CONTINUOUSLY PROTECTED FROM MOISTURE (INTERIOR LOCATIONS) SHALL BE PRESSURE-TREATED WITH DOT SODIUM BORATE (SBX) WITHOUT Na_2SO_3 AT LOCATIONS PERMANENTLY EXPOSED TO WEATHER OR IN CONTACT WITH THE GROUND. WOOD MEMBERS SHALL BE PRESSURE-TREATED WITH ALKALINE COPPER QUAT (ACQ-C FOR DOUGLAS-FIR) PRESERVATIVE UNLESS OTHERWISE NOTED. AMMONIACAL COPPER ZINC ARSENATE (ACZA) PRESERVATIVE OR OTHER PRESERVATIVES WITH AMMONIA CARRIERS, SHALL NOT BE USED.
GLUED LAMINATED MEMBERS EXPOSED TO WEATHER OR MOISTURE SHALL BE TREATED WITH A NON-CORROSIVE, APPROVED PRESERVATIVE.
SEE NOTE #27 FOR MATERIAL REQUIREMENTS OF CONNECTORS AND FASTENERS IN CONTACT WITH PRESSURE-TREATED MEMBERS.

26. TIMBER CONNECTORS CALLED OUT BY LETTERS AND NUMBERS SHALL BE "STRONG-TIE" BY SIMPSON COMPANY, AS SPECIED N THEIR WOOD CONSTRUCTION CONNECTORS CATALOG NO. C-C-2017-18. INSTALL NUMBER AND SIZE OF FASTENERS AS SPECIFIED BY MANUFACTURER. CONNECTORS SHALL BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS. WHERE CONNECTOR STRAPS CONNECT TWO MEMBERS, CENTER STRAP ON JOINT AND INSTALL NUMBER AND SIZE OF FASTENERS AS SPECIFIED BY MANUFACTURER, WITH EQUAL NUMBER AND SIZE OF FASTENERS IN EACH MEMBER. ALL BOLTS IN WOOD MEMBERS SHALL CONFORM TO ASTM A307. INSTALL WASHERS UNDER THE HEADS AND NUTS OF ALL BOLTS AND LAG SCREWS BEARING ON WOOD. ALL SHIMS SHALL BE SEASONED AND DRIED AND THE SAME GRADE (MINIMUM) AS MEMBERS CONNECTED.

ALL TIMBER CONNECTORS IN CONTACT WITH PRESSURE-TREATED WOOD THAT USED PRESERVATIVE CHEMICALS OTHER THAN DOT SODIUM BORATE (SBX) WITHOUT Na_2SO_3 SHALL BE MANUFACTURED FROM Z_{MAX} STEEL BY SIMPSON (C185 STEEL PER ASTM A653), OR TYPE 304 OR 316 STAINLESS STEEL. ALTERNATIVELY, CONNECTORS CAN BE POST HOT DIP GALVANIZED PER ASTM A123 OR MECHANICALLY GALVANIZED PER ASTM B685, CLASS 55 OR GREATER. STAINLESS STEEL FASTENERS SHALL BE USED WITH STAINLESS STEEL CONNECTORS, AND HOT DIP GALVANIZED FASTENERS PER ASTM A153 SHALL BE USED WITH GALVANIZED CONNECTORS.

27. WOOD FRAMING NOTES: THE FOLLOWING SHALL APPLY UNLESS OTHERWISE NOTED ON THE DRAWINGS.
A. ALL WOOD FRAMING DETAILS SHALL BE CONSTRUCTED TO THE MINIMUM STANDARDS OF THE SBC. MINIMUM NAILING SHALL CONFORM TO SBC TABLE 2304.9.1 OR CURRENT ICC-ES REPORT NER-272. COORDINATE THE SIZE AND LOCATION OF ALL OPENINGS WITH MECHANICAL AND ARCHITECTURAL DRAWINGS. INSTALL WASHERS UNDER THE HEADS AND NUTS OF ALL BOLTS AND LAG SCREWS BEARING ON WOOD. INSTALLATION OF LAG SCREWS SHALL CONFORM TO 2012 NDS SECTION 11.1.4, AND INSTALLATION OF BOLTS SHALL CONFORM TO 2012 NDS SECTION 11.1.3.
B. WALL FRAMING: TWO STUDS MINIMUM SHALL BE INSTALLED AT THE ENDS OF ALL WALLS, UNLESS NOTED OTHERWISE NOTED. INSTALL SOLID BLOCKING FOR WOOD COLUMN THROUGH FLOOR SPACES TO SUPPORTS BELOW.
ALL STUD WALLS SHALL HAVE THEIR LOWER WOOD PLATES ATTACHED TO WOOD FRAMING BELOW WITH 16d NAILS @ 12" oc STAGGERED OR BOLTED TO CONCRETE WITH $\frac{3}{8}"$ ANCHOR BOLTS @ 4'-0" oc PER SBC SECTION 2308.6 (EMBED 7"), UNLESS OTHERWISE NOTED. 3" x 3" x 0.229" PLATE WASHERS SHALL BE USED WITH ALL SILL PLATE ANCHOR BOLTS AND INSTALLED PER AFAPA SDPMVS-2008 SECTION 4.3.6.4.3. INDIVIDUAL MEMBERS OF BUILT-UP STUD POSTS SHALL BE NAILED TO EACH OTHER WITH 16d @ 12" oc STAGGERED.

- C. FLOOR AND ROOF FRAMING: INSTALL SOLID BLOCKING AT ALL BEARING POINTS. TOENAIL JOISTS TO SUPPORTS WITH (2)16d NAILS. ATTACH TIMBER JOISTS TO FLUSH HEADERS OR BEAMS WITH SIMPSON METAL JOIST HANGERS IN ACCORDANCE WITH NOTES ABOVE. NAIL ALL MULTI-JOIST BEAMS TOGETHER WITH 16d@12" oc STAGGERED.

ROOF AND FLOOR SHEATHING SHALL BE LAID UP WITH GRAIN PERPENDICULAR TO SUPPORTS AND NAILED AS SHOWN ON THE DRAWINGS. INSTALL APPROVED PANEL EDGE CLIPS CENTERED BETWEEN JOISTS/TRUSSES AT UNLOCKED ROOF SHEATHING EDGES. ALL FLOOR SHEATHING EDGES SHALL HAVE APPROVED TONGUE-AND-GROOVE JOINTS OR SHALL BE SUPPORTED WITH SOLID BLOCKING ALLOW $\frac{1}{8}"$ SPACING AT ALL PANEL EDGES AND ENDS OF FLOOR AND ROOF SHEATHING. TOENAIL BLOCKING TO SUPPORTS WITH 16d@12" oc. IN ACCORDANCE WITH SBC SECTION 1604.8.3, DECKS SHALL BE POSITIVELY ANCHORED TO THE STRUCTURE BY MEANS OTHER THAN NAILS SUBJECT TO WITHDRAWAL. ANCHOR WITH MINIMUM (1) 5516 STRAP AT EACH END ATTACHED TO DECK JOISTS AND TO A SOLID BLOCKING MEMBER WITHIN THE BUILDING.

- D. NAILING: A MINIMUM NAIL DIAMETER AND LENGTH SHALL BE AS FOLLOWS:
NAIL SIZE ON DRAWINGS DIAMETER x LENGTH
SHEATHING NAILS 8d 0.131" x 2 1/2"
10d 0.148" x 2 1/2"
FRAMING NAILS 10d 0.148" x 3"
16d 0.148" x 3 1/2"

- E. WOOD SHRINKAGE: THE PLUMBING, FIRE PROTECTION, DRAINAGE, MECHANICAL, ELECTRICAL, CLADDING, AND OTHER SYSTEMS INSTALLED WITHIN THE BUILDING SHALL BE DESIGNED AND CONSTRUCTED TO ACCOMMODATE VERTICAL SHRINKAGE AT ALL WOOD FRAMING LEVELS. THE WOOD SHRINKAGE AMOUNT SHALL BE ESTIMATED TO EQUAL $\frac{1}{8}"$ FOR EACH WOOD FRAMED FLOOR LEVEL.


Minimum Connectors and Fasteners for Wood Members per IBC 2021

DESCRIPTION OF BLDG. ELEMENT	NUMBER AND TYPE OF FASTENERS	SPACING & LOCATION
ROOF		
1. BLOCKING BETWEEN CEILING JOISTS, RAFTERS, OR TRUSSES TO TOP PLATE OR OTHER FRAMING BELOW	3-8d COMMON (2 1/2" x 0.131"); or 3-10d BOX (3" x 0.128"); or 4-3" x 0.131" NAILS; or 3-3" x 14 GAGE STAPLES, 3/16" CROWN	EACH END, TOENAIL
BLOCKING BETWEEN RAFTERS OR TRUSS NOT AT THE WALL TOP PLATE, TO RAFTER OR TRUSS	2-8d COMMON (2 1/2" x 0.131") 2-3" x 0.131" NAILS 2-3" x 14 GAGE STAPLES 2-16d COMMON (3 1/2" x 0.162") 3-3" x 0.131" NAILS 3-3" x 14 GAGE STAPLES	EACH END, TOENAIL END NAIL
FLAT BLOCKING TO TRUSS AND WEB FILLER	16d COMMON (3 1/2" x 0.162") @ 6" oc 3" x 0.131" NAILS @ 6" oc 3" x 14 GAGE STAPLES @ 6" oc	FACE NAIL
2. CEILING JOISTS TO TOP PLATE	3-8d COMMON (2 1/2" x 0.131"); or 3-10d BOX (3" x 0.128"); or 3-3" x 0.131" NAILS; or 3-3" x 14 GAGE STAPLES, 3/16" CROWN	EACH JOIST, TOENAIL
3. CEILING JOIST NOT ATTACHED TO PARALLEL RAFTER, LAPS OVER PARTITION (NO THRUST) (SEE 2308.7.3.1, TABLE 2308.7.3.1)	3-16d COMMON (3 1/2" x 0.162"); or 4-10d BOX (3" x 0.128"); or 4-3" x 0.131" NAILS; or 4-3" x 14 GAGE STAPLES, 3/16" CROWN	FACE NAIL
4. CEILING JOIST ATTACHED TO PARALLEL RAFTER (HEEL JOINT)	PER TABLE 2308.7.3.1	FACE NAIL
5. COLLAR TIE TO RAFTER	3-10d COMMON (3" x 0.148"); or 4-10d BOX (3" x 0.128"); or 4-3" x 0.131" NAILS; or 4-3" x 14 GAGE STAPLES, 3/16" CROWN	FACE NAIL
6. RAFTER OR ROOF TRUSS TO TOP PLATE (SEE 2308.7.5, TABLE 2308.7.5)	3-10d COMMON (3" x 0.148"); or 3-16d BOX (3 1/2" x 0.135"); or 4-10d BOX (3" x 0.128"); or 4-3" x 0.131" NAILS; or 4-3" x 14 GAGE STAPLES, 3/16" CROWN	TOENAIL
7. RAFTER TO RIDGE VALLEY OR HIP RAFTERS; OR ROOF RAFTER TO 2" RIDGE BEAM	2-16d COMMON (3 1/2" x 0.162"); or 3-10d BOX (3" x 0.128"); or 3-3" x 0.131" NAILS; or 3-3" x 14 GAGE STAPLES, 3/16" CROWN 3-10d COMMON (3 1/2" x 0.148"); or 3-16d BOX (3 1/2" x 0.135"); or 4-10d BOX (3" x 0.128"); or 4-3" x 0.131" NAILS; or 4-3" x 14 GAGE STAPLES, 3/16" CROWN	END NAIL TOENAIL
WALL		
8. STUD TO STUD (NOT AT SHEARWALL CHORDS)	16d COMMON (3 1/2" x 0.162")"	24" oc FACE NAIL
	10d BOX (3" x 0.128"); or 3" x 0.131" NAILS; or 3-3" x 14 GAGE STAPLES, 3/16" CROWN	16" oc FACE NAIL
9. STUD TO STUD AND ABUTTING STUDS AT INTERSECTION WALL CORNERS	16d COMMON (3 1/2" x 0.162")"; or 16d BOX (3 1/2" x 0.135"); or 3" x 0.131" NAILS; or 3-3" x 14 GAGE STAPLES, 3/16" CROWN	16" oc FACE NAIL 12" oc FACE NAIL 12" oc FACE NAIL
10. BUILT-UP HEADER (2" TO 2" HDR.)	16d COMMON (3 1/2" x 0.162")"; or 16d BOX (3 1/2" x 0.135")	16" oc EA. EDGE, FACE NAIL 12" oc EA. EDGE, FACE NAIL
11. CONTINUOUS HEADER TO STUD	4-8d COMMON (2 1/2" x 0.131"); or 4-10d BOX (3" x 0.128")	TOENAIL
12. TOP PLATE TO TOP PLATE	16d COMMON (3 1/2" x 0.162"); or 10d BOX (3" x 0.128"); or 3" x 0.131" NAILS; or 3" x 14 GAGE STAPLES, 3/16" CROWN	16" oc FACE NAIL 12" oc FACE NAIL
13. TOP PLATE TO TOP PLATE, AT END JOINTS	8-16d COMMON (3 1/2" x 0.162"); or 12-10d BOX (3" x 0.128"); or 12-3" x 0.131" NAILS; or 12-3" x 14 GAGE STAPLES, 3/16" CROWN	EACH SIDE OF END JOINT, FACE NAIL (MINIMUM 24" LAP SPLICE LENGTH EA. SIDE OF END JOINT)
14. BOTTOM PLATE TO JOIST, RIM JOIST, BAND JOIST, OR BLOCKING NOT AT SHEARWALL	16d COMMON (3 1/2" x 0.162")"; or 16d BOX (3 1/2" x 0.135"); or 3" x 0.131" NAILS; or 3" x 14 GAGE STAPLES, 3/16" CROWN	16" oc FACE NAIL 12" oc FACE NAIL

DESCRIPTION OF BLDG. ELEMENT	NUMBER AND TYPE OF FASTENERS	SPACING & LOCATION
WALL (CONTINUED)		
15. BOTTOM PLATE TO JOIST, RIM JOIST, BAND JOIST, OR BLOCKING AT SHEARWALL	2-16d COMMON (3½" x 0.162"); or 3-16d BOX (3½" x 0.135"); or 4-3" x 0.131" NAILS; or 4-3" x 14 GAGE STAPLES, ⅜" CROWN	16" oc FACE NAIL
16. STUD TO TOP OR BOTTOM PLATE	4-8d COMMON (2½" x 0.131"); or 4-10d BOX (3" x 0.128"); or 4-3" x 0.131" NAILS; or 4-3" x 14 GAGE STAPLES, ⅜" CROWN	TOENAIL
	2-16d COMMON (3½" x 0.162"); or 3-10d BOX (3" x 0.128"); or 3-3" x 0.131" NAILS; or 3-3" x 14 GAGE STAPLES, ⅜" CROWN	END NAIL
17. TOP OR BOTTOM PLATE TO STUD	2-16d COMMON (3½" x 0.162"); or 3-10d BOX (3" x 0.128"); or 3-3" x 0.131" NAILS; or 3-3" x 14 GAGE STAPLES, ⅜" CROWN	END NAIL
18. TOP PLATES, LAPS AT CORNERS AND INTERSECTIONS	2-16d COMMON (3½" x 0.162"); or 3-10d BOX (3" x 0.128"); or 3-3" x 0.131" NAILS; or 3-3" x 14 GAGE STAPLES, ⅜" CROWN	FACE NAIL
19. 1" BRACE TO EACH STUD AND PLATE	2-8d COMMON (2½" x 0.131"); or 2-10d BOX (3" x 0.128"); or 2-3" x 0.131" NAILS; or 2-3" x 14 GAGE STAPLES, ⅜" CROWN	FACE NAIL
20. 1" x 6" SHEATHING TO EACH BEARING	2-8d COMMON (2½" x 0.131"); or 2-10d BOX (3" x 0.128"); or	FACE NAIL
21. 1" x 8" AND WIDER SHEATHING TO EACH BEARING	3-8d COMMON (2½" x 0.131"); or 3-10d BOX (3" x 0.128"); or	FACE NAIL
FLOOR		
22. JOIST TO SILL, TOP PLATE, OR GIRDER	3-8d COMMON (2½" x 0.131"); or 3-10d BOX (3" x 0.128"); or 3-3" x 0.131" NAILS; or 3-3" x 14 GAGE STAPLES, ⅜" CROWN	TOENAIL
23. RIM JOIST, BAND JOIST, OR BLOCKING TO TOP PLATE, SILL, OR OTHER FRAMING BELOW	8d COMMON (2½" x 0.131"); or 10d BOX (3" x 0.128"); or 3" x 131" NAILS; or 3" x 14 GAGE STAPLES, ⅜" CROWN	6" o.c., TOENAIL
24. 1" x 6" SUBFLOOR OR LESS TO EACH JOIST	2-8d COMMON (2½" x 0.131"); or 2-10d BOX (3" x 0.128")	FACE NAIL
25. 2" SUBFLOOR TO JOIST OR GIRDER	2-16d COMMON (3½" x 0.162")	FACE NAIL
26. 2" PLANKS (PLANK & BEAM - FLOOR & ROOF)	2-16d COMMON (3½" x 0.162")	EA. BEARING, FACE NAIL
27. BUILT-UP GIRDERS AND BEAMS, 2" LUMBER LAYERS	20d COMMON (4" x 0.192")	32" o.c., FACE NAIL AT TOP & BOT. STAGGERED ON OPPOSITE SIDES
	10d BOX (3" x 0.128"); or 3" x 0.131" NAILS; or 3" x 14 GAGE STAPLES, ⅜" CROWN	24" o.c., FACE NAIL AT TOP & BOT. STAGGERED ON OPP. SIDES
	AND: 2-20d COMMON (4" x 0.192"); or 3-10d BOX (3" x 0.128"); or 3-3" x 0.131" NAILS; or 3-3" x 14 GAGE STAPLES, ⅜" CROWN	ENDS AND AT EACH SPLICE, FACE NAIL
28. LEDGER STRIP SUPPORTING JOISTS OR RAFTERS	3-16d COMMON (3½" x 0.162"); or 4-10d BOX (3" x 0.128"); or 4-5" x 0.131" NAILS; or 4-5" x 14 GAGE STAPLES, ⅜" CROWN	EACH JOIST OR RAFTER, FACE NAIL
29. JOIST TO BAND JOIST OR RIM JOIST	3-16d COMMON (3½" x 0.162"); or 4-10d BOX (3" x 0.128"); or 4-5" x 0.131" NAILS; or 4-5" x 14 GAGE STAPLES, ⅜" CROWN	END NAIL
30. BRIDGING OR BLOCKING TO JOIST, RAFTER, OR TRUSS	2-8d COMMON (2½" x 0.131"); or 2-10d BOX (3" x 0.128"); or 2-3" x 0.131" NAILS; or 2-3" x 14 GAGE STAPLES, ⅜" CROWN	EACH END, TOENAIL




	CONCRETE FOOTING
	CONCRETE WALL
	POST
$F_{\dots}$	SPREAD FOOTING PER 5/S3.1
	DENOTES TOP OF FOOTING ELEVATION (+)

	SIMPSON DESIGNATION	NOTES
(A)	CBS	POST BASE
(B)	JB ~~~~ LUS	HANGER
(C)	ITS ~~~~ IUS	HANGER
(D)	EQG5.37~SDS (H=11%)	TOP FLANGE HANGER
(E)	ECCLQ ASSEMBLY	BACK-TO-BACK COLDS JOINTS MUST BE COATED WITH EPOXY - SEE K9.2.2
(F)	HGLTV ~~~~ HGU	HANGER
(G)	CCQ	HANGER
(H)	EC09	END POST CAP
(I)	EC966	ELEVATED COLUMN BASE
(J)	AC62	POST CAP (ONE SIDE)
(K)	HUC48	CONCEALED FLANGE HANGER

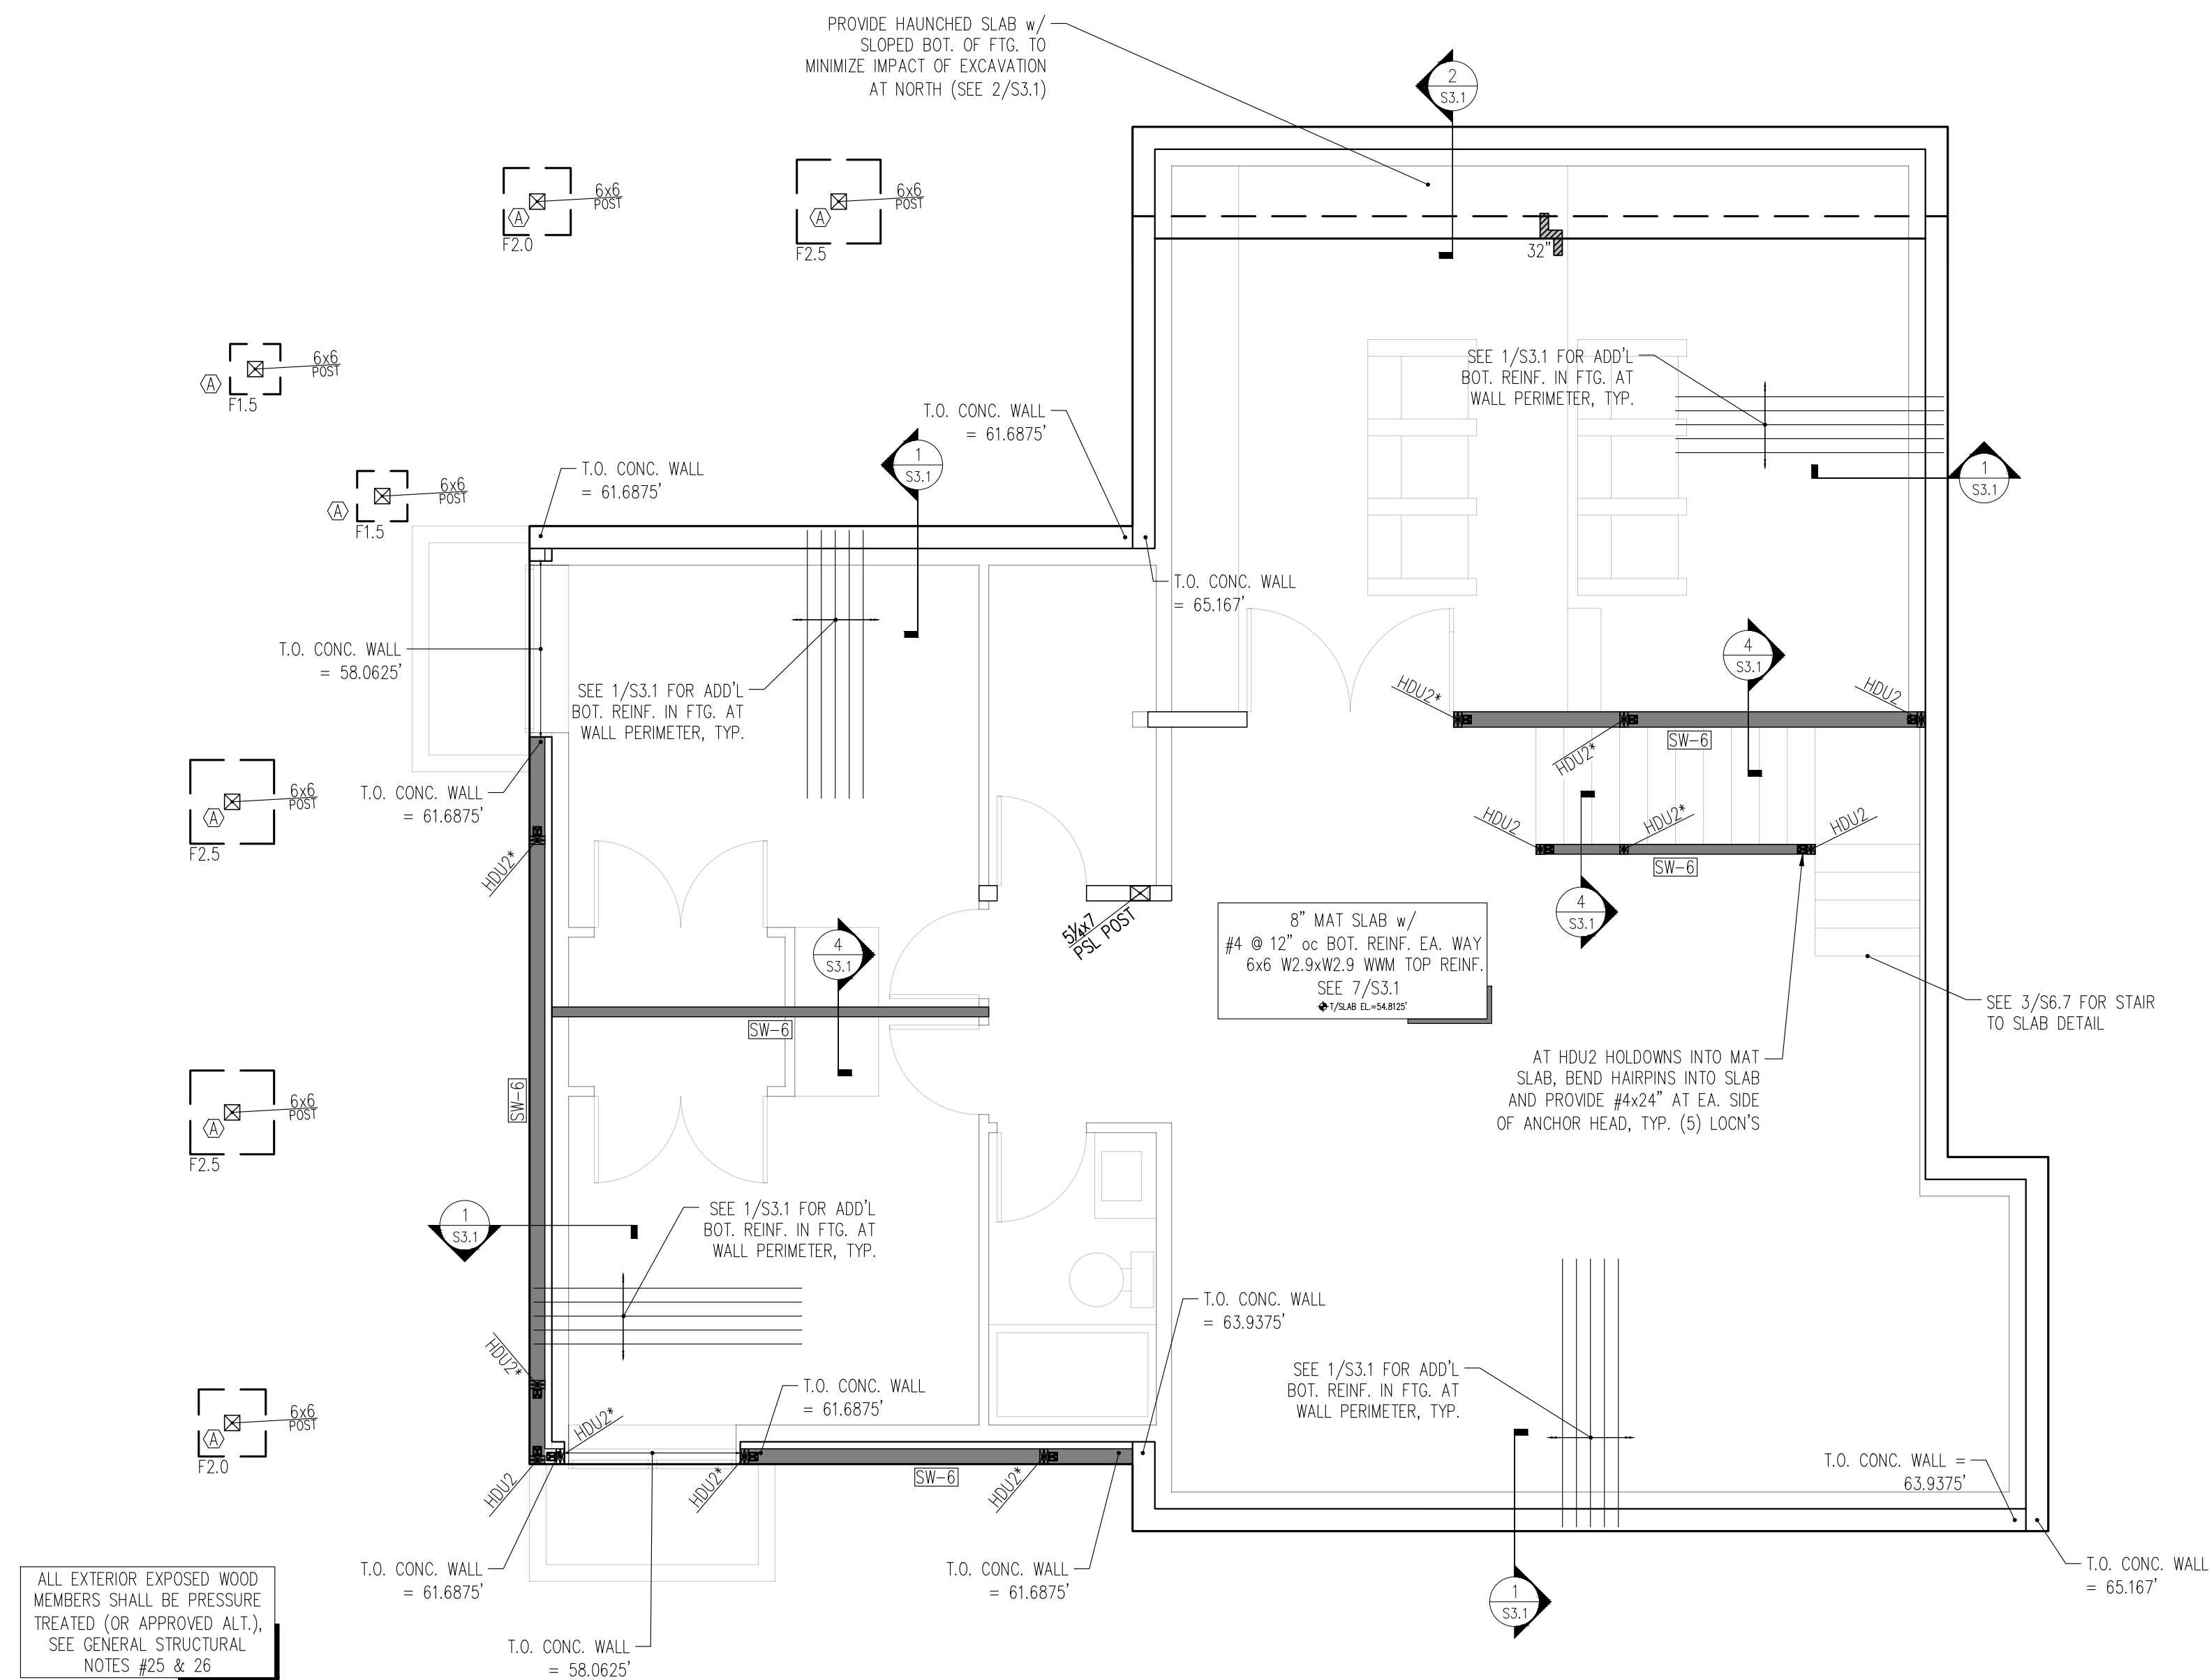

1. SOLID WALLS SHOWN IN PLAN ARE ABOVE FOUNDATION LEVEL (FROM FOUNDATION TO UNDERSIDE OF MAIN FLOOR FRAMING).
2. EXTERIOR STUDWALLS SHALL BE 2x6 STUDS @ 16" oc (MAX). SEE ARCHITECTURAL FOR INTERIOR STUDWALLS. SEE 6/6.2, 5/56.2, AND 2/56.2 FOR ALLOWABLE HOLES & NOTCHES IN STUDWALL STUDS AND TOP & BOTTOM PLATES.
3. SEE STRUCTURAL GENERAL NOTES #14 - 19 FOR CONCRETE AND CONCRETE REINFORCING REQUIREMENTS.
4. SEE GENERAL STRUCTURAL NOTE #11 FOR FOUNDATION CRITERIA.

1 LOWER FLOOR AND FOUNDATION PLAN
S2.1 1/4" = 1'-0"

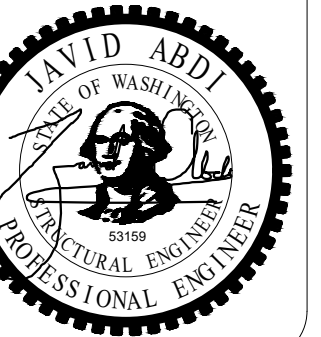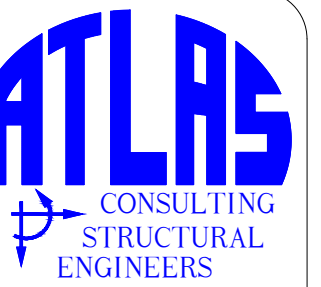

Yageneh Residence
3029 62nd Ave SE - Mercer Island

oundation
lan

DA


5.27.24

S2.1

LEGEND

	CONCRETE WALL BELOW		DENOTES EXTENT OF SHEARWALL TYPE SW- PER 1/S6.5
	CONCRETE WALL		DENOTES STRAPPED SHEARWALL PER 7/S6.6, WITH C DENOTING STRAP PER SCHEDULE ABOVE & BELOW OPENING
	STRUCTURAL WOOD STUDWALL		DENOTES SHEARWALL TENSION TIE PER 4/S6.6 OR 8/S6.6
	POST BELOW		* - DENOTES TRANSFER TIE FROM TIE ABOVE + - DENOTES TIE ATOP STEEL BEAM, SEE 8/S6.6
	POST		
	HEADER or BEAM		
	JOIST		

CONNECTOR TABLE		
SIMPSON DESIGNATION	NOTES	
(A)	CBS	POST BASE
(B)	JB ~or~ LUS	HANGER
(C)	ITS ~or~ IUS	HANGER
(D)	EQG5.37-SDS (H=11 1/8)	TOP FLANGE HANGER
(E)	ECCLO ASSEMBLY	BACK-TO-BACK ELEVATED POST CAPS, BEARD TO ORANGE OFFSET BEAM SEAT - SEE 4/S6.3
(F)	HGLTV ~or~ HGU	HANGER
(G)	CCQ	HANGER
(H)	ECCQ	END POST CAP
(I)	ECB66	ELEVATED COLUMN BASE
(J)	AC6Z	POST CAP (ONE SIDE)
(K)	HUC48	CONCEALED FLANGE HANGER

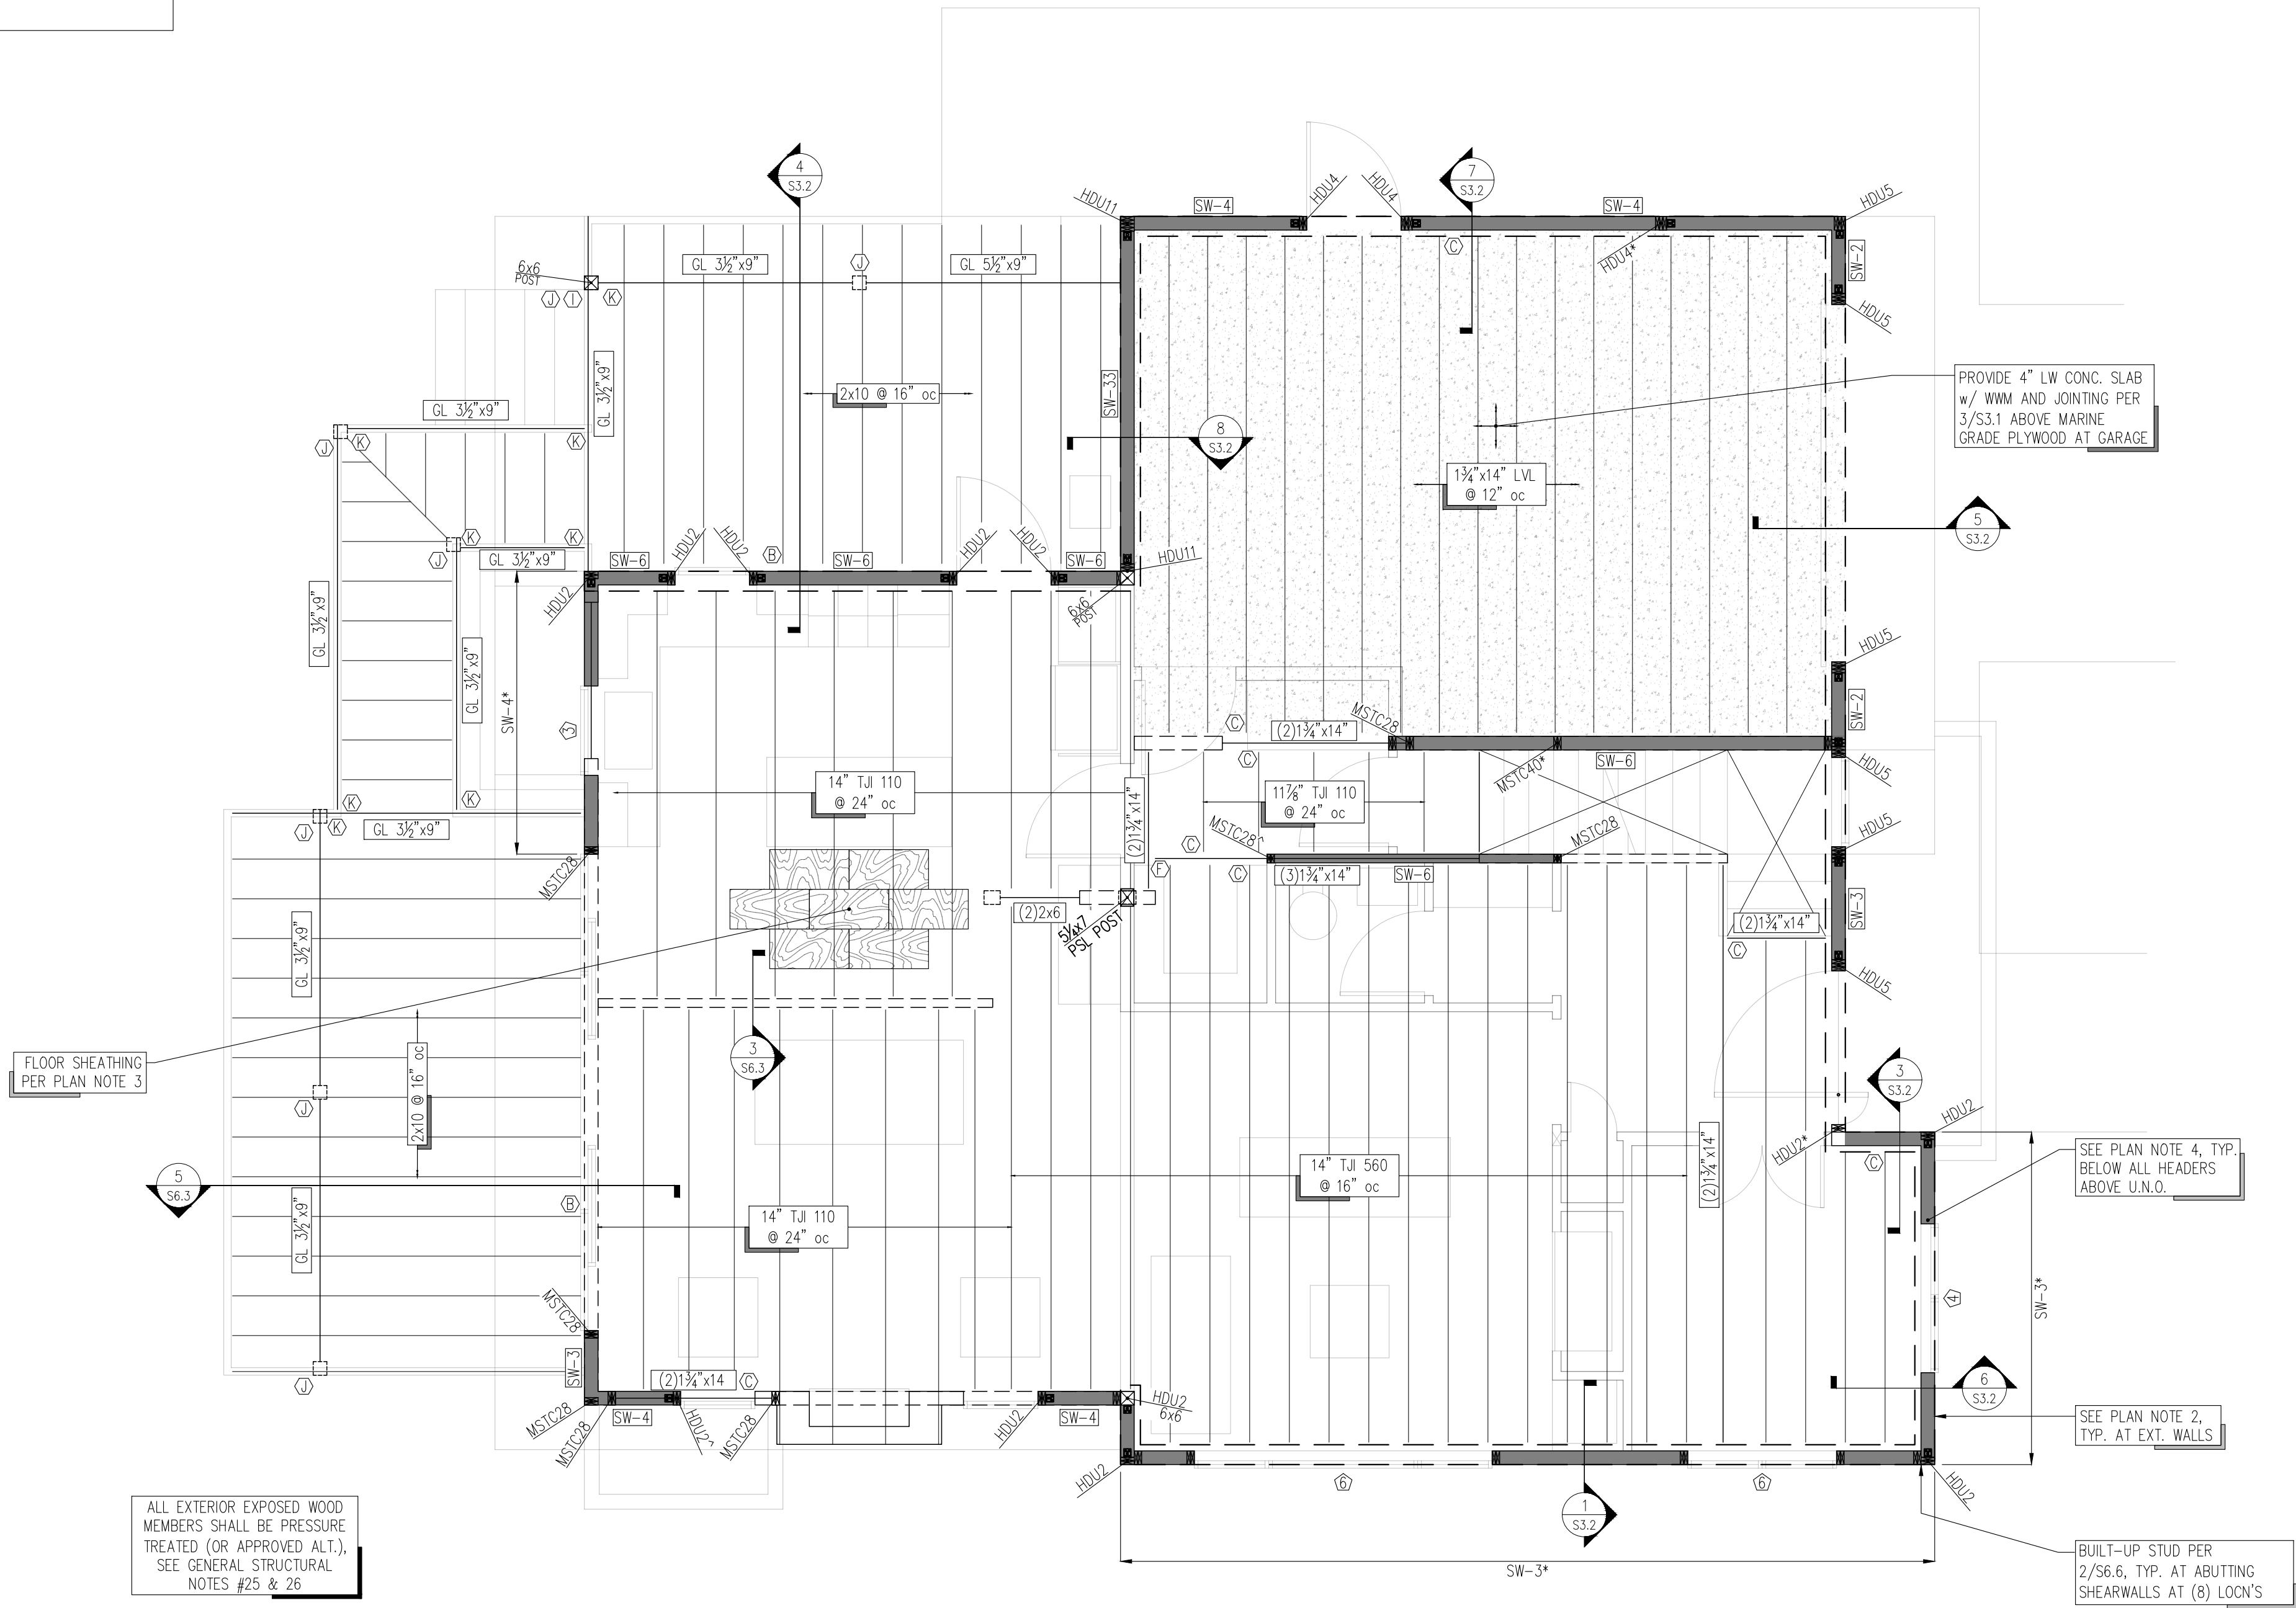




MAIN FLOOR FRAMING PLAN NOTES

- SOLID WALLS SHOWN IN PLAN ARE ABOVE MAIN FLOOR FRAMING ELEVATION (FROM MAIN FLOOR TO UNDERSIDE OF UPPER FLOOR). DASHED WALLS SHOWN IN PLAN ARE BELOW MAIN FLOOR FRAMING ELEVATION (FROM FOUNDATION TO UNDERSIDE OF MAIN FLOOR FRAMING).
- EXTERIOR STUDWALLS SHALL BE 2x6 STUDS @ 16" oc (MAX). SEE ARCHITECTURAL FOR INTERIOR STUDWALLS. SEE 6/6.2, 5/S6.2, AND 2/S6.2 FOR ALLOWABLE HOLES & NOTCHES IN STUDWALL STUDS AND TOP & BOTTOM PLATES.
- FLOOR SHEATHING SHALL CONSIST OF 3/4" T&G SHEATHING (PANEL SPAN RATING 48/24). NAIL SHEATHING AT ALL FRAMED PANEL EDGES, DIAPHRAGM BOUNDARIES, AND SHEAR WALLS w/ 10d @ 6" oc; AND AT ALL INTERMEDIATE SUPPORTS w/ 10d @ 12" oc (SEE 3/S6.1). GLUE SHEATHING AT ALL SUPPORTS w/ ADHESIVE CONFORMING TO ASTM SPECIFICATION D3498.
- ALL HEADERS ABOVE (SEE 1/S2.3) SHALL HAVE A MINIMUM NUMBER OF POSTS PER 4/S6.2 AT NON-LOAD BEARING EXTERIOR WALLS, AND PER 6/S6.2 AT LOAD BEARING EXTERIOR WALLS.

1
S2.2

MAIN FLOOR FRAMING PLAN

1/4" = 1'-0"

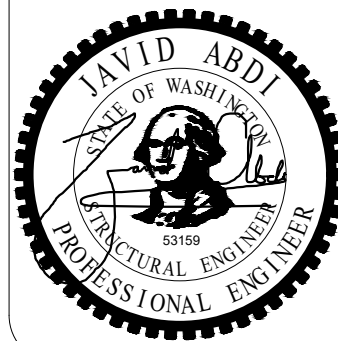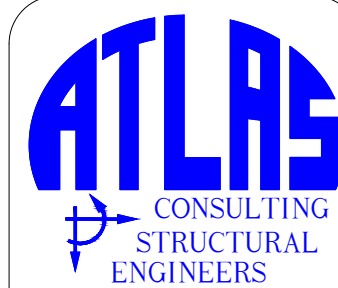

Yageneh Residence
3029 62nd Ave SE - Mercer Island

CONTENTS

Main Floor
Framing Plan

DRAWN BY





JDA

DATE


05.27.24

S2.2

LEGEND

	STRUCTURAL WOOD STUDWALL BELOW		DENOTES EXTENT OF SHEARWALL TYPE SW- PER 1/S6.5
	STRUCTURAL WOOD STUDWALL		DENOTES STRAPPED SHEARWALL PER 7/S6.6, WITH  DENOTING STRAP PER SCHEDULE ABOVE & BELOW OPENING
	POST BELOW		DENOTES SHEARWALL TENSION TIE PER 4/S6.6 OR 8/S6.6
	POST		* - DENOTES TRANSFER TIE FROM TIE ABOVE * - DENOTES TIE AT TOP STEEL BEAM, SEE 8/S6.6
	HEADER or BEAM		
	JOIST		

CONNECTOR TABLE		
SIMPSON DESIGNATION	NOTES	
(A) CBS	POST BASE	
(B) JB ~or~ LUS	HANGER	
(C) ITS ~or~ IUS	HANGER	
(D) EQ05.37~SDS (H=11 1/2")	TOP FLANGE HANGER	
(E) ECCLQ ASSEMBLY	BACK-TO-BACK ECCQ POST CAPS NEEDED TO CURE OFF SET STUD CAP - SEE 8/S6.5	
(F) HGLTV ~or~ HGU	HANGER	
(G) CCQ	HANGER	
(H) ECCQ	END POST CAP	
(I) ECB66	ELEVATED COLUMN BASE	
(J) AC6Z	POST CAP (ONE SIDE)	
(K) HUC48	CONCEALED FLANGE HANGER	

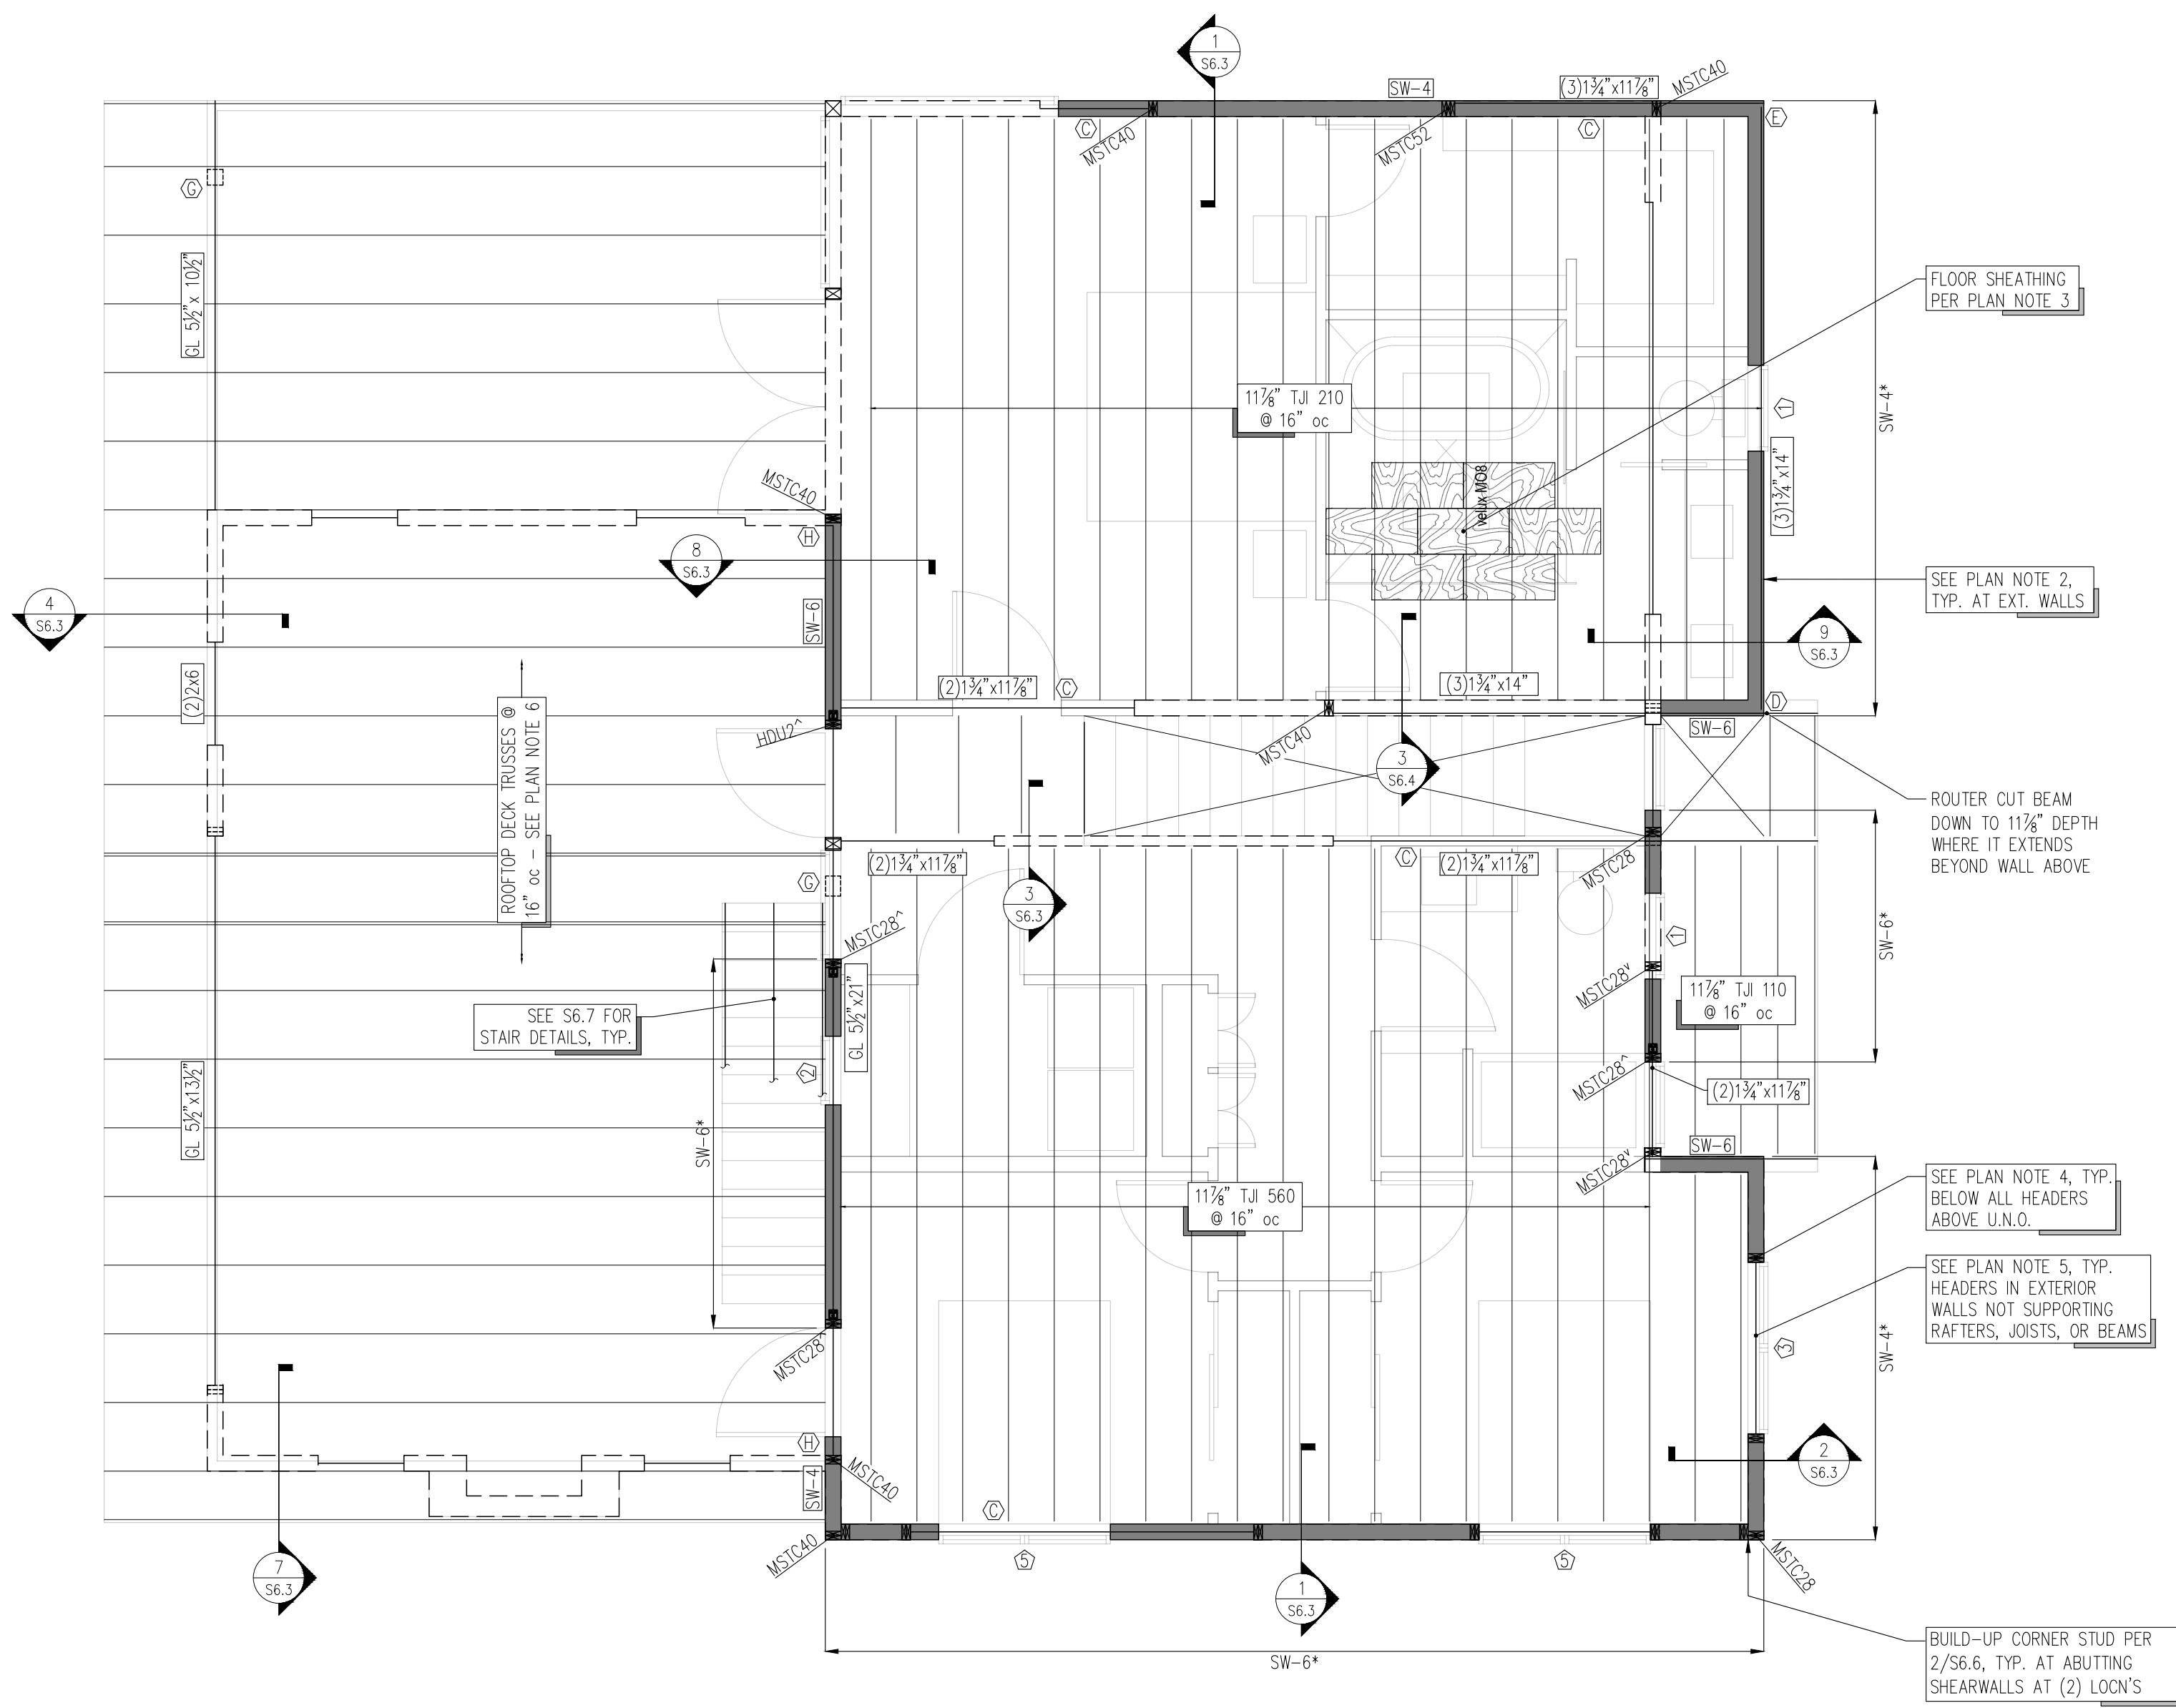

- MAIN FLOOR FRAMING PLAN NOTES
- SOLID WALLS SHOWN IN PLAN ARE ABOVE MAIN FLOOR FRAMING ELEVATION (FROM UPPER FLOOR TO UNDERSIDE OF ROOF). DASHED WALLS SHOWN IN PLAN ARE BELOW UPPER FLOOR FRAMING ELEVATION (FROM MAIN FLOOR TO UNDERSIDE OF UPPER FLOOR FRAMING)
 - EXTERIOR STUDWALLS SHALL BE 2x6 STUDS @ 16" oc (MAX). SEE ARCHITECTURAL FOR INTERIOR STUDWALLS. SEE 6/6.2, 5/S6.2, AND 2/S6.2 FOR ALLOWABLE HOLES & NOTCHES IN STUDWALL STUDS AND TOP & BOTTOM PLATES.
 - FLOOR SHEATHING SHALL CONSIST OF 3/4" T&G SHEATHING (PANEL SPAN RATING 48/24). NAIL SHEATHING AT ALL FRAMED PANEL EDGES, DIAPHRAGM BOUNDARIES, AND SHEAR WALLS w/ 10d @ 6" oc; AND AT ALL INTERMEDIATE SUPPORTS w/ 10d @ 12" oc (SEE 3/S6.1). GLUE SHEATHING AT ALL SUPPORTS w/ ADHESIVE CONFORMING TO ASTM SPECIFICATION D3498.
 - ALL HEADERS ABOVE (SEE 1/S2.3) SHALL HAVE A MINIMUM NUMBER OF POSTS PER 4/S6.2 AT NON-LOAD BEARING EXTERIOR WALLS, AND PER 6/S6.2 AT LOAD BEARING EXTERIOR WALLS
 - HEADERS IN EXTERIOR WALLS NOT SUPPORTING RAFTERS, JOISTS, OR BEAMS SHALL BE PER DETAIL 4/S6.1 U.N.O. IN PLAN.

1
S2.3
UPPER FLOOR FRAMING PLAN
1/4" = 1'-0"



Yageneh Residence
3029 62nd Ave SE - Mercer Island

CONTENTS
Upper Floor
Framing Plan


DRAWN BY
JDA
DATE
05.27.24

S2.3

LEGEND

-----	STRUCTURAL WOOD STUDWALL BELOW
□	POST BELOW
-----	HEADER or BEAM
-----	CONNECTOR PLATE WOOD TRUSS
-----	ROOF FRAMING

CONNECTOR TABLE		
	SIMPSON DESIGNATION	NOTES
(A)	CBS	POST BASE
(B)	JB ~or~ LUS	HANGER
(C)	ITS ~or~ IUS	HANGER
(D)	EG05.37~SDS (H=11½)	TOP FLANGE HANGER
(E)	ECCLQ ASSEMBLY	BACK-TO-BACK ECLQ POST CAPS W/20D TO CRATE FIRST FLOOR JOIST - SEE 4/S6.1
(F)	HGLTV ~or~ HGU	HANGER
(G)	CCQ	HANGER
(H)	ECCQ	END POST CAP
(I)	ECB66	ELEVATED COLUMN BASE
(J)	AC6Z	POST CAP (ONE SIDE)
(K)	HUC48	CONCEALED FLANGE HANGER

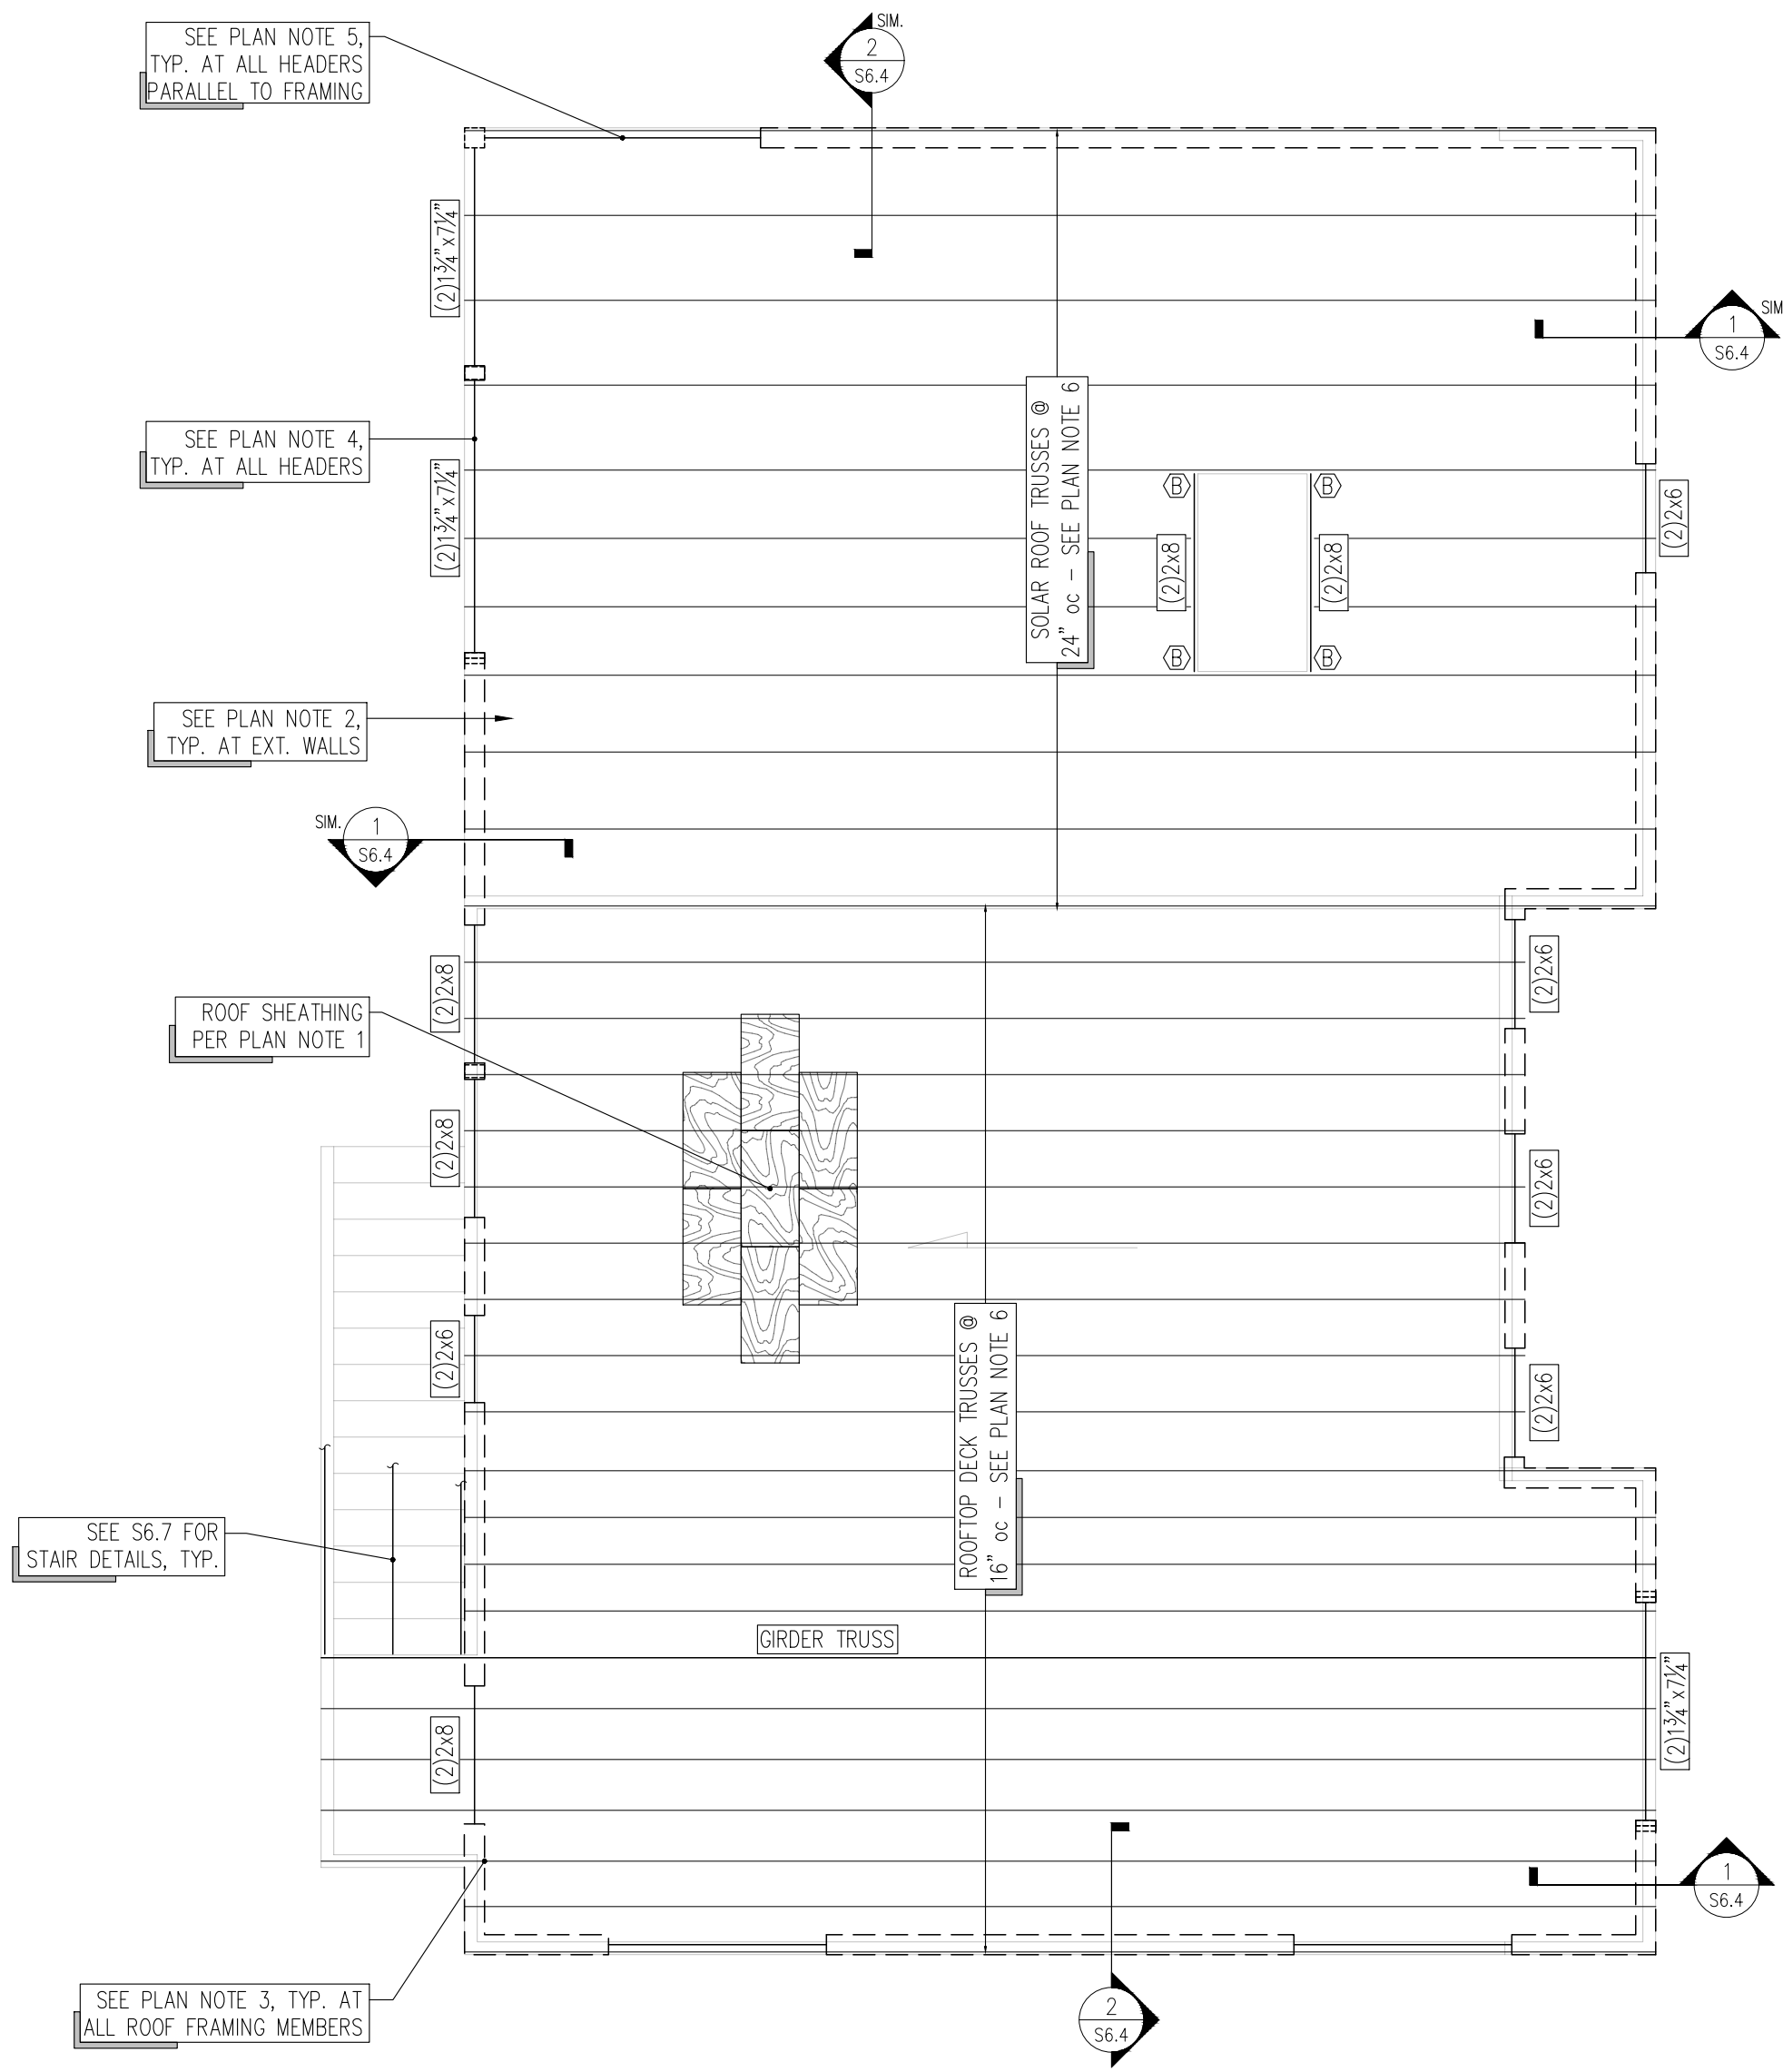




ROOF FRAMING PLAN NOTES

1. ROOF SHEATHING SHALL CONSIST OF 5/8" SHEATHING (PANEL SPAN RATING 32/16) AT NON-ROOF DECK AREAS; AND 3/4" T&G SHEATHING (PANEL SPAN RATING 48/24) AT ROOF DECK AREA. SHEATHING IN EITHER AREA SHALL BE NAILED AT ALL FRAMED PANEL EDGES, DIAPHRAGM BOUNDARIES, AND SHEAR WALLS BELOW w/ 10d @ 6" oc; AND AT ALL INTERMEDIATE SUPPORTS w/ 10d @ 12" oc (SEE 3/S6.2).
2. DASHED WALLS AND SHEARWALLS SHOWN IN PLAN ARE BELOW ROOF FRAMING ELEVATION.
3. PROVIDE H2.5A HURRICANE TIES AT EACH END OF ALL ROOF FRAMING.
4. ALL HEADERS SHALL HAVE A MINIMUM NUMBER OF POSTS PER 4/S6.1 AT NON-LOAD BEARING EXTERIOR WALLS, AND PER 6/S6.1 AT LOAD BEARING EXTERIOR WALLS.
5. HEADERS IN EXTERIOR WALLS NOT SUPPORTING RAFTERS, JOISTS, OR BEAMS SHALL BE PER DETAIL 4/S6.1 U.N.O. IN PLAN.
6. SEE GENERAL STRUCTURAL NOTE #9, 10, AND 22 FOR CONNECTOR PLATE ROOF TRUSS REQUIREMENTS.

1
S2.4

ROOF FRAMING PLAN

1/4" = 1'-0"

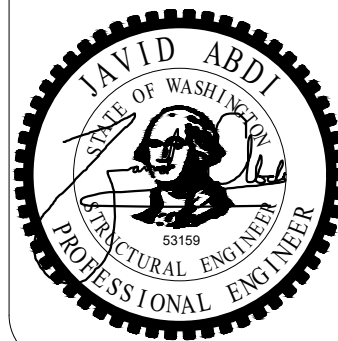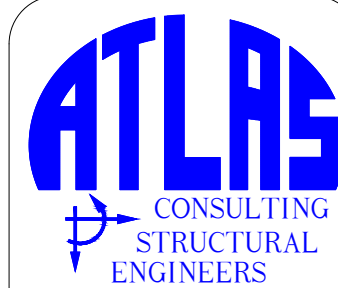

Yageneh Residence
3029 62nd Ave SE - Mercer Island

CONTENTS

Roof
Framing Plan


DRAWN BY

JDA

DATE

05.27.24

S2.4

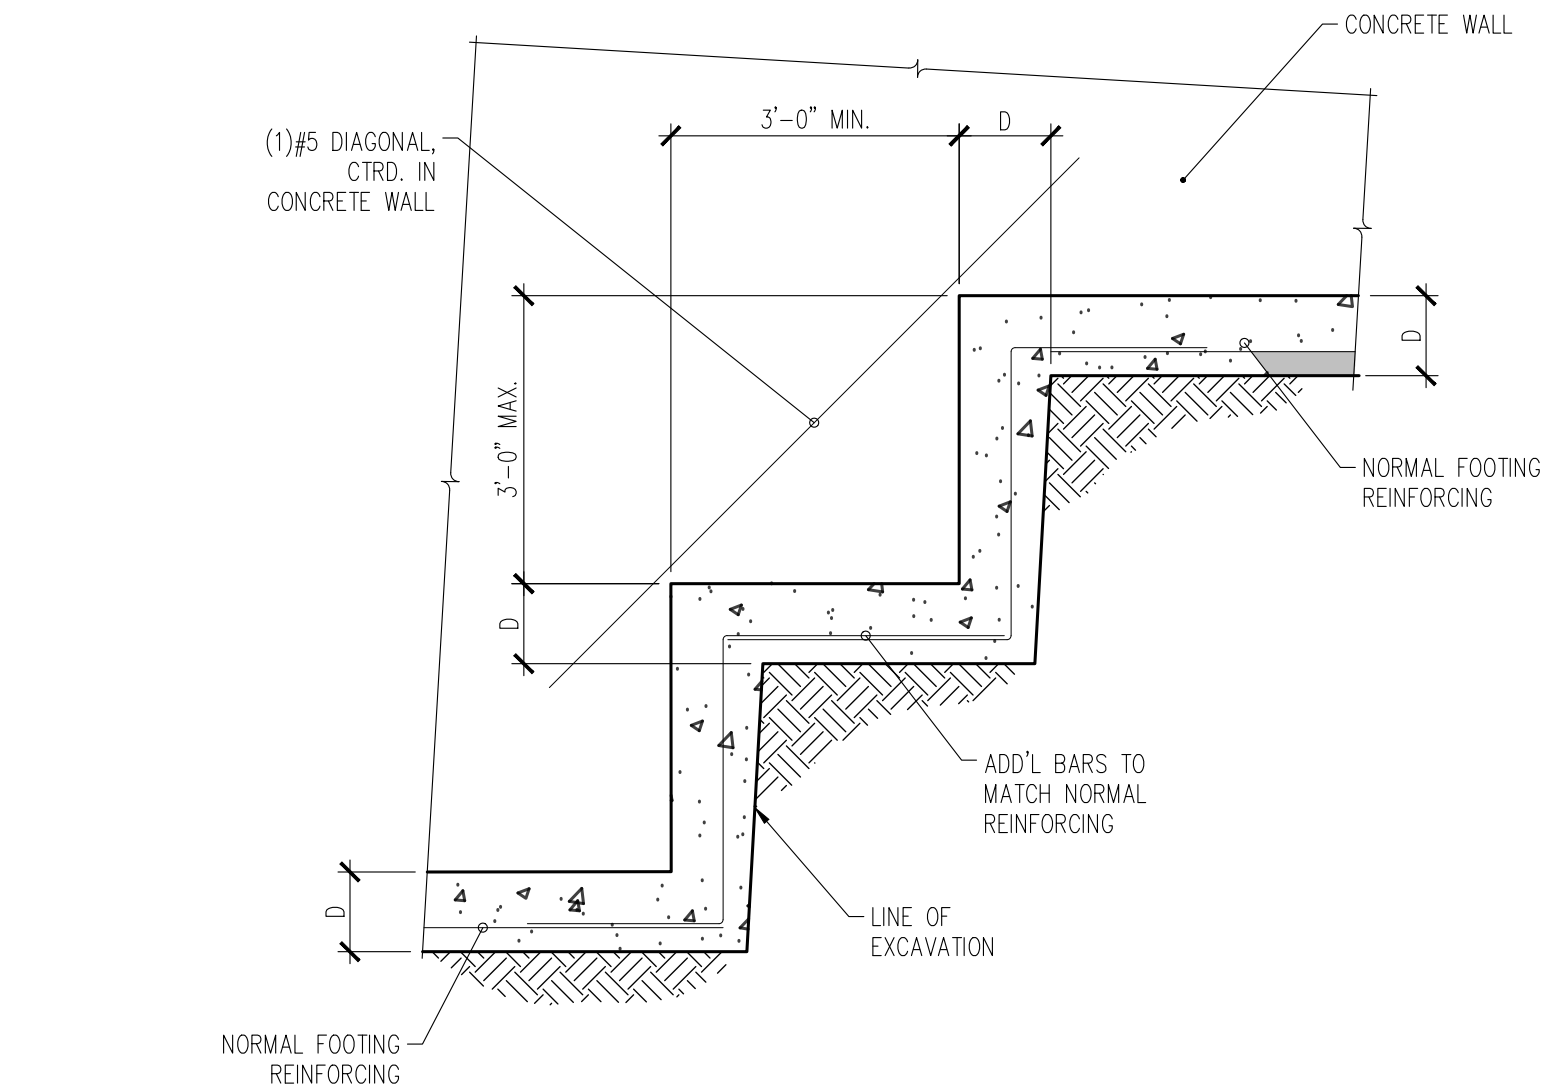

9
S3.1 TYPICAL STEPPED FOOTING
N.T.S.

MIN. STRAIGHT DEVELOPMENT LENGTH		
BAR SIZE	TOP BARS	OTHER BARS
#4	25"	19"
#5	31"	24"
#6	37"	29"
#7	54"	42"

TOP BARS ARE HORIZONTAL BARS WITH MORE THAN 12" DEPTH OF CONCRETE CAST BELOW THEM
IF CLEAR CONCRETE COVER IS LESS THAN 1x THE DIAMETER OF THE BAR OR THE CENTER-TO-CENTER SPACING IS LESS THAN (3) BAR DIAMETERS, THEN VALUES SHALL BE INCREASED BY 50%



MIN. EMBEDMENT LENGTH FOR STANDARD END HOOKS	
BAR SIZE	LENGTH
#4	7"
#5	9"
#6	10"
#7	12"

1. SIDE COVER MUST BE EQUAL TO OR GREATER THAN 2 ϕ
2. END COVER FOR 90° HOOKS MUST BE EQUAL TO OR GREATER THAN 2"

MIN. LAP SPlice LENGTH (CLASS B)		
BAR SIZE	TOP BARS	OTHER BARS
#4	33"	25"
#5	41"	31"
#6	49"	37"
#7	71"	54"


6
S3.1 CONCRETE REINFORCING DEVELOPMENT AND SPlice LENGTH TABLES
N/A

FTG. MARK	DIMENSIONS			REINFORCING DIRECTION	
	LENGTH	WIDTH	DEPTH	SHORT	LONG
F1.5	1'-6"	1'-6"	10"	(2)#4	(2)#4
F2.0	2'-0"	2'-0"	10"	(2)#4	(2)#4
F2.6	2'-6"	2'-6"	10"	(3)#4	(3)#4
F3.0	3'-0"	3'-0"	10"	(3)#4	(3)#4
F3.6	3'-6"	3'-6"	12"	(5)#4	(5)#4

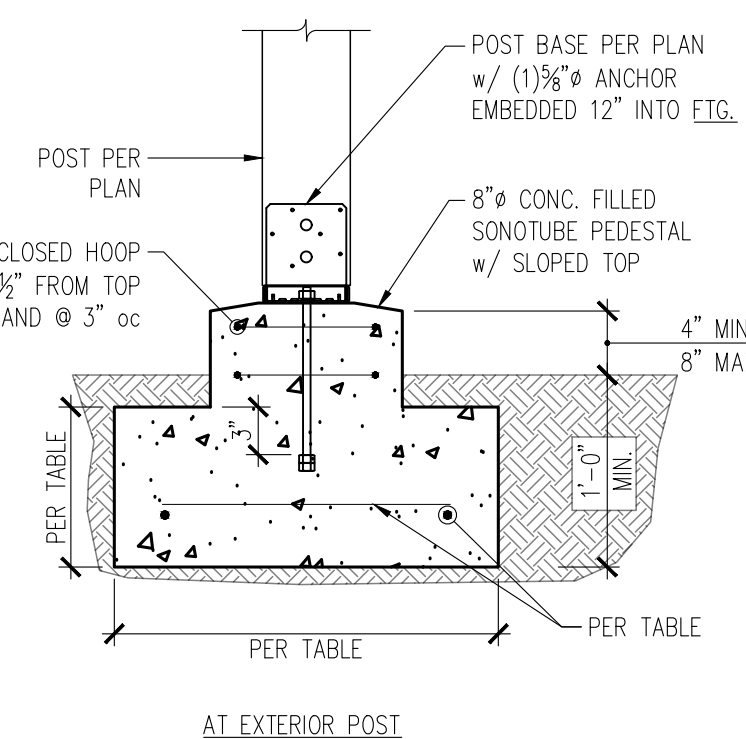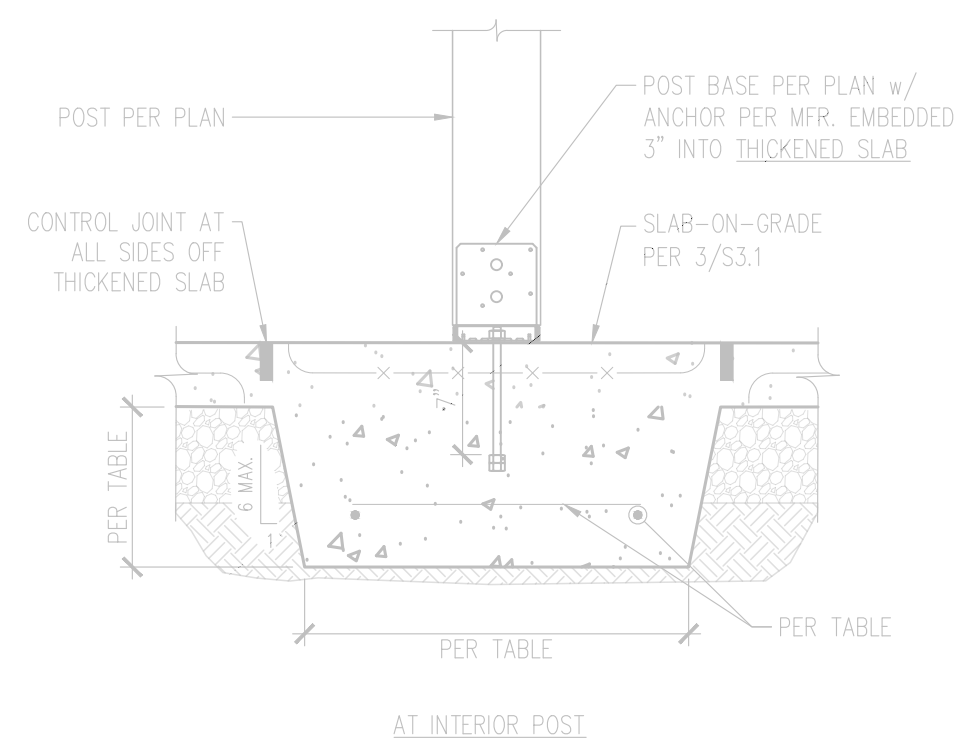


5
S3.1 SPREAD FOOTING
1" = 1'-0"

CONSTRUCTION/CONTROL JOINTS IN SLABS ON GRADE SHALL BE PROVIDED TO DIVIDE SLAB INTO RECTANGULAR AREAS 225 SQUARE FEET OR LESS. AREAS SHALL BE APPROXIMATELY SQUARE AND HAVE NO ACUTE ANGLES. JOINT LOCATIONS MUST BE APPROVED BY THE ARCHITECT

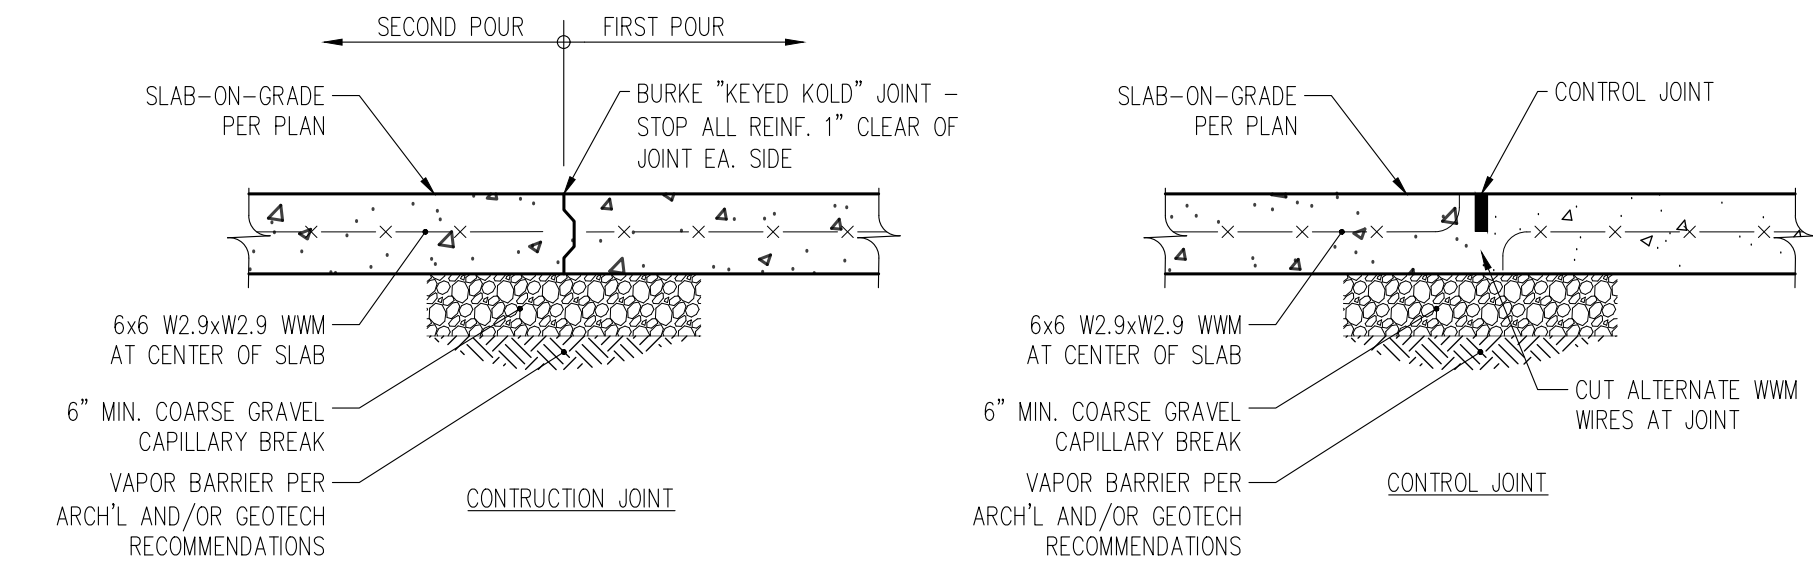


3
S3.1 EXTERIOR SLAB-ON-GRADE JOINTING
1" = 1'-0"

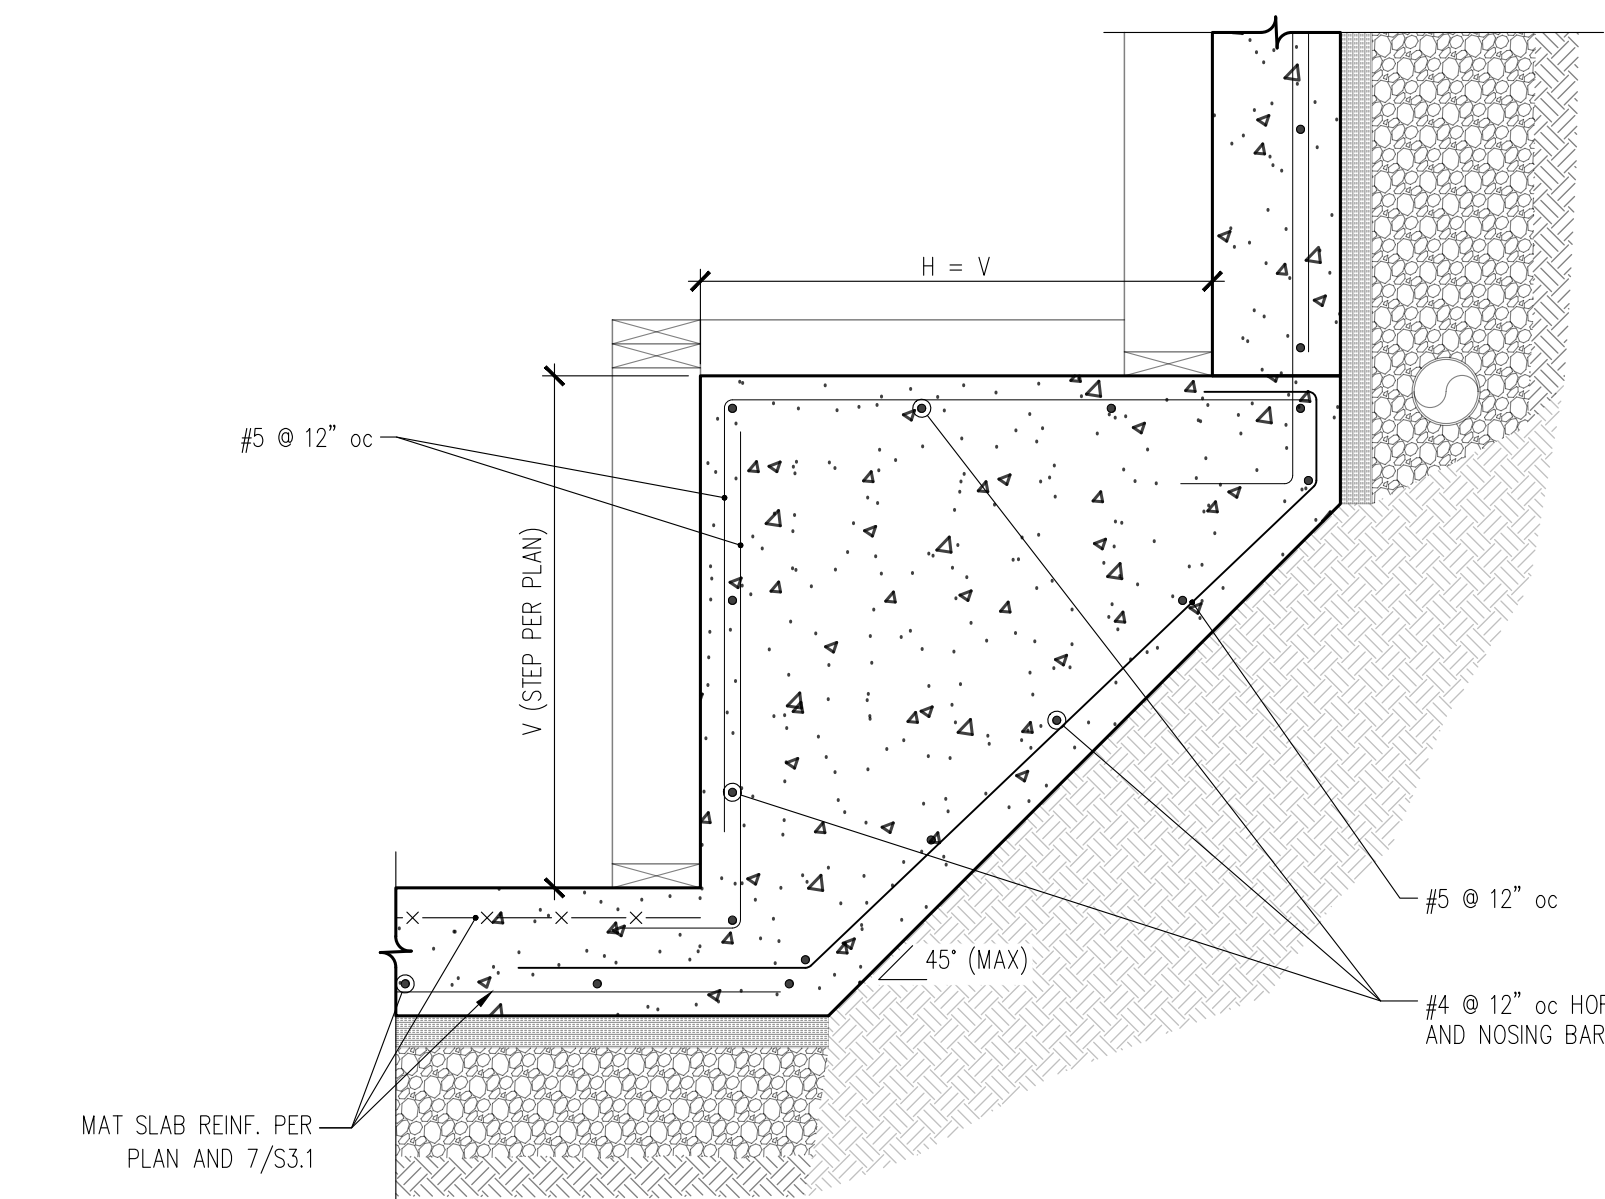

2
S3.1 SECTION THROUGH HAUNCHED MAT SLAB
1" = 1'-0"


WALL AND FOOTING HAVE BEEN DESIGNED AS CANTILEVERED DURING CONSTRUCTION WITH A SOIL PRESSURE OF 35 PCF; AND CANTILEVERED IN PERMANENT CONDITION WITH A SOIL PRESSURE OF 45 PCF AND SEISMIC SURCHARGE OF 8H. WALL IS RESTRAINED FROM SLIDING BY SLAB ON GRADE IN ALL CONDITIONS

WALL HEIGHT	ADDITIONAL FOOTING BOTTOM BARS	DOWELS
< 5'-0"	-	#5 @ 12" oc
< 7'-0"	#5 @ 12" oc x 8'-0"	#5 @ 12" oc
< 9'-0"	#6 @ 5" oc x 10'-0"	#6 @ 10" oc
< 10'-0"	#7 @ 5" oc x 12'-0"	#7 @ 10" oc

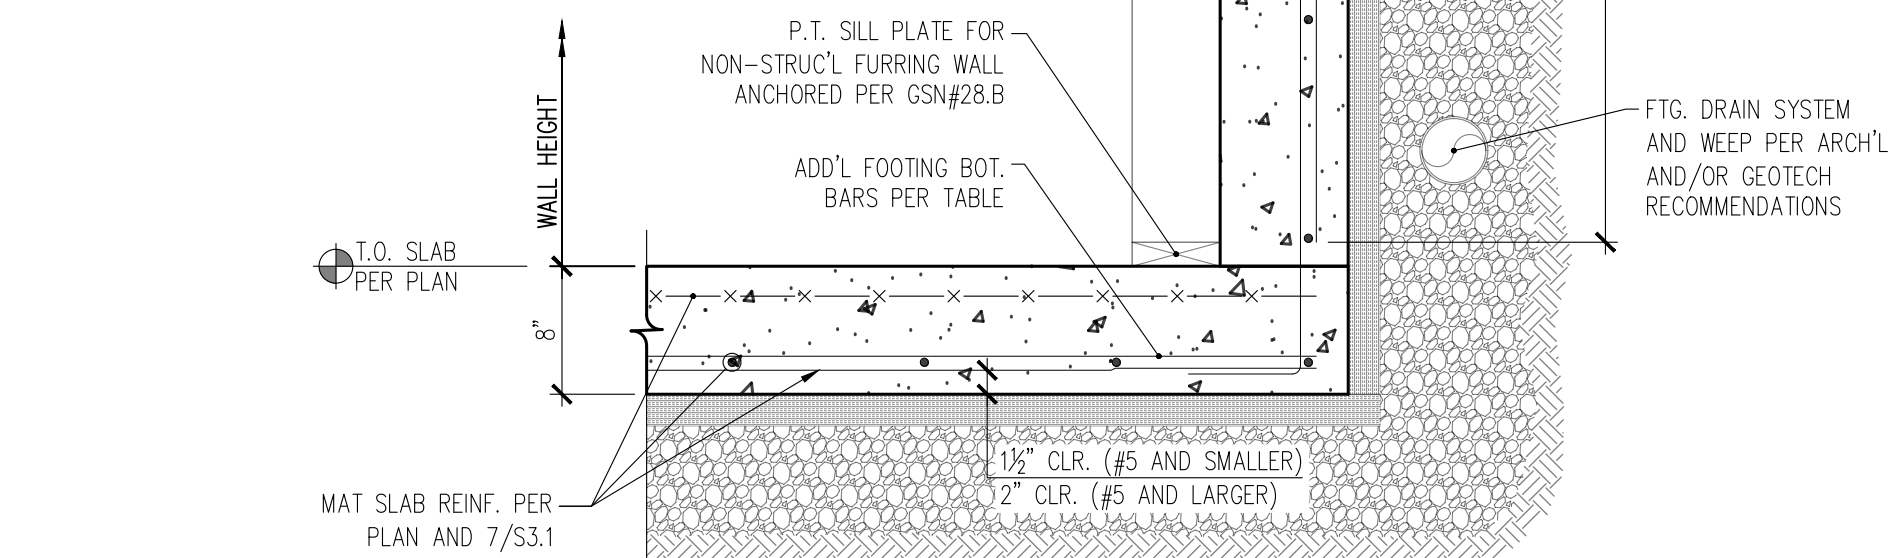


1
S3.1 SECTION THROUGH FOUNDATION WALL
1" = 1'-0"




CONSTRUCTION/CONTROL JOINTS IN SLABS ON GRADE SHALL BE PROVIDED TO DIVIDE SLAB INTO RECTANGULAR AREAS 225 SQUARE FEET OR LESS. AREAS SHALL BE APPROXIMATELY SQUARE AND HAVE NO ACUTE ANGLES. JOINT LOCATIONS MUST BE APPROVED BY THE ARCHITECT. SEE 3/S3.1

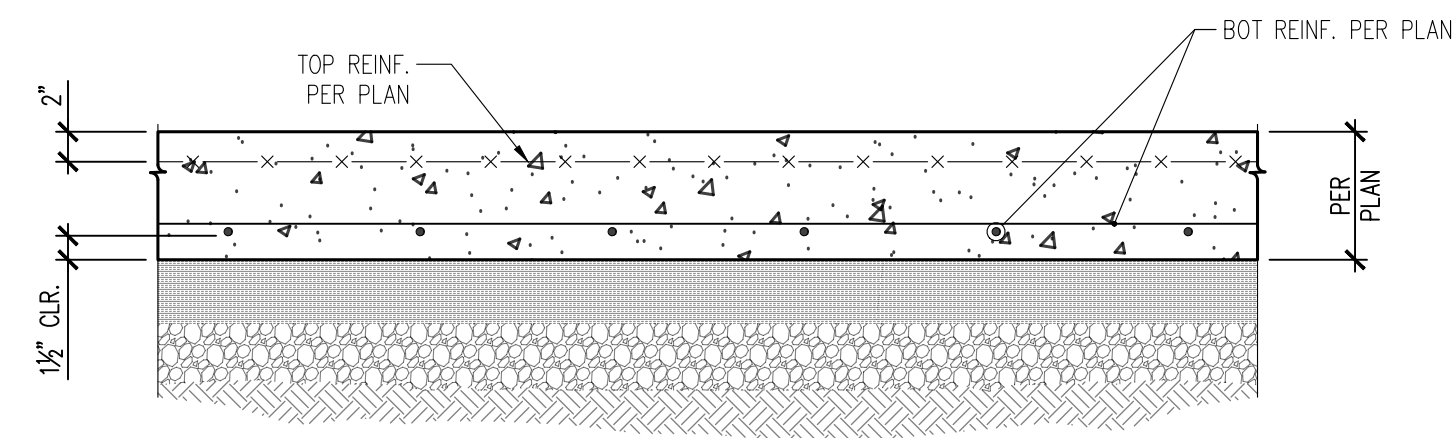

7
S3.1 SECTION THROUGH MAT SLAB
1" = 1'-0"

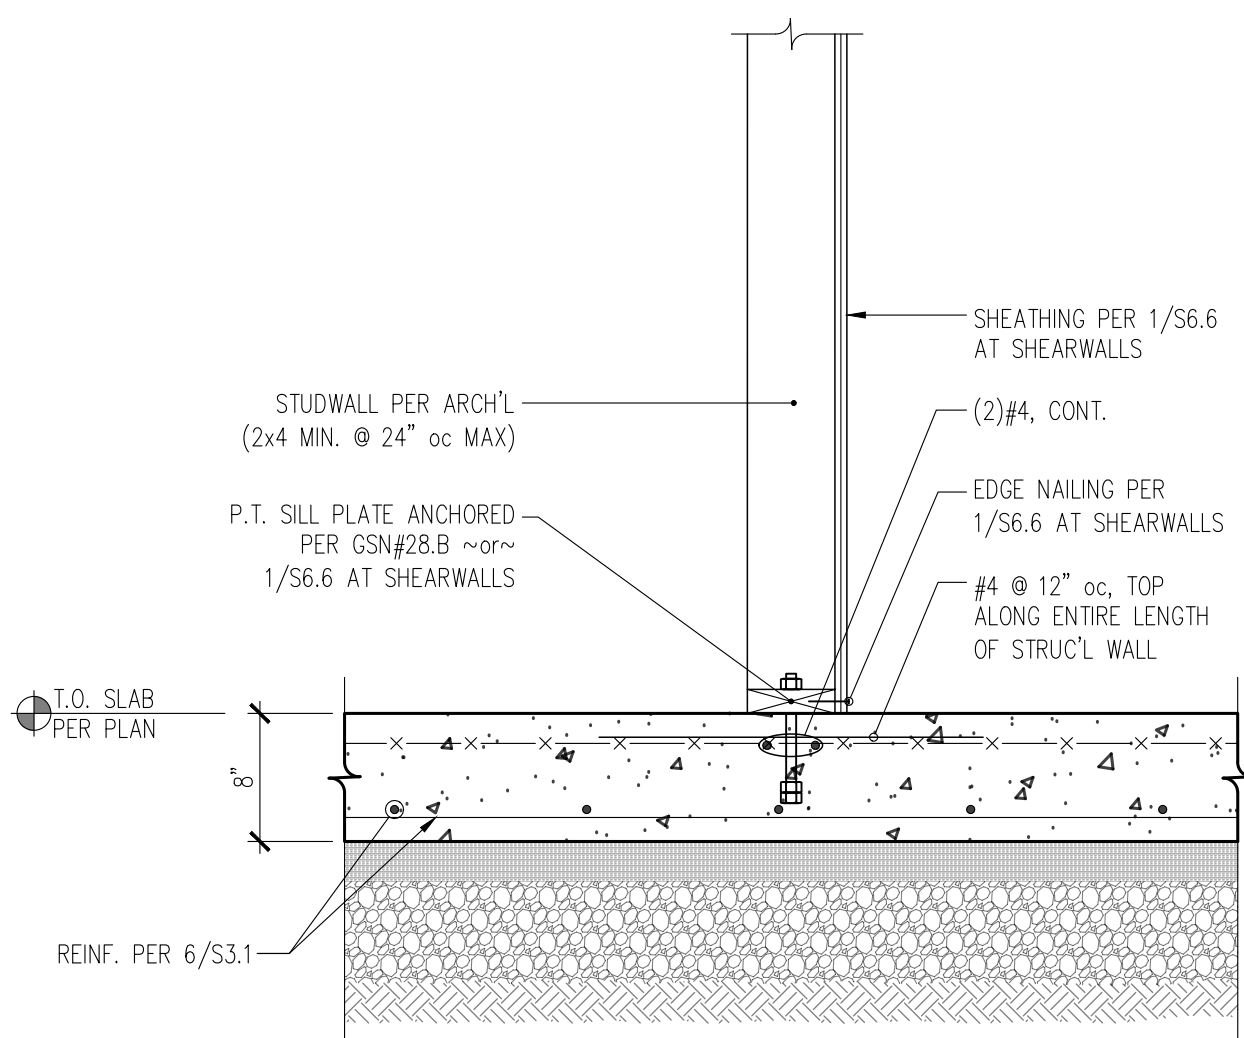

4
S3.1 SECTION THROUGH MAT SLAB AT INTERIOR STRUCTURAL WALL
1" = 1'-0"

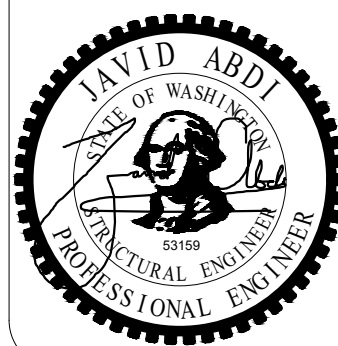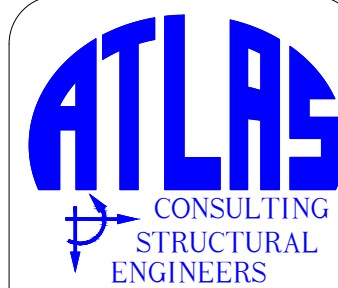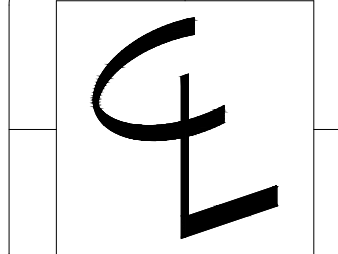


Yageneh Residence
3029 62nd Ave SE - Mercer Island


CONTENTS
Foundation
Details

DRAWN BY
JDA
DATE
05.27.24


S3.1

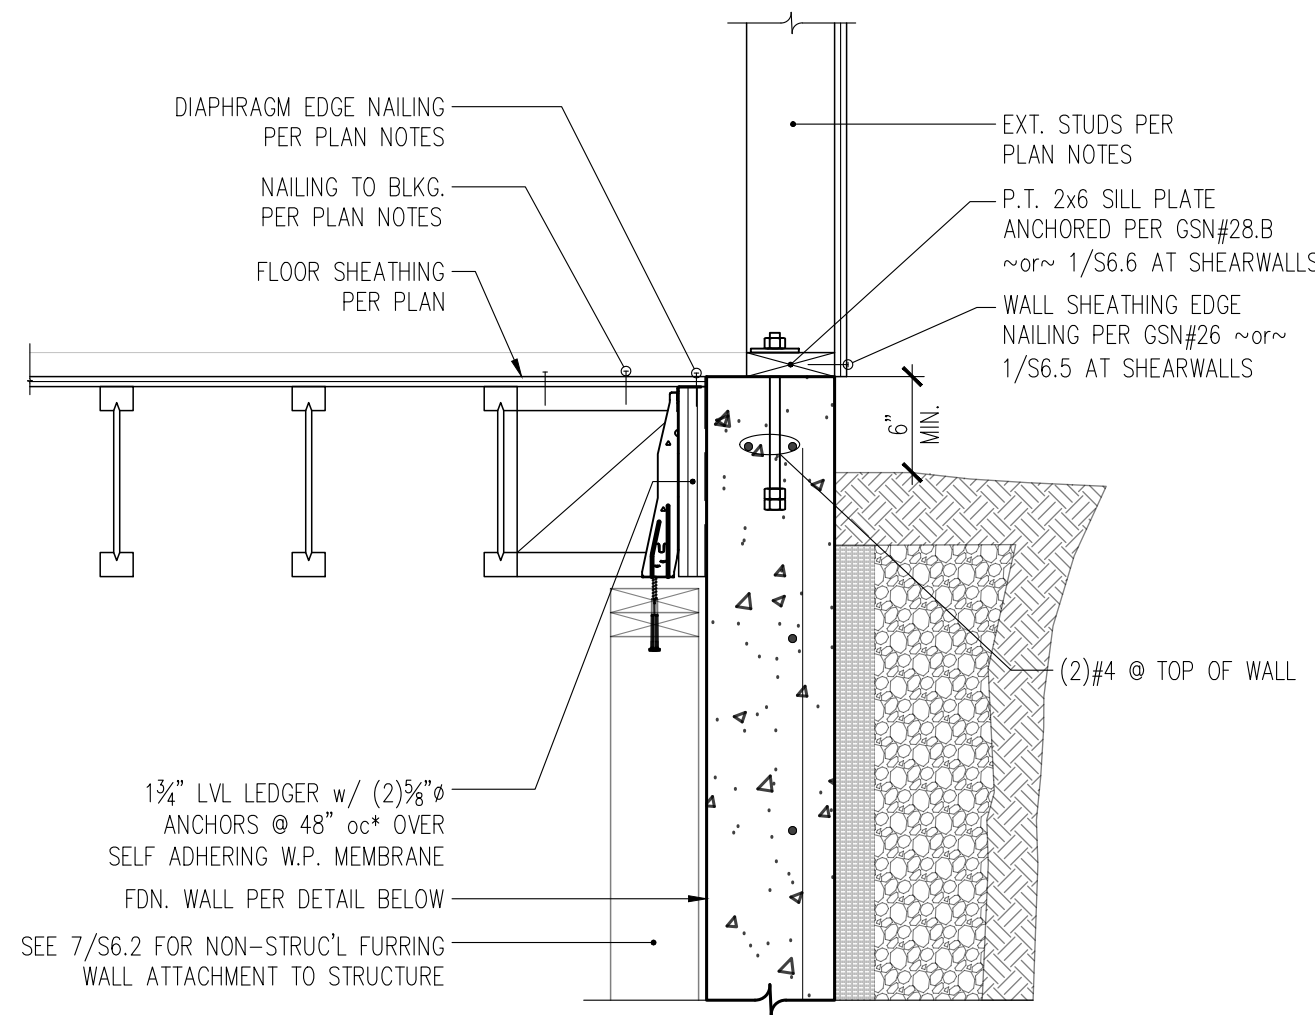


6 SECTION THROUGH FOUNDATION WALL AT PARALLEL JOISTS AND HIGH GRADE
S3.2 1" = 1'-0"

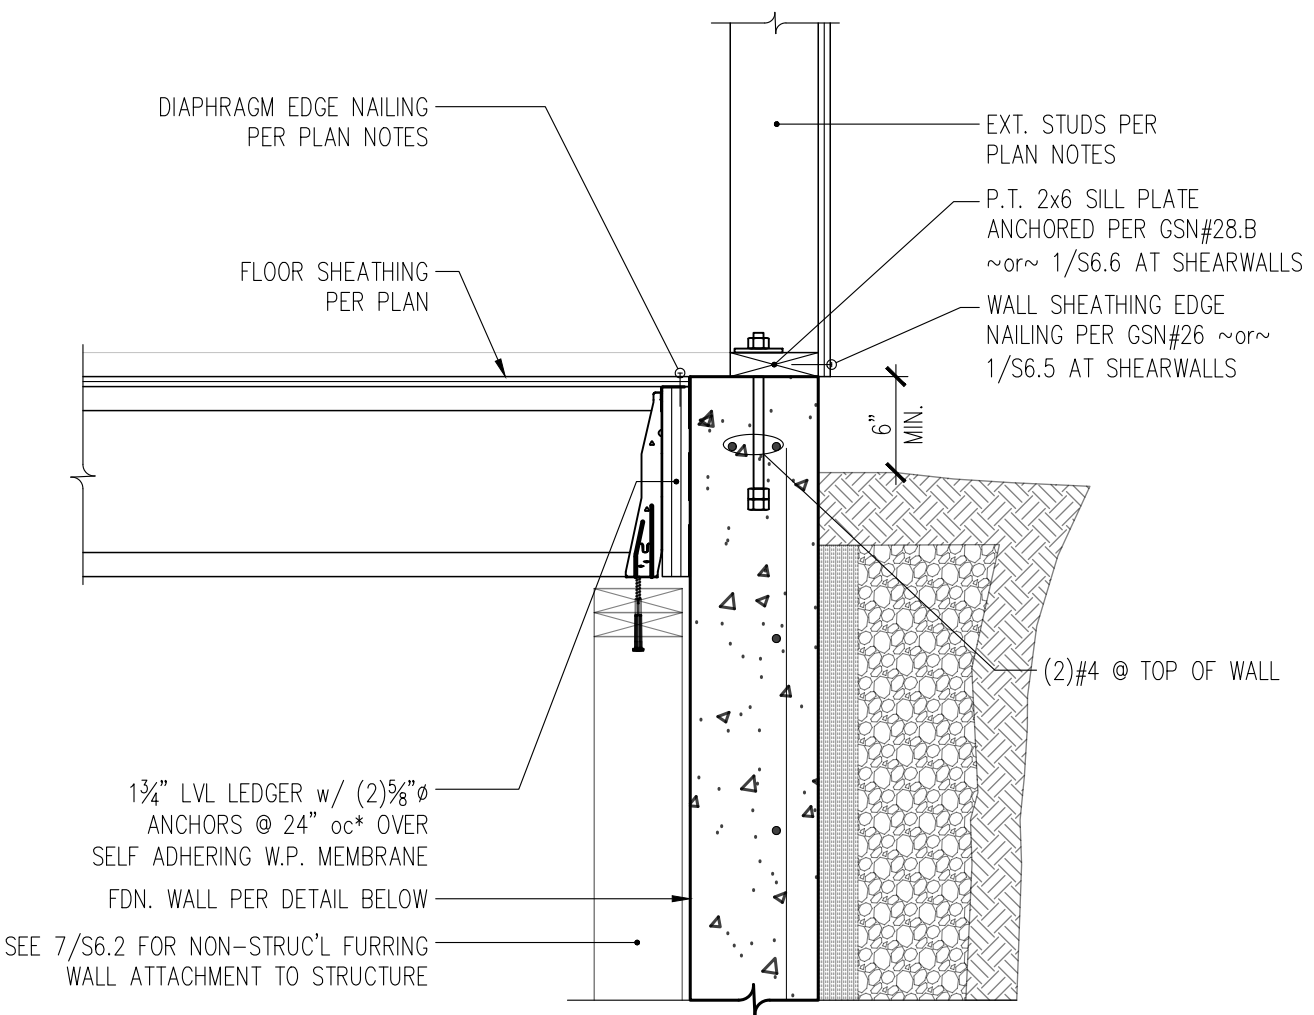


3 SECTION THROUGH FOUNDATION WALL AT PERPENDICULAR JOISTS AND HIGH GRADE
S3.2 1" = 1'-0"

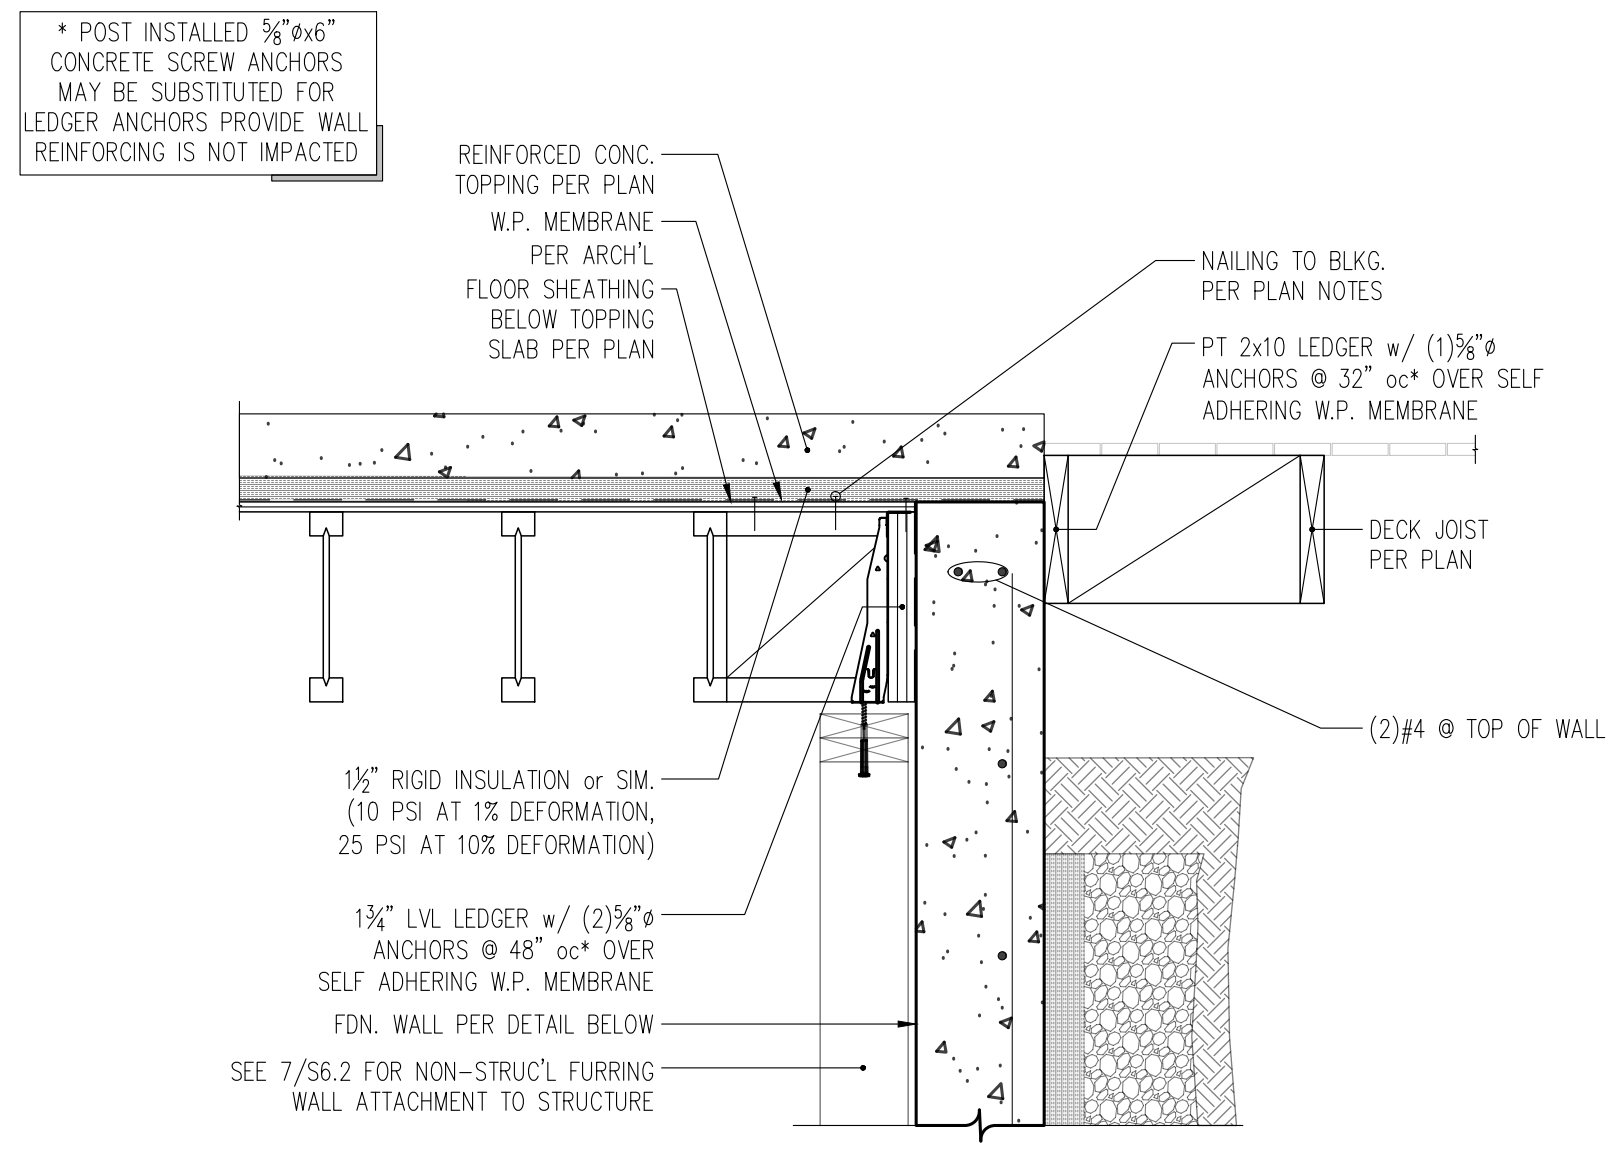


8 SECTION THROUGH FOUNDATION WALL AT PARALLEL GARAGE JOISTS AND APPROACH SLAB
S3.2 1" = 1'-0"

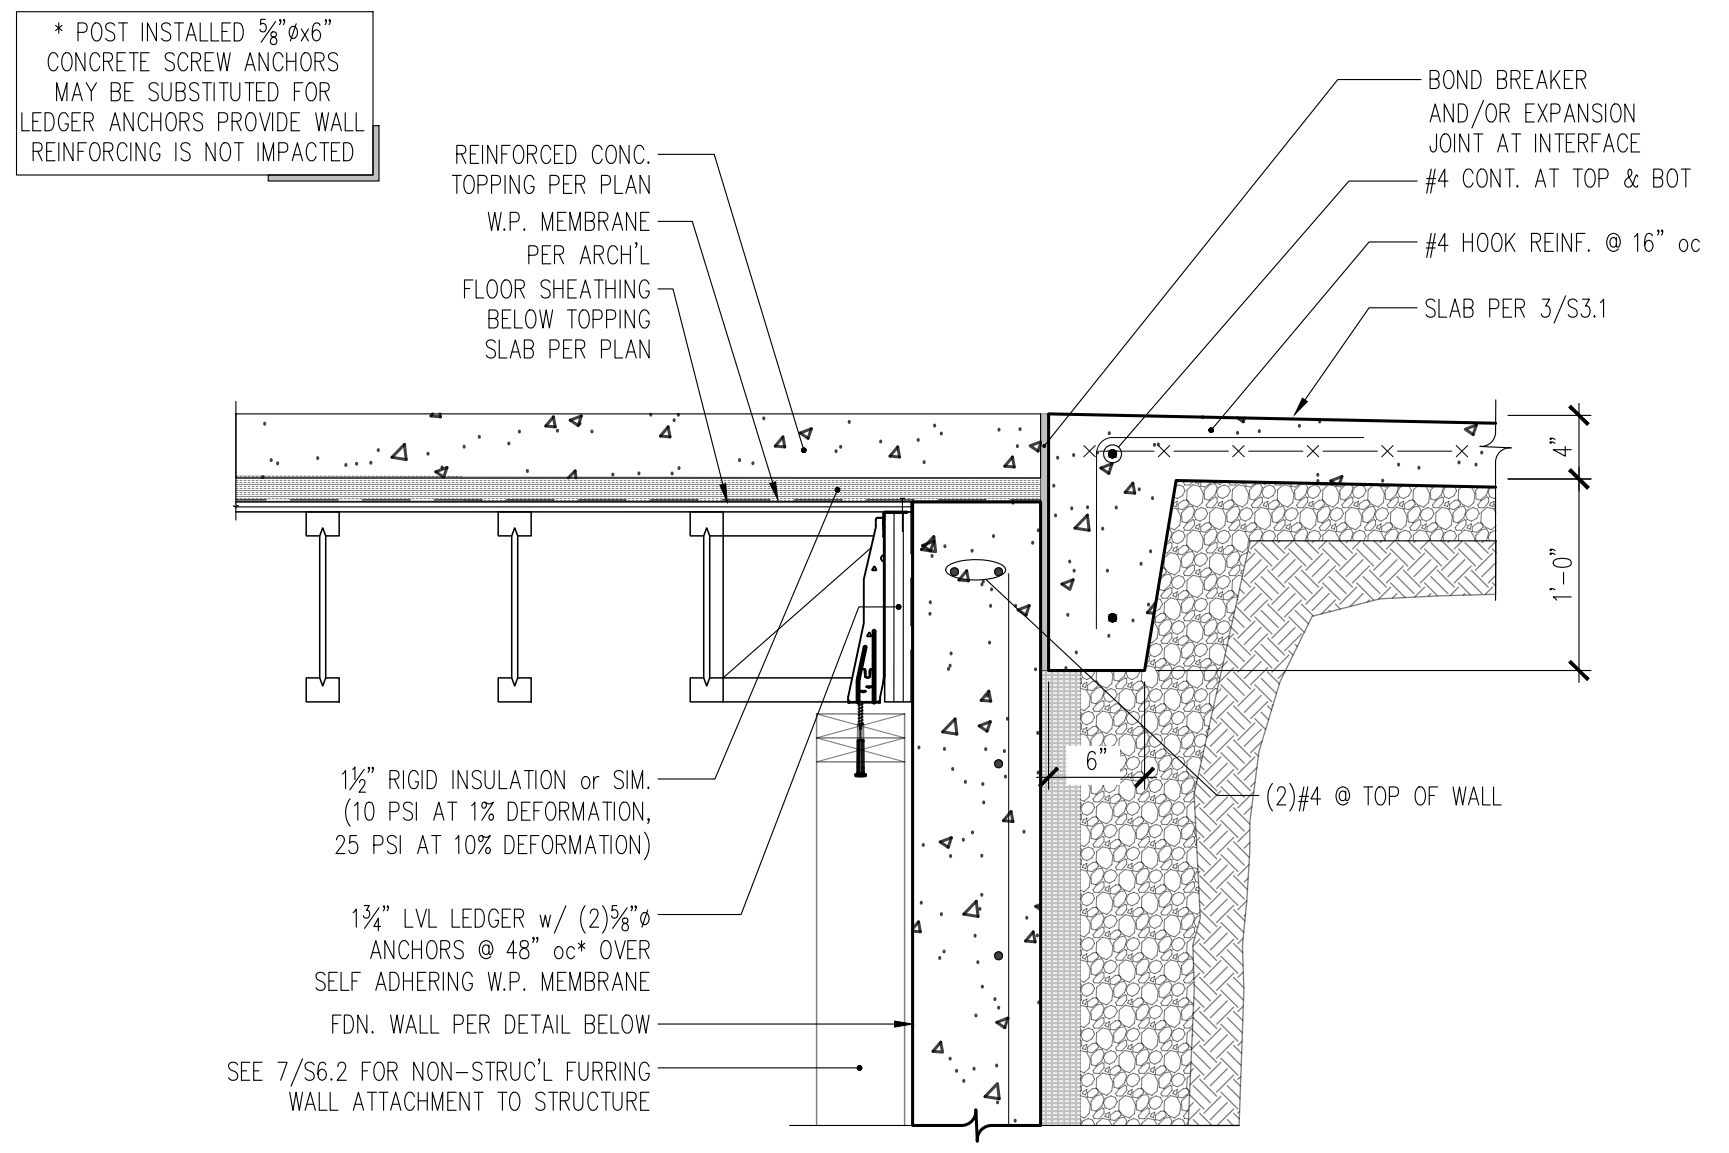


5 SECTION THROUGH FOUNDATION WALL AT PARALLEL GARAGE JOISTS AND APPROACH SLAB
S3.2 1" = 1'-0"

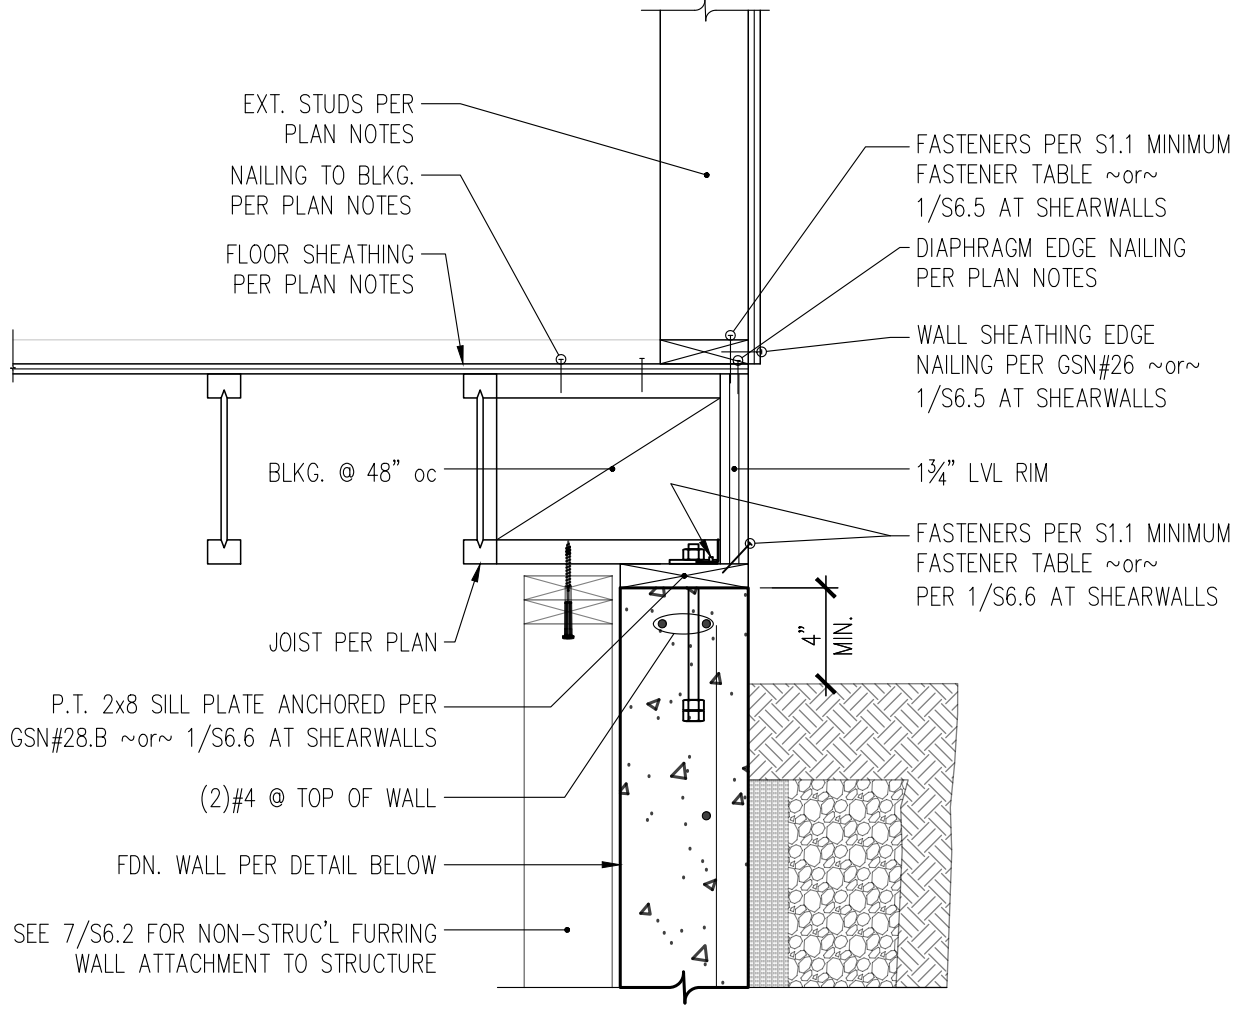


2 SECTION THROUGH FOUNDATION WALL AT PARALLEL JOISTS
S3.2 1" = 1'-0"

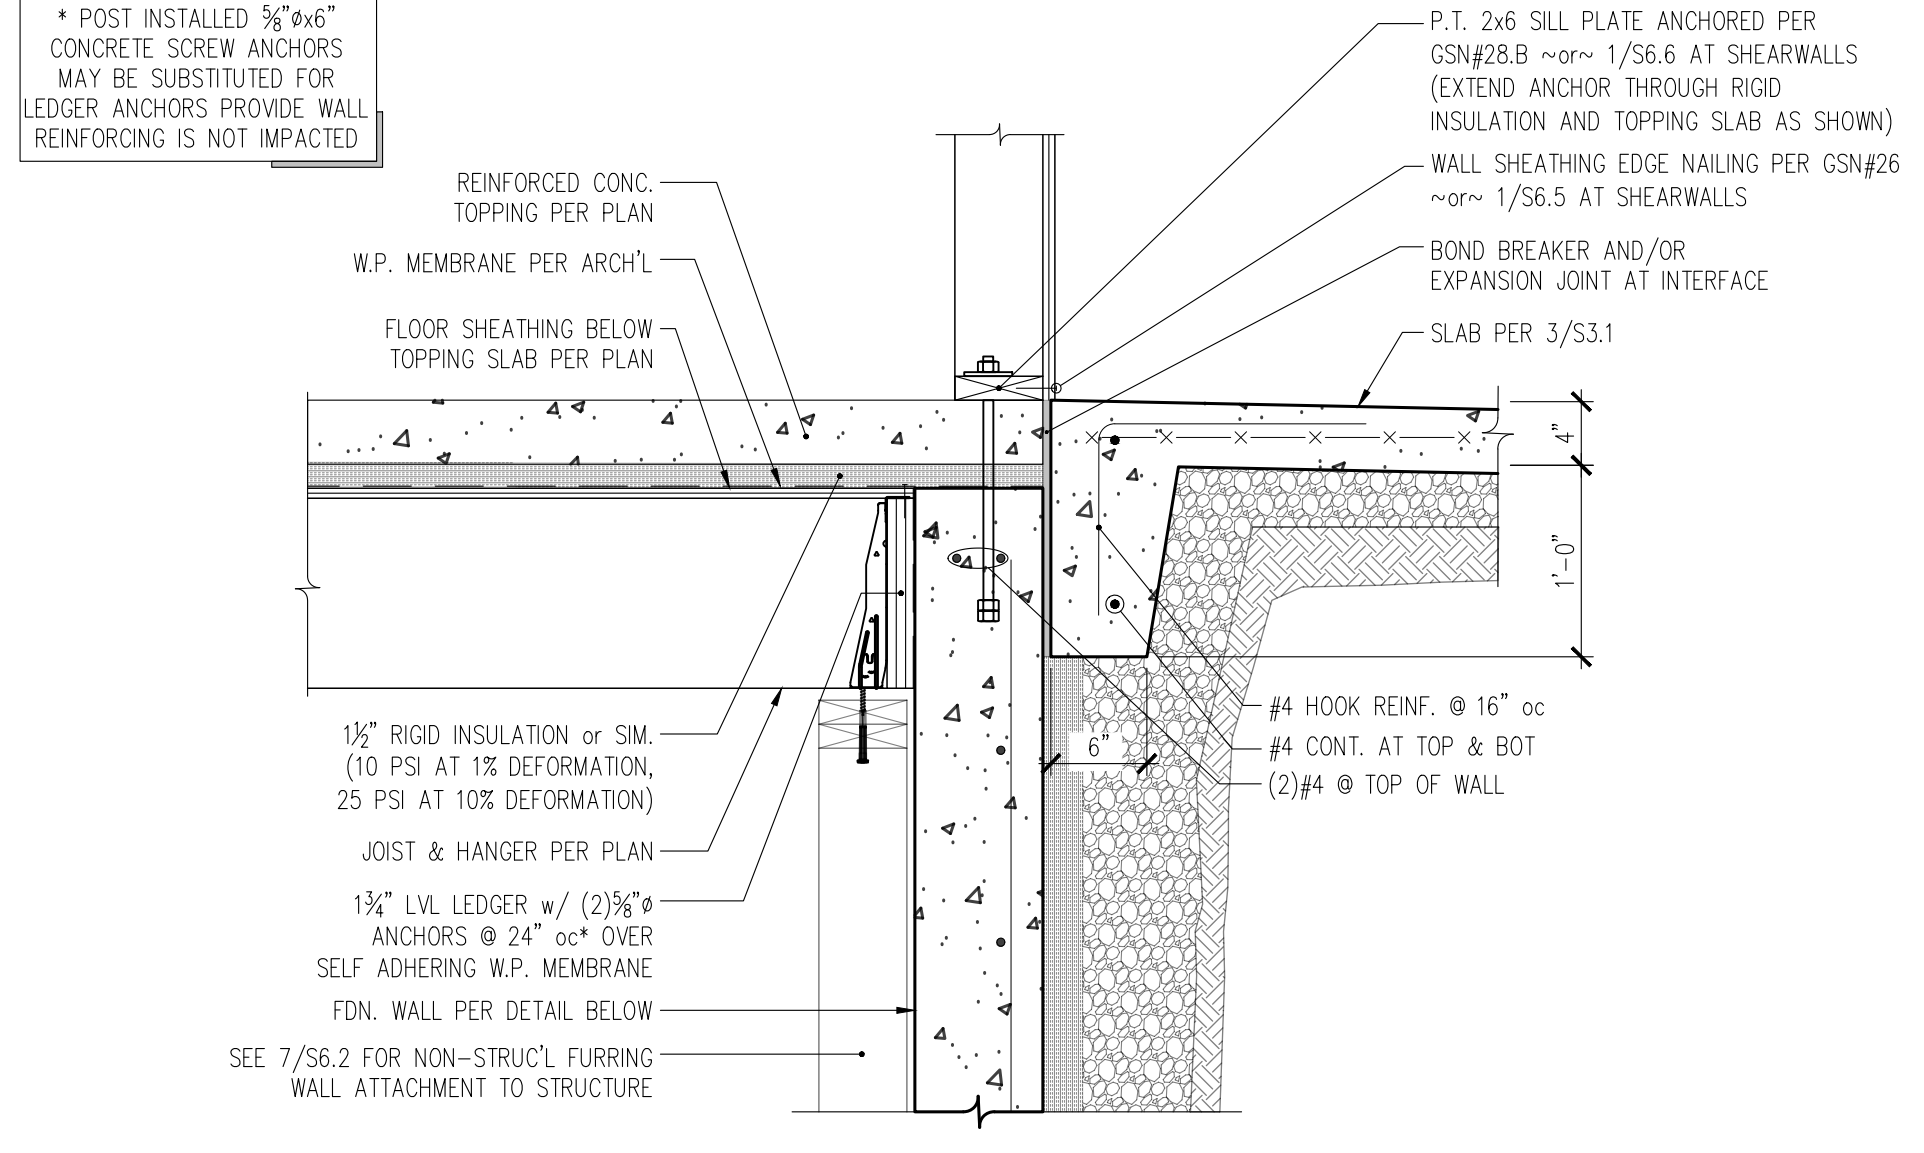


7 SECTION THROUGH FOUNDATION WALL AT PERPENDICULAR GARAGE JOISTS
S3.2 1" = 1'-0"

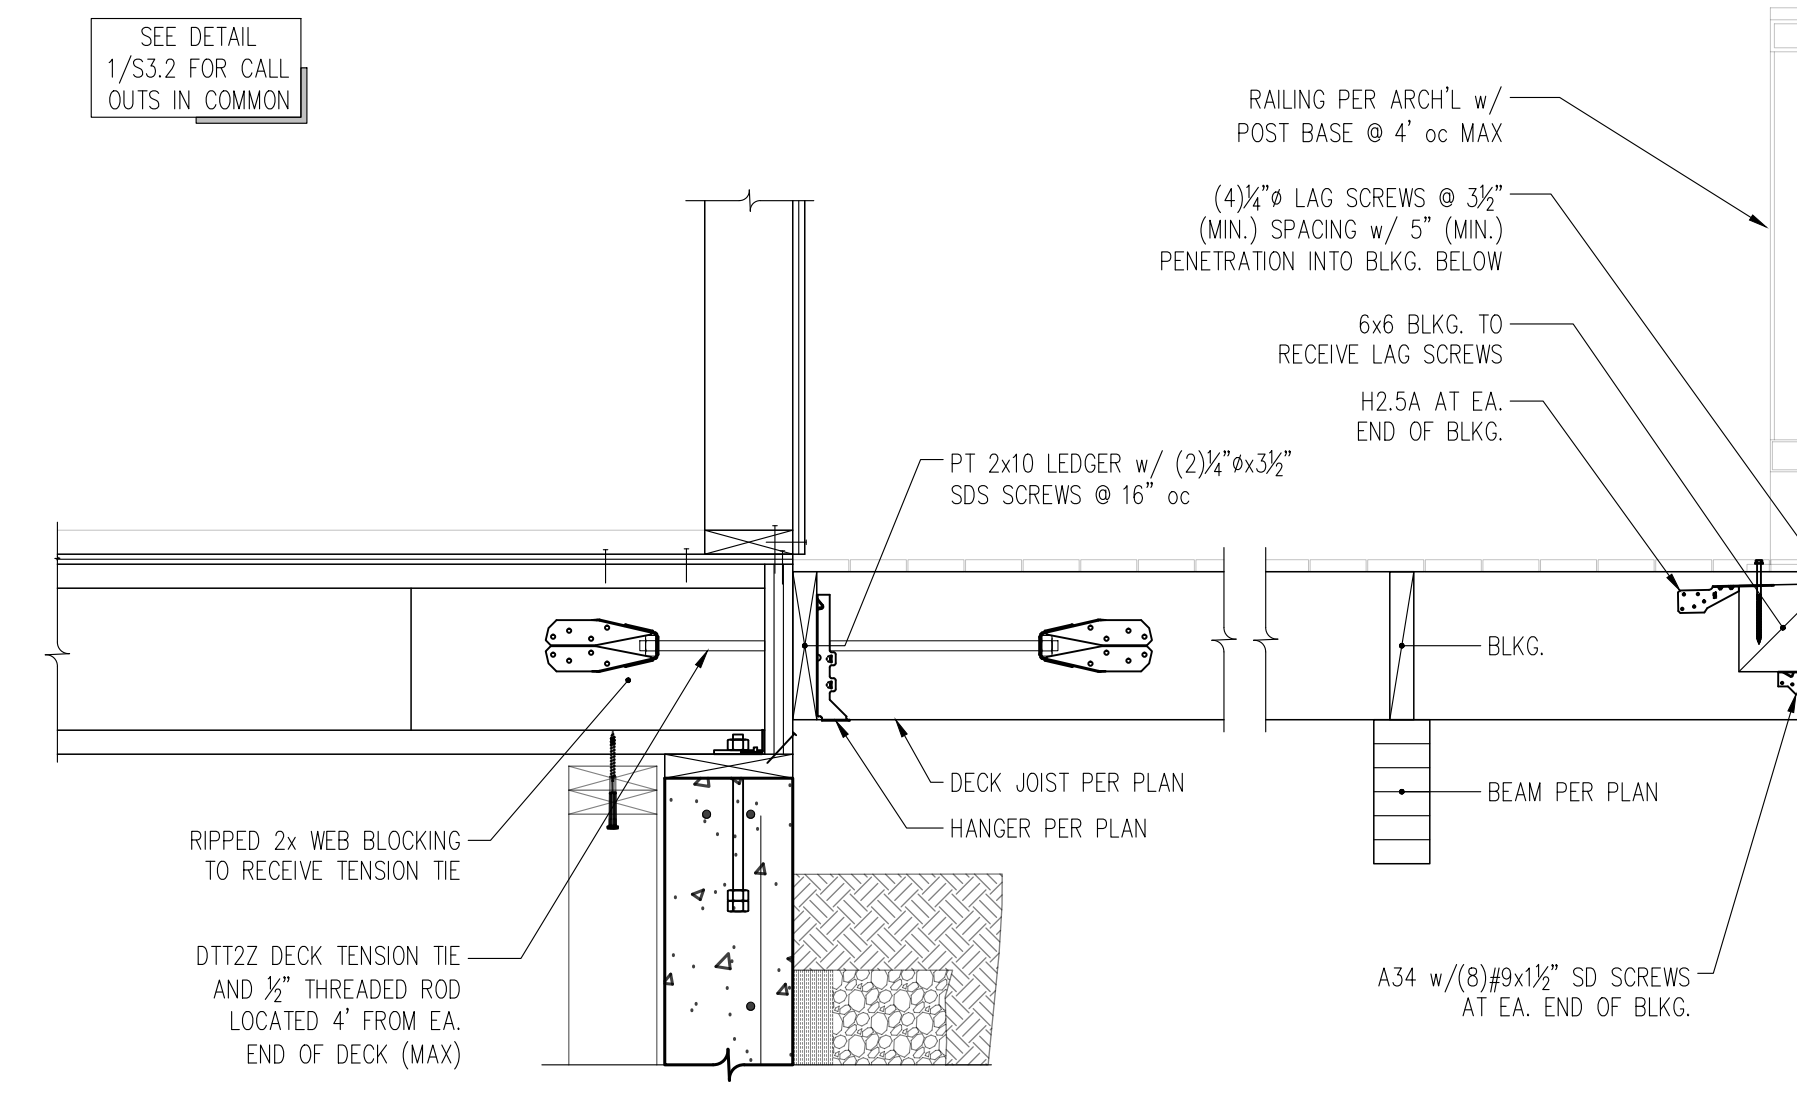


4 SECTION THROUGH FOUNDATION WALL AT PERPENDICULAR JOISTS AND PERPENDICULAR DECK JOISTS
S3.2 1" = 1'-0"

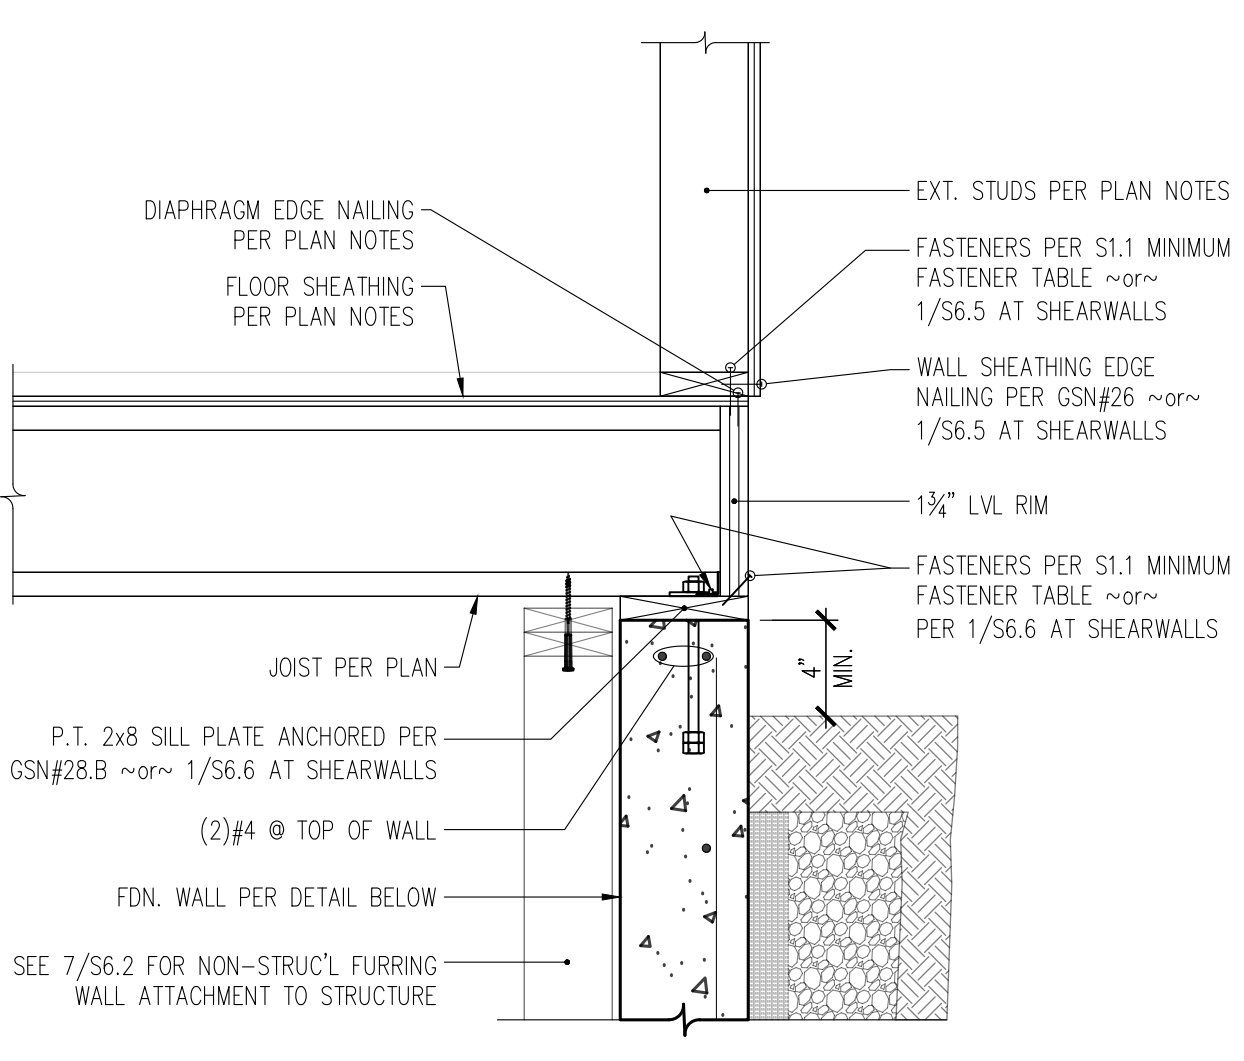


1 SECTION THROUGH FOUNDATION WALL AT PERPENDICULAR JOISTS
S3.2 1" = 1'-0"

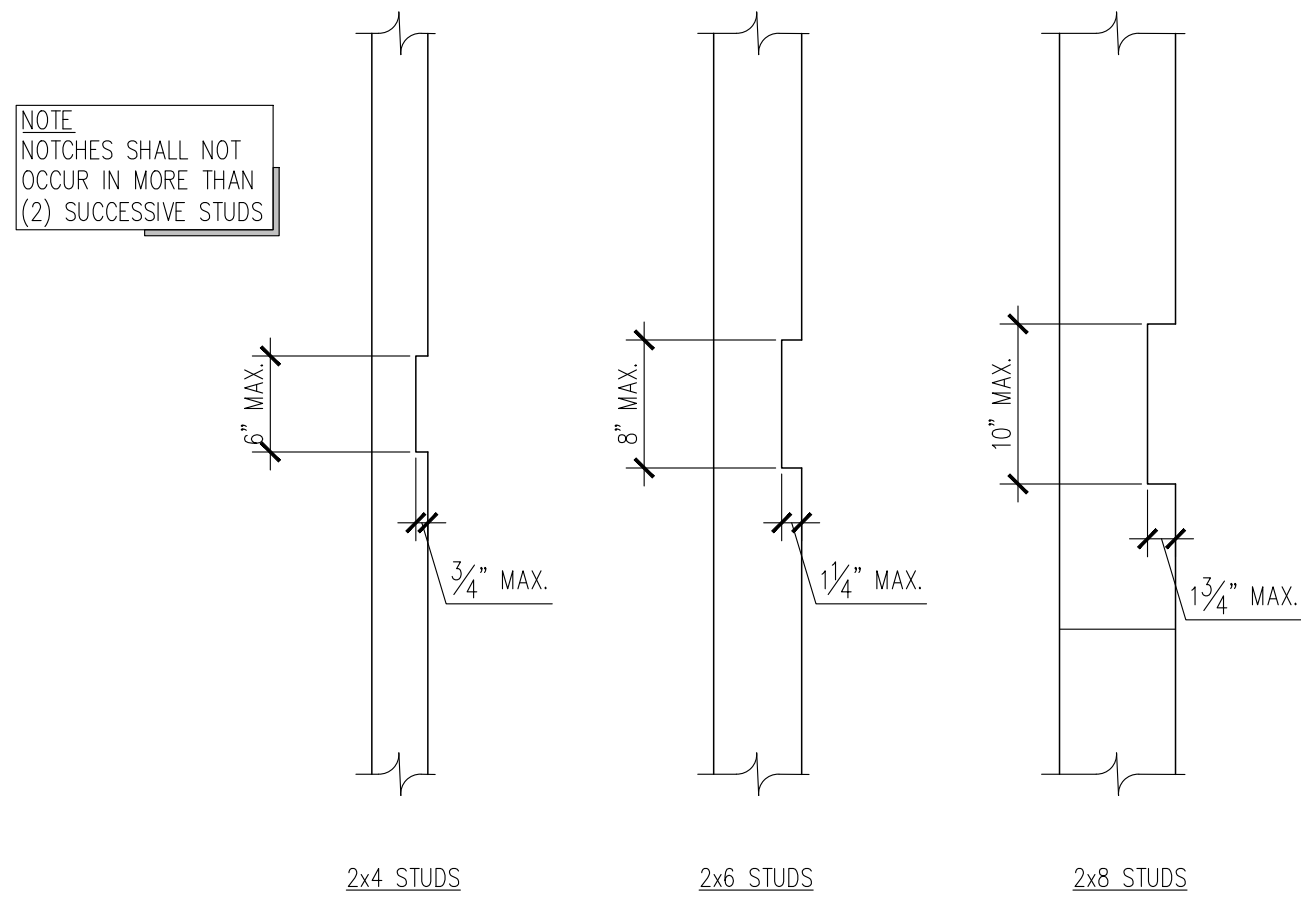







6 ALLOWABLE HOLES IN STUDWALL STUDS
NTS

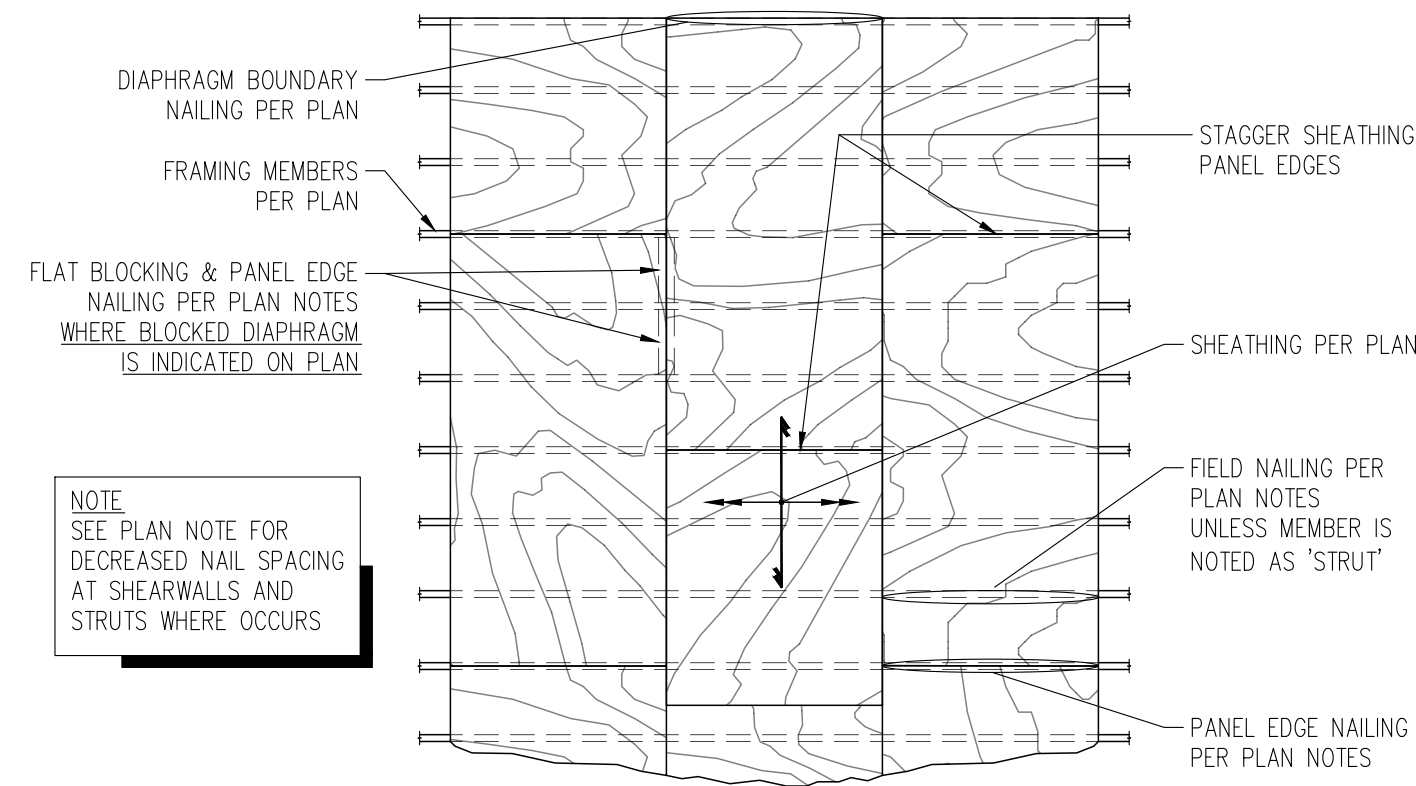


3 TYPICAL DIAPHRAGM NAILING
NTS

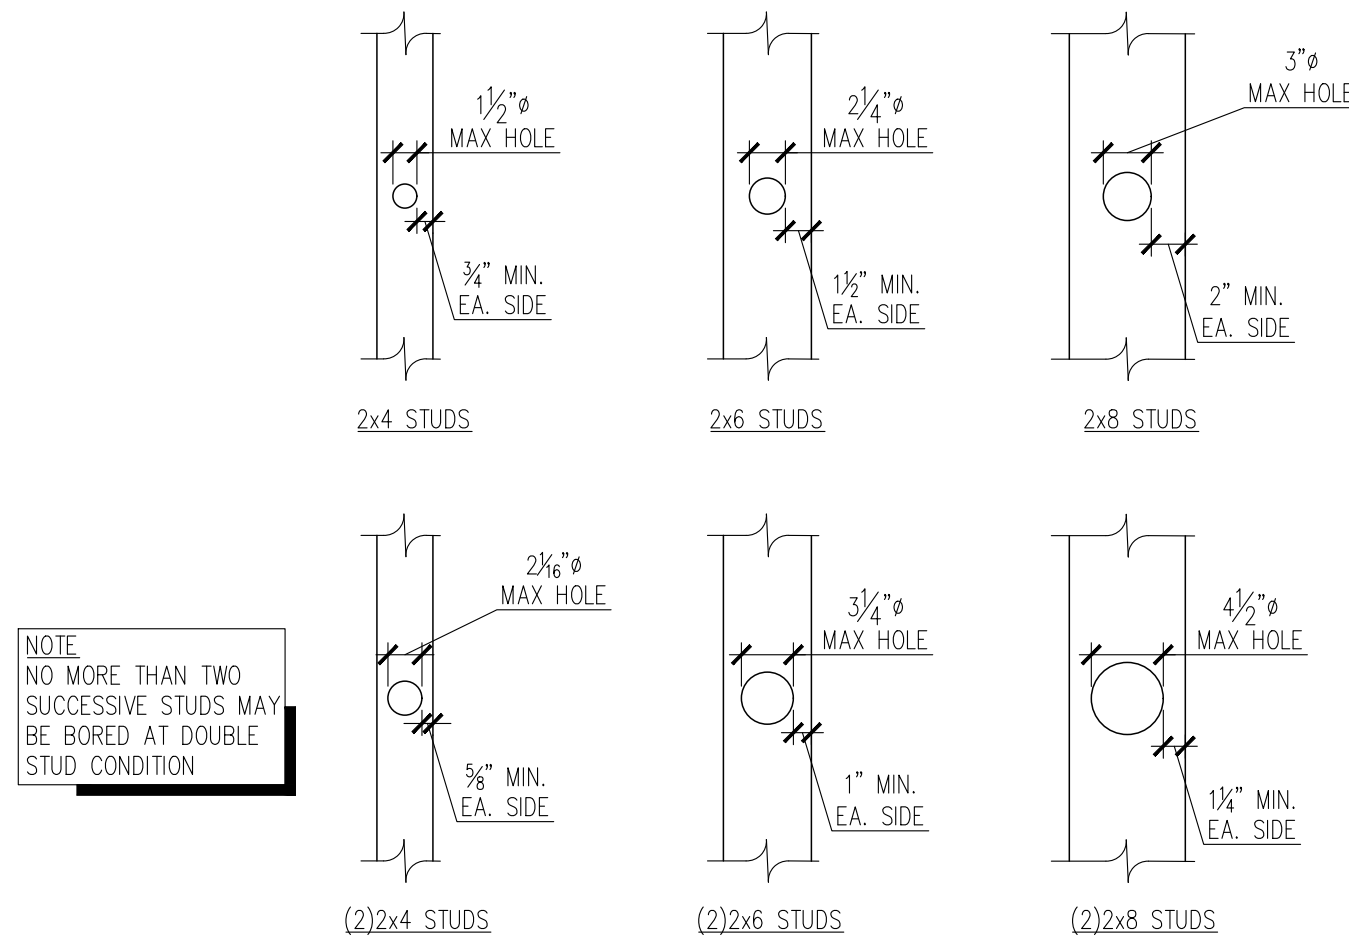


5 ALLOWABLE HOLES IN STUDWALL STUDS
NTS

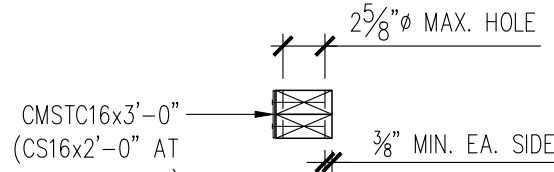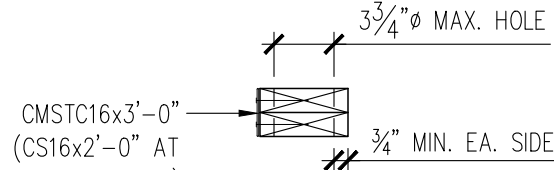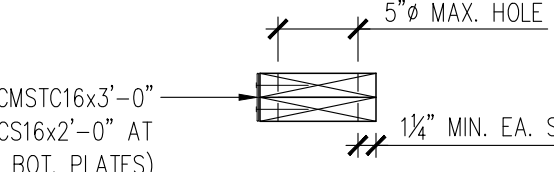	NO REINF. REQUIRED	STRAP REINF. REQUIRED
2x4 PLATES		
2x6 PLATES		
2x8 PLATES		


2 ALLOWABLE HOLES THROUGH TOP PLATES
NTS

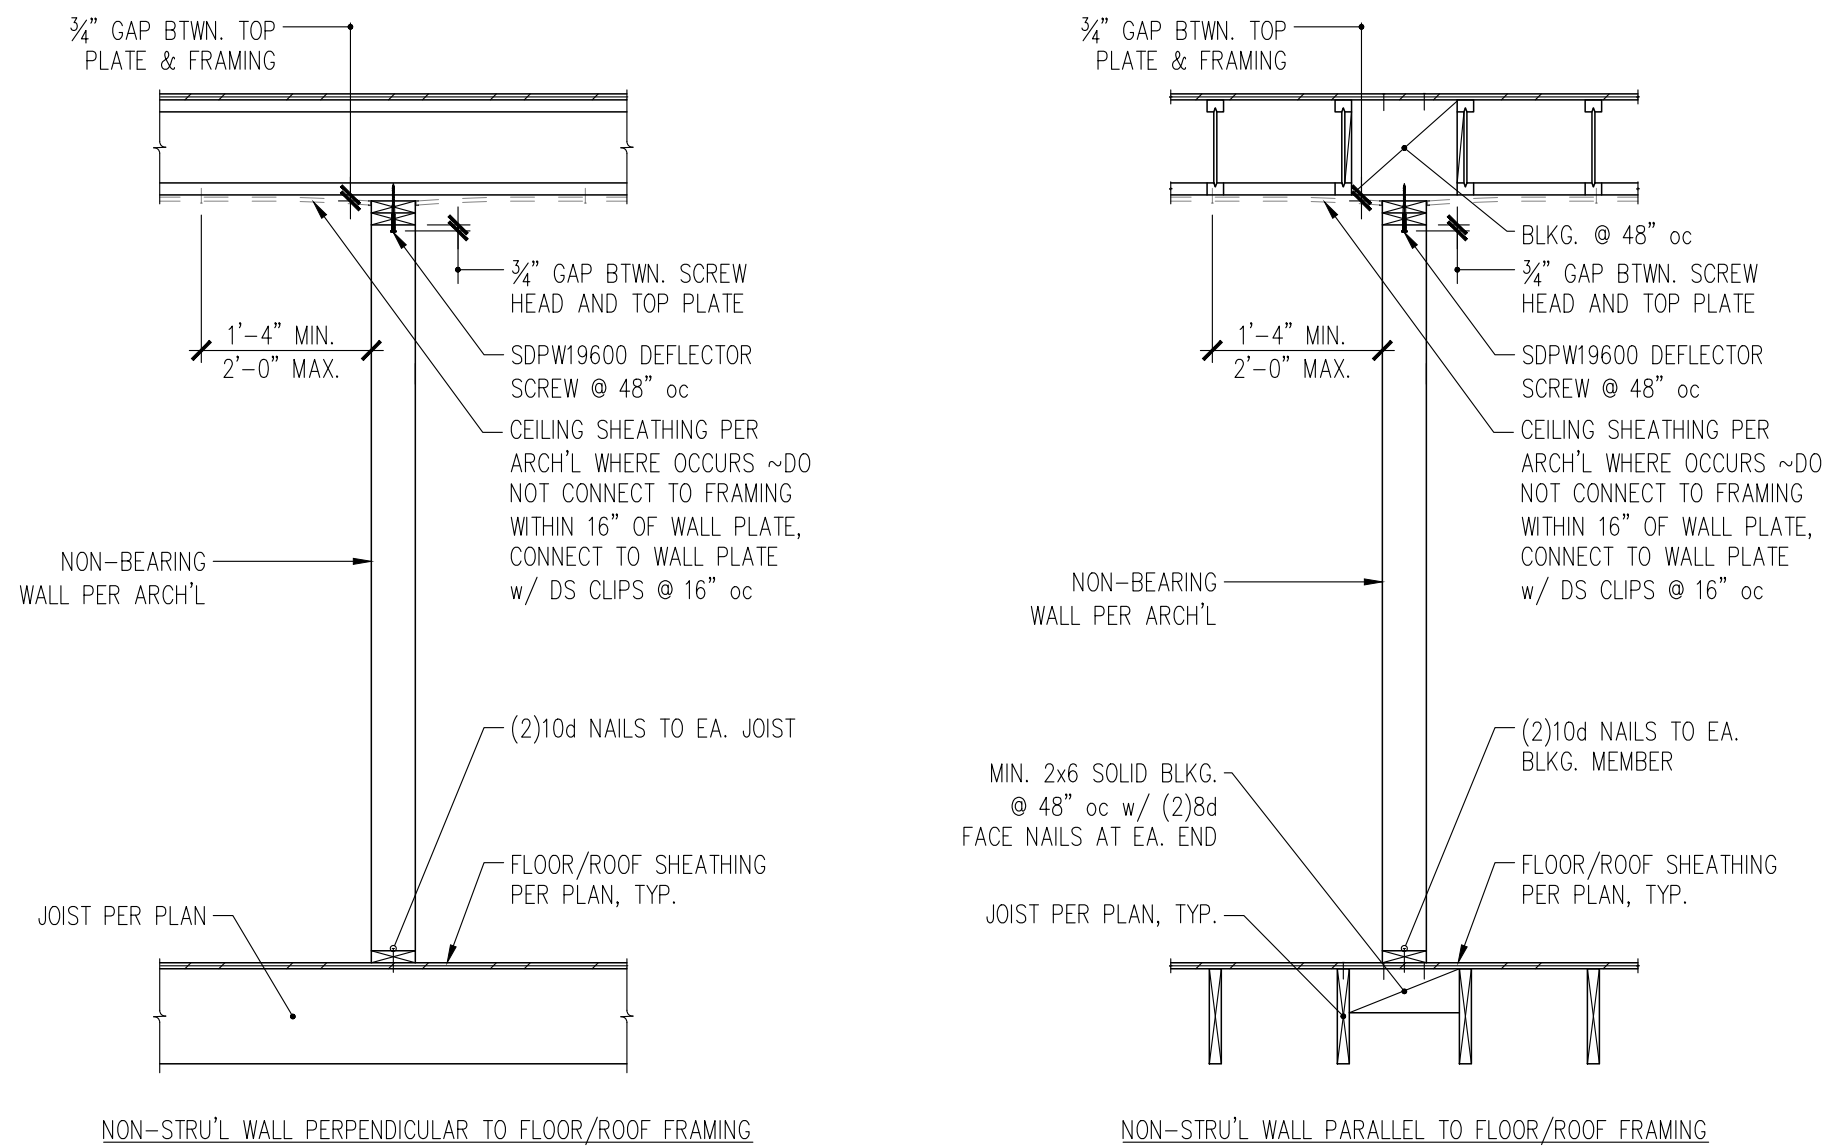

7 CONNECTION OF NON-STRUC'L PARTITION WALL TO STRUCTURE
NTS

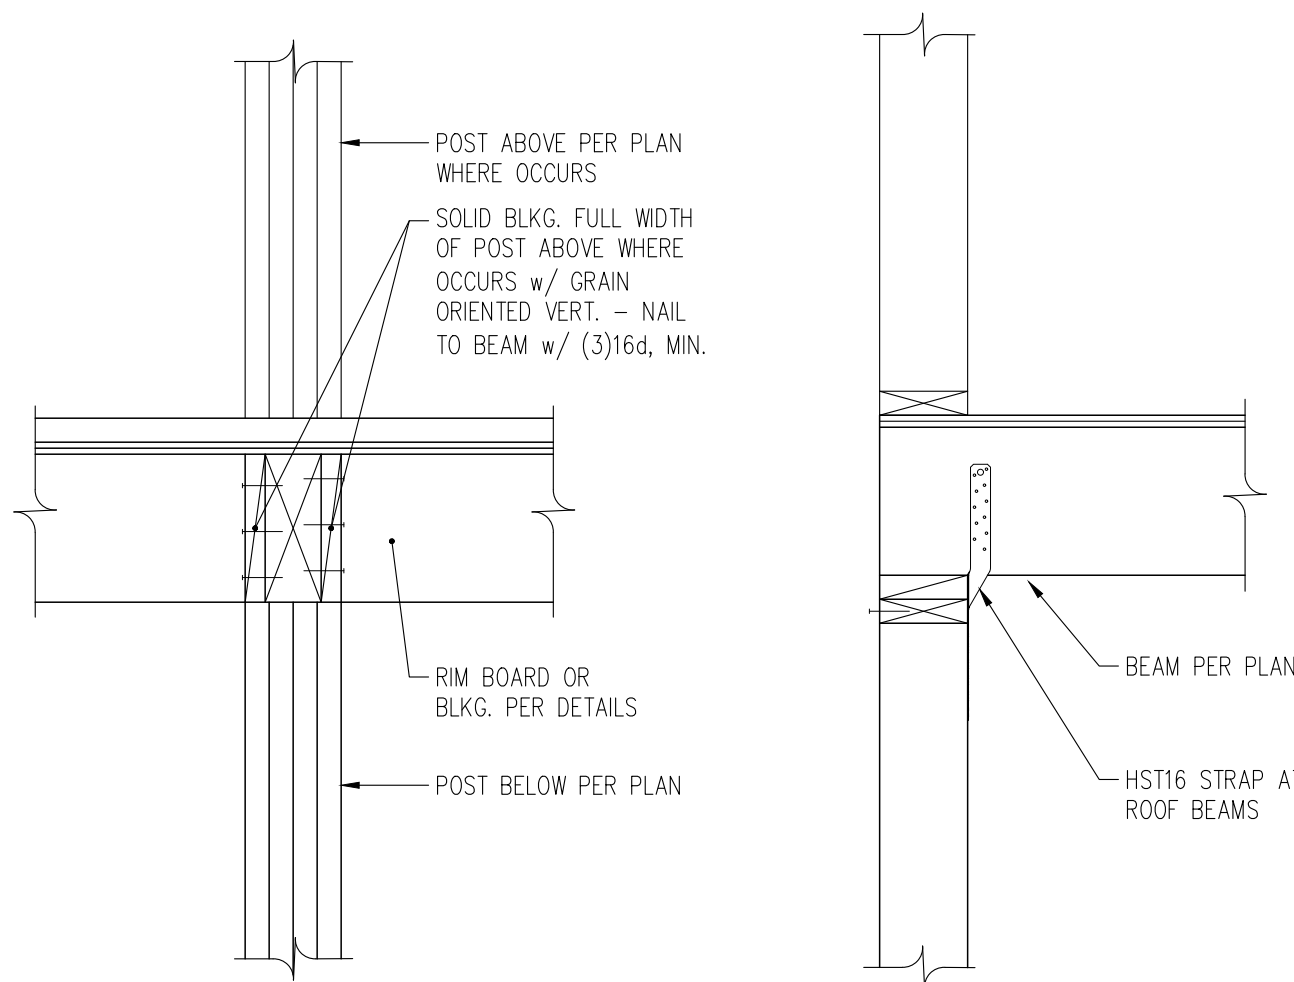


4 TYPICAL BEAM PERPENDICULAR TO WALL
NTS

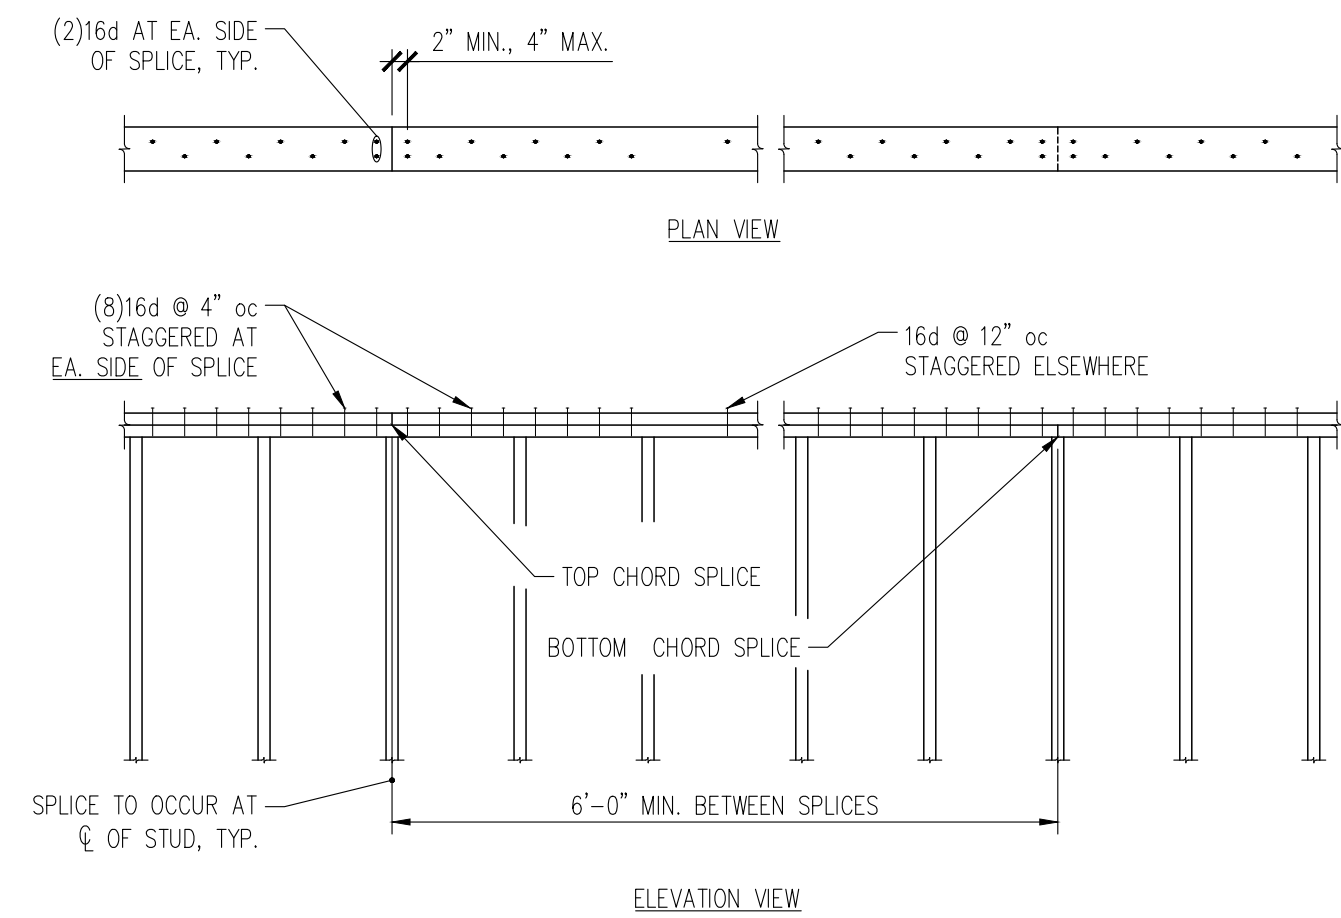


1 TOP PLATE SPLICE
NTS


OPENING WIDTH, L	RIM/HEADER SIZE	MINIMUM No. OF JAMB STUD
UPPER FLOOR		
L ≤ 3'-6"	1¾"x11½" LVL	(1)2x6
L ≤ 5'-0"	1¾"x11½" LVL	(2)2x6
L ≤ 10'-0"	(2)1¾"x11½" LVL	(3)2x6

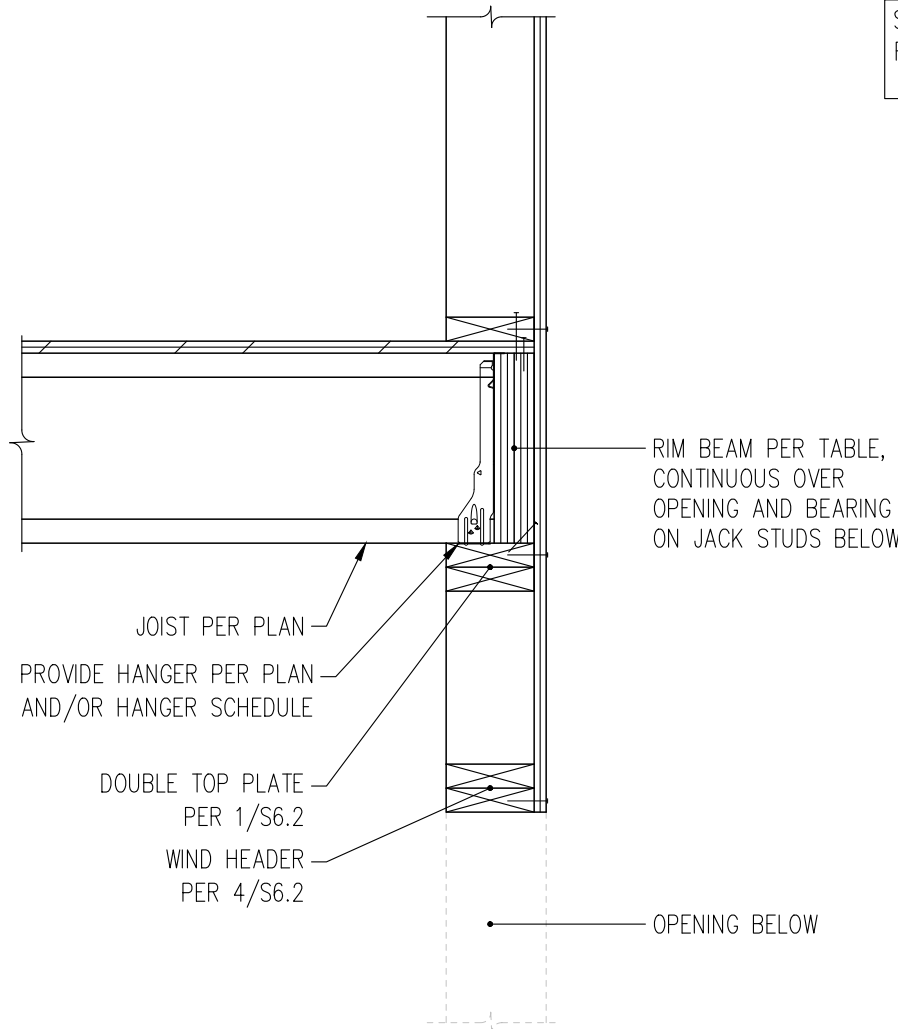


6
S6.2 TYPICAL RIMBOARD HEADER & WIND HEADER IN LOAD BEARING EXTERIOR WALL
NTS

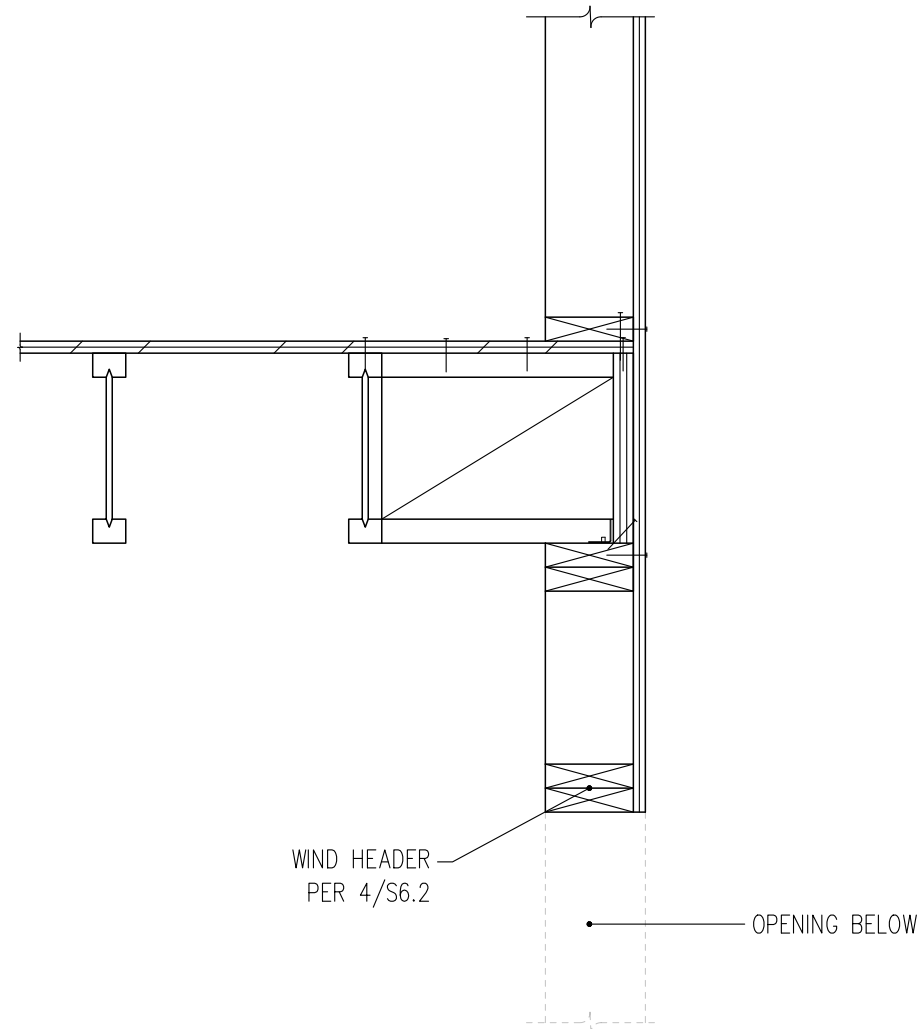


3
S6.2 TYPICAL WIND HEADER IN NON-LOAD BEARING EXTERIOR WALL
NTS

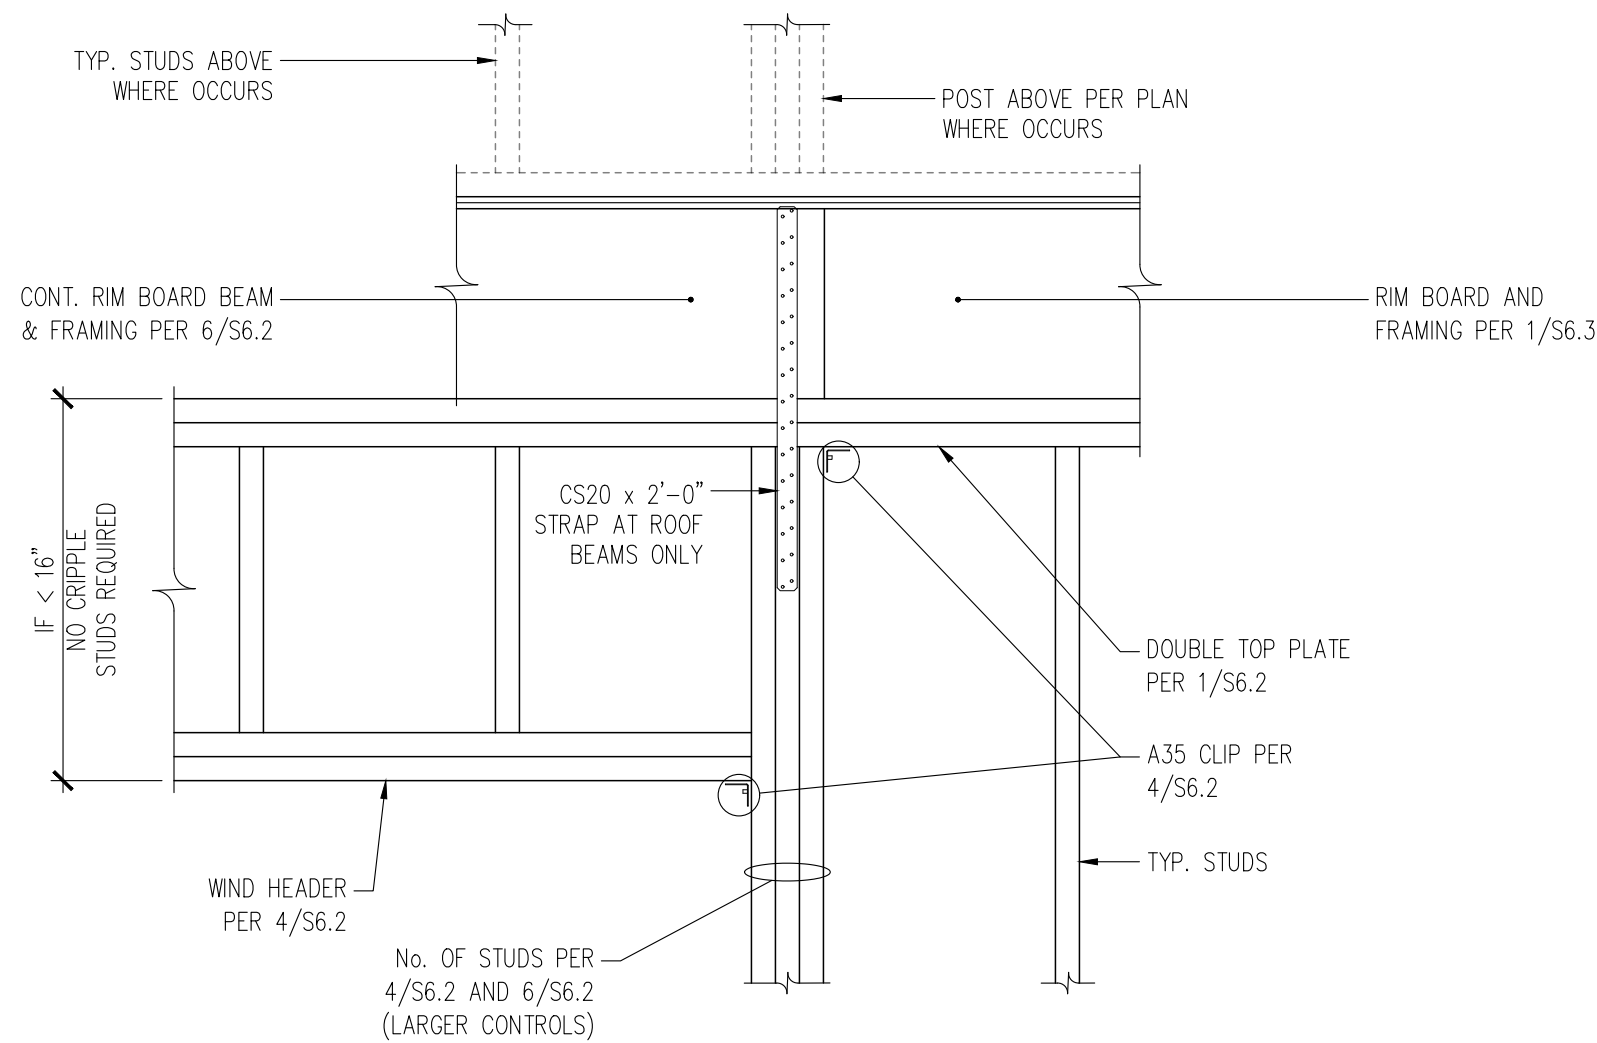


5
S6.2 TYPICAL FLUSH BEAM/HEADER IN EXTERIOR WALL
NTS

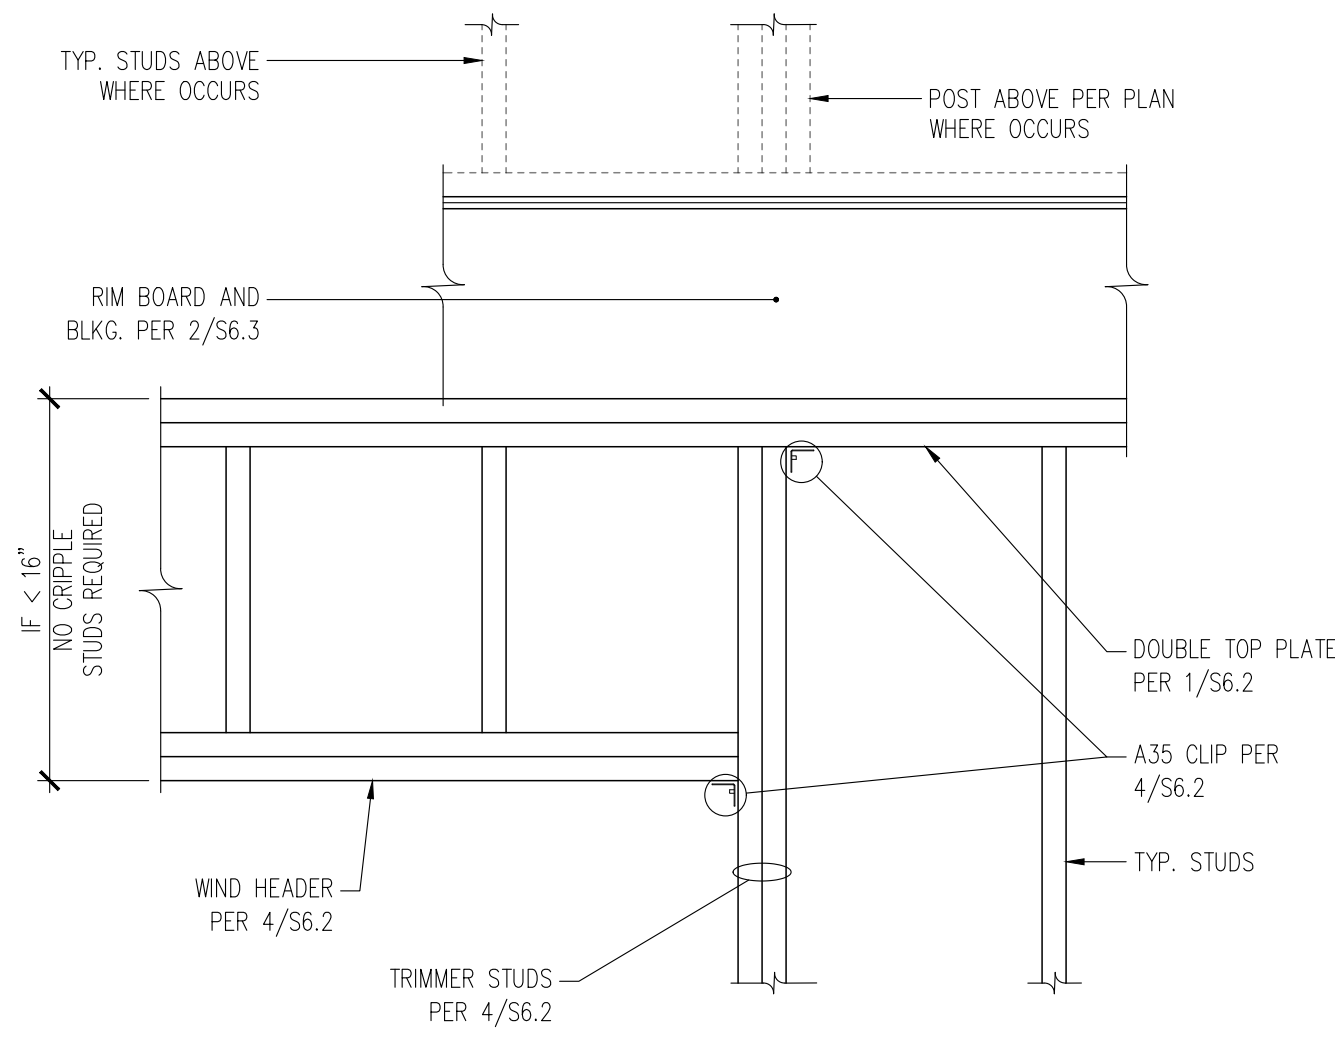

2
S6.2 TYPICAL WIND HEADER DETAIL
NTS

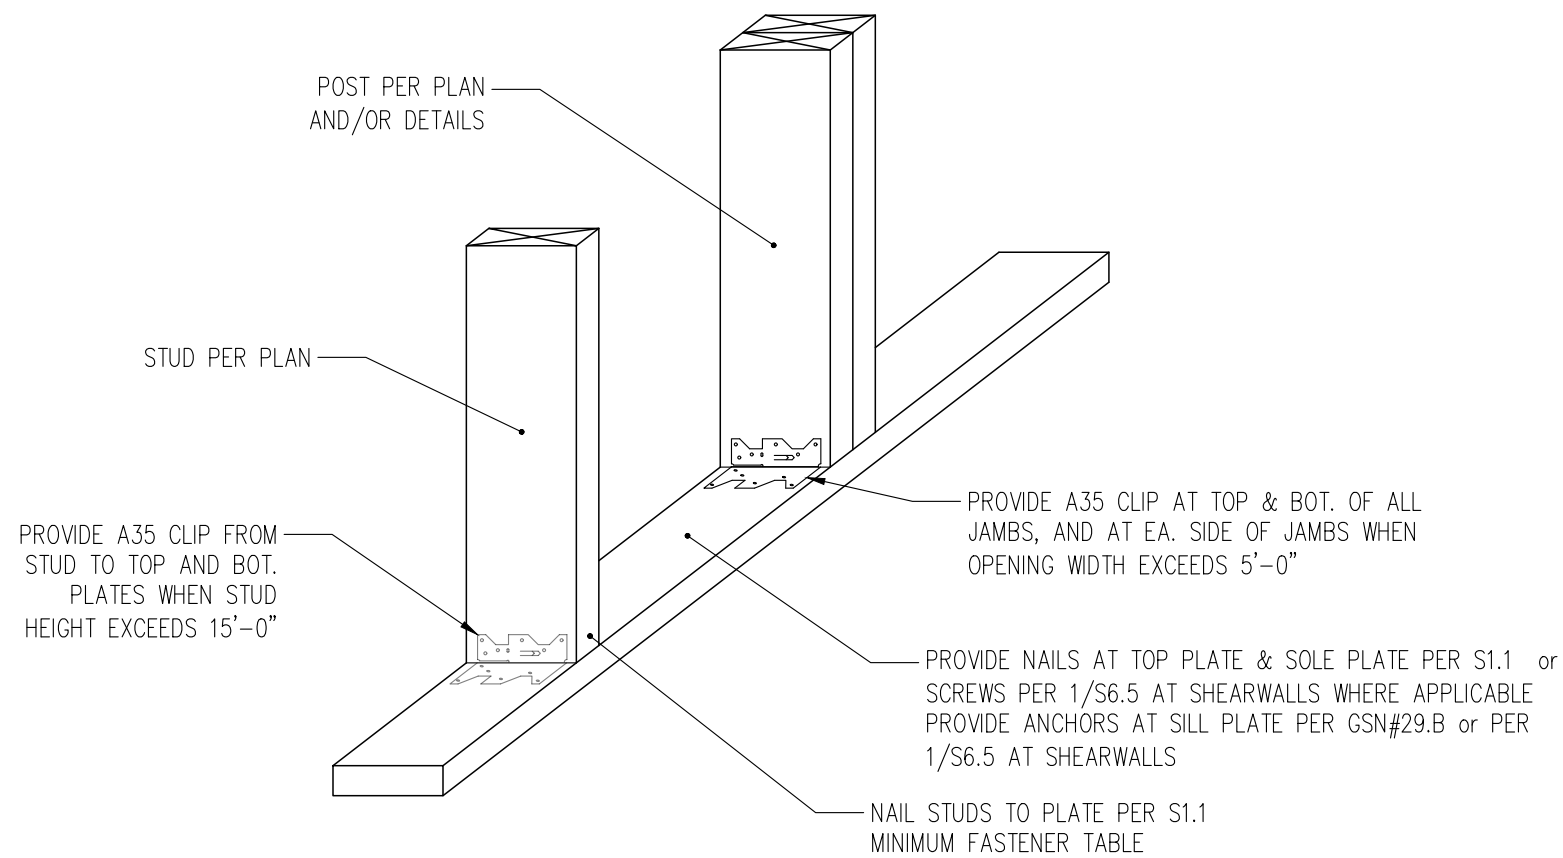





7
S6.2 CONNECTION OF EXTERIOR STUDS AT TOP & BOTTOM PLATES
NTS

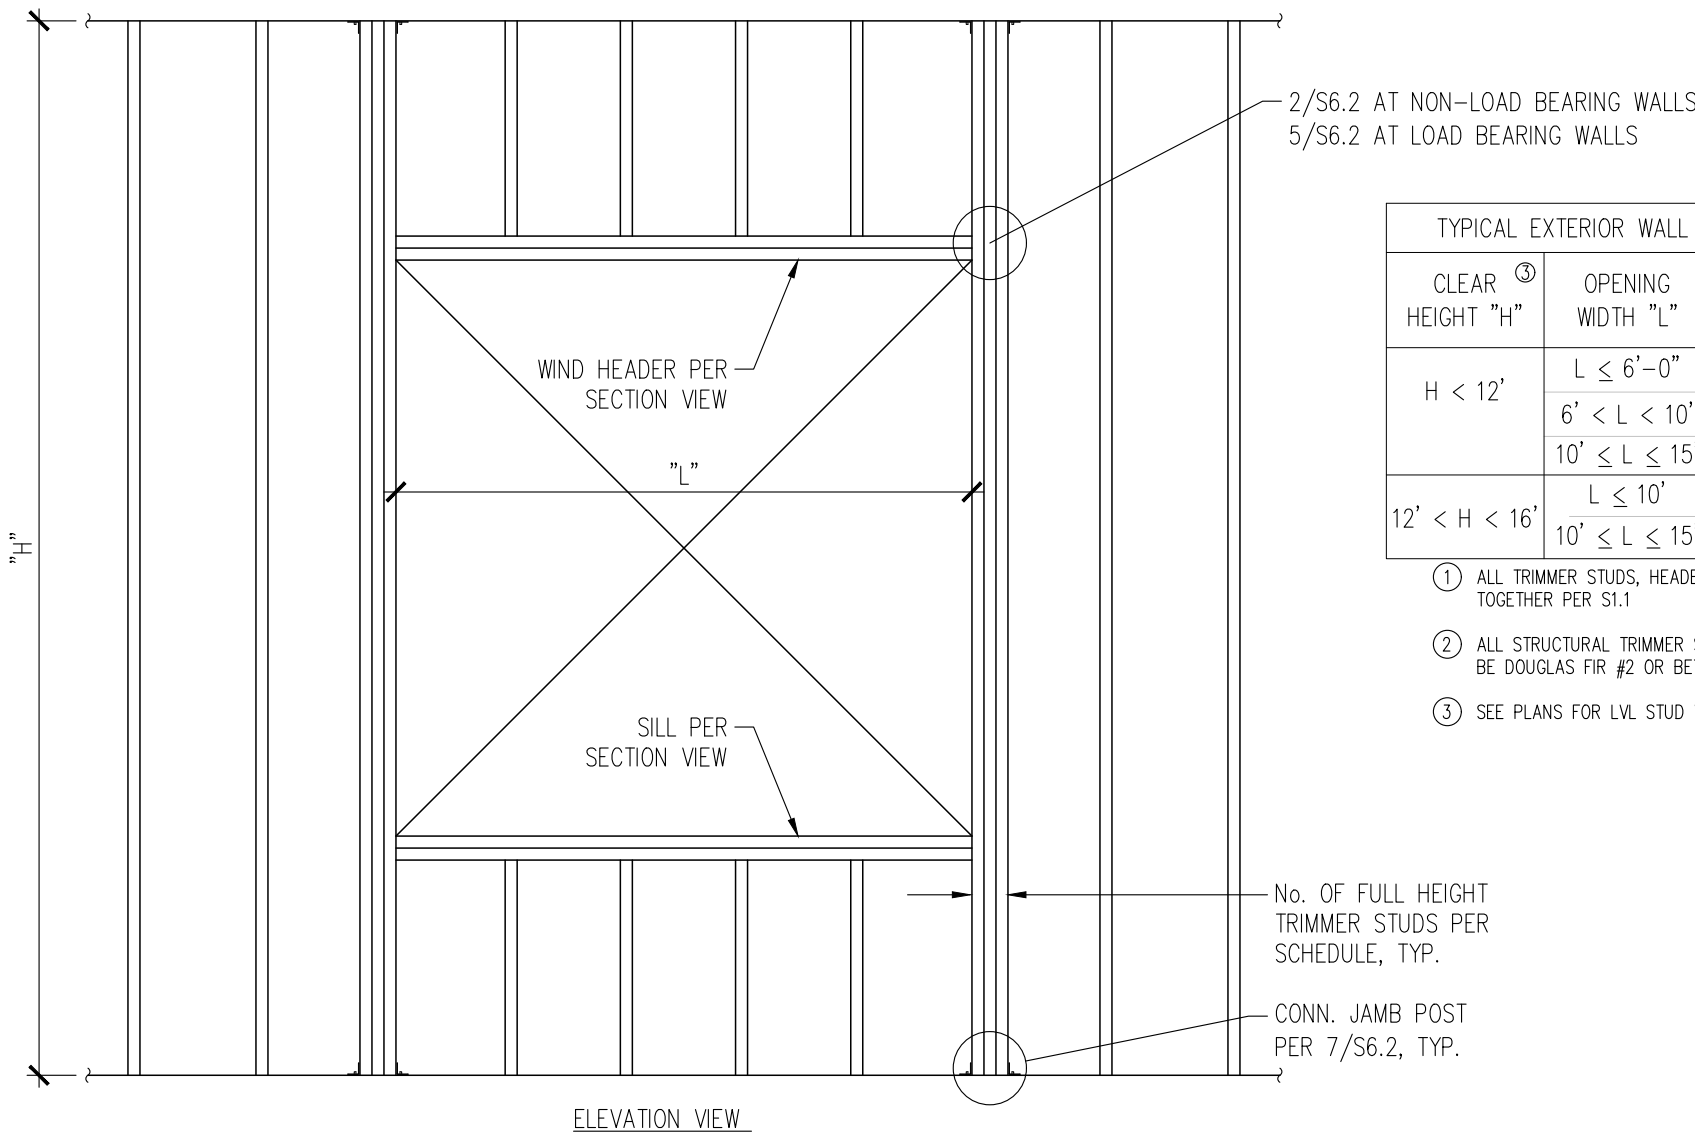

4
S6.2 TYPICAL WIND HEADER
NTS

TYPICAL EXTERIOR WALL OPENING FRAMING SCHEDULE ②			
CLEAR ① HEIGHT "H"	OPENING WIDTH "L"	HDR./SILL TYPE PER SECTION AT RIGHT	No. OF FULL HEIGHT TRIMMER STUDS ③
H < 12'	L ≤ 6'-0"	A	2
	6' < L < 10'	B	2
	10' ≤ L ≤ 15'	C	3
12' < H < 16'	L ≤ 10'	B	3
	10' ≤ L ≤ 15'	C	6x8

- ① ALL TRIMMER STUDS, HEADERS, AND SILLS SHALL BE NAILED TOGETHER PER S1.1
- ② ALL STRUCTURAL TRIMMER STUDS, SILLS, AND HEADERS SHALL BE DOUGLAS FIR #2 OR BETTER
- ③ SEE PLANS FOR LVL STUD WALL LOCATIONS, WHERE APPLICABLE

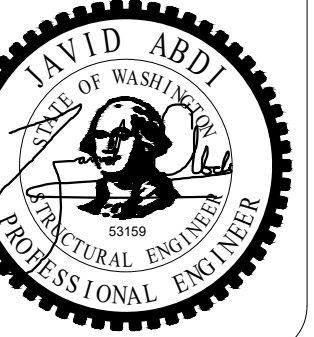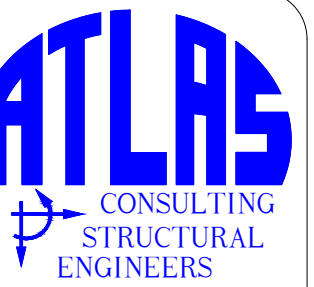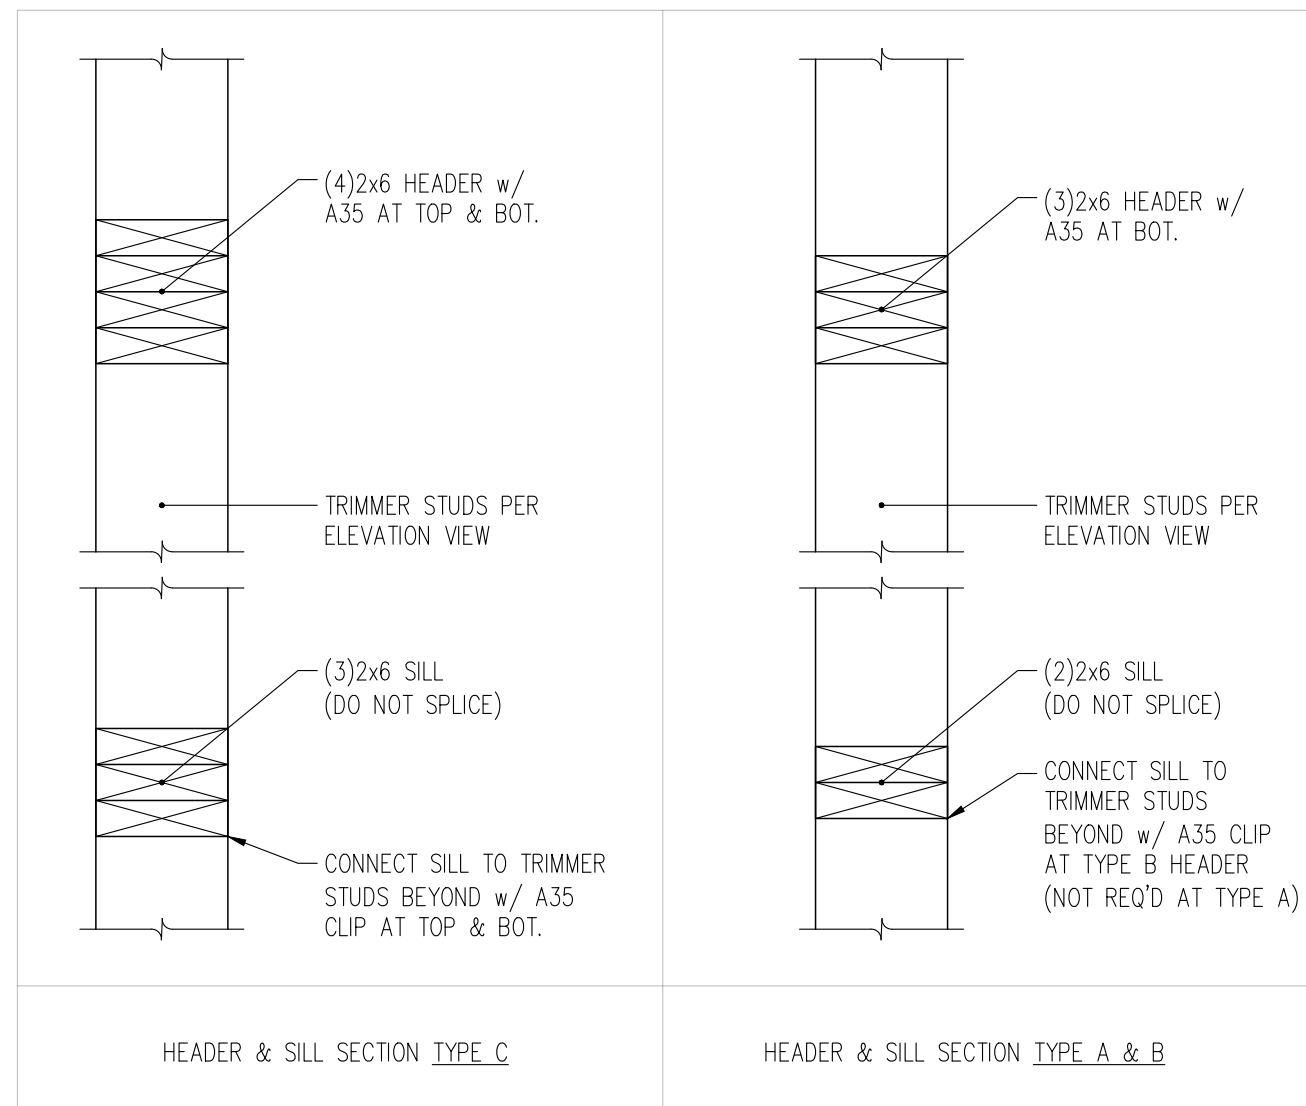


Yageneh Residence
3029 62nd Ave SE - Mercer Island


CONTENTS
Typical Framing
Details

DRAWN BY
JDA
DATE
05.27.24


S6.2

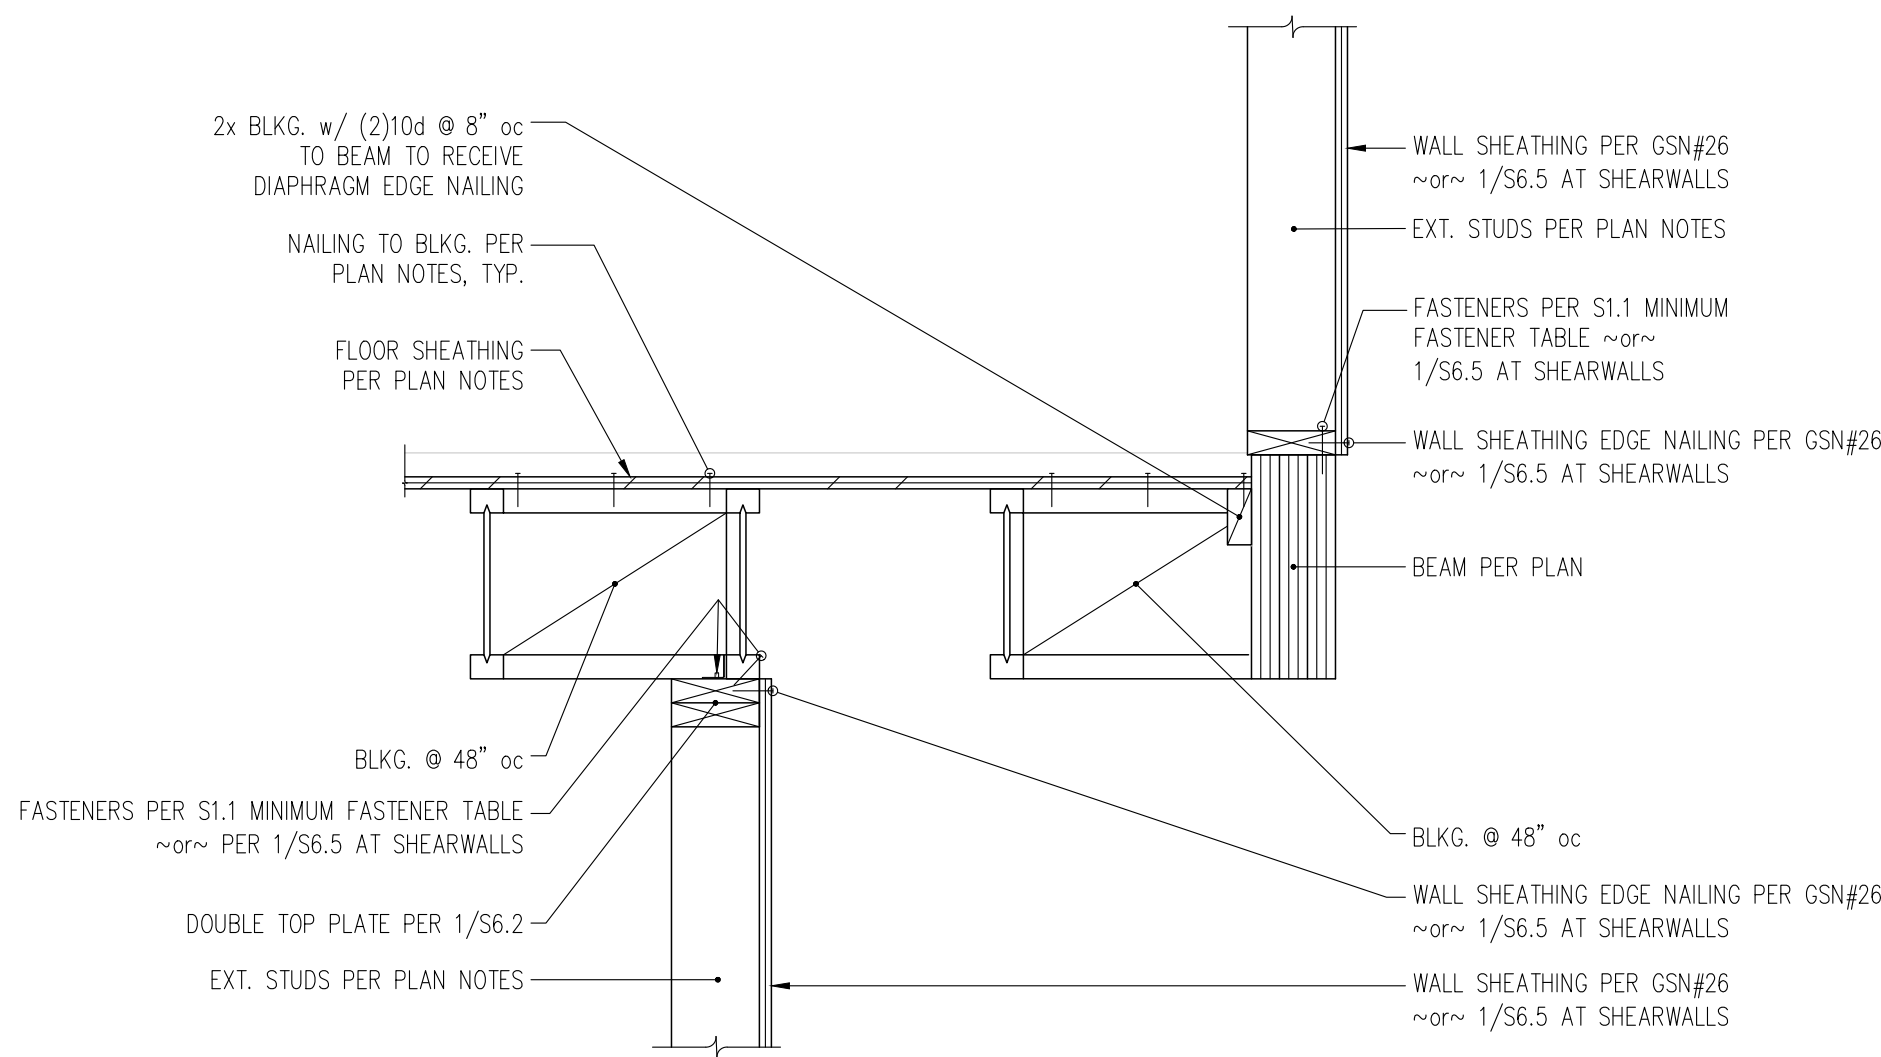


9
S6.3 SECTION AT OFFSET EXTERIOR WALL AND PARALLEL JOISTS
1" = 1'-0"

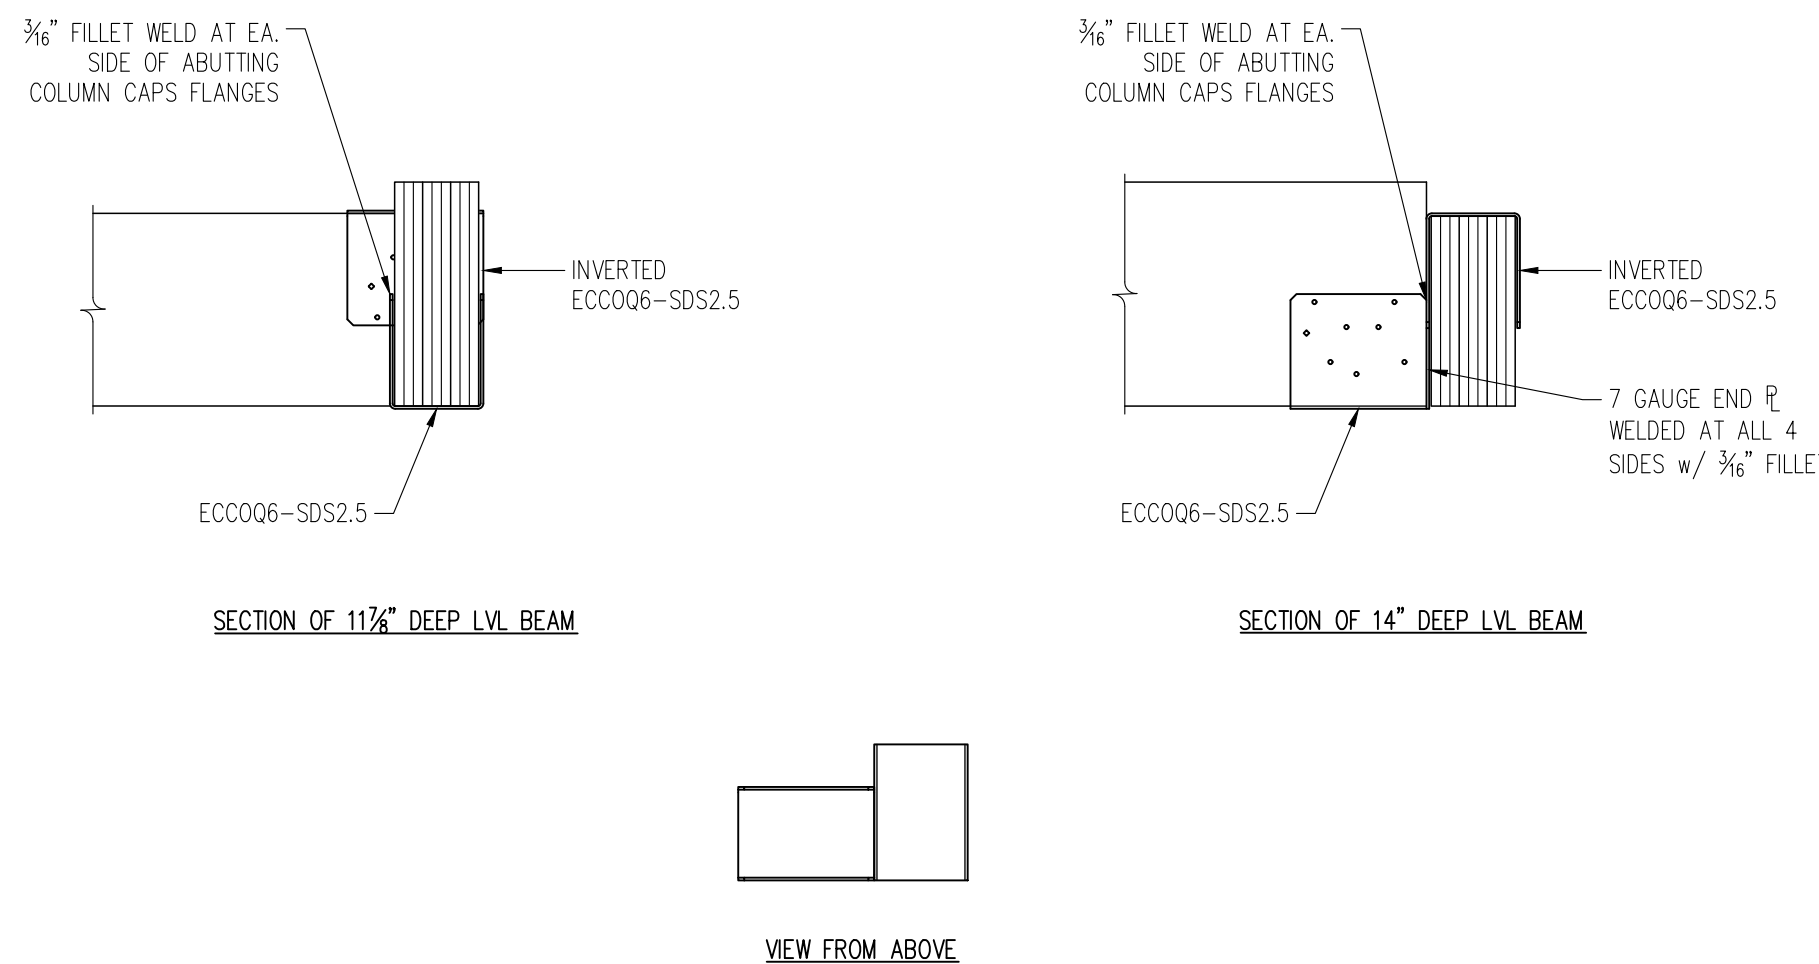


6
S6.3 COLUMN CAP ASSEMBLY BEAM SEAT HANGER
1" = 1'-0"

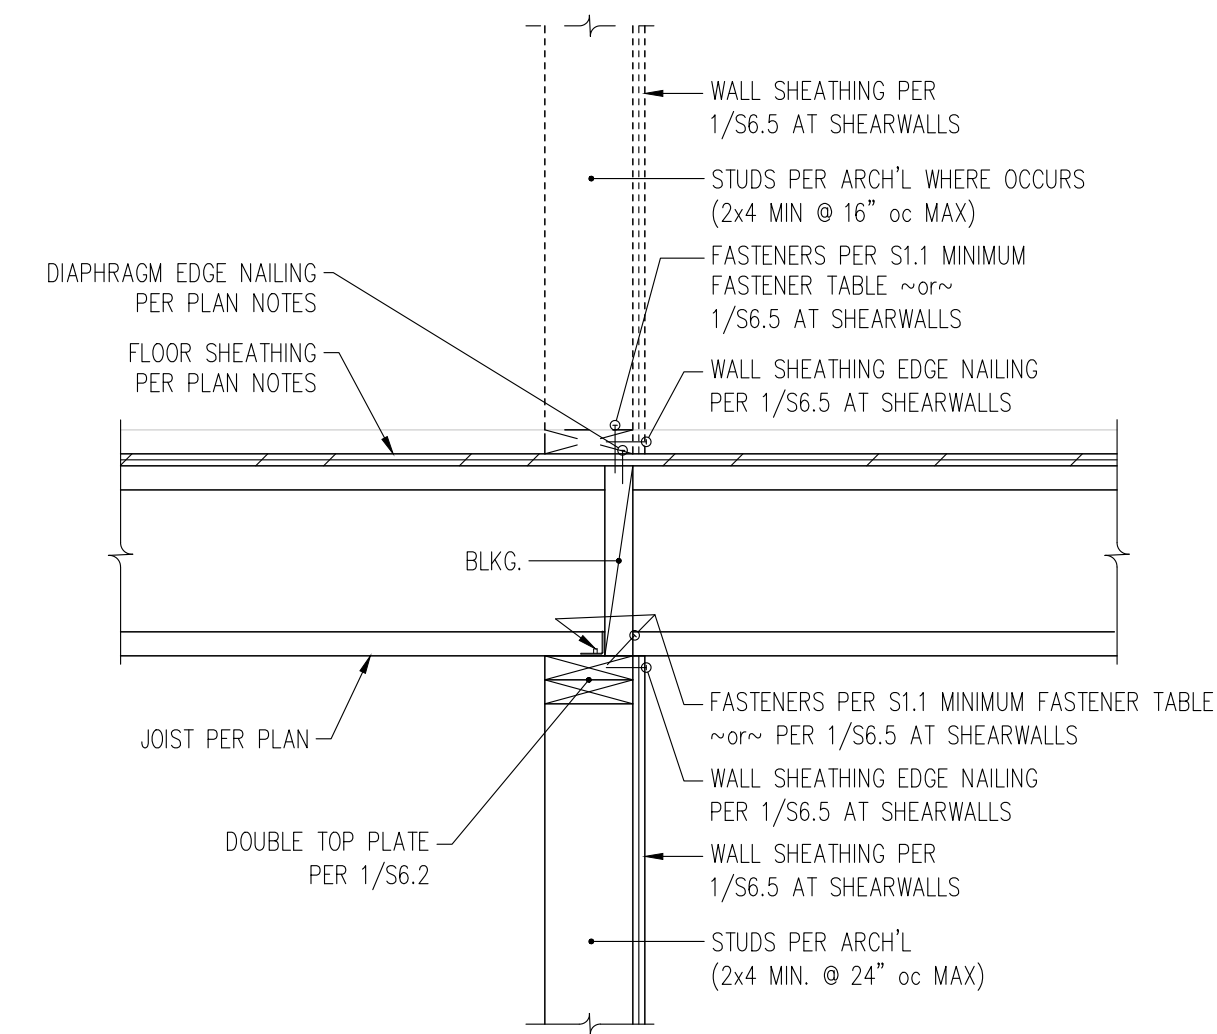


3
S6.3 SECTION THROUGH INTERIOR STRUCTURAL WALL AT PERPENDICULAR JOISTS
1" = 1'-0"

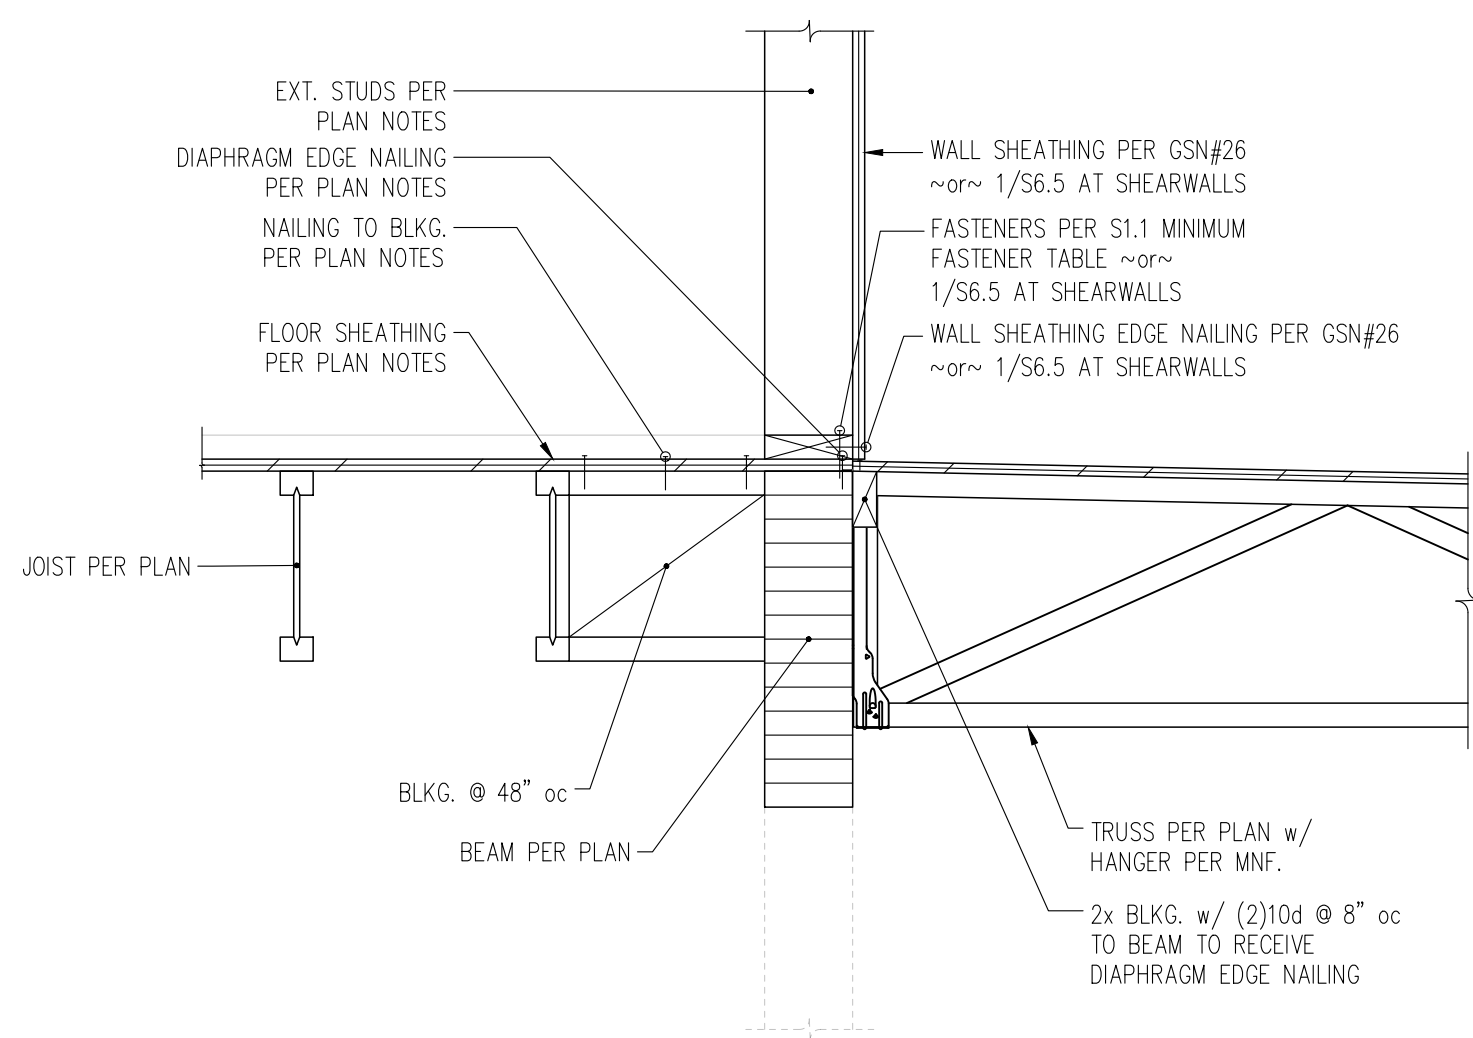


8
S6.3 SECTION THROUGH INTERIOR WALL ABOVE PARALLEL JOISTS AND PERP. ROOF DECK TRUSS
1" = 1'-0"

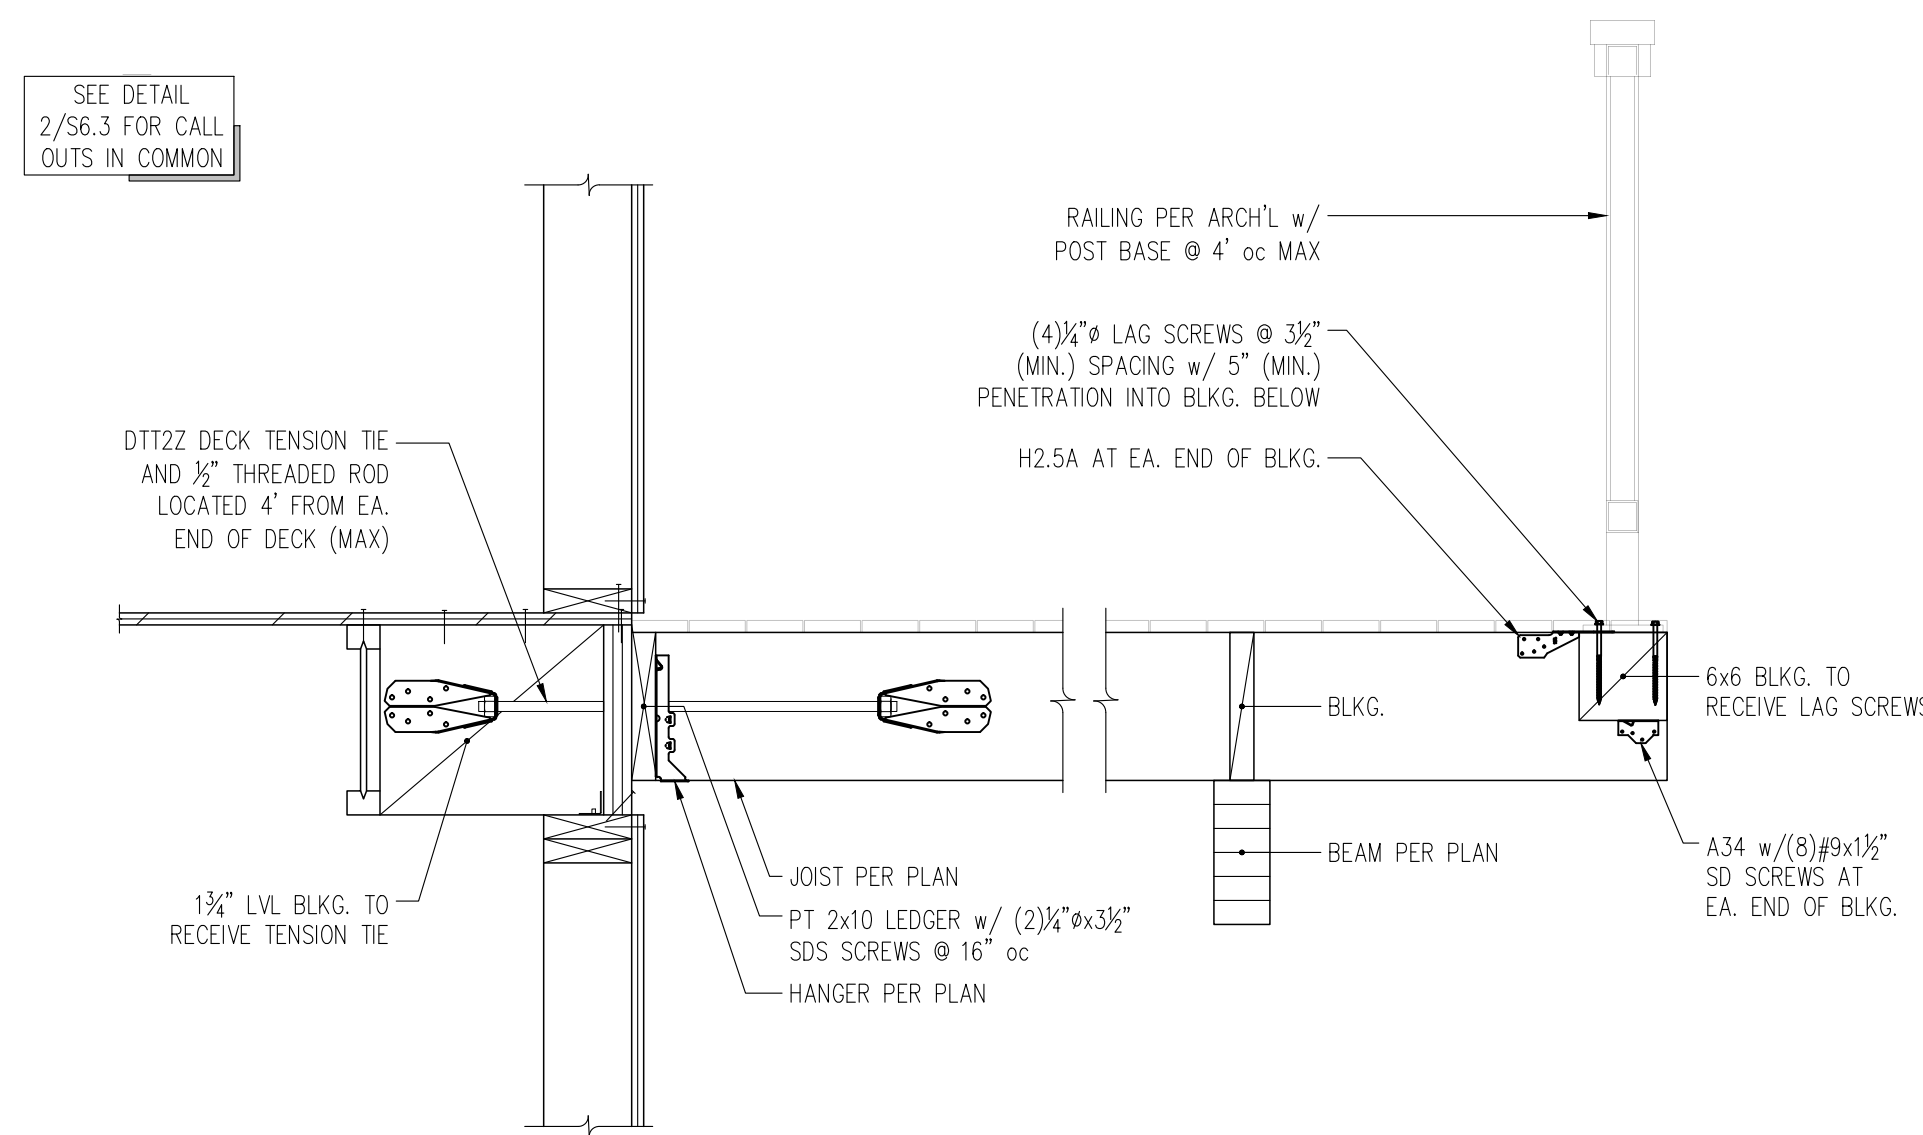


5
S6.3 SECTION THROUGH EXTERIOR WALL AT PARALLEL JOISTS AND PERPENDICULAR DECK JOISTS
1" = 1'-0"

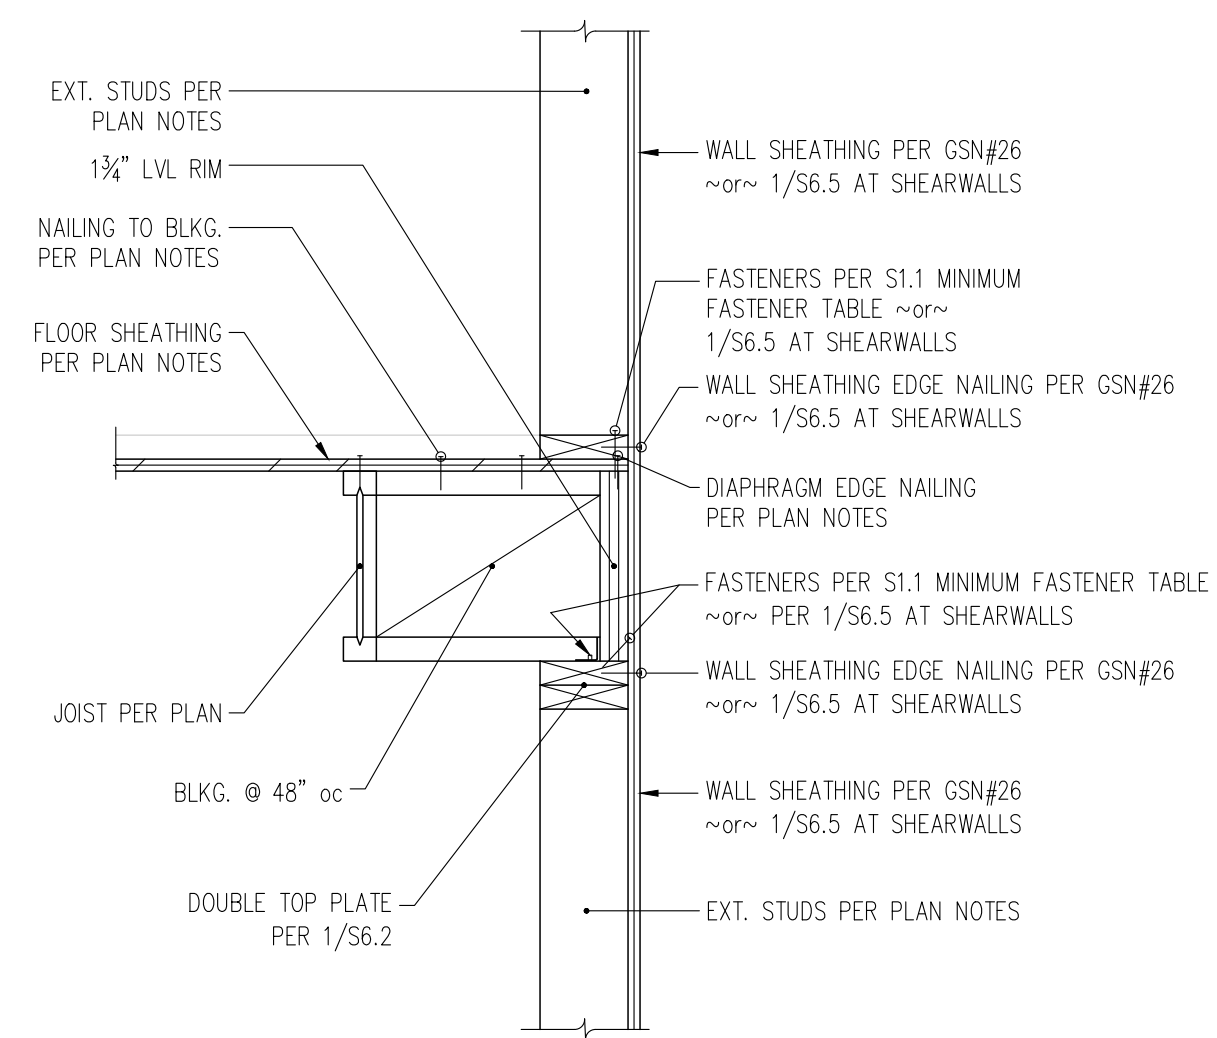


2
S6.3 SECTION THROUGH EXTERIOR WALL AT PARALLEL JOISTS
1" = 1'-0"

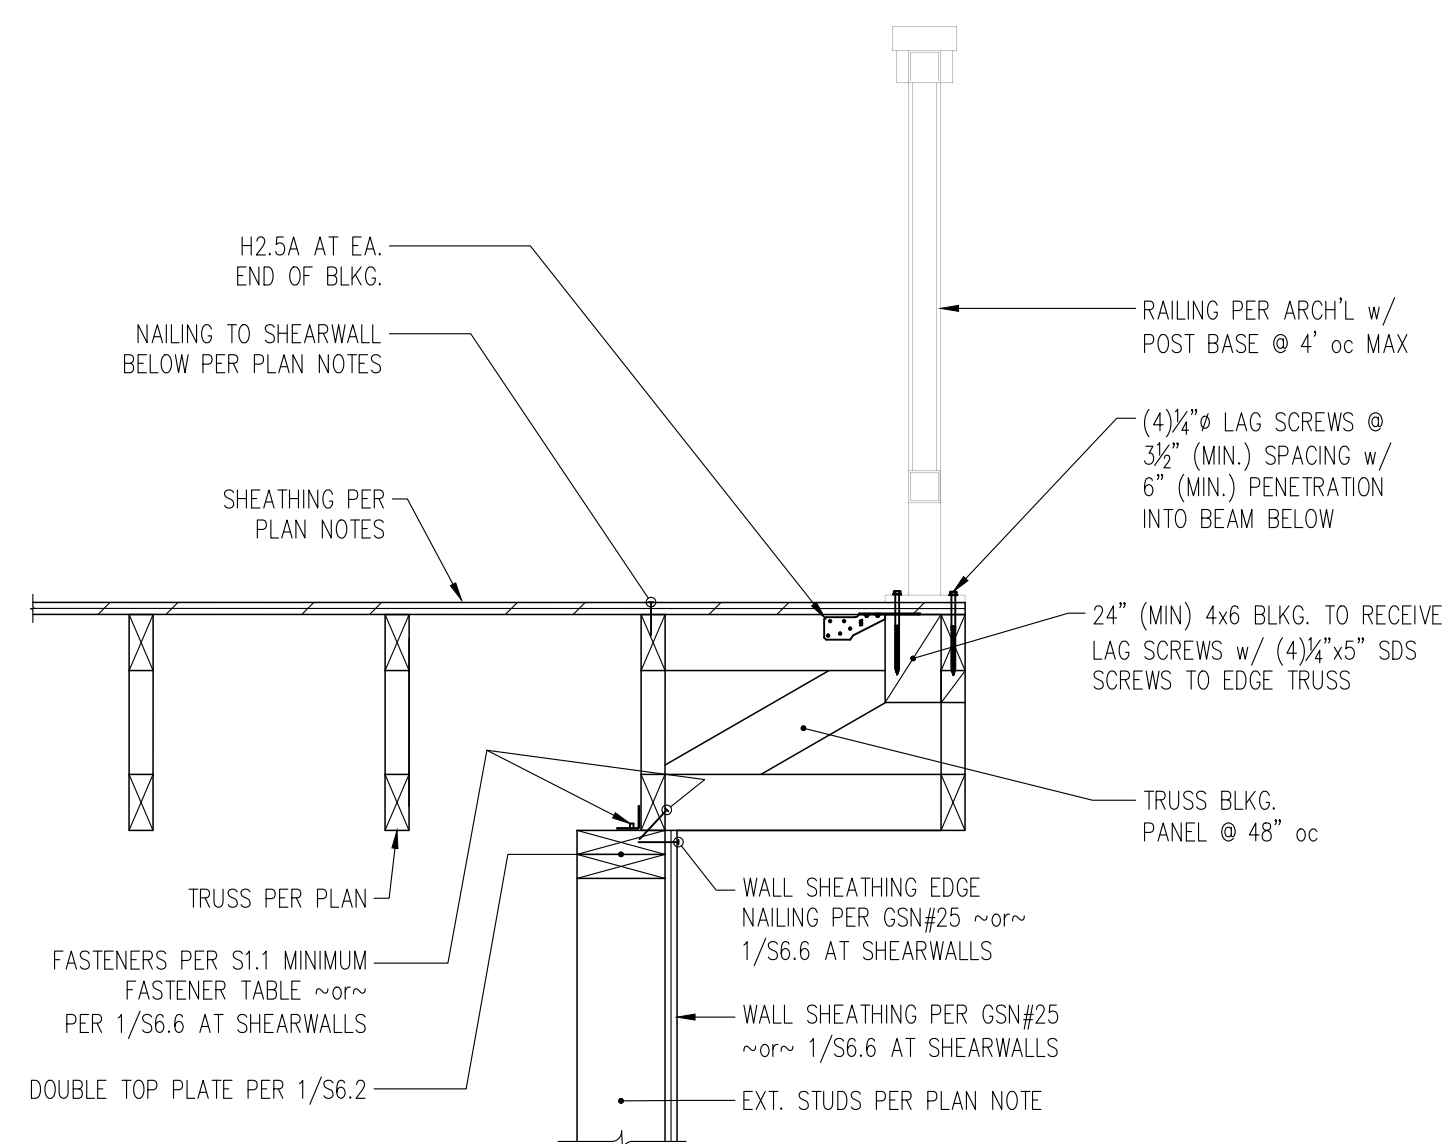




7
S6.3 SECTION THROUGH EXTERIOR WALL AT OFFSET PARALLEL ROOF DECK TRUSS
1" = 1'-0"

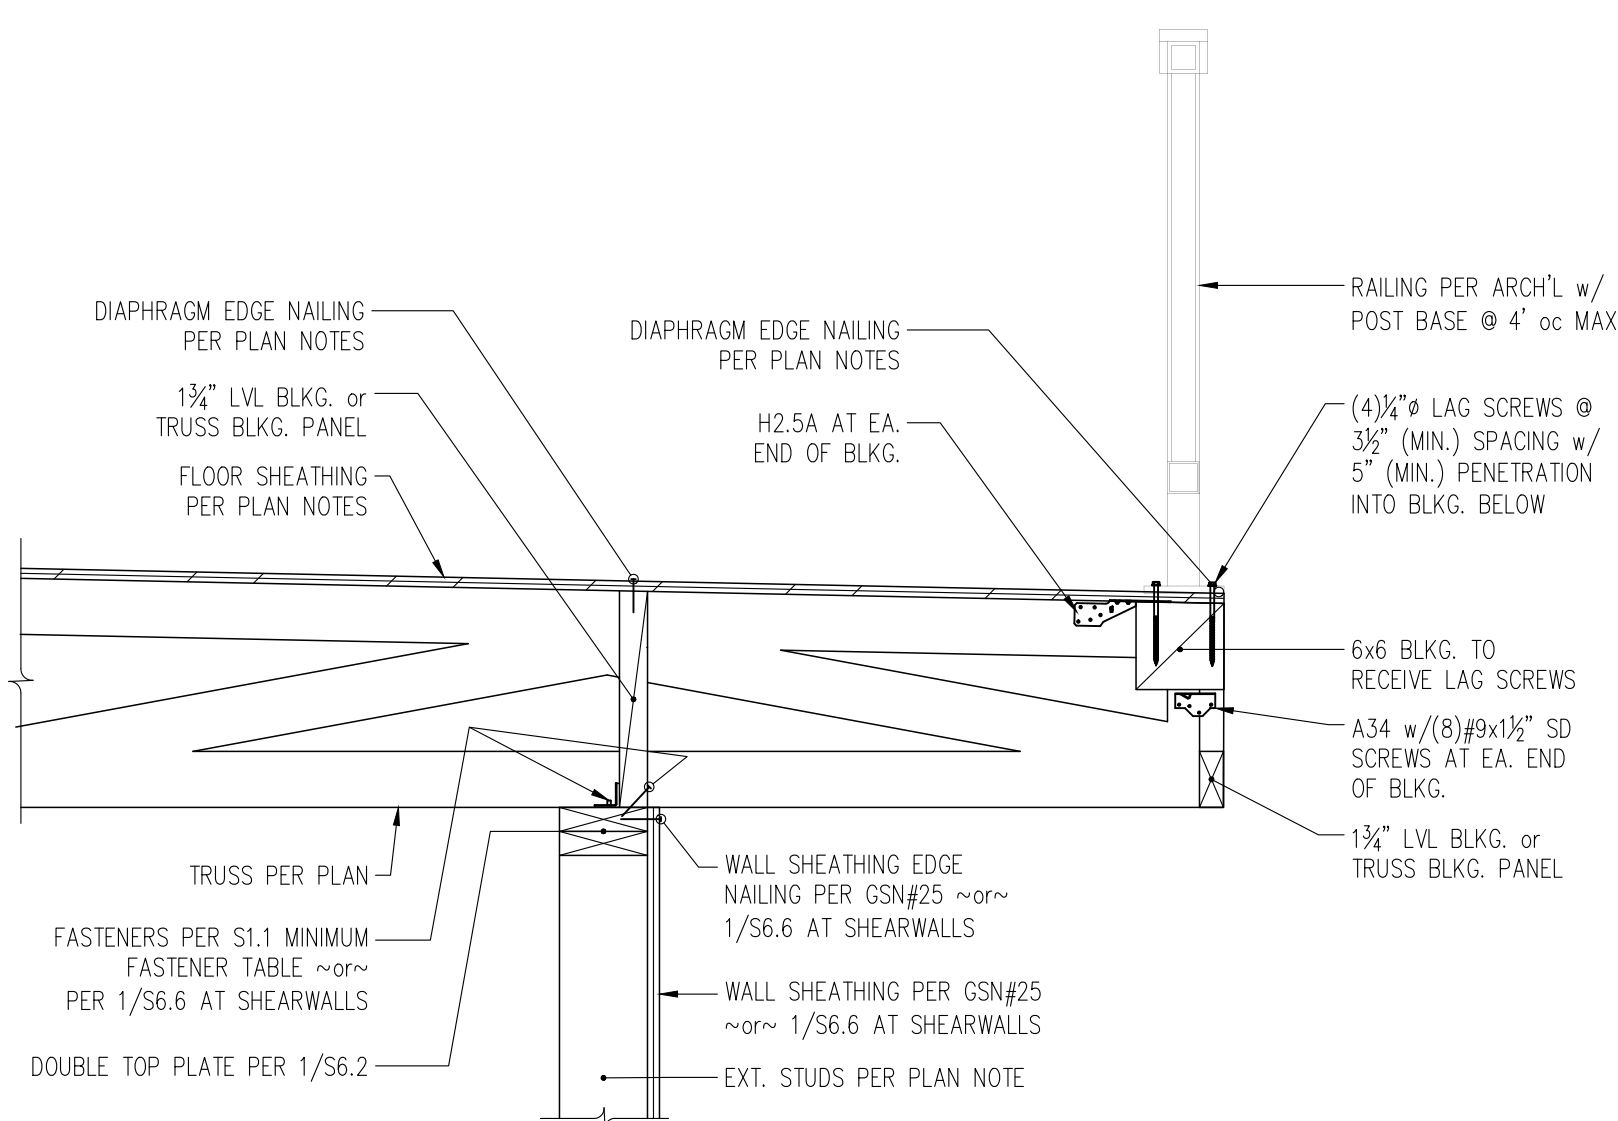

4
S6.3 SECTION THROUGH EXTERIOR WALL AT PERPENDICULAR CANTILEVERED ROOF DECK TRUSS
1" = 1'-0"

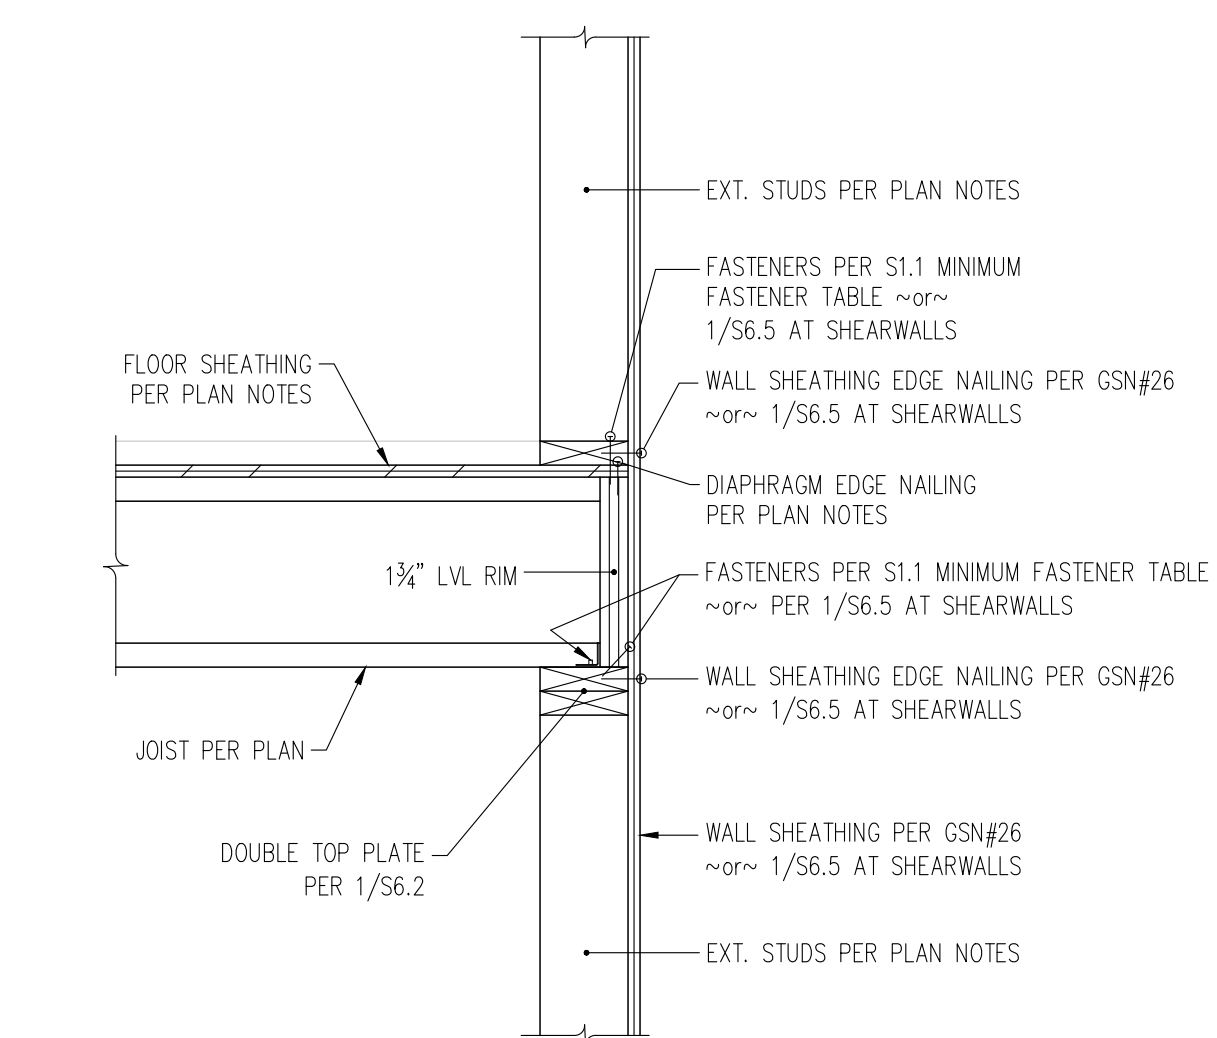

1
S6.3 SECTION THROUGH EXTERIOR WALL AT PERPENDICULAR JOISTS
1" = 1'-0"

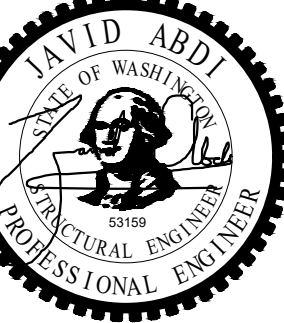


Yageneh Residence
3029 62nd Ave SE - Mercer Island


CONTENTS
Floor Framing
Details

DRAWN BY
JDA
DATE
05.27.24


S6.3

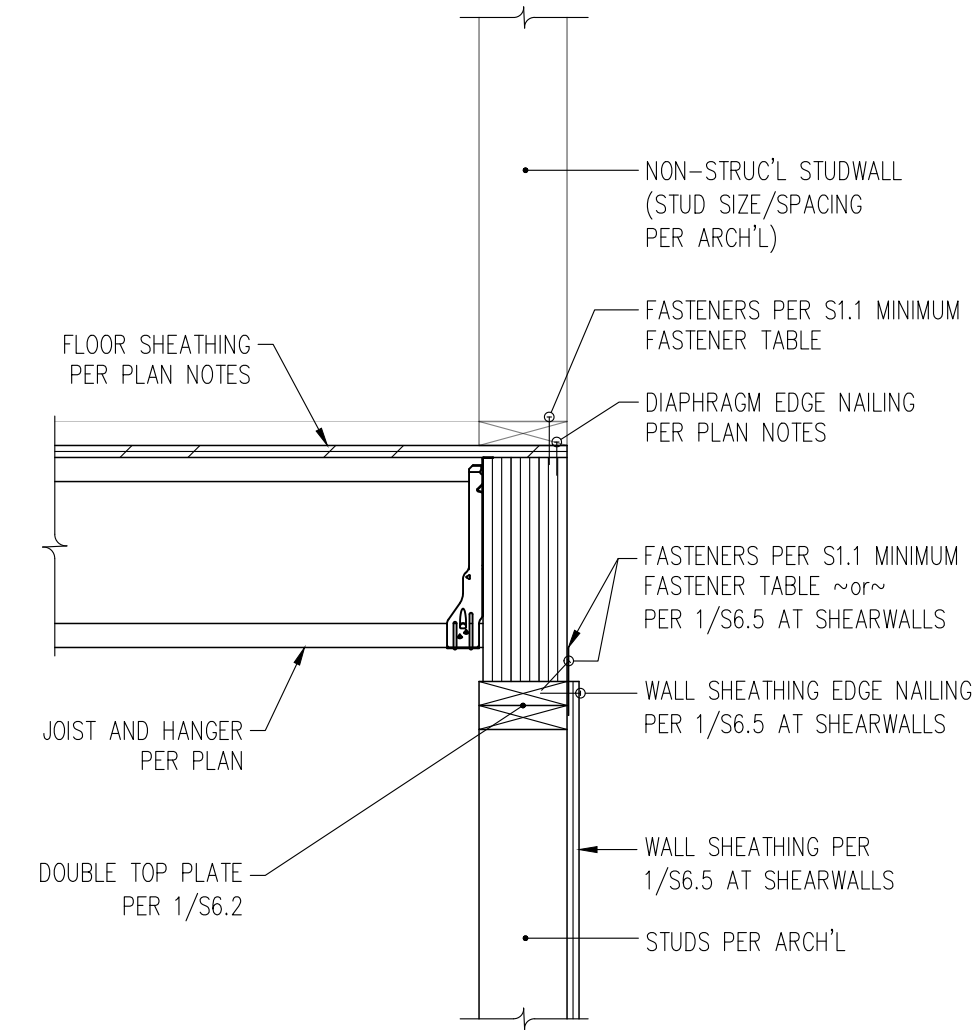




3
S6.4 SECTION THROUGH DEEP CANTILEVERED BEAM AT PERPENDICULAR JOISTS
1" = 1'-0"

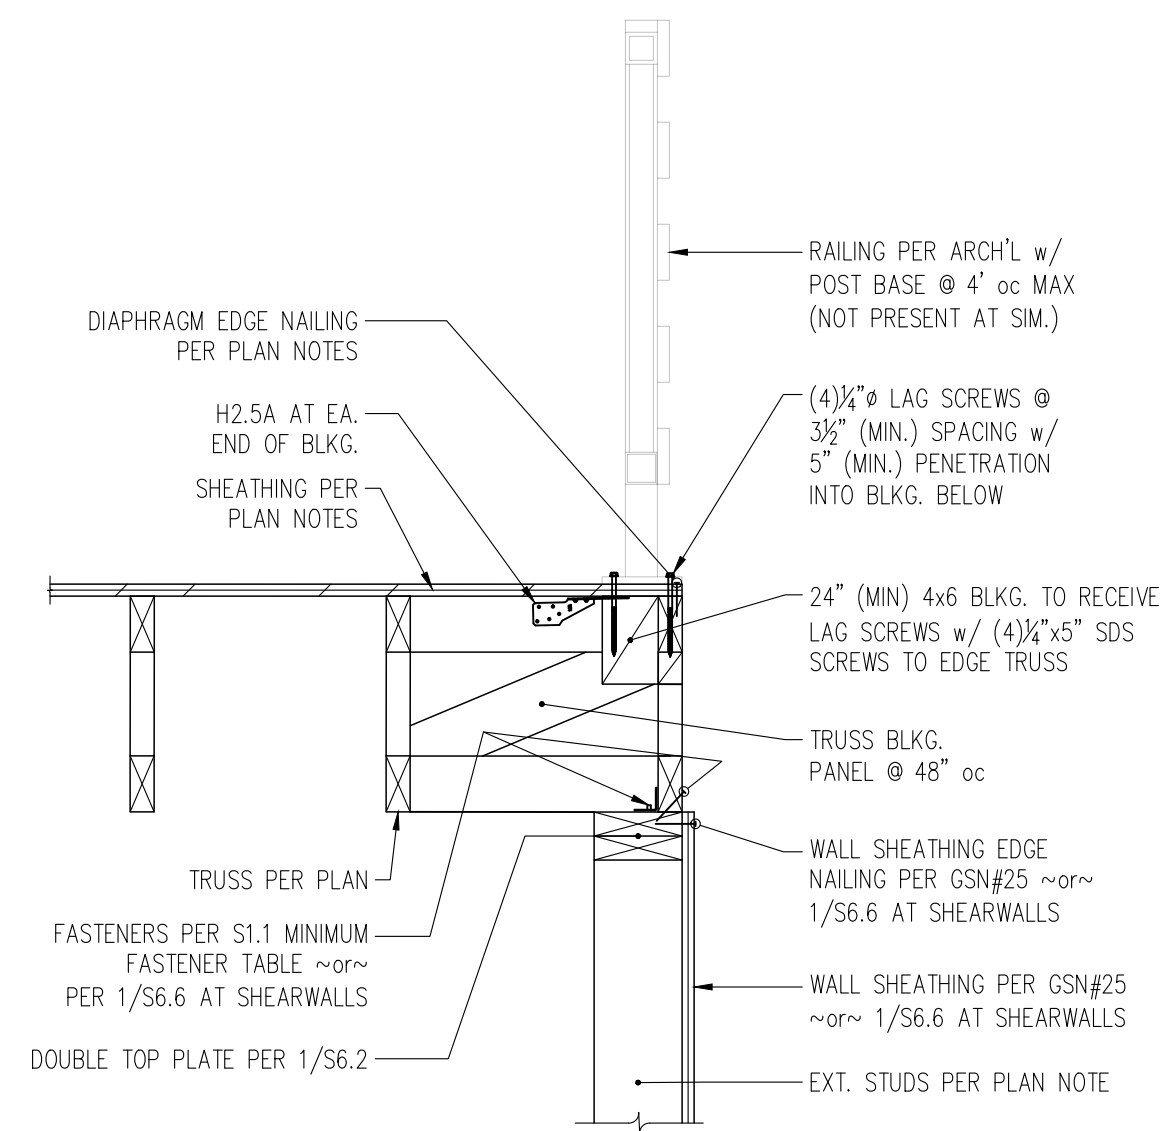

2
S6.4 SECTION THROUGH EXTERIOR WALL AT OFFSET PARALLEL ROOF DECK TRUSS
1" = 1'-0"

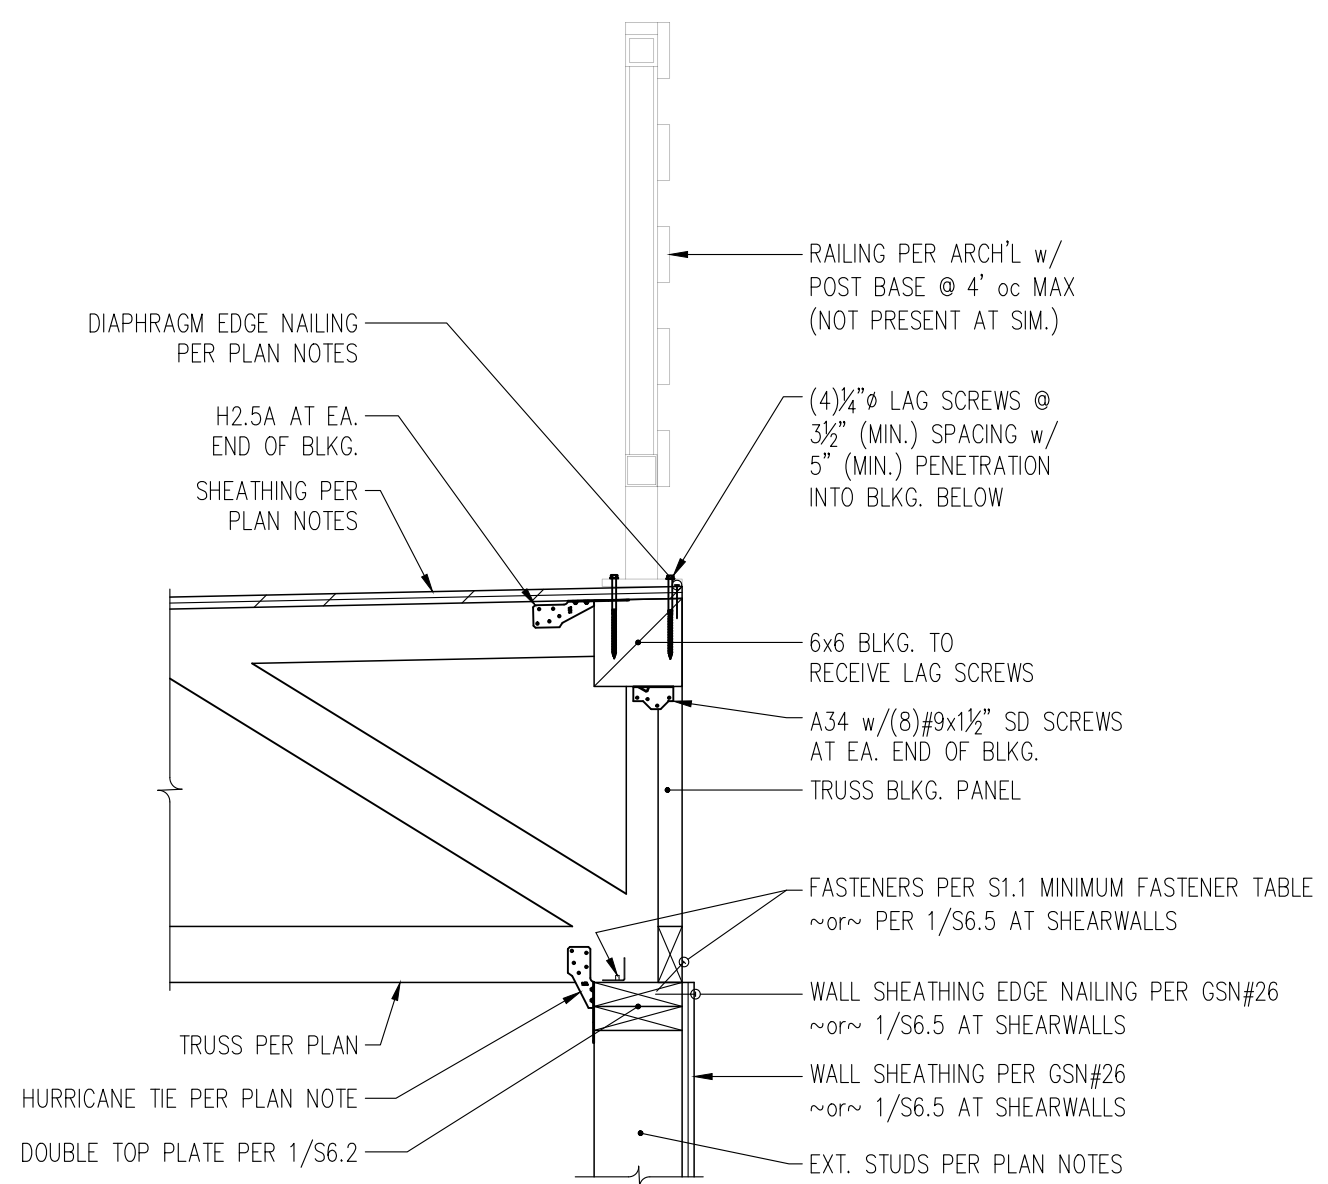

1
S6.4 SECTION THROUGH EXTERIOR WALL AT PERPENDICULAR TRUSS
1" = 1'-0"

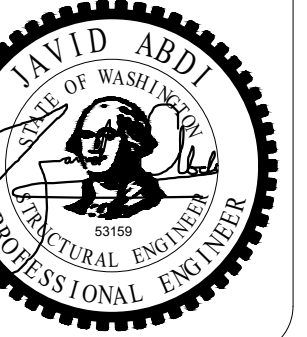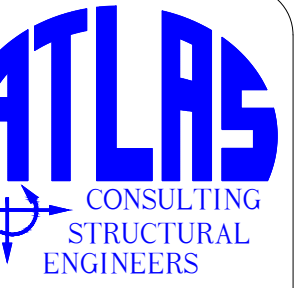


Yageneh Residence
3029 62nd Ave SE - Mercer Island

CONTENTS
Roof Framing
Details

DRAWN BY
JDA
DATE
05.27.24



S6.4

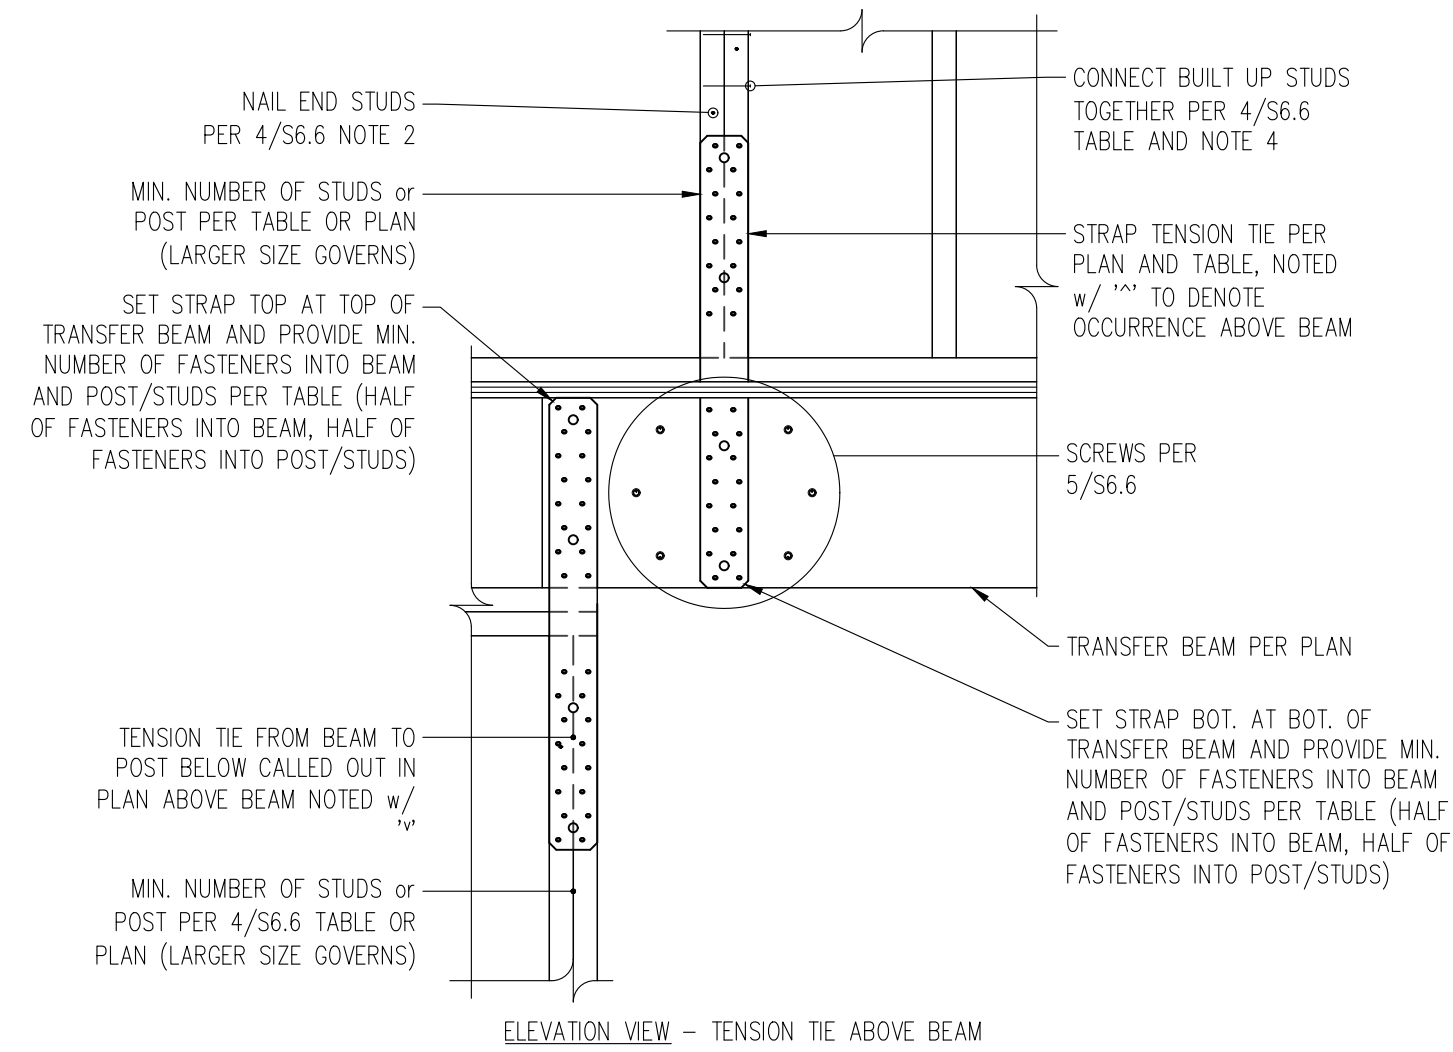

8 STRAP TENSION TIE ABOVE TRANSFER BEAM
S6.6 N.T.S.



STRAP TENSION TIE SCHEDULE				
TIE MARK	Min. # of studs	CLEAR SPAN AND TOTAL FASTENERS	ASD CAPACITY	BUILT-UP STUD FACE NAILS or SCREWS
MSTC28	(2)2x	18" - (12)0.148"ø x 3/4"	1,150#	10d @ 6" oc
MSTC40	(2)2x	18" - (28)0.148"ø x 3/4"	2,690#	10d @ 4" oc
MSTC52	(3)2x	18" - (44)0.148"ø x 3/4"	4,225#	(8)1/4"x4 1/2" SDS
MSTC66	(3)2x	18" - (64)0.148"ø x 3/4"	5,850#	(12)1/4"x6" SDS
(2)MSTC52	(4)2x	18" - (64)0.148"ø x 3/4"	7,750#	(14)1/4"x6" SDS
(2)MSTC66	6x6	18" - (64)0.148"ø x 3/4"	9,800#	(12)1/4"x6" SDS

- TENSION TIE TYPES REFER TO SIMPSON STRONG-TIE CATALOG CALLOUTS.
 - NAIL PLYWOOD SHEATHING TO STUDS RECEIVING HOLDOWN WITH SCHEDULED PANEL EDGE NAILING. STAGGER NAILS SO THAT EACH STUD IS NAILED.
 - FASTENERS NOTED IN TABLE ABOVE REPRESENT THE TOTAL AMOUNT. FOR STRAPS, HALF OF THE FASTENERS SHALL BE PROVIDED INTO EACH STUD.
 - SCREWS SHALL BE SPACED EQUALLY ALONG FULL HEIGHT OF STUD ABOVE TENSION TIE. PROVIDE SCREWS AS NOTED IN TABLE AT ONE FACE OF BUILT-UP STUD, AND 10d @ 6" oc NAILS AT OPPOSITE FACE OF BUILT UP STUD.
- ^ DENOTES TENSION TIE THAT OCCURS ATOP OF A FRAMING MEMBER BELOW. FOR:
MSTC28 ^ - SET STRAP SO 1/2 OF FASTENERS ARE INSTALLED INTO BEAM, SEE 8/56.8 - 4 TOTAL SDW EWP-PLY SCREWS, SEE 5/56.6
HDU2 ^ - 3/8" LAG SCREW WITH 7" MINIMUM PENETRATION INTO BEAM - 6 TOTAL SDW EWP-PLY SCREWS, SEE 5/56.6

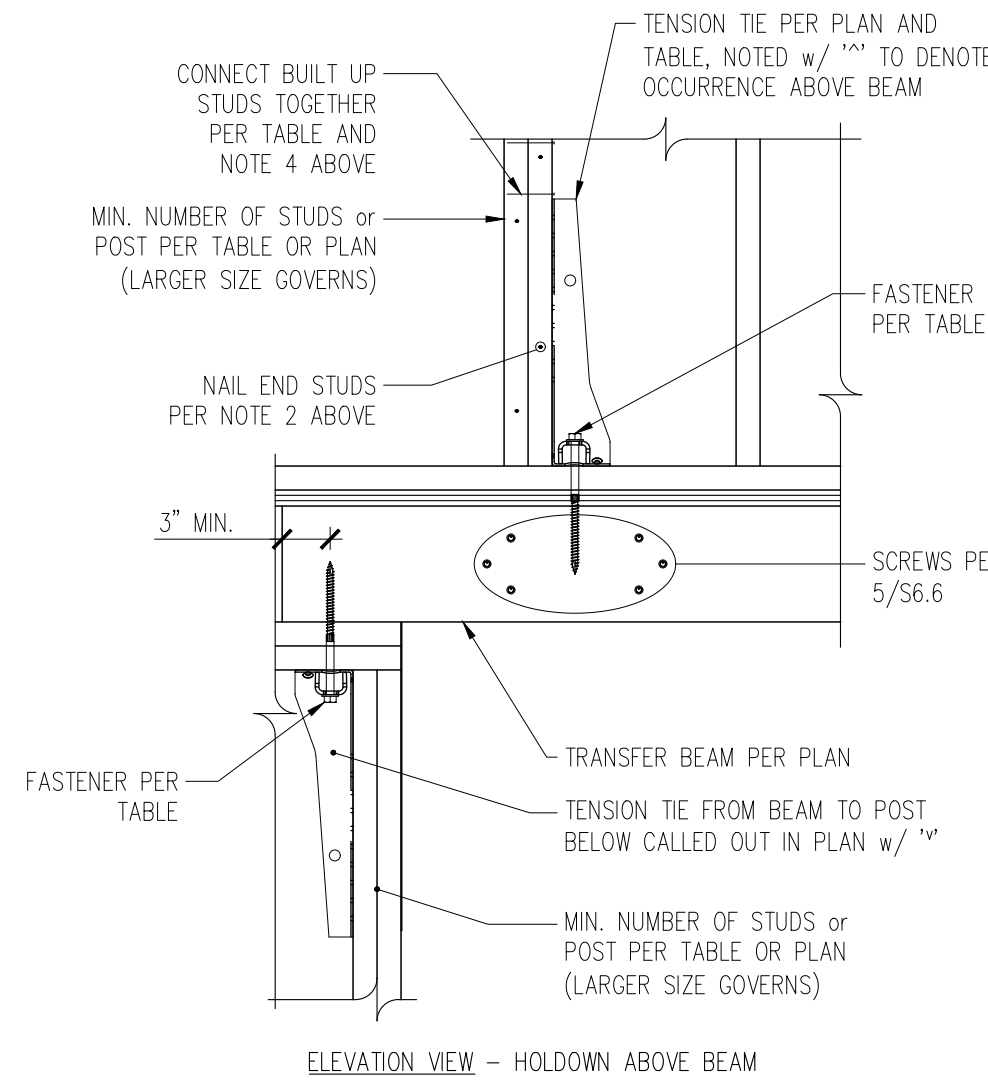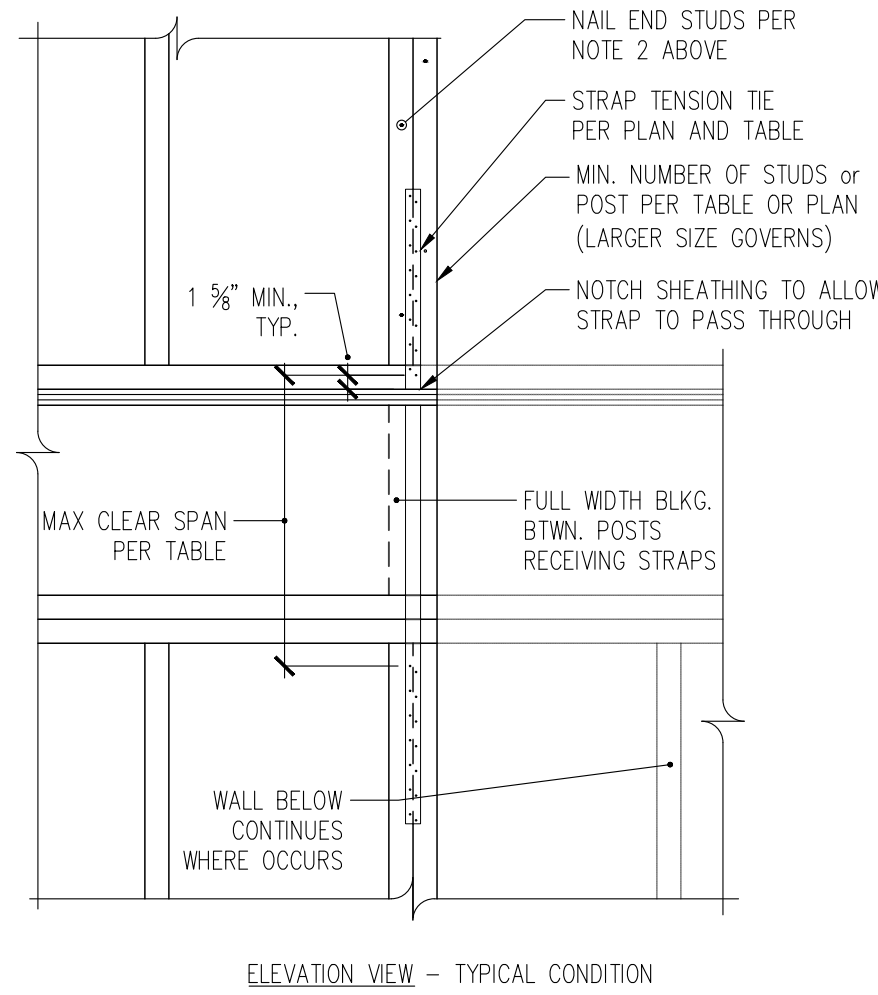

HOLDOWN TENSION TIE SCHEDULE					
TIE MARK	MIN. NUMBER OF STUDS	ANCHOR (ø x EMBEDMENT) and No. OF HAIRPIN DOWELS	FASTENERS FROM TIE TO STUD	ASD CAPACITY	BUILT-UP STUD FACE NAILS or SCREWS
HDU2	(2)2x	3/8"ø x 10" - (2)#4 HAIRPIN	(6)1/4"ø x 2 1/2" SDS SCREWS	3,075#	10d @ 4" oc
HDU4	(3)2x	3/8"ø x 10" - (2)#4 HAIRPIN	(10)1/4"ø x 2 1/2" SDS SCREWS	4,565#	(9)1/4"x4 1/2" SDS
HDU5	(3)2x	3/8"ø x 10" - (2)#4 HAIRPIN	(14)1/4"ø x 2 1/2" SDS SCREWS	5,645#	(10)1/4"x4 1/2" SDS
HDU8	(4)2x	3/8"ø x 10" - (4)#4 HAIRPIN	(20)1/4"ø x 2 1/2" SDS SCREWS	7,870#	(15)1/4"x6" SDS
HDU11	6x6	1"ø x 10" - (4)#4 HAIRPIN	(30)1/4"ø x 2 1/2" SDS SCREWS	11,175#	N/A
HDU14	6x6	1"ø x 10" - (6)#4 HAIRPIN	(36)1/4"ø x 2 1/2" SDS SCREWS	14,445#	N/A

- TENSION TIE TYPES REFER TO SIMPSON STRONG-TIE CATALOG CALLOUTS.
- NAIL PLYWOOD SHEATHING TO STUDS RECEIVING HOLDOWN WITH SCHEDULED PANEL EDGE NAILING. STAGGER NAILS SO THAT EACH STUD IS NAILED.
- ANCHORS SHALL BE HEAVY HEX HEAD WITH DOUBLE NUT CAST INTO CONCRETE.
ASTM F 1554 Gr. 36 FOR 3/8"ø ANCHOR
ASTM F 1554 Gr. 55 FOR 3/8"ø AND 1"ø ANCHORS
- SCREWS SHALL BE SPACED EQUALLY ALONG FULL HEIGHT OF STUD ABOVE TENSION TIE. PROVIDE SCREWS AS NOTED IN TABLE AT ONE FACE OF BUILT-UP STUD, AND 10d @ 6" oc NAILS AT OPPOSITE FACE OF BUILT UP STUD.

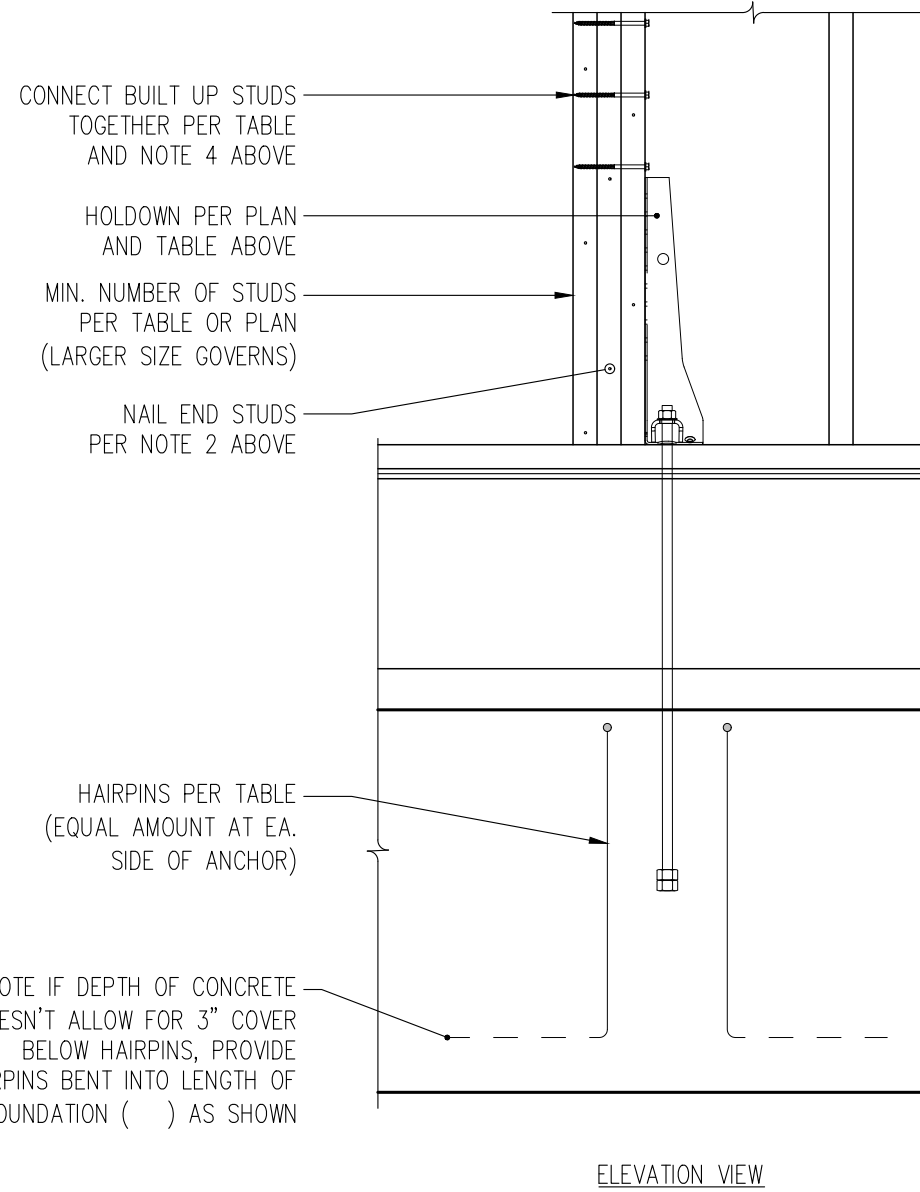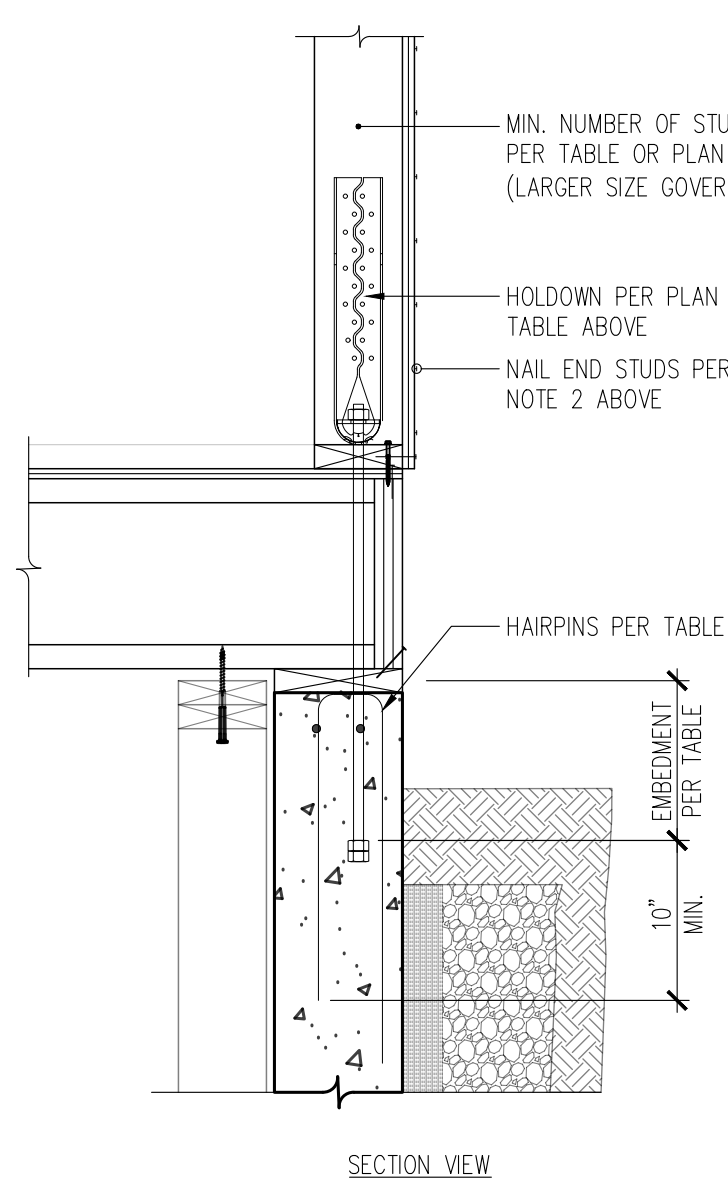


4 HOLDOWN DETAIL AND SCHEDULE
S6.5 1" = 1'-0"


TENSION TIE ABOVE BEAM				
TIE MARK	Min. # of studs	FASTENERS	ASD CAPACITY	BUILT-UP STUD FACE NAILS or SCREWS
MSTC28 ^ v	(2)2x	(16)0.148"ø x 3/4"	1,400#	10d @ 4" oc
HDU2 ^ v	(2)2x	(6)1/4"ø x 2 1/2" SDS SCREWS	3,000#	10d @ 4" oc

SHEARWALL PANEL TYPE	① SHEATHING THICKNESS	② 0.148" x 2 1/2" PANEL NAILING	③ STUD/BLKG. AT ABUTTING PANEL EDGES & SILL PLATE THICKNESS	⑦ CONN. OF BLKG. OR FRAMING to TOP PLATE; AND SOLE PLATE TO SILL PLATE			⑧ ANCHOR BOLTS TO CONC.	⑨ 3/4"ø	ASD CAPACITY, PLF
				④ 1/4"ø x 3 1/2" SDS SCREWS	⑤ A35 CLIPS	⑥ LTP4 PLATES			
SW-6	1/2"	6" oc	2x	15" oc	25" oc	24" oc	48" oc	48" oc	310
SW-4	1/2"	4" oc	3x	10" oc	16" oc	16" oc	38" oc	48" oc	460
SW-3	1/2"	3" oc	3x	8" oc	13" oc	12" oc	29" oc	40" oc	600
SW-2	1/2"	2" oc	3x	6" oc	10" oc	9" oc	23" oc	31" oc	770
SW-44	1/2"	4" oc EA. SIDE	3x	5" oc	8" oc	8" oc	19" oc	26" oc	920
SW-33	1/2"	3" oc EA. SIDE	3x	4" oc	6" oc	6" oc	14" oc	20" oc	1200
SW-22	1/2"	2" oc EA. SIDE	3x	3" oc	5" oc	4" oc	11" oc	15" oc	1540

- SHEATHING SHALL CONSIST OF 1/2" PLYWOOD AND HAVE A MINIMUM SPAN RATING OF 2 1/2" AT INTERIOR SHEARWALLS ONLY. 1 1/2" OSB MAY BE USED
- PANEL NAILING APPLIES TO ALL SHEATHING PANEL EDGES. INSTALL BLOCKING AT ALL UNFRAMED PANEL EDGES. ENSURE SHEATHING IS NAILED TO ALL INTERMEDIATE STUDS/BLOCKING WITH PANEL NAILS AT 12" oc
- DOUBLE 2x MEMBERS MAY BE SUBSTITUTED FOR 3x MEMBERS AT WALLS WITH ONLY ONE LAYER OF SHEATHING. 2x MEMBERS SHALL BE NAILED TOGETHER WITH 8d FACE. @ 4" oc FOR SW-6, @ 3" oc FOR SW-4, @ 2" oc FOR SW-3, AND (2)@ 3" oc FOR SW-2 (116#/NAIL)
- ROWS OF NAILS AND SDS SCREWS SHALL BE OFFSET AT LEAST 1/2" AND STAGGERED. MINIMUM EDGE DISTANCE FOR NAILS AND SDS SCREWS INTO EDGE OF MEMBERS SHALL BE 3/8" (400#/SCREW)
- A35 CLIPS SHALL BE INSTALLED w/ (12)0.131 x 1 1/2" NAILS (650#/CLIP)
- LTP4 LATERAL TIE PLATES MAY BE INSTALLED OVER SHEATHING w/ (12)0.131 x 2 1/2" NAILS (625#/CLIP)
- CONTRACTOR MAY USE EITHER SDS SCREWS OR LTP4 CLIPS TO CONNECT FIELD-INSTALLED BOTTOM PLATE TO RIM
- PLATE WASHERS IN 2x4 STUD WALLS AND ALL SINGLE SIDED SHEAR WALLS SHALL BE 3"x3"x0.229". DOUBLE SIDED 2x6 SHEAR WALLS SHALL HAVE 4 1/2"x3"x0.229" PLATE WASHERS. THE EDGE OF PLATE WASHERS SHALL BE LOCATED WITHIN 1/2" OF THE EDGE OF BOTTOM PLATE ON THE SIDE WITH SHEATHING.
- CAST ANCHORS A MINIMUM OF 7" INTO CONCRETE. INSTALL ADDITIONAL ANCHOR BOLTS AT EACH SIDE OF PLATE BREAKS AND PENETRATIONS EXCEEDING THE "NO REINFORCING" HOLE SIZE PER 2/56.1.



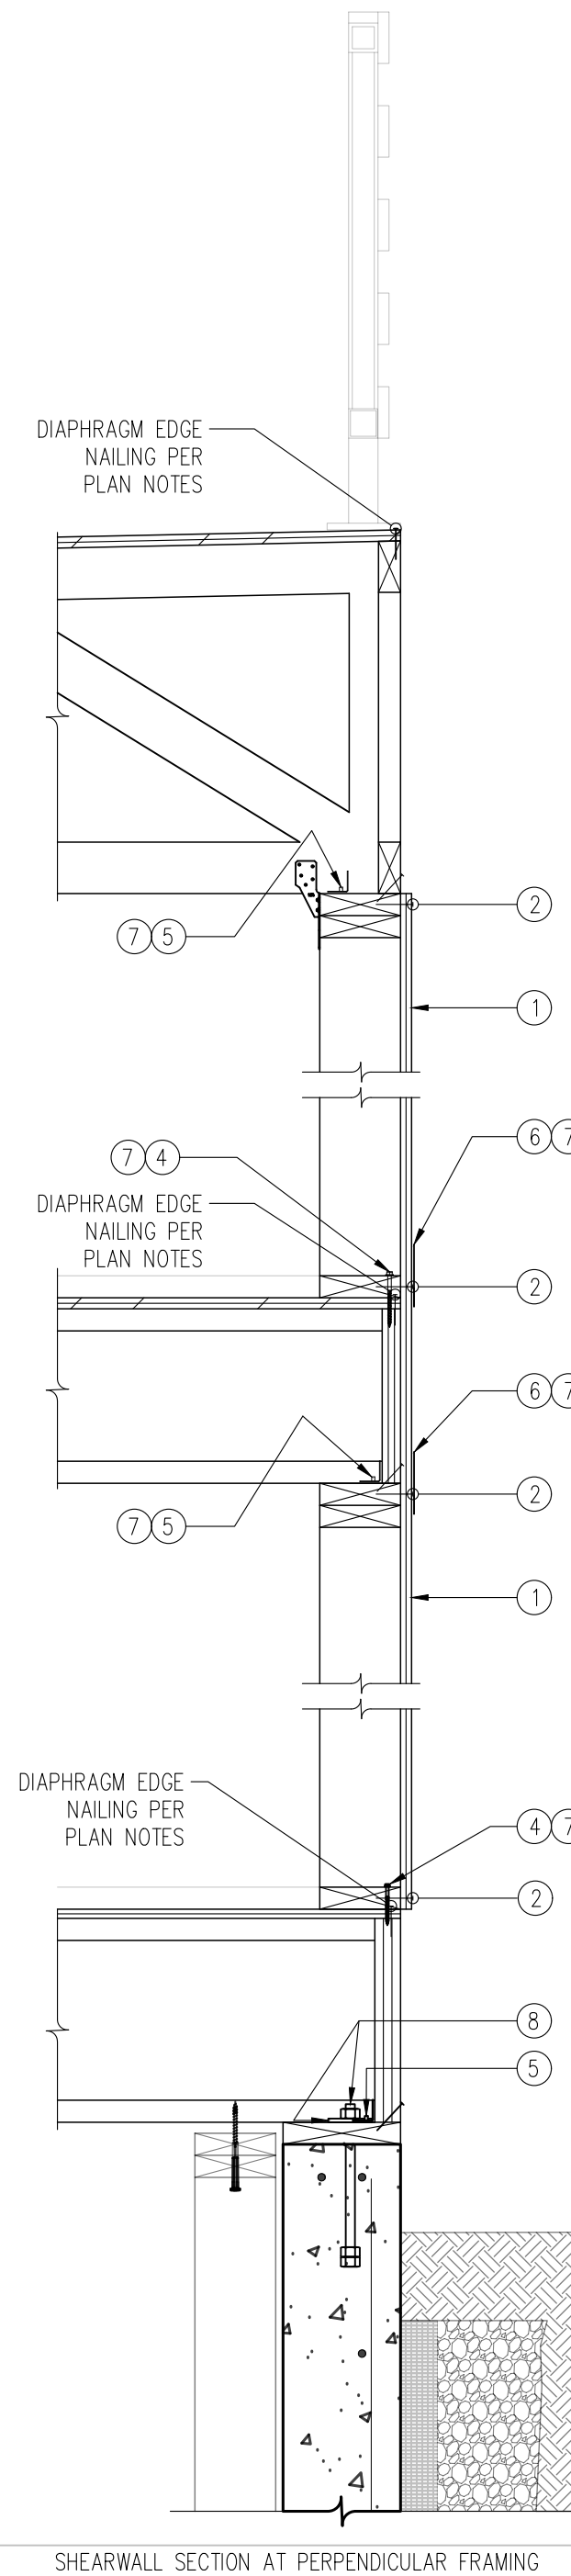


SHEARWALL SECTION AT PERPENDICULAR FRAMING

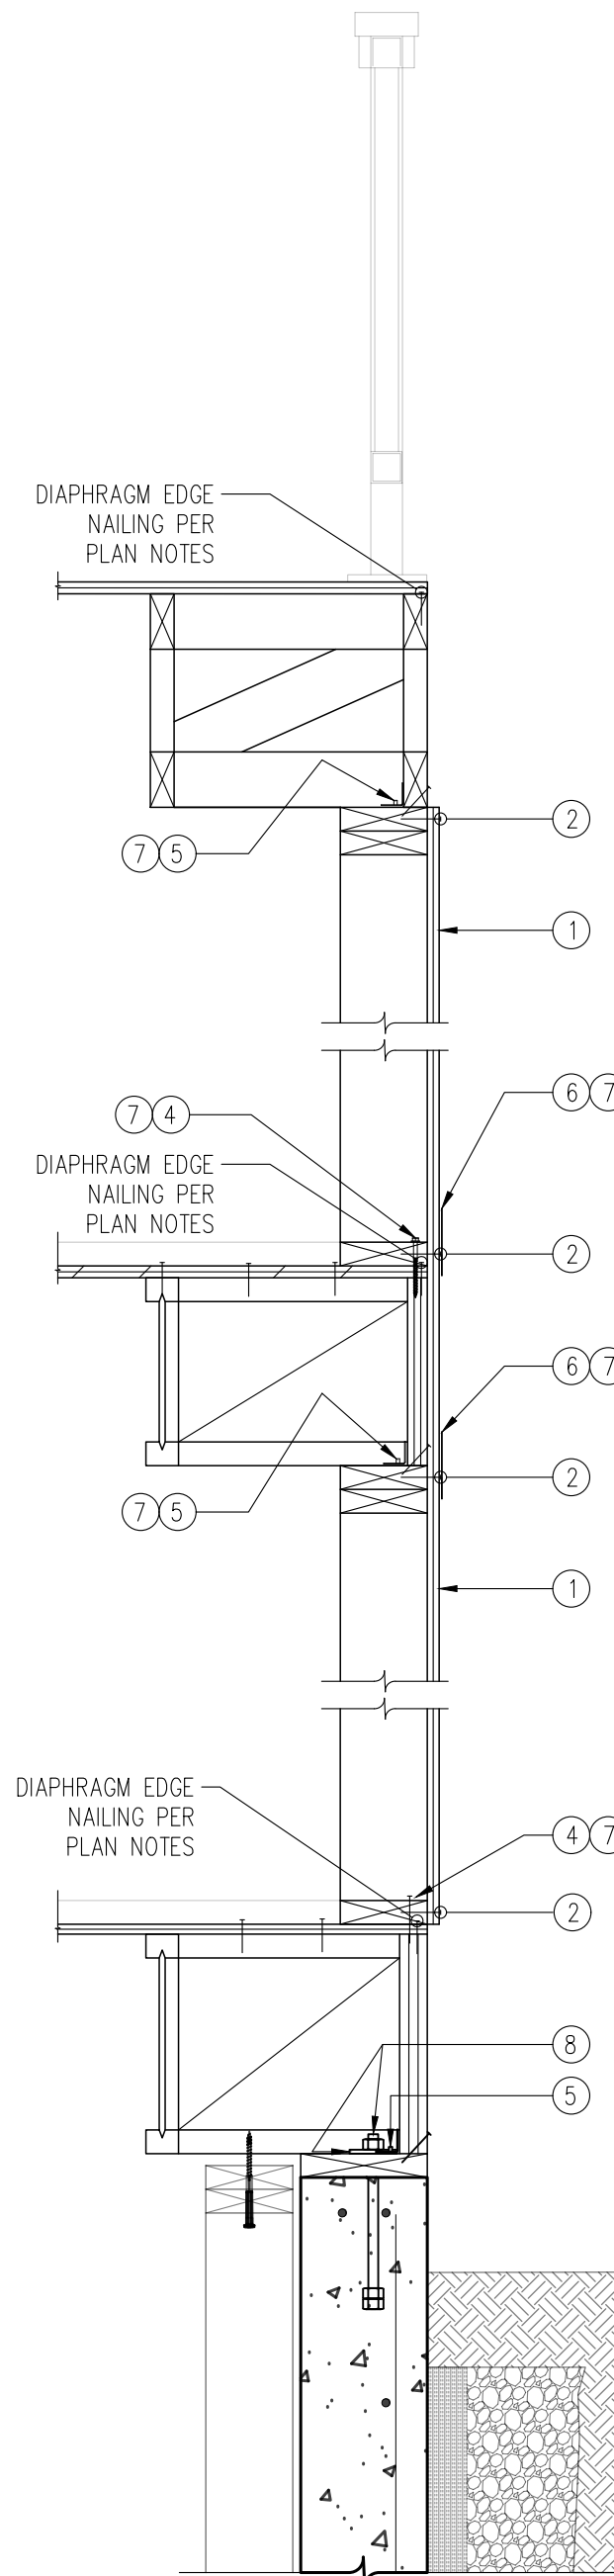

SHEARWALL SECTION AT PARALLEL FRAMING

1 SHEARWALL SECTION AND SCHEDULE
S6.5 1" = 1'-0"

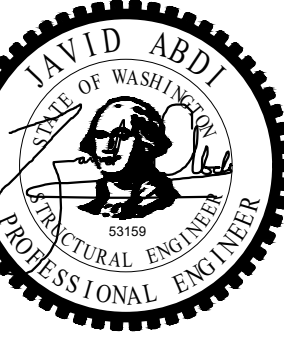


Yageneh Residence
3029 62nd Ave SE - Mercer Island


CONTENTS
Lateral
Details

DRAWN BY
JDA
DATE
05.27.24


S6.5

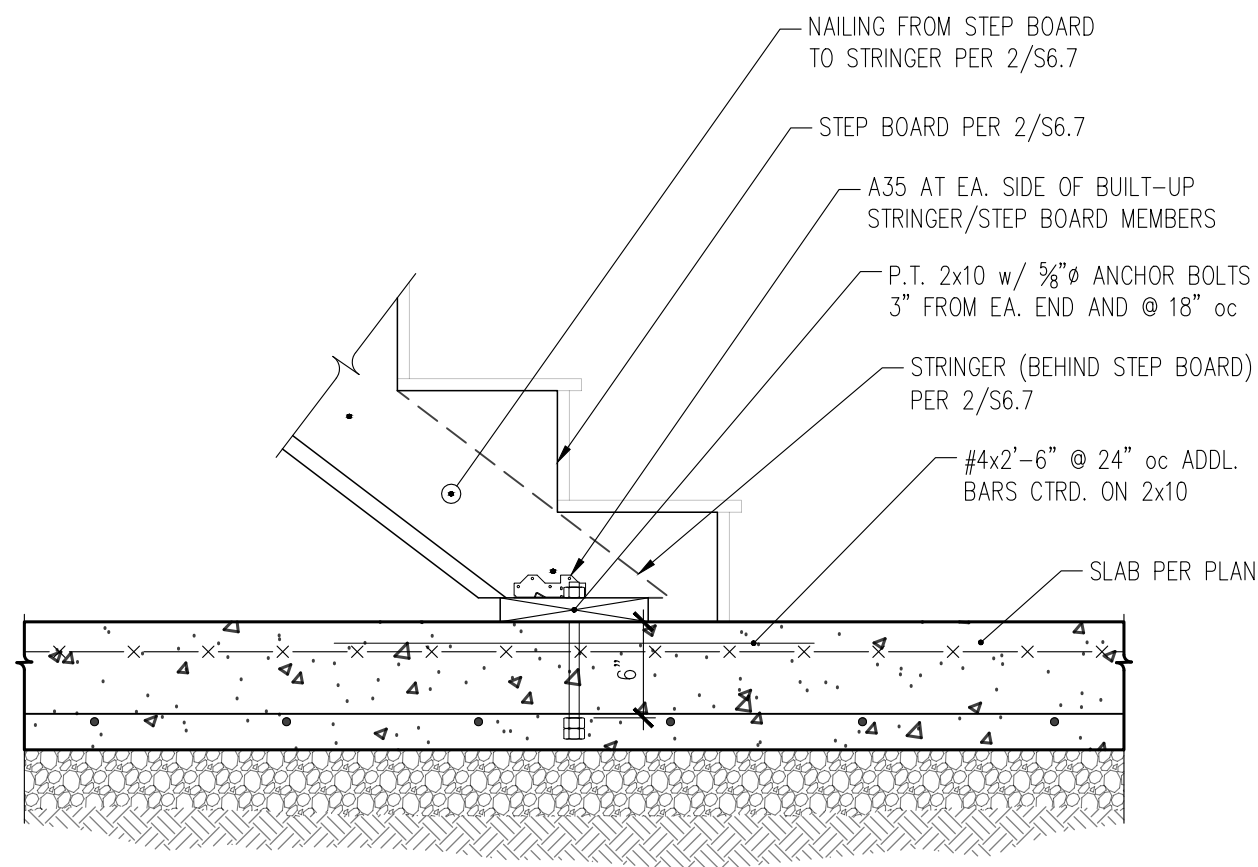


3
S6.7

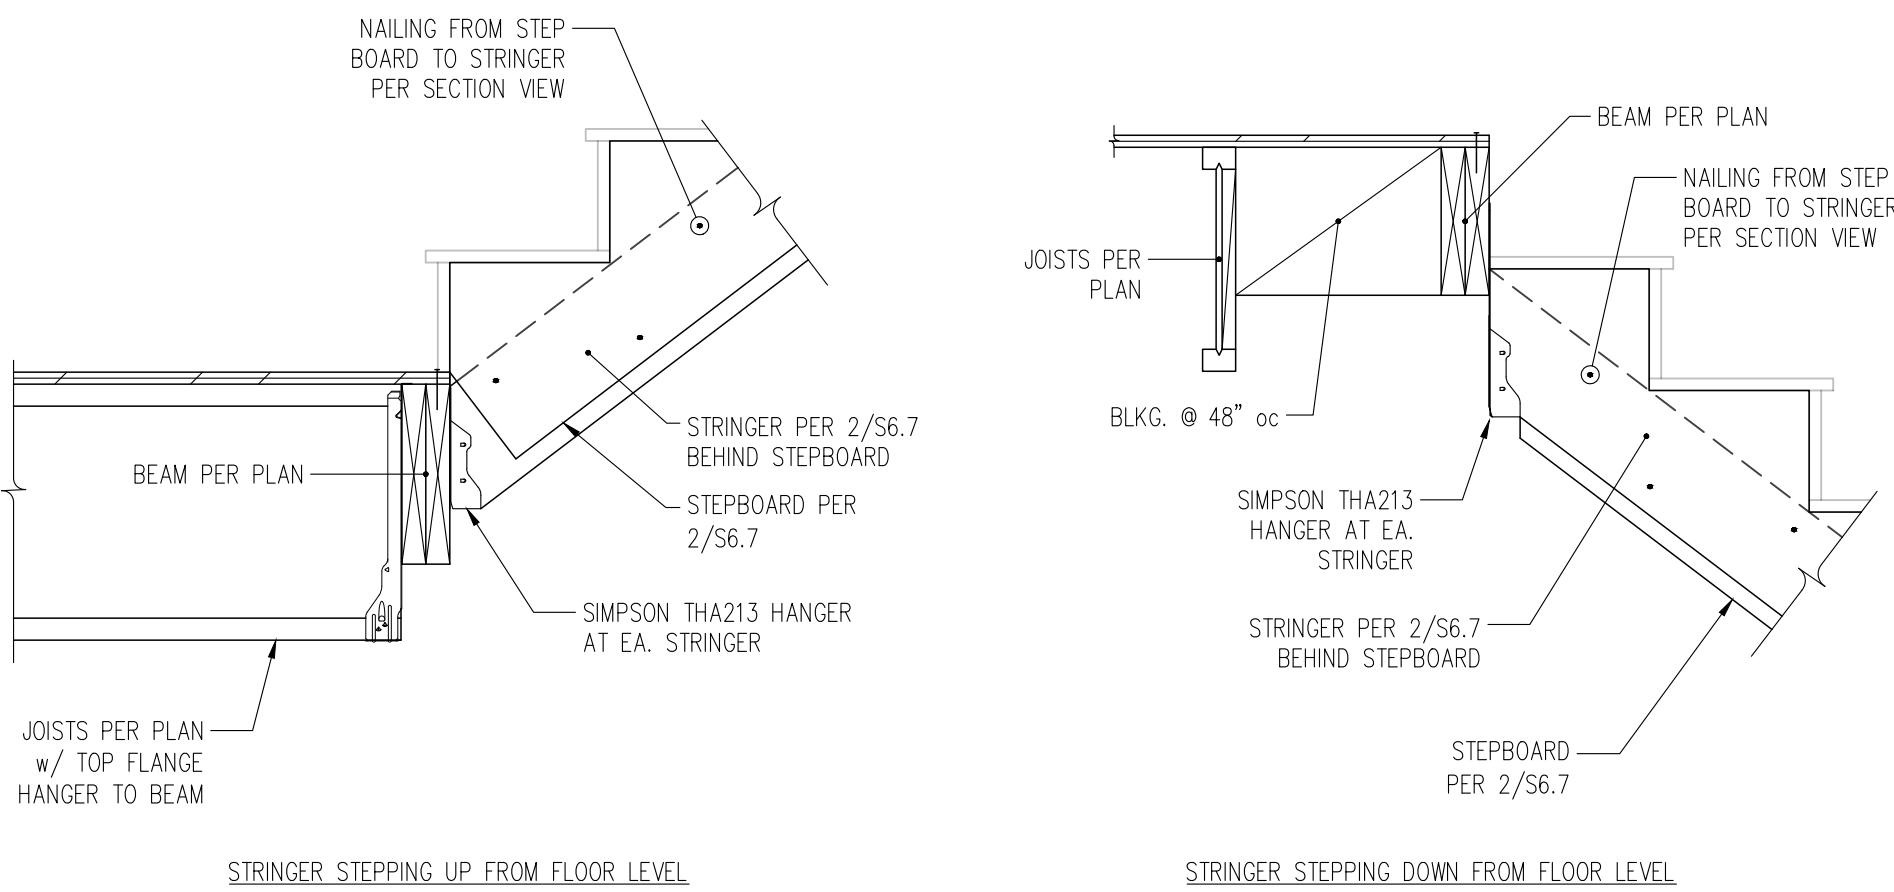SECTION THROUGH SLAB-ON-GRADE AT STAIR STRINGERS
1" = 1'-0"


5
S6.7

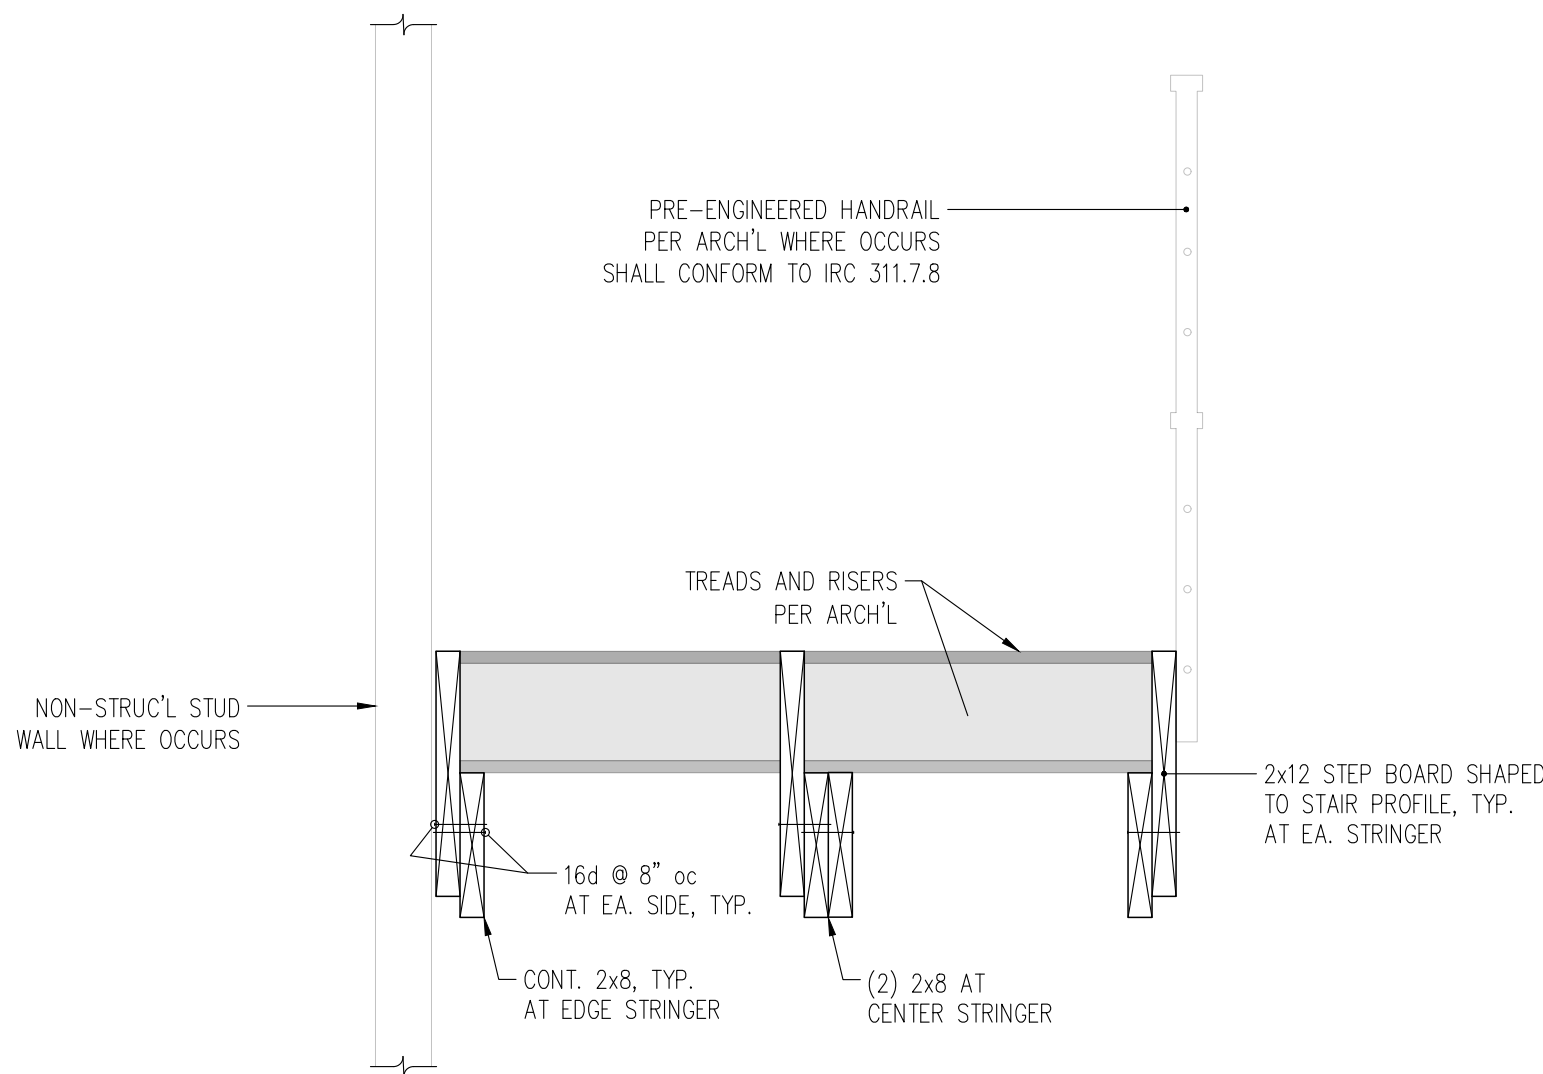ELEVATION OF STRINGER TO SUPPORT MEMBER
1" = 1'-0"

2
S6.7

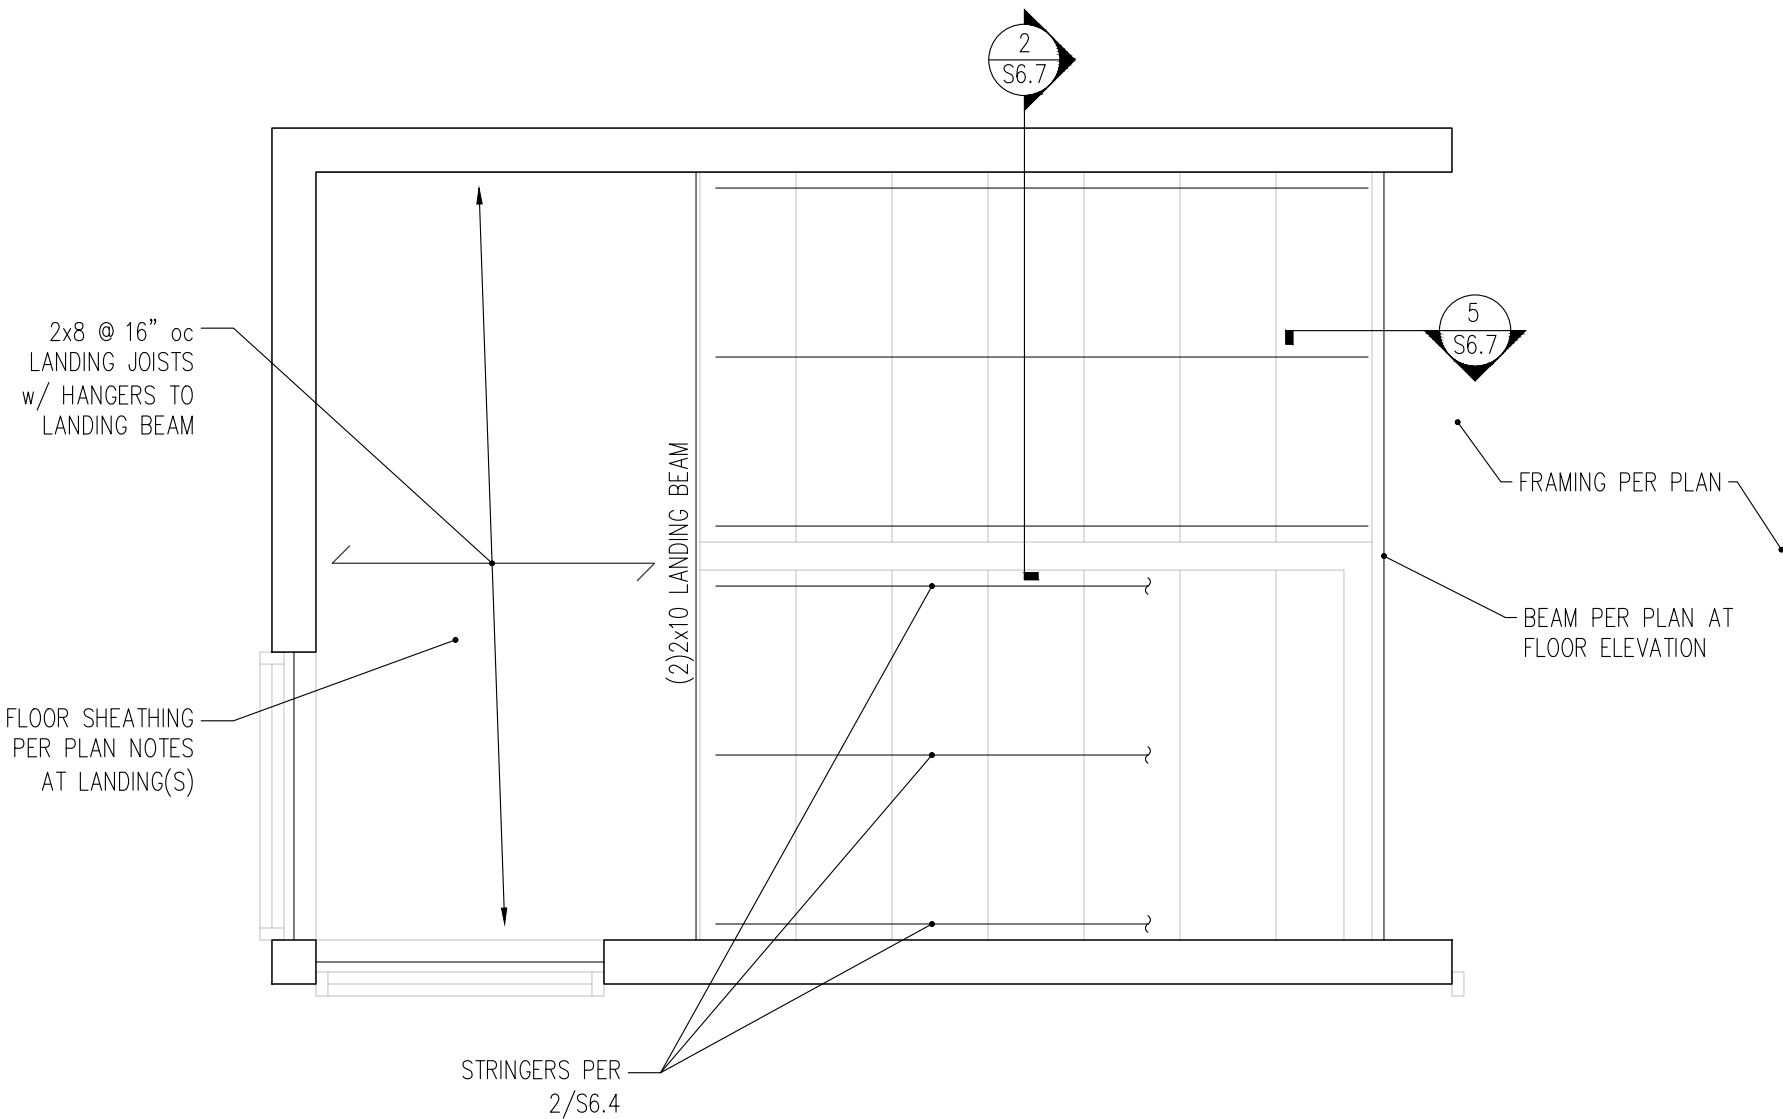SECTION THROUGH STAIR FRAMING
1" = 1'-0"

4
S6.7

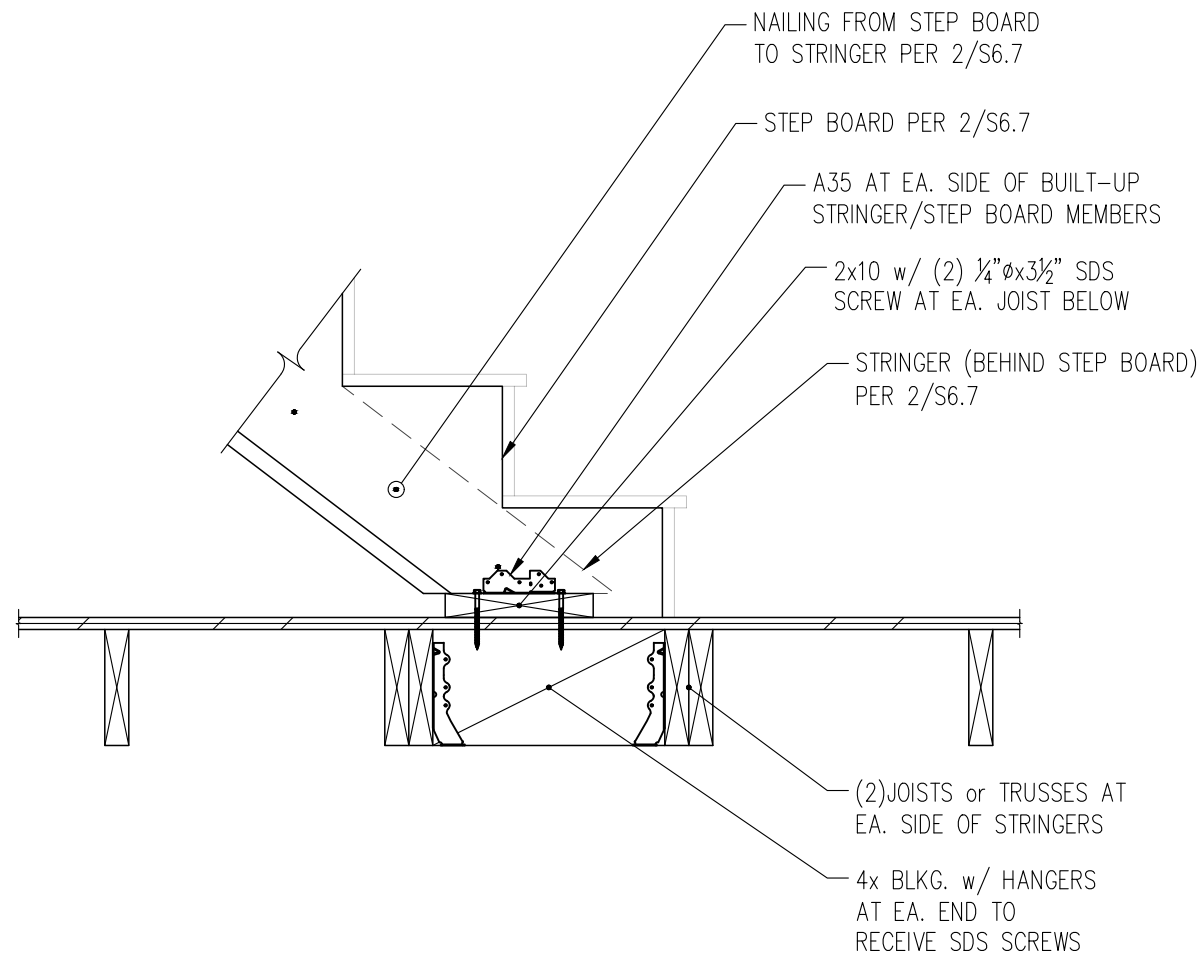TYPICAL STAIR FRAMING/LANDING PLAN VIEW
1" = 1'-0"

1
S6.7

ELEVATION VIEW OF STAIR STRINGERS BEARING ATOP FRAMING
1" = 1'-0"

TREE PROTECTION AREA (TPZ)

KEEP OUT!

DO NOT REMOVE OR ADJUST THE APPROVED LOCATION OF THIS TREE PROTECTION AREA


Trees enclosed by this fence are protected and are subject to the conditions of the tree permit. Violation of tree conditions may lead to:

1. Correction Notices or Stop Work Orders until compliance is achieved
2. RE Inspection Fees/financial penalties
3. Arborist reports recommending mitigation

Notes

1. No pruning shall be performed unless under the direction of the Project Arborist. Including limbing trees up.
2. No grading, excavation, storage (materials, equipment, vehicles, etc.), or other unpermitted activity shall occur inside the protective fencing.
3. Penalties for damaging by root damage/compaction or removing a saved tree may be a fine up to three times the value of the tree plus restoration (MICC 19.10.160).
4. Any work in approved TPZ must be with the permission of the City Arborist (206) 275-7713, john.kenney@mercergov.org.
5. 5" course woodchips within the tree protection zone, but not against the tree trunk.

Crown drip line or other limit of Tree Protection area. See Site/Utility Plan for fence alignment.

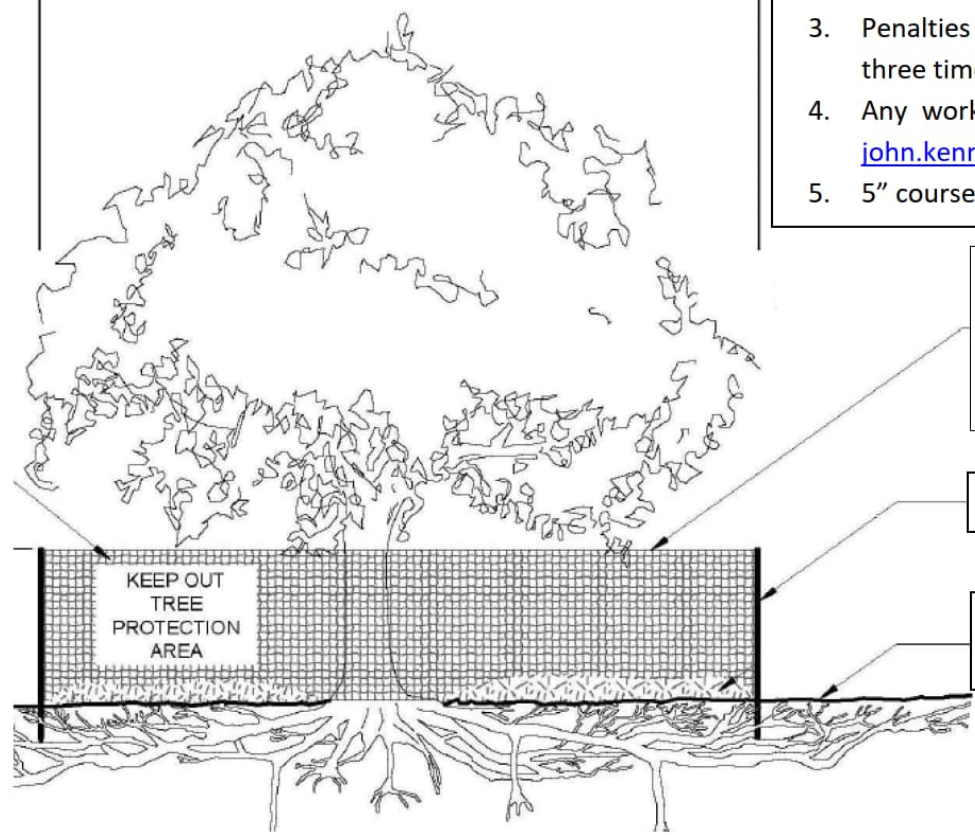

Tree protection fence: 6' chain link fence, solidly anchored into the ground, or if authorized High-density polyethylene fencing with 3.5" x 1.5" openings; color orange. Steel posts installed at 8' o.c.

2" x 6" steel posts or approved equal

Maintain existing grade with the tree protection fence unless otherwise indication on the plans

Any Work in the protected area must be with the permission of the City Arborist john.kenney@mercergov.org

EROSION CONTROL LEGEND

LIMITS OF DISTURBANCE		
FILTER FABRIC FENCE (SILT FENCE)	(SF)	—X—X—X—
STABILIZED CONSTRUCTION ENTRANCE	(CE)	
CATCH BASIN INLET PROTECTION	(IP)	
INTERCEPTOR SWALE SEE COR DWG 504. TYPE A TEMPORARY SWALE	(IS)	←—←—←—←—
TREE PROTECTION FENCING	(TP)	—○—○—○—
CHECK DAM	(CD)	
STRAW WATTI FS	(SW)	USF AS NEEDED

PROJECT ARBORIST
TREE PROTECTION RECOMMENDATIONS

Protective fencing is required around the perimeters of the LOD for each retained or group of trees during grading and construction. Temporary chain-link fencing is recommended to preserve the trees from soil disturbance due to machines, foot traffic, and materials. Grading and construction should not be allowed within the LOD of retained trees, unless described in this report. Some of the trees have irregular root zones because of compacted surfaces, retaining walls, and structures.

I allow the protection fencing to cut across part of the LOD of retained trees 110 and 113 to provide room for building as shown on the map (page 10). This fencing plan results in less than 30% disturbance of the outer root zone area and protects the inner (critical) root zone area. The bottom branches (canopy) of trees 110 and 113 may be pruned up to 8 feet above the ground prior to fencing placement.

The radius of the Critical Root Zone (CRZ) depends on the species, dripline (branch length), and DSH of the tree. The CRZ is the area around the tree where the minimum biological capacity of roots are located for essential structural stability and health - a distance from the trunk where root growth can recover and still maintain stability. Generally, the CRZ ranges from 1/2 - 2/3 of the LOD radius. The threshold for outer root zone disturbance of the LOD is no more than 30 % of the area, not including the CRZ area.

Retention walls within the root zones may be renovated with minimal effects to tree health. Installation of updated stone may be done with minimal impact to the root zone. Before fencing and demolition of the existing retention wall, 3-4 inches of mulch (i.e., bark or wood chips) shall be applied over the LOD to minimize root zone disturbance. Thick plywood (> 1/2 inch) shall be used over the mulch where foot traffic is needed to demo and build a new retention wall. A Certified Arborist is recommended during soil work (base work) within the CRZ to ensure root mitigation and report procedures. Orange barricade fencing may be used around the wall construction to protect the rest of the LOD. Tree protection placement during retention wall renovation is shown on the included map. No foot traffic or material staging within the LOD other than on plywood. Machinery used for wall demo and construction shall stage outside the LOD. Tree protection fencing shall be replaced back to its original placement as shown on the included map when the new retention wall is finished.

LEGAL DESCRIPTION

(PER STATUTORY WARRANTY DEED RECORDING # 20190815000691)

LOT 9, BLOCK 1, MADRONA CREST ADDITION, ACCORDING TO THE PLAT THEREOF, RECORDED IN VOLUME 42 OF PLATS, PAGE 12, IN KING COUNTY, WASHINGTON.

SITUATE IN THE COUNTY OF KING, STATE OF WASHINGTON.

ORGANIC SOIL REQUIREMENT


MINIMUM 10% ORGANIC
MULCH &
COMPOST SOIL
REQUIRED

SOIL AMENDMENT REQUIRED

COMPOST AMENDED SOIL REQUIRED ON ALL LANDSCAPED AREAS AFTER CONSTRUCTION. SEE DETAIL ON C3.5.

SOIL INSPECTION REQUIRED BY ENGINEER

A POST CONSTRUCTION INSPECTION & CERTIFICATION OF AMENDED SOILS IS REQUIRED BY A LICENSED CIVIL ENGINEER. THIS IS REQUIRED BEFORE FINAL SIGN-OFF BY CITY.

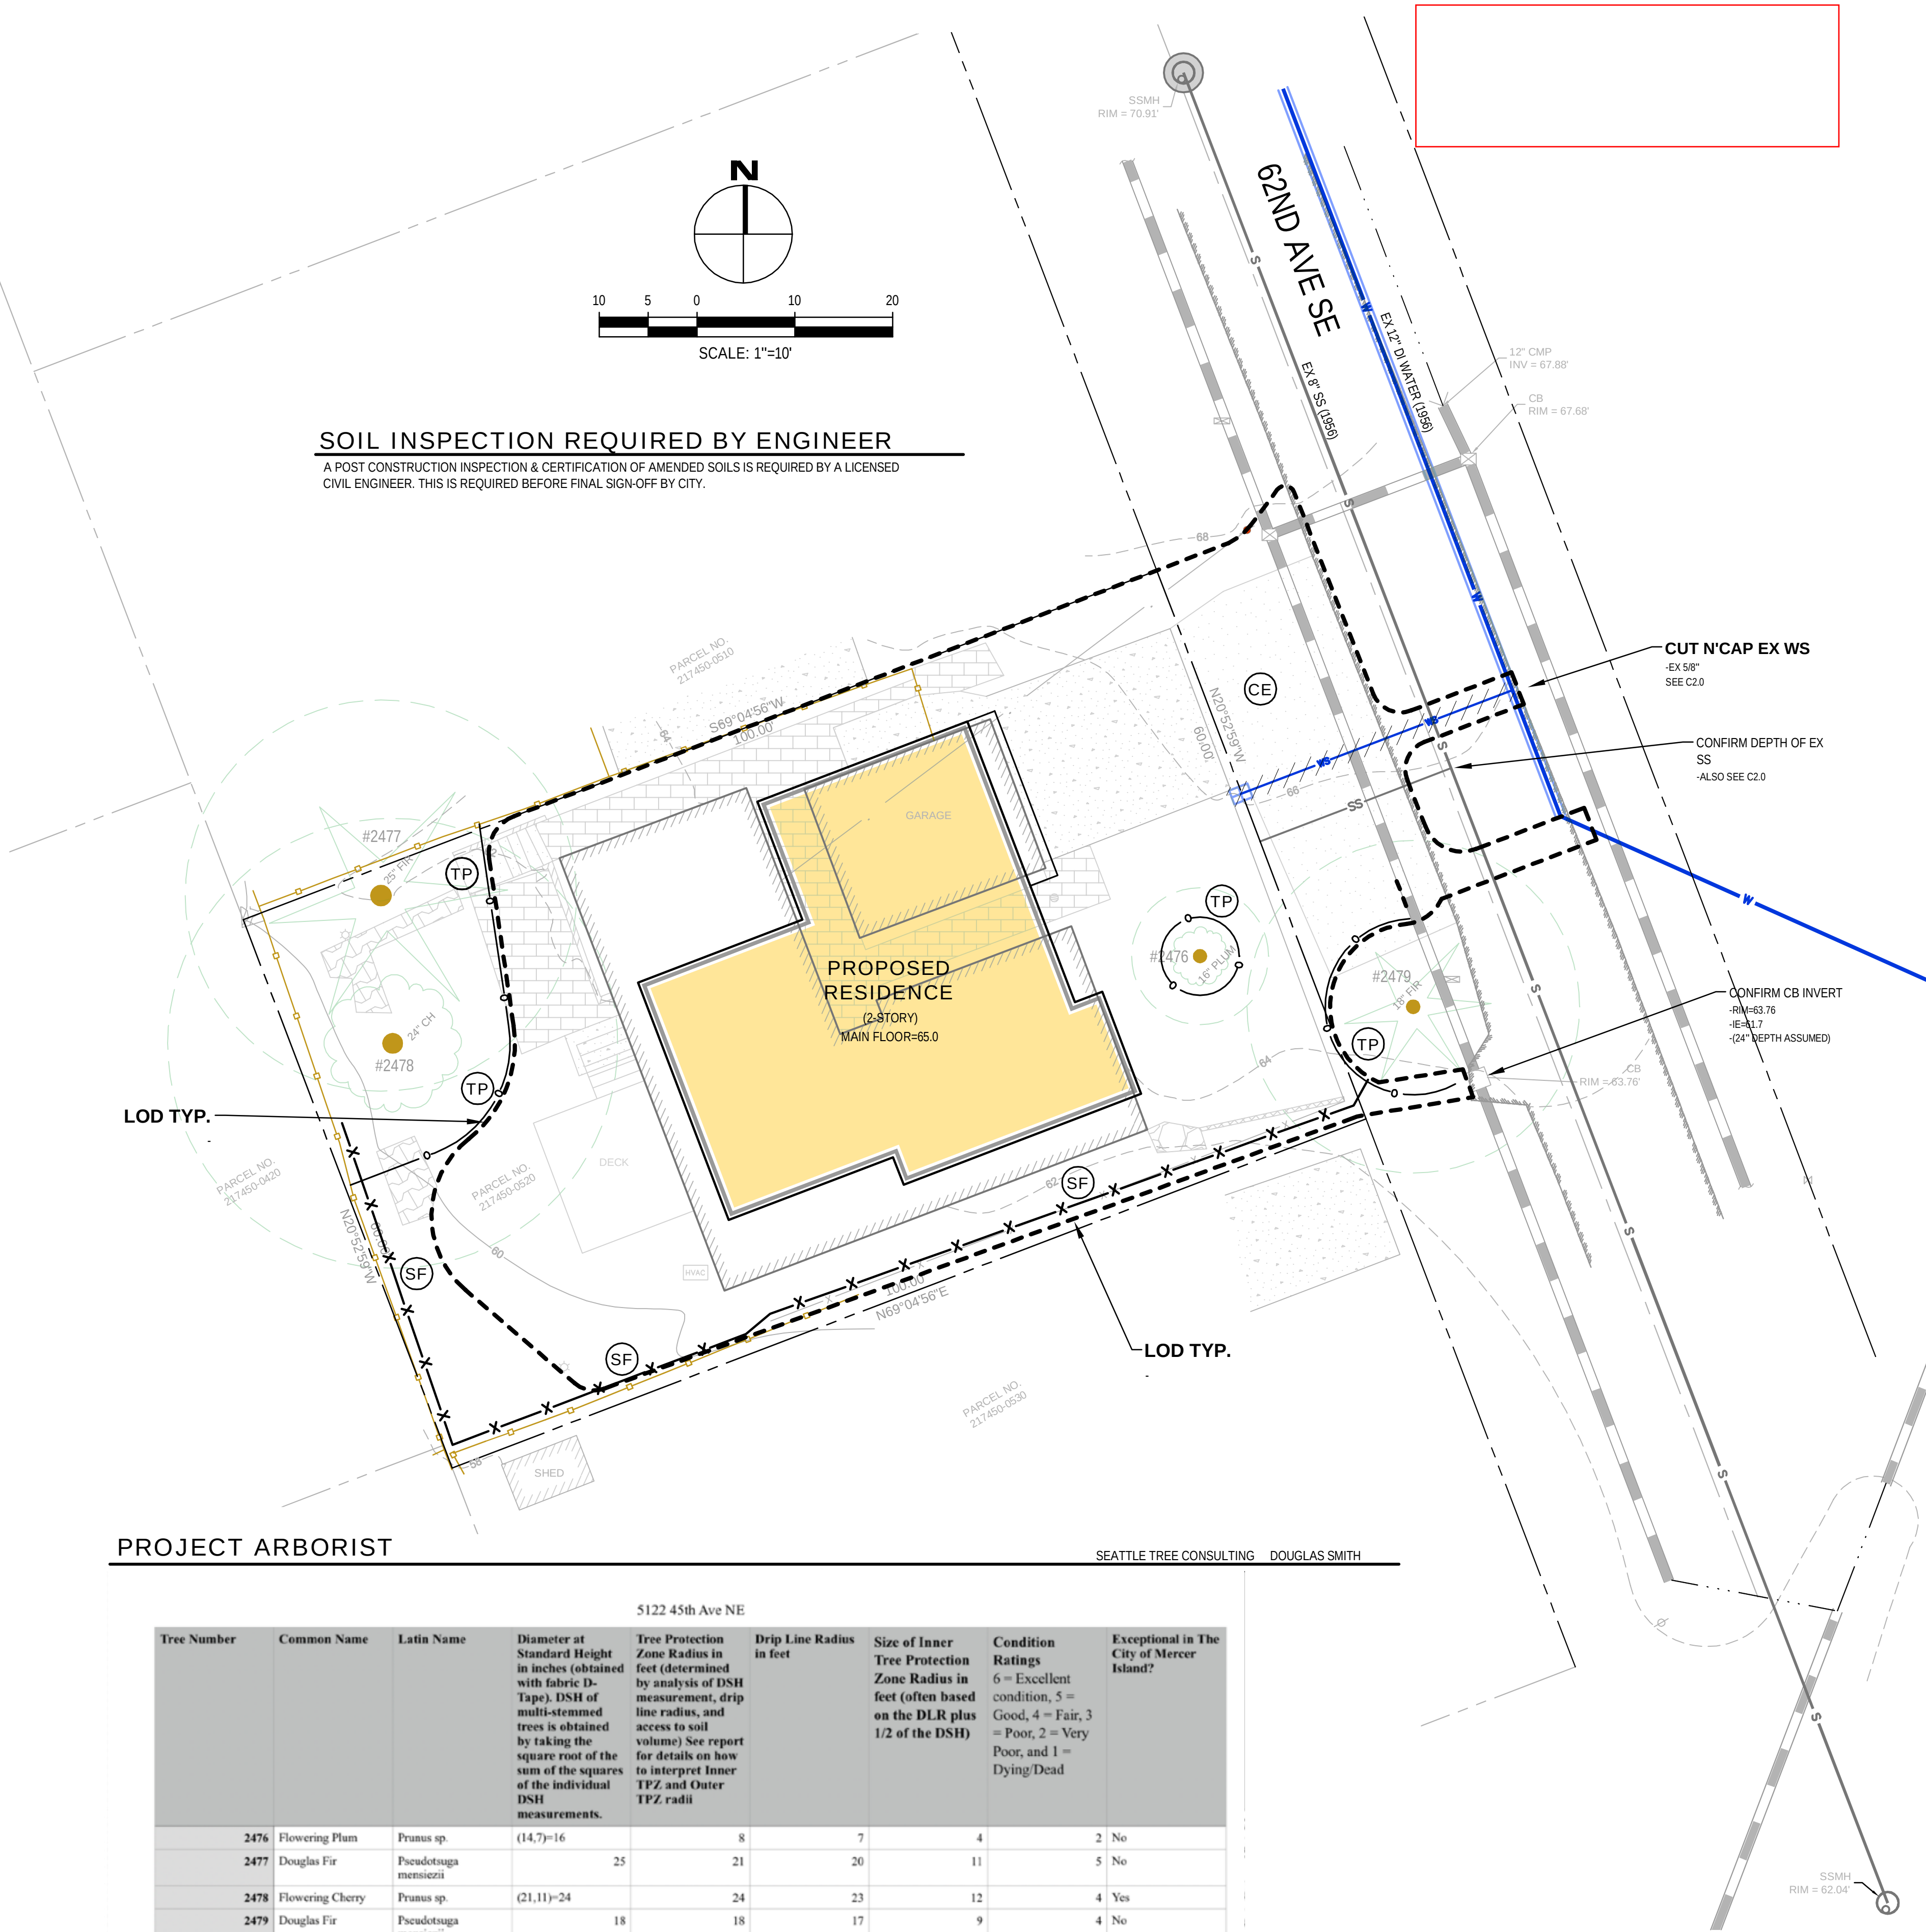

PROJECT ARBORIST


SEATTLE TREE CONSULTING DOUGLAS SMITH

5122 45th Ave NE								
Tree Number	Common Name	Latin Name	Diameter at Standard Height in inches (obtained with fabric D-Tape). DSH of multi-stemmed trees is obtained by taking the square root of the sum of the squares of the individual DSH measurements.	Tree Protection Zone Radius in feet (determined by analysis of DSH measurement, drip line radius, and access to soil volume) See report for details on how to interpret Inner TPZ and Outer TPZ radii	Drip Line Radius in feet	Size of Inner Tree Protection Zone Radius in feet (often based on the DLR plus 1/2 of the DSH)	Condition Ratings 6 = Excellent condition, 5 = Good, 4 = Fair, 3 = Poor, 2 = Very Poor, and 1 = Dying/Dead	Exceptional in The City of Mercer Island?
2476	Flowering Plum	Prunus sp.	(14.7)-16		8	7	4	2 No
2477	Douglas Fir	Pseudotsuga menziesii		25	21	20	11	5 No
2478	Flowering Cherry	Prunus sp.	(21.11)-24		24	23	12	4 Yes
2479	Douglas Fir	Pseudotsuga menziesii		18	18	17	9	4 No

NO.	DATE	BY	REVISIONS

APPLICANT
ASPEN HOMES NW
MIKE@ASPENHOMESNW.COM

DATE: Sep 23, 2024
JOB#: 2091
DRAFTED: SS DESIGN: SS
DIGITAL SIGNATURE

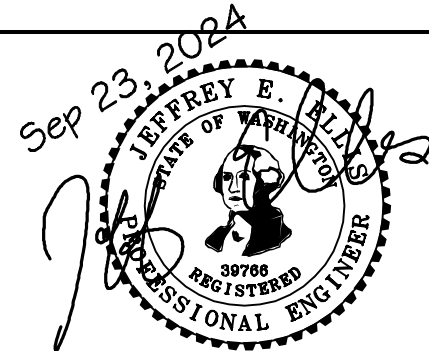

CIVIL ENGINEERING
SOLUTIONS

701 N 36TH STREET
206.930.0342

SEATTLE, WA 98103
DUFFY@CESOLUTIONS.US

TESC PLAN
TREE RETENTION PLAN

ASPEN HOMES NW
3029 62nd AVE SE, MERCER ISLAND, WA 98040

DRAWING NO:

C1.0

APN 502190-0045
2405-264

#2405-264

DOE

Diagram illustrating the construction of a silt fence.

Top View (Plan View):

- Joints in geotextile fabric shall be spliced at posts. Use staples, wire rings or equivalent to attach fabric to posts.
- 2"x2" by 14 Ga. wire or equivalent, if standard strength fabric used.
- Minimum 4"x4" trench.
- 6' max (spacing between posts).
- Post spacing may be increased to 8' if wire backing is used.
- 2"x2" wood posts, steel fence posts, or equivalent.

Side View (Cross Section):

- 2"x2" by 14 Ga. wire or equivalent, if standard strength fabric used.
- Geotextile fabric.
- Backfill trench with native soil or $\frac{3}{4}$ " - 1.5" washed gravel.
- Minimum 4"x4" trench.
- 2"x2" wood posts, steel fence posts, or equivalent.
- 2' min (height of fence).
- 12" min (depth of backfill).

NOT TO SCALE

Revised July 2017

Department of Ecology
State of Washington

For more information, please visit <http://www.ecy.wa.gov/copyright.html> for copyright notice including permissions, limitation of liability, and disclaimer.

DOE

The diagram illustrates a T-junction where a new stabilized access road meets an existing road. The existing road is shown at the top with a dashed line and arrows indicating traffic flow. The new access road branches off downwards. The junction area is filled with a pattern of circles representing quarry spalls. A layer of geotextile is shown beneath the spalls. A culvert is indicated where the access road crosses under the existing road. Dimensions include a 100' minimum length for the access road, a 15' minimum width at the end, and a 12" minimum thickness for the spall layer. A note specifies to install a driveway culvert if a roadside ditch is present. Another note indicates to provide the full width of ingress/egress area at the end of the road.

Existing Road

Install driveway culvert if there is a roadside ditch present

4" - 8" quarry spalls

Geotextile

100' min.

15' min.

12" minimum thickness

Provide full width of ingress/egress area

Notes:

1. Driveway shall meet the requirements of the permitting agency.
2. It is recommended that the access be crowned so that runoff drains off the pad.

Stabilized Construction Access

Revised June 2018

DEPARTMENT OF
ECOLOGY
State of Washington

Please see <http://www.ecy.wa.gov/copyright.html> for copyright notice including permissions, limitation of liability, and disclaimer.

NOT TO SCALE

A DETAILED CONSTRUCTION SEQUENCE IS NEEDED TO ENSURE THAT EROSION AND SEDIMENT CONTROL MEASURES ARE APPLIED AT THE APPROPRIATE TIMES. A RECOMMENDED CONSTRUCTION SEQUENCE IS PROVIDED BELOW:

APRIL 1 TO SEPT 30
ALL DENUDED AREAS MUST BE STABILIZED WITHIN 7 DAYS OF CONSTRUCTION. PLEASE READ ALL CITY
TESC NOTES ON SHEET C1.2.

OCT 1 TO MARCH 31
ALL DENUDED AREAS MUST BE STABILIZED WITHIN 2 DAYS OF GRADING. IF AN EROSION PROBLEM
ALREADY EXISTS ON THE SITE, OTHER COVER PROTECTION AND EROSION CONTROL WILL BE REQUIRED.

D.8.2 STANDARD ESC PLAN NOTES

THE STANDARD ESC PLAN NOTES MUST BE INCLUDED ON ALL ESC PLANS. AT THE APPLICANT'S DISCRETION, NOTES THAT IN NO WAY APPLY TO THE PROJECT MAY BE OMITTED; HOWEVER, THE REMAINING NOTES MUST NOT BE RENUMBERED. FOR EXAMPLE, IF ESC NOTE #3 WERE OMITTED, THE REMAINING NOTES SHOULD BE NUMBERED 1, 2, 4, 5, 6, ETC.

- ANY CHANGES TO THE APPROVED PLANS REQUIRES CITY APPROVAL THROUGH A REVISION.
2. APPLICANT IS RESPONSIBLE FOR ANY DAMAGES TO UNDERGROUND UTILITIES CAUSED FROM THIS CONSTRUCTION.
3. CATCH BASIN FILTERS SHOULD BE PROVIDED FOR ALL STORM DRAIN CATCH BASINS/INLETS DOWNSLOPE AND WITHIN 500 FEET OF THE CONSTRUCTION AREA. CATCH BASIN FILTERS SHOULD BE DESIGNED BY THE MANUFACTURER FOR USE AT CONSTRUCTION SITES AND APPROVED BY THE CITY INSPECTOR. CATCH BASIN FILTERS SHOULD BE INSPECTED FREQUENTLY, ESPECIALLY AFTER STORM EVENTS. IF THE FILTER BECOMES CLOGGED, IT SHOULD BE CLEANED OR REPLACED.
4. CONTRACTORS SHALL VERIFY LOCATIONS AND DEPTHS OF UTILITES.
5. AT LEAST 48 HOURS PRIOR TO CONSTRUCTION, CALL "ONE CALL" AT 1.800.424.5555
6. DO NOT BACKFILL WITH NATIVE MATERIAL ON PUBLIC RIGHT-OF-WAY. ALL MATERIAL MUST BE IMPORTED
7. EROSION CONTROL: ALL "LAND DISTURBING ACTIVITY" IS SUBJECT TO PROVISIONS OF MERCER ISLAND ORDINANCE 95C-118 "STORM WATER MANAGEMENT." SPECIFIC ITEMS TO BE FOLLOWED AT YOUR SITE:
8. PROTECT ADJACENT PROPERTIES FROM ANY INCREASED RUNOFF OR SEDIMENTATION DUE TO THE CONSTRUCTION PROJECT THROUGH THE USE OF APPROPRIATE "BEST MANAGEMENT PRACTICES" (BMP) EXAMPLES INCLUDE, BUT ARE NOT LIMITED TO, SEDIMENT TRAPS, SEDIMENT PONDS, FILTER FABRIC FENCES, VEGETATIVE BUFFER STRIPS OR BIOENGINEERED SWALES.
9. CONSTRUCTION ACCESS TO THE SITE SHOULD BE LIMITED TO ONE ROUTE. STABILIZE ENTRANCE WITH QUARRY SPALLS TO PREVENT SEDIMENT FROM LEAVING THE SITE OR ENTERING THE STORM DRAINS.
10. PREVENT SEDIMENT, CONSTRUCTION DEBRIS, PAINTS, SOLVENTS, ETC. OR OTHER TYPES OF POLLUTION FROM ENTERING PUBLIC STORM DRAINS. KEEP ALL POLLUTION ON YOUR SITE.
11. ALL EXPOSED SOILS SHALL REMAIN DENUDDED FOR NO LONGER THAN SEVEN (7) DAYS AND SHALL BE STABILIZED WITH MULCH, HAY, OR THE APPROPRIATE GROUND COVER. ALL EXPOSED SOILS SHALL BE COVERED IMMEDIATELY DURING ANY RAIN EVENT.
12. INSTALLATION OF CONCRETE DRIVEWAYS, TREES, SHRUBS, IRRIGATION, BOULDERS, BERMS, WALLS, GATES, AND OTHER IMPROVEMENTS ARE NOT ALLOWED IN THE PUBLIC RIGHT-OF-WAY WITHOUT PRIOR APPROVAL, AND AN ENCROACHMENT AGREEMENT AND RIGHT OF WAY PERMIT FROM THE SENIOR DEVELOPMENT ENGINEER.
13. OWNER SHALL CONTROL DISCHARGE OF SURFACE DRAINAGE RUNOFF FROM EXISTING AND NEW IMPEVIOUS AREAS IN A RESPONSIBLE MANNER. CONSTRUCTION OF NEW GUTTERS AND DOWNSPOUTS, DRY WELLS, LEVEL SPREADERS OR DOWNSLOPE CONVEYANCE PIPE MAY BE NECESSARY TO MINIMIZE DRAINAGE IMPACT TO YOUR NEIGHBORS. CONSTRUCTION OF MINIMUM DRAINAGE IMPROVEMENTS SHOWN OR CALLED OUT ON THIS PLAN DOES NOT IMPLY RELIEF FROM CIVIL LIABILITY FOR YOUR DOWNSLOPE DRAINAGE.
14. POT HOLING THE PUBLIC UTILITIES IS REQUIRED PRIOR TO ANY GRADING ACTIVITIES LESS THAN 6" OVER THE PUBLIC MAINS (WATER, SEWER AND STORM SYSTEMS). IF THERE IS A CONFLICT, THE APPLICANT IS REQUIRED TO SUBMIT A REVISION FOR APPROVAL PRIOR TO ANY GRADING ACTIVITIES OVER THE PUBLIC MAINS.
15. REMEMBER: EROSION CONTROL IS YOUR FIRST INSPECTION.
16. ROOF DRAINS MUST BE CONNECTED TO THE STORM DRAIN SYSTEM AND INSPECTED BY THE PUBLIC WORKS DEPARTMENT PRIOR TO ANY BACKFILLING OF PIPE.
17. SILENT FENCE: CLEAN AND PROVIDE REGULAR MAINTENANCE OF THE SILT FENCE. THE FENCE IS TO REMAIN VERTICAL AND IS TO FUNCTION PROPERLY THROUGHOUT THE TERM OF THE PROJECT.
18. WORK IN PUBLIC RIGHT OF WAY REQUIRES A RIGHT-OF-WAY USE PERMIT.
19. REFER TO WATER SERVICE PERMIT FOR ACTUAL LOCATION OF NEW WATER METER AND SERVICE LINE DETERMINED BY MERCER ISLAND WATER DEPARTMENT.
20. THE TV INSPECTION OF THE EXISTING SIDE SEWER TO THE CITY SEWER MAIN IS REQUIRED. IF THE RESULT OF THE TV INSPECTION IS NOT IN SATISFACTORY CONDITION, AS DETERMINED BY THE CITY OF MERCER ISLAND INSPECTOR, THE REPLACEMENT OF THE EXISTING SIDE SEWER IS REQUIRED. ALTERNATELY, A PRESSURE TEST OF THE SIDE SEWER, FROM SEWER MAIN TO POINT OF CONNECTION, MAY BE SUBSTITUTED FOR THE VIDEO INSPECTION.
20. NEWLY INSTALLED SIDE SEWER REQUIRES A 4 P.S.I. AIR TEST OR PROVIDE 10' OF HYDROSTATIC HEAD TEST.
21. POT HOLING THE PUBLIC UTILITIES IS REQUIRED PRIOR TO ANY GRADING ACTIVITIES LESS THAN 6" OVER THE PUBLIC MAINS (WATER, SEWER AND STORM SYSTEMS). IF THERE IS A CONFLICT, THE APPLICANT IS REQUIRED TO SUBMIT A REVISION FOR APPROVAL PRIOR TO ANY GRADING ACTIVITIES OVER THE PUBLIC MAINS.
22. THE LIMITS AND EXTENDS OF THE PAVEMENT IN THE PUBLIC RIGHT OF WAY SHALL BE DETERMINED BY THE CITY ENGINEER PRIOR TO FINALIZE THE PROJECT.

NO.	DATE	BY	REVISIONS	APPLICANT ASPEN HOMES NW MIKE@ASPENHOMESNW.COM	DATE: May 08, 2024 JOB#: 2091 DRAFTED: SS DESIGN: DE DIGITAL SIGNATURE	  CIVIL ENGINEERING SOLUTIONS 701 N 36TH STREET 206.930.0342 SEATTLE, WA 98103 DUFFY@CESOLUTIONS.US	TESC & CITY NOTES TESC DETAILS ASPEN HOMES NW 3029 62nd AVE SE, MERCER ISLAND, WA 98040	DRAWING NO: C1.2 APN 502190-0045 2306-185
-----	------	----	-----------	---	---	--	--	---

SANITARY SEWER IMPROVEMENTS

- 1 -
2 -6" SDR 35 PVC SANITARY SEWER(SS) @ MIN 1.0 %
3 -
4 -
7 -LOCATE AND VIDEO CONDITION OF EXISTING SANITARY SIDE SEWER. REPLACE LINE IF FOUND DEFECTIVE AS DETERMINED BY CITY INSPECTOR.

WATER IMPROVEMENTS

- 10 -RESIDENTIAL 1" WATER SERVICE & METER PIT. CONFIRM REQUIRED SIZE WITH BUILDING PERMIT REVIEW. INSTALL PER MERCER ISLAND DETAIL W-13, W-14, OR W-14A
11 -1.5" 250 PSI PRIVATE HDPE WATER (ASTM D2239) FROM METER TO HOUSE. RECOMMENDED DEPTH=36". COORDINATE HOUSE ENTRY WITH BUILDER/OWNER.
12 -
14 -

STORM DRAIN PIPE KEY NOTES

- 20 -4" STORM DRAIN (3034 PVC) @ MIN 1 % GRADE. USE HDPE DUAL WALL OR EQUIVALENT WHEN PIPE COVER <24" IN PAVED AREAS.
21 -4" FOUNDATION DRAIN (3034 PVC) @ MIN 1 % GRADE
22 -6" STORM DRAIN (3034 PVC) @ MIN 2 % GRADE. USE HDPE DUAL WALL OR EQUIVALENT WHEN PIPE COVER <24" IN PAVED AREAS.
23 -
24 -12" STORM DRAIN (HDPE N12 OR EQUAL).
25 -STORM DRAIN FORCE MAIN @ MIN. 30" DEPTH. SEE PLAN FOR DIAMETER. SUITABLE PIPE OPTIONS INCLUDE SDR-7 PE 250 PSI OR EQUAL.

STORM STRUCTURE KEY NOTES

- 30 -
31 -
32 -TYPE 1 CB WITH SOLID LID
33 -
34 -
35 -
36 -
38A -
37 -PRIVATE STORM CLEANOUT. PROVIDE PROTECTIVE COVER IF WARRANTED.
39 -
40 -TYPE 40 PRIVATE CATCH BASIN OR EQUAL. PROVIDE RISOR WITH TURNED-DOWN ELBOW FOR IMPROVED WATER QUALITY FUNCTION.
41 -
43 -
46 -
47 -
48 -FOOTING DRAIN SUMP PUMP: USE 1/3 HP HYDROMATIC SUMP PUMP OR EQUAL. 120V, 1/3 HP, SINGLE PHASE, 8.0 AMP 1-1/2" DISCHARGE. PLACE IN 24" GREEN ULTRA-RIB PVC PIPE OR EQUAL.

STORM BMP's

- 50 -COMPOST AMENDED SOIL TO ALL DISTURBED AREAS (SEE DETAIL SHEET C3.5). TILL 2-3" OF COMPOST INTO UPPER 8" OF SOIL. LOOSEN COMPACTED SUBSOIL, IF NEEDED BY RIPPING TO 12" DEPTH. MULCH LANDSCAPE BEDS AFTER PLANTING.
51 -
52 -
53 -
54 -
55 -
56 -
57 -
58 -

SOILS

SEE MAY 2023 REPORT BY RILEY GROUP
SMALL-SCALE PIT TEST PERFORMED
MEASURED INFILTRATION RATE = 1.56 IN/HR
DESIGN INFILTRATION RATE = 0.42 IN /HR

SURVEYOR

TOPOGRAPHIC SURVEY BY:
TERRANE
10801 MAIN STREET, SUITE 102
BELLEVUE, WA 98004
PHONE 425-458-4488
info@terrane.net

VERTICAL DATUM

NAVD 88 PER WGS SURVEY DATA WAREHOUSE
POINT DESIGNATION 509
SEE SURVEY

LEGAL DESCRIPTION

SEE C1.0

SOIL AMENDMENT REQUIRED

COMPOST AMENDED SOIL REQUIRED ON ALL LANDSCAPED AREAS AFTER CONSTRUCTION.
SEE DETAIL ON C3.5.


SOIL INSPECTION REQUIRED BY ENGINEER

A POST CONSTRUCTION INSPECTION & CERTIFICATION OF AMENDED SOILS IS REQUIRED BY A LICENSED CIVIL ENGINEER.
THIS IS REQUIRED BEFORE FINAL SIGN-OFF BY CITY.

TOPSOIL IMPORT

ESTIMATED TOPSOIL IMPORT= _____

Impervious Area Spreadsheet - Stormwater Version		
Sina Residence - 3029 62nd Avenue SE, Mercer Island, WA 98040		
Gross Site area	6,000	sf
	0.138	acres
Existing Impervious Area		
roof	1,532	sf
garage	330	sf
driveway	360	sf
Best of the rest	953	sf
total existing =	3,175	sf
Proposed Impervious Area		
Roof	2,088	sf
driveway	247	sf
front side walkway to street	100	sf
north hardscape	299	sf
total on-site (new + replaced) proposed =	2,734	sf
Result Pervious=	3,266	sf
total on-site new =		sf

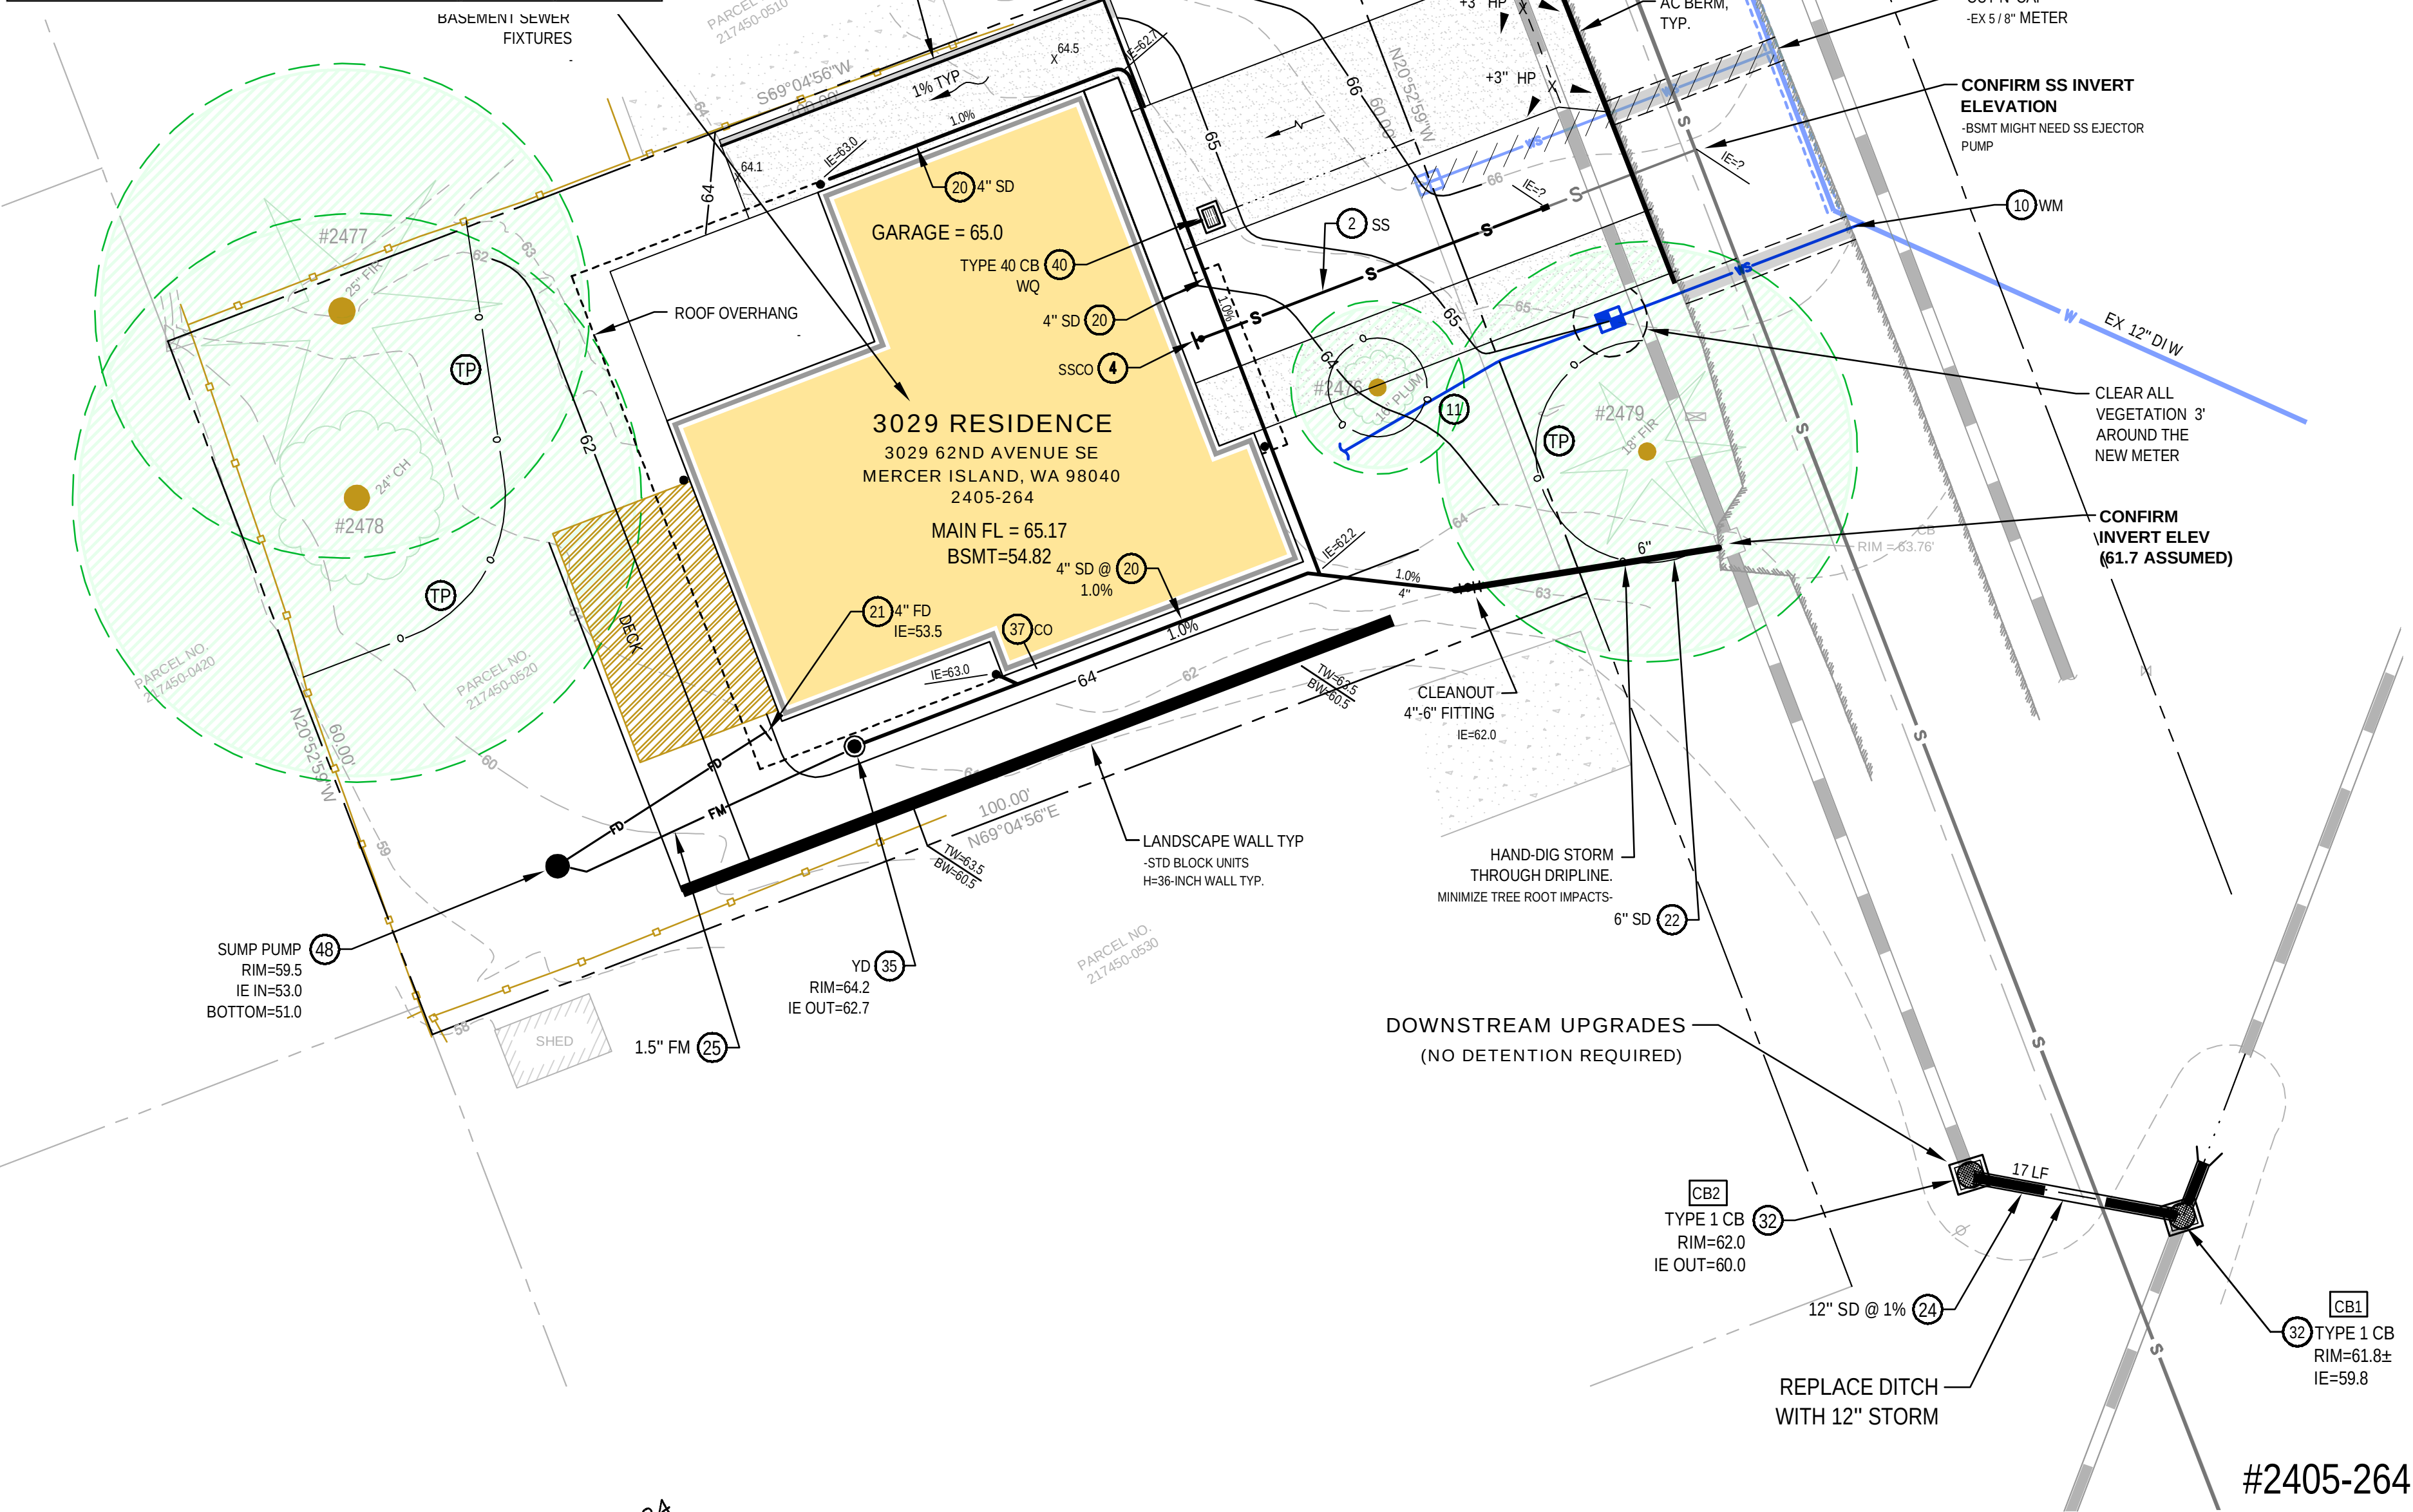

MINIMUM 10% ORGANIC -
COMPOST SOIL
REQUIRED


SOIL AMENDMENT REQUIRED

COMPOST AMENDED SOIL REQUIRED ON ALL LANDSCAPED AREAS
AFTER CONSTRUCTION. SEE DETAIL BELOW.

SOIL INSPECTION REQUIRED BY ENGINEER


A POST CONSTRUCTION INSPECTION & CERTIFICATION OF AMENDED SOILS IS
REQUIRED BY A LICENSED CIVIL ENGINEER.
THIS IS REQUIRED BEFORE FINAL SIGN-OFF BY CITY.

COMPOST AMENDED SOIL SPEC

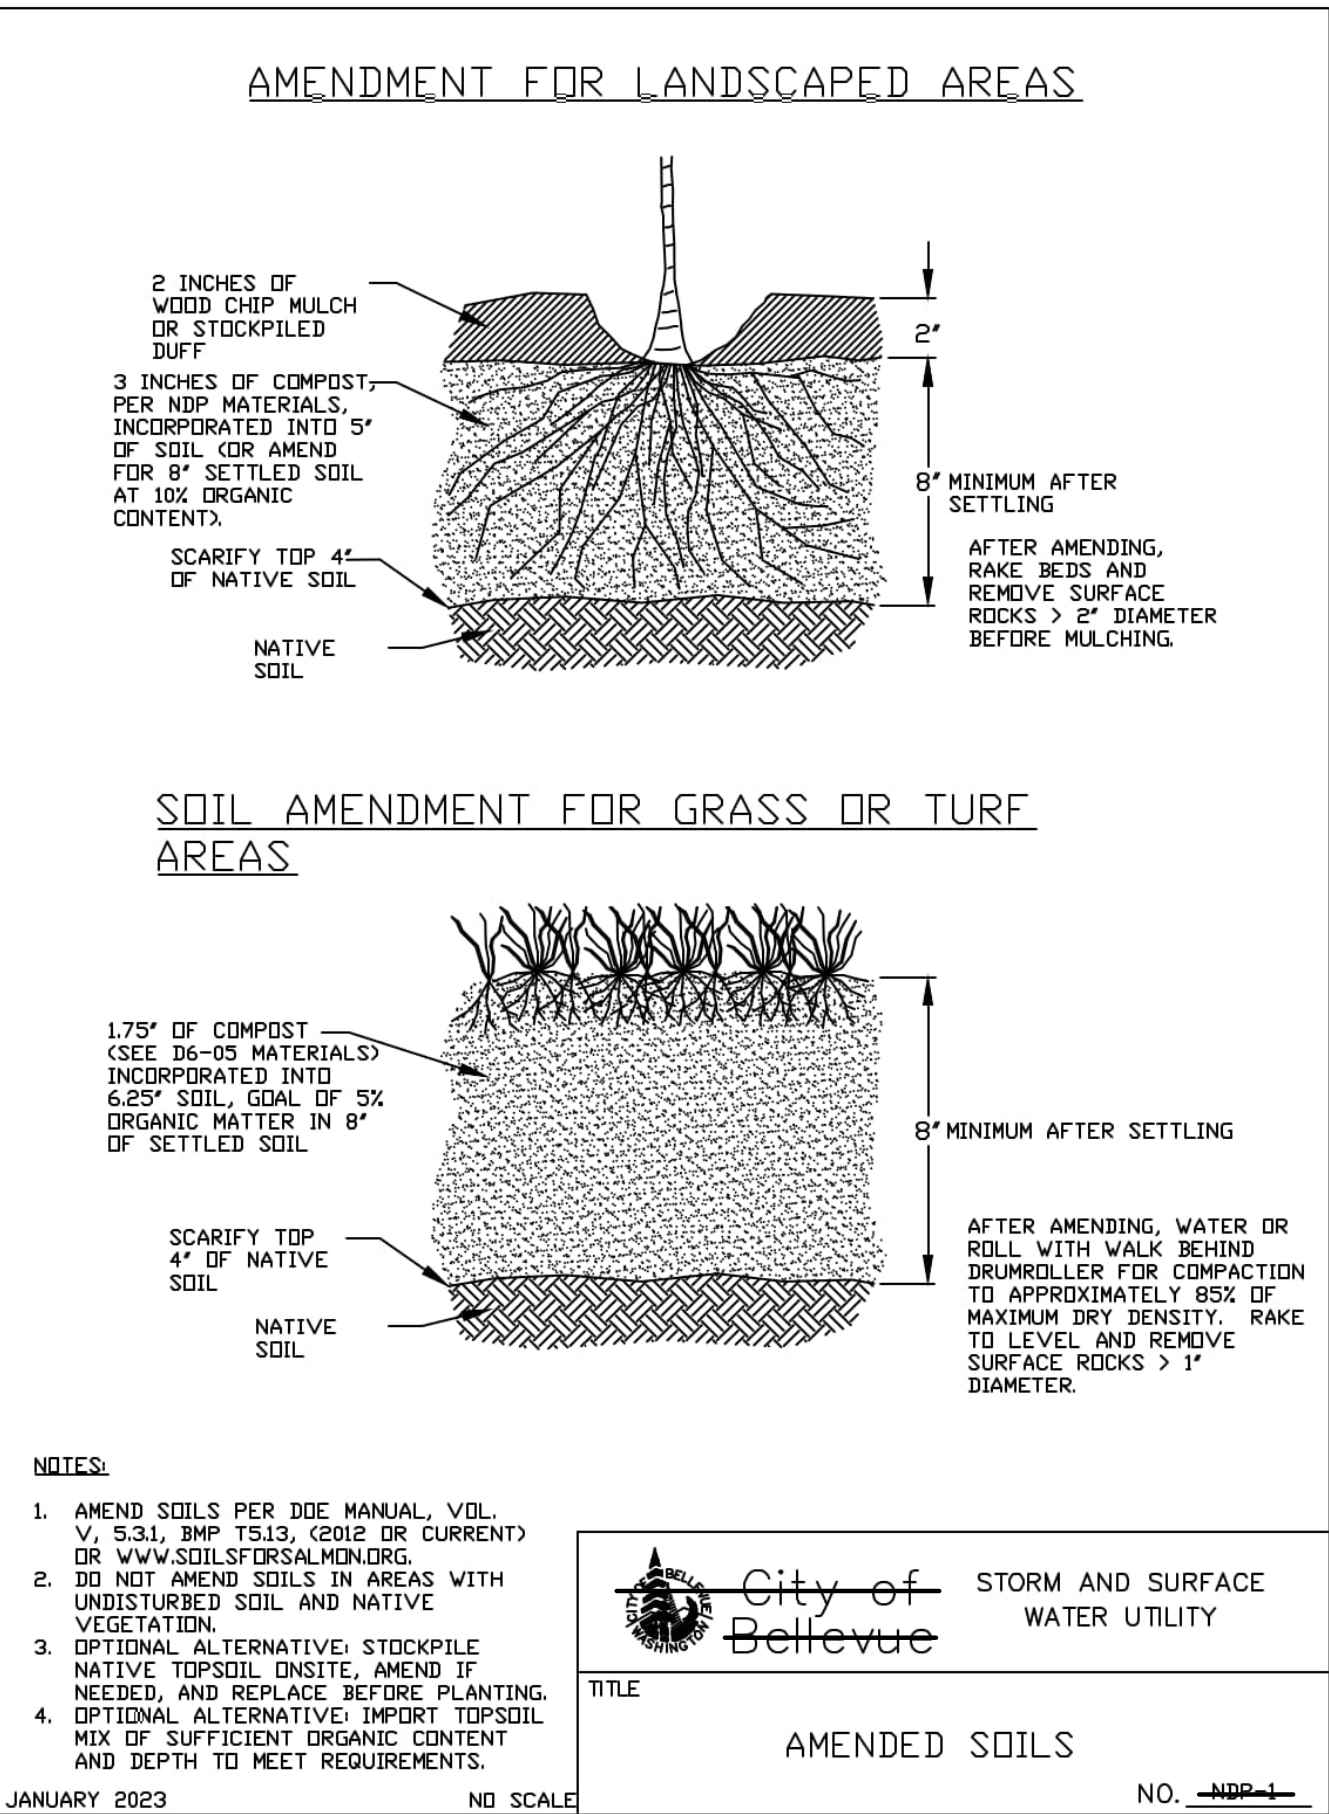

#24__-xxx

NO.	DATE	BY	REVISIONS	APPLICANT ASPEN HOMES NW MIKE@ASPENHOMESNW.COM	DATE: May 08, 2024	701 N 36TH STREET 206.930.0342	SEATTLE, WA 98103 DUFFY@CESOLUTIONS.US	BMP DETAILS ASPEN HOMES NW 3029 62nd AVE SE, MERCER ISLAND, WA 98040	DRAWING NO: C3.5 APN 502190-0045 2306-185
					JOB# 2091				
					DRAFTED: SS DESIGN: SS				
					DIGITAL SIGNATURE				

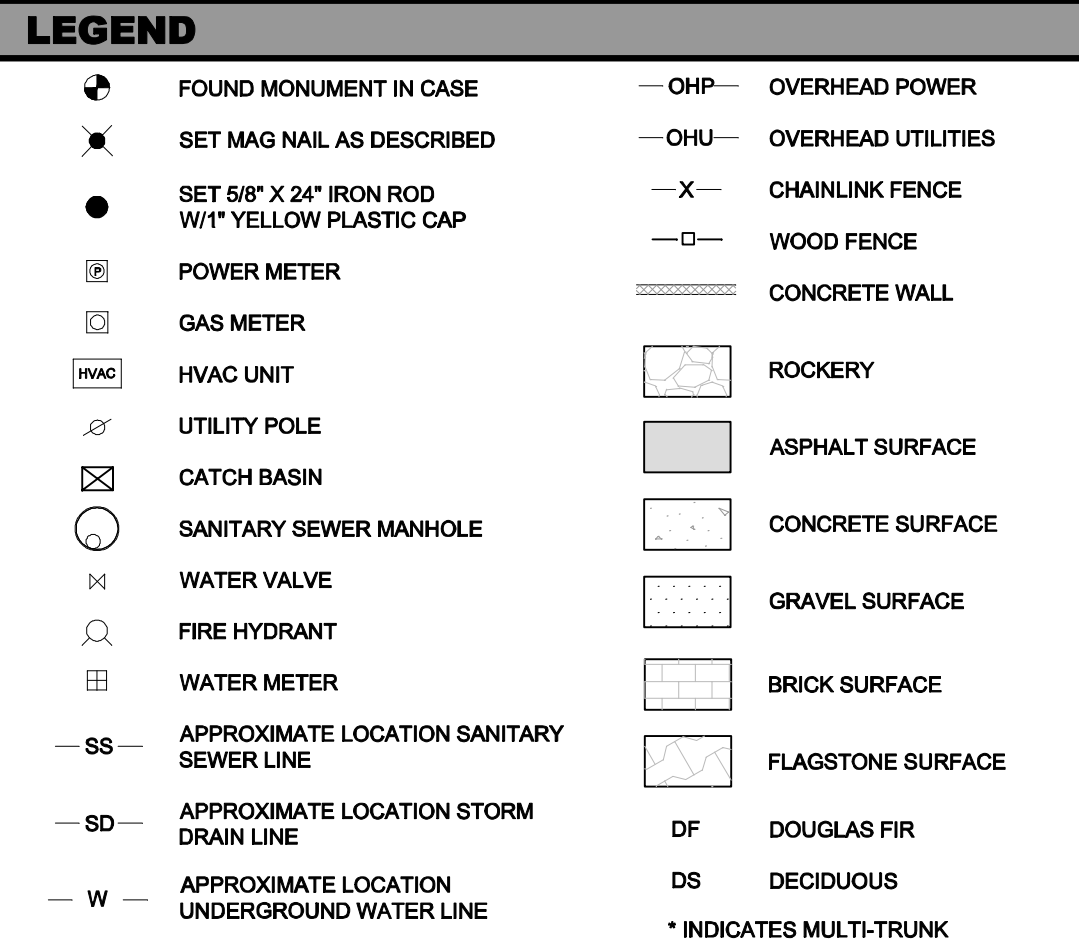

LOTS 32 AND 33, BLOCK 3 OF EAST SEATTLE, AS PER PLAT THEREOF RECORDED IN VOLUME 3 OF PLATS, PAGE 22, RECORDS OF KING COUNTY, WASHINGTON;

SITUATE IN THE CITY OF MERCER ISLAND, COUNTY OF KING, STATE OF WASHINGTON.

RECORD OF SURVEY BY GEODIMENSIONS FOR JAY MARC HOMES, RECORDED ON MAY 5, 2013, IN VOLUME 297 OF SURVEYS, PAGE 246, UNDER RECORDING NO. 20130509900010 RECORDS OF KING COUNTY, WASHINGTON.

PROPERTY OWNER:	SINA YEGANEH 3029 62ND AVENUE SE MERCER ISLAND, WA 98040
TAX PARCEL NUMBER:	217450-0520
PROJECT ADDRESS:	3029 62ND AVENUE SE MERCER ISLAND, WA 98040
ZONING:	R-8.4
JURISDICTION:	CITY OF MERCER ISLAND
PARCEL ACREAGE:	6,000 S.F. (0.136 ACRES) AS SURVEYED



1. THIS SURVEY WAS COMPLETED WITHOUT BENEFIT OF A CURRENT TITLE REPORT. EASEMENTS AND OTHER ENCUMBRANCES MAY EXIST ON THIS PROPERTY THAT ARE NOT SHOWN HEREON.
2. INSTRUMENTATION FOR THIS SURVEY WAS A 3-SECOND SPECTRAPRECISION FOCUS 35 TOTAL STATION AND AN EMILIO REACH RS2 GPS RECEIVER. PROCEDURES USED IN THIS SURVEY MEET OR EXCEED STANDARDS SET BY WAC 332-139-090.
3. THE INFORMATION ON THIS MAP REPRESENTS THE RESULTS OF A SURVEY MADE IN MARCH 2022 AND CAN ONLY BE CONSIDERED AS INDICATING THE GENERAL CONDITIONS EXISTING AT THAT TIME.
4. UTILITIES SHOWN ON THIS SURVEY ARE BASED UPON ABOVE GROUND OBSERVATIONS AND AS-BUILT PLANS WHERE AVAILABLE. ACTUAL LOCATIONS OF UNDERGROUND UTILITIES MAY VARY AND UTILITIES NOT SHOWN ON THIS SURVEY MAY EXIST ON THIS SITE.
5. ALL MONUMENTS WERE LOCATED DURING THIS SURVEY UNLESS OTHERWISE NOTED.

ELEVATIONS SHOWN ON THIS DRAWING WERE DERIVED FROM INFORMATION PROVIDED BY WCCS SURVEY CONTROL DATABASE.

THE MARK IS A ALUMINUM CAP ON THE WEST SIDE OF THE INTERSECTION OF SE 30TH STREET AND W MERCER WAY.


POINT 10 NO. MI 1010;
ELEVATION: 91.436 FEET (27.869 METERS) NAVD 88

1.0' CONTOUR INTERVAL- THE EXPECTED VERTICAL ACCURACY IS EQUAL TO 1/2 THE CONTOUR INTERVAL OR PLUS / MINUS 0.5' FOR THIS PROJECT.

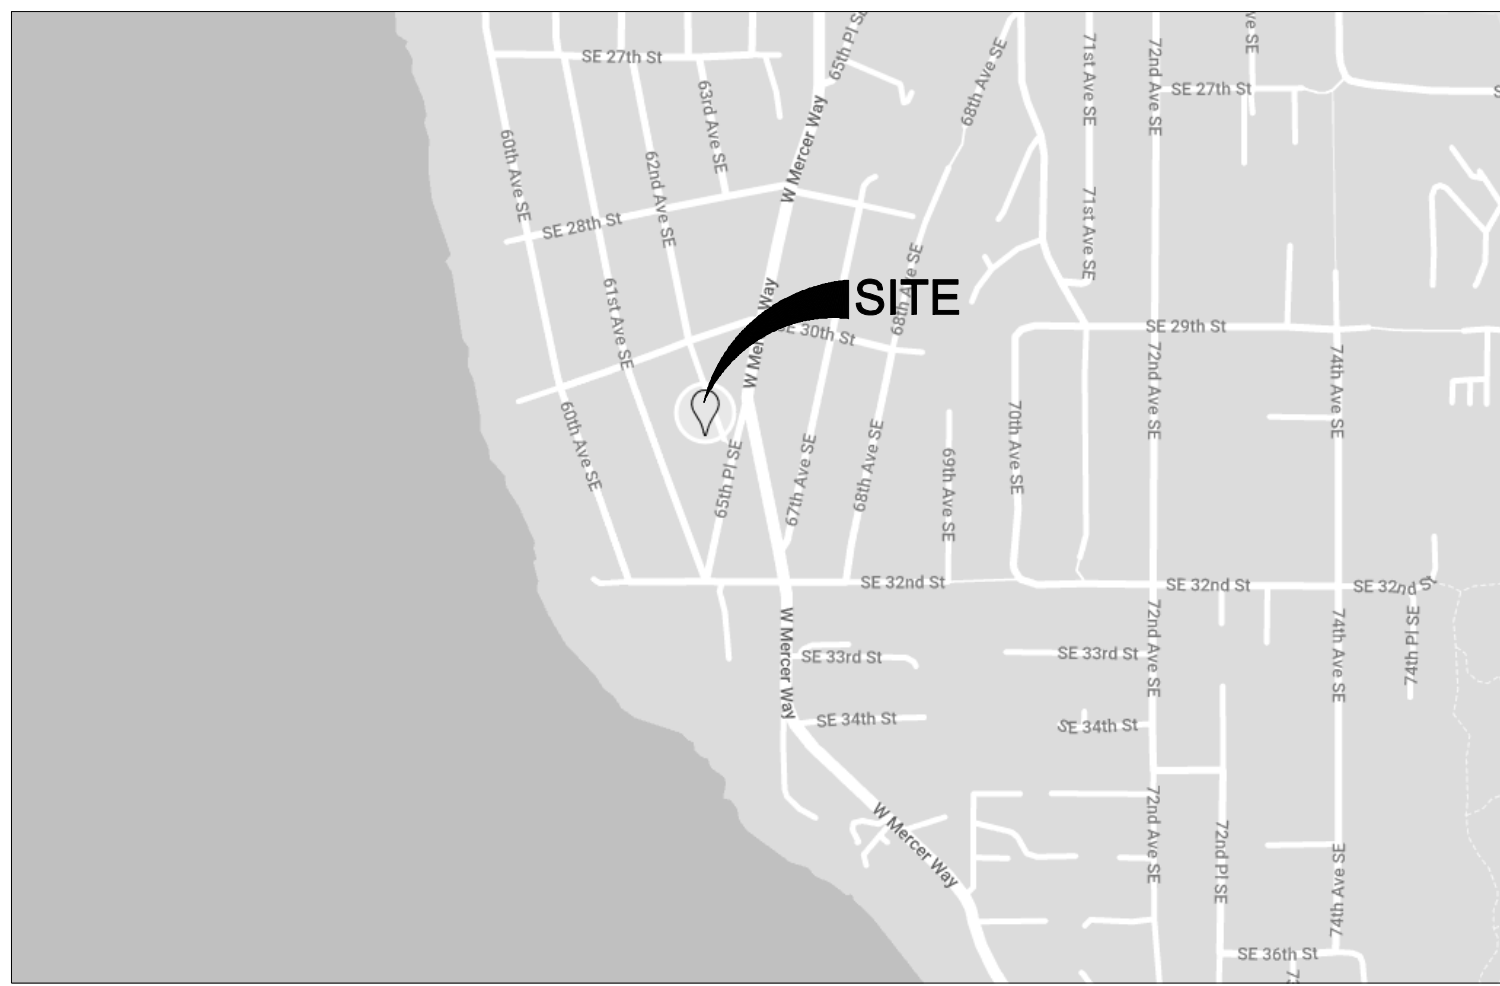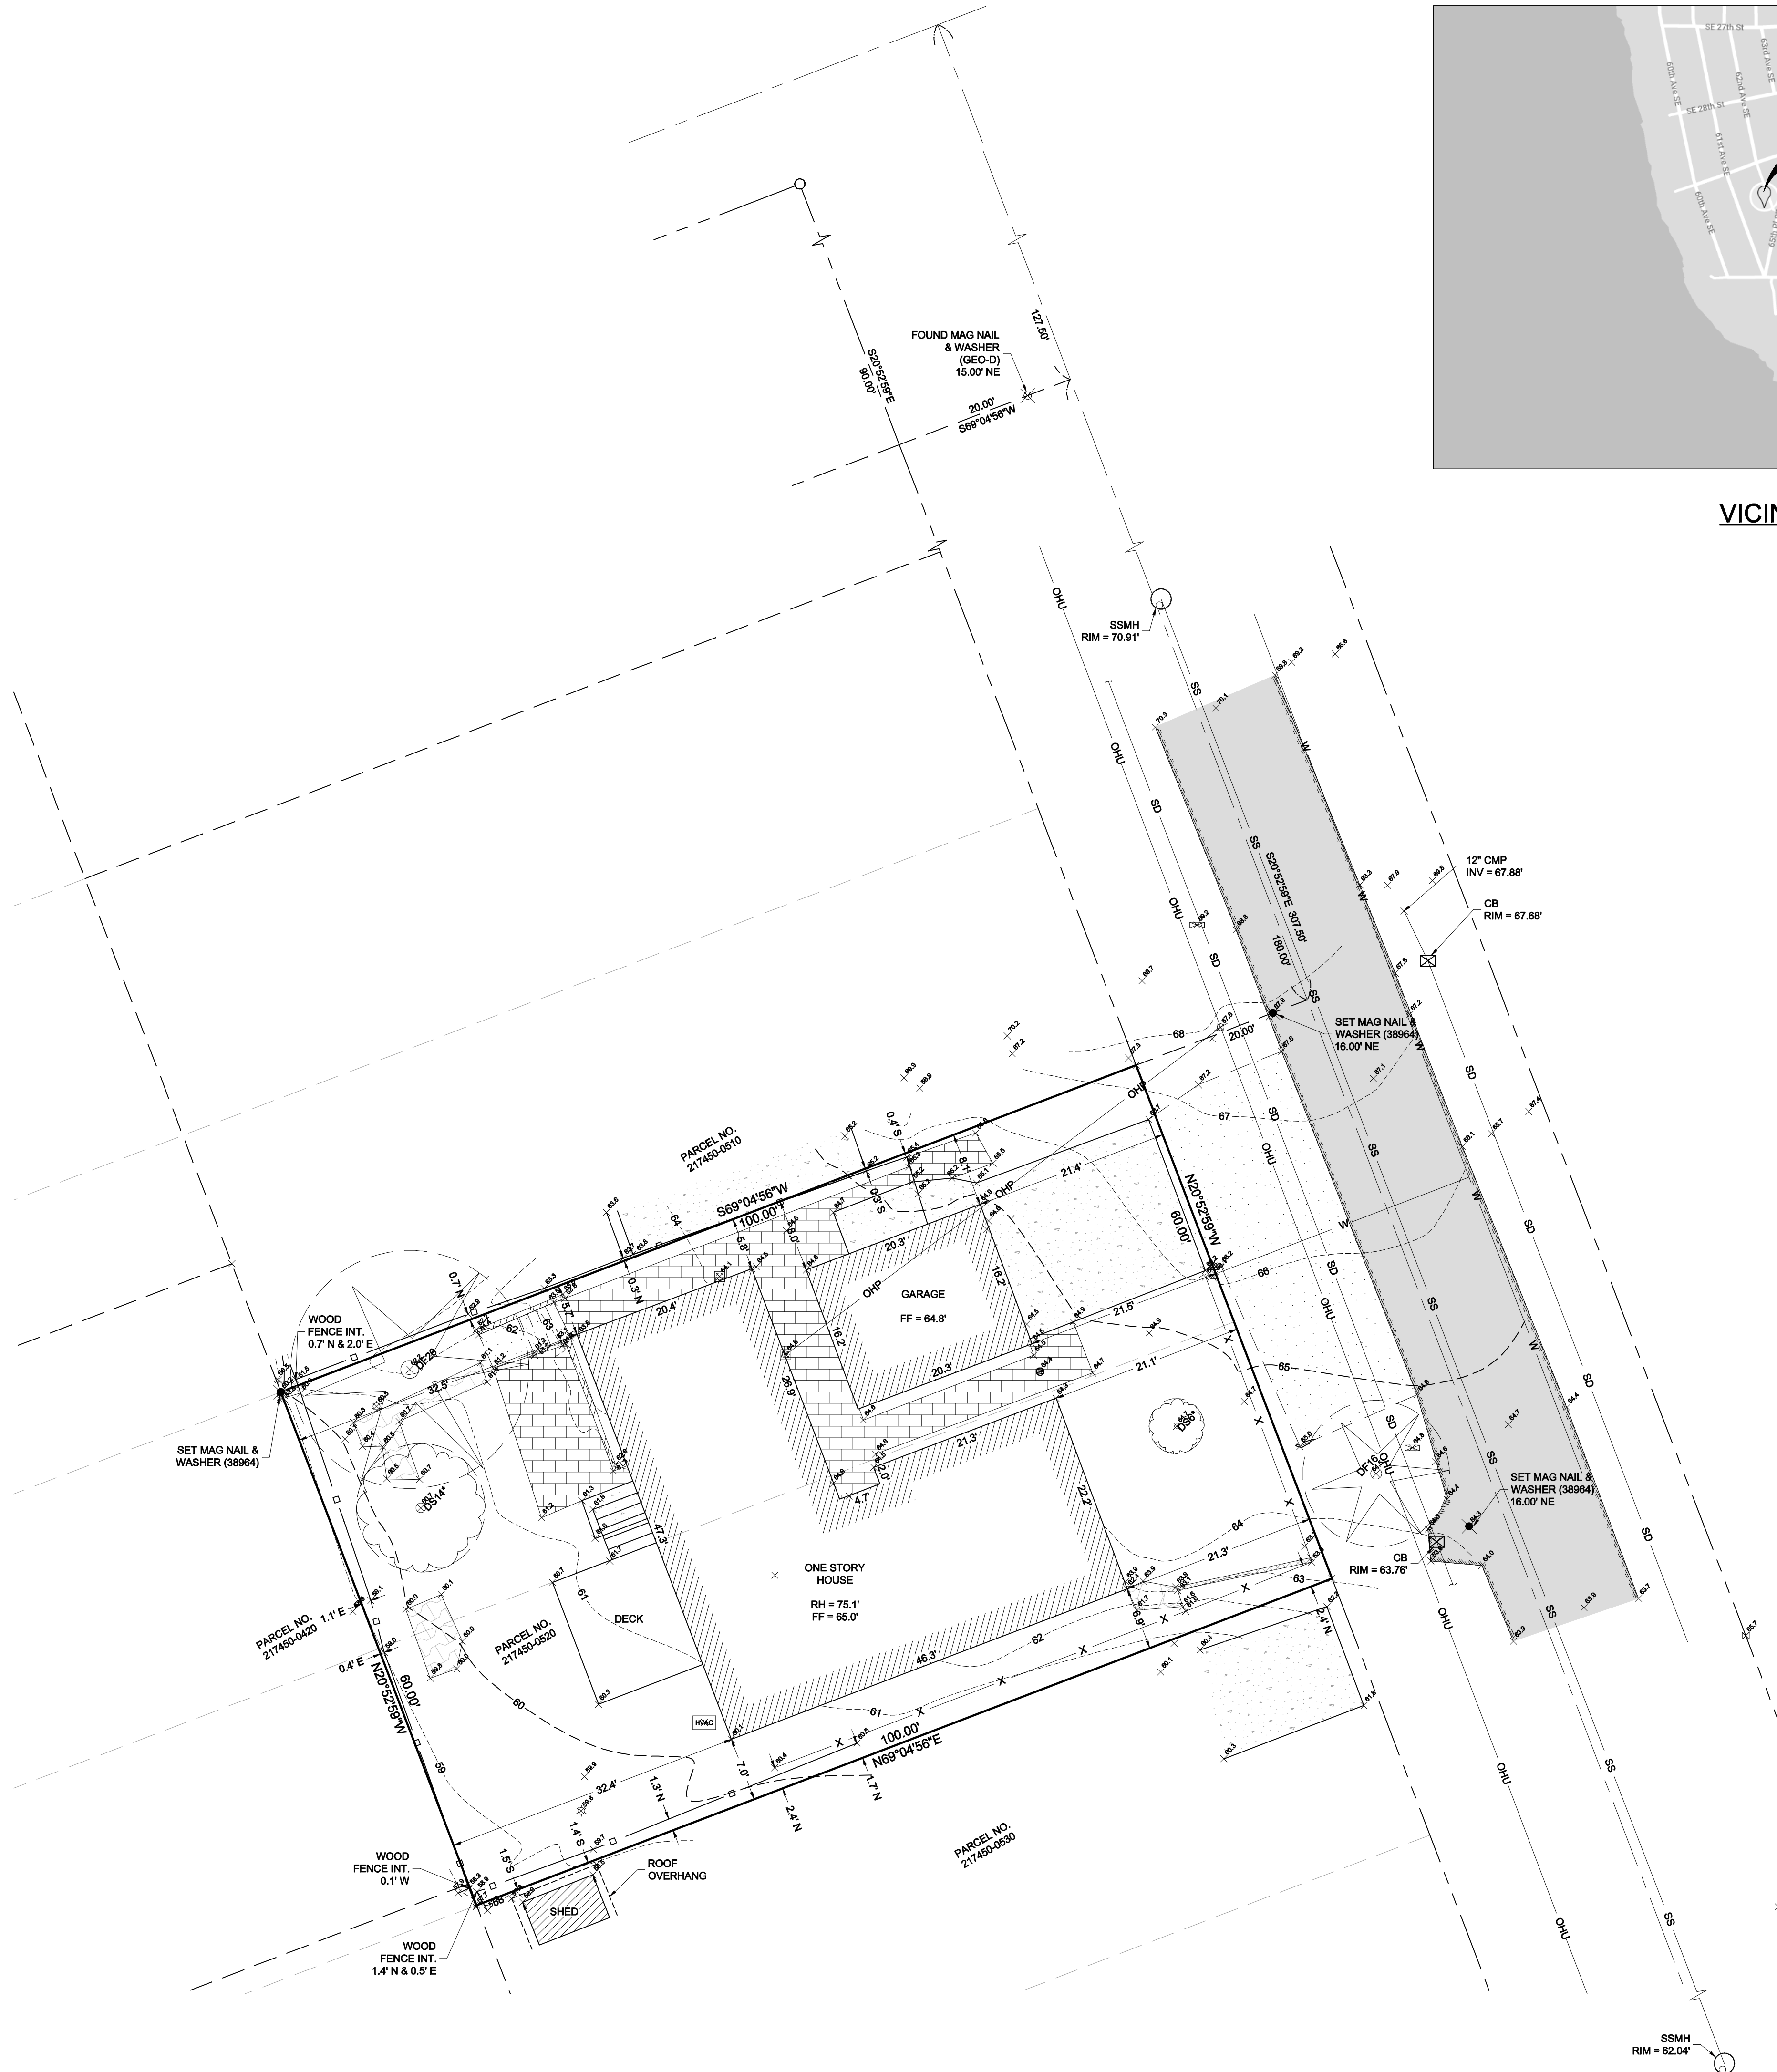

VICINITY MAP

SE 1/4, NE 1/4, SEC 11, TWP 24N, RNG 4E, W.M.

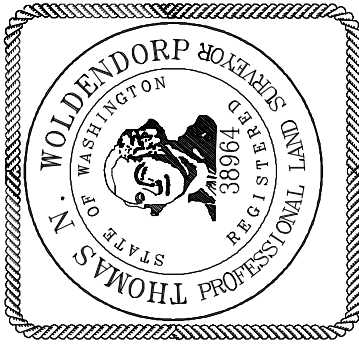

DATE	REVISION	DRN

TOPOGRAPHIC SURVEY

ASPEN HOMES NW
3029 62ND AVENUE SE
MERCER ISLAND, WA 98040

© 2022. SITE SURVEYING, INC.. ALL RIGHTS RESERVED

PROJECT NO. 22-037

DRAWN BY: MTS
CHECKED BY: TNW
DATE: 3/10/2022
SHEET 1 OF 1