

Hi Ken ! Looks like 58 . See attached

Thanks

Begin forwarded message:

From: Customer Service Mailbox <customerservice@mercerisland.gov>

Date: January 28, 2025 at 9:44:13 AM PST

To: jim@rijholdings.net

Subject: Hydrant Pressure Information for 3633 Island Crest Way

Hello Jim,

Nice to speak with you this morning. Attached is the pressure information for 3633 Island Crest way and also a guide to how to find pressure info Records" section. Once you have selected and address, use the "layers" button and then select the "water" feature from the menu on the left and show you the pressure.

Give me a call if you want me to walk you through it the first time that you try it.

Best regards,

Sheila Barlow
Customer Service Representative

City of Mercer Island

City Hall Operating Hours: City Hall temporarily closed -- read more [here](#).

206-275-7889 | www.mercerisland.gov/

Notices: Emails and attachments may be subject to disclosure pursuant to the Public Records Act (chapter 42.56 RCW).

The City of Mercer Island utilizes a hybrid working environment. Please see the City's [Employee Work Environment Information](#) page for City Hall and City service hours of operation.

Description Details Attachments

Filter

Special Interest Layers

ASSET ID
WA-HY-C3-33

Utility Layers

SHORTID
C3-33

Water

STATUS
Active

Blowoff Assemblies

BARREL DIAMETER
N/A

Hydrant

HYDRANT MAIN VALVE DIAMETER
4.25

Air Release

Pressure Reducing Valve

OWNERSHIP
Mercer Island

Backflow Preventors

YEAR INSTALLED
N/A

Lateral Valve

PRESSURE ZONE
398_Reservoir

Main Valve

Main Break

ADDRESS
38TH PL AND 82ND AVE

Sampling Station

LOCATION
38TH PL AND 82ND AVE: SE Intersection

Water Main

NUMBER OF PORTS
2

Meter

Water Pump Station

QUICK COUPLINGS
False

Storage Facility

BLUE LIGHT REFLECTOR
False

Water Lateral

Water Meter Link

FIRE FLOW MEASURED
N/A

FOOT VALVE DISTANCE
1

FOOT VALVE TURNS
13

MANUFACTURER
N/A

MODEL
N/A

STEM PLACEMENT
Unknown

BURIED
N/A

WATER MAIN DIAMETER
6"


ACCESSIBILITY
Non-Permanent Obstruction

PSI MEASURED
58

PSI MEASURE DATE
04/26/2018

CHLORINE MEASURED
1.06

CHLORINE MEASURE DATE
04/26/2018

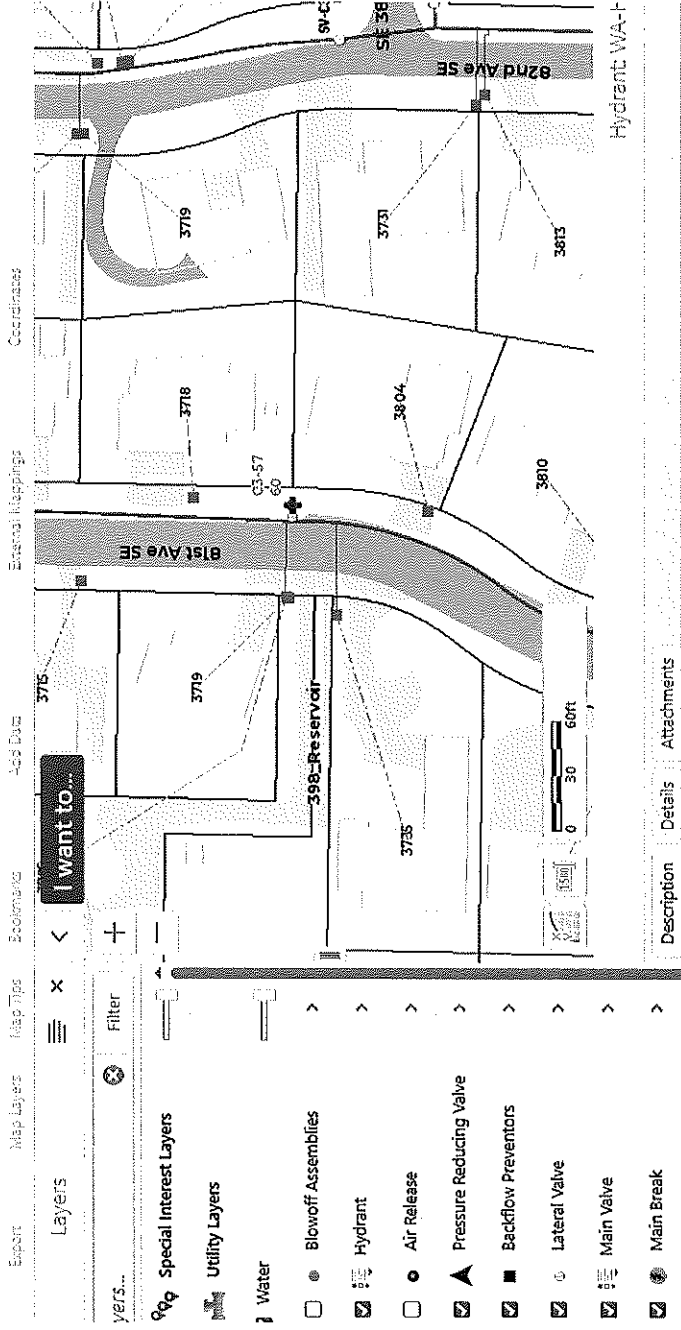

I want to...

Special Interest Layers

Utility Layers

- Water
- Blowoff Assemblies
- Hydrant
- Air Release
- Pressure Reducing Valve
- Backflow Preventors
- Lateral Valve
- Main Valve
- Main Break
- Sampling Station
- Water Main
- Meter
- Water Pump Station
- Storage Facility

Description Details Attachments

Measured Static Pressure 58
 Static Pressure Measure Date: 04/26/2018
 Modeled Fire Flow (2017): 1317
 Modeled Fire Flow (2022): 1318
 Ownership: Mercer Island

CITY OF MERCER ISLAND

COMMUNITY PLANNING & DEVELOPMENT

9611 SE 36TH STREET | MERCER ISLAND, WA 98040

PHONE: 206.275.7605 | www.mercer.gov.org

How to Find Electronic Records

TO FIND BUILDING PERMIT RECORDS

1. Go to www.mercerisland.gov

