

ROSENWALD RESIDENCE

4836 E. MERCER WAY
MERCER ISLAND, WA 98040



BUILDING PERMIT

July 25, 2025

JML
ARCHITECTS

Architect:

JML ARCHITECTS

Mercer Island, WA 98040

P. 206.802.4040
Contact: Jean-Marc LeRoy, AIA



Owner:

Greg and Jennifer Rosenwald

4836 E Mercer Way
Mercer Island, WA 98040

P. 206.914.0417
Contact: Greg Rosenwald

General Contractor:

TBD

-

P. -

Contact: -

Structural Engineer:

Harriott Valentine Engineering

1932 1st Ave, Suite 720

Seattle, WA 98101

P. 206.624.4760

Contact: Todd Valentine

Mechanical Engineer:

n/a

-

P. -

Contact: -

Jurisdiction Approval Stamp

-

-

-

-

-

-

-

-

-

-

-

-

-

-

-

-

-

-

-

-

-

-

-

ROSENWALD RESIDENCE

4836 E. MERCER WAY

MERCER ISLAND, WA 98040

ABBREVIATIONS

ANGLE AT CENTERLINE CHANNEL PENNY PERPENDICULAR PLATE POUND OR NUMBER DIAMETER SQUARE FEET	DIM. DIV. DN. DR. DPR. DR. DS. D.T. DWG. DWR.	DIMENSION DIVISION DOWN DAMP/PROOFING DISPENSER DOOR DOWNSPOUT DRAIN TILE DRAWING DRAWER	I.D. INS. INCL. INSULL. INT. INV.	INSIDE DIAMETER INSIDE PIPE SIZE INCLUDING INSULATION INTERIOR INVERT	R. R.A. RAD. R.B. R.T. R.D. REF. REFL. REFR. REG. REIN. REINFORC. REQ'D. REV. R.H. R.M. R.O. R.O.W. RCP.	RISER RETURN AIR RADIUS RESILIENT BASE RESILIENT TILE ROOF DRAIN REFERENCE REFLECTED REFRIGERATOR REGISTER REINFORCING REQUIRED REVISION RIGHT HAND ROOM ROUGH OPENING RIGHT OF WAY REFLECTED CLG. PLAN	S. S.C. SCHED. S.D. SEAL SECT. SLOPE SLOPE FEET SHELF SHEET SHEATHING SIM. SLOPE STAND PIPE SPEC. SQUARE SERVICE SINK S.S.T.L. STD. STEL STOR. STR. STRUCT. SUSP.	MARB. MAS. MAX. M.C. MECH. MED. MEMB. META. MEZZ. MFR. M.F.B. MH. MIN. MISC. MTD. MTL. MULL.	MARBLE MASONRY MAXIMUM MEDICINE CABINET METAL MEZZANINE MANUFACTURE(R) MINERAL FIBER BD. MANHOLE MINIMUM MISCELLANEOUS MOUNTED METAL MULLION	N. N.I.C. NO NOM. N.T.S.	NORTH NOT IN CONTRACT NUMBER NOMINAL NOT TO SCALE	O.A. O.C. O.D. O.F.R.D. OH. OPNG. OPP. O.T.S.	OVERALL ON CENTER OUTSIDE DIAMETER OVERFLOW ROOF DRAIN OVERHEAD OPENING OPPOSITE OPEN TO STRUCTURE	PASS. P.B. P.B.D. P.C. PERF. PERI. P.L. P.LAM. PLAS. PLWD. PNL. P.O. PR. P.S.F. P.S.I. PT. P.T. PD. PARTITION PVT.M. P.T.D.	PASSENGER PANIC BAR PARTICLE BOARD PRECAST CONCRETE PERFORATE(D) PERIMETER PLATE PROPERTY LINE PLASTIC LAMINATE PLASTER PLYWOOD PANEL PURCHASE ORDER PAIR POUNDS PER SQUARE FOOT POUNDS PER SQUARE INCH POINT PRESSURE TREATED PLANTER DRAIN PARTITION PAVEMENT PAPER TOWEL DISPENSER	Q.T.	QUARRY TILE																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																		
A.B. A/C ACC. ACOUS. AC.T. A.D. ADD. ADDJ. ADDUS. A.F.F. AGGR. AGGR. ALUM. ANOD. APPROX. ARCH. ASPH. A.V.	ANCHOR BOLT AIR CONDITIONING ACCESSIBLE ACOUSTICAL ACOUSTIC TILE AREA DRAIN ADDENDUM ADJACENT ADJUSTABLE ABOVE FINISH FLOOR AGGREGATE ALTERNATE ALUMINUM ANODIZED APPROXIMATE ARCHITECT ASPHALT AUDIOVISUAL	E. E.A.C. E.A.F.S. E.J.T. ELEV. ELEV. ENCL. EQ. EQUIP. ESC. EST. EXCAV. EXHAUST EXIST. EXP. EXT.	EAST EACH EXTERIOR/INSULATED FINISH SYSTEM EXPANSION JOINT ELEVATION ELECTRIC(AL) ELEVATOR ENCLOSE(URE) EQUAL EQUIPMENT ESCALATOR ESTIMATE EXCAVATE EXHAUST EXISTING EXPANSION EXTERIOR	F.B.O.I.C. F.B.O.I.O. F.D. F.D.N. F.E. F.E.C. F.F. F.F.C. F.F.I. F.L. F.LASH. FLOR. F.O.S. F.O.C. F.O.B. F.O.M. F.T. FTG. F.T.V. FURR. FUT. F.W.B. F.W.C.	FURNISHED BY OWNER INSTALLED BY CONTRACTOR FURNISHED BY OWNER INSTALLED BY OWNER FLOOR DRAIN FOUNDATION FIRE EXTINGUISHER FIRE EXTINGUISHER CABINET FACTORY FINISH FINISHED FLOOR FLASHING FLUORESCENT FACE OF STUDS FACE OF CONCRETE FACE OF FINISH FACE OF BRICK FACE OF MASONRY FIREPROOF FOOTING FIXED SECURITY TELEVISION FURRED FUTURE FIBERGLASS REINF. GYPSUM FABRIC WALLCOVERING	G. G.A. G.B. GEN. GL. GND. GR. G.W.B. GYP. GFR.C.	GAGE GALVANIZED GRAB BAR GENERAL GLASS GLAZING GROUND GRADE GRADING GYPSUM WALL BOARD GYP. GLASS FIBER REINF. CONC.	H.B. H.D. HDBD. HDR. HDWD. HDWR. H.M. HORIZ. HR. HTG. H.V.A.C. H.W.	HOSE BIBB HOLLOW CORE HEAD HARDBOARD HEADER HARDWOOD HARDWARE HOLLOW METAL HORIZONTAL HOUR HEIGHT HEATING HEATING/VENTILATING/ AIR CONDITIONING HOT WATER HEATER																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																										
B.D. BTWN BLDG. BLK. BLKG. BM. B.M. BOT. BOTT. BRG. BRZ. BSMT. B.U.R.	BOARD BETWEEN BUILDING BLOCK BLOCKING BEAM BENCH MARK BOTTOM BEARING BRONZE BASEMENT BUILT UP ROOF	F.B.O.I.C. F.B.O.I.O. F.D. F.D.N. F.E. F.E.C. F.F. F.F.C. F.F.I. F.L. F.LASH. FLOR. F.O.S. F.O.C. F.O.B. F.O.M. F.T. FTG. F.T.V. FURR. FUT. F.W.B. F.W.C.	FURNISHED BY OWNER INSTALLED BY CONTRACTOR INSTALLED BY OWNER FLOOR DRAIN FOUNDATION FIRE EXTINGUISHER FIRE EXTINGUISHER CABINET FACTORY FINISH FINISHED FLOOR FLASHING FLUORESCENT FACE OF STUDS FACE OF CONCRETE FACE OF FINISH FACE OF BRICK FACE OF MASONRY FIREPROOF FOOTING FIXED SECURITY TELEVISION FURRED FUTURE FIBERGLASS REINF. GYPSUM FABRIC WALLCOVERING	N. N.I.C. NO NOM. N.T.S.	NORTH NOT IN CONTRACT NUMBER NOMINAL NOT TO SCALE	O.A. O.C. O.D. O.F.R.D. OH. OPNG. OPP. O.T.S.	OVERALL ON CENTER OUTSIDE DIAMETER OVERFLOW ROOF DRAIN OVERHEAD OPENING OPPOSITE OPEN TO STRUCTURE	PASS. P.B. P.B.D. P.C. PERF. PERI. P.L. P.LAM. PLAS. PLWD. PNL. P.O. PR. P.S.F. P.S.I. PT. P.T. PD. PARTITION PVT.M. P.T.D.	PASSENGER PANIC BAR PARTICLE BOARD PRECAST CONCRETE PERFORATE(D) PERIMETER PLATE PROPERTY LINE PLASTIC LAMINATE PLASTER PLYWOOD PANEL PURCHASE ORDER PAIR POUNDS PER SQUARE FOOT POUNDS PER SQUARE INCH POINT PRESSURE TREATED PLANTER DRAIN PARTITION PAVEMENT PAPER TOWEL DISPENSER	Q.T.	QUARRY TILE																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																								
CAB. C.B. C.B.M. CER. C.G. CHAMF. C.I. C.I.P. CIRC. C.J.T. CLG. CLR. C.M.U. CNTR. C.O. COL. CONC. CONJ. CONST. CONT. CONTR. CORR. CPT. CRS. CSMT. C.T. C.T.R. CSK. CU. CU. FT. CU. YD.	CABINET CATCH BASIN CEMENT CERAMIC CORNER GUARD CHAMFER CAST IRON CAST IN PLACE(CONCRETE) CIRCLE CONTROL JOINT CEILING CLEAR(ANCE) CONCRETE MASONRY UNIT COUNTER CLEAN OUT C.O. COLUMN CONCRETE CONNECTION CONSTRUCTION CONTINUOUS CONTRACTOR CORRIDOR CARPET COURISING CASEMENT CERAMIC TILE CENTER COUNTER SINK CUBIC FOOT CUBIC YARD	F.B.O.I.C. F.B.O.I.O. F.D. F.D.N. F.E. F.E.C. F.F. F.F.C. F.F.I. F.L. F.LASH. FLOR. F.O.S. F.O.C. F.O.B. F.O.M. F.T. FTG. F.T.V. FURR. FUT. F.W.B. F.W.C.	FURNISHED BY OWNER INSTALLED BY CONTRACTOR INSTALLED BY OWNER FLOOR DRAIN FOUNDATION FIRE EXTINGUISHER FIRE EXTINGUISHER CABINET FACTORY FINISH FINISHED FLOOR FLASHING FLUORESCENT FACE OF STUDS FACE OF CONCRETE FACE OF FINISH FACE OF BRICK FACE OF MASONRY FIREPROOF FOOTING FIXED SECURITY TELEVISION FURRED FUTURE FIBERGLASS REINF. GYPSUM FABRIC WALLCOVERING	N. N.I.C. NO NOM. N.T.S.	NORTH NOT IN CONTRACT NUMBER NOMINAL NOT TO SCALE	O.A. O.C. O.D. O.F.R.D. OH. OPNG. OPP. O.T.S.	OVERALL ON CENTER OUTSIDE DIAMETER OVERFLOW ROOF DRAIN OVERHEAD OPENING OPPOSITE OPEN TO STRUCTURE	PASS. P.B. P.B.D. P.C. PERF. PERI. P.L. P.LAM. PLAS. PLWD. PNL. P.O. PR. P.S.F. P.S.I. PT. P.T. PD. PARTITION PVT.M. P.T.D.	PASSENGER PANIC BAR PARTICLE BOARD PRECAST CONCRETE PERFORATE(D) PERIMETER PLATE PROPERTY LINE PLASTIC LAMINATE PLASTER PLYWOOD PANEL PURCHASE ORDER PAIR POUNDS PER SQUARE FOOT POUNDS PER SQUARE INCH POINT PRESSURE TREATED PLANTER DRAIN PARTITION PAVEMENT PAPER TOWEL DISPENSER	Q.T.	QUARRY TILE																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																								
DEMOL. DBL. D.L. DET. D.F. D.H. DIAGON. DIAM.	DEMOLITION DOUBLE DEAD LOAD DETACHED DRINKING FOUNTAIN DOUBLE HUNG DIAGONAL DIAMETER	H.B. H.D. HDBD. HDR. HDWD. HDWR. H.M. HORIZ. HR. HTG. H.V.A.C. H.W.	HOSE BIBB HOLLOW CORE HEAD HARDBOARD HEADER HARDWOOD HARDWARE HOLLOW METAL HORIZONTAL HOUR HEIGHT HEATING HEATING/VENTILATING/ AIR CONDITIONING HOT WATER HEATER	N. N.I.C. NO NOM. N.T.S.	NORTH NOT IN CONTRACT NUMBER NOMINAL NOT TO SCALE	O.A. O.C. O.D. O.F.R.D. OH. OPNG. OPP. O.T.S.	OVERALL ON CENTER OUTSIDE DIAMETER OVERFLOW ROOF DRAIN OVERHEAD OPENING OPPOSITE OPEN TO STRUCTURE	PASS. P.B. P.B.D. P.C. PERF. PERI. P.L. P.LAM. PLAS. PLWD. PNL. P.O. PR. P.S.F. P.S.I. PT. P.T. PD. PARTITION PVT.M. P.T.D.	PASSENGER PANIC BAR PARTICLE BOARD PRECAST CONCRETE PERFORATE(D) PERIMETER PLATE PROPERTY LINE PLASTIC LAMINATE PLASTER PLYWOOD PANEL PURCHASE ORDER PAIR POUNDS PER SQUARE FOOT POUNDS PER SQUARE INCH POINT PRESSURE TREATED PLANTER DRAIN PARTITION PAVEMENT PAPER TOWEL DISPENSER	Q.T.	QUARRY TILE																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																								
																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																			</

SYMBOL LEGEND

COLUMN GRID LINE	B	
DETAIL BUG	5 A2.7	DETAIL NUMBER DRAWING NUMBER
BUILDING SECTION/ WALL SECTION/ ELEVATION	A9.4	SECTION DESIGNATION DRAWING NUMBER
DATUM		
REVISION	3	SEE TITLE BLOCK FOR REVISION. MOST RECENT REVISION SHOWN CLOUDED.
NORTH ARROW		
INTERIOR ELEVATION REFERENCE	22 A8.6 22	SHEET NUMBER DRAWING NUMBER
ROOM IDENTIFICATION	ROOM NAME 304	ROOM NUMBER
OPENING NUMBER	308A	
MATCH LINE	MATCH LINE	
WALL/PARTITION TYPE	6 3 a	

ENERGY CALCULATIONS

PROJECT INFORMATION

PROJECT ADDRESS:	4836 E MERCER WAY, MERCER ISLAND, WA 98040
PROJECT DESCRIPTION:	272 SF ADDITION TO EXIST. HOUSE, 653 SF OF ROOF AREA FOR COVERED PATIO SPACE. SECOND FLOOR ADDITION TO EXIST. GARAGE. INTERIOR AND EXTERIOR RENOVATIONS PER DRAWINGS
CITY OF MERCER ISLAND PROJECT NUMBER:	2504-054
RELATED PERMIT NUMBER:	N/A
ACCESSOR'S TAX NUMBER:	192405-9001
PARCEL NUMBER:	192405-9001
CONSTRUCTION TYPE:	VB
CONSTRUCTION STORMWATER CONTROL:	NO
BUILDING CODES:	ARCHITECTURE - 2021 INTERNATIONAL RESIDENTIAL CODE ENGINEERING - 2021 INTERNATIONAL BUILDING CODE

LEGAL DESCRIPTION

BEG AT N MNDR COR OF GL 1 TH S 00-11-00 W 335 FT TH N 89-41-00 W 15 FT TO TPOB TH S 00-11-00 W 80 FT TH S 89-41-00 E 220 FT ML TO ELY LN SD GL TH NELY TO PT S 89-41-00 E OF TPOB TH N 89-41-00 W TO TPOB TGW 2ND CL SH LDS ADJ

ZONING

ZONING - R-15
LAND USE - SINGLE FAMILY/DUPLEX RESIDENTIAL

FIRE DEPARTMENT

1. NFPA 13D (FULL COVERAGE) FIRE SPRINKLER SYSTEM IN COMPLIANCE WITH NFPA 13D AND CoMI STANDARDS SHALL BE INSTALLED THROUGHOUT THE RESIDENCE.

2. NFPA 72 MONITORED HOUSEHOLD FIRE ALARM SYSTEM IN COMPLIANCE WITH NFPA 72 AND CoMI STANDARDS SHALL BE INSTALLED THOUGHOUT THE RESIDENCE.

3. FIRE ROAD ACCESS ALTERNATIVE - ALL BEDROOM, UTILITY ROOM AND MECHANICAL ROOMS SHALL HAVE SOLID CORE DOORS.

GENERAL NOTES

- DO NOT SCALE DRAWINGS.
- IT IS THE INTENT OF THE CONTRACT DOCUMENTS THAT ALL WORK COMPLY WITH THE 2021 INTERNATIONAL RESIDENTIAL CODE, THE 2021 WASHINGTON STATE ENERGY CODE, THE 2021 INTERNATIONAL MECHANICAL CODE, THE 2021 UNIFORM PLUMBING CODE AND RULES AND REGULATIONS OF THE JURISDICTIONS HAVING AUTHORITY.
- PRIOR TO COMMENCEMENT OF ANY PORTION OF THE WORK, THE CONTRACTOR SHALL NOTIFY THE ARCHITECT OF ANY DISCREPANCIES NOTED AMONG OR BETWEEN THE CONTRACT DOCUMENTS, OWNER-PROVIDED INFORMATION, SITE CONDITIONS, MANUFACTURER RECOMMENDATIONS, OR CODE REGULATIONS OR RULES OF JURISDICTIONS HAVING AUTHORITY.
- PRIOR TO COMMENCEMENT, OF ANY PORTION OF THE WORK, THE CONTRACTOR SHALL BECOME FAMILIAR WITH THE CONTRACT DOCUMENTS, OWNER PROVIDED INFORMATION, AND SITE CONDITIONS INCLUDING TAKING FIELD MEASUREMENTS AS NECESSARY.
- THE CONTRACTOR SHALL PAY AND SECURE ALL GOVERNMENTAL PERMITS, FEES, LICENSES AND INSPECTIONS NECESSARY FOR PROPER EXECUTION AND COMPLETION OF THE WORK WITH THE EXCEPTION OF THE GENERAL BUILDING PERMIT.
- ALL DIMENSIONS ARE TO FACE OF FINISH, UNLESS OTHERWISE NOTED, CONTACT THE ARCHITECT FOR CLARIFICATIONS IF NEEDED.
- DESIGN-BUILD SERVICES SUCH AS ELECTRICAL, PLUMBING AND MECHANICAL SHALL BE CONDUCTED UNDER SEPARATE PERMITS FILED AND SECURED BY THE G.C. OR DESIGN-BUILD SUB-CONTRACTOR.

DRAWING INDEX

ARCHITECTURAL	
A0.1	PROJECT INFORMATION SURVEY SITE PLAN HARDSCAPE PLAN HARD SURFACE PLAN SHORELINE PLAN IMPERVIOUS SURFACE AREA GROSS FLOOR AREA AND A.B.E.
A1.0	FOUNDATION PLAN
A1.1	EXISTING MAIN FLOOR PLAN
A1.2	PROPOSED MAIN FLOOR PLAN
A1.3	EXISTING UPPER FLOOR PLAN
A1.4	PROPOSED UPPER FLOOR PLAN
A1.5	ROOF PLAN
A2.0	EXISTING EXT. ELEVATIONS
A2.1	EXISTING EXT. ELEVATIONS
A2.2	EXT. ELEVATIONS
A2.3	EXT. ELEVATIONS
A2.4	BUILDING SECTIONS
A2.5	BUILDINGWALL SECTIONS
A2.6	DOOR SCHEDULE, ENERGY NOTES
A2.7	WINDOW SCHEDULE, ENERGY NOTES
STRUCTURAL ENGINEERING	
S1.0	GENERAL STRUCTURAL NOTES
S2.0	MAIN FLOOR FRAMING/FOUNDATION PLAN
S2.1	UPPER FLOOR FRAMING PLAN
S2.2	ROOF FRAMING PLAN
S3.0	STRUCTURAL DETAILS
S3.1	STRUCTURAL DETAILS
S3.2	STRUCTURAL DETAILS
S4.0	STRUCTURAL DETAILS

PROJECT DIRECTORY

OWNER:	GREG AND JENNIFER ROSENWALD 4836 E MERCER WAY MERCER ISLAND, WA 98040 CONTACT: GREG ROSENWALD 206 914 0417
ARCHITECT:	JML ARCHITECTS 3490 69TH AVE SE MERCER ISLAND, WA 98040 CONTACT: JEAN-MARC LEROY, AIA 206.802.4040
GENERAL CONTRACTOR:	TBD - - CONTACT: - -
STRUCTURAL ENGINEER:	HARRIOTT VALENTINE ENGINEERING 1932 1ST AVE, SUITE 720 SEATTLE, WA 98101 CONTACT: TODD VALENTINE 206.624.4760
MECHANICAL ENGINEER:	N/A

Date:

-

-

-

-

-

-

-

-

-

-

-

-

-

-

-

-

-

-

Project: Rosenwald Residence

4836 E Mercer Way
Mercer Island, WA 98040
Project No. 24.245
Date: July 25, 2025


BUILDING PERMIT

PROJECT
INFORMATION

A0.1

Plot Date: 12/3/2025 2:05 PM
Save Date: 12/12/25 1:00 PM
By: John Christensen
File: P:\O\WDV\03510001\0400CAD\SV\BASE\SV\BS-OWD\VD\0351.dwg

NE 1/4 OF THE NE 1/4, SEC. 19, TWP. 24 N., RNG. 5 E., W.M.

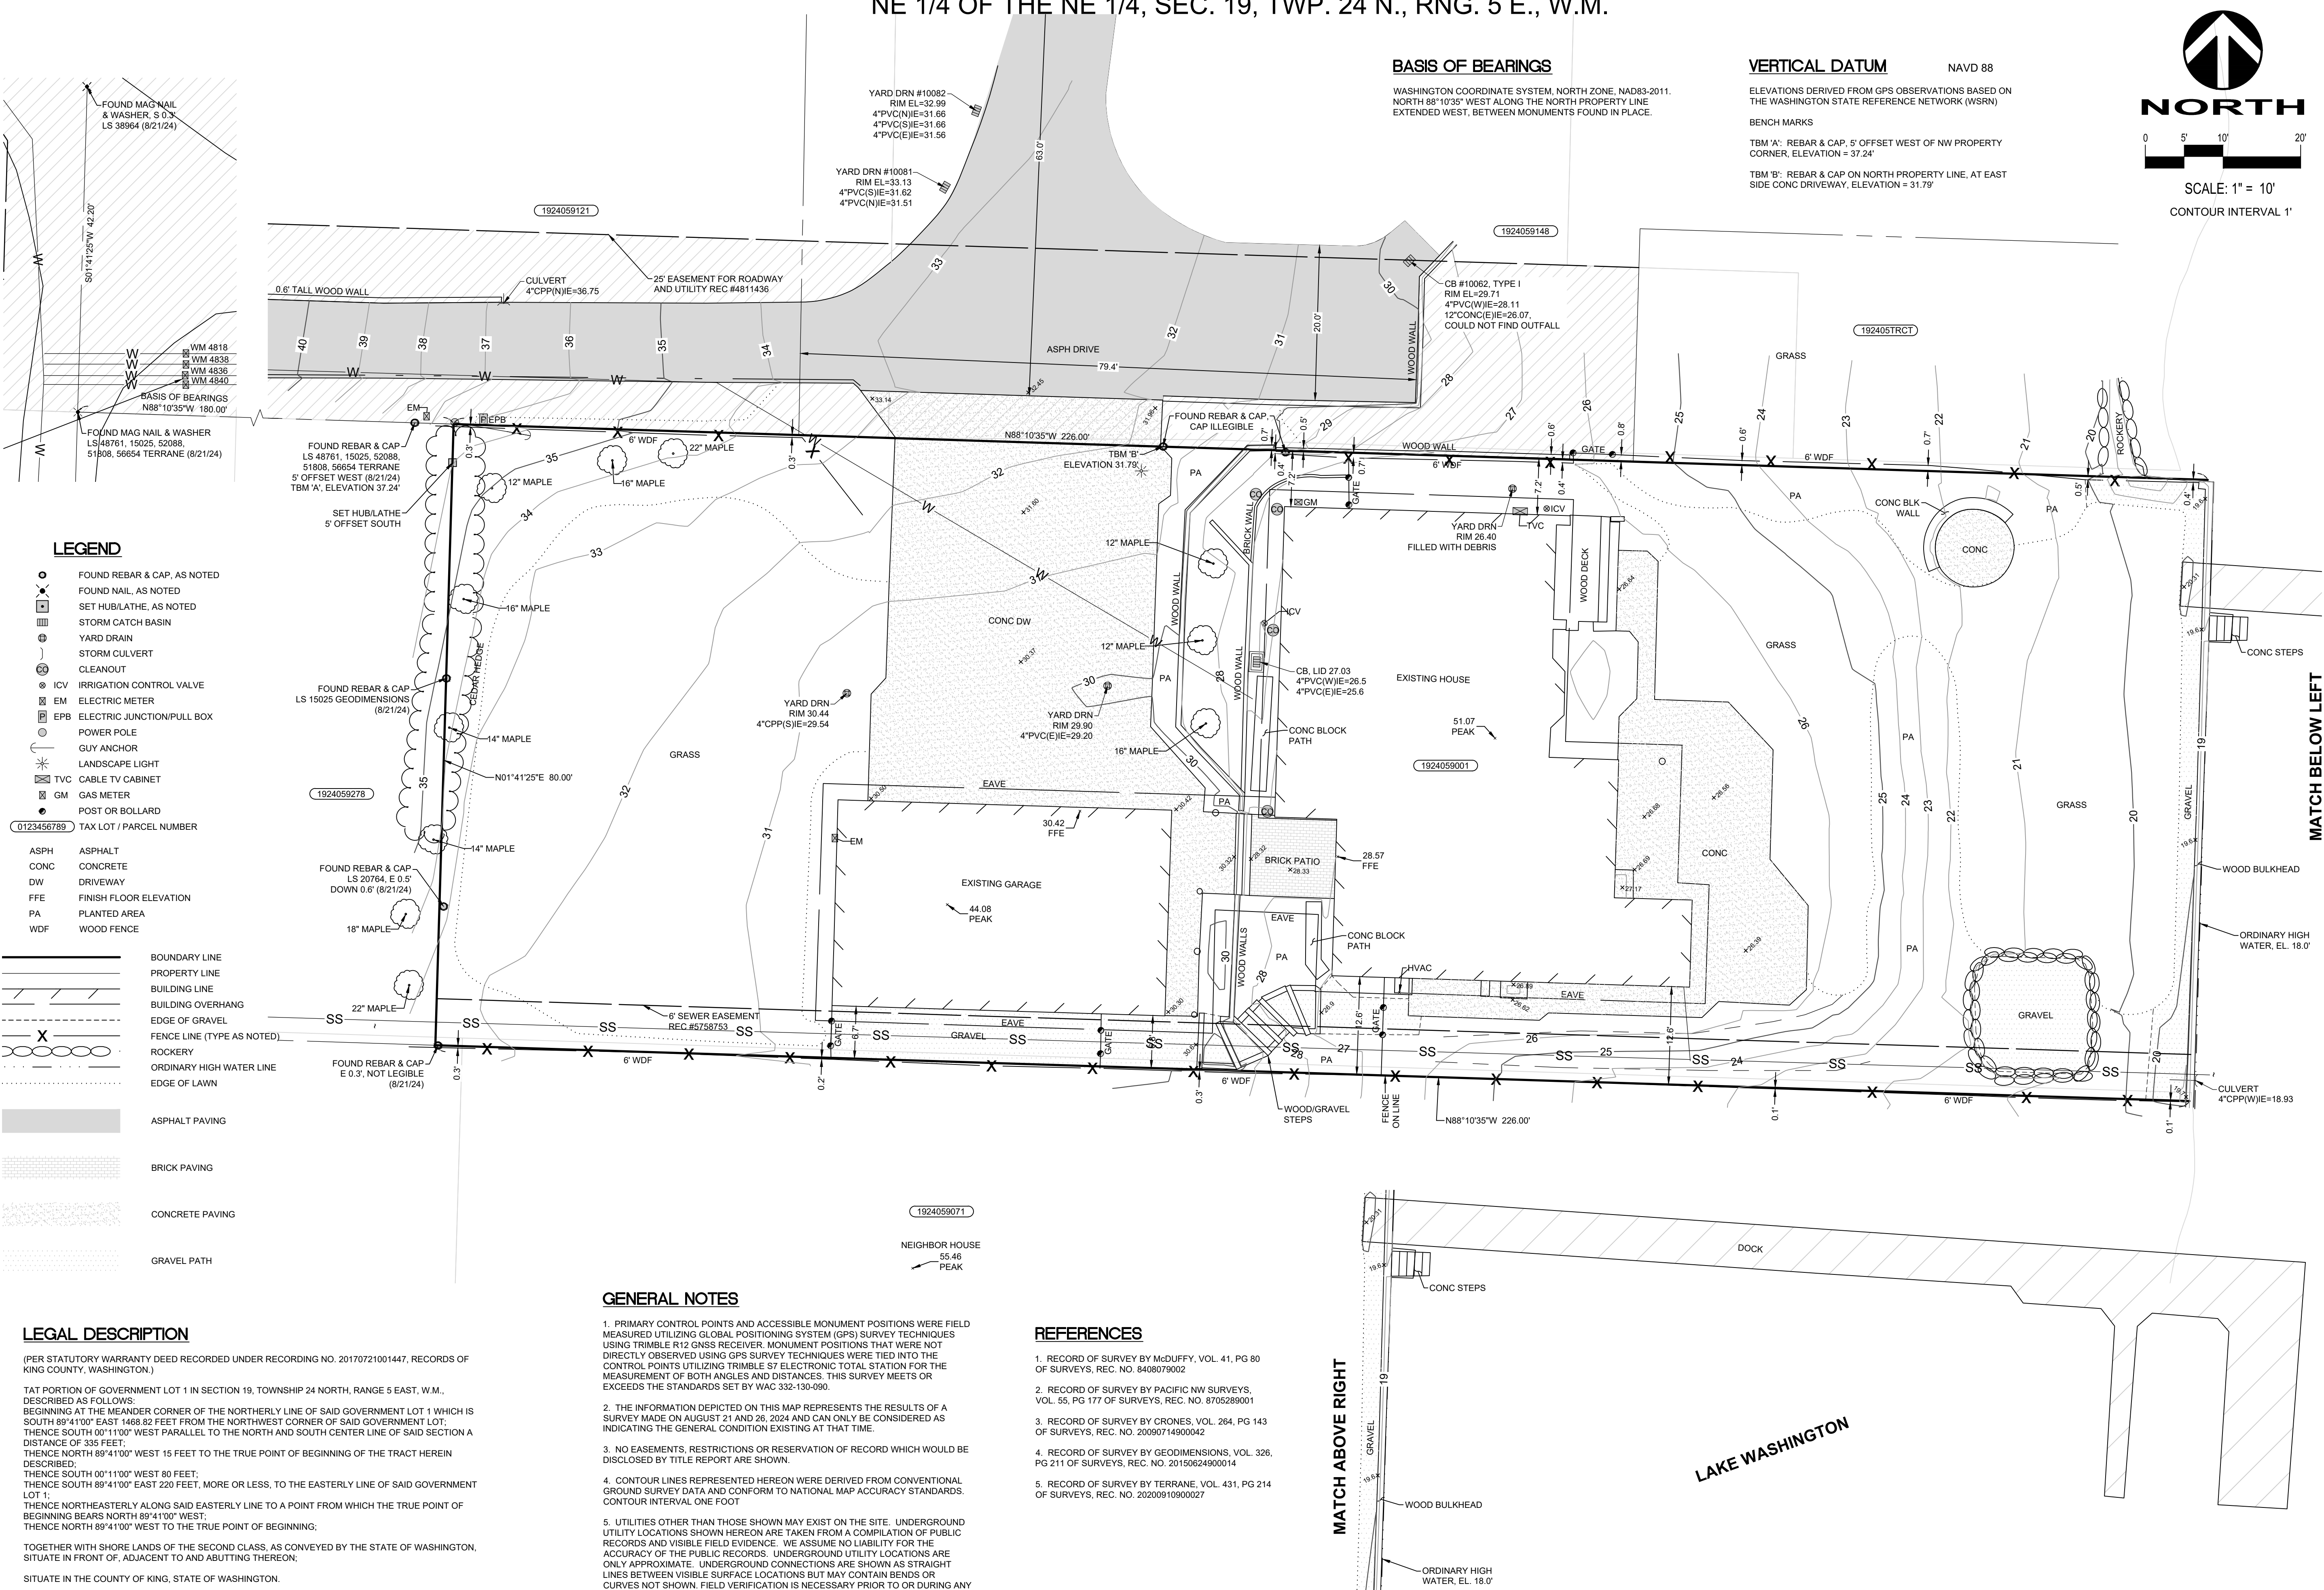

LEGEND

- FOUND REBAR & CAP, AS NOTED
- FOUND NAIL, AS NOTED
- SET HUB/LATHE, AS NOTED
- STORM CATCH BASIN
- YARD DRAIN
- STORM CULVERT
- CLEANOUT
- ICV IRRIGATION CONTROL VALVE
- EM ELECTRIC METER
- EPB ELECTRIC JUNCTION/PULL BOX
- POWER POLE
- GUY ANCHOR
- LANDSCAPE LIGHT
- TVC CABLE TV CABINET
- GM GAS METER
- POST OR BOLLARD
- TAX LOT / PARCEL NUMBER
- ASPH ASPHALT
- CONC CONCRETE
- DW DRIVEWAY
- FFE FINISH FLOOR ELEVATION
- PA PLANTED AREA
- WDF WOOD FENCE

- BOUNDARY LINE
- PROPERTY LINE
- BUILDING LINE
- BUILDING OVERHANG
- EDGE OF GRAVEL
- FENCE LINE (TYPE AS NOTED)
- ROCKERY
- ORDINARY HIGH WATER LINE
- EDGE OF LAWN
- ASPHALT PAVING
- BRICK PAVING
- CONCRETE PAVING
- GRAVEL PATH

LEGAL DESCRIPTION

(PER STATUTORY WARRANTY DEED RECORDED UNDER RECORDING NO. 20170721001447, RECORDS OF KING COUNTY, WASHINGTON.)

TAT PORTION OF GOVERNMENT LOT 1 IN SECTION 19, TOWNSHIP 24 NORTH, RANGE 5 EAST, W.M., DESCRIBED AS FOLLOWS:
BEGINNING AT THE MEANDER CORNER OF THE NORTHERLY LINE OF SAID GOVERNMENT LOT 1 WHICH IS SOUTH 89°41'00" EAST 1468.82 FEET FROM THE NORTHWEST CORNER OF SAID GOVERNMENT LOT;
THENCE SOUTH 00°11'00" WEST PARALLEL TO THE NORTH AND SOUTH CENTER LINE OF SAID SECTION A DISTANCE OF 335 FEET;
THENCE NORTH 89°41'00" WEST 15 FEET TO THE TRUE POINT OF BEGINNING OF THE TRACT HEREIN DESCRIBED;
THENCE SOUTH 00°11'00" WEST 80 FEET;
THENCE SOUTH 89°41'00" EAST 220 FEET, MORE OR LESS, TO THE EASTERLY LINE OF SAID GOVERNMENT LOT 1;
THENCE NORTHEASTERLY ALONG SAID EASTERLY LINE TO A POINT FROM WHICH THE TRUE POINT OF BEGINNING BEARS NORTH 89°41'00" WEST;
THENCE NORTH 89°41'00" WEST TO THE TRUE POINT OF BEGINNING;

TOGETHER WITH SHORE LANDS OF THE SECOND CLASS, AS CONVEYED BY THE STATE OF WASHINGTON, SITUATE IN FRONT OF, ADJACENT TO AND ABUTTING THEREON;

SITUATE IN THE COUNTY OF KING, STATE OF WASHINGTON.

GENERAL NOTES

- PRIMARY CONTROL POINTS AND ACCESSIBLE MONUMENT POSITIONS WERE FIELD MEASURED UTILIZING GLOBAL POSITIONING SYSTEM (GPS) SURVEY TECHNIQUES USING TRIMBLE R12 GNSS RECEIVER. MONUMENT POSITIONS THAT WERE NOT DIRECTLY OBSERVED USING GPS SURVEY TECHNIQUES WERE TIED INTO THE CONTROL POINTS UTILIZING TRIMBLE S7 ELECTRONIC TOTAL STATION FOR THE MEASUREMENT OF BOTH ANGLES AND DISTANCES. THIS SURVEY MEETS OR EXCEEDS THE STANDARDS SET BY WAC 332-130-090.
- THE INFORMATION DEPICTED ON THIS MAP REPRESENTS THE RESULTS OF A SURVEY MADE ON AUGUST 21 AND 28, 2024 AND CAN ONLY BE CONSIDERED AS INDICATING THE GENERAL CONDITION EXISTING AT THAT TIME.
- NO EASEMENTS, RESTRICTIONS OR RESERVATION OF RECORD WHICH WOULD BE DISCLOSED BY TITLE REPORT ARE SHOWN.
- CONTOUR LINES REPRESENTED HEREON WERE DERIVED FROM CONVENTIONAL GROUND SURVEY DATA AND CONFORM TO NATIONAL MAP ACCURACY STANDARDS. CONTOUR INTERVAL ONE FOOT
- UTILITIES OTHER THAN THOSE SHOWN MAY EXIST ON THE SITE. UNDERGROUND UTILITY LOCATIONS SHOWN HEREON ARE TAKEN FROM A COMPILATION OF PUBLIC RECORDS AND VISIBLE FIELD EVIDENCE. WE ASSUME NO LIABILITY FOR THE ACCURACY OF THE PUBLIC RECORDS. UNDERGROUND UTILITY LOCATIONS ARE ONLY APPROXIMATE. UNDERGROUND CONNECTIONS ARE SHOWN AS STRAIGHT LINES BETWEEN VISIBLE SURFACE LOCATIONS BUT MAY CONTAIN BENDS OR CURVES NOT SHOWN. FIELD VERIFICATION IS NECESSARY PRIOR TO OR DURING ANY CONSTRUCTION.

REFERENCES


- RECORD OF SURVEY BY McDUFFY, VOL. 41, PG 80 OF SURVEYS, REC. NO. 8408079002
- RECORD OF SURVEY BY PACIFIC NW SURVEYS, VOL. 55, PG 177 OF SURVEYS, REC. NO. 8705289001
- RECORD OF SURVEY BY GRONES, VOL. 264, PG 143 OF SURVEYS, REC. NO. 20090714900042
- RECORD OF SURVEY BY GEODIMENSIONS, VOL. 326, PG 211 OF SURVEYS, REC. NO. 20150624900014
- RECORD OF SURVEY BY TERRANE, VOL. 431, PG 214 OF SURVEYS, REC. NO. 20200910900027

BASIS OF BEARINGS

WASHINGTON COORDINATE SYSTEM, NORTH ZONE, NAD83-2011.
NORTH 88°10'35" WEST ALONG THE NORTH PROPERTY LINE
EXTENDED WEST, BETWEEN MONUMENTS FOUND IN PLACE.

VERTICAL DATUM

NAVD 88
ELEVATIONS DERIVED FROM GPS OBSERVATIONS BASED ON
THE WASHINGTON STATE REFERENCE NETWORK (WSRN)
BENCH MARKS
TBM 'A': REBAR & CAP, 5' OFFSET WEST OF NW PROPERTY
CORNER, ELEVATION = 37.24'
TBM 'B': REBAR & CAP ON NORTH PROPERTY LINE, AT EAST
SIDE CONC DRIVEWAY, ELEVATION = 31.79'

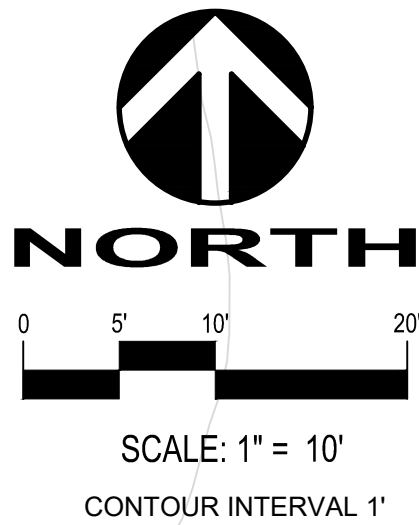

BOUNDARY AND TOPOGRAPHIC SURVEY

ROSENWALD PROPERTY
GREG & JENNIFER ROSENWALD
4836 E MERCER WAY, MERCER ISLAND, WA



REVISIONS: APPD.

DATE: SEPT. 3, 2024
DESIGN:
DRAWN:
CHECKED:
REVISION NUMBER:

SCALE: 1"=10'

PROJECT NUMBER:
OWDV03510001



DRAWING FILE:
SV-BS-OWDV0351.dwg

SHEET NO.

1
OF 2

Plot Date: 12/3/2025 2:01 PM
Save Date: 12/1/2025 1:00 PM
By: John Christensen
By: JPCN File: P:\O\OWDV03510001\0400\CAD\SV\BASE\SV\BS-OWDV0351.dwg

NE 1/4 OF THE NE 1/4, SEC. 19, TWP. 24 N., RNG. 5 E., W.M.

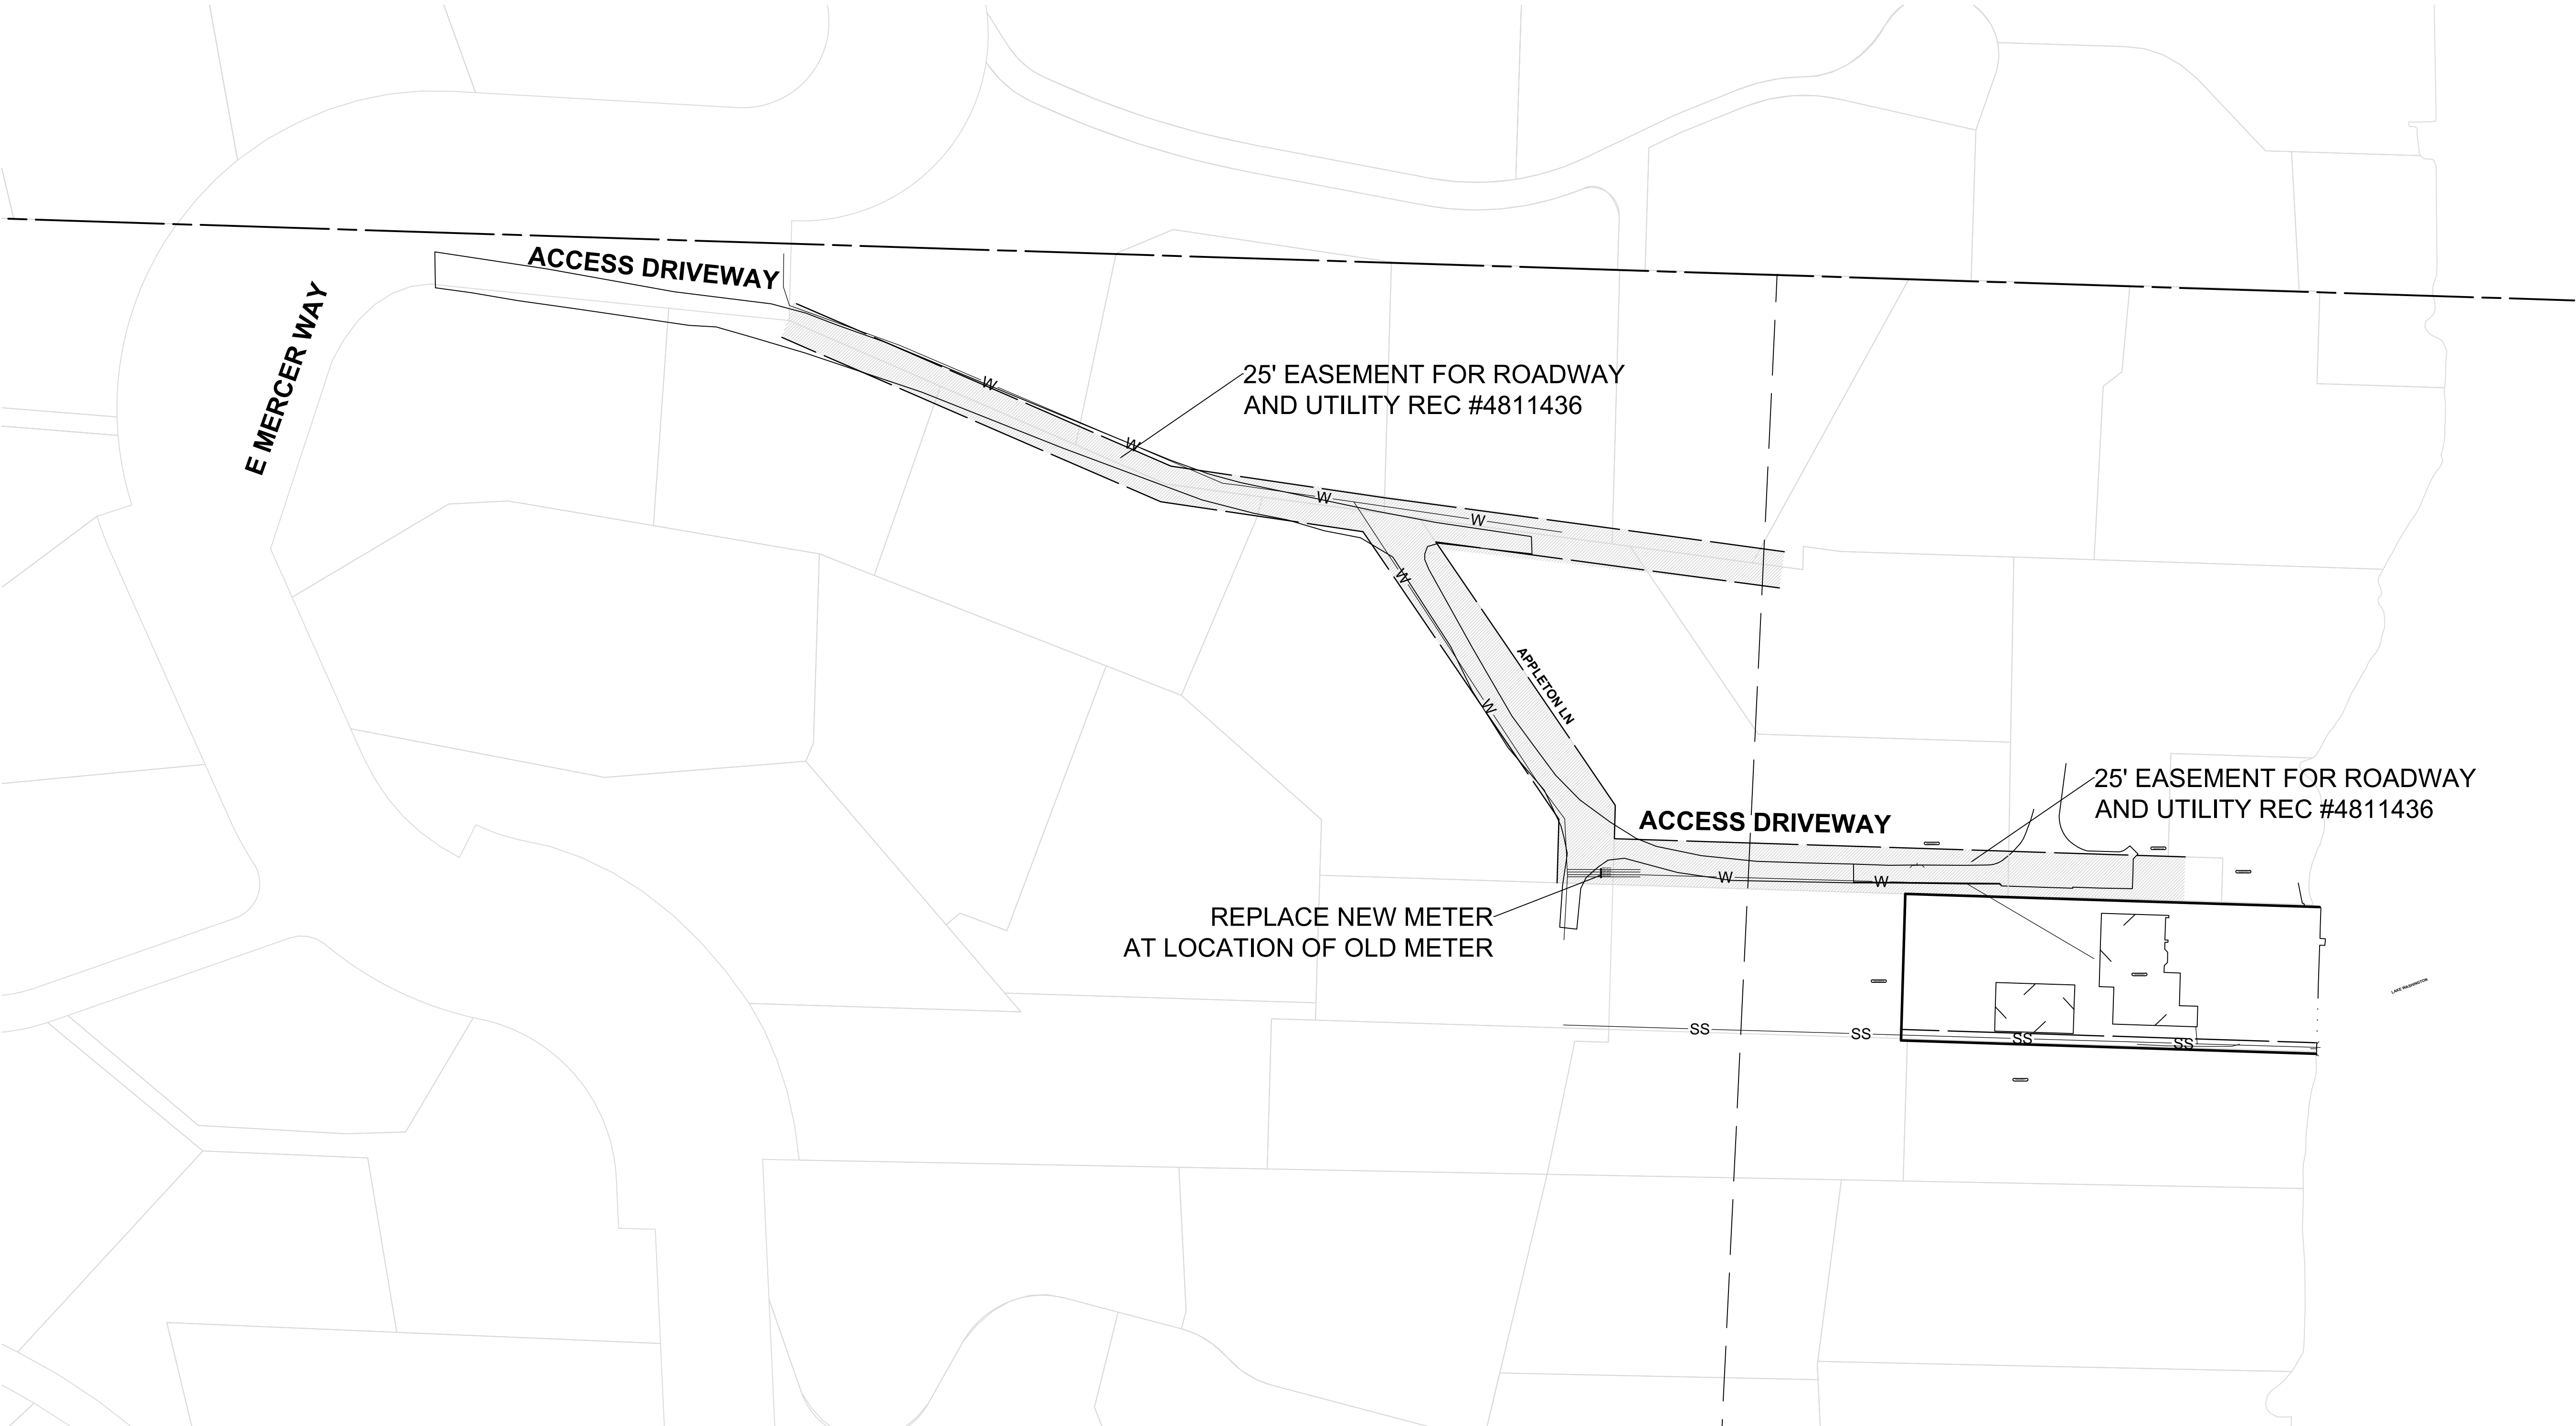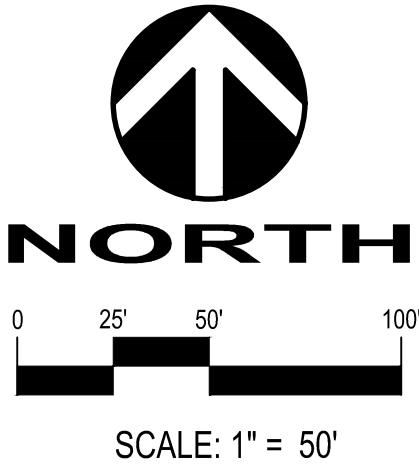

DAVID EVANS
AND ASSOCIATES INC.
20300 Woodinville Snohomish Rd. NE, Ste A
Woodinville Washington 98072
Phone: 425.415.2000



9/03/24
REVISIONS: APPD.

DATE: SEPT. 3, 2024
DESIGN:
DRAWN:
CHECKED:
REVISION
NUMBER:

SCALE: 1"=10'


PROJECT NUMBER:
OWDV03510001

DRAWING FILE:
SV-BS-OWDV0351.dwg

SHEET NO.

BOUNDARY AND TOPOGRAPHIC SURVEY

ROSENWALD PROPERTY
GREG & JENNIFER ROSENWALD
4836 E MERCER WAY, MERCER ISLAND, WA

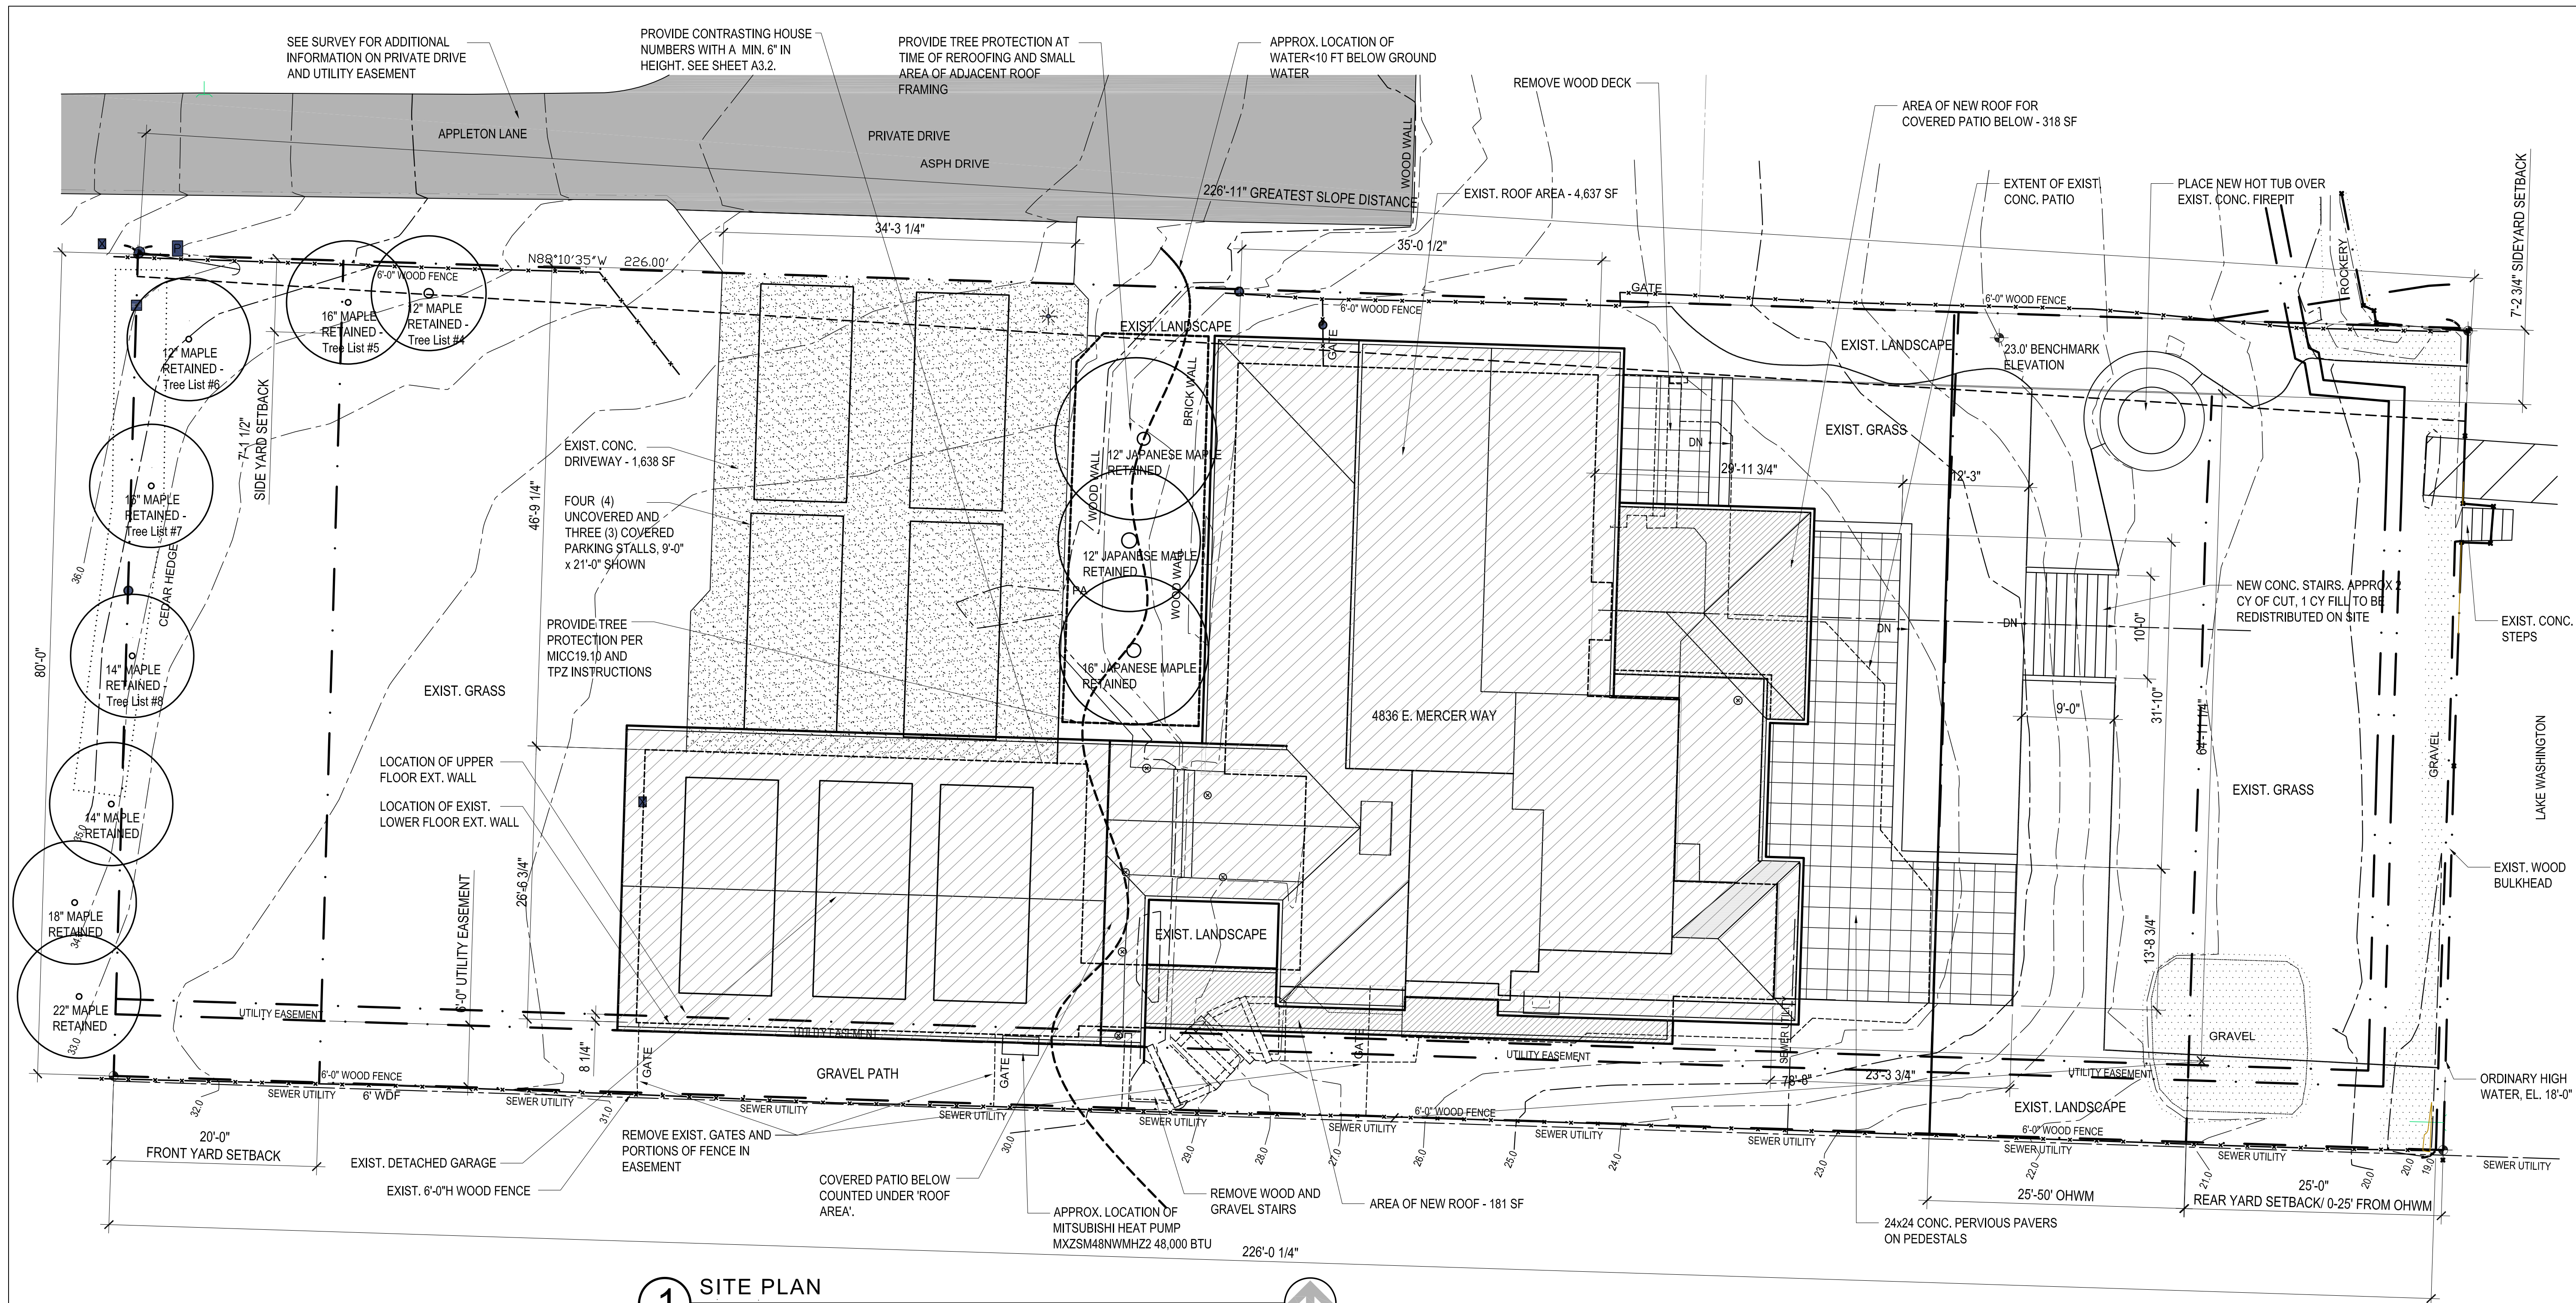

1 SITE PLAN
1/8" = 1'-0"

PROJECT ADDRESS: 4836 E MERCER WAY, MERCER ISLAND, WA 98040
PARCEL NUMBER: 1924059001
ZONING: R-15
MIN BUILDING SETBACKS: FRONTYARD: 20'-0" SIDEYARD: 15'-0" TOTAL REAR: 25'-0"
LOT SIZE: 18,403 SF
LEGAL DESCRIPTION: BEG AT N MNDR COR OF GL 1 TH S 00-11-00 W 335 FT TH N 89-41-00 W 15 FT TO TPOB TH S 00-11-00 W 80 FT TH S 89-41-00 E 220 FT ML TO ELY LN SD GL TH NELY TO PT S 89-41-00 E OF TPOB TH N 89-41-00 W TO TPOB TGW 2ND CL SH LDS ADJ
ENVIRONMENTAL CONDITIONS: R-15
ZONING: WIND SPEED EXPOSURE C WIND SPEED 1.0 POTENTIAL SLIDE/LANDSLIDE AREA SEISMIC/LIQUEFACTION

NOTE: ENTIRE SITE CONSIDERED LANDSLIDE PRONE

LEGEND:
MAIN STRUCTURE ROOF AREA:
NEW ROOF AREA:
EXIST. DRIVEWAY:
EXIST. GRAVEL PATH TO REMAIN


HIGHEST ELEVATION POINT ON LOT 36.0 FT
LOWEST ELEVATION POINT OF LOT 19.0 FT
ELEVATION DIFFERENCE 17.0 FT
HORIZONTAL DISTANCE BETWEEN HIGH AND LOW POINTS 226.92 FT
LOT SLOPE 8%

LOT SLOPE CALCULATIONS

AVERAGE BUILDING ELEVATION CALCULATION
SEE SHEET A1.5


A. Gross Lot Area: 18,403 SF
B. Net Lot Area: 18,403 SF
C. Allowed Lot Coverage Area: 7,361 SF
D. Allowed Lot Coverage % of Lot 40%
E. Existing Lot Coverage:
1. Main Structure Roof Area: 4,623 SF
2. Accessory Building Roof Area: 0
3. Vehicular Use: (driveway, paved access easements [portion used by the lot for access], parking): 1,638 SF
4. Covered Patios and Covered Decks: UNDER E1
5. Total Existing Lot Coverage Area (E1+E2+E3+E4): 6,261 SF
F. (Total Lot Coverage Area Removed- See Sheet A3.3): (61) SF
G. Proposed Adjustment for Single Story (Area): N/A
H. Proposed Adjustment for Flag Lot: N/A
I. Total New Lot Coverage Area:
1. Main Structure Roof Area: 499 SF
2. Accessory Structure Roof Area: N/A
3. Vehicular Use (driveway, paved access easement [portion used by the lot for access], parking): N/A
4. Covered Patios and Covered Decks: UNDER I1
5. Total New Lot Coverage Area (I1 + I2 + I3 + I4): 499 SF
J. Total Project Lot Coverage Area = (E5 - F) + I5: 6,699
K. Proposed Lot Coverage Area = (J/B) x 100 % of Lot: 36.4%

NOTE:
EXISTING STRUCTURE IS NON-CONFORMING REGARDING SIDEYARD SETBACKS PER PREVIOUS BUILDING PERMIT. PROPOSED DESIGN CONFORMS TO MICC 19.01.050(D)(1)(b). NO EXISTING NON-CONFORMING EXTERIOR STRUCTURAL WALLS TO BE REMOVED.

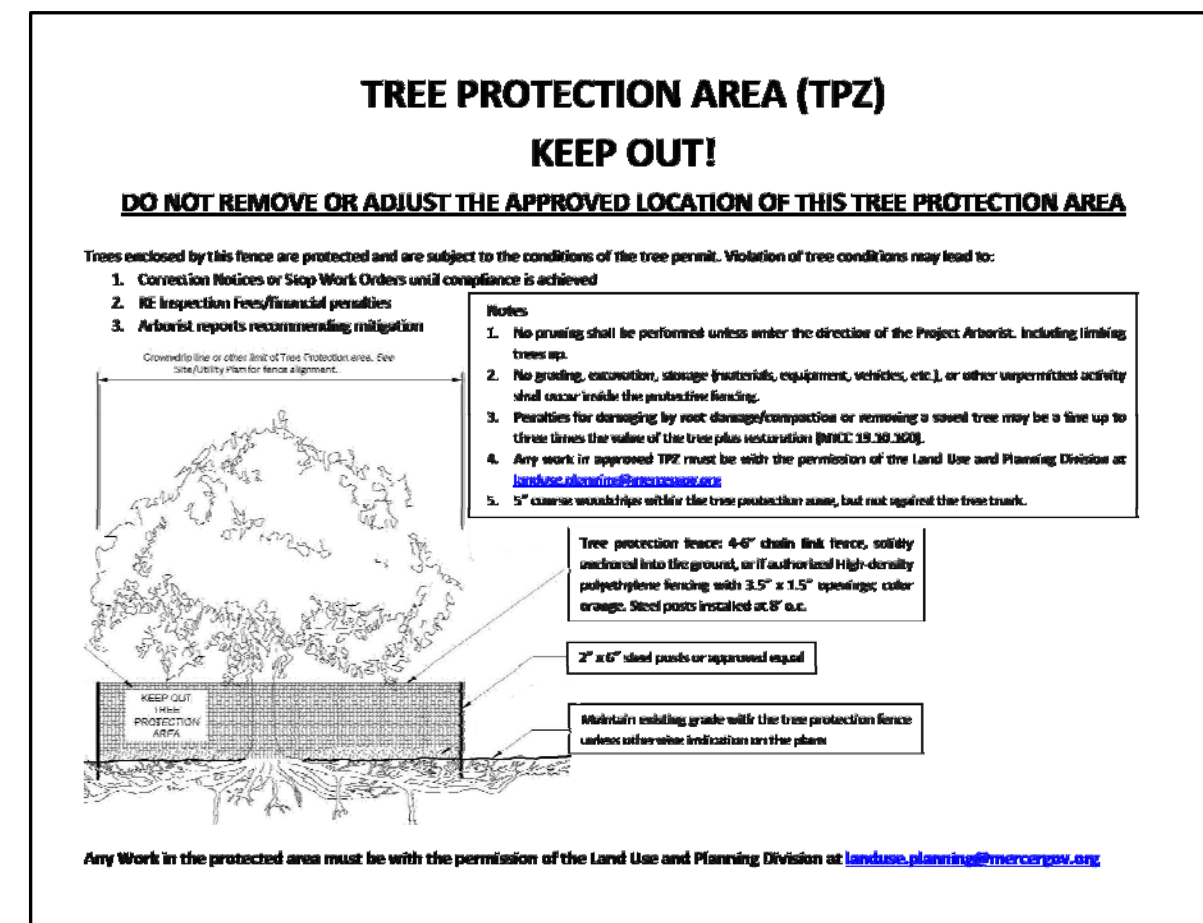



PROJECT INFORMATION

LOT COVERAGE CALCULATIONS

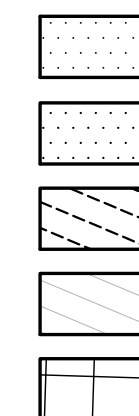

HARDSCAPE CALCULATIONS

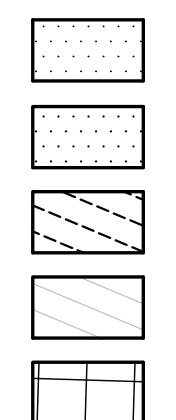

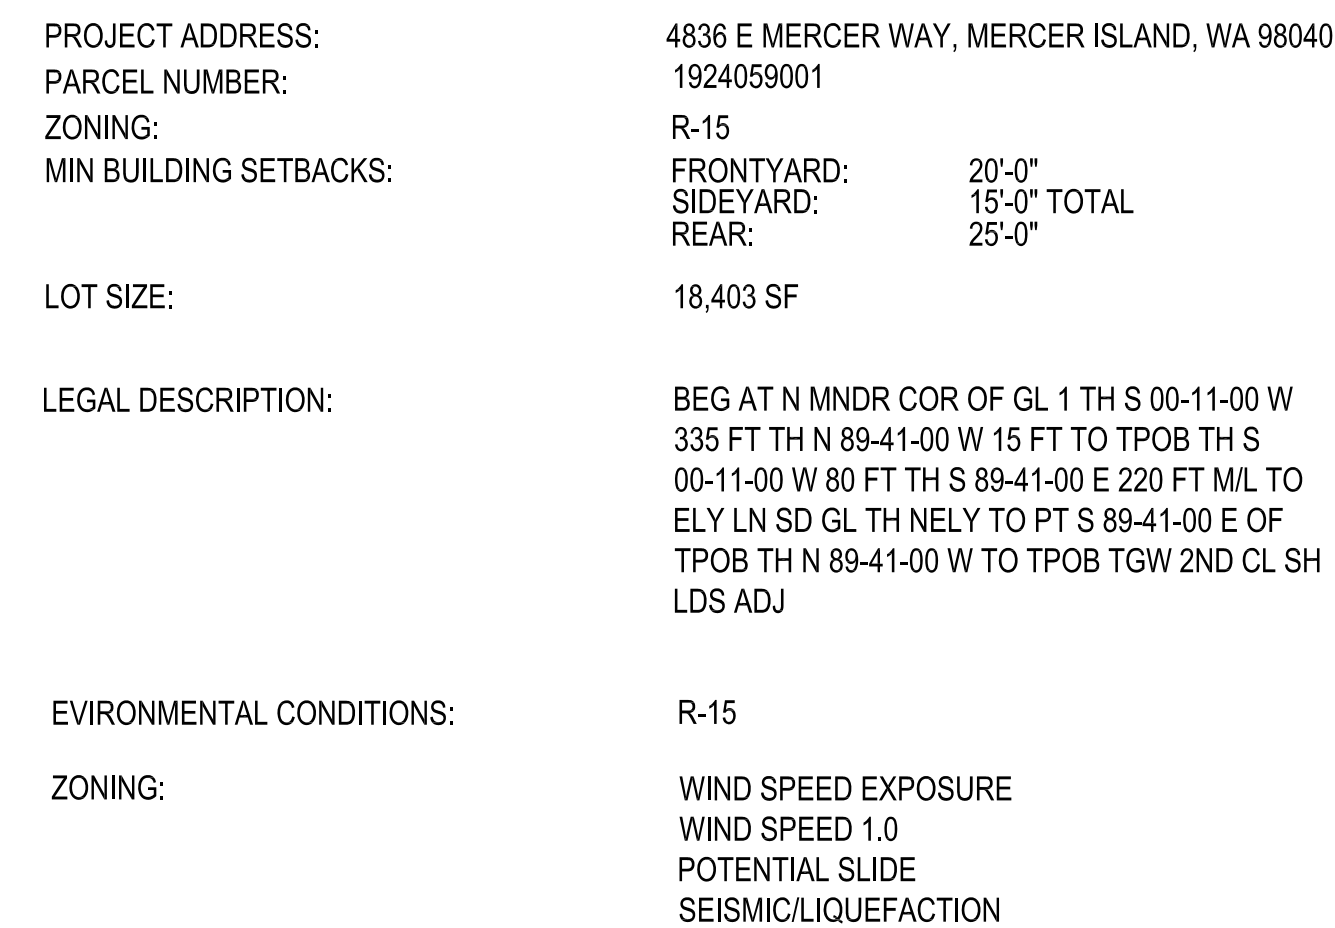

* DENOTES EXCEPTION TREE

ALLOWED HARDSCAPE 0-25' FROM OHWM:	ALLOWED HARDSCAPE 25-50' FROM OHWM:
AREA: 1,994 SF	AREA: 1,944 SF
ALLOWED: 10%	ALLOWED: 30%
PROPOSED: 93 SF = 5%	PROPOSED: 320 SF = 6.2%

NEW CONC. PAVER ON PEDESTALS

Jurisdiction Approval Stamp

Project: **Rosenwald
Residence**
4836 E Mercer Way
Mercer Island, WA 98040
Project No. 24,245
Date: July 25, 2025
BUILDING PERMIT

SHORELINE LANDSCAPE PLAN A1.3



<u>Replaced and New Impervious Surface area</u>	
1. Replaced Impervious Surface Area:	2,178 sf
2. New Impervious Surface Area:	658 sf
3. Roof Over Garage does not counted (ext. walls remain)	(1,425 sf)

Removed Impervious surface area:
1. Removed Impervious Surface Area: 401 sf


Total New/Replaced Impervious Area:	1,411 sf
Total Removed Impervious Area:	(401 sf)
Difference:	1,010 sf

REMOVED IMPERVIOUS SURFACE AREA

REPLACE IMPERVIOUS AREA

NEW IMPERVIOUS SURFACE AREA

REPLACED ROOF OVER EXISTING EXTERIOR WALLS
(NOT COUNTED)

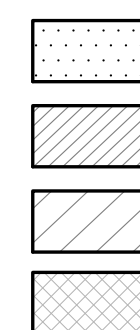

FOUNDATION
PLAN
A2.0



EXISTING MAIN FLOOR PLAN


A2.1

GENERAL NOTES:

- DO NOT SCALE DRAWINGS.
- IT IS THE INTENT OF THE CONTRACT DOCUMENTS THAT ALL WORK COMPLY WITH THE 2021 INTERNATIONAL RESIDENTIAL CODE, THE 2021 WASHINGTON STATE ENERGY CODE, THE 2021 NATIONAL ELECTRICAL CODE, THE 2021 WASHINGTON STATE PLUMBING CODE AND RULES AND REGULATIONS OF THE JURISDICTIONS HAVING AUTHORITY.
- PRIOR TO COMMENCEMENT OF ANY PORTION OF THE WORK, THE CONTRACTOR SHALL NOTIFY THE ARCHITECT OF ANY DISCREPANCIES NOTED AMONG OR BETWEEN THE CONTRACT DOCUMENTS, OWNER-PROVIDED INFORMATION, SITE CONDITIONS, MANUFACTURER RECOMMENDATIONS, OR CODE REGULATIONS OR RULES OF JURISDICTIONS HAVING AUTHORITY.
- PRIOR TO COMMENCEMENT, OF ANY PORTION OF THE WORK, THE CONTRACTOR SHALL BECOME FAMILIAR WITH THE CONTRACT DOCUMENTS, OWNER PROVIDED INFORMATION, AND SITE CONDITIONS INCLUDING TAKING FIELD MEASUREMENTS AS NECESSARY.
- THE CONTRACTOR SHALL PAY AND SECURE ALL GOVERNMENTAL PERMITS, FEES, LICENSES AND INSPECTIONS NECESSARY FOR PROPER EXECUTION AND COMPLETION OF THE WORK WITH THE EXCEPTION OF THE GENERAL BUILDING PERMIT.
- ALL DIMENSIONS ARE TO FACE OF FINISH, UNLESS OTHERWISE NOTED. CONTACT THE ARCHITECT FOR CLARIFICATIONS IF NEEDED.
- DESIGN-BUILD SERVICES SUCH AS ELECTRICAL, PLUMBING AND MECHANICAL SHALL BE CONDUCTED UNDER SEPARATE PERMITS FILED AND SECURED BY THE G.C. OR DESIGN-BUILD SUB-CONTRACTOR.


STAIR AND HANDRAIL NOTES:

- STAIRWAYS SHALL NOT BE LESS THAN 36" IN CLEAR WIDTH AT ALL POINTS ABOVE THE PERMITTED HANDRAIL HEIGHT AND BELOW THE THE REQUIRED HEADROOM HEIGHT.
- MINIMUM HEIGHT IN ALL PARTS OF THE STAIRWAY SHALL NOT BE LESS THEN 6'-8" MEASURED VERTICALLY FROM NOSING OR LANDING TO SLOPED PLANE OR CEILING ABOVE.
- STAIRS RISERS SHALL NOT BE MORE THAN 7 3/4" IN HEIGHT WITH A MAXIMUM OF 3/8" DIFFERENCE BETWEEN THE TALLEST AND THE SHORTEST RISER.
- THE MINIMUM TREAD DEPTH SHALL BE 10". THE GREATEST TREAD DEPTH SHALL NOT EXCEED THE SMALLEST DEPTH BY MORE THAN 3/8".
- HANDRAIL SHALL BE TYPE I OR TYPE II AND BE AT 36" ABOVE EDGE OF TREAD NOSING PER SBC/IBC R311.5.6.3.
- HANDRAIL GRIP SHALL HAVE A CIRCULAR DIAMETER OF 1 1/2" PER HANDRAIL TYPE I AND HAVE A MINIMUM OF 1 1/2" CLEARANCE FROM WALL.
- STAIR TREAD NOSING PROJECTION SHALL NOT BE LESS THAN 3/4" AND NOT MORE THAN 1 1/4".
- HANDRAIL SHOULD BE CONTINUOUS OR TERMINATE AT NEWEL POST OR SAFETY TERMINAL.

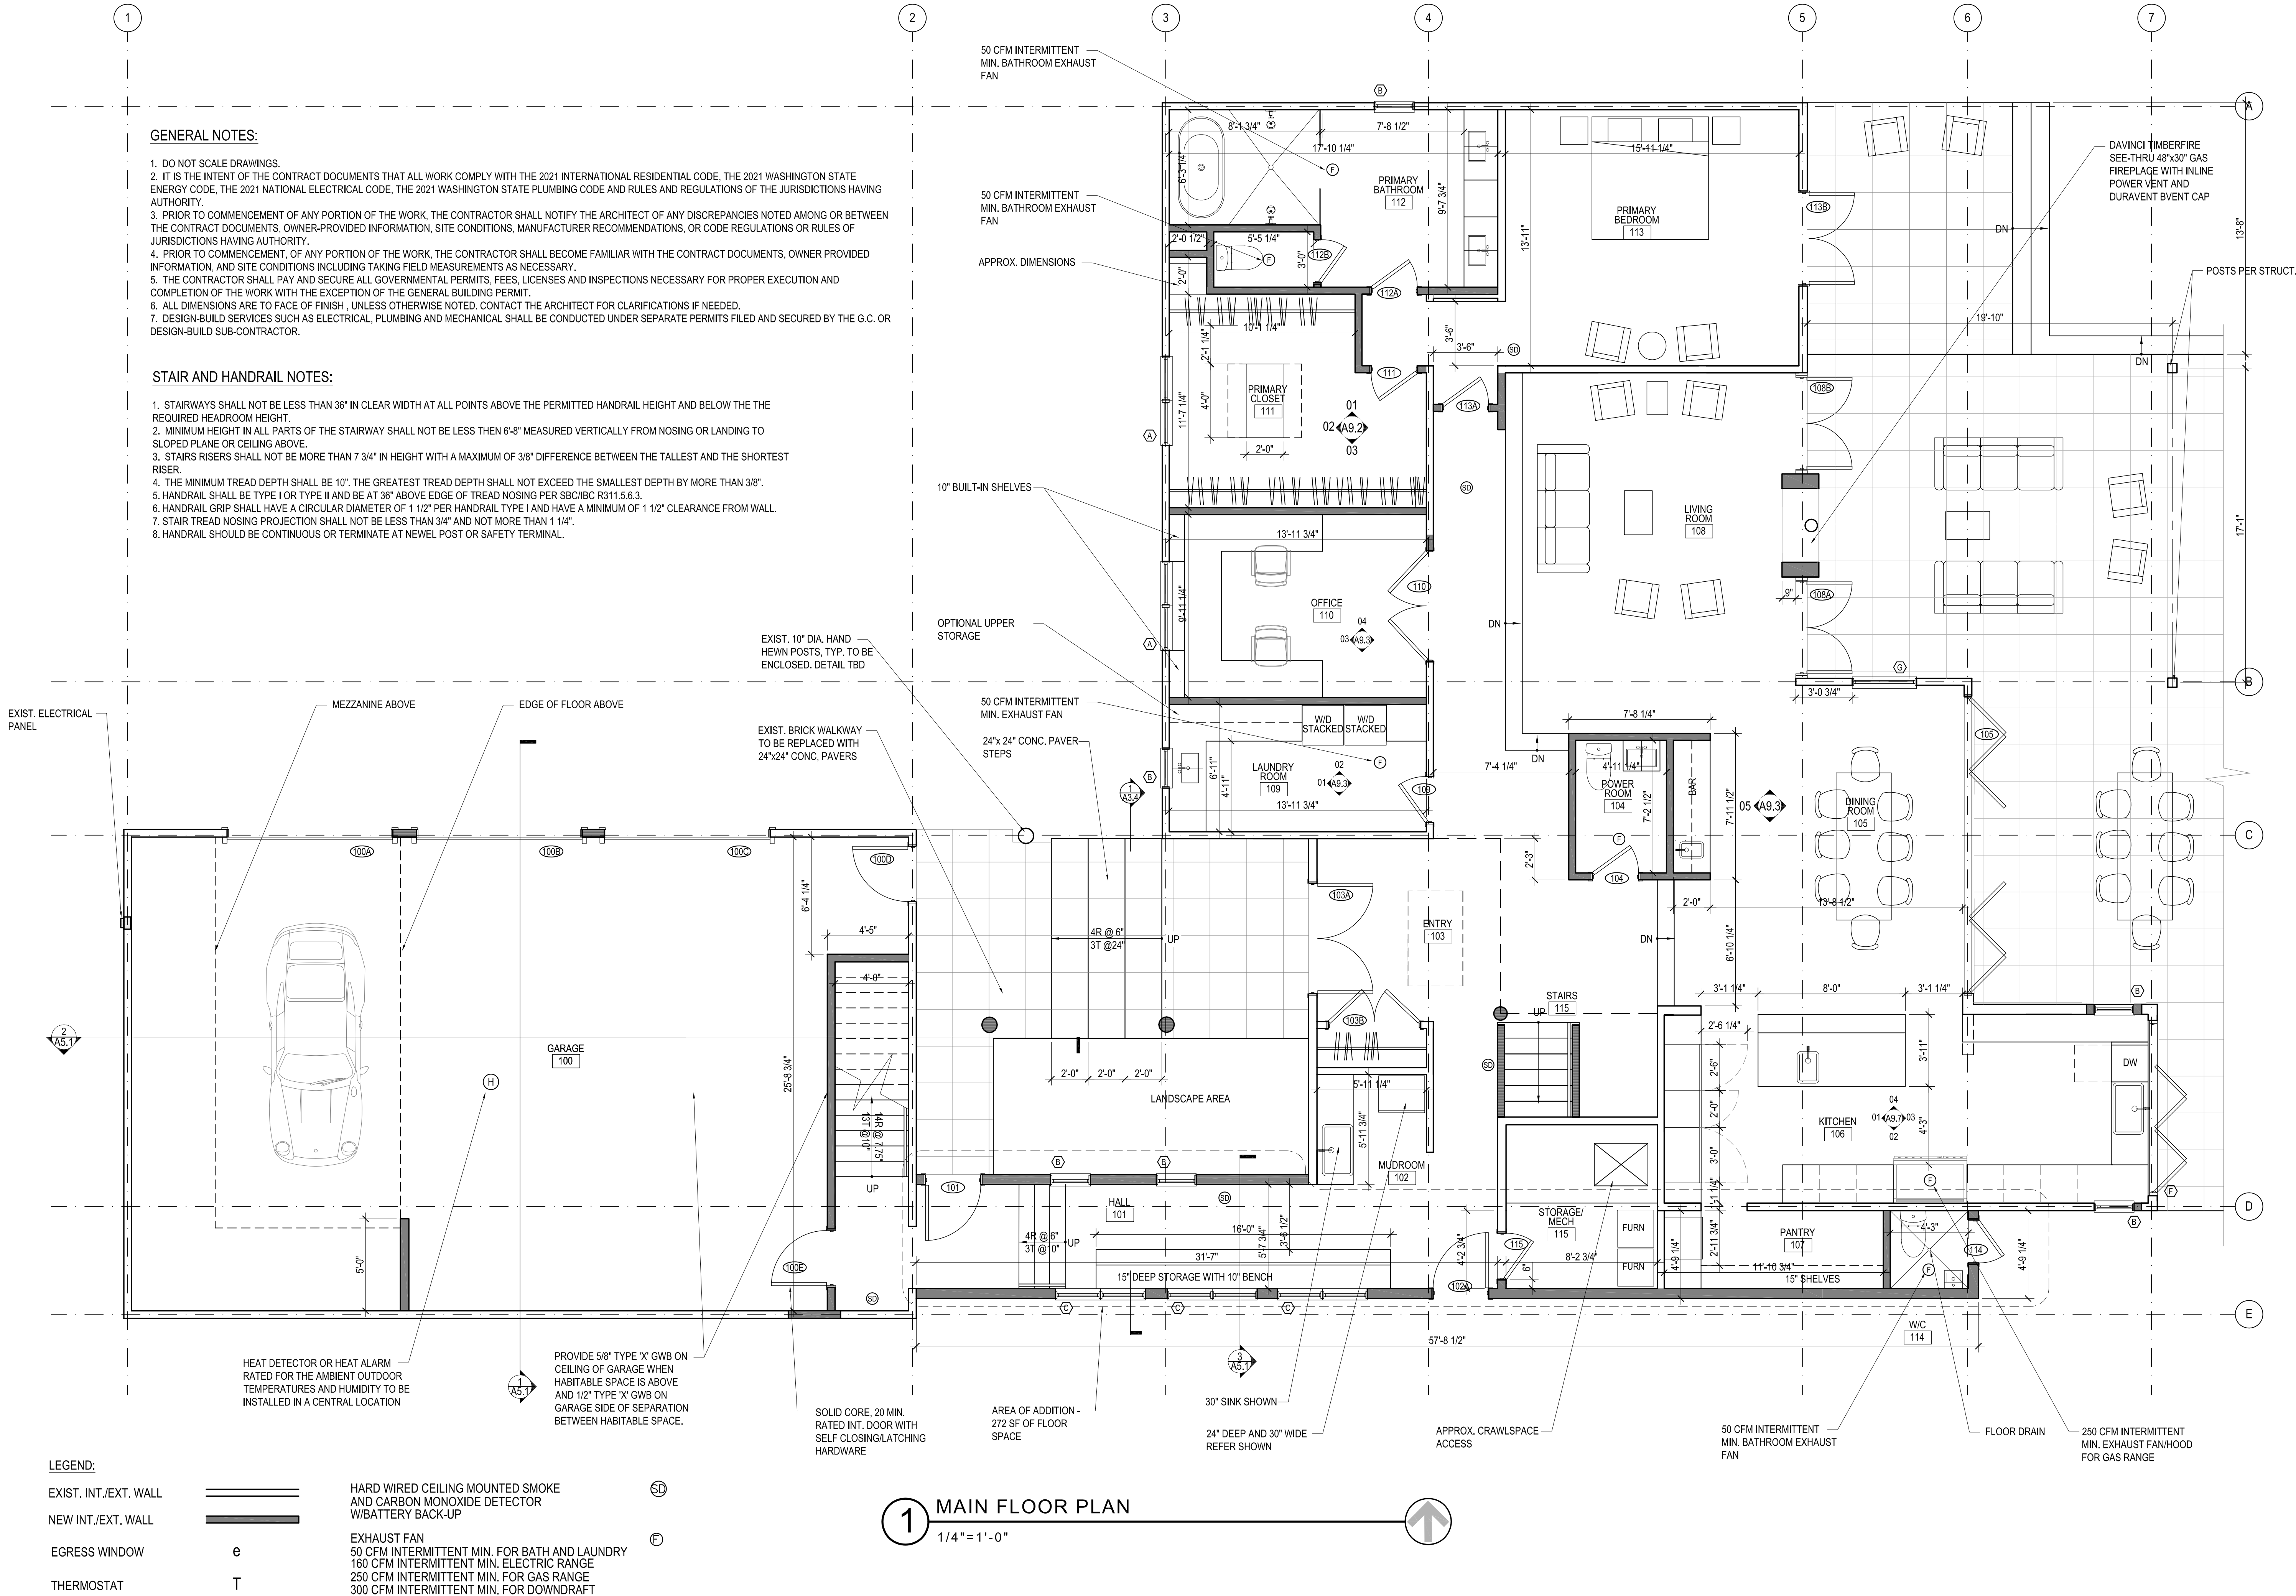

1 MAIN FLOOR PLAN

1/4" = 1'-0"

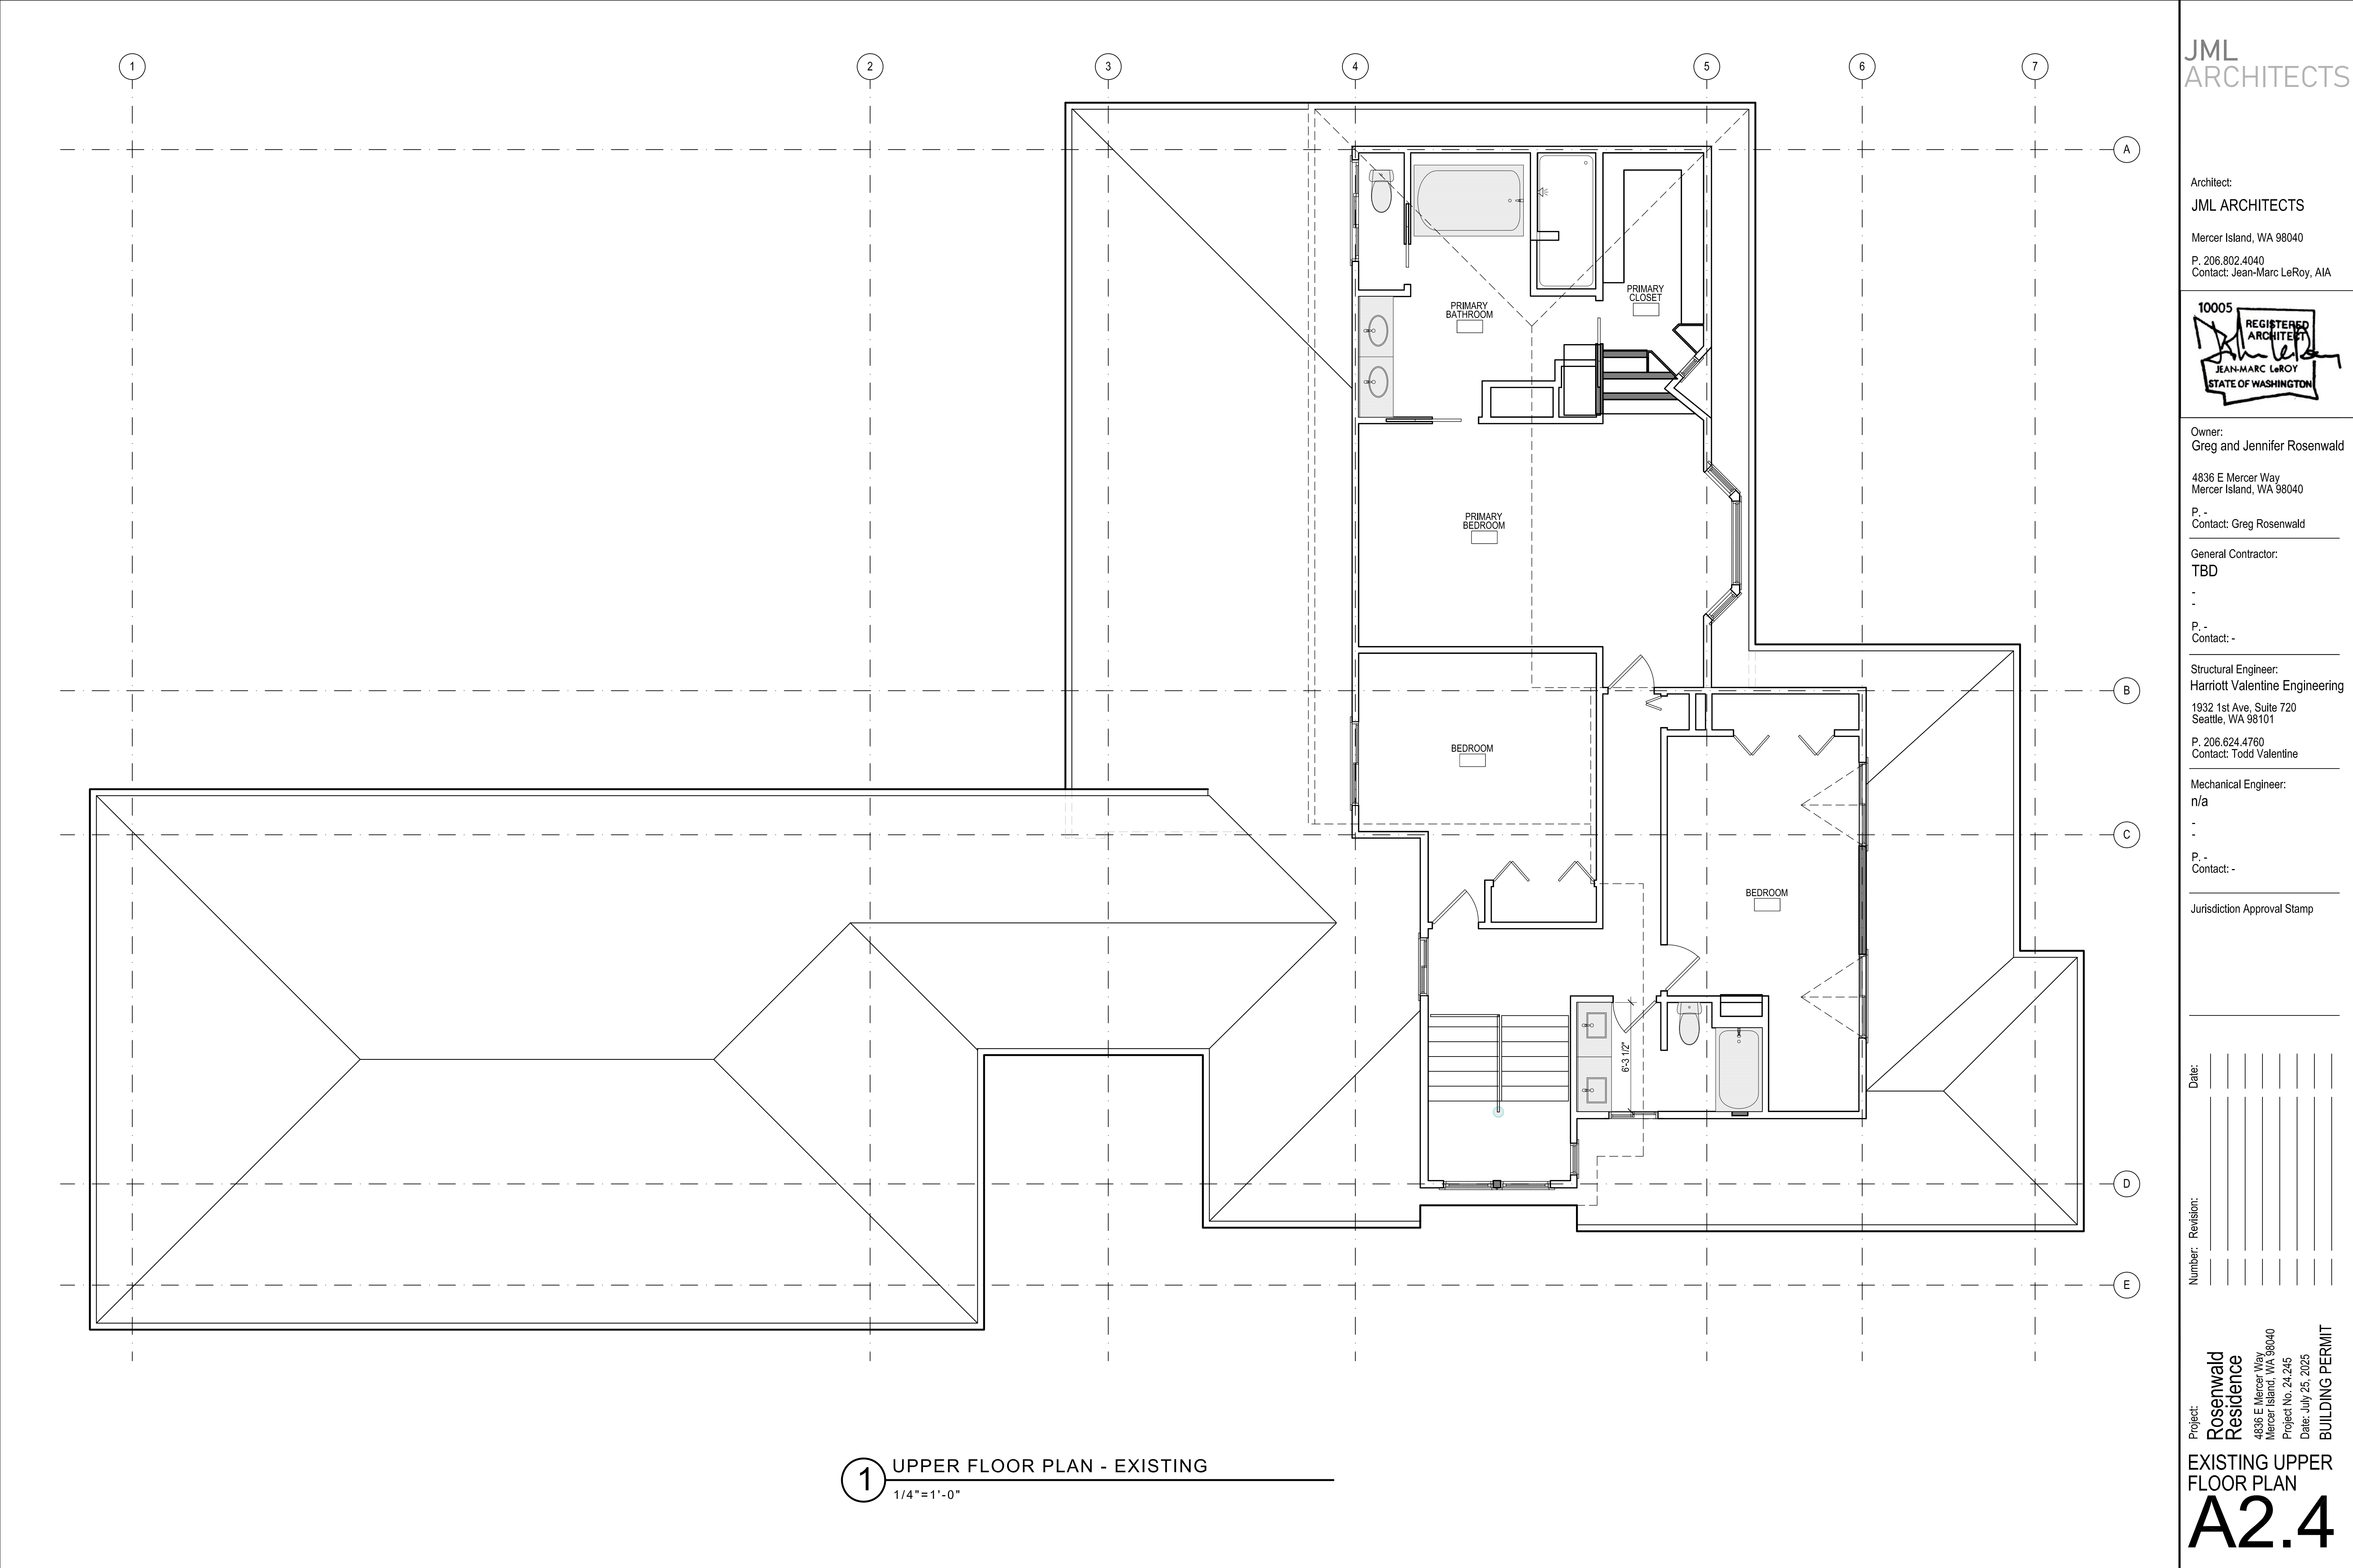

JML
ARCHITECTS

Architect:
JML ARCHITECTS

Mercer Island, WA 98040
P. 206.802.4040
Contact: Jean-Marc LeRoy, AIA



Owner:
Greg and Jennifer Rosenwald

4836 E Mercer Way
Mercer Island, WA 98040
P. -
Contact: Greg Rosenwald

General Contractor:
TBD
-
P. -
Contact: -

Structural Engineer:
Harriott Valentine Engineering
1932 1st Ave, Suite 720
Seattle, WA 98101
P. 206.624.4760
Contact: Todd Valentine

Mechanical Engineer:
n/a
-
P. -
Contact: -

Jurisdiction Approval Stamp

Date:										
	1	2	3	4	5	6	7	8	9	10
Number:										
	1	2	3	4	5	6	7	8	9	10

Project:
**Rosenwald
Residence**
4836 E Mercer Way
Mercer Island, WA 98040
Project No. 24.245
Date: July 25, 2025
BUILDING PERMIT

EXISTING UPPER
FLOOR PLAN
A2.4

1 UPPER FLOOR PLAN - EXISTING
1/4"=1'-0"

Architect:

JML ARCHITECTS

Mercer Island, WA 98040

P. 206.802.4040

Contact: Jean-Marc LeRoy, AIA

10005



Owner:

Greg and Jennifer Rosenwald

4836 E Mercer Way

Mercer Island, WA 98040

P. -

Contact: Greg Rosenwald

General Contractor:

TBD

-

P. -

Contact: -

Structural Engineer:

Harriott Valentine Engineering

1932 1st Ave, Suite 720

Seattle, WA 98101

P. 206.624.4760

Contact: Todd Valentine

Mechanical Engineer:

n/a

-

P. -

Contact: -

Jurisdiction Approval Stamp

Date:

Number: Revision:

Project: Rosenwald Residence

4836 E Mercer Way

Mercer Island, WA 98040

Project No. 24.245

Date: July 25, 2025

BUILDING PERMIT

UPPER FLOOR PLAN

A2.5

GENERAL NOTES:

- DO NOT SCALE DRAWINGS.
- IT IS THE INTENT OF THE CONTRACT DOCUMENTS THAT ALL WORK COMPLY WITH THE 2021 INTERNATIONAL RESIDENTIAL CODE, THE 2021 WASHINGTON STATE ENERGY CODE, THE 2021 NATIONAL ELECTRICAL CODE, THE 2021 WASHINGTON STATE PLUMBING CODE AND RULES AND REGULATIONS OF THE JURISDICTIONS HAVING AUTHORITY.
- PRIOR TO COMMENCEMENT OF ANY PORTION OF THE WORK, THE CONTRACTOR SHALL NOTIFY THE ARCHITECT OF ANY DISCREPANCIES NOTED AMONG OR BETWEEN THE CONTRACT DOCUMENTS, OWNER-PROVIDED INFORMATION, SITE CONDITIONS, MANUFACTURER RECOMMENDATIONS, OR CODE REGULATIONS OR RULES OF JURISDICTIONS HAVING AUTHORITY.
- PRIOR TO COMMENCEMENT, OF ANY PORTION OF THE WORK, THE CONTRACTOR SHALL BECOME FAMILIAR WITH THE CONTRACT DOCUMENTS, OWNER PROVIDED INFORMATION, AND SITE CONDITIONS INCLUDING TAKING FIELD MEASUREMENTS AS NECESSARY.
- THE CONTRACTOR SHALL PAY AND SECURE ALL GOVERNMENTAL PERMITS, FEES, LICENSES AND INSPECTIONS NECESSARY FOR PROPER EXECUTION AND COMPLETION OF THE WORK WITH THE EXCEPTION OF THE GENERAL BUILDING PERMIT.
- ALL DIMENSIONS ARE TO FACE OF FINISH, UNLESS OTHERWISE NOTED. CONTACT THE ARCHITECT FOR CLARIFICATIONS IF NEEDED.
- DESIGN-BUILD SERVICES SUCH AS ELECTRICAL, PLUMBING AND MECHANICAL SHALL BE CONDUCTED UNDER SEPARATE PERMITS FILED AND SECURED BY THE G.C. OR DESIGN-BUILD SUB-CONTRACTOR.

STAIR AND HANDRAIL NOTES:

- STAIRWAYS SHALL NOT BE LESS THAN 36" IN CLEAR WIDTH AT ALL POINTS ABOVE THE PERMITTED HANDRAIL HEIGHT AND BELOW THE THE REQUIRED HEADROOM HEIGHT.
- MINIMUM HEIGHT IN ALL PARTS OF THE STAIRWAY SHALL NOT BE LESS THEN 6'-8" MEASURED VERTICALLY FROM NOSING OR LANDING TO SLOPED PLANE OR CEILING ABOVE.
- STAIRS RISERS SHALL NOT BE MORE THAN 7 3/4" IN HEIGHT WITH A MAXIMUM OF 3/8" DIFFERENCE BETWEEN THE TALLEST AND THE SHORTEST RISER.
- THE MINIMUM TREAD DEPTH SHALL BE 10". THE GREATEST TREAD DEPTH SHALL NOT EXCEED THE SMALLEST DEPTH BY MORE THAN 3/8".
- HANDRAIL SHALL BE TYPE I OR TYPE II AND BE AT 36" ABOVE EDGE OF TREAD NOSING PER SBC/IBC R311.5.6.3.
- HANDRAIL GRIP SHALL HAVE A CIRCULAR DIAMETER OF 1 1/2" PER HANDRAIL TYPE I AND HAVE A MINIMUM OF 1 1/2" CLEARANCE FROM WALL.
- STAIR TREAD NOSING PROJECTION SHALL NOT BE LESS THAN 3/4" AND NOT MORE THAN 1 1/4".
- HANDRAIL SHOULD BE CONTINUOUS OR TERMINATE AT NEWEL POST OR SAFETY TERMINAL.

PROVIDE 5/8" TYPE 'X' GWB ON CEILING OF GARAGE WHEN HABITABLE SPACE IS ABOVE AND 1/2" TYPE 'X' GWB ON GARAGE SIDE OF SEPARATION BETWEEN HABITABLE SPACE.

GARAGE AREA WITH CEILING HEIGHT GREATER THAN 16'. 212 SF

36" HIGH WALL

OPEN TO BELOW

FAMILY ROOM
212

STORAGE
213

WALL BELOW

SOLID CORE, 20 MIN. RATED DOOR WITH SELF LATCHING/ CLOSING HARDWARE

AREA OF SECOND FLOOR ADDITION - 1,086 SF

50 CFM INTERMITTENT MIN. BATHROOM EXHAUST FAN

48" VANITY

REPLACE EXIST. SKYLIGHT

50 CFM INTERMITTENT MIN. BATHROOM EXHAUST FAN


REPLACE EXIST. HANDRAIL WITH NEW PER HANDRAIL NOTES

50 CFM INTERMITTENT MIN. BATHROOM EXHAUST FAN

36" HIGH WALL

LEGEND:

EXIST. INT./EXT. WALL



NEW INT./EXT. WALL



EGRESS WINDOW

e

THERMOSTAT

T

HARD WIRED CEILING MOUNTED SMOKE AND CARBON MONOXIDE DETECTOR W/BATTERY BACK-UP

SD

EXHAUST FAN
50CFM MIN. FOR BATH AND LAUNDRY
100CFM MIN. FOR KITCHEN


F

1 UPPER FLOOR PLAN

1/4" = 1'-0"



1 EAST ELEVATION
1/4"=1'-0"

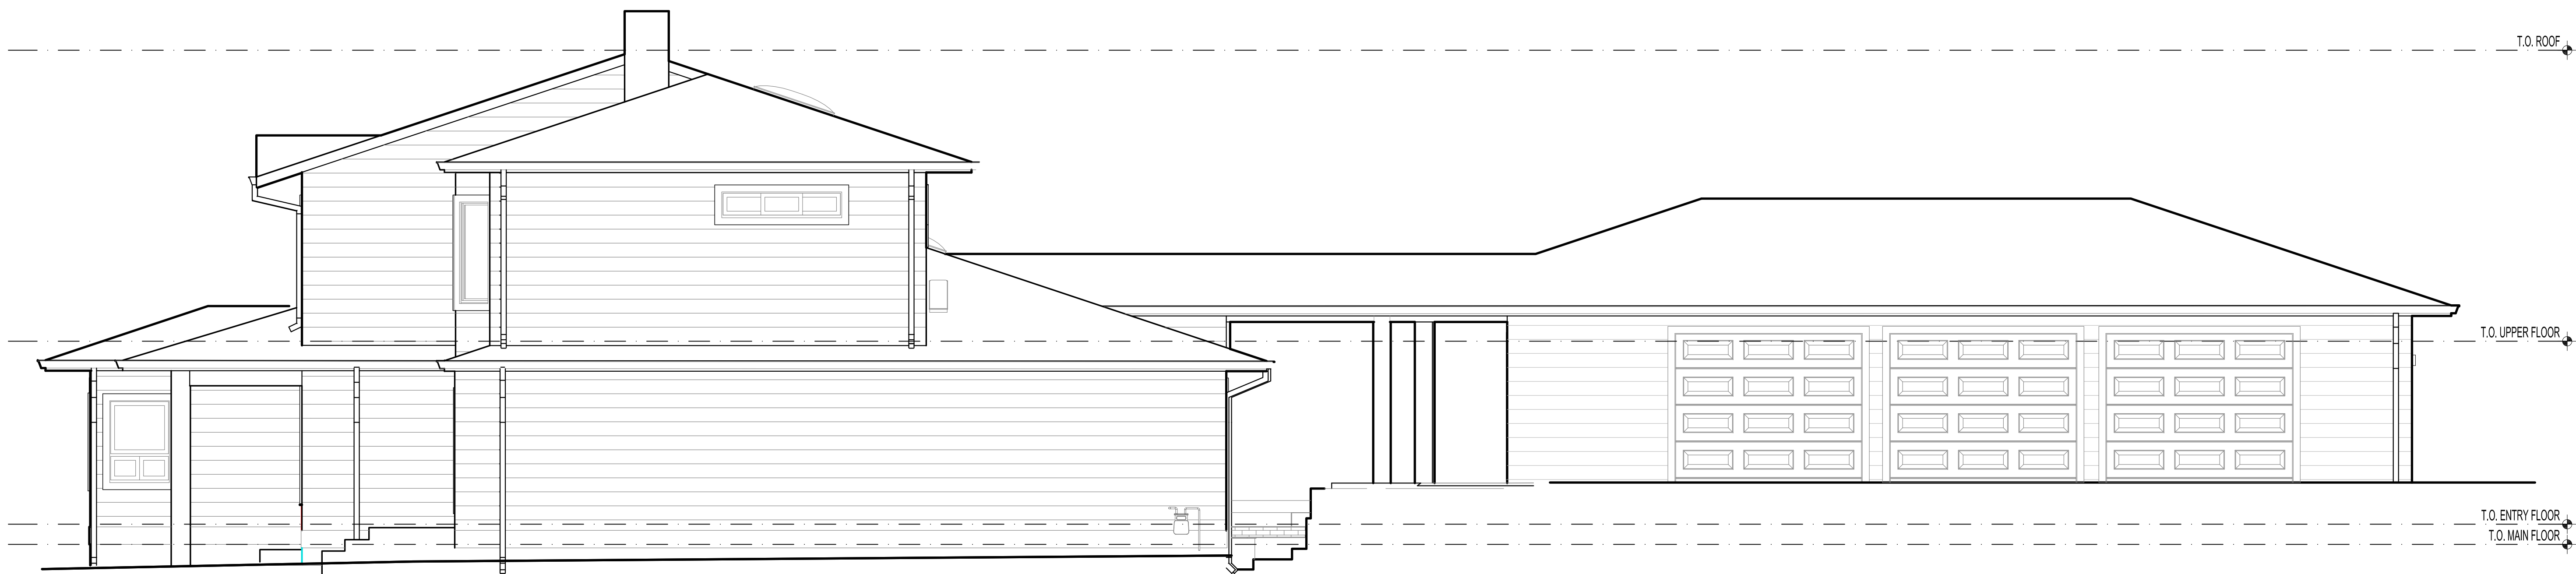

2 NORTH ELEVATION
1/4"=1'-0"

JML
ARCHITECTS

Architect:

JML ARCHITECTS

Mercer Island, WA 98040

P. 206.802.4040

Contact: Jean-Marc LeRoy, AIA

10005



Owner:

Greg and Jennifer Rosenwald

4836 E Mercer Way
Mercer Island, WA 98040

P. -

Contact: Greg Rosenwald

General Contractor:

TBD

-

P. -

Contact: -

Structural Engineer:

Harriott Valentine Engineering

1932 1st Ave, Suite 720
Seattle, WA 98101

P. 206.624.4760

Contact: Todd Valentine

Mechanical Engineer:

n/a

-

P. -

Contact: -

Jurisdiction Approval Stamp

Date:

Number: Revision:

Project: Rosenwald Residence

4836 E Mercer Way
Mercer Island, WA 98040


Project No. 24.245

Date: July 25, 2025


BUILDING PERMIT

EXISTING EXT.
ELEVATIONS

A3.0

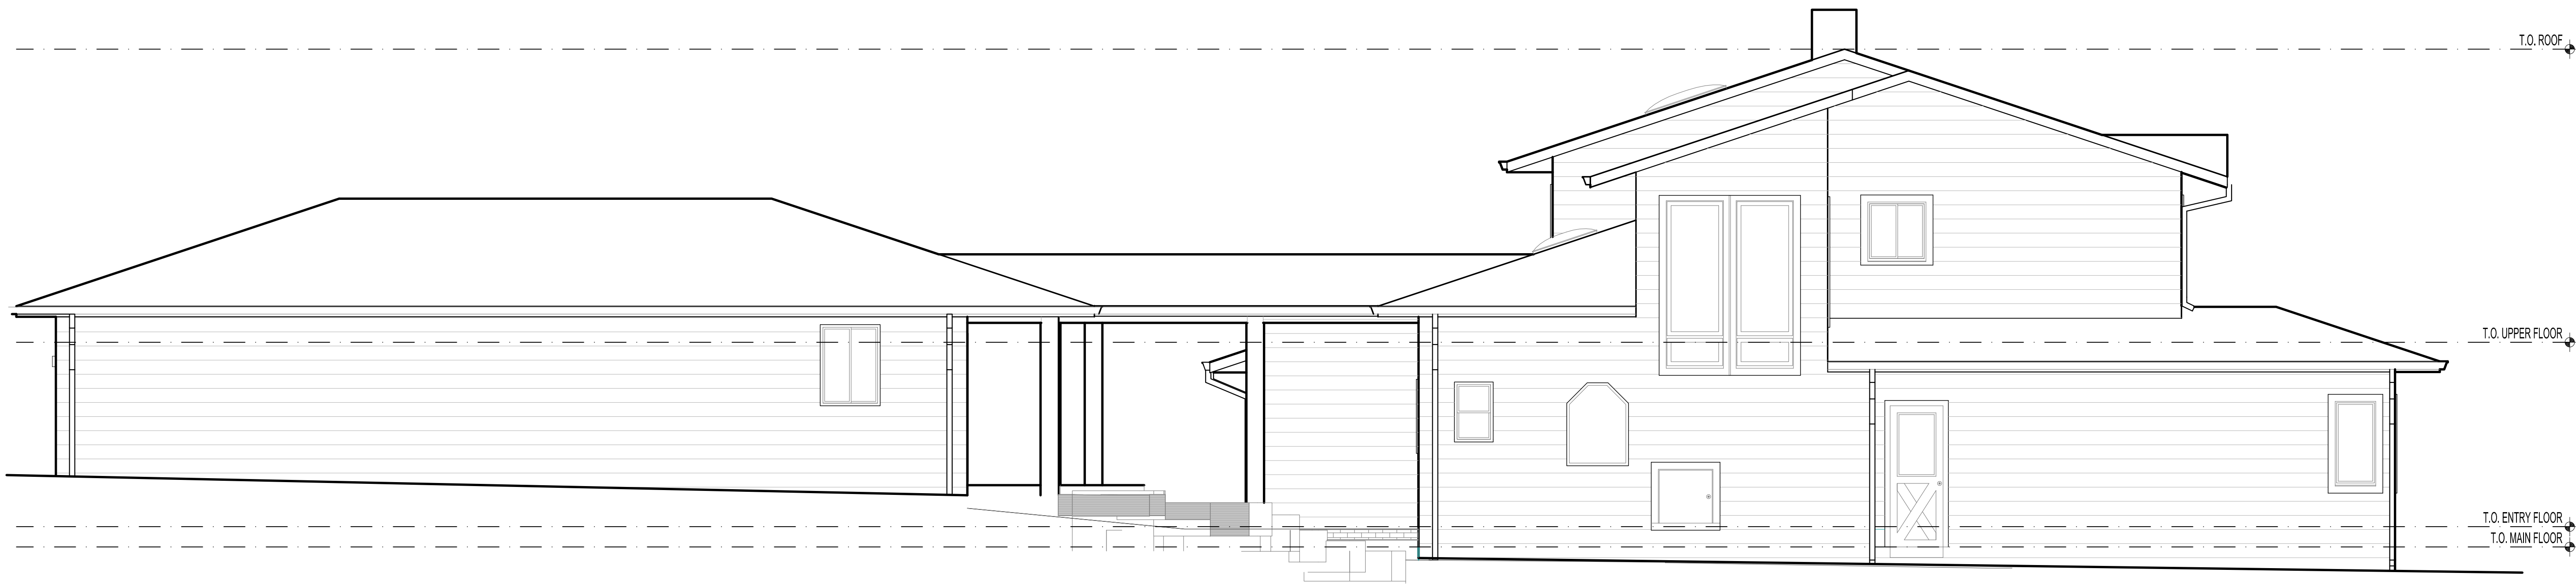

1 SOUTH ELEVATION
1/4" = 1'-0"

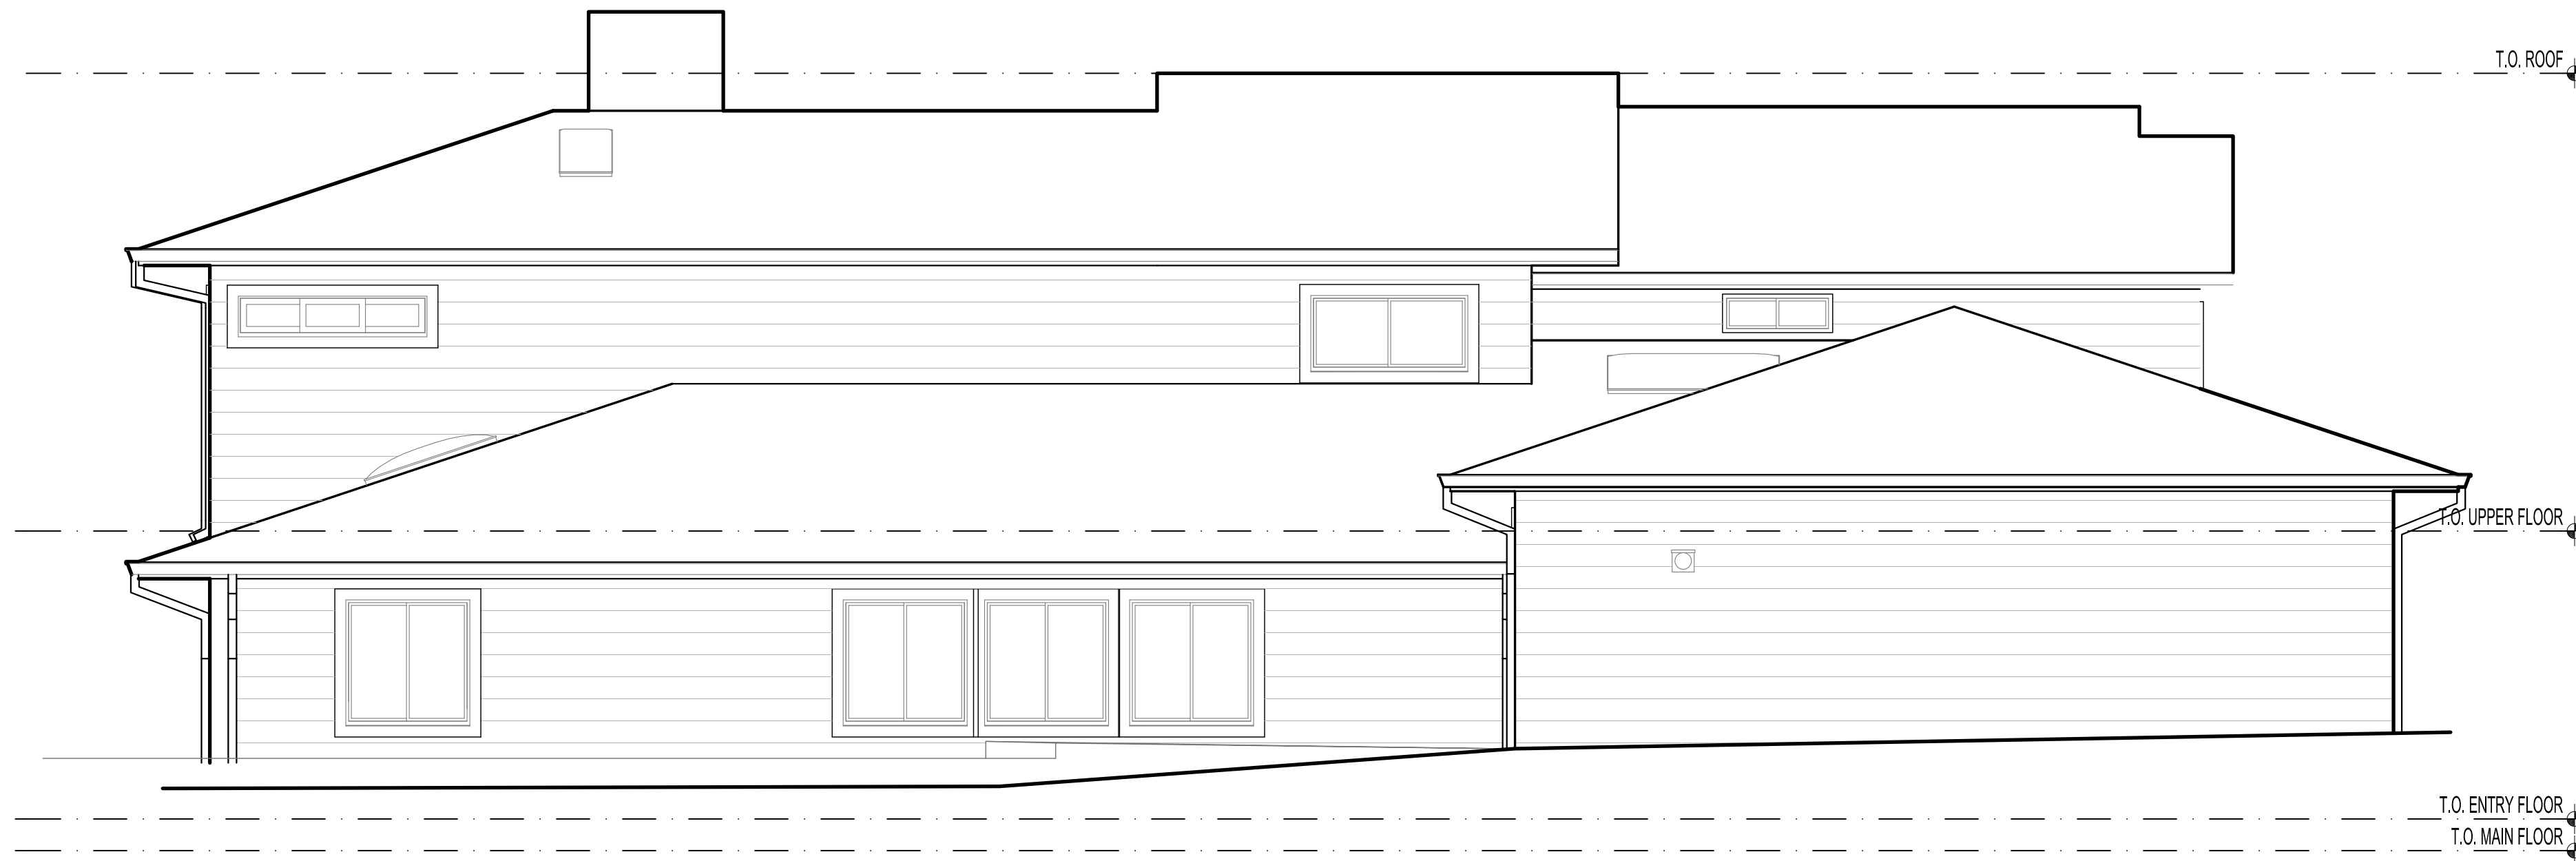

2 WEST ELEVATION
1/4" = 1'-0"

JML
ARCHITECTS

Architect:
JML ARCHITECTS
Mercer Island, WA 98040
P. 206.802.4040
Contact: Jean-Marc LeRoy, AIA



Owner:
Greg and Jennifer Rosenwald
4836 E Mercer Way
Mercer Island, WA 98040
P. -
Contact: Greg Rosenwald

General Contractor:
TBD
-
-

P. -
Contact: -

Structural Engineer:
Harriott Valentine Engineering
1932 1st Ave, Suite 720
Seattle, WA 98101
P. 206.624.4760
Contact: Todd Valentine

Mechanical Engineer:
n/a
-
-

P. -
Contact: -

Jurisdiction Approval Stamp

Date:																			
Number:																			
Revision:																			


Project:
Rosenwald
Residence
4836 E Mercer Way
Mercer Island, WA 98040
Project No. 24.245
Date: July 25, 2025

EXISTING EXT.
ELEVATIONS

A3.1

BUILDING PERMIT

A3.3

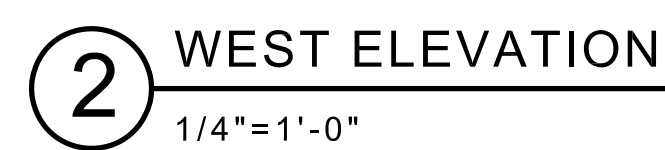

NOTE:
EXISTING STRUCTURE IS NON-CONFORMING
REGARDING SIDEYARD SETBACKS PER PREVIOUS
BUILDING PERMIT. PROPOSED DESIGN CONFORMS TO
MICC 19.01.050(D)(1)(b). NO EXISTING
NON-CONFORMING EXTERIOR STRUCTURAL WALLS
TO BE REMOVED.



A3.4



10005
REGISTERED
ARCHITECT
JEAN-MARC LeROY
STATE OF WASHINGTON

Owner:
Greg and Jennifer Rosenwald

4836 E Mercer Way
Mercer Island, WA 98040

P. -
Contact: Greg Rosenwald

General Contractor:
TBD

P. -
Contact: -

Structural Engineer:
Harriott Valentine Engineering
1932 1st Ave, Suite 720
Seattle, WA 98101

P. 206.624.4760
Contact: Todd Valentine

Mechanical Engineer:	n/a
----------------------	-----

- -	
--	--

P. -
Contact: -

Jurisdiction Approval Stamp

[illegible]

Project: **Rosenwald
Residence**
4836 E Mercer Way
Mercer Island, WA 98040
Project No. 24.245
Date: July 25, 2025

BUILDING SECTIONS

A5.1



NOTE:
PROVIDE 5/8" TYPE 'X' GWB ON CEILING OF
GARAGE WITH HABITABLE SPACE ABOVE AND
1/2" TYPE 'X' GWB ON GARAGE SIDE OF
SEPARATION BETWEEN HABITABLE SPACE.



NOTE:
EXISTING STRUCTURE IS NON-CONFORMING
REGARDING SIDEWAY SETBACKS PER PREVIOUS
BUILDING PERMIT. PROPOSED DESIGN CONFORMS TO
MICC 19.01.050(D)(1)(b). NO EXISTING
NON-CONFORMING EXTERIOR STRUCTURAL WALLS
TO BE REMOVED.



10005
REGISTERED
ARCHITECT
JEAN-MARC LeROY
STATE OF WASHINGTON

Owner:
Greg and Jennifer Rosenwald

4836 E Mercer Way
Mercer Island, WA 98040

P. -
Contact: Greg Rosenwald

General Contractor
TBD

P. -
Contact: -

Structural Engineer:
Harriott Valentine Engineering
1932 1st Ave, Suite 720
Seattle, WA 98101
P. 206.624.4760
Contact: Todd Valentine

Mechanical Engineer
n/a
-
-
P. -
Contact: -


Jurisdiction Approval Stamp

[illegible]

Project: **Rosenwald
Residence**
4836 E Mercer Way
Mercer Island, WA 98040
Project No. 24.245
Date: July 25, 2025
BUILDING PERMIT

BUILDING/WALL SECTIONS

A5.2

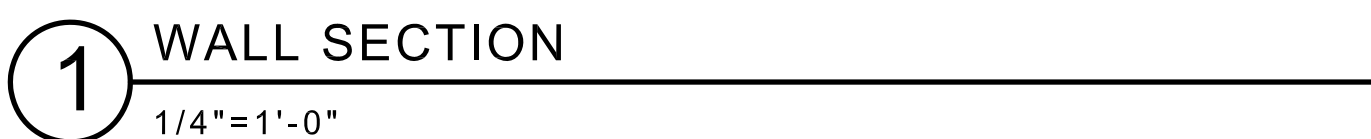

[illegible]


TYPE	INT./EXT.	THICK	DESCRIPTION
GL-1	INT.		TEMP'D, CLEAR, SINGLE PANE
GL-2	INT.		TEMP'D, OBSCURE, SINGLE PANE
GL-3	EXT.		CLEAR, DOUBLE PANE, LOW-E W/ARGON
GL-4	EXT.		TEMP'D, CLEAR, DOUBLE PANE, LOW-E W/ARGON
GL-5	EXT.		TEMP'D, OBSCURE, TRIPLE PANE, LOW-E W/ARGON
GL-6	EXT.		TEMP'D, OVER LAMINATE, TRIPLE PANE, LOW-E W/ARGON

3 GLAZING NOTES

THIS STRUCTURE SHALL BE CONSTRUCTED PER THE 2021 WASHINGTON
STATE ENERGY CODE REQUIREMENTS OF PERSPECTIVE ENVELOPE
PATH:

- | | |
|---|--------------------------------------|
| A. VERTICAL GLAZING - U:0.30 | F. WALLS ABOVE GRADE - R-21 |
| B. OVERHEAD GLAZING - U:0.50 | G. WALLS BELOW GRADE (INT) - R21 |
| C. DOORS - U:0.20 | H. WALLS BELOW GRADE (EXT.) - R10/13 |
| D. ROOF/CLG - R-49 TAPERED OR R-38 FULL DEPTH | I. FLOORS - R-30 |
| E. VAULTED CEILING - R-38 | J. SLAB ON GRADE - R-10 |

4 ENERGY CODE REQUIREMENTS

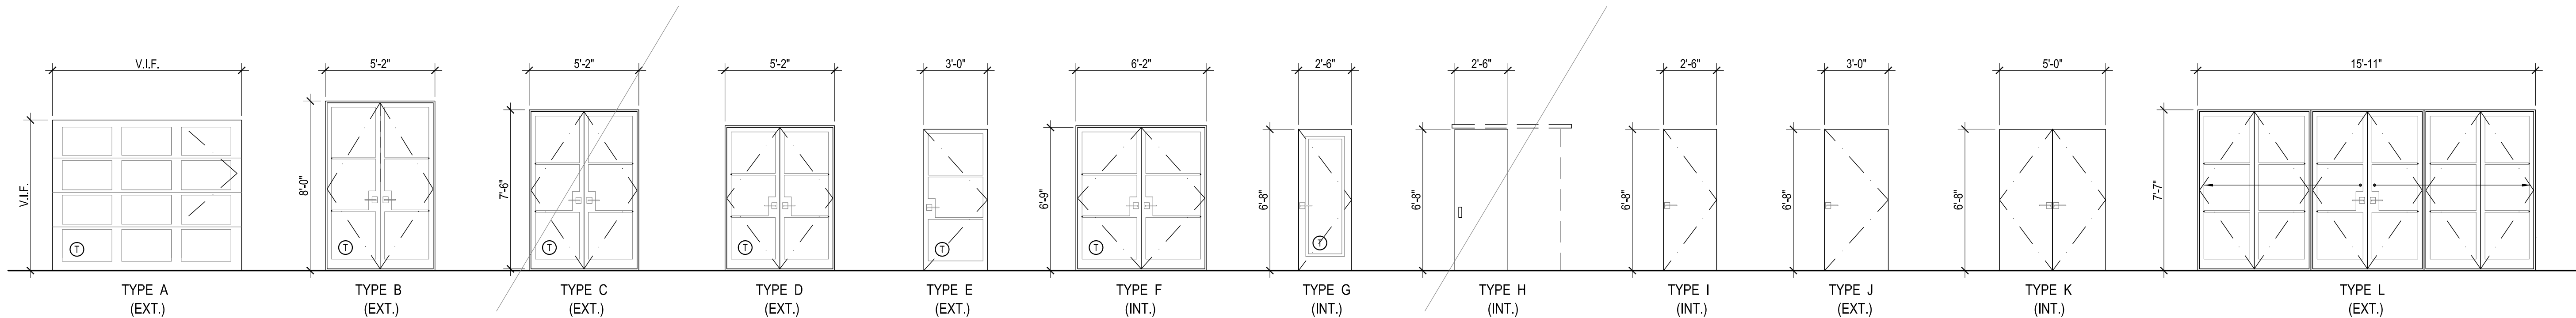

1 DOOR SCHEDULE
SHOWN VIEWED FROM OUTSIDE

SHOWN VIEWED FROM OUTSIDE

DOOR GENERAL NOTES:

1. SEE DRAWINGS A3.1 AND A3.2 FOR SWING DIRECTION AND TEMPERED GLAZING LOCATIONS.
2. ① INDICATES FULLY TEMPERED GLAZING.
4. GLAZING TO MEET SAFETY GLAZING REQUIREMENTS PER SRC R308.

JML
ARCHITECTS

Architect:

JML ARCHITECTS

Mercer Island, WA 98040

P. 206.802.4040

Contact: Jean-Marc LeRoy, AIA



Owner:

Greg and Jennifer Rosenwald

4836 E Mercer Way

P. =

Contact: Greg Rosenwald

General Contractor:

1

P. -
Contact:

Structural Engineering

Structural Engineer:
Harriett Valentine Engineering

1932 1st Ave, Suite 720
Seattle, WA 98101

Seattle, WA 98101

Contact: Todd Valentine

Mechanical Engineer:

1

P. -
Contact:

Jurisdiction Approval Stamp

Date:

vision:

umber:

Project:

Rosenwald
Residence

4836 E Mercer Way

Project No. 24.245
Mercer Island, WA 98040

Date: July 25, 2025

BUILDING PERMIT


DOOR SCHEDULE & ENERGY NOTES

A7.1

MARK	LOCATION	WINDOW SIZE			R.O. SIZE		WINDOW AREA (SF)	TYPE	GLAZING	VERT. GLAZING AREA (SF)	QTY	TOTAL VGA	U-FACTOR /UNIT	TOTAL UA (TOTAL AREA x UF)	TOTAL WINDOW AREA	FRAME			FINISH
		W	H	JAMB WIDTH	W	H										MAT.	INT. FIN.	EXT. FIN.	
Ⓐ	100 (3), 106, 110, 111, 201 (2), 205, 208, 212 (5)	4'-9"	4'-2 1/2"	4 9/16"			20.2	CASEMENT	GL-4	13.2	15	198			303				
Ⓑ	101 (2), 106 (2), 109, 112, 202, 203, 206, 209	2'-2"	4'-2 1/2"	4 9/16"			9.1	CASEMENT	GL-4	5.6	10	61.6			100.1				
Ⓒ	101 (3), 204 (4)	4'-10"	2'-4"	4 9/16"			11.2	FIXED	GL-4	7.2	7	50.4			78.4				
Ⓓ	114	1'-9"	5'-10"	4 9/16"			10.2	FIXED	GL-4	6.0	1	6.0			10.2				
Ⓔ	114 (2)	2'-9 1/4"	5'-4 1/2"	4 9/16"			14.6	FIXED	GL-4	10.1	2	20.2			29.2				
Ⓕ	106	9'-7"	4'-2 1/2"	4 9/16"			40.2	FOLDING	GL-4	25.6	1	25.6			40.2				

GARAGE WINDOWS NOT INCLUDED

TOTAL VERTICAL GLAZING AREA =	67.7		361.8	TOTAL UA =	X
TOTAL WINDOWS QTY =		36		TOTAL WINDOW AREA =	561.1
				UA/AREA =	X
				AVERAGE U VALUE =	0.30

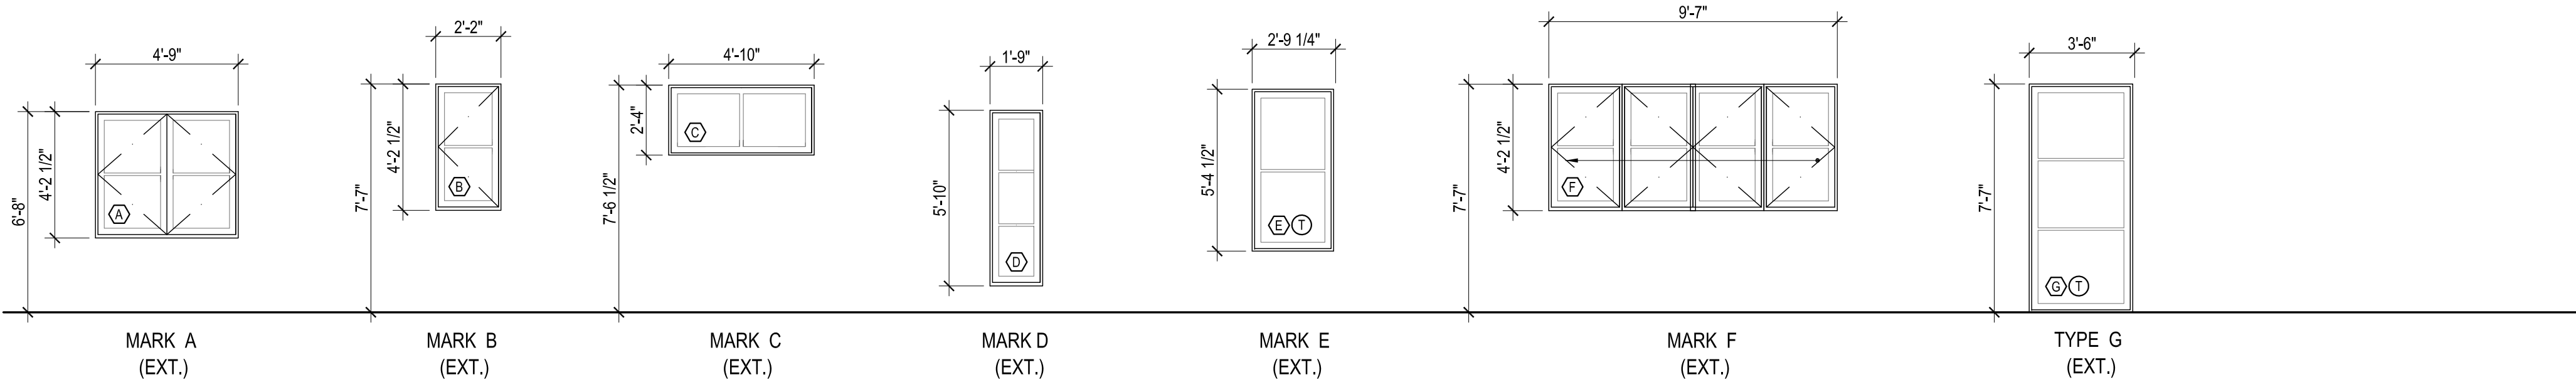

1 WINDOW SCHEDULE

SHOWN VIEWED FROM OUTSIDE

WINDOW GENERAL NOTES:

- SEE DRAWINGS A3.1 AND A3.2 FOR SWING DIRECTION AND TEMPERED GLAZING LOCATIONS.
- Ⓔ INDICATES EGRESS WINDOW. SEE DRAWINGS A3.1 AND A3.2 FOR LOCATIONS.
- Ⓕ INDICATES FULLY TEMPERED GLAZING.
- GLAZING TO MEET SAFETY GLAZING REQUIREMENTS PER SRC R308.

TYPE	INT./EXT.	THICK	DESCRIPTION
GL-1	INT.		TEMP'D, CLEAR, SINGLE PANE
GL-2	INT.		TEMP'D, OBSCURE, SINGLE PANE
GL-3	EXT.		CLEAR, DOUBLE PANE, LOW-E W/ARGON
GL-4	EXT.		LAMINATED, CLEAR, DOUBLE PANE, LOW-E W/ARGON
GL-5	EXT.		TEMP'D, OBSCURE, TRIPLE PANE, LOW-E W/ARGON
GL-6	EXT.		TEMP'D, OVER LAMINATE, TRIPLE PANE, LOW-E W/ARGON

3 GLAZING NOTES

THIS STRUCTURE SHALL BE CONSTRUCTED PER THE 2021 WASHINGTON STATE ENERGY CODE REQUIREMENTS OF PERSPECTIVE ENVELOPE PATH:

- A. VERTICAL GLAZING - U:0.30
- F. WALLS ABOVE GRADE - R-21
- B. OVERHEAD GLAZING - U:0.50
- G. WALLS BELOW GRADE (INT.) - R21
- C. DOORS - U:0.20
- H. WALLS BELOW GRADE (EXT.) - R10/13
- D. ROOF/CLG - R-49 TAPERED OR R-38 FULL DEPTH
- I. FLOORS - R-30
- E. VAULTED CEILING - R-38
- J. SLAB ON GRADE - R-10

4 ENERGY CODE REQUIREMENTS

ENERGY CREDITS:

5.0 CREDITS MIN. REQUIRED FOR ADDITIONS GREATER THAN 500 SF OF HEATED AREA BUT LESS THAN 1,500 SF

5.0 CREDITS PROVIDED

FUEL NORMALIZATION CREDITS:

SYSTEM TYPE 4: (3.0 CREDIT):
For heating system using a heat pump that meets federal standards for the equipment listed in Table C403.3.2(2) or C403.3.2(9) or Air to water heat pump units that are configured to provide both heating and cooling and are rated in accordance with AHRI 550/590

HIGH EFFICIENCY HVAC EQUIPMENT OPTIONS (1.0 CREDIT):

OPTION 3.6 - A centrally ducted air source cold climate variable capacity heat pump (cc VHP) found on the NEEF cc VCHP qualified product list with a minimum of 10 HSPF may be used to satisfy this requirement. .

- EQUIPMENT: MITSUBISHI HEAT PUMP MXZSM48NWMHZ2 48,000 BTU
- MAIN FLOOR AIR HANDLER: SVZ-KP36NA
- UPPER FLOOR AIR HANDLER: SVZ-KP18NA

AIR LEAKAGE CONTROL AND EFFICIENT VENTILATION (1.0 CREDIT):

OPTION 2.1 Compliance based on Section R402.4.1.2:
Reduce the tested air leakage to 2.0 air changes per hour maximum at 50 Pascals, or for R-2 Occupancies, optional compliance based on Section R402.4.1.2: Reduce the tested air leakage to 0.25 cfm/ft2 maximum at 50 Pascals
and
All whole house ventilation requirements as determined by Section M1505.3 of the International Residential Code or Section 403.8 of the International Mechanical Code shall be met with a heat recovery ventilation system with minimum sensible heat recovery efficiency of 0.65.

5 ENERGY EFFICIENCY REQUIREMENTS

DOOR AND WINDOW HEADERS
DOOR AND WINDOW HEADERS SHALL BE INSULATED WITH A MIN. OF R10 INSULATION

AIR LEAKAGE
A WRITTEN REPORT OF THE TEST RESULT SHALL BE SIGNED BY THE TESTING PARTY AND PROVIDED TO THE BUILDING INSPECTOR PRIOR TO CALL FOR A FINAL INSPECTION

LIGHTING
A MINIMUM OF 90% OR PERMANENTLY INSTALLED LAMPS IN LIGHTING FIXTURES SHALL BE HIGH-EFFECACY LAMPS.

INSULATION
COMPLETE AND POST INSULATION CERTIFICATE FOR RESIDENTIAL CONSTRUCTION WITHIN 3' OF ELECTRICAL PANEL PRIOR TO FINAL INSPECTION

6 ENERGY NOTES

JML
ARCHITECTS

Architect:

JML ARCHITECTS

Mercer Island, WA 98040

P. 206.802.4040
Contact: Jean-Marc LeRoy, AIA



Owner:
Greg and Jennifer Rosenwald

4836 E Mercer Way
Mercer Island, WA 98040

P. -
Contact: Greg Rosenwald

General Contractor:
TBD

-

P. -
Contact: -

Structural Engineer:
Harriott Valentine Engineering

1932 1st Ave, Suite 720
Seattle, WA 98101

P. 206.624.4760
Contact: Todd Valentine

Mechanical Engineer:
n/a

-

P. -
Contact: -

Jurisdiction Approval Stamp

Date:									
Number:									
Revision:									

Project:
Rosenwald Residence
4836 E Mercer Way
Mercer Island, WA 98040
Project No. 24.245
Date: July 25, 2025
BUILDING PERMIT

WINDOW
SCHEDULE

A7.2

GENERAL STRUCTURAL NOTES
(THE FOLLOWING APPLY UNLESS SHOWN OTHERWISE ON THE PLANS)

CRITERIA

1. ALL MATERIALS, WORKMANSHIP, DESIGN, AND CONSTRUCTION SHALL CONFORM TO THE DRAWINGS, SPECIFICATIONS, THE INTERNATIONAL BUILDING CODE (2021 EDITION), & LOCAL BUILDING CODE MODIFICATIONS TO THE INTERNATIONAL BUILDING CODE.
2. DESIGN LOADING CRITERIA:

FLOOR LIVE LOAD (RESIDENTIAL). 40 PSF

ROOF SNOW LOAD (Pf). 25 PSF

WIND:

BASIC WIND SPEED (3-SECOND GUST) 98 MPH

WIND IMPORTANCE FACTOR (Iw). 1.0

WIND EXPOSURE B

TOPOGRAPHICAL FACTOR (Kzt). 1.00

EARTHQUAKE:

LAT. / LONG. 47.559 / -122.210

SEISMIC IMPORTANCE FACTOR (Ie). 1.0

SEISMIC USE GROUP. I

MAPPED SPECTRAL RESPONSE (Ss/S1) 1.43g/0.50g

SPECTRAL RESPONSE COEF. (SDS/SD1). 1.15g/NULL

SEISMIC DESIGN CATEGORY D

ANALYSIS PROCEDURE EQUIVALENT LATERAL FORCE

HOUSE:

SEISMIC FORCE RESISTING SYSTEM: PLYWOOD SHEAR WALLS

DESIGN BASE SHEAR. 10.66k

SEISMIC RESPONSE COEFFICIENT (Cs) 0.176

RESPONSE MODIFICATION FACTOR (R) 6.5

SEISMIC FORCE RESISTING SYSTEM: . .STEEL ORD. CANTILEVER COLUMN

DESIGN BASE SHEAR. 55.5k

SEISMIC RESPONSE COEFFICIENT (Cs). 0.916

RESPONSE MODIFICATION FACTOR (R) 1.25

GARAGE:

SEISMIC FORCE RESISTING SYSTEM: PLYWOOD SHEAR WALLS

DESIGN BASE SHEAR. 5.92k

SEISMIC RESPONSE COEFFICIENT (Cs) 0.176

RESPONSE MODIFICATION FACTOR (R) 6.5

REFERENCE: USGS NATIONAL SEISMIC HAZARD MAPPING PROJECT, 2008 DATA

3. STRUCTURAL DRAWINGS SHALL BE USED IN CONJUNCTION WITH ARCHITECTURAL DRAWINGS FOR BIDDING AND CONSTRUCTION. CONTRACTOR SHALL VERIFY DIMENSIONS AND CONDITIONS FOR COMPATIBILITY AND SHALL NOTIFY ARCHITECT OF ANY DISCREPANCIES PRIOR TO CONSTRUCTION.

4. CONTRACTOR SHALL VERIFY ALL EXISTING DIMENSIONS, MEMBER SIZES, AND CONDITIONS PRIOR TO COMMENCING ANY WORK. ALL DIMENSIONS OF EXISTING CONSTRUCTION SHOWN ON THE DRAWINGS ARE INTENDED AS GUIDELINES ONLY AND MUST BE VERIFIED. CONTRACTOR SHALL DETERMINE THE LOCATION OF ALL ADJACENT UNDERGROUND UTILITIES PRIOR TO COMMENCING EXCAVATION. THE CONTRACTOR SHALL BRING ALL CONFLICTS AND DISCREPANCIES TO THE ATTENTION OF THE ARCHITECT AND STRUCTURAL ENGINEER.

5. CONTRACTOR SHALL VERIFY ALL EXISTING CONDITIONS BEFORE COMMENCING ANY DEMOLITION. SHORING SHALL BE INSTALLED TO SUPPORT EXISTING CONSTRUCTION AS REQUIRED AND IN A MANNER SUITABLE TO THE WORK SEQUENCES. EXISTING REINFORCING SHALL BE RETAINED UNDAMAGED WHERE NOTED ON THE PLANS. DEMOLITION DEBRIS SHALL NOT BE ALLOWED TO DAMAGE OR OVERLOAD THE EXISTING STRUCTURE. LIMIT CONSTRUCTION LOADING (INCLUDING DEMOLITION DEBRIS) ON EXISTING FLOOR SYSTEMS TO 40 PSF. ALL NEW OPENINGS THROUGH EXISTING CONCRETE OR MASONRY WALLS, SLABS AND BEAMS SHALL BE ACCOMPLISHED BY SAW CUTTING WHEREVER POSSIBLE.

6. CONTRACTOR SHALL PROVIDE TEMPORARY BRACING FOR THE STRUCTURE AND STRUCTURAL COMPONENTS UNTIL ALL FINAL CONNECTIONS HAVE BEEN COMPLETED IN ACCORDANCE WITH THE PLANS.

7. CONTRACTOR SHALL BE RESPONSIBLE FOR ALL SAFETY PRECAUTIONS AND THE METHODS, TECHNIQUES, SEQUENCES OR PROCEDURES REQUIRED TO PERFORM THE WORK. THE STRUCTURAL ENGINEER HAS NO OVERALL SUPERVISORY AUTHORITY OR ACTUAL AND/OR DIRECT RESPONSIBILITY FOR THE SPECIFIC WORKING CONDITIONS AT THE SITE AND/OR FOR ANY HAZARDS RESULTING FROM THE ACTIONS OF ANY TRADE CONTRACTOR. THE STRUCTURAL ENGINEER HAS NO DUTY TO INSPECT, SUPERVISE, NOTE, CORRECT, OR REPORT ANY HEALTH OR SAFETY DEFICIENCIES OF THE OWNER, CONTRACTORS, OR OTHER ENTITIES OR PERSONS AT THE PROJECT SITE.

8. SPECIAL INSPECTION OF THE FOLLOWING TYPES OF CONSTRUCTION SHALL BE PROVIDED IN ACCORDANCE WITH SECTIONS 109 AND 1704 OF THE INTERNATIONAL BUILDING CODE AND THE PROJECT SPECIFICATIONS BY A QUALIFIED TESTING AGENCY DESIGNATED BY THE ARCHITECT, AND RETAINED BY THE BUILDING OWNER. THE ARCHITECT, STRUCTURAL ENGINEER, AND BUILDING DEPARTMENT SHALL BE FURNISHED WITH COPIES OF ALL INSPECTION AND TEST RESULTS.

A. STRUCTURAL STEEL FABRICATION AND ERECTION (INCLUDING FIELD WELDING AND HIGH-STRENGTH FIELD BOLTING)

B. EPOXY GROUTED INSTALLATIONS

9. SHOP DRAWINGS FOR THE FOLLOWING ITEMS SHALL BE SUBMITTED TO THE ARCHITECT AND STRUCTURAL ENGINEER FOR REVIEW PRIOR TO FABRICATION OF THESE ITEMS.

A. STRUCTURAL STEEL

APPROVED SETS OF ALL SHOP DRAWINGS SHALL ALSO BE SUBMITTED TO THE BUILDING DEPARTMENT.

GEOTECHNICAL

10. FOUNDATION NOTES: SUBGRADE PREPARATION INCLUDING DRAINAGE, EXCAVATION, COMPACTION, AND FILLING REQUIREMENTS, SHALL CONFORM STRICTLY WITH RECOMMENDATIONS GIVEN IN THE SOILS REPORT OR AS DIRECTED BY THE SOILS ENGINEER. FOOTINGS SHALL BEAR ON SOLID UNDISTURBED EARTH (CONTROLLED, COMPACTED STRUCTURAL FILL OR BOTH) AT LEAST 18" BELOW LOWEST ADJACENT FINISHED GRADE. FOOTING DEPTHS/ELEVATIONS SHOWN ON PLANS (OR IN DETAILS) ARE MINIMUM AND FOR GUIDANCE ONLY; THE ACTUAL ELEVATIONS OF FOOTINGS MUST BE ESTABLISHED BY THE CONTRACTOR IN THE FIELD WORKING WITH THE TESTING LAB AND SOILS ENGINEER. BACKFILL BEHIND ALL RETAINING WALLS WITH FREE DRAINING GRANULAR FILL AND PROVIDE FOR SUBSURFACE DRAINAGE AS NOTED IN THE SOILS REPORT.

ALLOWABLE SOIL PRESSURE. 2000 PSF

LATERAL EARTH PRESSURE 35 PCF

SOILS REPORT REFERENCE: PANGE0 INC. NO. 25-195

11. PIPE PILE INSTALLATION SHALL CONFORM STRICTLY WITH THE RECOMMENDATIONS GIVEN IN THE SOILS REPORT OR AS DIRECTED BY THE SOILS ENGINEER. THE GEOTECHNICAL SPECIAL INSPECTOR SHALL CONTINUOUSLY OBSERVE INSTALLATION OF THE PILES. PIPE PILES SHALL BE DRIVEN WITH A 90-POUND JACKHAMMER OR A 140-POUND RHINO HAMMER TO A FINAL PENETRATION RATE OF 1-INCH OR LESS FOR ONE MINUTE OF CONTINUOUS DRIVING.

PIPE PILE AXIAL CAPACITY IS 3 TONS (6,000 LB).

PIPE PILES SHALL BE 2" DIAMETER, SCHEDULE 80 (0.218" WALL), AND SHALL CONFORM TO ASTM A53, GRADE A, FY = 30 KSI.

PIPE PILES ARE ONLY REQUIRED AT THE NEW PATIO CANOPY SUPPORT COLUMNS.

CONCRETE

12. CONCRETE SHALL BE MIXED, PROPORTIONED, CONVEYED AND PLACED IN ACCORDANCE WITH IBC SECTION 1905 AND ACI 301. CONCRETE SHALL ATTAIN A 28-DAY STRENGTH OF F'c = 2,500 PSI. THE CONCRETE MIX SHALL CONTAIN A MAXIMUM OF 330 POUNDS OF CEMENT PER CUBIC YARD AND SHALL HAVE A HIGH (30 PERCENT OR MORE) SCM (SUPPLEMENTARY CEMENTITIOUS MATERIALS, SUCH AS FLYASH OR SLAG) CONTENT. CEMENT SHALL BE A BLENDED HYDRAULIC CEMENT CONFORMING TO ASTM C595.

A CONCRETE PERFORMANCE MIX SHALL BE SUBMITTED TO THE ARCHITECT, STRUCTURAL ENGINEER AND THE BUILDING DEPARTMENT FOR APPROVAL TWO WEEKS PRIOR TO PLACING ANY CONCRETE. THE CONCRETE PERFORMANCE MIX SHALL INCLUDE THE AMOUNTS OF CEMENT, SUPPLEMENTARY CEMENTITIOUS MATERIALS, FINE AND COARSE AGGREGATE, WATER AND ADMIXTURES AS WELL AS THE WATER CEMENT RATIO, SLUMP, CONCRETE YIELD & SUBSTANTIATING STRENGTH DATA IN ACCORDANCE WITH ARTICLE 4.2.3 OF ACI 301. REVIEW OF MIX SUBMITTALS BY THE ENGINEER OF RECORD INDICATES ONLY THAT INFORMATION PRESENTED CONFORMS GENERALLY WITH CONTRACT DOCUMENTS. CONTRACTOR OR SUPPLIER MAINTAINS FULL RESPONSIBILITY FOR SPECIFIED PERFORMANCE.

ALL CONCRETE WITH SURFACES EXPOSED TO STANDING WATER SHALL BE AIR-ENTRAINED WITH AN AIR-ENTRAINING AGENT CONFORMING TO ASTM C260, C494, AND C618. TOTAL AIR CONTENT SHALL BE IN ACCORDANCE WITH TABLE 19.3.2.1 OF THE ACI 318.

13. REINFORCING STEEL SHALL CONFORM TO ASTM A615 (INCLUDING SUPPLEMENT S1), GRADE 60, FY = 60,000 PSI. WELDED WIRE FABRIC SHALL CONFORM TO ASTM A-185.

14. REINFORCING STEEL SHALL BE DETAILED (INCLUDING HOOKS AND BENDS) IN ACCORDANCE WITH ACI 318. LAP ALL CONTINUOUS REINFORCEMENT 40 BAR DIAMETERS OR 2'-0" MINIMUM. PROVIDE CORNER BARS AT ALL WALL AND FOOTING INTERSECTIONS. LAP CORNER BARS 40 BAR DIAMETERS OR 2'-0" MINIMUM. LAP ADJACENT MATS OF WELDED WIRE FABRIC A MINIMUM OF 8" AT SIDES AND ENDS.

15. CONCRETE PROTECTION (COVER) FOR REINFORCING STEEL SHALL BE AS FOLLOWS:

A. FOOTINGS AND OTHER UNFORMED SURFACES, EARTH FACE . . .3"

B. ALL OTHER SURFACES 1 1/2"

ANCHORAGE

16. EPOXY-GROUTED ITEMS SPECIFIED ON THE DRAWINGS SHALL BE GROUTED WITH "SET-3G" HIGH STRENGTH EPOXY AS MANUFACTURED BY THE SIMPSON COMPANY AND INSTALLED IN STRICT ACCORDANCE WITH ICC ESR 4057.

17. TITEN HD ANCHORS SPECIFIED ON THE DRAWINGS SHALL CONSIST OF "TITEN HD" HEAVY DUTY SCREW ANCHORS AS MANUFACTURED BY THE SIMPSON COMPANY AND INSTALLED IN STRICT ACCORDANCE WITH ICC ESR 2713.

STEEL

18. STRUCTURAL STEEL DESIGN, FABRICATION, AND ERECTION SHALL BE BASED ON THE LATEST EDITIONS OF THE AISC SPECIFICATIONS AND CODES.

A. SPECIFICATION FOR STRUCTURAL STEEL BUILDINGS (AISC 360)

B. CODE OF STANDARD PRACTICE FOR STEEL BUILDINGS AND BRIDGES (AISC 303)

C. SPECIFICATION FOR STRUCTURAL JOINTS USING ASTM A325 OR A490 BOLTS. BOLTS IN SHEAR OR BEARING TYPE CONNECTIONS NEED ONLY BE TIGHTENED TO THE SNUG TIGHT CONDITION PER SECTION 8(C).

19. STRUCTURAL STEEL SHALL CONFORM TO THE FOLLOWING MINIMUM STANDARDS. PLATES, ANGLES, AND CHANNELS SHALL CONFORM TO ASTM A36, FY = 36 KSI. WIDE FLANGE SHAPES SHALL CONFORM TO ASTM A992, FY = 50 KSI. STEEL PIPE SHALL CONFORM TO ASTM A53, TYPE E OR S, GRADE B, FY = 35 KSI. SQUARE OR RECTANGULAR STRUCTURAL TUBING SHALL CONFORM TO ASTM A500, GRADE B, FY = 46 KSI. ANCHOR BOLTS AND CONNECTION BOLTS SHALL CONFORM TO ASTM A307. THREADED ROD AND STUDS SHALL CONFORM TO ASTM A36.

20. STRUCTURAL STEEL SHALL BE PRODUCED IN THE UNITED STATES. HOT-ROLLED SECTIONS SHALL HAVE A MINIMUM RECYCLED CONTENT OF 75%. PLATE AND HSS SHALL BE PRODUCED BY THE ELECTRIC ARC FURNACE METHOD.

21. ALL WELDING SHALL BE IN CONFORMANCE WITH AISC AND AWS STANDARDS AND SHALL BE PERFORMED BY WABO CERTIFIED WELDERS USING E70XX ELECTRODES. ONLY PREQUALIFIED WELDS (AS DEFINED BY AWS) SHALL BE USED.

WOOD

22. FRAMING LUMBER SHALL BE KILN DRIED OR MC-15, AND GRADED AND MARKED IN CONFORMANCE WITH WCLTB STANDARD GRADING RULES FOR WEST COAST LUMBER NO. 17, LATEST EDITION. FURNISH TO THE FOLLOWING MINIMUM STANDARDS:

JOISTS: (2X MEMBERS) HEM-FIR NO. 2
MINIMUM BASE VALUE, FB = 850 PSI

(3X & 4X MEMBERS) DOUGLAS FIR NO. 1
MINIMUM BASE VALUE, FB = 1000 PSI

STRUCTURAL LIGHT FRAMING:
(INCL. 3X AND 4X POSTS) DOUGLAS FIR NO. 2
MINIMUM BASE VALUE, FB = 900 PSI

BEAMS AND STRINGERS:
(INCL. 6X AND LARGER) DOUGLAS FIR NO. 1
MINIMUM BASE VALUE, FB = 1350 PSI

POSTS AND TIMBERS:
(6X6 AND LARGER) DOUGLAS FIR NO. 1
MINIMUM BASE VALUE, FC = 1000 PSI

STUDS, PLATES & MISC. FRAMING: DOUGLAS FIR OR HEM-FIR STANDARD GRADE

2X6 STUDS AND PLATES: HEM-FIR NO.3/ STUD GRADE

23. GLUED LAMINATED MEMBERS SHALL BE FABRICATED IN CONFORMANCE WITH ASTM AND AITC STANDARDS IN A CITY OF SEATTLE CERTIFIED PLANT. EACH MEMBER SHALL BEAR AN AITC IDENTIFICATION MARK AND SHALL BE ACCOMPANIED BY AN AITC CERTIFICATE OF CONFORMANCE. CERTIFICATES OF CONFORMANCE MUST BE MADE AVAILABLE TO BUILDING INSPECTORS. CITY INSPECTION IS REQUIRED PRIOR TO COVERING GLUED LAMINATED MEMBERS. ALL SIMPLE SPAN BEAMS SHALL BE DOUGLAS FIR COMBINATION 24F-V4, FB = 2,400 PSI, FV = 165 PSI. ALL CANTILEVERED BEAMS SHALL BE DOUGLAS FIR COMBINATION 24F-V8, FB = 2,400 PSI, FV = 165 PSI. CAMBER ALL SIMPLE SPAN GLULAM BEAMS TO 2,000 RADIUS, UNLESS SHOWN OTHERWISE. ALL COLUMNS SHALL BE DOUGLAS FIR COMBINATION NO. 5, FC = 2400 PSI, E = 2.0 X 10E6 PSI.

24. ENGINEERED LUMBER MEMBERS SHALL BE MANUFACTURED UNDER A PROCESS BY THE NATIONAL RESEARCH BOARD. EACH PIECE SHALL BEAR A STAMP OR STAMPS NOTING THE NAME AND PLANT NUMBER OF THE MANUFACTURER, THE GRADE, THE NATIONAL RESEARCH BOARD NUMBER, AND THE QUALITY CONTROL AGENCY. ALL LUMBER SHALL BE MANUFACTURED IN ACCORDANCE WITH THE APPROPRIATE NER REPORT AND GLUED WITH A WATERPROOF ADHESIVE MEETING THE REQUIREMENTS OF ASTM D2559 WITH ALL GRAIN PARALLEL WITH THE LENGTH OF THE MEMBER.

PSL FB = 2900 PSI E = 2000 KSI FV = 290 PSI NER-292

LSL FB = 2250 PSI E = 1500 KSI FV = 285 PSI NER-481

LVL FB = 2600 PSI E = 1800 KSI FV = 285 PSI NER-126

DESIGN SHOWN ON PLANS IS BASED ON LUMBER MANUFACTURED BY THE MEYERHAUSER CORPORATION. ALTERNATE MANUFACTURERS MAY BE USED SUBJECT TO REVIEW AND APPROVAL BY THE ARCHITECT AND STRUCTURAL ENGINEER. ALTERNATE JOIST HANGERS AND OTHER HARDWARE MAY BE SUBSTITUTED FOR ITEMS SHOWN PROVIDED THEY HAVE ICC APPROVAL FOR EQUAL OR GREATER LOAD CAPACITIES. ALL JOIST HANGERS AND OTHER HARDWARE SHALL BE COMPATIBLE IN SIZE WITH MEMBERS PROVIDED.

ALL PROPOSED HOLE SIZES AND LOCATIONS SHALL BE SUBMITTED TO THE STRUCTURAL ENGINEER FOR APPROVAL TWO WORKING DAYS PRIOR TO DRILLING HOLES.

25. PLYWOOD SHEATHING SHALL BE GRADE C-D, EXTERIOR GLUE OR STRUCTURAL II, EXTERIOR GLUE IN CONFORMANCE WITH APA STANDARDS. ORIENTED STRAND BOARD OF EQUIVALENT THICKNESS, EXPOSURE RATING AND SPAN RATING MAY BE USED IN LIEU OF PLYWOOD.

A. ROOF SHEATHING SHALL BE 1/2" (NOM.) WITH SPAN RATING 24/0.

B. FLOOR SHEATHING SHALL BE 3/4" (NOM.) WITH SPAN RATING 40/20.

C. WALL SHEATHING SHALL BE 1/2" (NOM.) WITH SPAN RATING 24/0.

REFER TO WOOD FRAMING NOTES BELOW FOR TYPICAL NAILING.

26. ALL WOOD IN DIRECT CONTACT WITH CONCRETE OR MASONRY SHALL BE PRESSURE-TREATED WITH AN APPROVED PRESERVATIVE OR (2) LAYERS OF ASPHALT IMPREGNATED BUILDING PAPER SHALL BE PROVIDED BETWEEN UNTREATED WOOD AND CONCRETE OR MASONRY. ALL WOOD EXPOSED TO WEATHER WITHOUT THE ADEQUATE PROTECTION OF A ROOF OR EAVE SHALL BE AN APPROVED WOOD OF NATURAL RESISTANCE TO DECAY OR PRESSURE TREATED. SUCH MEMBERS INCLUDE HORIZONTAL MEMBERS SUCH AS GIRDERS, JOISTS, AND DECKING; OR VERTICAL MEMBERS SUCH AS POSTS, POLES, AND COLUMNS.

27. TIMBER CONNECTORS CALLED OUT BY LETTERS AND NUMBERS SHALL BE "STRONG-TIE" BY SIMPSON COMPANY, AS SPECIFIED IN THEIR MOST RECENT CATALOG. EQUIVALENT DEVICES BY OTHER MANUFACTURERS MAY BE SUBSTITUTED, PROVIDED THEY HAVE ICC APPROVAL FOR EQUAL OR GREATER LOAD CAPACITIES. PROVIDE NUMBER AND SIZE OF FASTENERS AS SPECIFIED BY MANUFACTURER. CONNECTORS SHALL BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS. WHERE CONNECTOR STRAPS CONNECT TWO MEMBERS, PLACE ONE-HALF OF THE NAILS OR BOLTS IN EACH MEMBER. ALL BOLTS IN WOOD MEMBERS SHALL CONFORM TO ASTM A307. PROVIDE WASHERS UNDER THE HEADS AND NUTS OF ALL BOLTS AND LAG SCREWS BEARING ON WOOD. UNLESS NOTED OTHERWISE, ALL NAILS SHALL BE COMMON. ALL SHIMS SHALL BE SEASONED AND DRIED AND THE SAME GRADE (MINIMUM) AS MEMBERS CONNECTED. HANGERS IN DIRECT CONTACT WITH PRESERVATIVE-TREATED WOOD SHALL BE EITHER STAINLESS STEEL (SST300), POST HOT-DIPPED GALVANIZED(HDG) OR GALVANIZED WITH A MINIMUM OF 1.850Z ZINC PER SQUARE INCH (ZMAX). UNLESS NOTED OTHERWISE, ALL LUMBER JOISTS SHALL BE CONNECTED TO FLUSH BEAMS WITH "LUS" SERIES JOIST HANGERS, AND ALL TJI JOISTS SHALL BE CONNECTED TO FLUSH BEAMS WITH "ITI" OR "IUT" SERIES JOIST HANGERS.

28. NAILS – NAIL SIZES SPECIFIED ON DRAWINGS ARE BASED ON THE FOLLOWING SPECIFICATIONS:

SIZE	LENGTH	DIAMETER
6D	2"	0.113"
8D	2-1/2"	0.131"
10D	3"	0.148"
12D	3-1/4"	0.148"
16D	3-1/2"	0.162"

IF CONTRACTOR PROPOSES THE USE OF ALTERNATE NAILS, THEY SHALL SUBMIT NAIL SPECIFICATIONS TO THE STRUCTURAL ENGINEER (PRIOR TO CONSTRUCTION) FOR REVIEW AND APPROVAL. NAILS SHALL BE DRIVEN FLUSH TO FACE OF SHEATHING WITH NO COUNTERSINKING PERMITTED.

29. WOOD FRAMING NOTES—THE FOLLOWING APPLY UNLESS OTHERWISE SHOWN:

A. ALL WOOD FRAMING DETAILS NOT SHOWN OTHERWISE SHALL BE CONSTRUCTED TO THE MINIMUM STANDARDS OF THE INTERNATIONAL BUILDING CODE. MINIMUM NAILING, UNLESS OTHERWISE NOTED, SHALL CONFORM TO TABLE 2304.10.1 OF THE INTERNATIONAL BUILDING CODE. UNLESS NOTED OTHERWISE, ALL NAILS SHALL BE COMMON. COORDINATE THE SIZE AND LOCATION OF ALL OPENINGS WITH MECHANICAL AND ARCHITECTURAL DRAWINGS. PROVIDE WASHERS UNDER THE HEADS AND NUTS OF ALL BOLTS AND LAG SCREWS BEARING ON WOOD.

B. WALL FRAMING: ALL STUD WALLS SHOWN AND NOT OTHERWISE NOTED SHALL BE 2X4 STUDS @ 16" O.C. AT INTERIOR WALLS AND 2X6 @ 16" O.C. AT EXTERIOR WALLS. TWO STUDS MINIMUM SHALL BE PROVIDED AT THE END OF ALL WALLS AND AT EACH SIDE OF ALL OPENINGS. TWO 2X8 HEADERS SHALL BE PROVIDED OVER ALL OPENINGS NOT OTHERWISE NOTED. SOLID BLOCKING FOR WOOD COLUMNS SHALL BE PROVIDED THROUGH FLOORS TO SUPPORTS BELOW. WALLS SHALL HAVE A SINGLE BOTTOM PLATE AND A DOUBLE TOP PLATE. END NAIL TOP PLATE TO EACH STUD WITH TWO 16D NAILS, AND TOENAIL OR END NAIL EACH STUD TO BOTTOM PLATE WITH TWO 16D NAILS. FACE NAIL DOUBLE TOP PLATE WITH 16D AT 12" O.C. AND LAP MINIMUM 4'-0" AT JOINTS AND PROVIDE SIX 16D NAILS AT 4" O.C. EACH SIDE OF JOINT. ALL STUD WALLS SHALL HAVE THEIR LOWER WOOD PLATES ATTACHED TO WOOD FRAMING BELOW WITH 16D NAILS AT 12" O.C. STAGGERED OR BOLTED TO CONCRETE WITH 5/8" DIAMETER ANCHOR BOLTS (WITH 7" MINIMUM EMBEDMENT) @ 4'-0" O.C. UNLESS INDICATED OTHERWISE. INDIVIDUAL MEMBERS OF BUILT-UP POSTS SHALL BE NAILED TO EACH OTHER WITH 16D @ 12" O.C. STAGGERED. REFER TO THE PLANS AND SHEAR WALL SCHEDULE FOR REQUIRED SHEATHING AND NAILING. WHEN NOT OTHERWISE NOTED, PROVIDE GYPSUM WALLBOARD ON INTERIOR SURFACES NAILED TO ALL STUDS, TOP AND BOTTOM PLATES AND BLOCKING WITH NAILS AT 7" O.C. USE 5D COOLER NAILS FOR 1/2" GWB AND 6D COOLER NAILS FOR 5/8" GWB. WHEN NOT OTHERWISE NOTED, PROVIDE 1/2" (NOW.) APA RATED SHEATHING (SPAN RATING 24/0) ON EXTERIOR SURFACES NAILED AT ALL PANEL EDGES (BLOCK UNSUPPORTED EDGES), TOP AND BOTTOM PLATES WITH 8D @ 6" O.C. AND TO ALL INTERMEDIATE STUDS AND BLOCKING WITH 8D @ 12" O.C. ALLOW 1/8" SPACING AT ALL PANEL EDGES AND ENDS.

C. FLOOR AND ROOF FRAMING: PROVIDE DOUBLE JOISTS AROUND ALL OPENINGS IN FLOORS OR ROOFS UNLESS OTHERWISE NOTED. PROVIDE SOLID BLOCKING AT ALL BEARING POINTS. TOENAIL JOISTS TO SUPPORTS WITH TWO 16D NAILS. ATTACH TIMBER JOISTS TO FLUSH HEADERS OR BEAMS WITH METAL JOIST HANGERS IN ACCORDANCE WITH TIMBER CONNECTOR NOTE. NAIL ALL MULTI-JOIST BEAMS TOGETHER WITH 16D @ 12" O.C. STAGGERED. UNLESS OTHERWISE NOTED ON THE PLANS, ROOF AND FLOOR SHEATHING SHALL BE LAID UP WITH STRENGTH AXIS PERPENDICULAR TO SUPPORTS AND NAILED WITH 8D NAILS @ 6" O.C. TO FRAMED PANEL EDGES AND OVER STUD WALLS AS SHOWN ON PLANS AND @ 12" O.C. TO INTERMEDIATE SUPPORTS. PROVIDE APPROVED PLYWOOD EDGE CLIPS CENTERED BETWEEN JOISTS/TRUSSES AT UNBLOCKED ROOF SHEATHING EDGES. ALL FLOOR SHEATHING EDGES SHALL HAVE APPROVED TONGUE-AND-GROOVE JOINTS OR SHALL BE SUPPORTED WITH SOLID BLOCKING. ALLOW 1/8" SPACING AT ALL PANEL EDGES AND ENDS OF ALL ROOF AND FLOOR SHEATHING. TOENAIL BLOCKING TO SUPPORTS WITH 16D @ 12" O.C. UNLESS OTHERWISE NOTED. AT BLOCKED FLOOR AND ROOF DIAPHRAGMS PROVIDE FLAT 2X BLOCKING AT ALL UNFRAMED PLYWOOD PANEL EDGES AND NAIL WITH EDGE NAILING SPECIFIED.

HV
Harriott Valentine Engineers Inc.
1932 First Avenue, Suite 720
Seattle, Washington 98101-2447
tel 206 624 4760 fax 206 447 6971
www.harriottvalentine.com

Project Contact
Henry Nuckles
tel 206 413 6664
hnnuckles@harriottvalentine.com

Project Architect
JML Architects
Mercer Island, 98040

Project
Rosenwald Residence
4836 E Mercer Way
Mercer Island, WA 98040


Issue Date	Issue Description
06/27/25	Permit Submittal

Building Department Approval

Drawing Title
GENERAL STRUCTURAL NOTES

Drawing Number
S1.0

ROSENWALD RESIDENCE

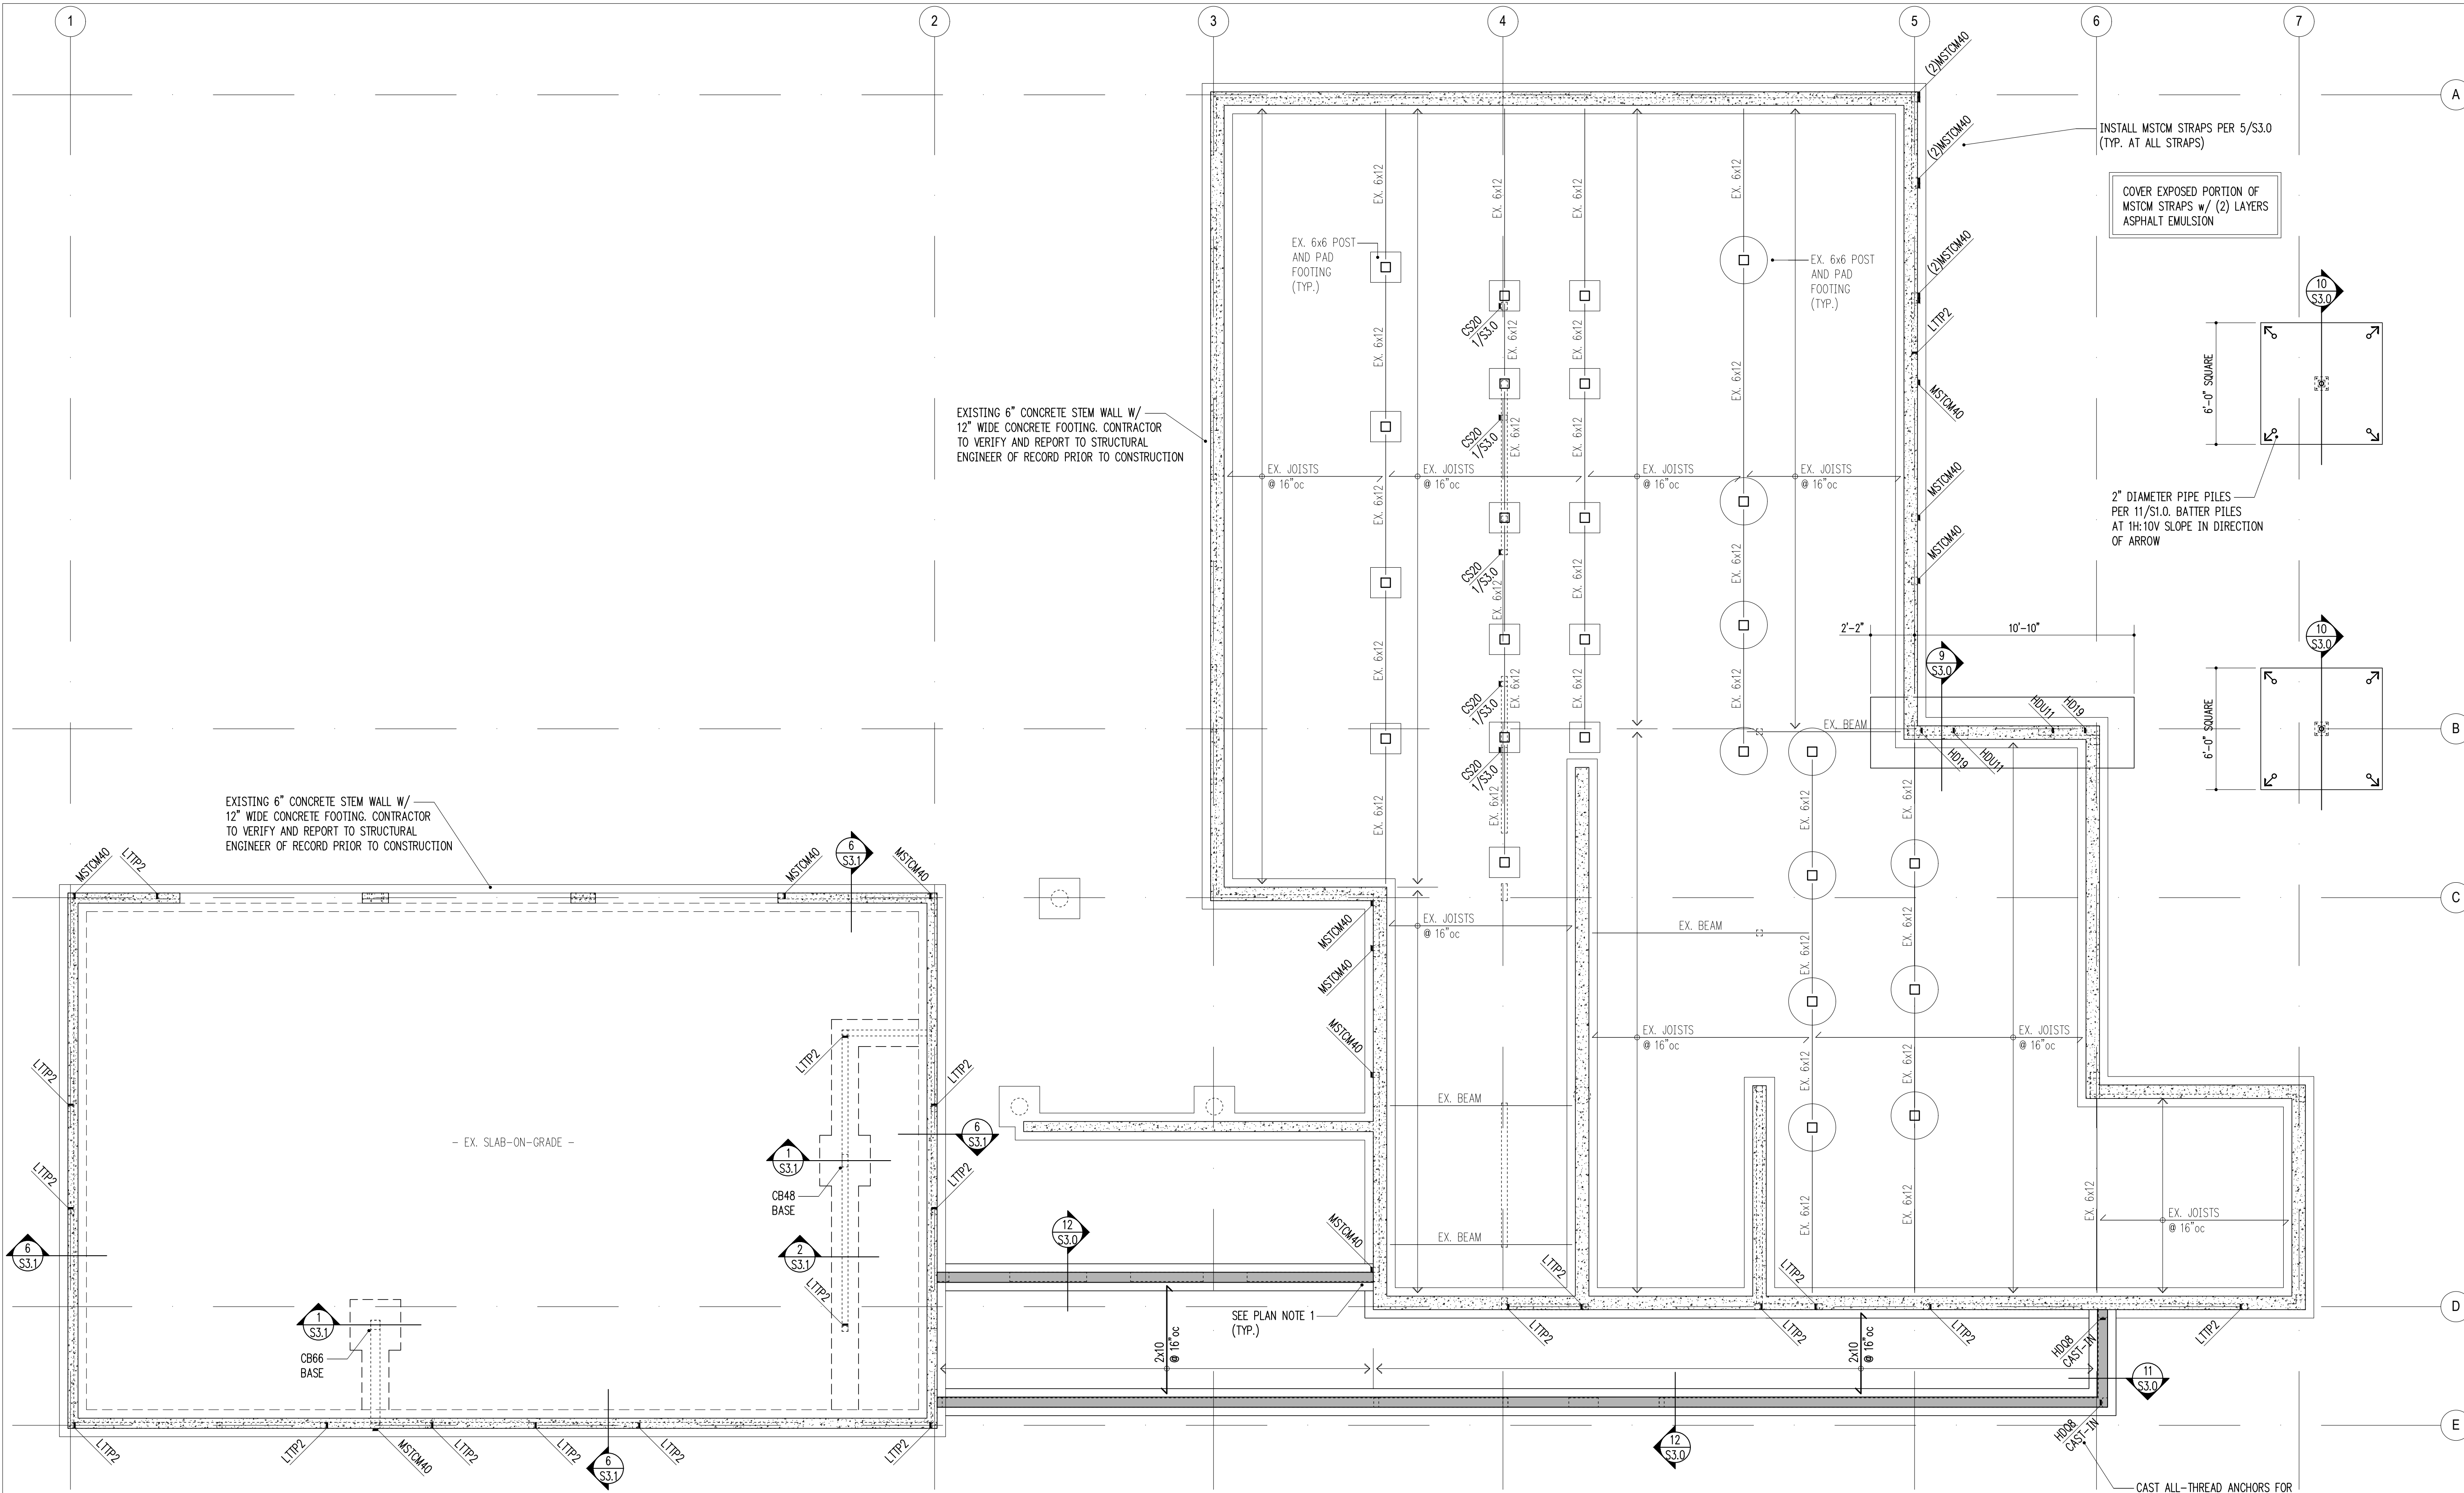

LEGEND	
	SPAN
	EXTENT
	SECTION DETAIL
	FLUSH BEAM
	PRESSURE-TREATED
	COLUMN ABOVE
	COLUMN BELOW
	NEW STRUCTURAL WALL
	EXISTING STRUCTURAL WALL
	NEW CONCRETE WALL
	EXISTING CONCRETE WALL
	ALL-THREAD HOLDOWN AT END OF SHEARWALL ABOVE
	STRAP HOLDOWN AT END OF SHEARWALL ABOVE

- FOUNDATION PLAN NOTES
- WHERE NEW CONCRETE WALLS OR FOOTING ABUT EX. CONCRETE, PROVIDE DOWELS #4 x 2'-0" TO MATCH HORIZ. REINFORCING, EMBED 5" IN EPOXY GROUT.
 - SEE 10/S4.0 FOR TYPICAL HOLDOWN REQUIREMENTS AT CONCRETE WALLS AND FOOTINGS.
 - SLAB-ON-GRADE SHALL BE PLACED AND CURED FOR A MINIMUM OF SEVEN DAYS BEFORE RETAINING WALLS ARE BACKFILLED. SEE RETAINING WALL DETAILS FOR SPECIFIC CONFIGURATION.

1
S2.0
scale: 1/4" = 1'-0"

NOTE! EXISTING FRAMING MEMBERS AS INDICATED ON THIS PLAN ARE ASSUMED FOR DESIGN PURPOSES ONLY. HARRIOTT VALENTE ENGINEERS SHALL NOT BE HELD LIABLE FOR LOCATION/ SIZE OF EXISTING MEMBERS AS CALLED ON THIS PLAN. EXISTING MEMBERS SHALL BE VERIFIED AND REPORTED TO STRUCTURAL ENGINEER OF RECORD PRIOR TO CONSTRUCTION.

HV
Harriott Valentine Engineers Inc.
1932 First Avenue, Suite 720
Seattle, Washington 98101-2447
tel 206 624 4760 fax 206 447 6971
www.harriottvalentine.com



Project Contact
Henry Nuckles
tel 206 413 6664
hnuckles@harriottvalentine.com

Project Architect
JML Architects
Mercer Island, 98040

Project
Rosenwald Residence
4836 E Mercer Way
Mercer Island, WA 98040

Issue Date	Issue Description
06/27/25	Permit Submittal

Building Department Approval

Drawing Title
MAIN FLOOR FRAMING/
FOUNDATION PLAN

Drawing Number

S2.0

ROSENWALD RESIDENCE



6/17/25

Project Contact
Henry Nuckles
tel 206 413 6664
hnuckles@harriottvalentine.com

Project Architect
JML Architects
Mercer Island, 98040

Project
Rosenwald Residence
4836 E Mercer Way
Mercer Island, WA 98040

Issue Date
06/27/25

Issue Description
Permit Submittal

Building Department Approval

Drawing Title
UPPER FLOOR FRAMING PLAN


Drawing Number

S2.1

ROSENWALD RESIDENCE

NOTE! EXISTING FRAMING MEMBERS AS INDICATED ON THIS PLAN ARE ASSUMED FOR DESIGN PURPOSES ONLY. HARRIOTT VALENTINE ENGINEERS SHALL NOT BE HELD LIABLE FOR LOCATION / SIZE OF EXISTING MEMBERS AS CALLED ON THIS PLAN. EXISTING MEMBERS SHALL BE VERIFIED AND REPORTED TO STRUCTURAL ENGINEER OF RECORD PRIOR TO CONSTRUCTION.

1
S2.1
scale: 1/4" = 1'-0"

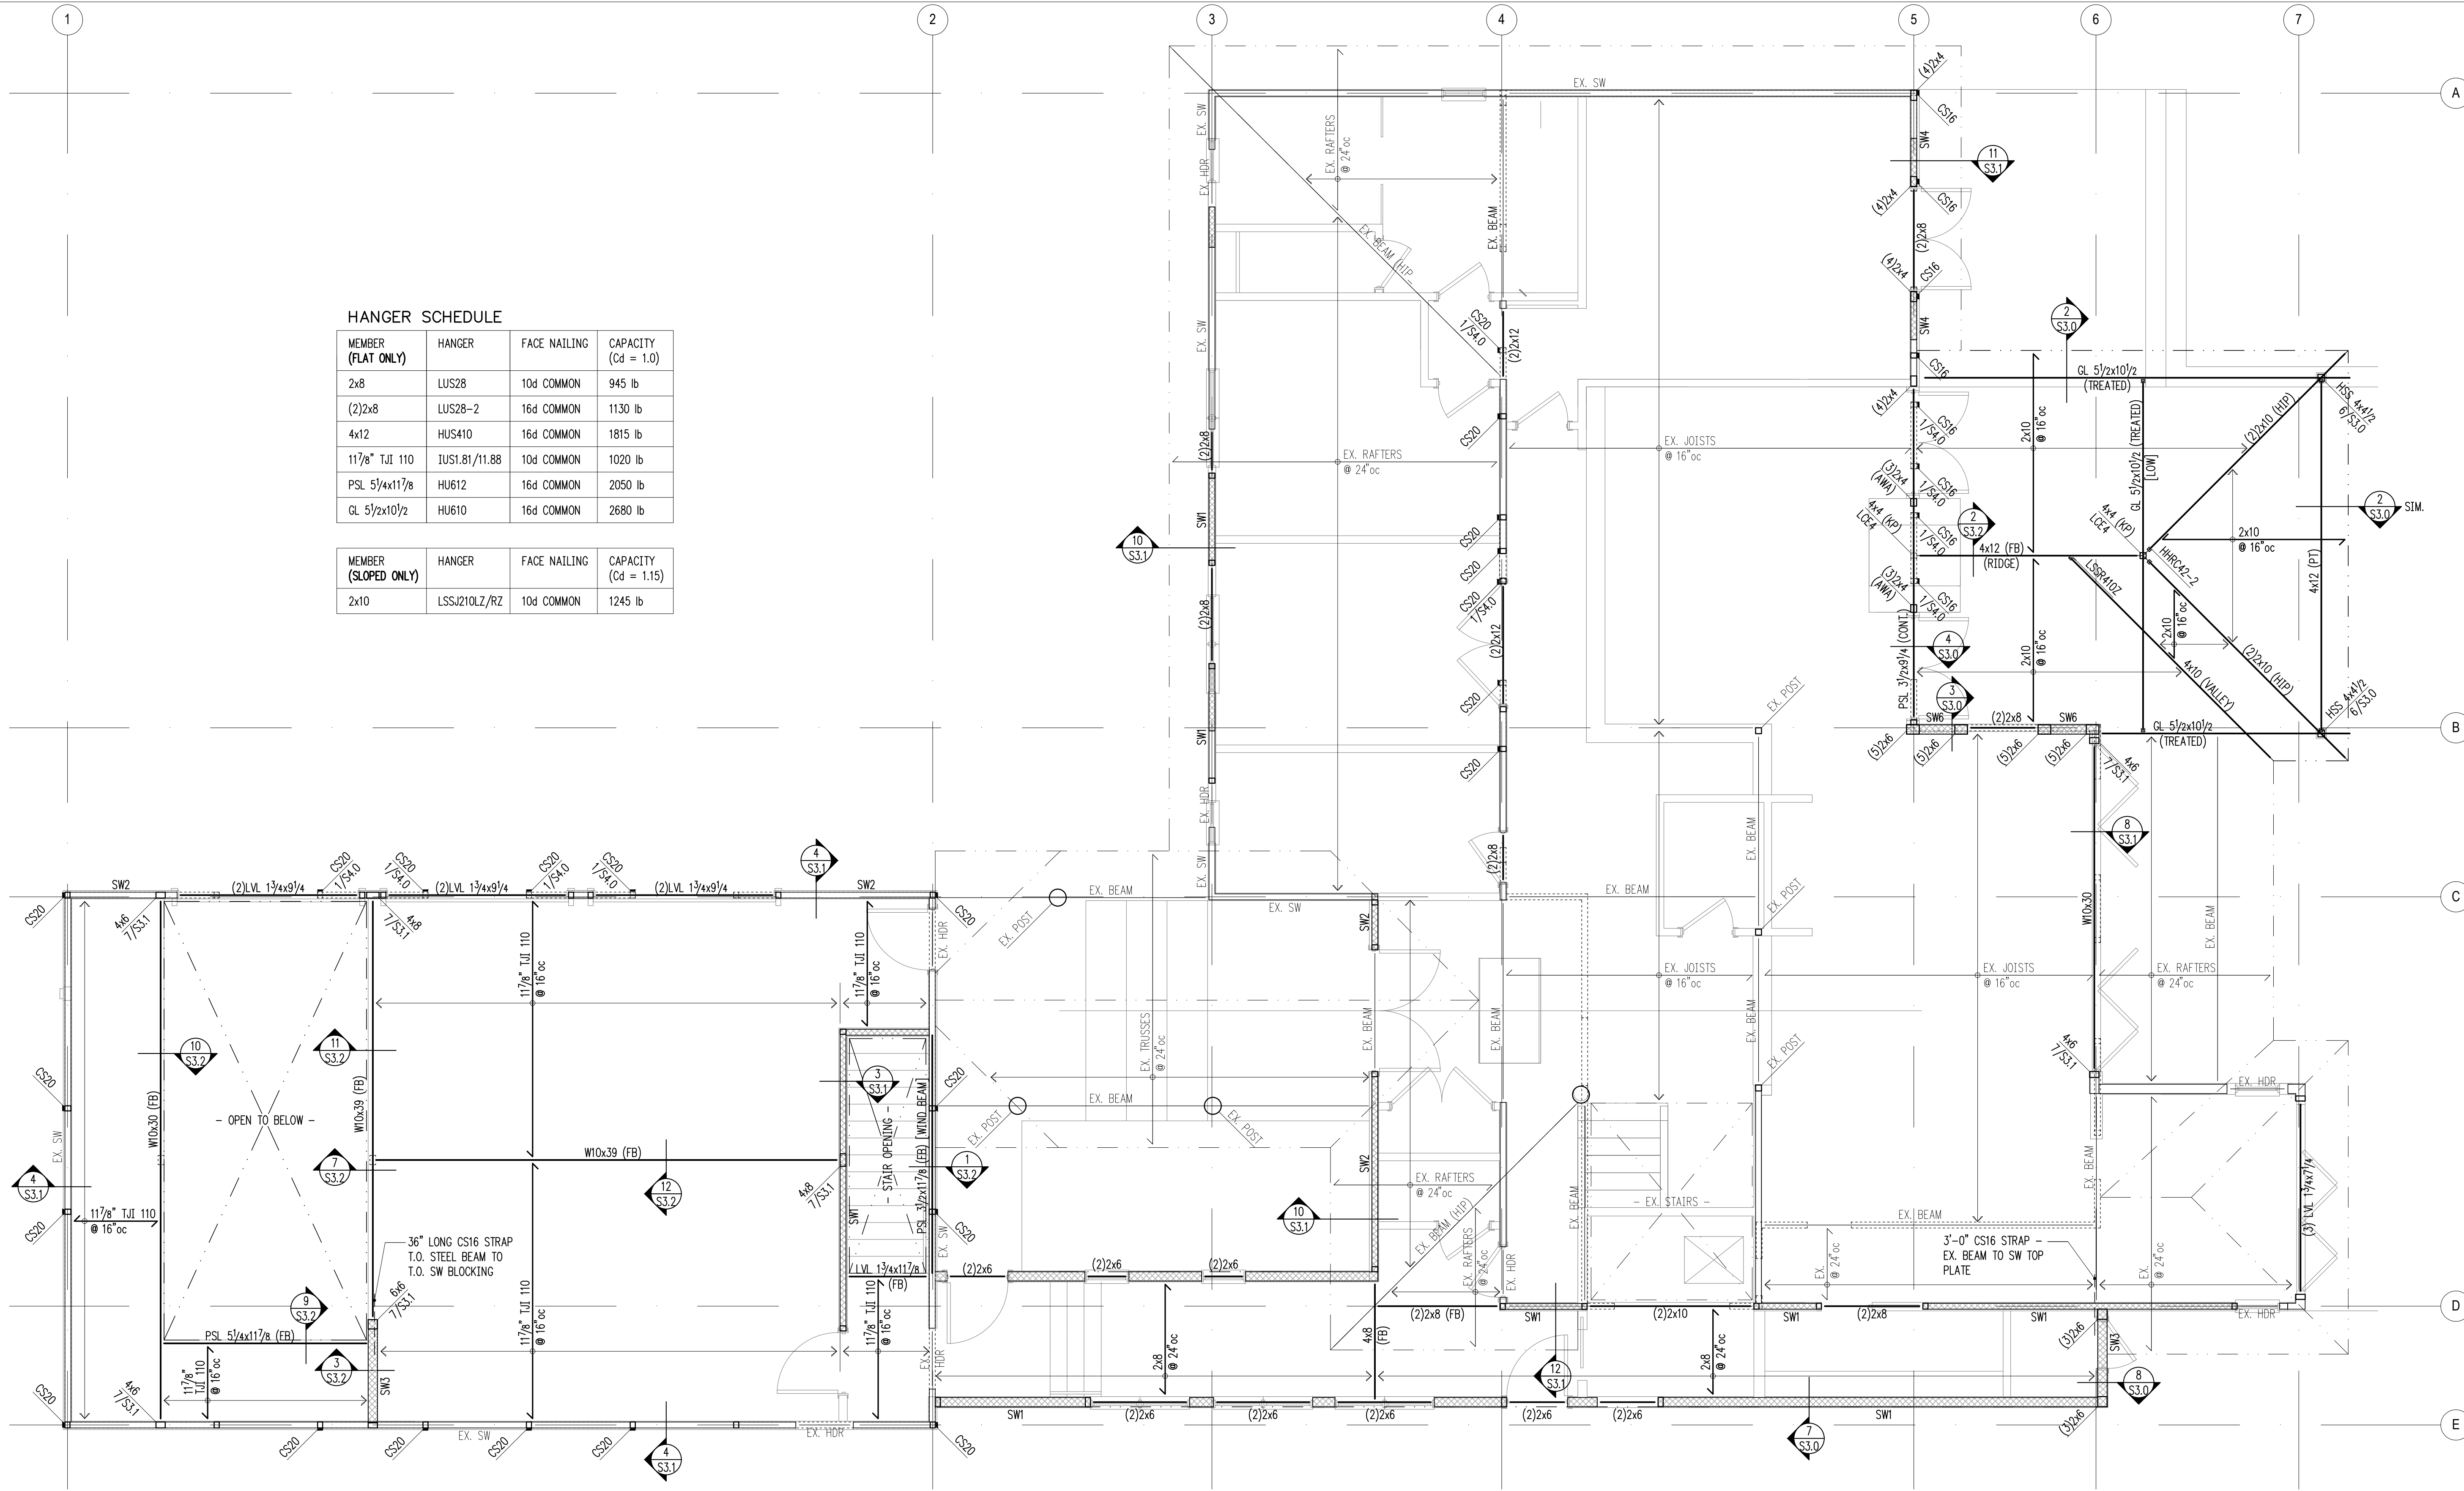

HANGER SCHEDULE

MEMBER (FLAT ONLY)	HANGER	FACE NAILING	CAPACITY (Cd = 1.0)
2x8	LUS28	10d COMMON	945 lb
(2)2x8	LUS28-2	16d COMMON	1130 lb
4x12	HUS410	16d COMMON	1815 lb
11 7/8" TJI 110	IUS1.81/11.88	10d COMMON	1020 lb
PSL 5 1/4x11 7/8	HU612	16d COMMON	2050 lb
GL 5 1/2x10 1/2	HU610	16d COMMON	2680 lb


MEMBER (SLOPED ONLY)	HANGER	FACE NAILING	CAPACITY (Cd = 1.15)
2x10	LSSJ210LZ/RZ	10d COMMON	1245 lb

LEGEND

	SPAN		NEW STRUCTURAL WALL
	EXTENT		EXISTING STRUCTURAL WALL
	SECTION DETAIL		NEW CONCRETE WALL
	FLUSH BEAM		EXISTING CONCRETE WALL
	PRESSURE-TREATED		ALL-THREAD HOLDOWN AT END OF SHEARWALL ABOVE
	COLUMN ABOVE		STRAP HOLDOWN AT END OF SHEARWALL ABOVE
	COLUMN BELOW		

FRAMING PLAN NOTES

- SW... INDICATES SHEARWALL TYPE PER SCHEDULE 8/S4.0. REFER TO DETAILS FOR TYPICAL SHEARWALL CONSTRUCTION. SEE ARCHITECTURAL DRAWINGS FOR ADDITIONAL WALL INFORMATION.
- REFER TO GENERAL STRUCTURAL NOTES FOR FLOOR OR ROOF SHEATHING TYPE, THICKNESS, AND NAILING.
- COLUMNS SHALL BE DOUBLE STUD MINIMUM, UNLESS NOTED OTHERWISE. SEE 11/S4.0.
- AT ALL SHEARWALLS PROVIDE DOUBLE TOP PLATES AND SPLICE PER 12/S4.0.
- CS... INDICATES COILED STRAP TYPE PER SCHEDULE 6/S4.0. REFER TO DETAILS FOR TYPICAL STRAP ASSEMBLY.
- POSTS □, INCLUDING ENDS OF WALL OPENINGS, SHALL BE (2)2x4 UNLESS NOTED OTHERWISE.

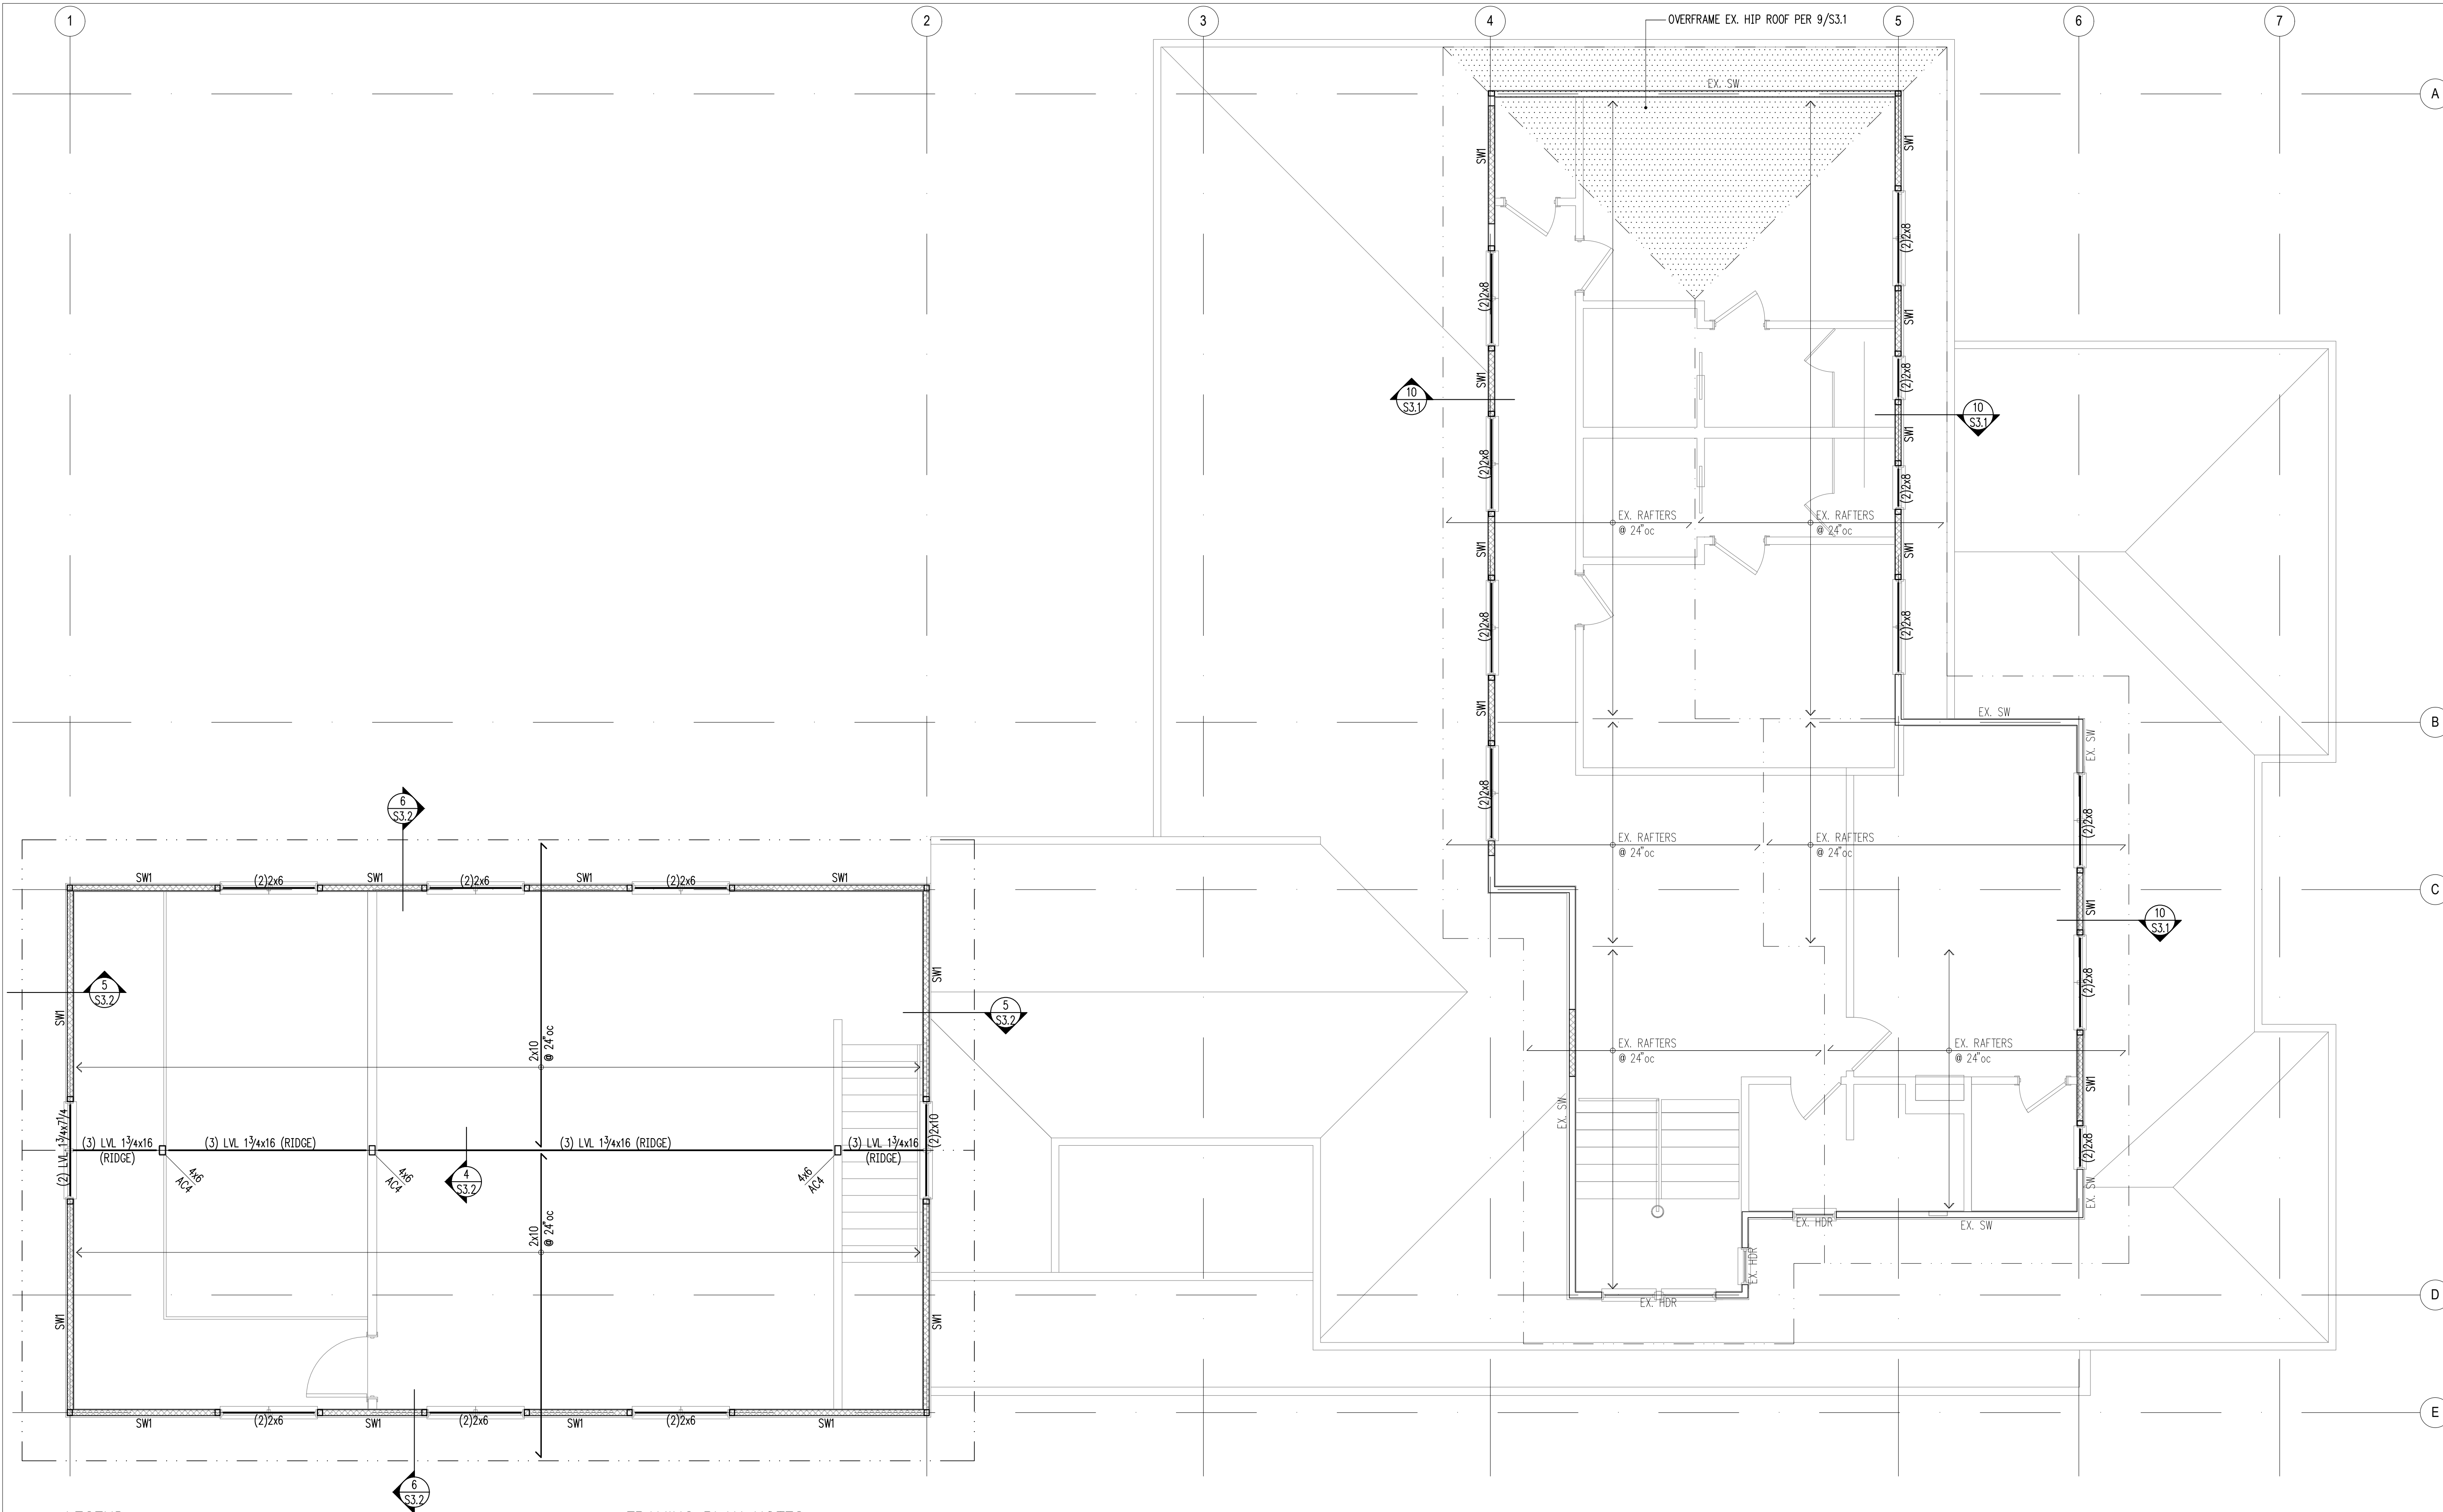

LEGEND

	SPAN		NEW STRUCTURAL WALL
	EXTENT		EXISTING STRUCTURAL WALL
	SECTION DETAIL		NEW CONCRETE WALL
	FLUSH BEAM		EXISTING CONCRETE WALL
	PRESSURE-TREATED		ALL-THREAD HOLDOWN AT END OF SHEARWALL ABOVE
	COLUMN ABOVE		STRAP HOLDOWN AT END OF SHEARWALL ABOVE
	COLUMN BELOW		

FRAMING PLAN NOTES

- SW___ INDICATES SHEARWALL TYPE PER SCHEDULE 8/S4.0. REFER TO DETAILS FOR TYPICAL SHEARWALL CONSTRUCTION. SEE ARCHITECTURAL DRAWINGS FOR ADDITIONAL WALL INFORMATION.
- REFER TO GENERAL STRUCTURAL NOTES FOR FLOOR OR ROOF SHEATHING TYPE, THICKNESS, AND NAILING.
- COLUMNS SHALL BE DOUBLE STUD MINIMUM, UNLESS NOTED OTHERWISE. SEE 11/S4.0.
- AT ALL SHEARWALLS PROVIDE DOUBLE TOP PLATES AND SPLICE PER 12/S4.0.
- CS___ INDICATES COILED STRAP TYPE PER SCHEDULE 6/S4.0. REFER TO DETAILS FOR TYPICAL STRAP ASSEMBLY.
- POSTS □, INCLUDING ENDS OF WALL OPENINGS, SHALL BE (2)2x4 UNLESS NOTED OTHERWISE.



1
S2.2

ROOF FRAMING PLAN (UPPER FLOOR WALLS)

scale: 1/4" = 1'-0"

NOTE! EXISTING FRAMING MEMBERS AS INDICATED ON THIS PLAN ARE ASSUMED FOR DESIGN PURPOSES ONLY. HARRIOTT VALENTE ENGINEERS SHALL NOT BE HELD LIABLE FOR LOCATION / SIZE OF EXISTING MEMBERS AS CALLED ON THIS PLAN. EXISTING MEMBERS SHALL BE VERIFIED AND REPORTED TO STRUCTURAL ENGINEER OF RECORD PRIOR TO CONSTRUCTION.

HV

Harriott Valentine Engineers Inc.
1932 First Avenue, Suite 720
Seattle, Washington 98101-2447
tel 206 624 4760 fax 206 447 6971
www.harriottvalentine.com



Project Contact

Henry Nuckles
tel 206 413 6664
hnuckles@harriottvalentine.com

Project Architect

JML Architects
Mercer Island, 98040

Project

Rosenwald Residence
4836 E Mercer Way
Mercer Island, WA 98040

Issue Date

06/27/25

Issue Description

Permit Submittal


Building Department Approval

Drawing Title

**ROOF
FRAMING PLAN**


Drawing Number

S2.2

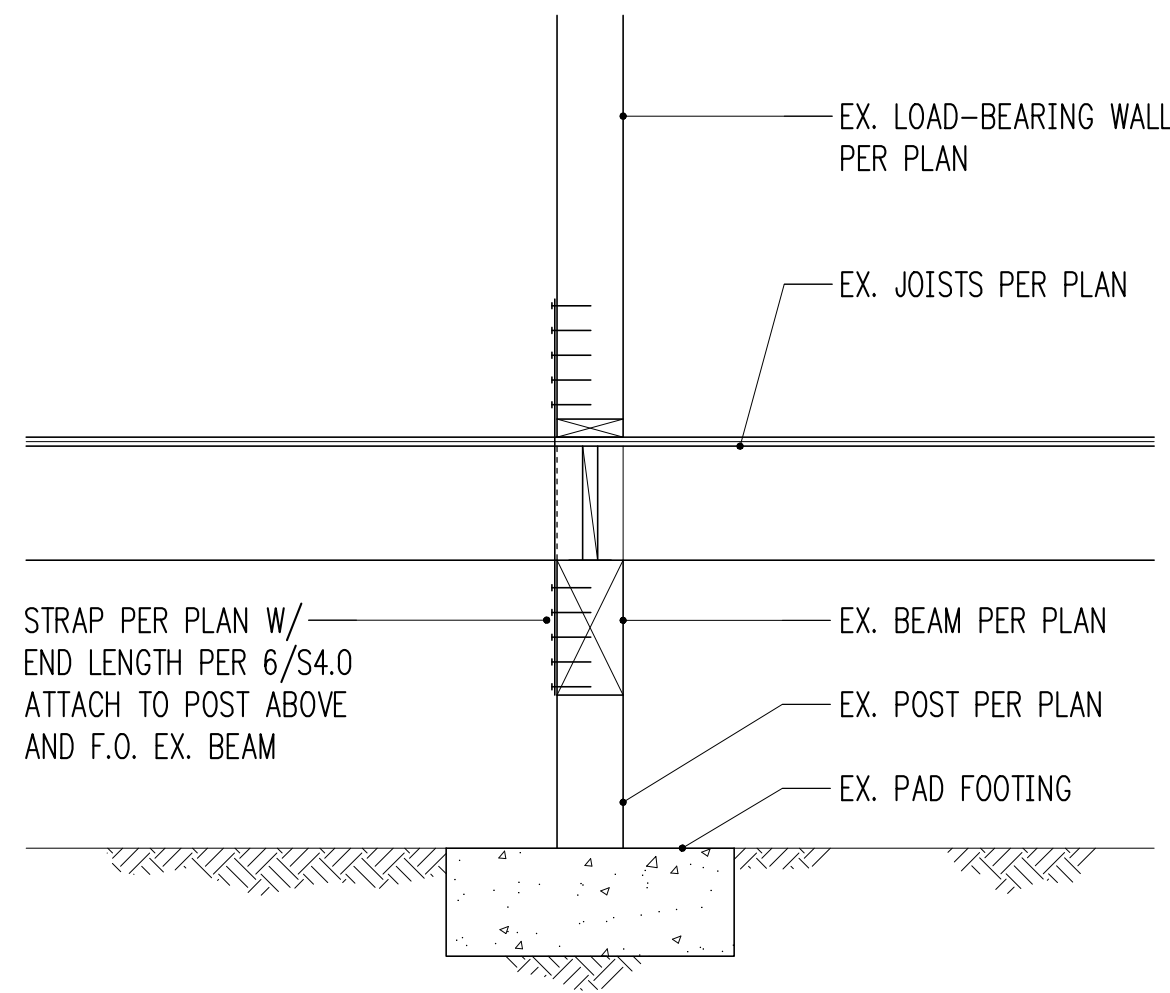


3/4" = 1'-0"

1

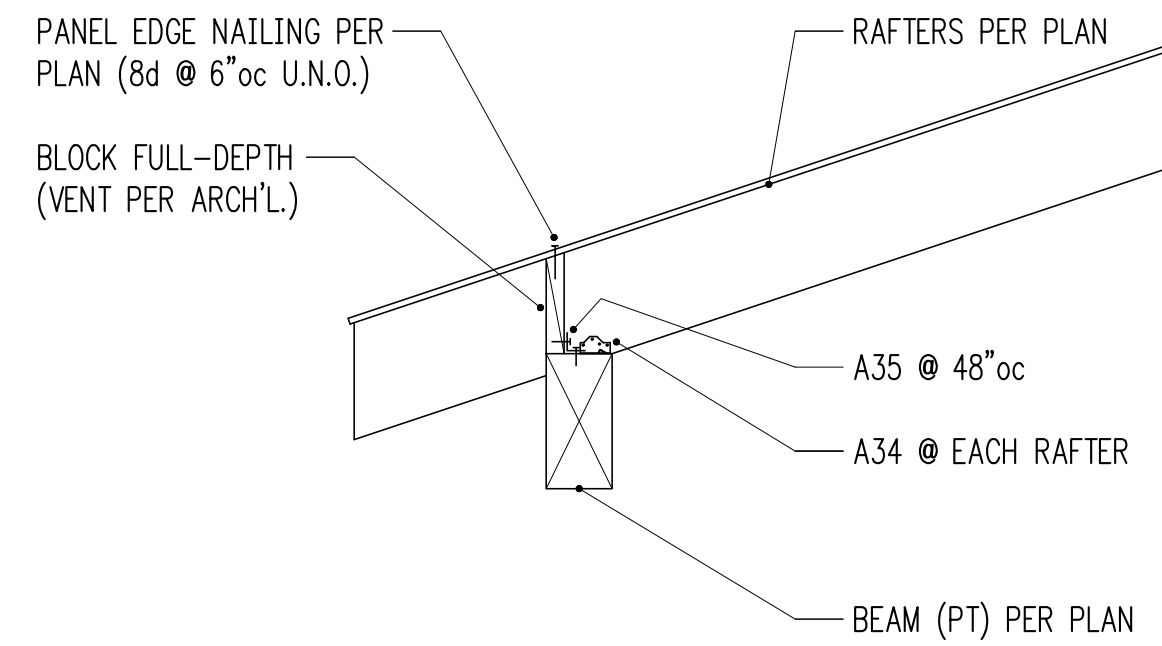


3/4" = 1'-0"

2

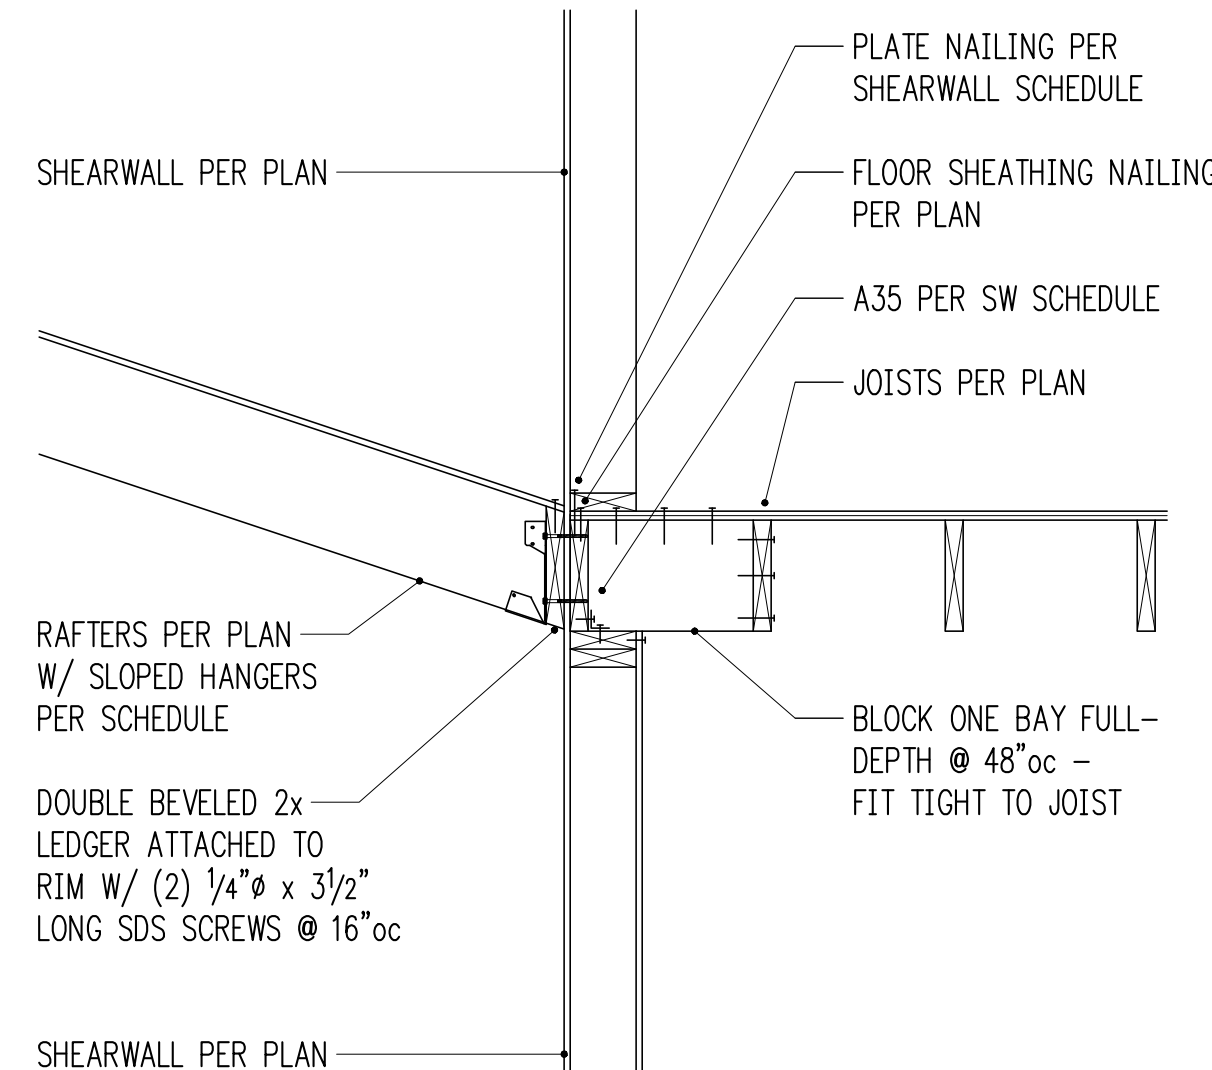


3/4" = 1'-0"

3

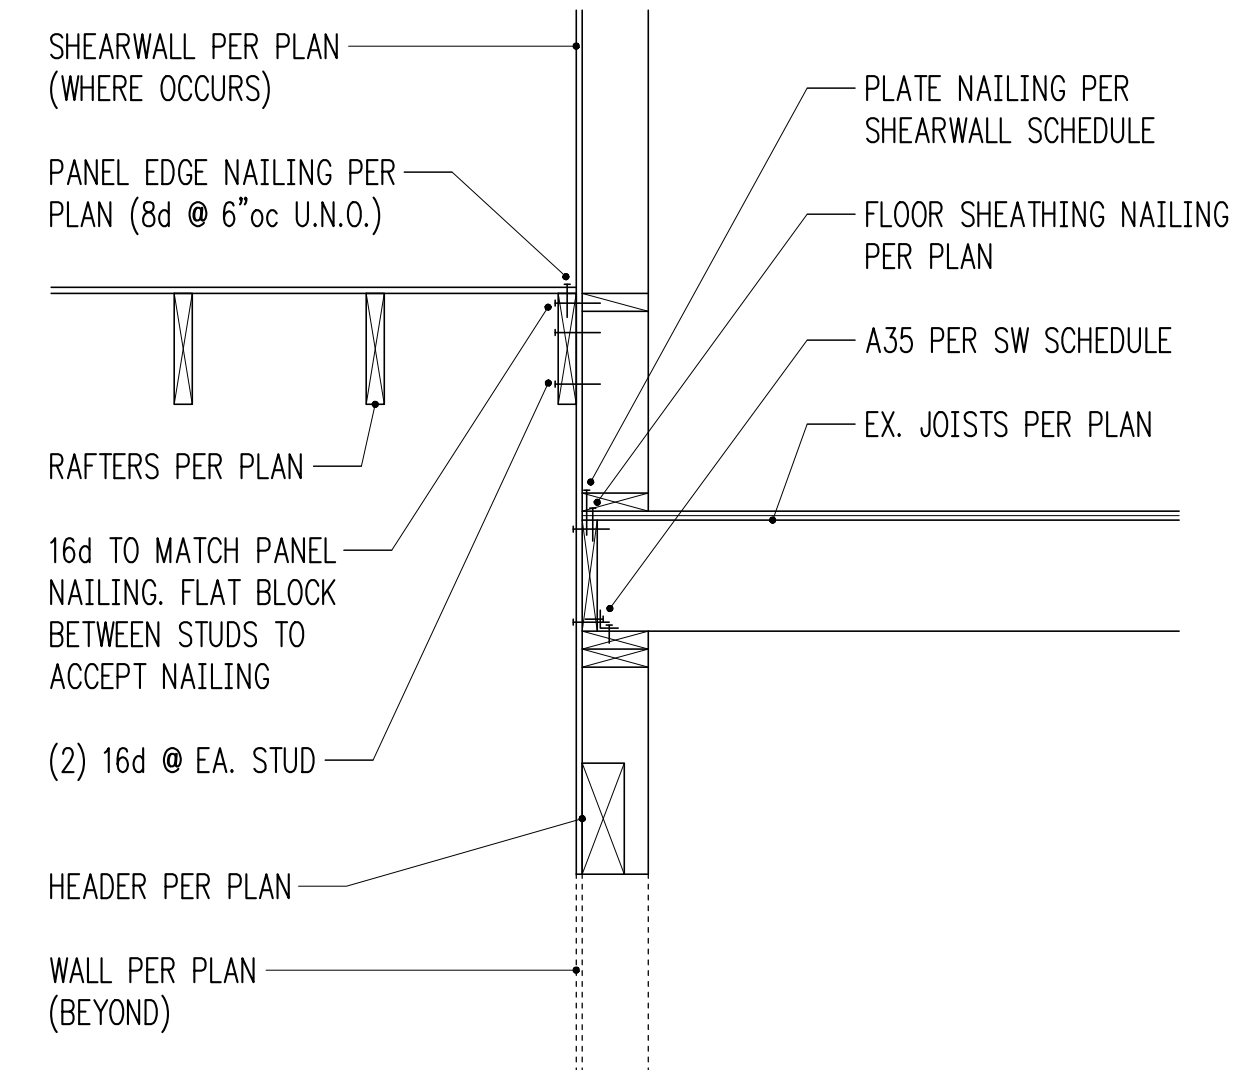


3/4" = 1'-0"

4

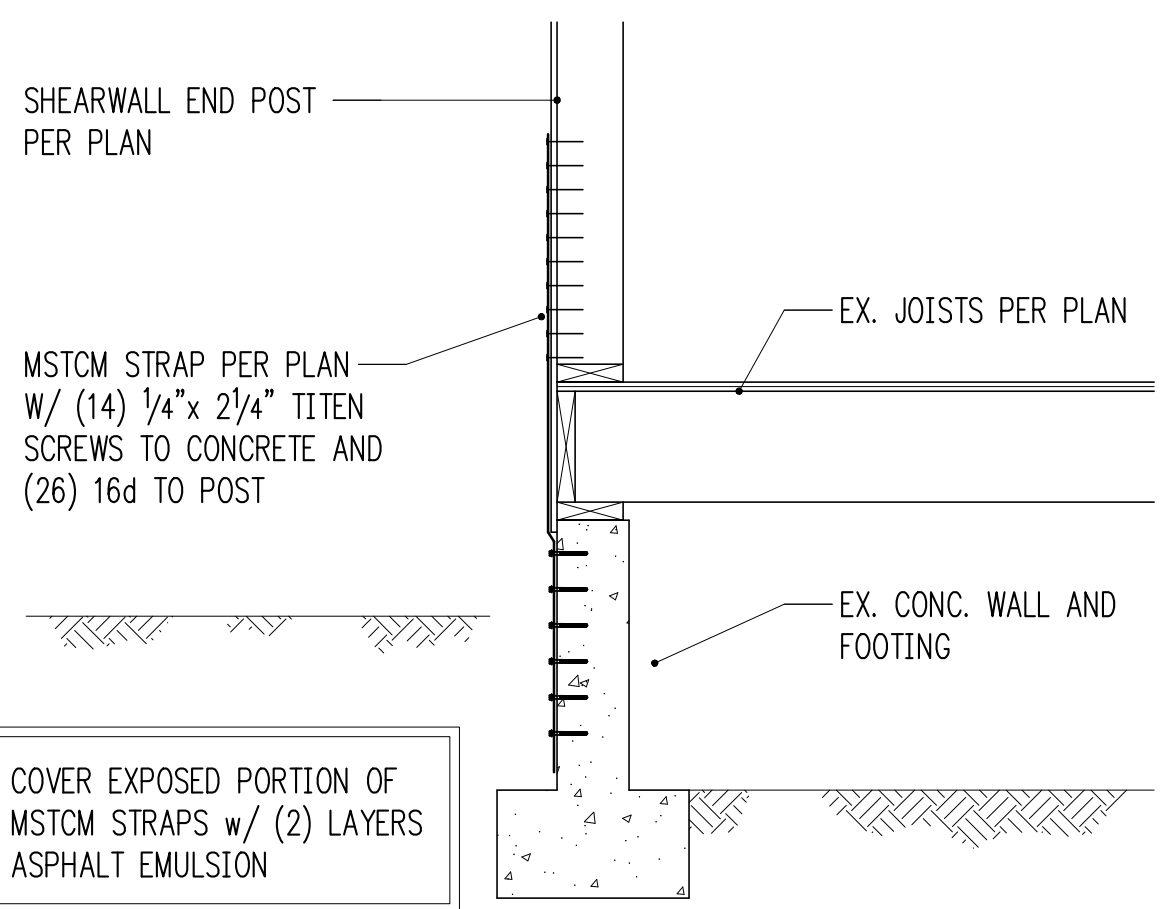

3/4" = 1'-0"


5

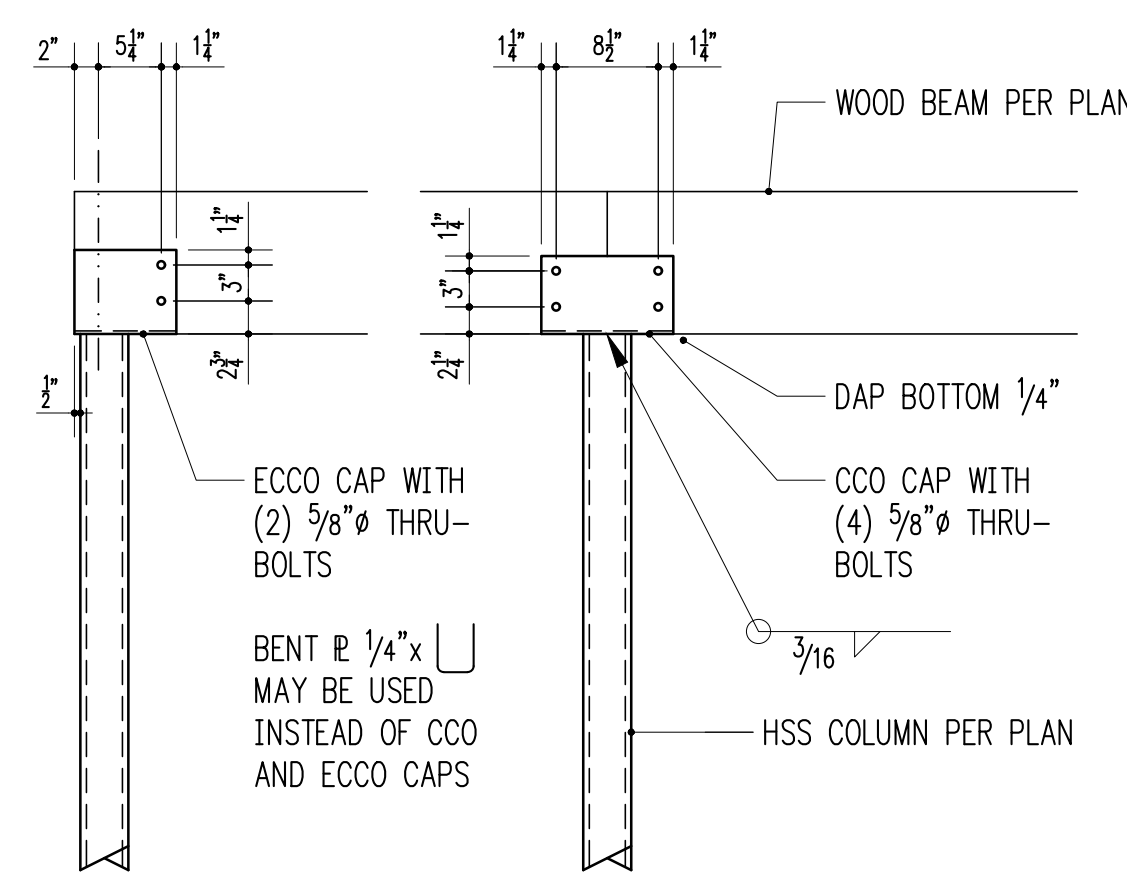

WOOD BEAM BEARING ON HSS COLUMN


3/4" = 1'-0"

6

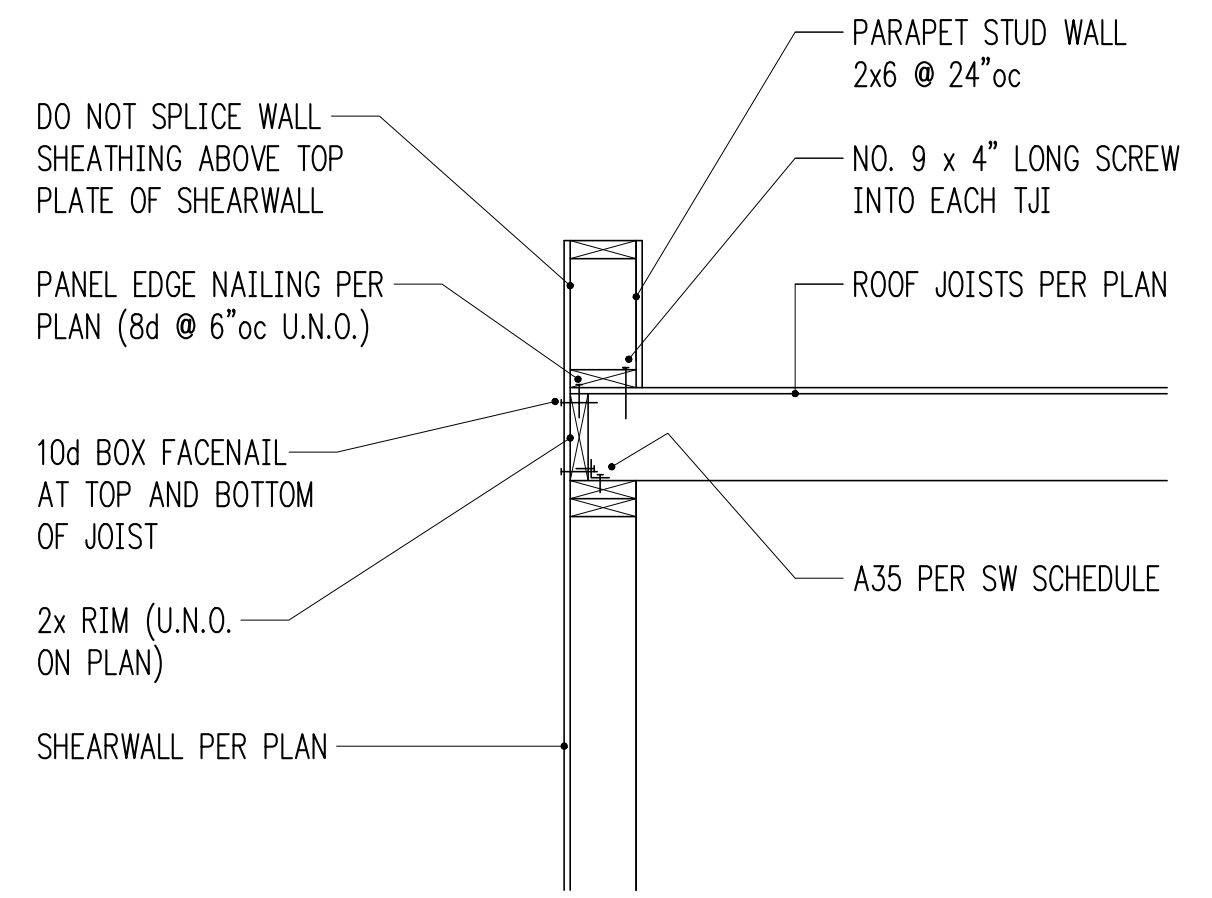


3/4" = 1'-0"

7

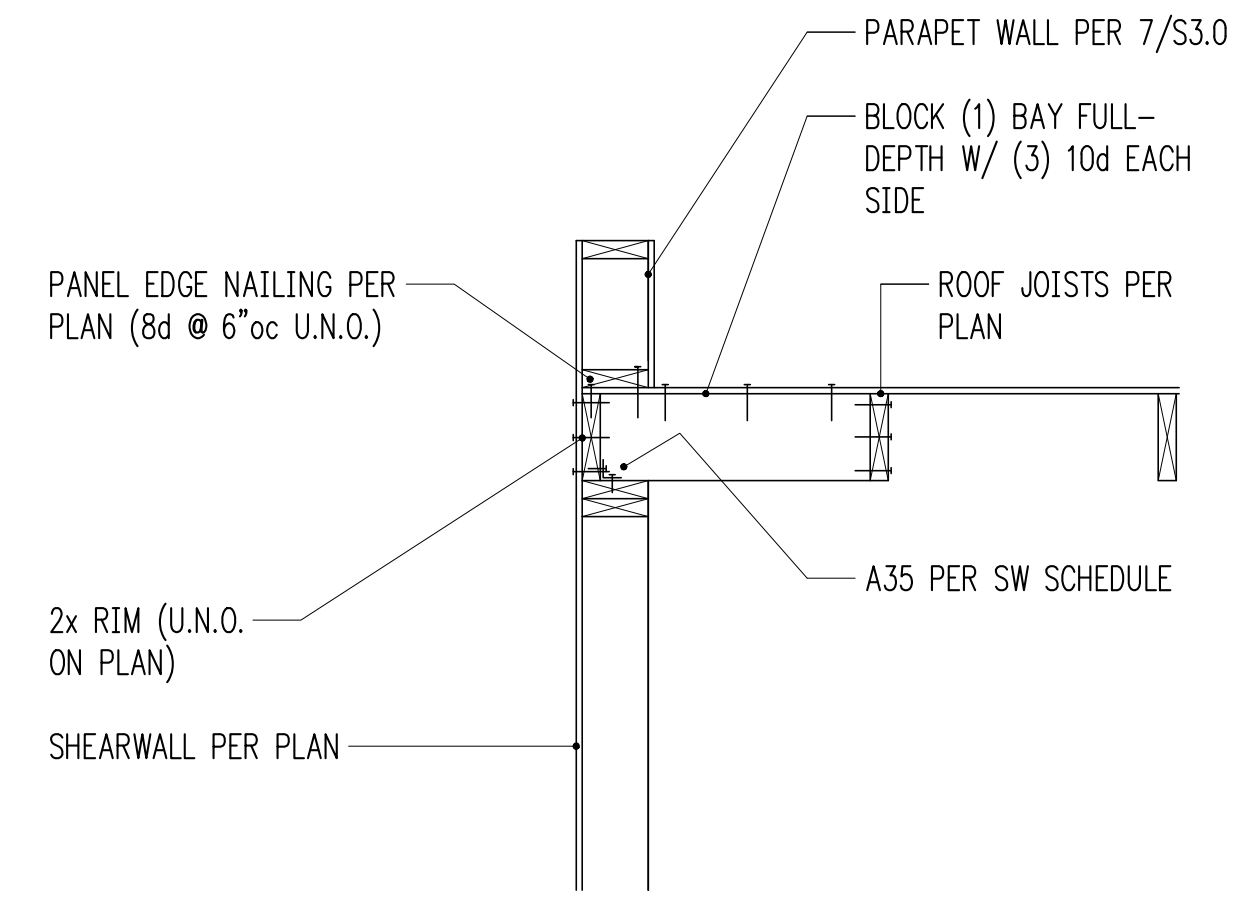


3/4" = 1'-0"

8

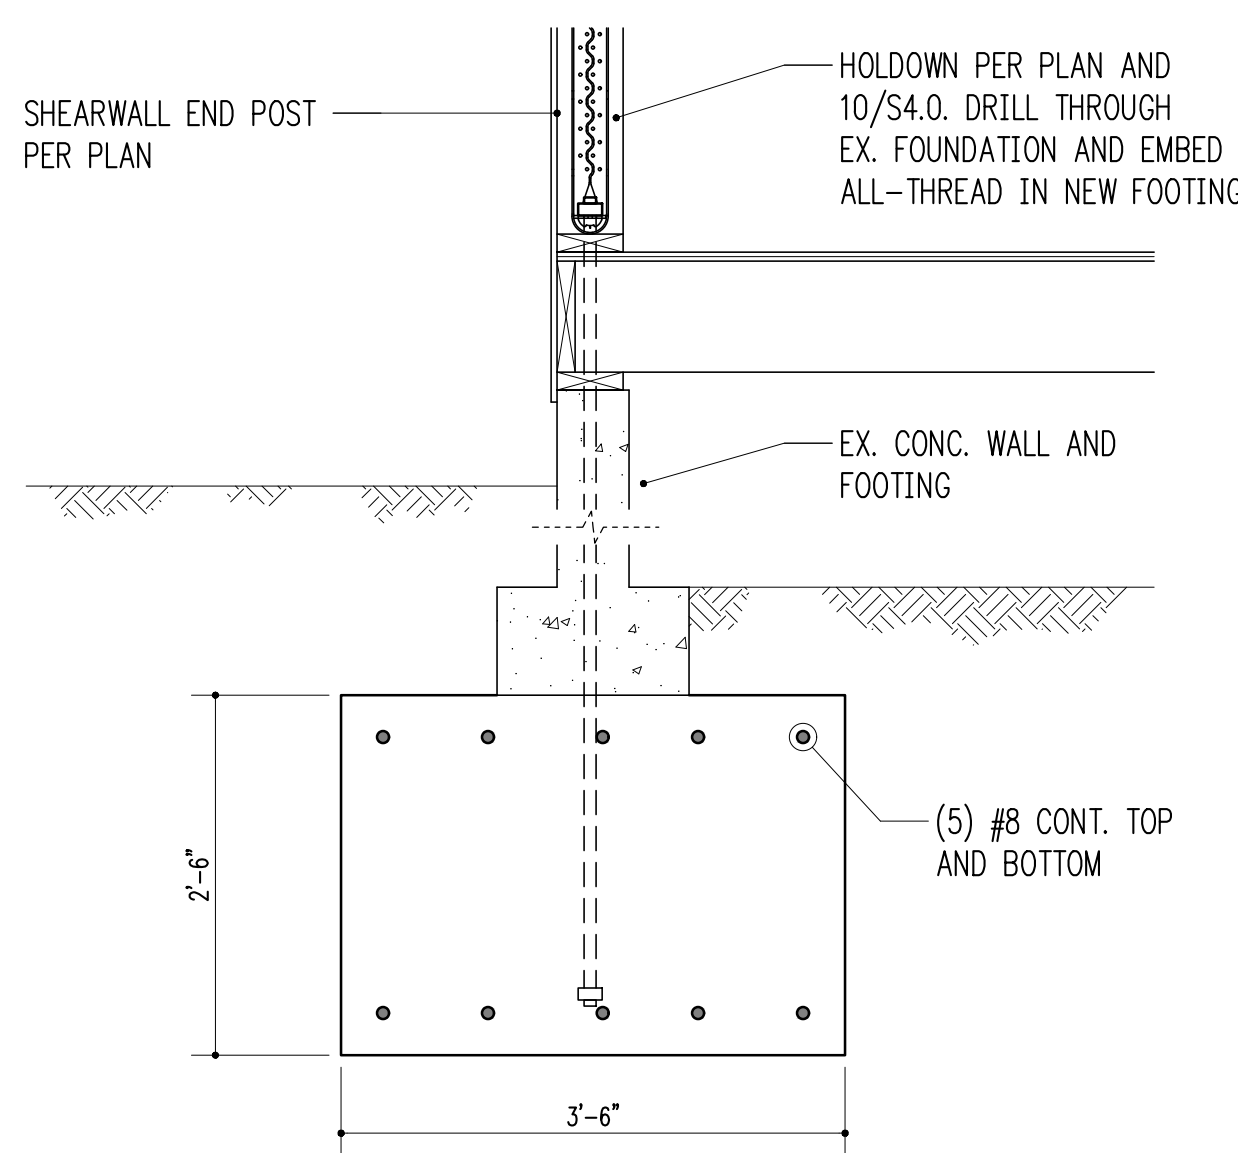


3/4" = 1'-0"

9

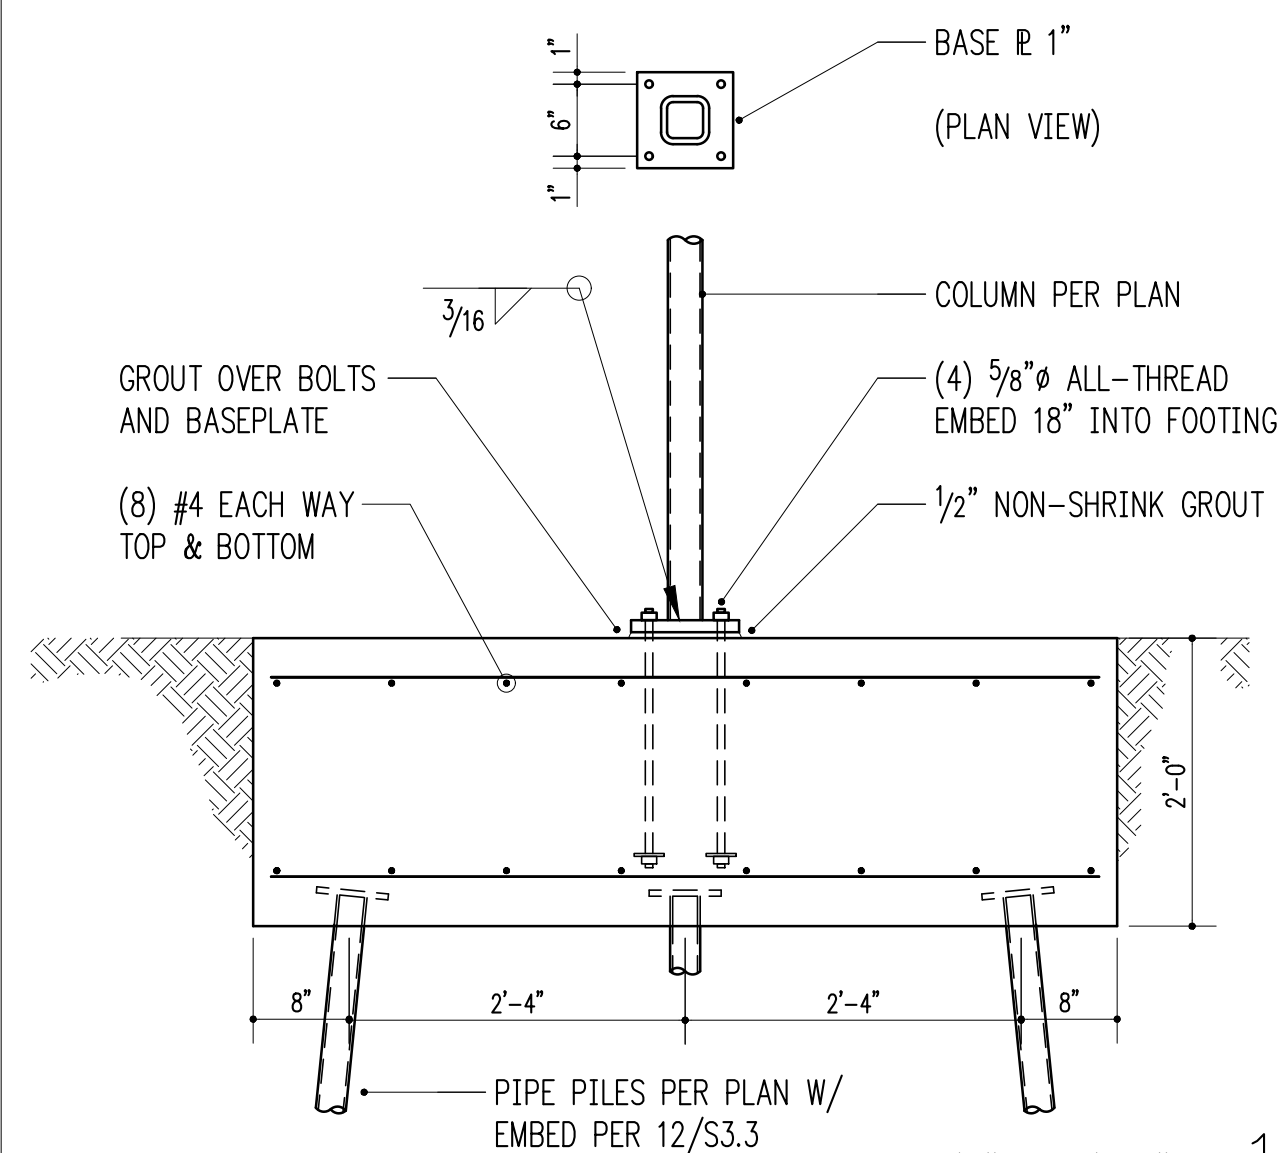


3/4" = 1'-0"

10

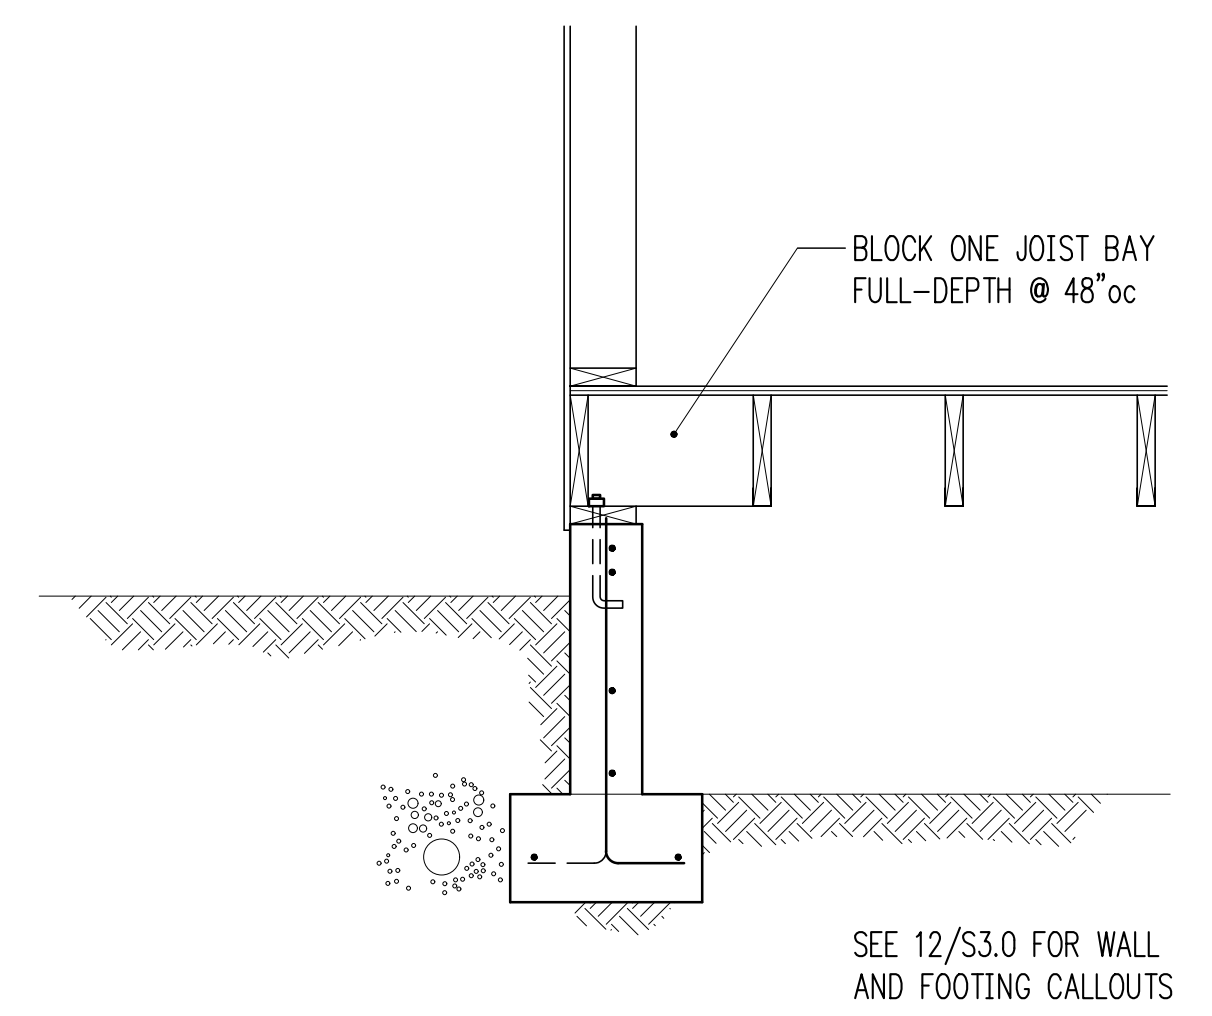

3/4" = 1'-0"

11

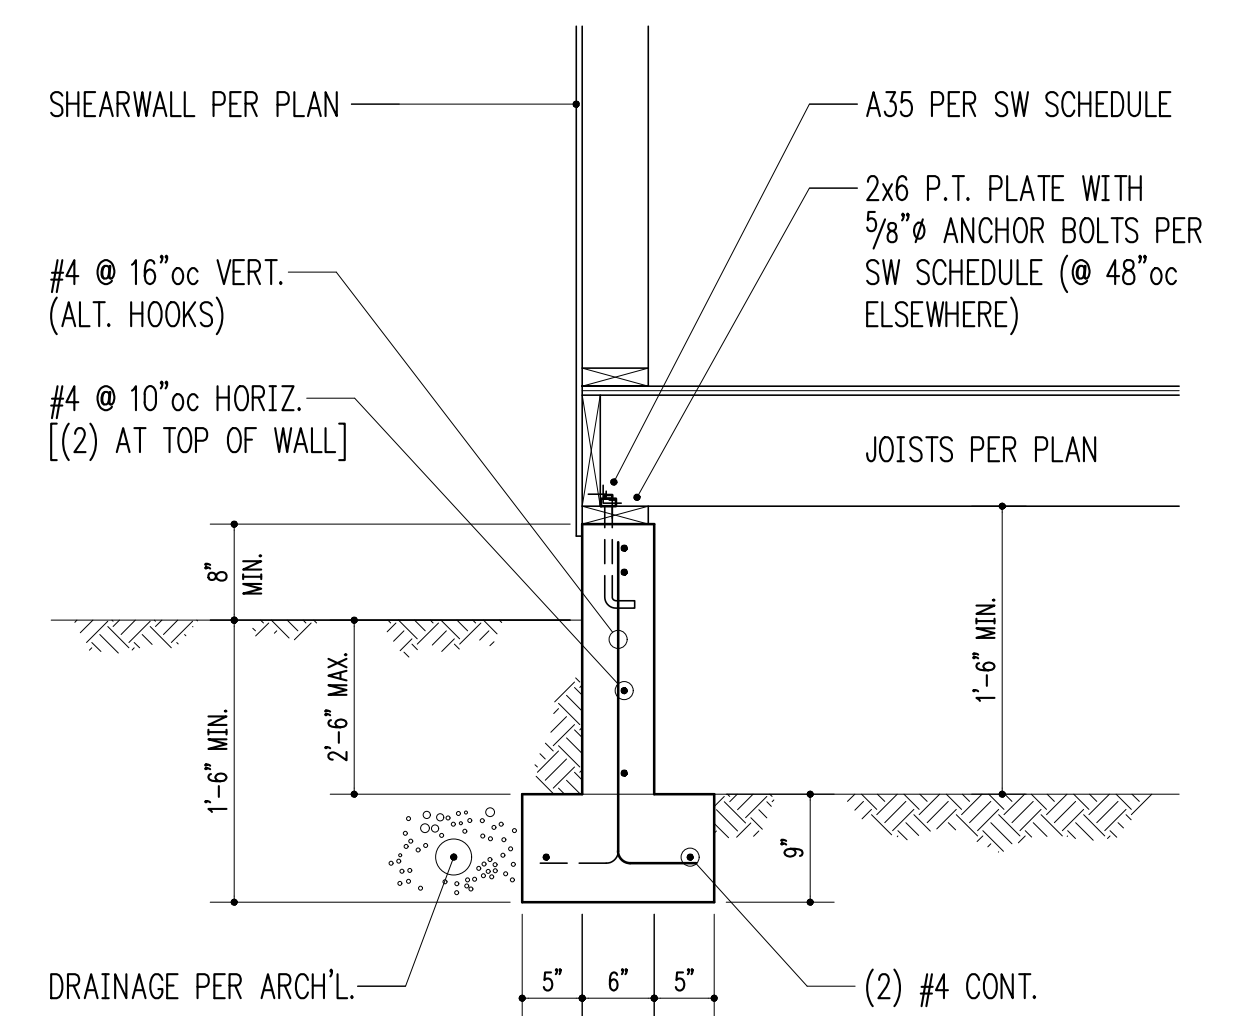

3/4" = 1'-0"

12

HV

Harriott Valentine Engineers Inc.
1932 First Avenue, Suite 720
Seattle, Washington 98101-2447
tel 206 624 4760 fax 206 447 6971
www.harriottvalentine.com




Project Contact
Henry Nuckles
tel 206 413 6664
hnuckles@harriottvalentine.com

Project Architect
JML Architects
Mercer Island, 98040

Project
Rosenwald Residence
4836 E Mercer Way
Mercer Island, WA 98040

Issue Date	Issue Description
06/27/25	Permit Submittal

Building Department Approval




Drawing Title
STRUCTURAL DETAILS


Drawing Number

S3.0


ROSENWALD RESIDENCE

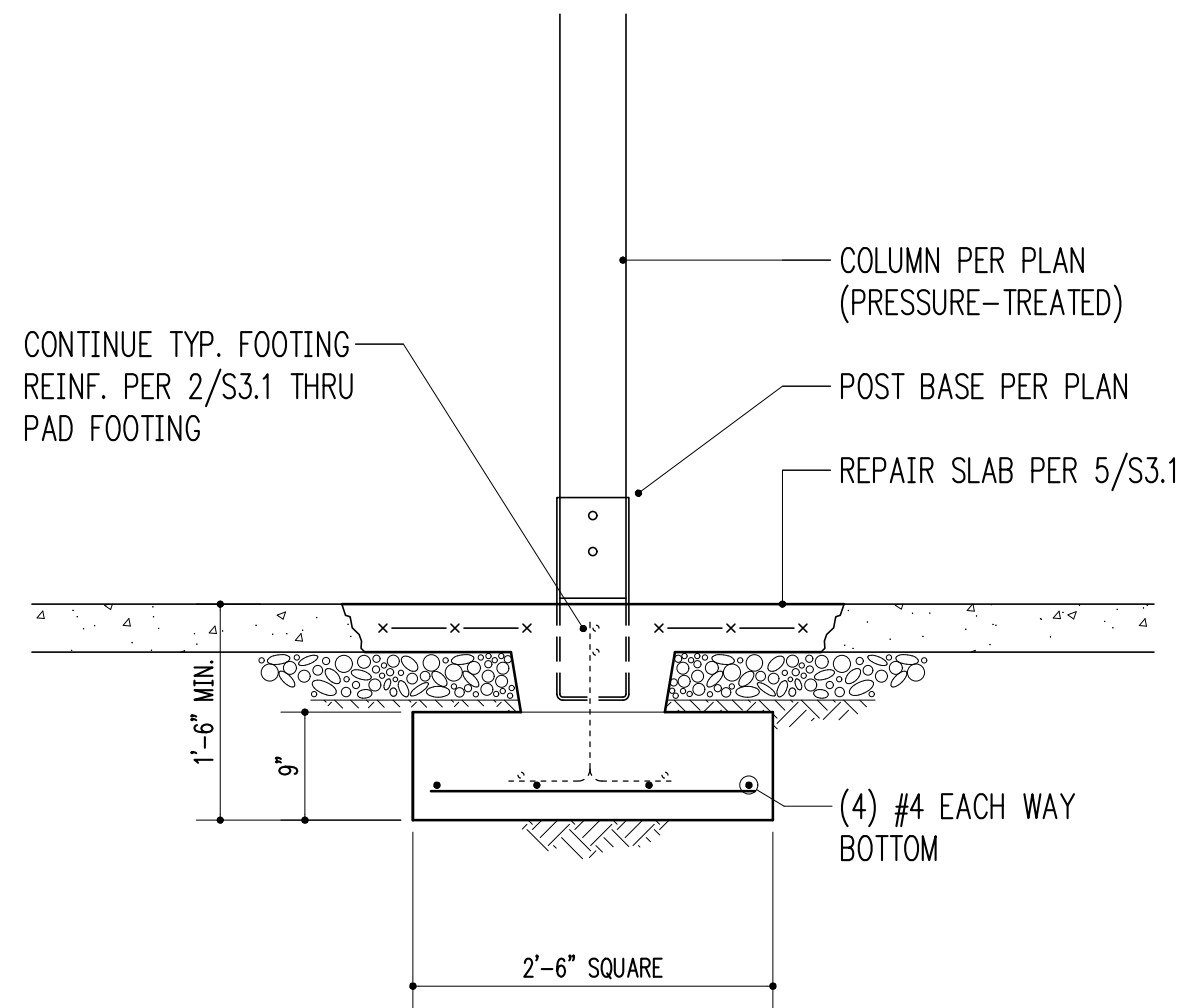


3/4" = 1'-0" 1

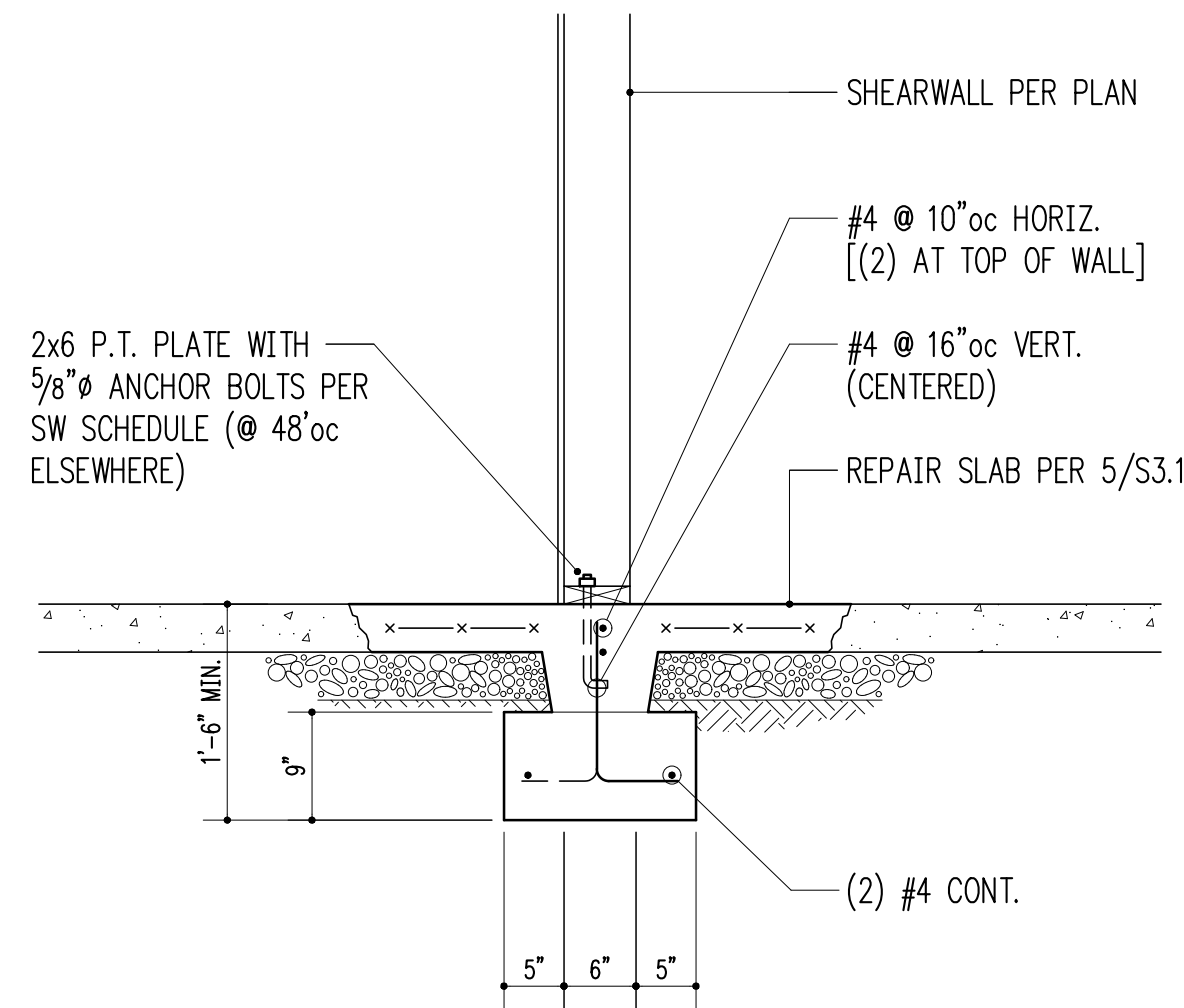


3/4" = 1'-0" 2

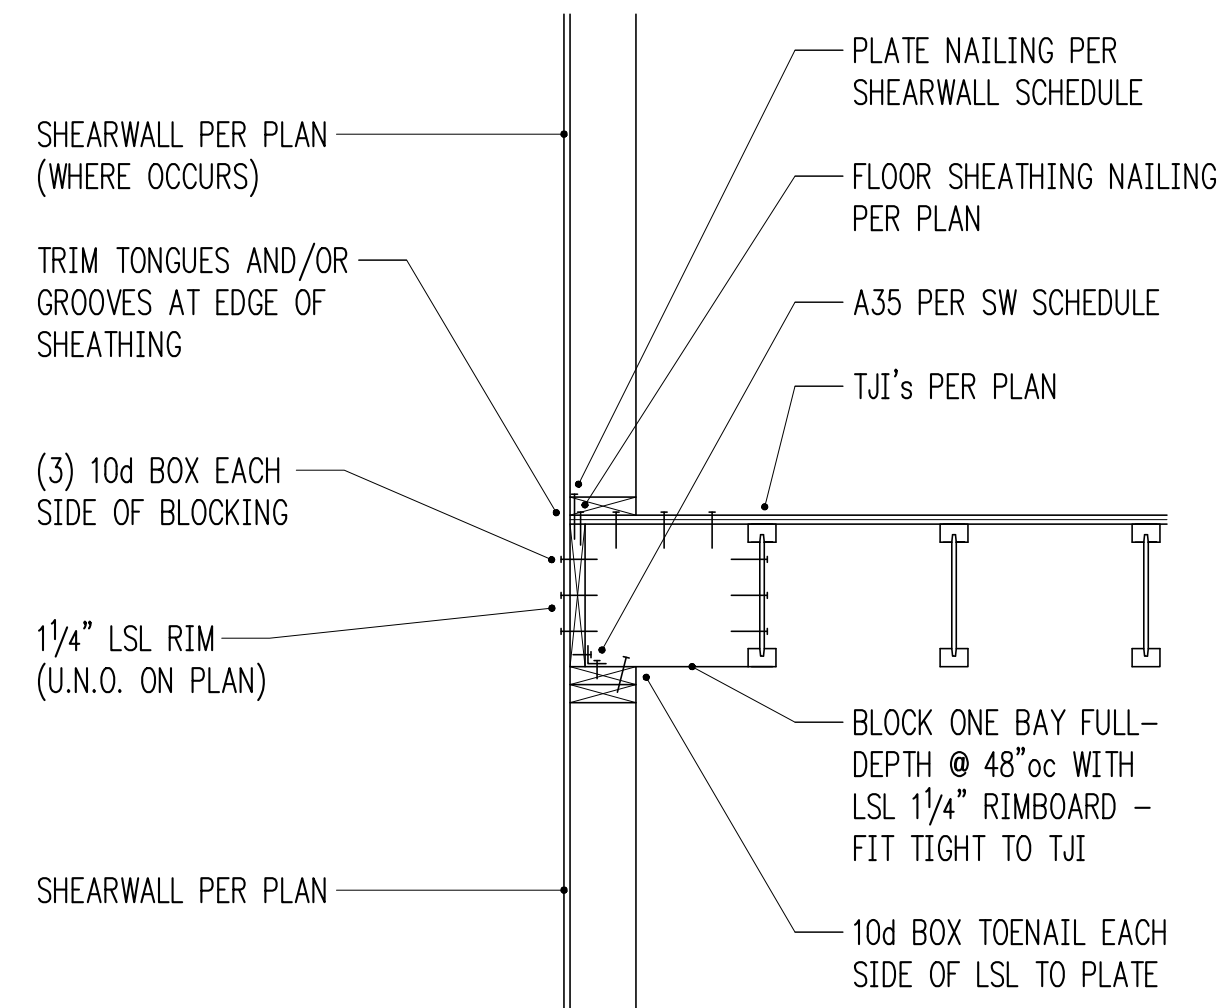


3/4" = 1'-0" 3

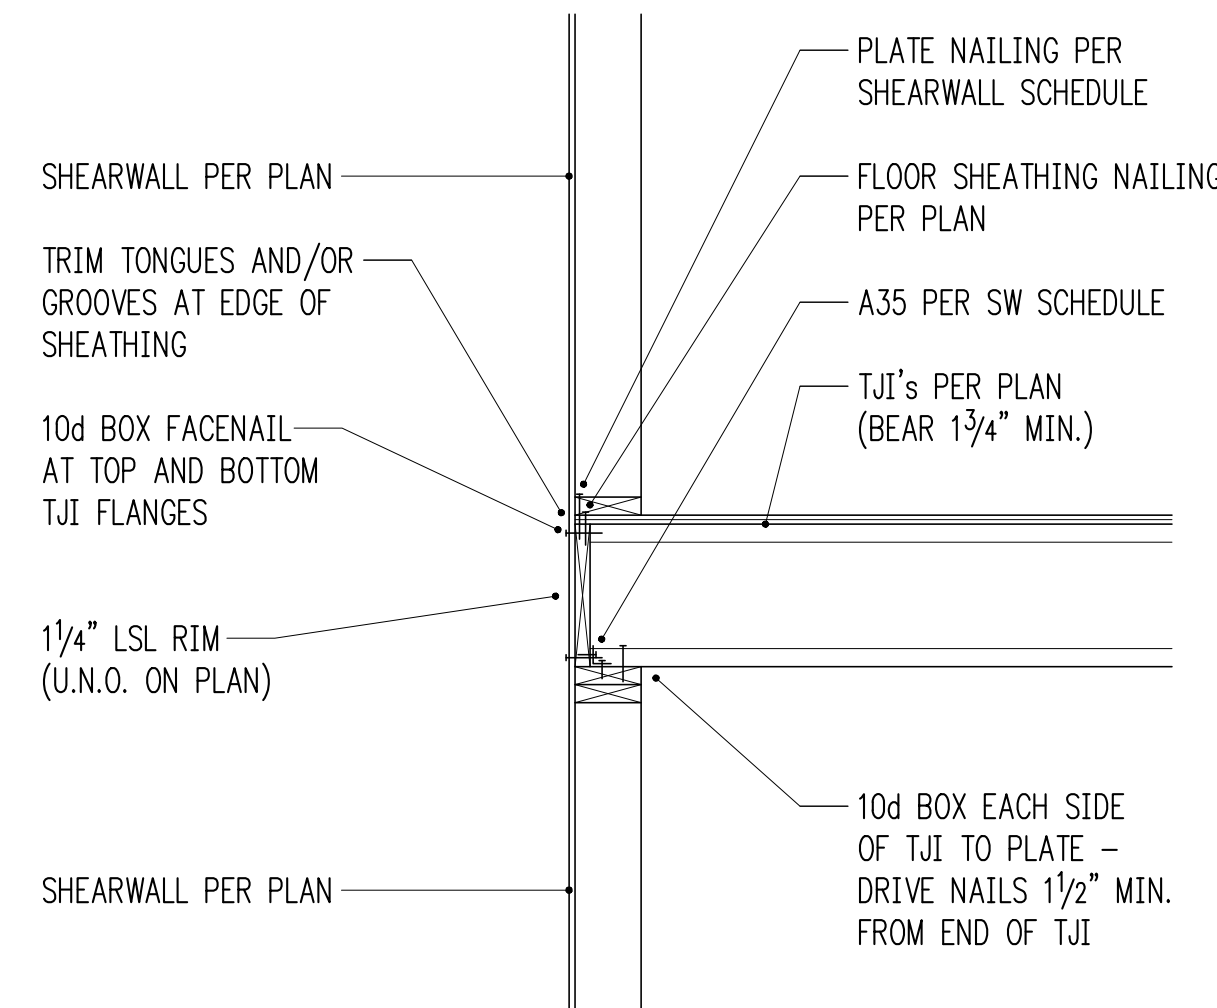


3/4" = 1'-0" 4

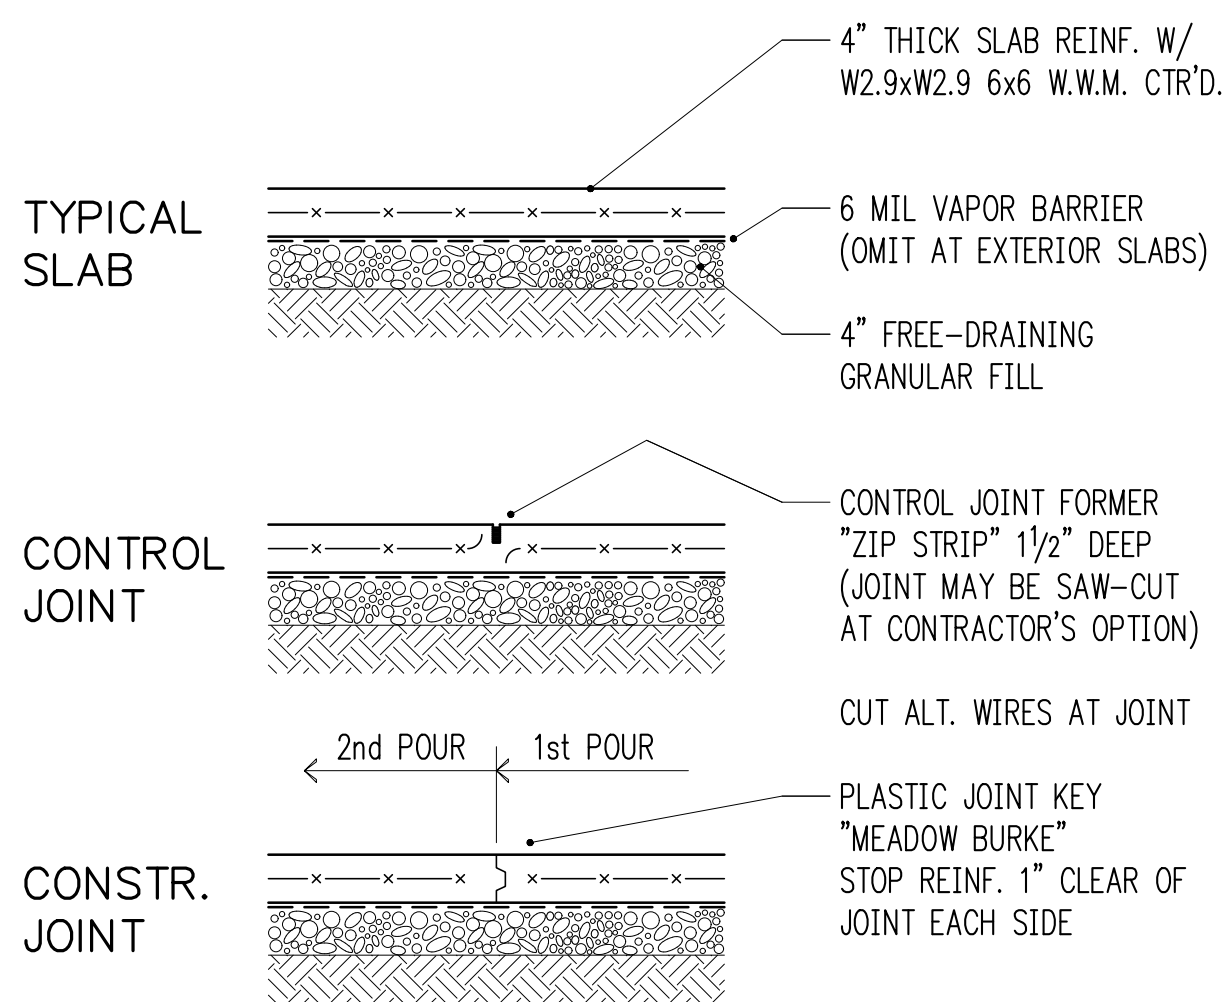


SLAB-ON-GRADE (NOT INSULATED)
3/4" = 1'-0" 5

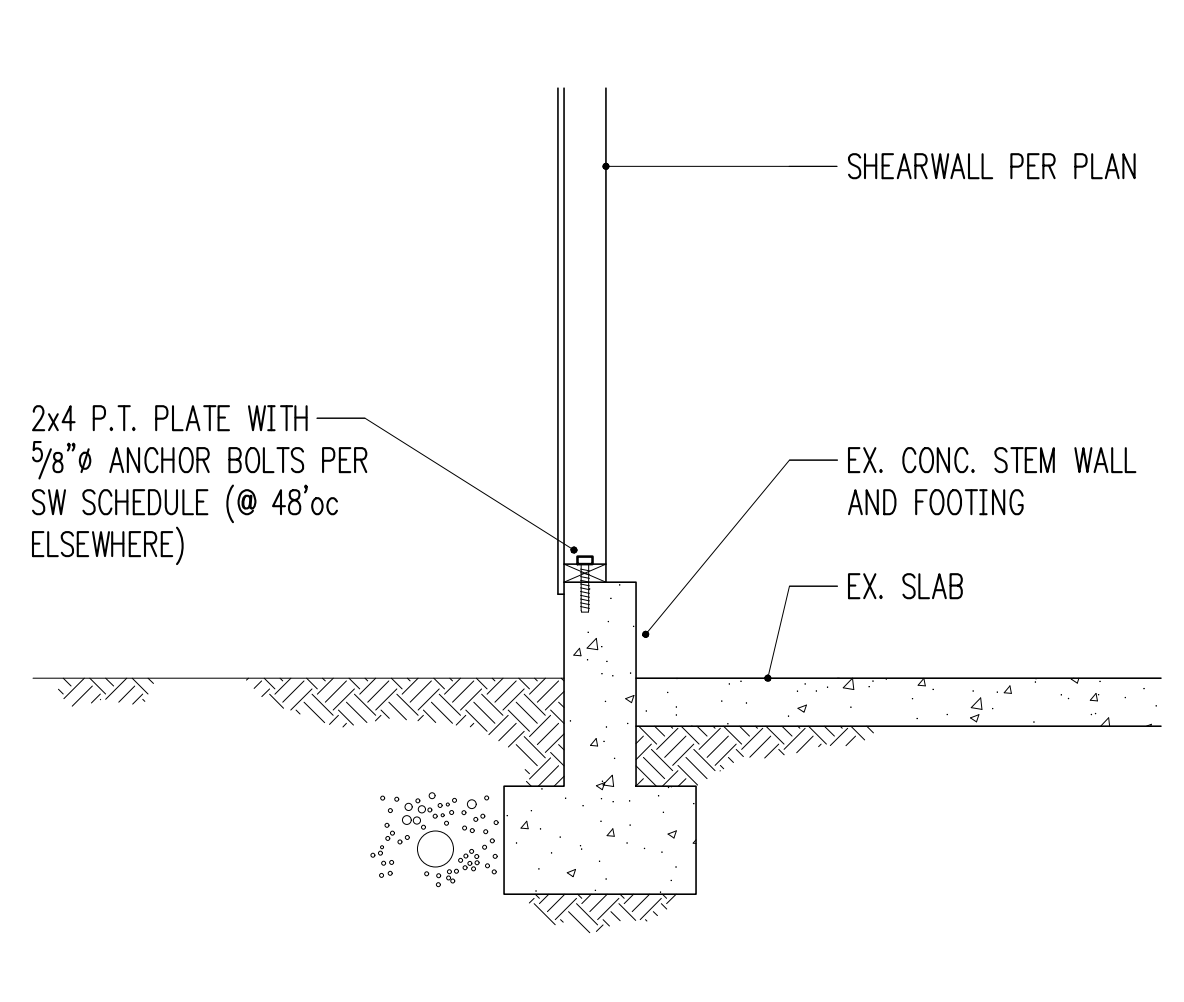


3/4" = 1'-0" 6

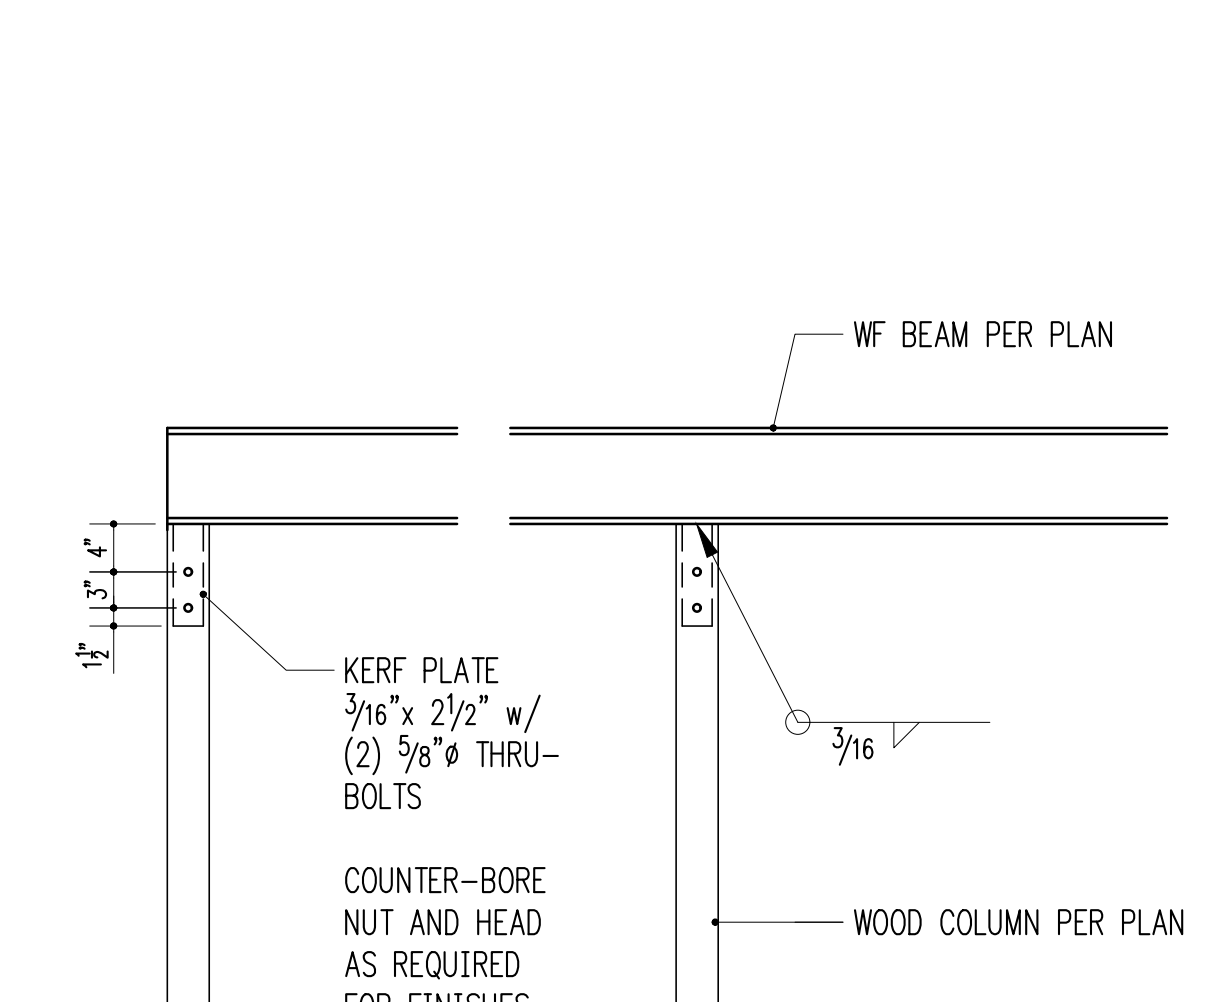


WF BEAM BEARING ON WOOD COLUMN (KERF)
3/4" = 1'-0" 7

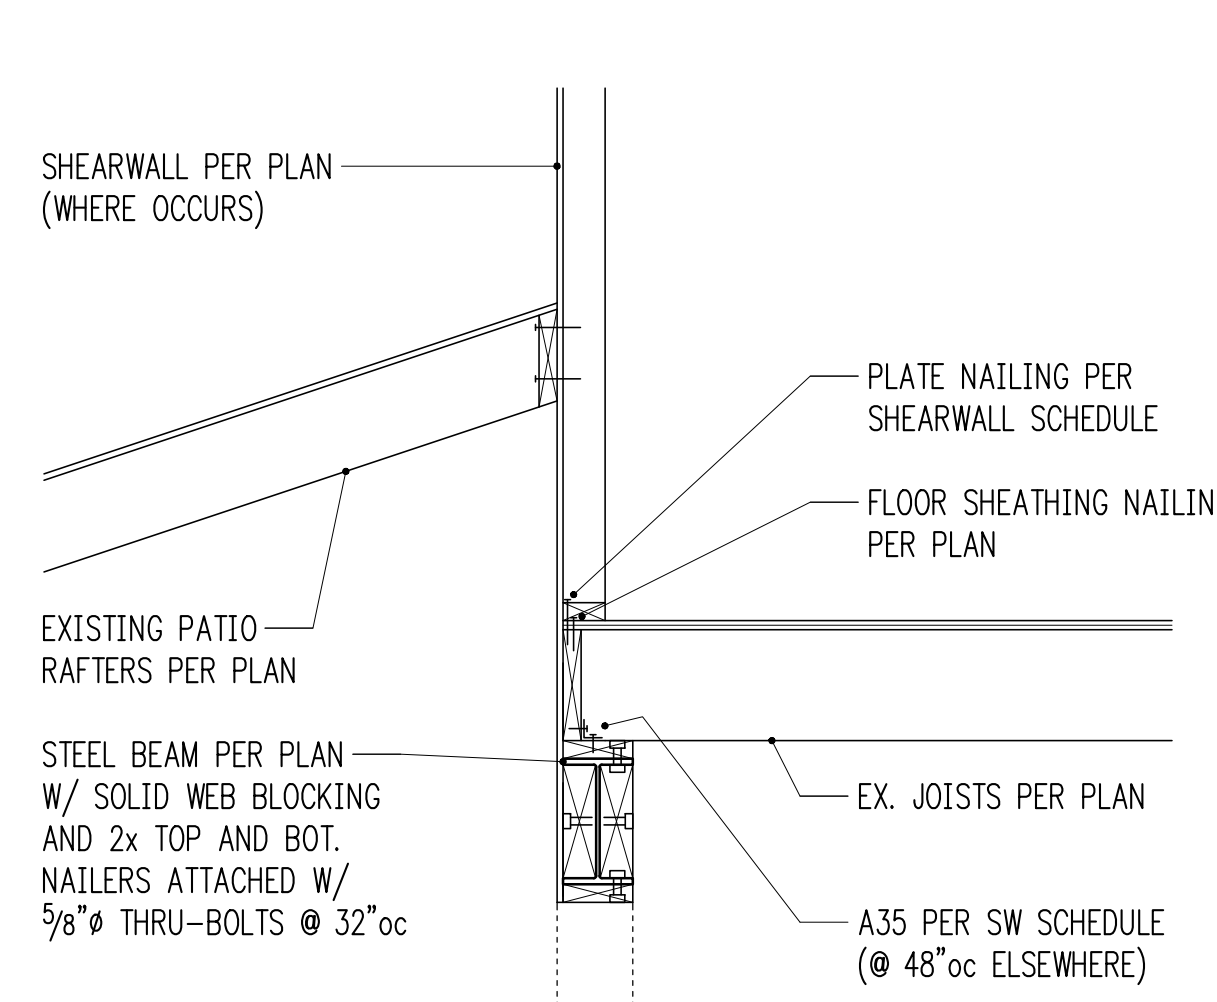


3/4" = 1'-0" 8

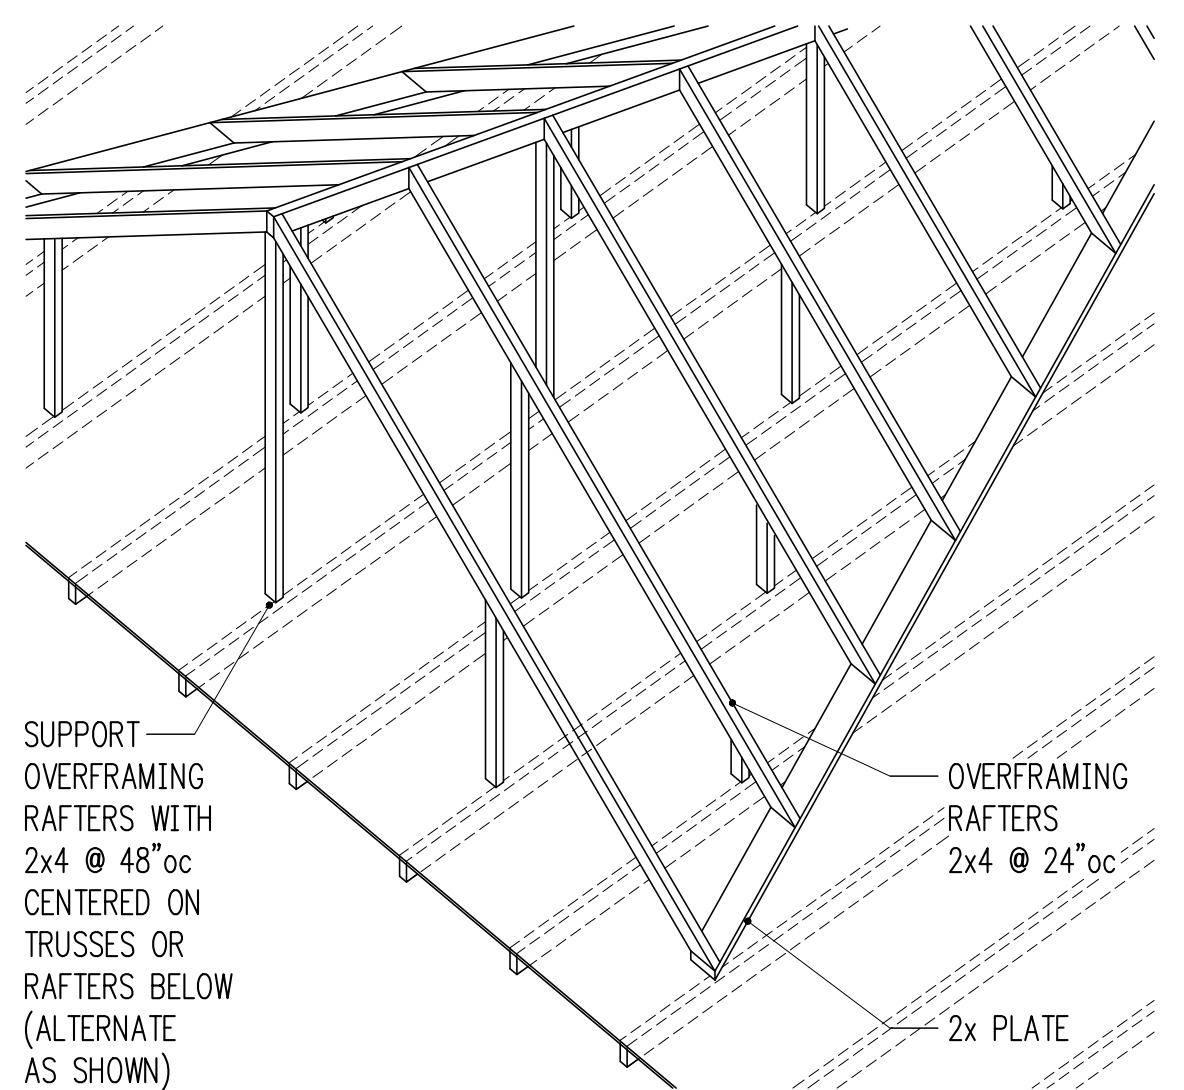


3/8" = 1'-0" 9

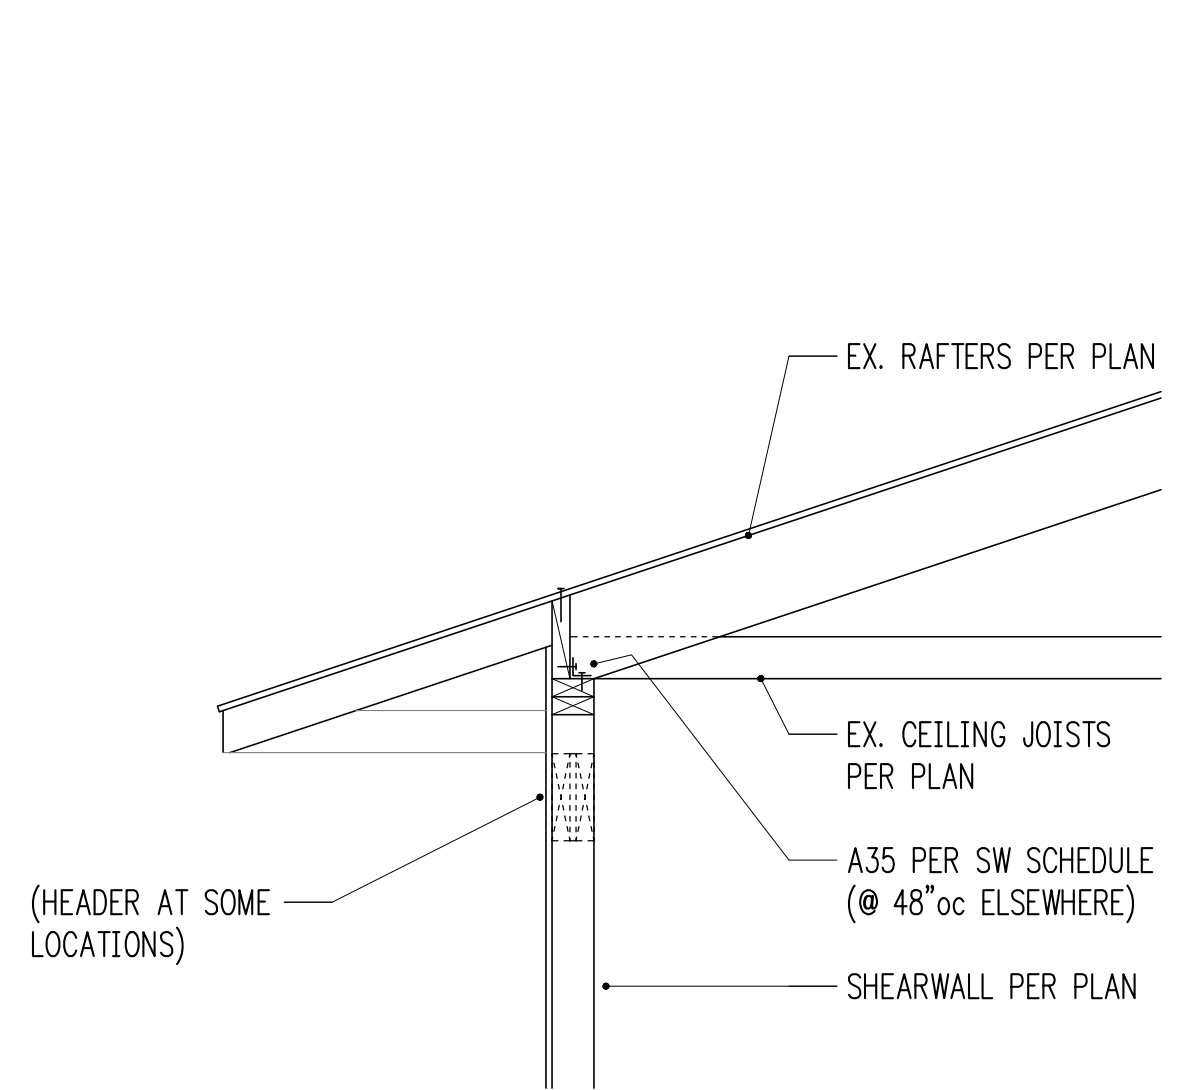

3/4" = 1'-0" 10

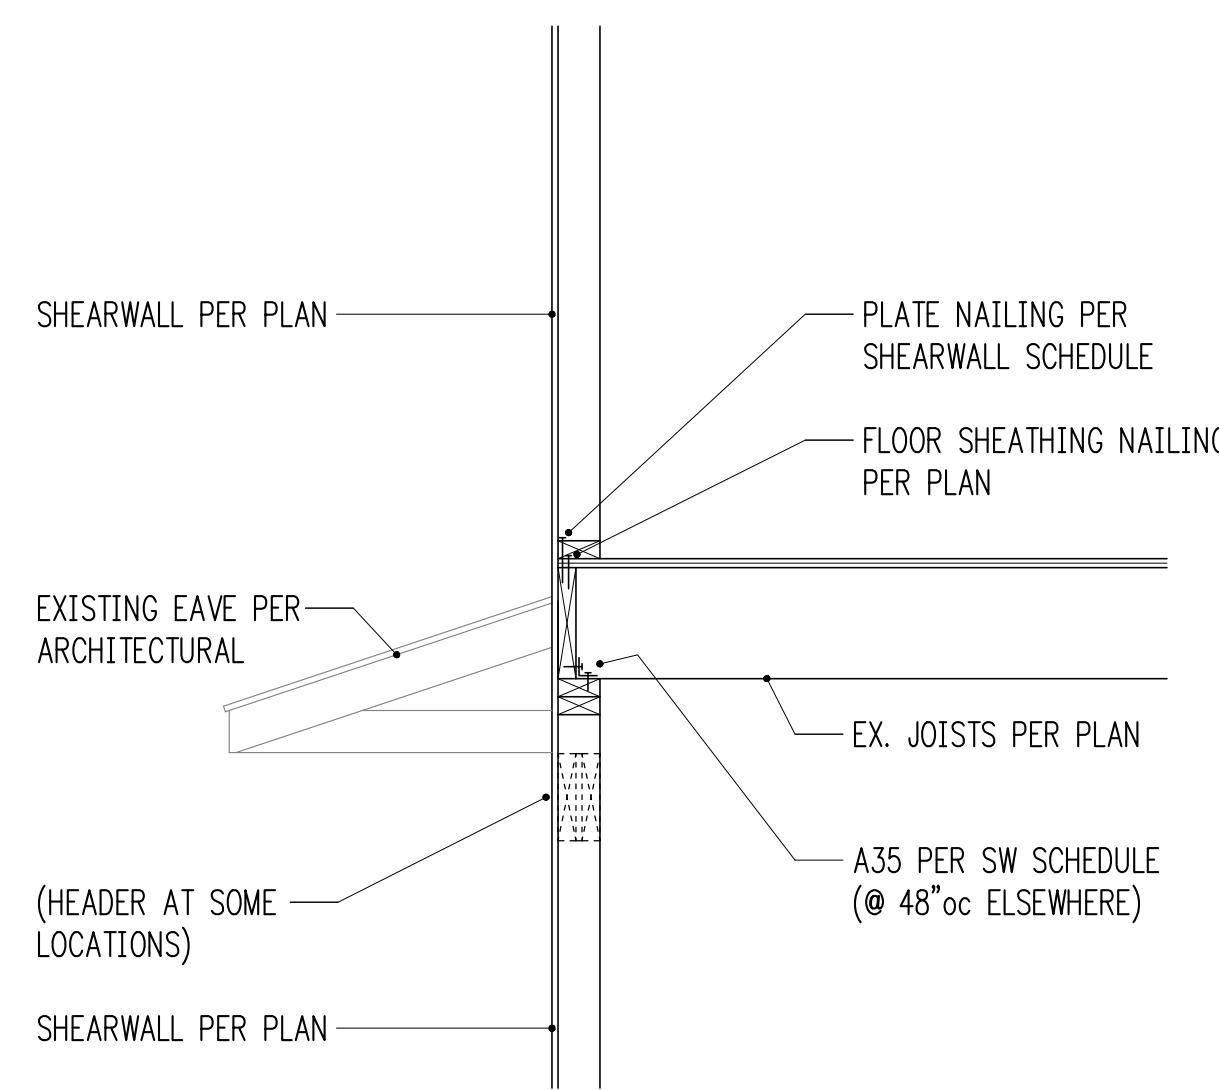


3/4" = 1'-0" 11

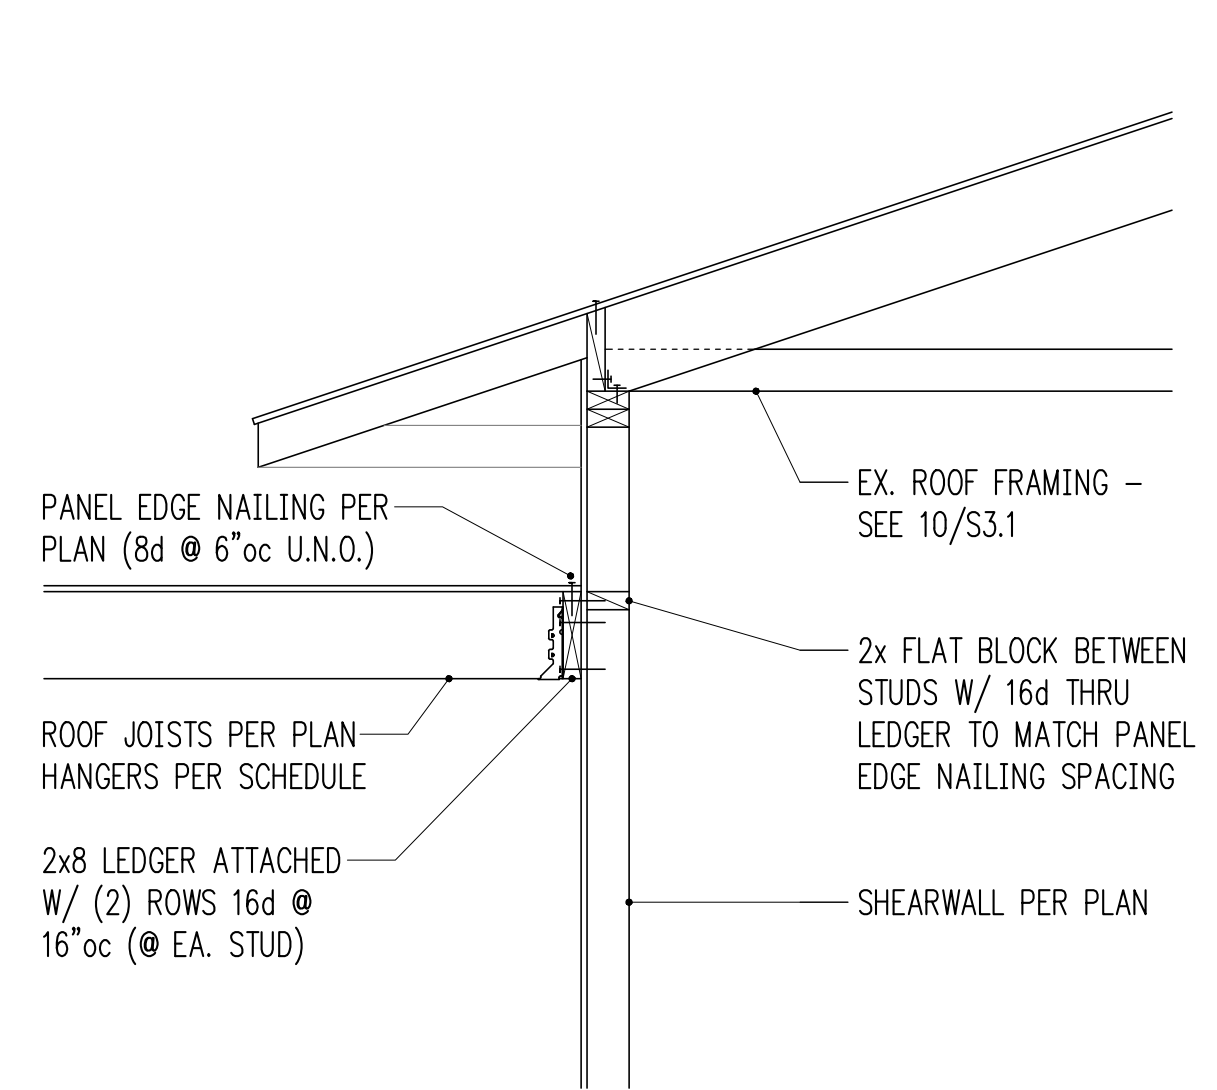

3/4" = 1'-0" 12

HV

Harriott Valentine Engineers Inc.
1932 First Avenue, Suite 720
Seattle, Washington 98101-2447
tel 206 624 4760 fax 206 447 6971
www.harriottvalentine.com

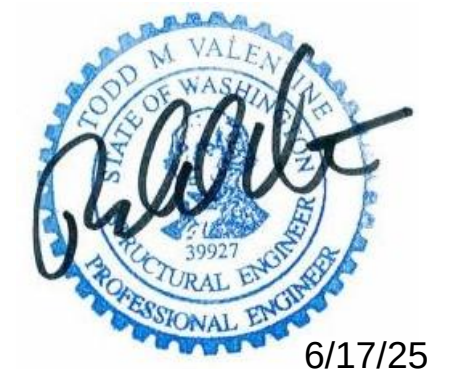


Project Contact
Henry Nuckles
tel 206 413 6664
hnuckles@harriottvalentine.com

Project Architect
JML Architects
Mercer Island, 98040

Project
Rosenwald Residence
4836 E Mercer Way
Mercer Island, WA 98040

Issue Date	Issue Description
06/27/25	Permit Submittal

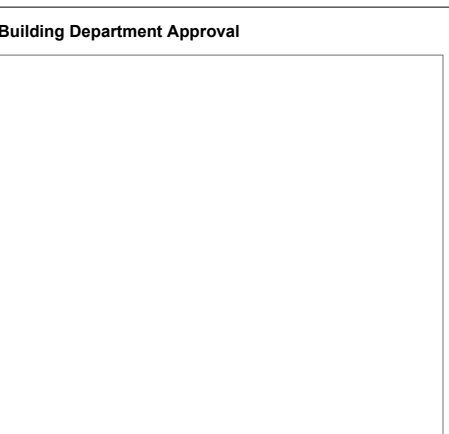


Drawing Title
STRUCTURAL DETAILS


Drawing Number

S3.1


ROSENWALD RESIDENCE

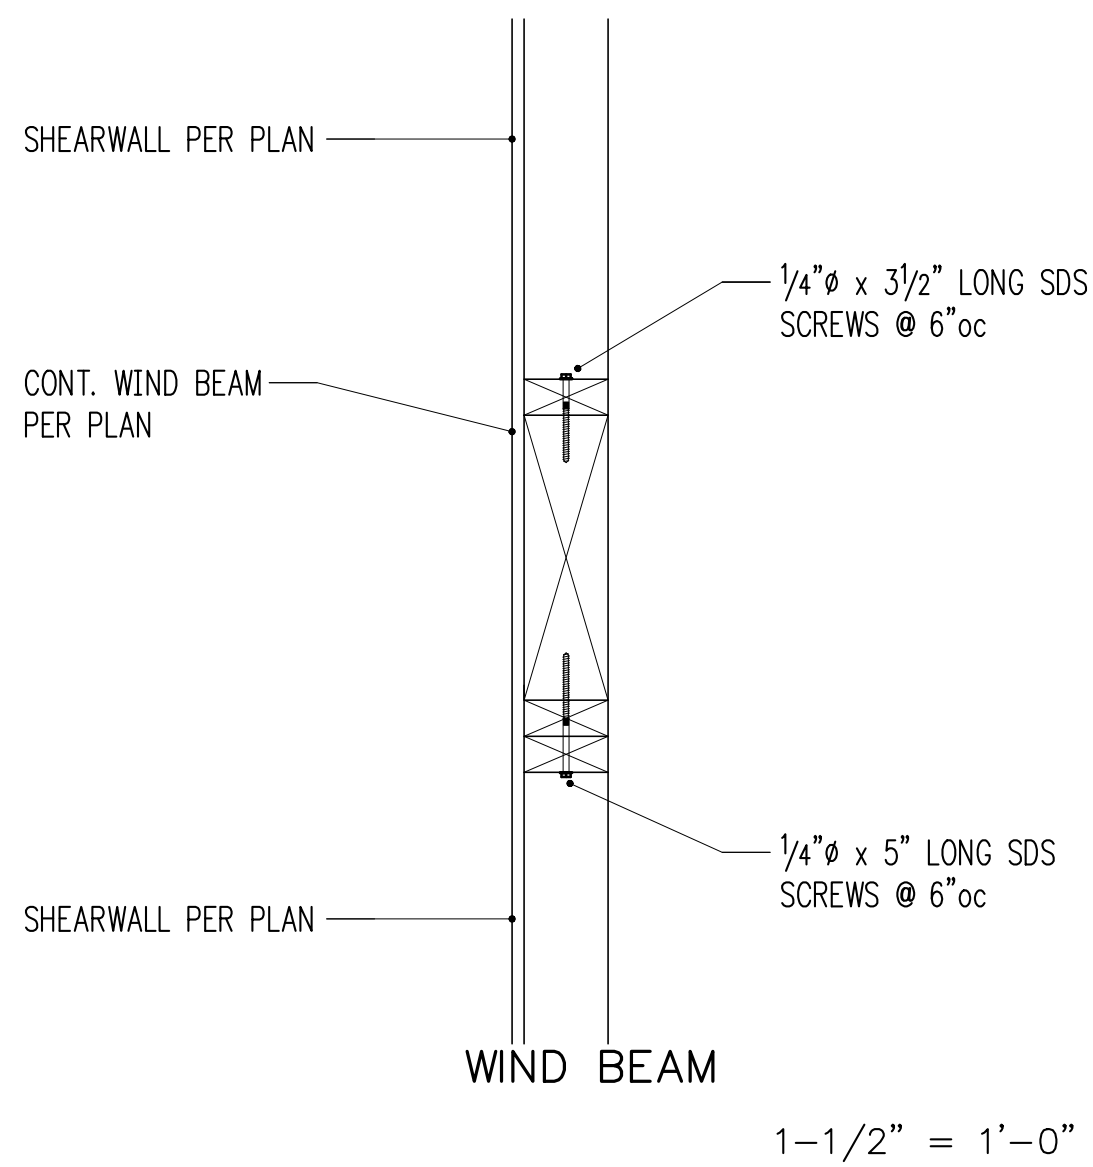


1-1/2" = 1'-0" 1

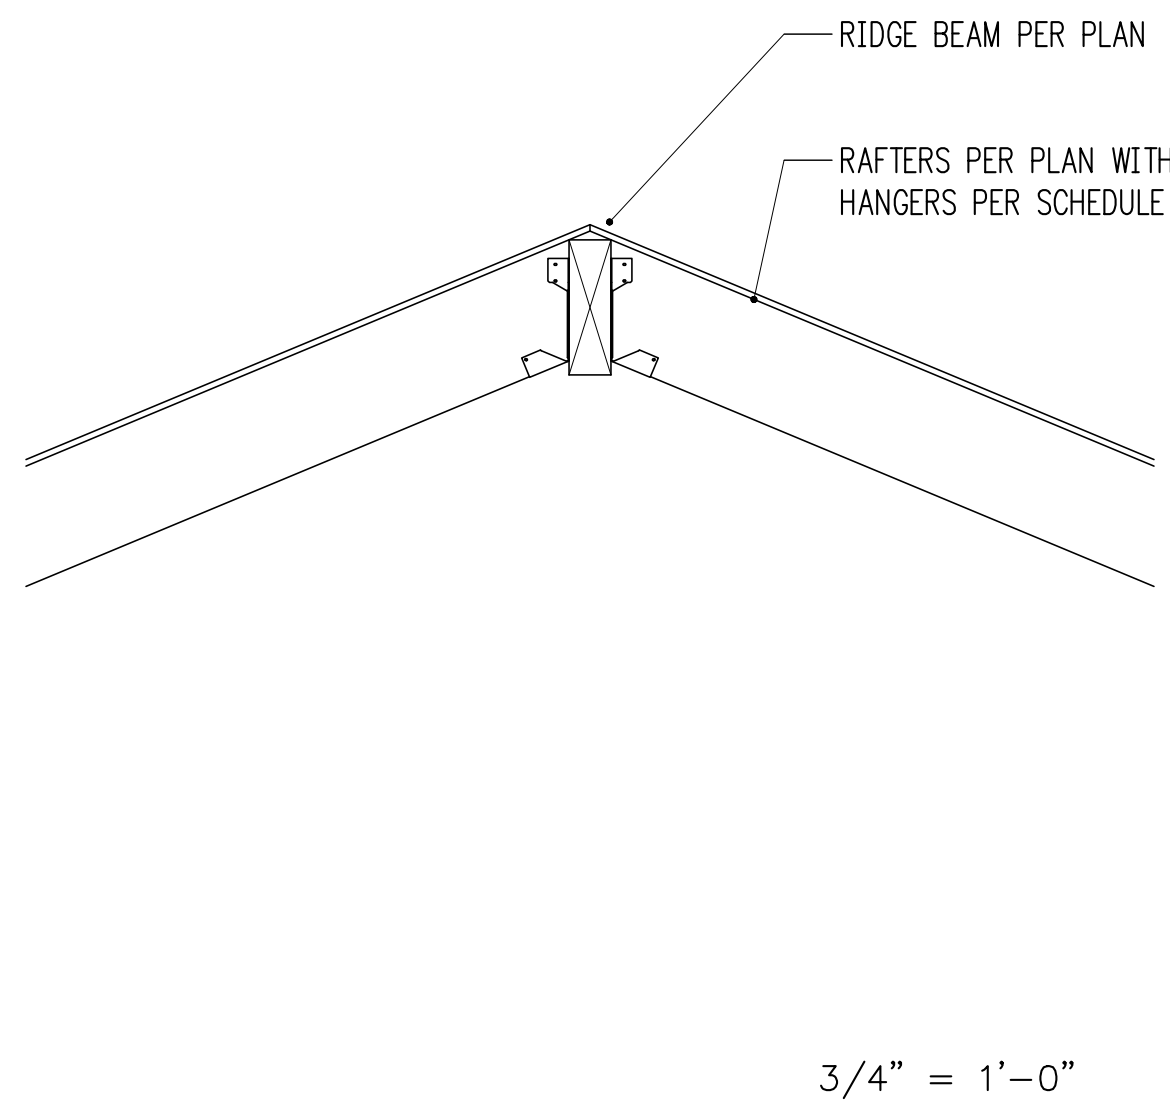


3/4" = 1'-0" 2

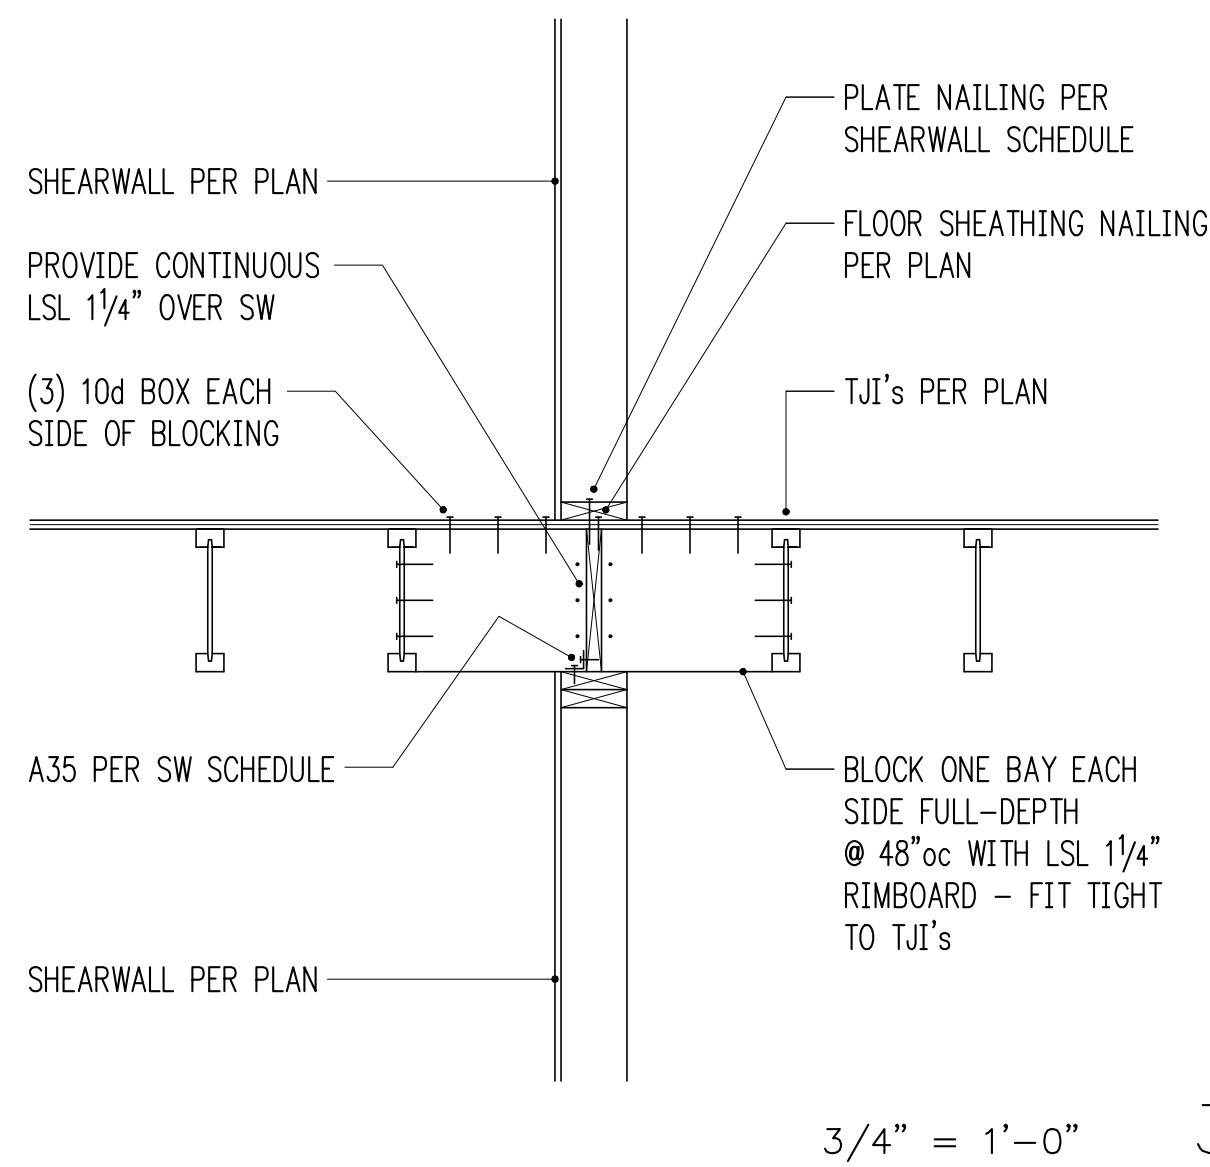


3/4" = 1'-0" 3

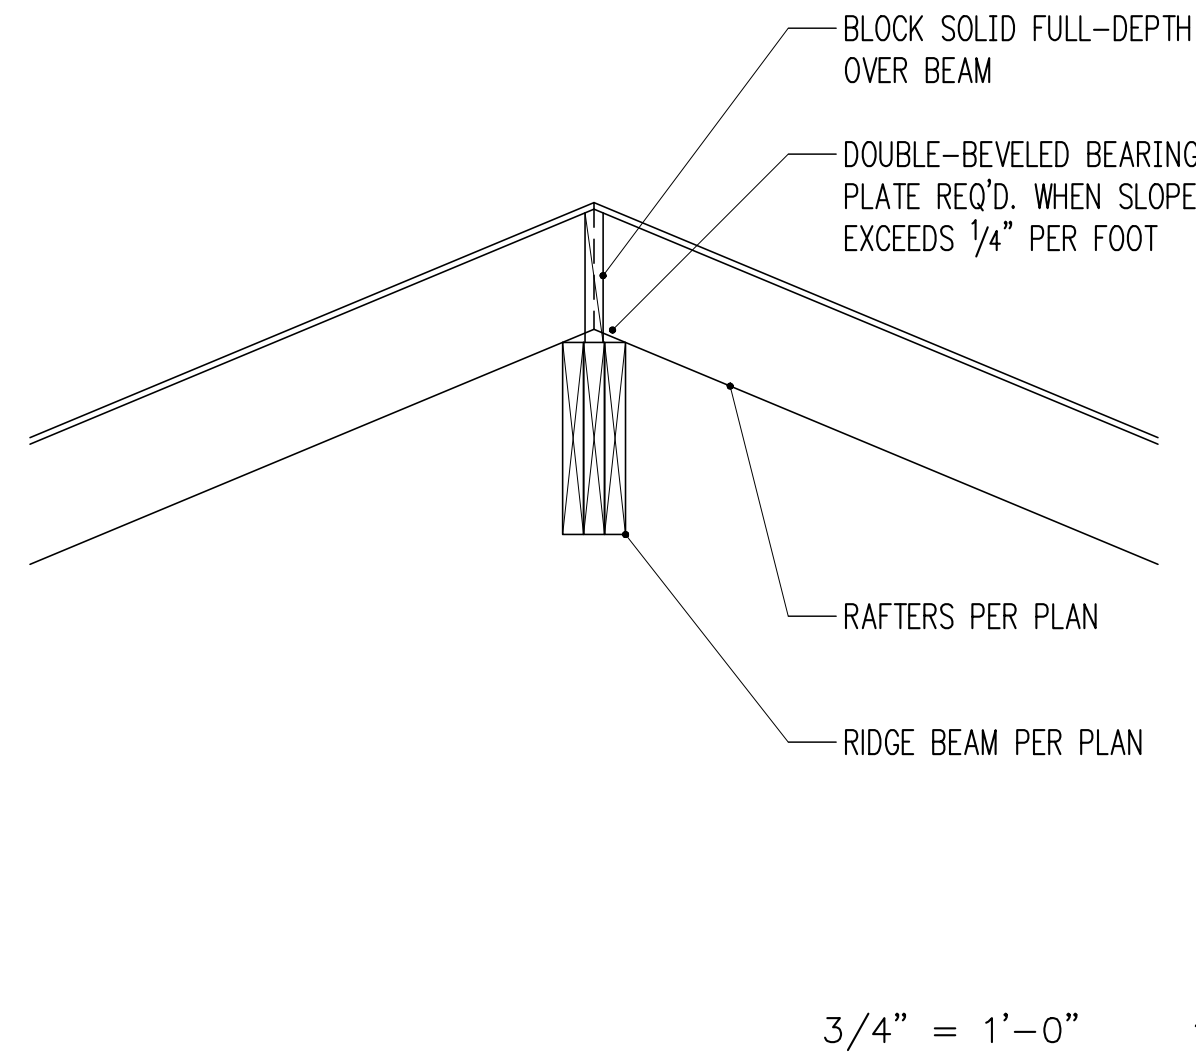


3/4" = 1'-0" 4

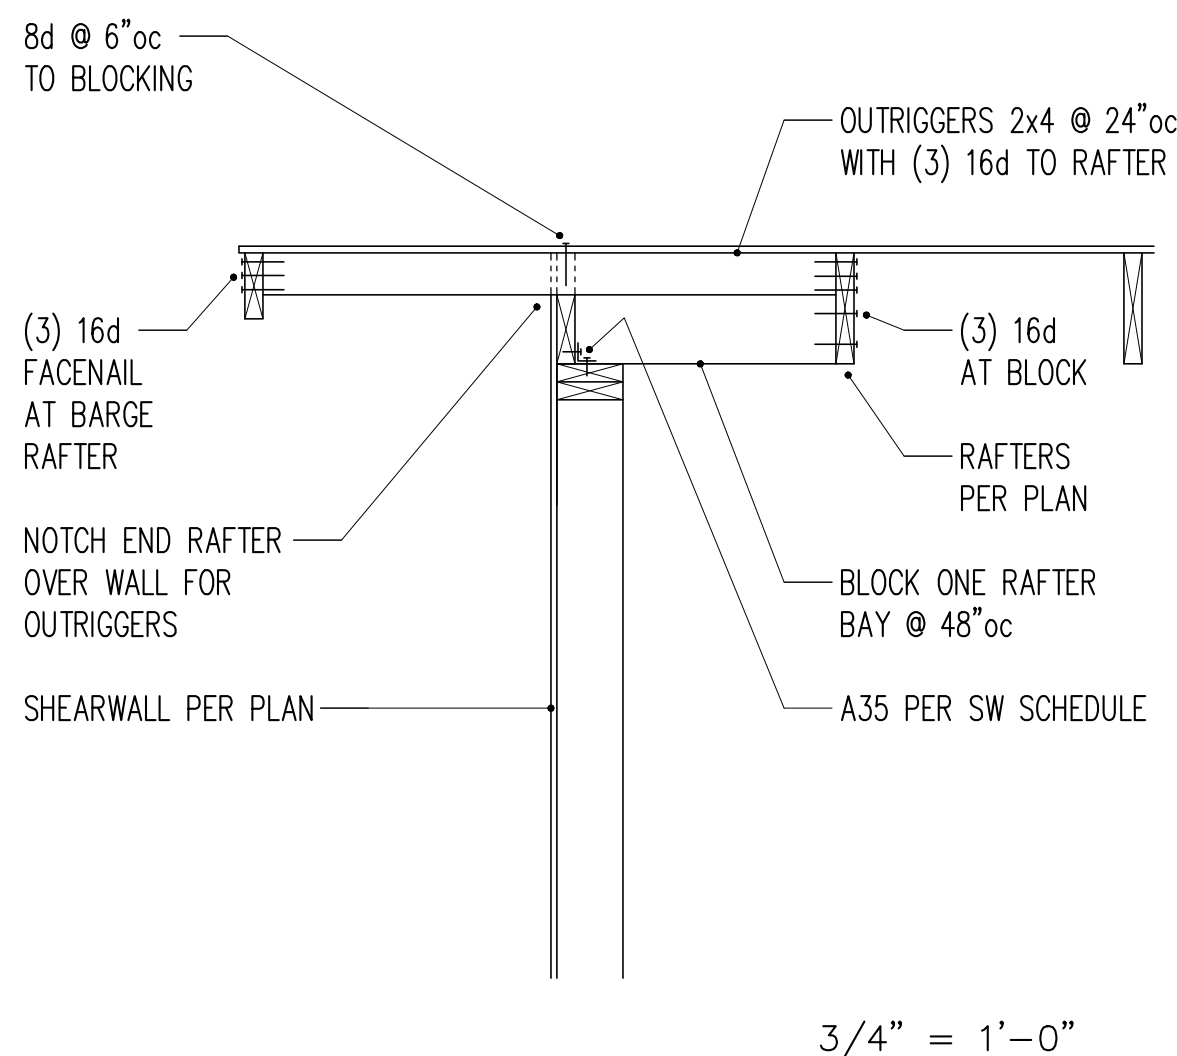

3/4" = 1'-0" 5

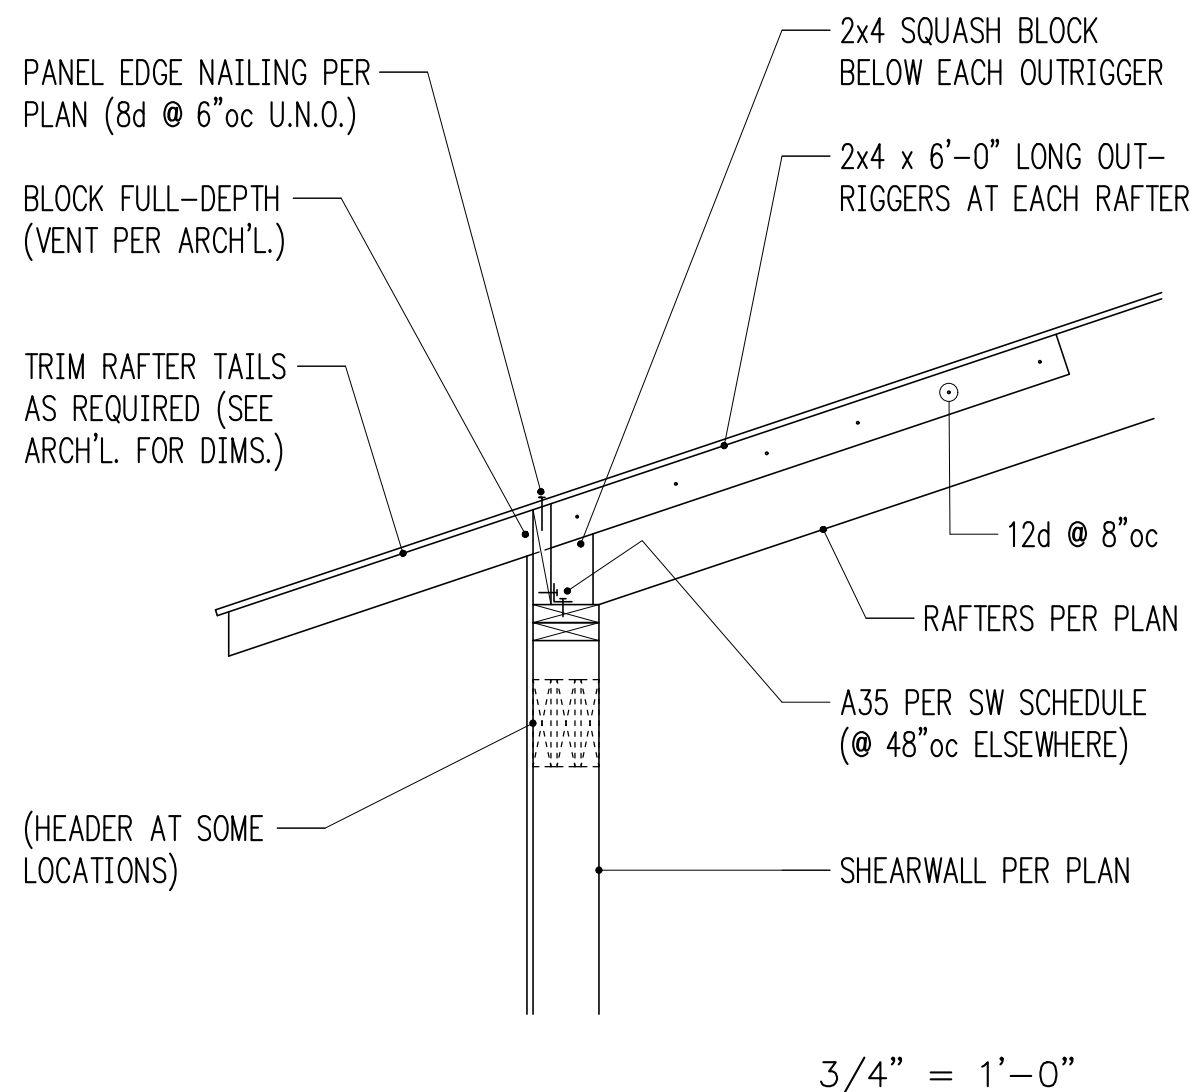

3/4" = 1'-0" 6

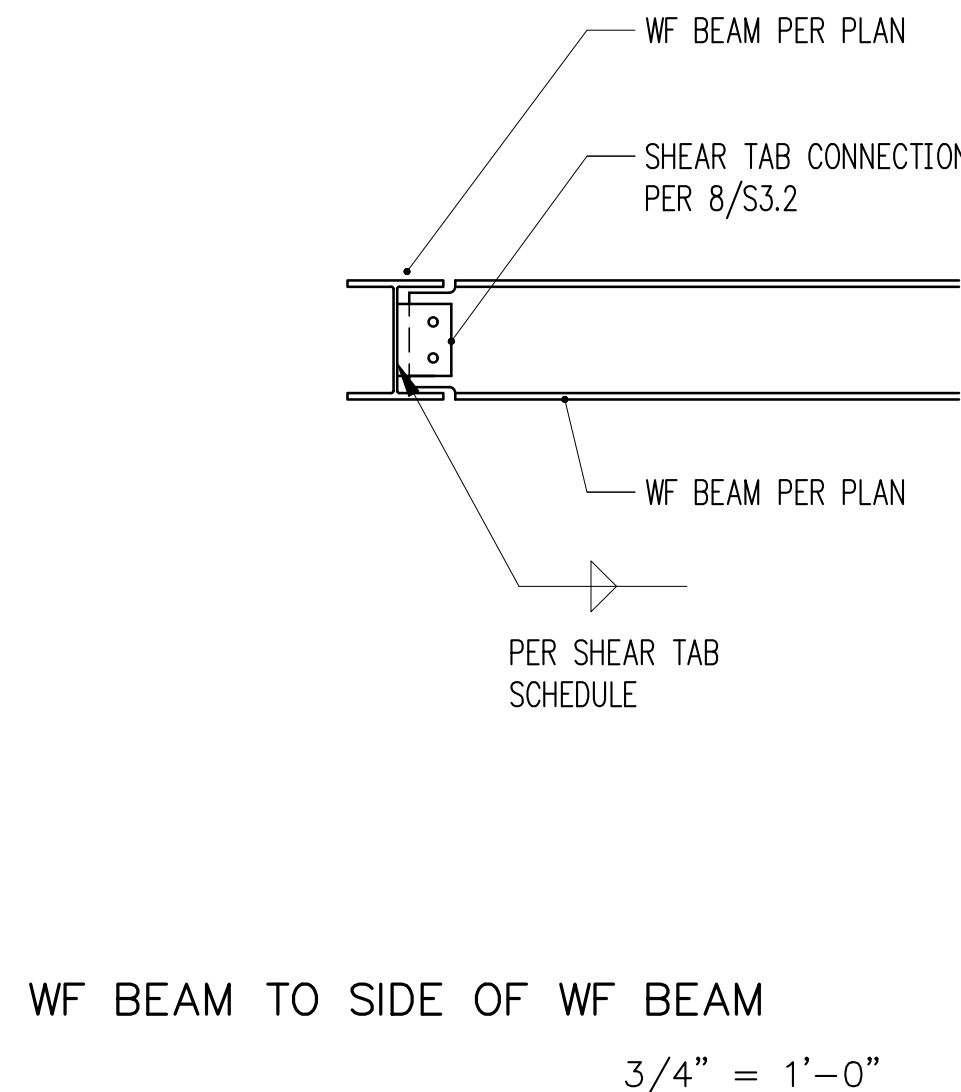


WF BEAM TO SIDE OF WF BEAM
3/4" = 1'-0" 7


SHEAR TAB SCHEDULE

BEAM SIZE	# BOLTS	BOLT SIZE	PL THICK.	WELD SIZE	CAPACITY
W10	(2)	3/4"Ø	1/4"	3/16"	16,300 lb


BOLT TYPE SHALL BE A325N. PLATE MATERIAL SHALL BE A36.

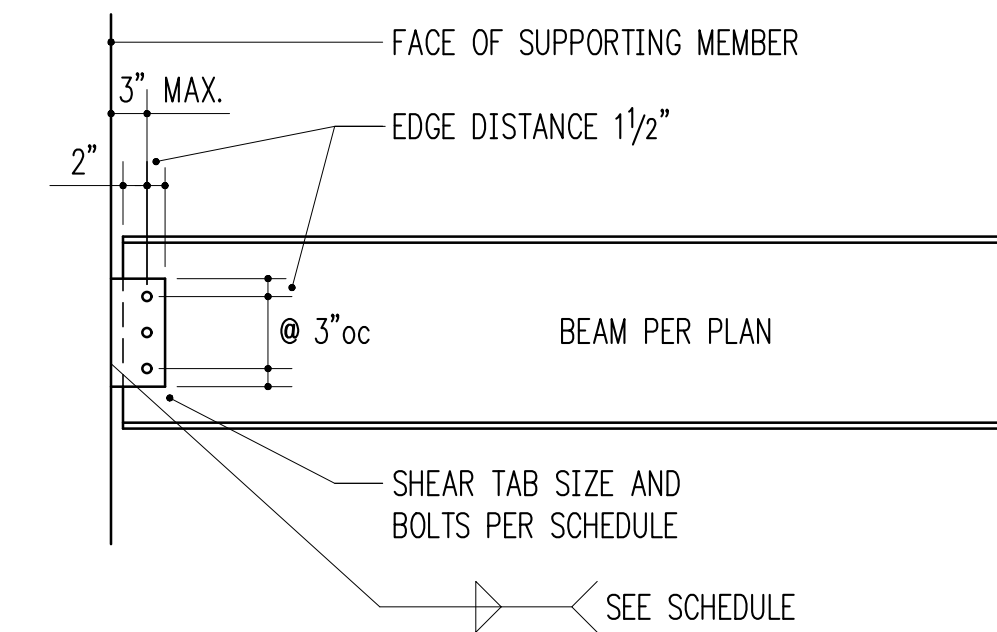


TYPICAL SHEAR TAB CONNECTION
3/4" = 1'-0" 8

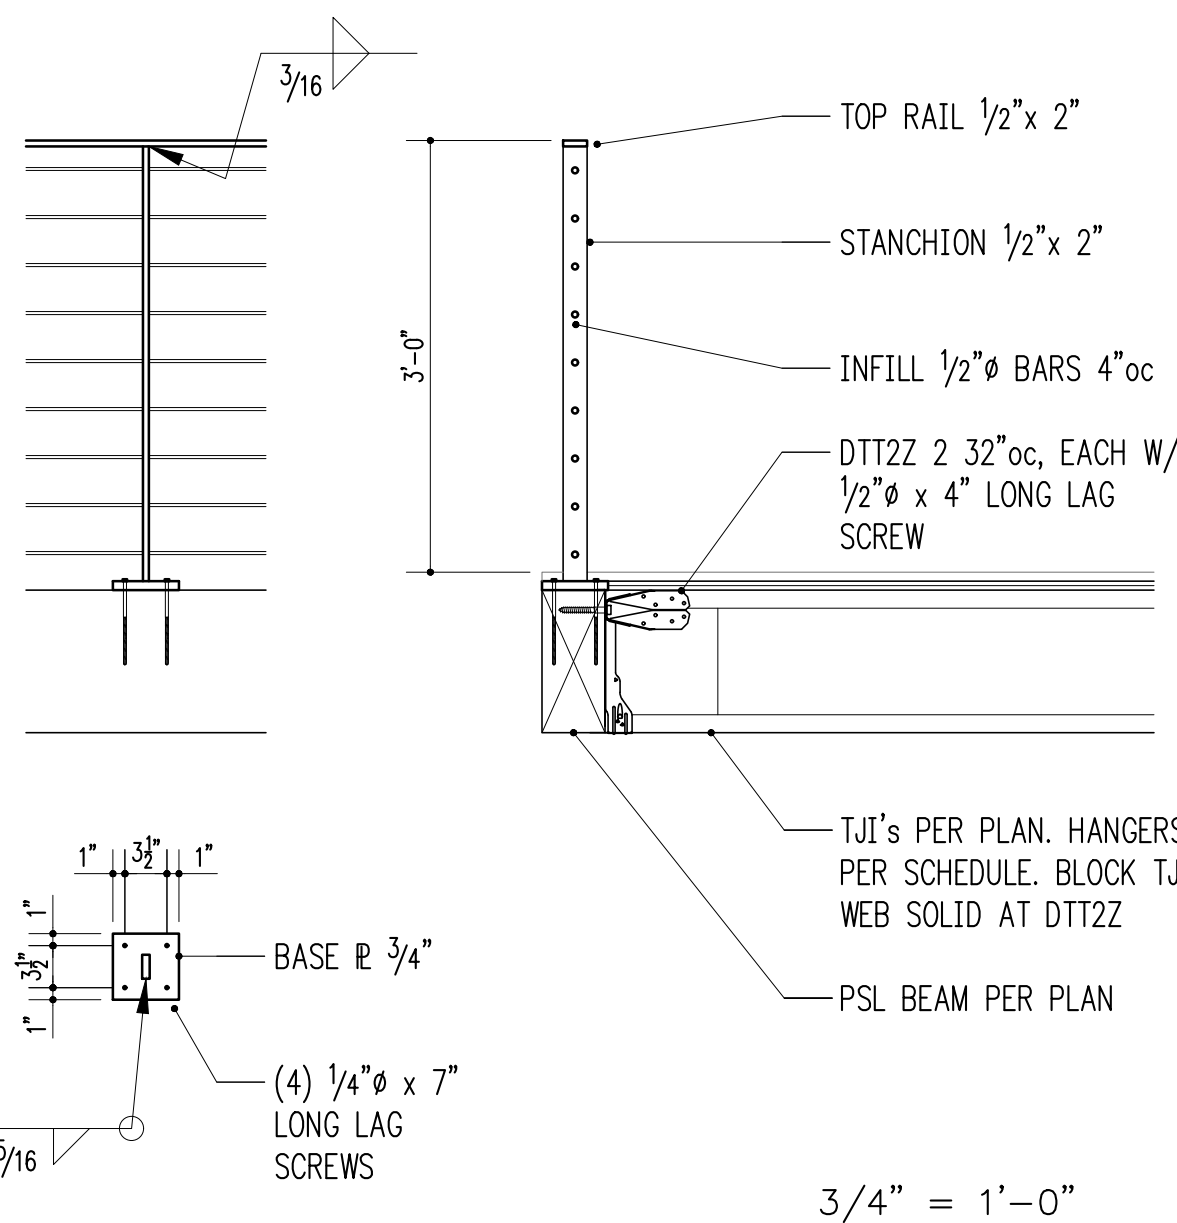


3/4" = 1'-0" 9

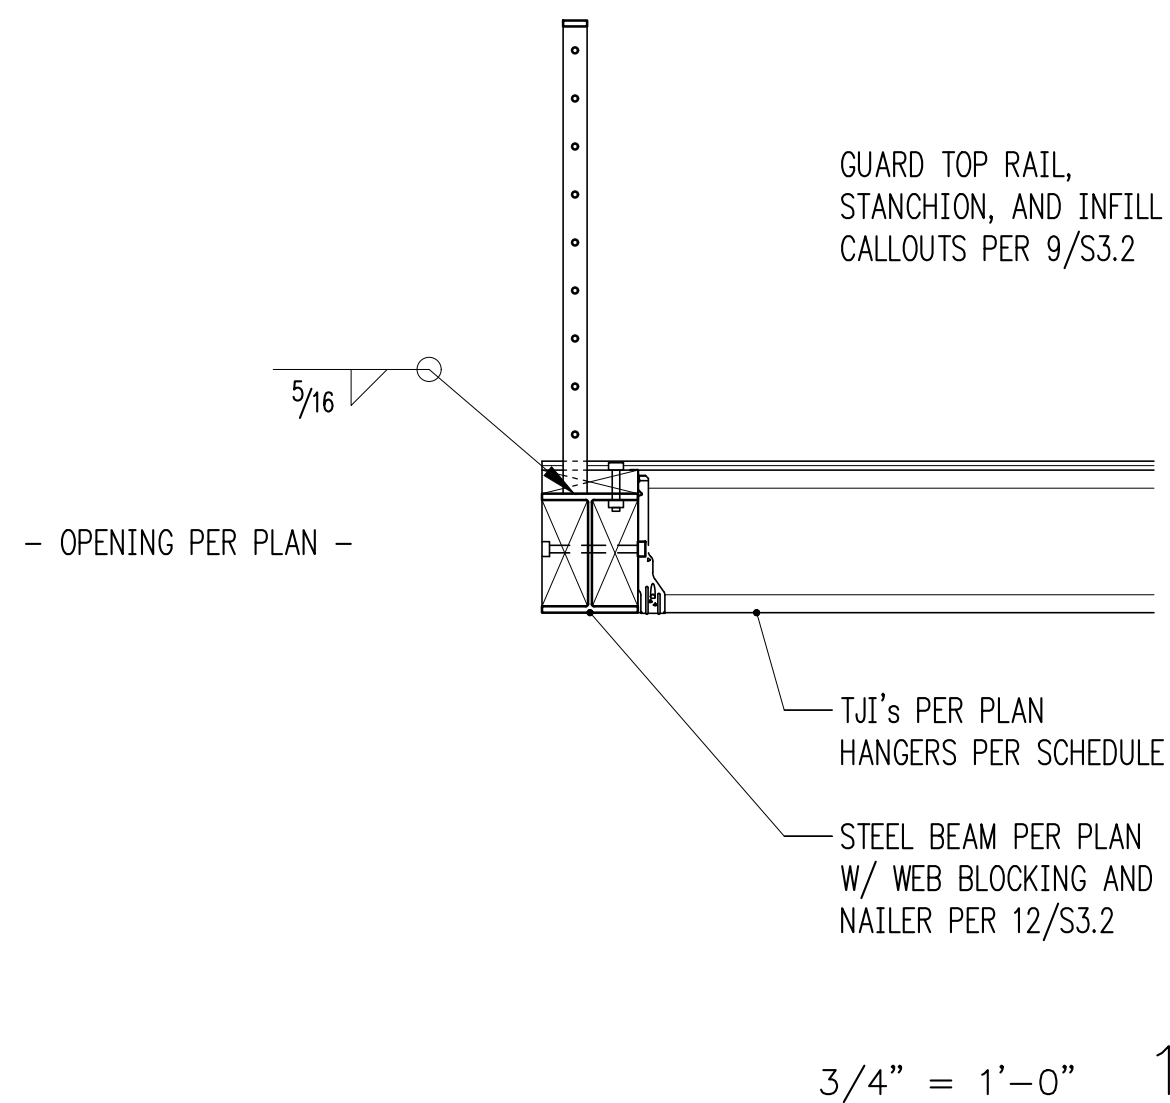

3/4" = 1'-0" 10

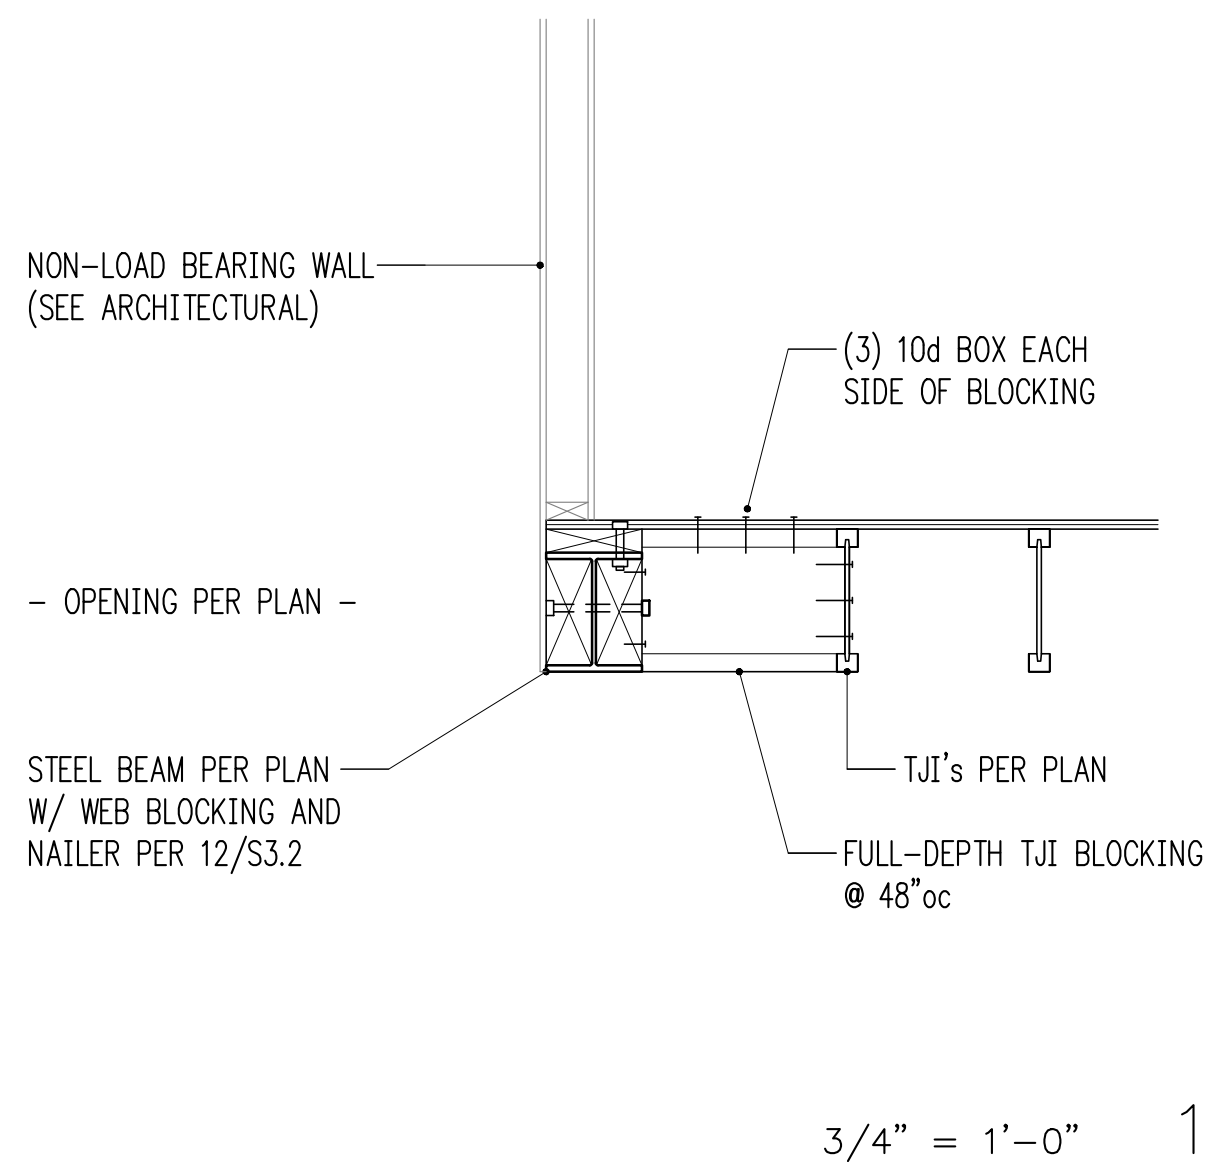

3/4" = 1'-0" 11

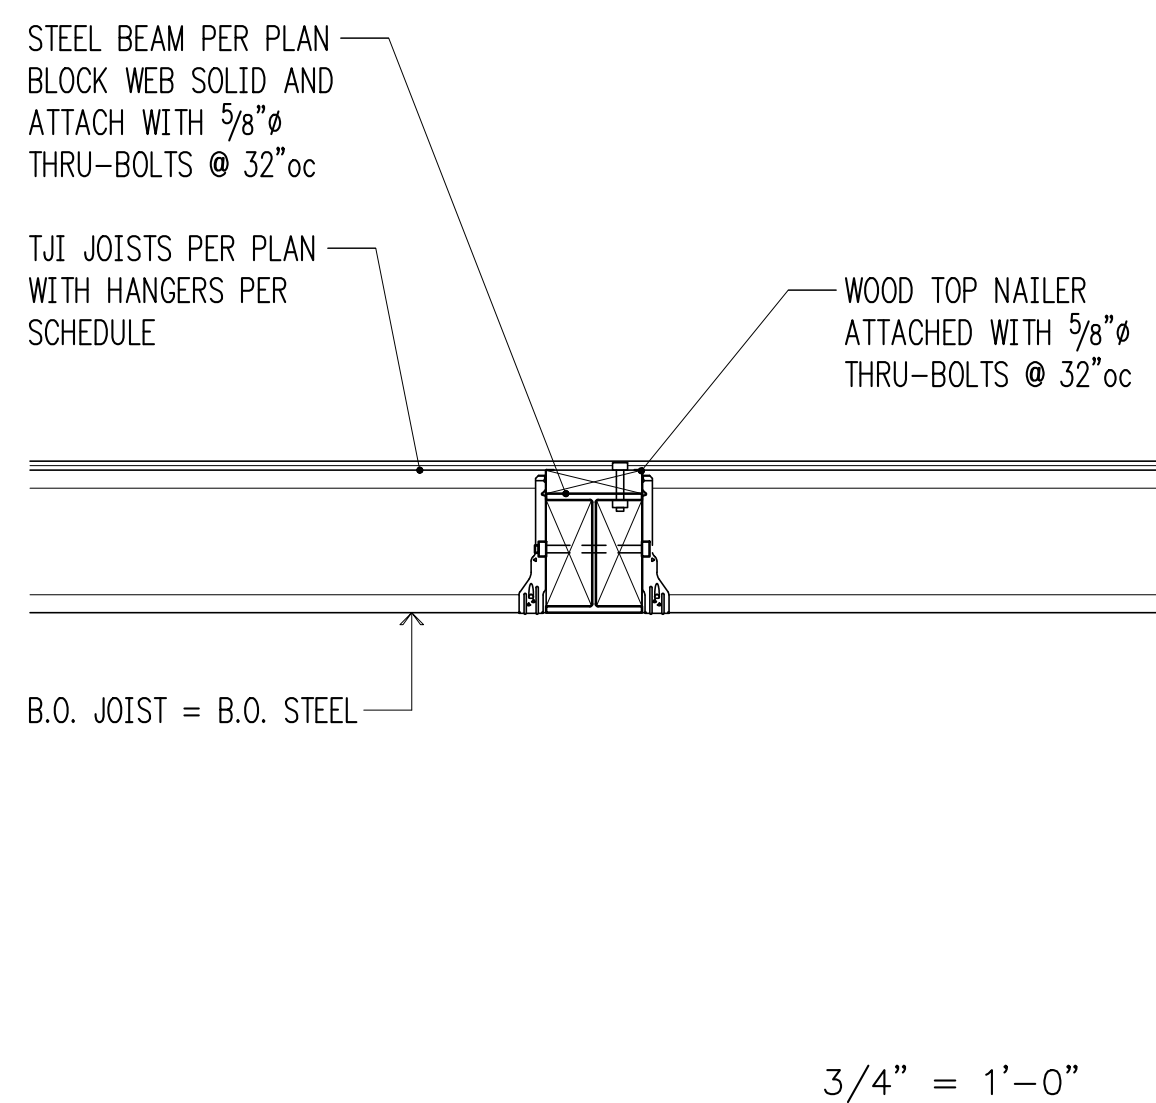

3/4" = 1'-0" 12

HV

Harriott Valentine Engineers Inc.
1932 First Avenue, Suite 720
Seattle, Washington 98101-2447
tel 206 624 4760 fax 206 447 6971
www.harriottvalentine.com



6/17/25

Project Contact
Henry Nuckles
tel 206 413 6664
hnuckles@harriottvalentine.com

Project Architect
JML Architects
Mercer Island, 98040

Project
Rosenwald Residence
4836 E Mercer Way
Mercer Island, WA 98040

Issue Date	Issue Description
06/27/25	Permit Submittal

Building Department Approval


Drawing Title
STRUCTURAL DETAILS

Drawing Number

S3.2

ROSENWALD RESIDENCE

Harriott Valentine Engineers Inc.
1932 First Avenue, Suite 720
Seattle, Washington 98101-2447
tel 206 624 4760 fax 206 447 6971
www.harriottvalentine.com



Project Contact
Henry Nuckles
tel 206 413 6664
hnuckles@harriottvalentine.com

Project Architect
JML Architects
Mercer Island, 98040

Project

Rosenwald Residence

4836 E Mercer Way
Mercer Island, WA 98040


[illegible]

Building Department Approval

Drawing Title
STRUCTURAL DETAILS

Drawing Number


S3.3

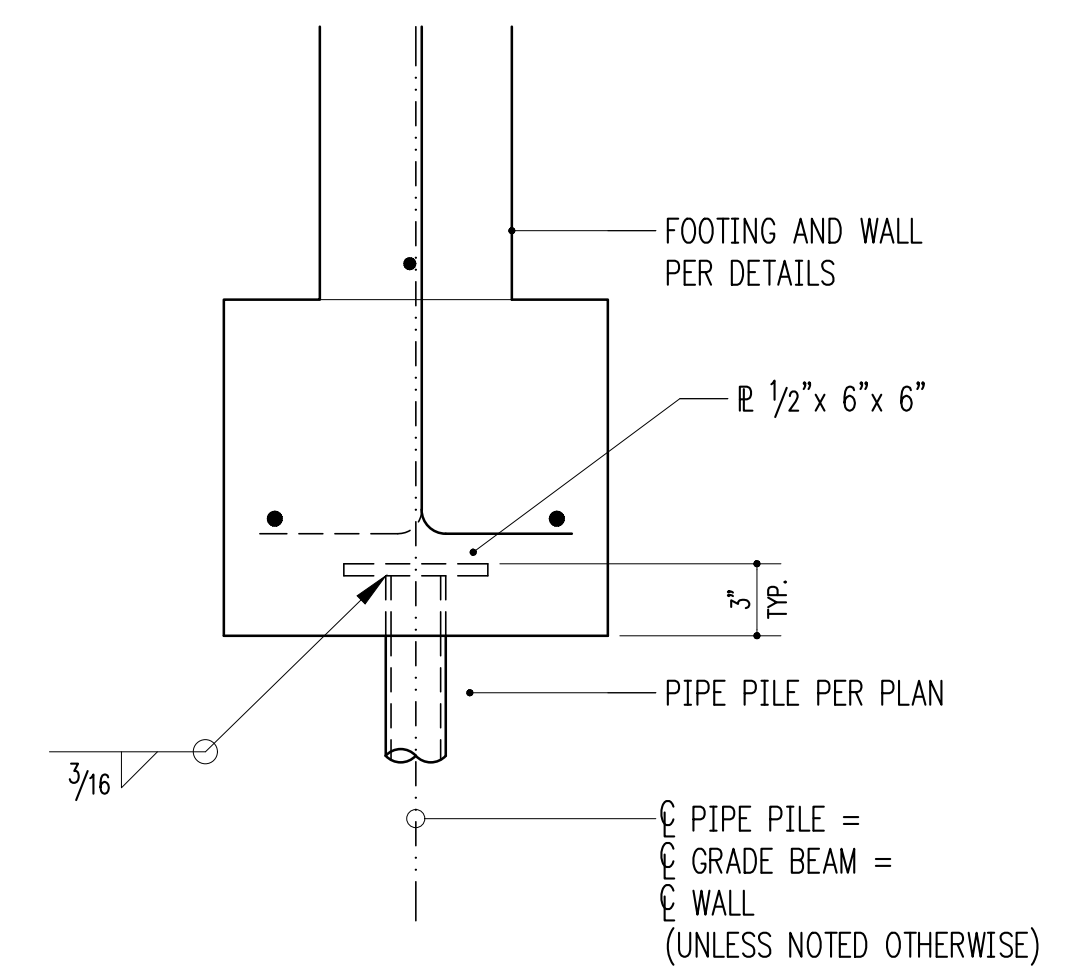

TYPICAL PIPE PILE EMBEDMENT

$$1-1/2'' = 1'-0''$$

ROSENWALD RESIDENCE

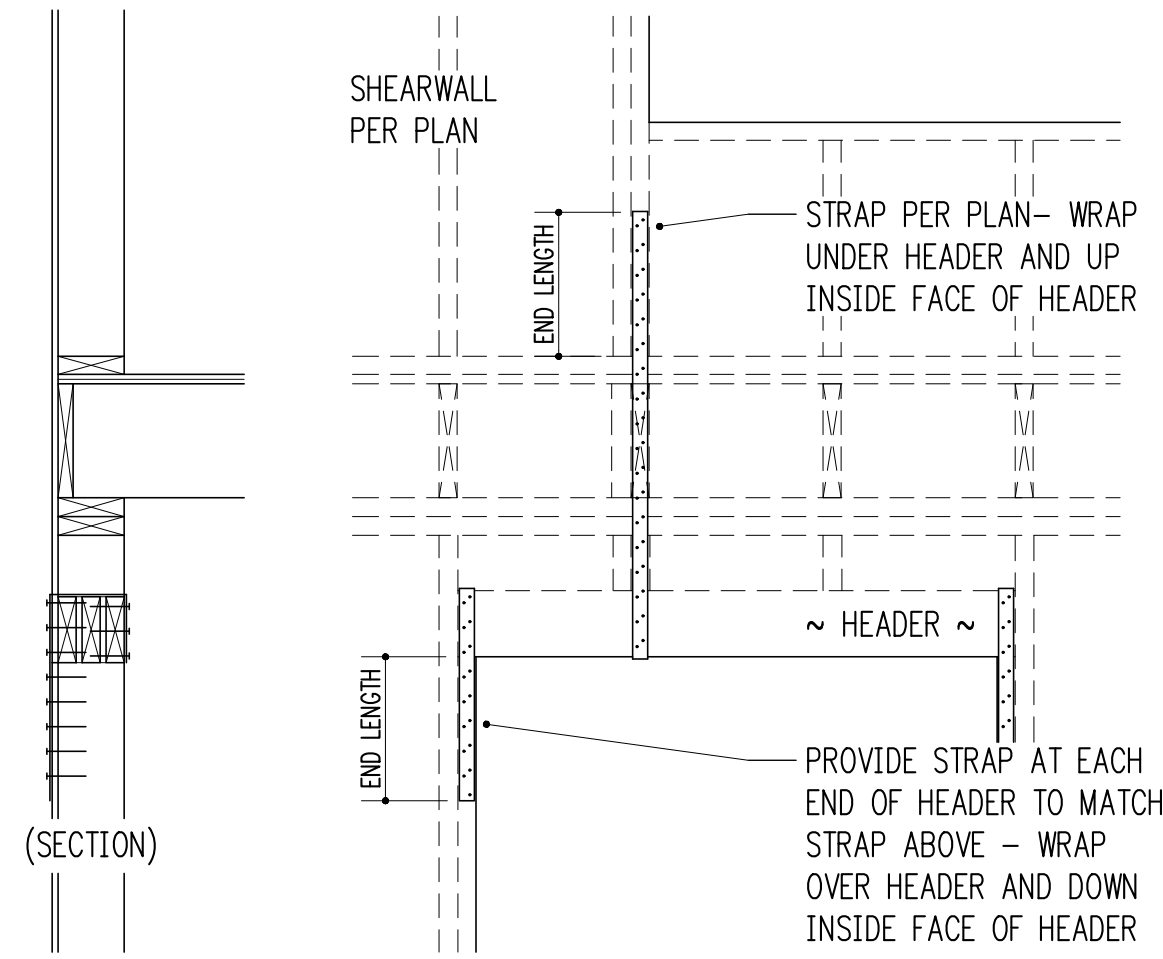


TYPICAL STRAPPED HEADER


3/4" = 1'-0"

1

ONE-SIDED
SHEARWALL

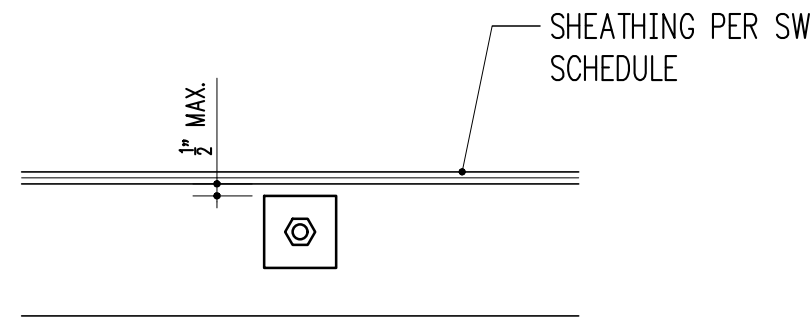

TWO-SIDED
SHEARWALL

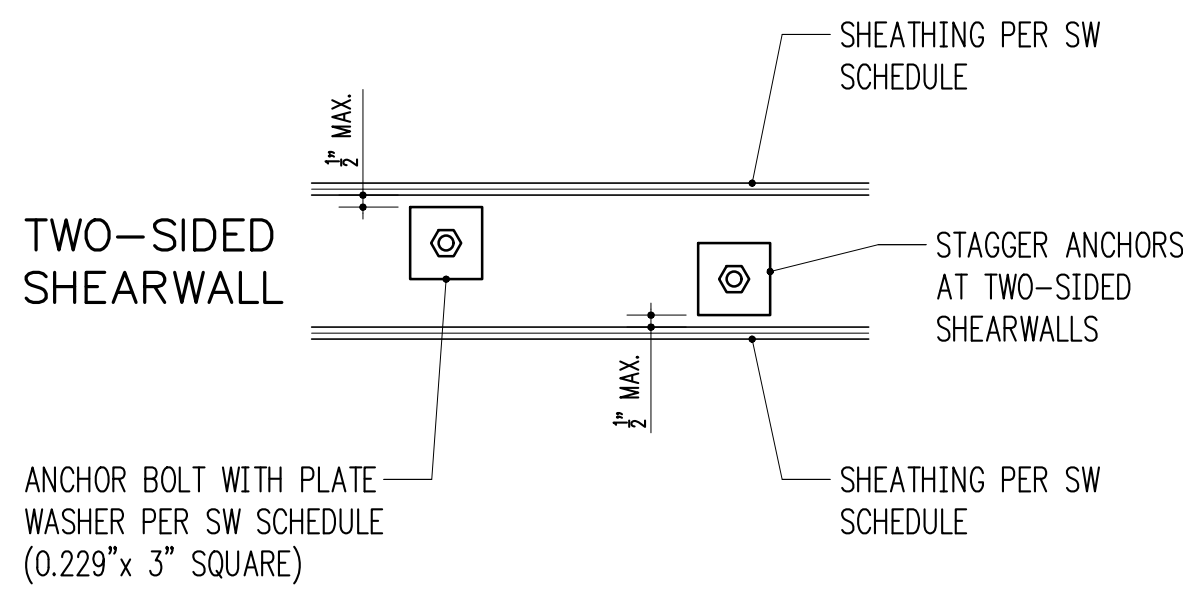

TYPICAL SHEARWALL ANCHOR BOLT PLACEMENT


1-1/2" = 1'-0"

2

STRAP SCHEDULE (NOT ALL USED)

MARK	END LENGTH	NAILS	NAIL SPACING
CMST12	44"	(98) 10d x 3"	13/4"
CMST14	34"	(76) 10d x 3"	13/4"
CMSTC16	25"	(58) 12d x 3/4"	1 1/2"
CS14	19"	(36) 8d x 2 1/2"	2 1/16"
CS16	14"	(26) 8d x 2 1/2"	2 1/16"
CS18	12"	(22) 8d x 2 1/2"	2 1/16"
CS20	9"	(16) 8d x 2 1/2"	2 1/16"
CS22	8"	(14) 8d x 2 1/2"	2 1/16"

- 10d AND 12d DIAMETER = 0.148"; 8d DIAMETER = 0.131".
- USE HALF OF THE REQUIRED NAILS IN EACH MEMBER BEING CONNECTED (i.e. IN EACH END LENGTH).

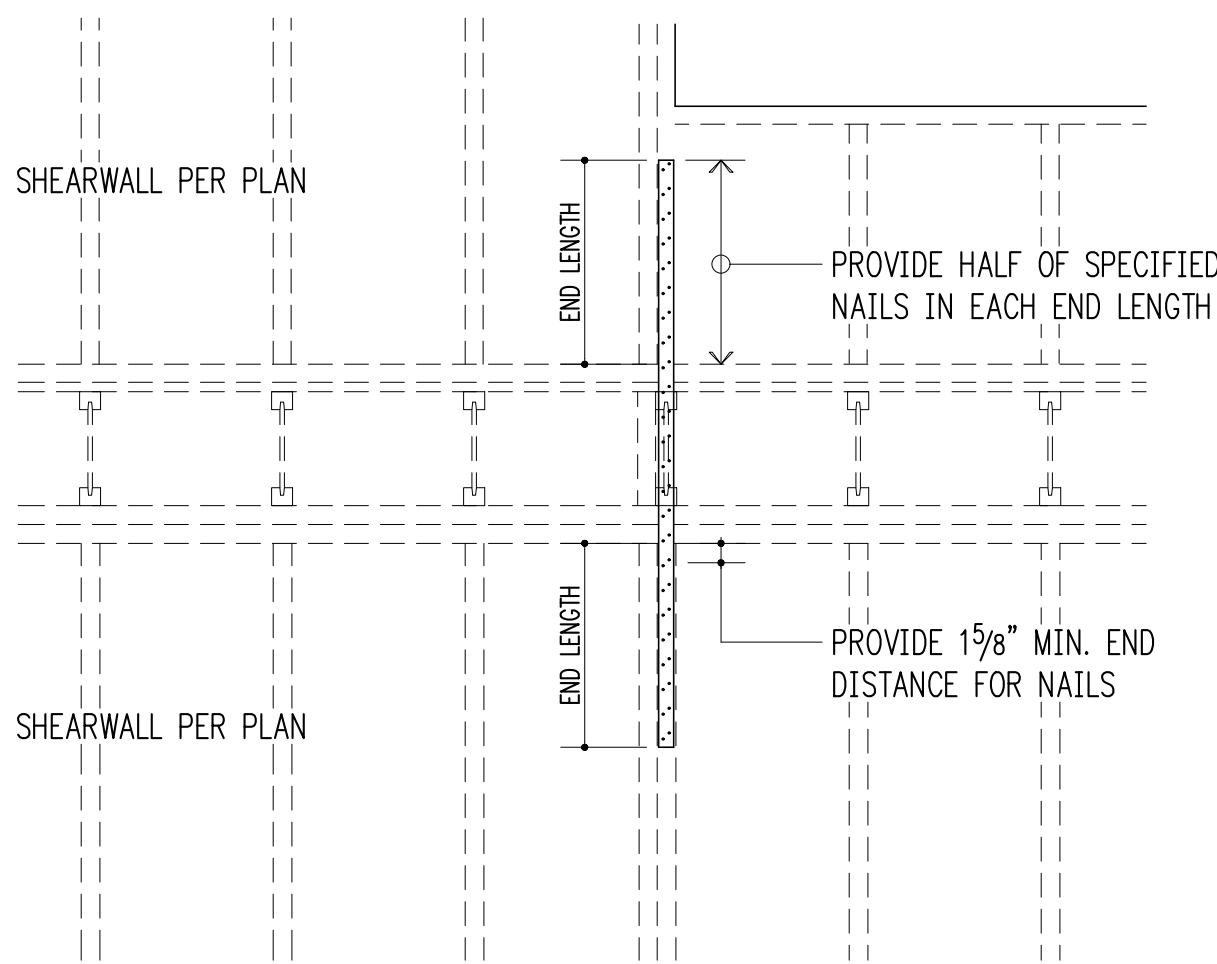

TYPICAL STRAP HOLDOWN AT FLOOR


3/4" = 1'-0"

6

HOLDOWN SCHEDULE

MARK	FASTENERS TO STUDS ¹	ANCHOR DIA. ²	EMBEDMENT LENGTH	
			EPOXY ³	CAST-IN ⁴
LTP2	(12) #9 x 1 1/2" SD SCREWS	1/2"	6"	N/A
HQ08	(20) 1/4"Ø x 3" SCREWS	7/8"	N/A	6" ⁵
HDU11	(30) 1/4"Ø x 2 1/2" SCREWS	1"	N/A	24" ⁵
HD19	(5) 1"Ø STUD BOLTS	1 1/4"	N/A	24" ⁵

- 10d AND 12d DIAMETER = 0.148"; 16d DIAMETER = 0.162". SCREWS SHALL BE SIMPSON "SDS" TYPE SCREWS U.N.O., INSTALL PER SIMPSON RECOMMENDATIONS.
- PROVIDE A36 OR A307 ALL-THREAD AT EPOXY AND CAST-IN ANCHORS.
- PROVIDE SIMPSON "SET-3G" EPOXY PER GENERAL STRUCTURAL NOTES. SPECIAL INSPECTION IS REQUIRED.
- AT CAST-IN ANCHORS PROVIDE HEAVY HEX NUT AT BOTTOM OF ALL-THREAD.
- NOTED EMBEDMENT FOR HQ08, HDU11, AND HD19 ANCHORS IS INTO FOOTING BELOW STEMWALL.

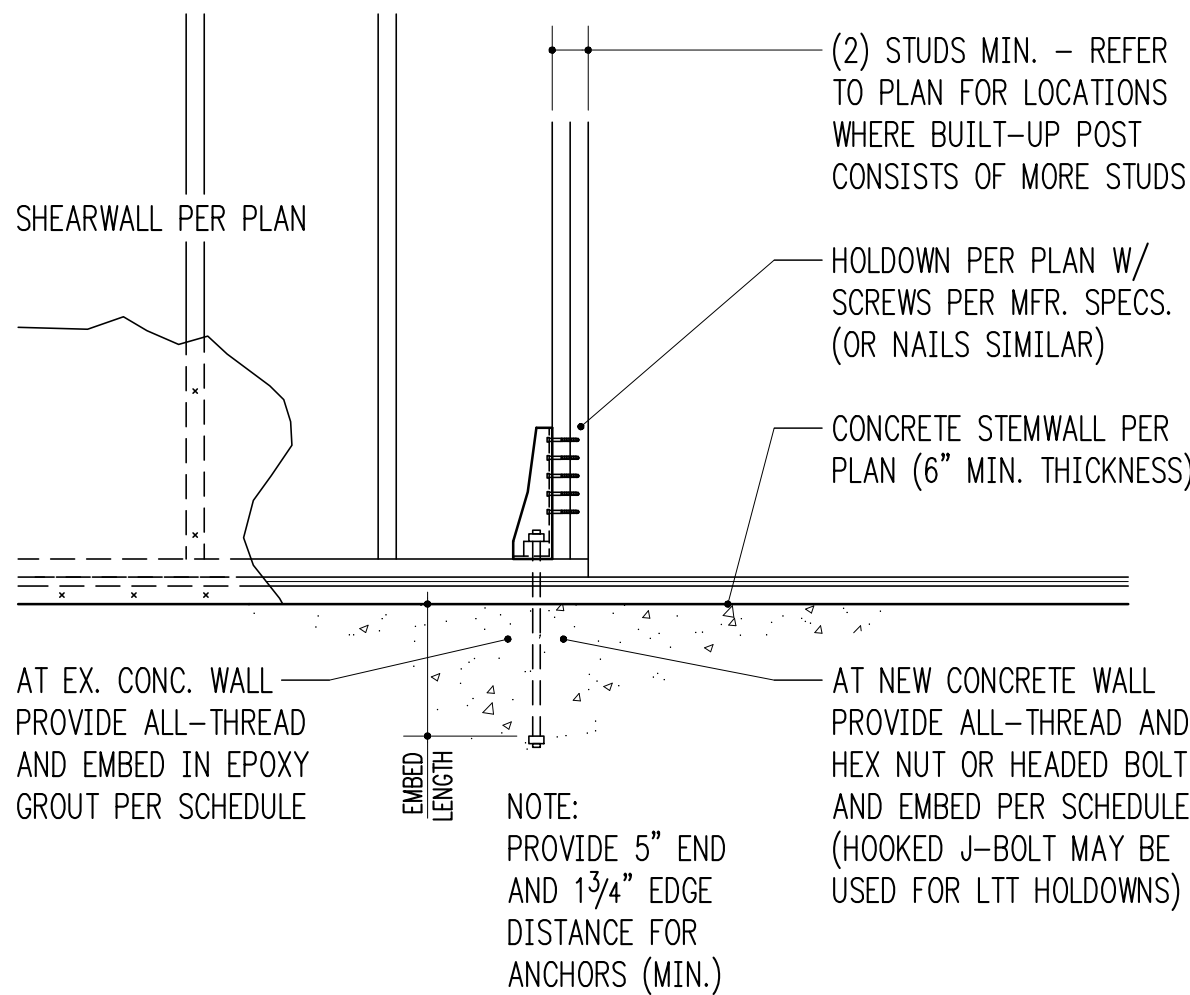

TYPICAL HOLDOWN AT CONCRETE


3/4" = 1'-0"

10


SHEARWALL SCHEDULE (NOT ALL USED ON PLANS)

MARK	SHEATHING ¹	STUDS AT ABUTTING PANEL EDGES ²	PANEL EDGE NAILING ^{3,4}	RIM JOIST OR BLOCKING TO TOP PLATE		BOTTOM PLATE ATTACHMENT		
				SOLID RIM	TJI RIM	BOTTOM PLATE TO RIM JOIST BELOW ⁴	ANCHOR BOLT TO CONCRETE ⁵	SILL PLATE AT FOUND.
SW1	15/32" CDX PLYWOOD	2x	8d @ 6"oc	A35 @ 24"oc	16d @ 6"oc	16d @ 6"oc	5/8"Ø @ 48"oc	2x
SW2	15/32" CDX PLYWOOD	2x	8d @ 4"oc	A35 @ 15"oc	16d @ 4"oc	16d @ 4"oc	5/8"Ø @ 32"oc	2x
SW3	15/32" CDX PLYWOOD	3x	8d @ 3"oc	A35 @ 12"oc	N/A - USE SOLID RIM	16d @ 3"oc	5/8"Ø @ 16"oc	2x
SW4	15/32" CDX PLYWOOD	3x	8d @ 2"oc	A35 @ 9"oc	N/A - USE SOLID RIM	16d @ 2"oc	5/8"Ø @ 12"oc	2x
SW5	15/32" CDX PLYWOOD BOTH SIDES	3x	8d @ 3"oc	A35 @ 6"oc	N/A - USE SOLID RIM	(2) ROWS 16d @ 3"oc	5/8"Ø @ 12"oc	3x
SW6	15/32" CDX PLYWOOD BOTH SIDES	3x	8d @ 2"oc	A35 @ 4 1/2"oc	N/A - USE SOLID RIM	(2) ROWS 16d @ 2"oc	5/8"Ø @ 12"oc	3x

- WALL SHEATHING SHALL CONSIST OF APA RATED PLYWOOD WITH SPAN RATING 24/0. ALLOW 1/8" SPACING AT ALL PANEL EDGES AND ENDS OF PANELS. 7/16" APA RATED SHEATHING (OSB) MAY BE USED IN PLACE OF 15/32" CDX.
- STUDS AT ABUTTING PANEL EDGES MAY CONSIST OF (2)2x STUDS IN PLACE OF 3x STUDS - NAIL (2)2x STUDS TOGETHER WITH BOTTOM PLATE ATTACHMENT NAILING.
- BLOCK ALL PANEL EDGES W/ 2x4 FLAT, ATTACH W/ PANEL EDGE NAILING. TWO STUDS MINIMUM ARE REQUIRED AT EACH END OF ALL SHEARWALLS. END STUDS SHALL RECEIVE PANEL EDGE NAILING. INTERMEDIATE STUDS SHALL BE 2x STUDS. NAIL SHEATHING TO INTERMEDIATE FRAMING MEMBERS WITH 8d @ 12"oc.
- 8d NAILS SHALL BE 0.131" DIAMETER x 2 1/2" (COMMON). 16d NAILS SHALL BE 0.135" DIAMETER x 3 1/2" (BOX).
- ANCHORS TO CONCRETE SHALL CONSIST OF CAST-IN-PLACE ANCHOR BOLTS, EXPANSION BOLTS, EPOXY GROUTED ALL-THREADS, OR TITEN HD HEAVY DUTY SCREW ANCHORS. CAST-IN-PLACE ANCHOR BOLTS HAVE A 7" EMBED AND SHALL BE J-BOLTS OR SHALL HAVE A HEX NUT AT THE BOTTOM END. EXPANSION BOLTS SHALL HAVE 5" EMBED AND SHALL NOT BE USED AT STEM WALL LOCATIONS WITH EDGE DISTANCE LESS THAN 5" (INSTEAD, USE EPOXY GROUTED ALL-THREADS OR TITEN HD ANCHORS). EPOXY GROUTED ANCHORS SHALL HAVE 5" EMBED AND 2 1/2" MIN. EDGE DISTANCE. TITEN HD ANCHORS SHALL HAVE 3 1/2" EMBED AND 1 3/4" MIN. EDGE DISTANCE. AT ALL ANCHOR BOLTS, PROVIDE STEEL PLATE WASHERS THAT ARE A MINIMUM OF 0.229" (3 GAUGE) x 3"x 3" (SIMPSON BP5/8-3 OR SIMILAR). PLACE BOLTS PER ANCHOR BOLT PLACEMENT DETAIL.

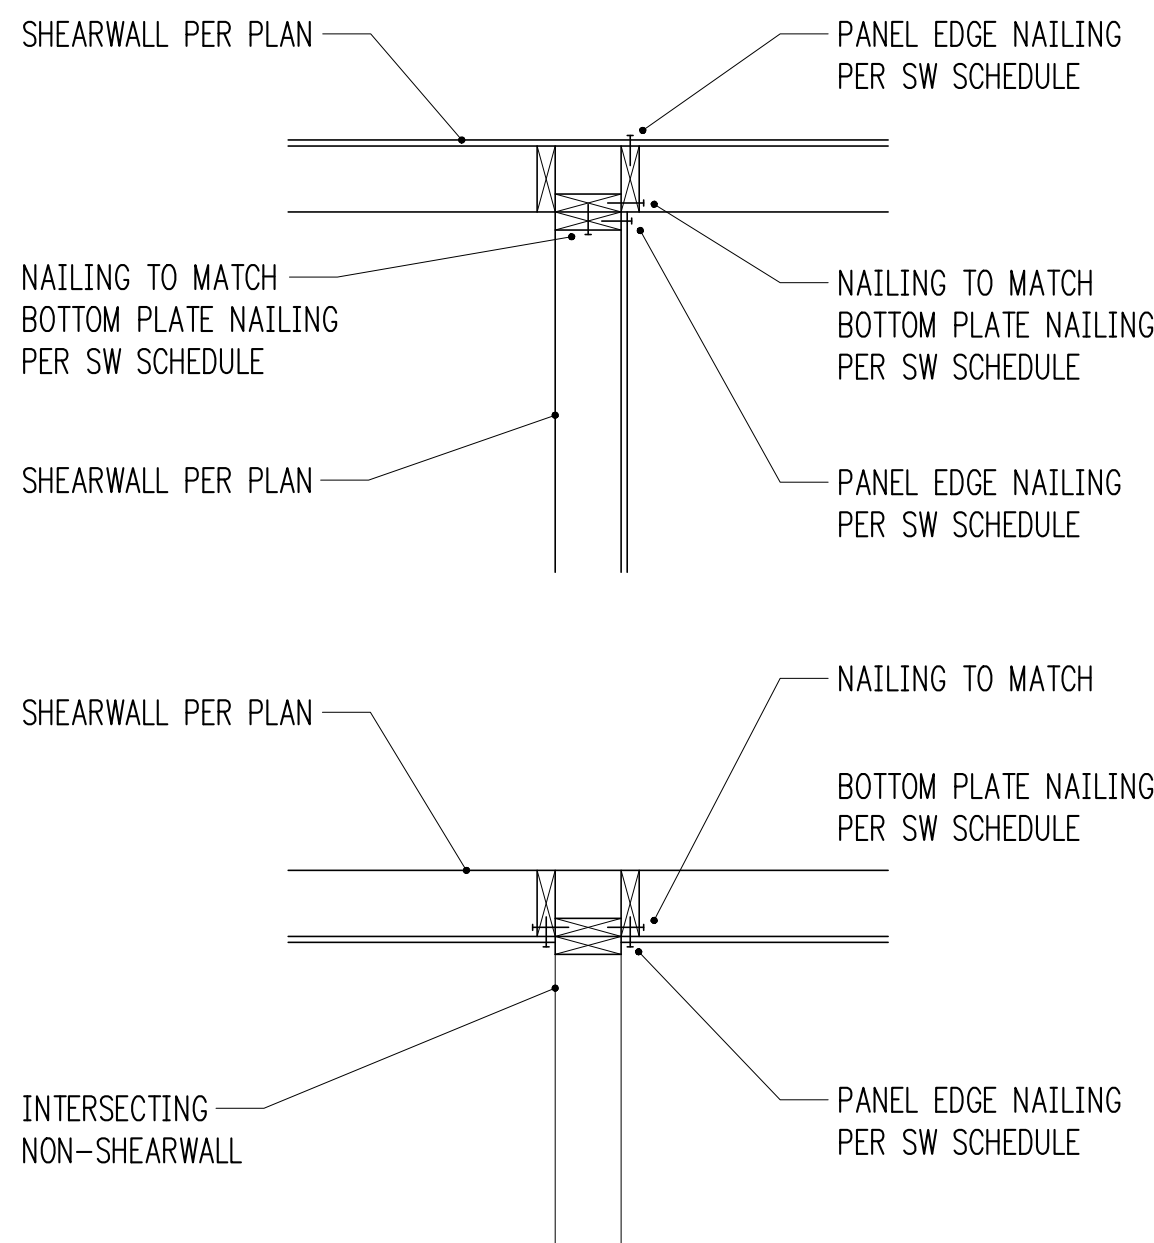


TYPICAL SHEARWALL INTERSECTIONS

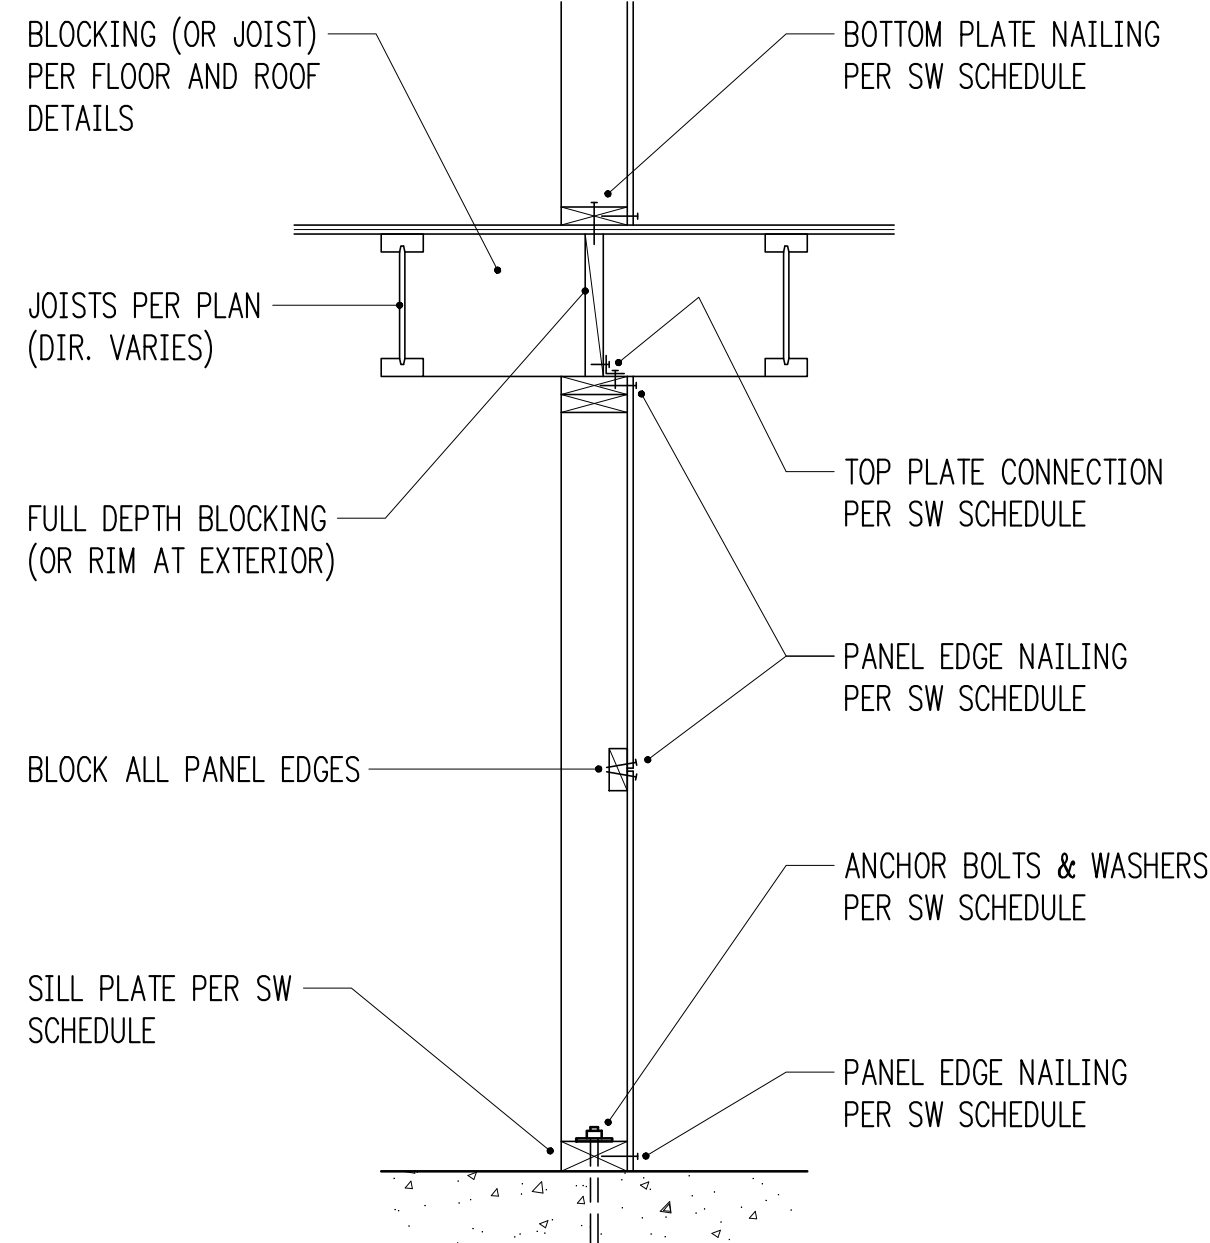

TYPICAL SHEARWALL SECTION

3/4" = 1'-0"


8

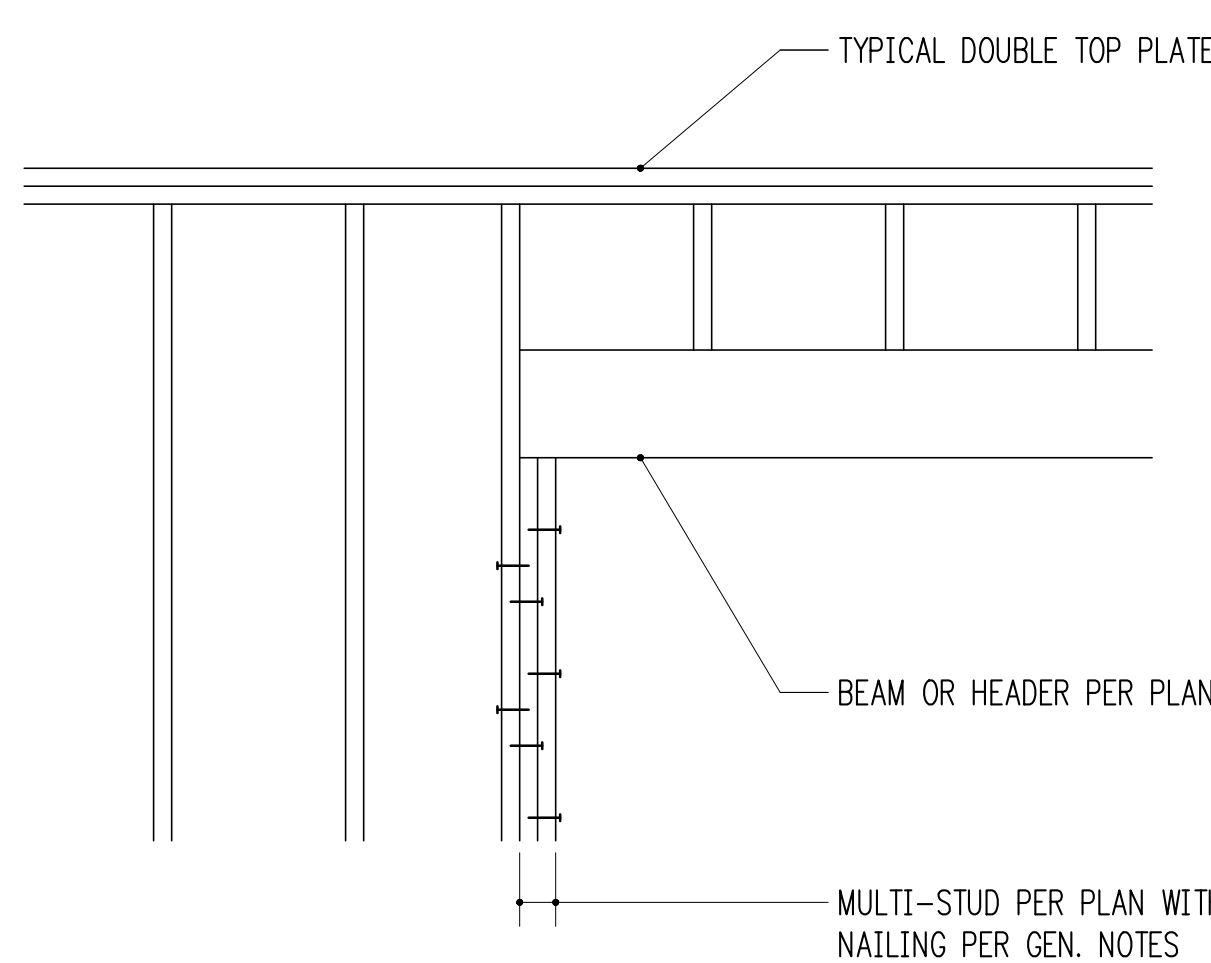

TYPICAL MULTIPLE-STUD POST CONSTRUCTION

3/4" = 1'-0"

11

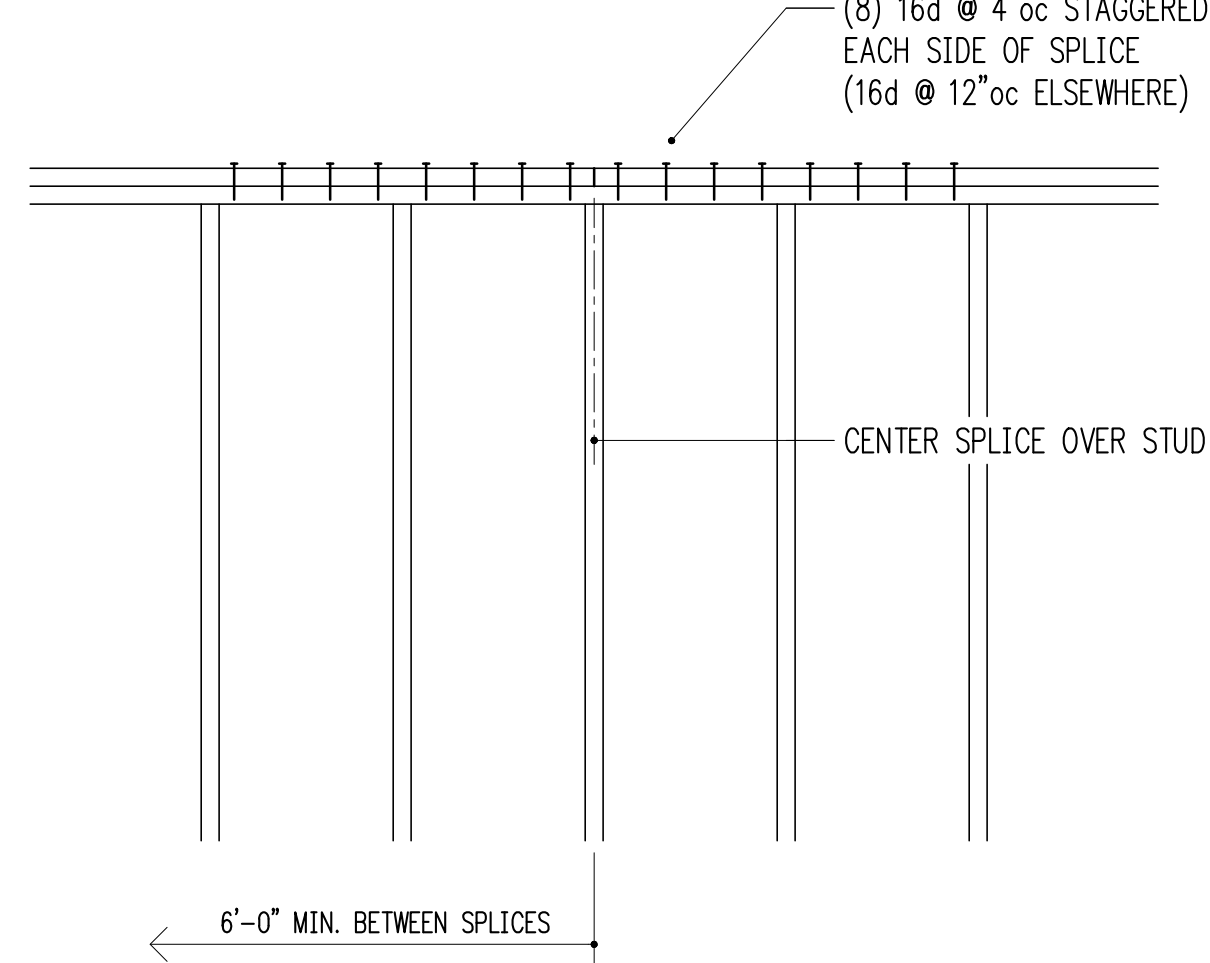


TYPICAL TOP PLATE SPLICE CONSTRUCTION

3/4" = 1'-0"

12

HV

Harriott Valentine Engineers Inc.
1932 First Avenue, Suite 720
Seattle, Washington 98101-2447
tel 206 624 4760 fax 206 447 6971
www.harriottvalentine.com

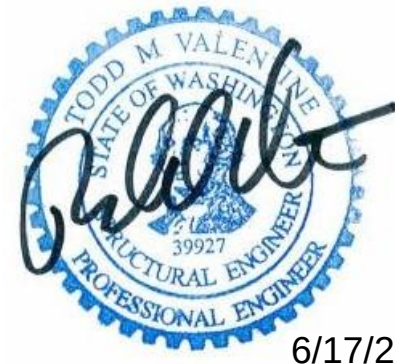

6/17/25

Project Contact
Henry Nuckles
tel 206 413 6664
hnuckles@harriottvalentine.com

Project Architect
JML Architects
Mercer Island, 98040

Project
Rosenwald Residence
4836 E Mercer Way
Mercer Island, WA 98040

Issue Date	Issue Description
06/27/25	Permit Submittal

Building Department Approval

Drawing Title
STRUCTURAL DETAILS

Drawing Number

S4.0

ROSENWALD RESIDENCE