
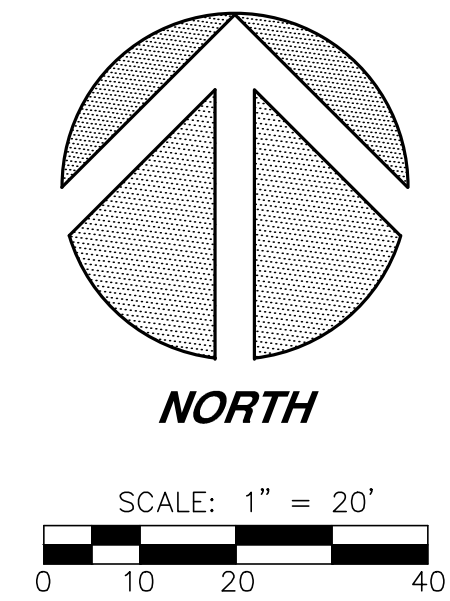


TITLE SCHEDULE B EXCEPTIONS:

- RELEVANT EXCEPTIONS PER TITLE REPORT (SEE NOTE 6):
- EASEMENT(S) FOR THE PURPOSE(S) SHOWN BELOW AND RIGHTS INCIDENTAL THERETO, AS GRANTED IN A DOCUMENT:
 PURPOSE: RIGHT OF WAY
 RECORDING NO.: 2731421
 AFFECTS: THE EAST 30 FEET

 SAID EASEMENT INCLUDES THE RIGHT TO CUT AND REMOVE BRUSH, TREES AND OTHER OBSTRUCTIONS WHICH IN THE OPINION OF THE GRANTEE, INTERFERE WITH THE USE OF THE RIGHT OF WAY.
 - EASEMENT(S) FOR THE PURPOSE(S) SHOWN BELOW AND RIGHTS INCIDENTAL THERETO, AS GRANTED IN A DOCUMENT:
 PURPOSE: RIGHT OF WAY
 RECORDING NO.: 4080045
 AFFECTS: THE EAST 30 FEET
 - EASEMENT(S) FOR THE PURPOSE(S) SHOWN BELOW AND RIGHTS INCIDENTAL THERETO AS SET FORTH IN A DOCUMENT:
 IN FAVOR OF: MERCER ISLAND SEWER DISTRICT
 PURPOSE: SEWER PIPE LINES WITH NECESSARY APPURTENANCES
 RECORDING DATE: SEPTEMBER 30, 1964
 RECORDING NO.: 5792913
 AFFECTS: THE EAST 6 FEET
 - EASEMENT(S) FOR THE PURPOSE(S) SHOWN BELOW AND RIGHTS INCIDENTAL THERETO AS SET FORTH IN A DOCUMENT:
 IN FAVOR OF: CITY OF MERCER ISLAND
 PURPOSE: WATER PIPE LINES WITH NECESSARY APPURTENANCES
 RECORDING DATE: AUGUST 7, 1967
 RECORDING NO.: 6214927
 AFFECTS: THE EAST 20 FEET
 - EASEMENT(S) FOR THE PURPOSE(S) SHOWN BELOW AND RIGHTS INCIDENTAL THERETO, AS GRANTED IN A DOCUMENT:
 PURPOSE: INSTALLING, MAINTAINING AND REPLACING AS NEEDED DRAINAGE IMPROVEMENTS
 RECORDING NO.: 20000330000820
 AFFECTS: PORTION OF SAID PREMISES

 SURVEYORS NOTE: NOT PLOTTABLE, NO FOOTPRINT DEFINED.

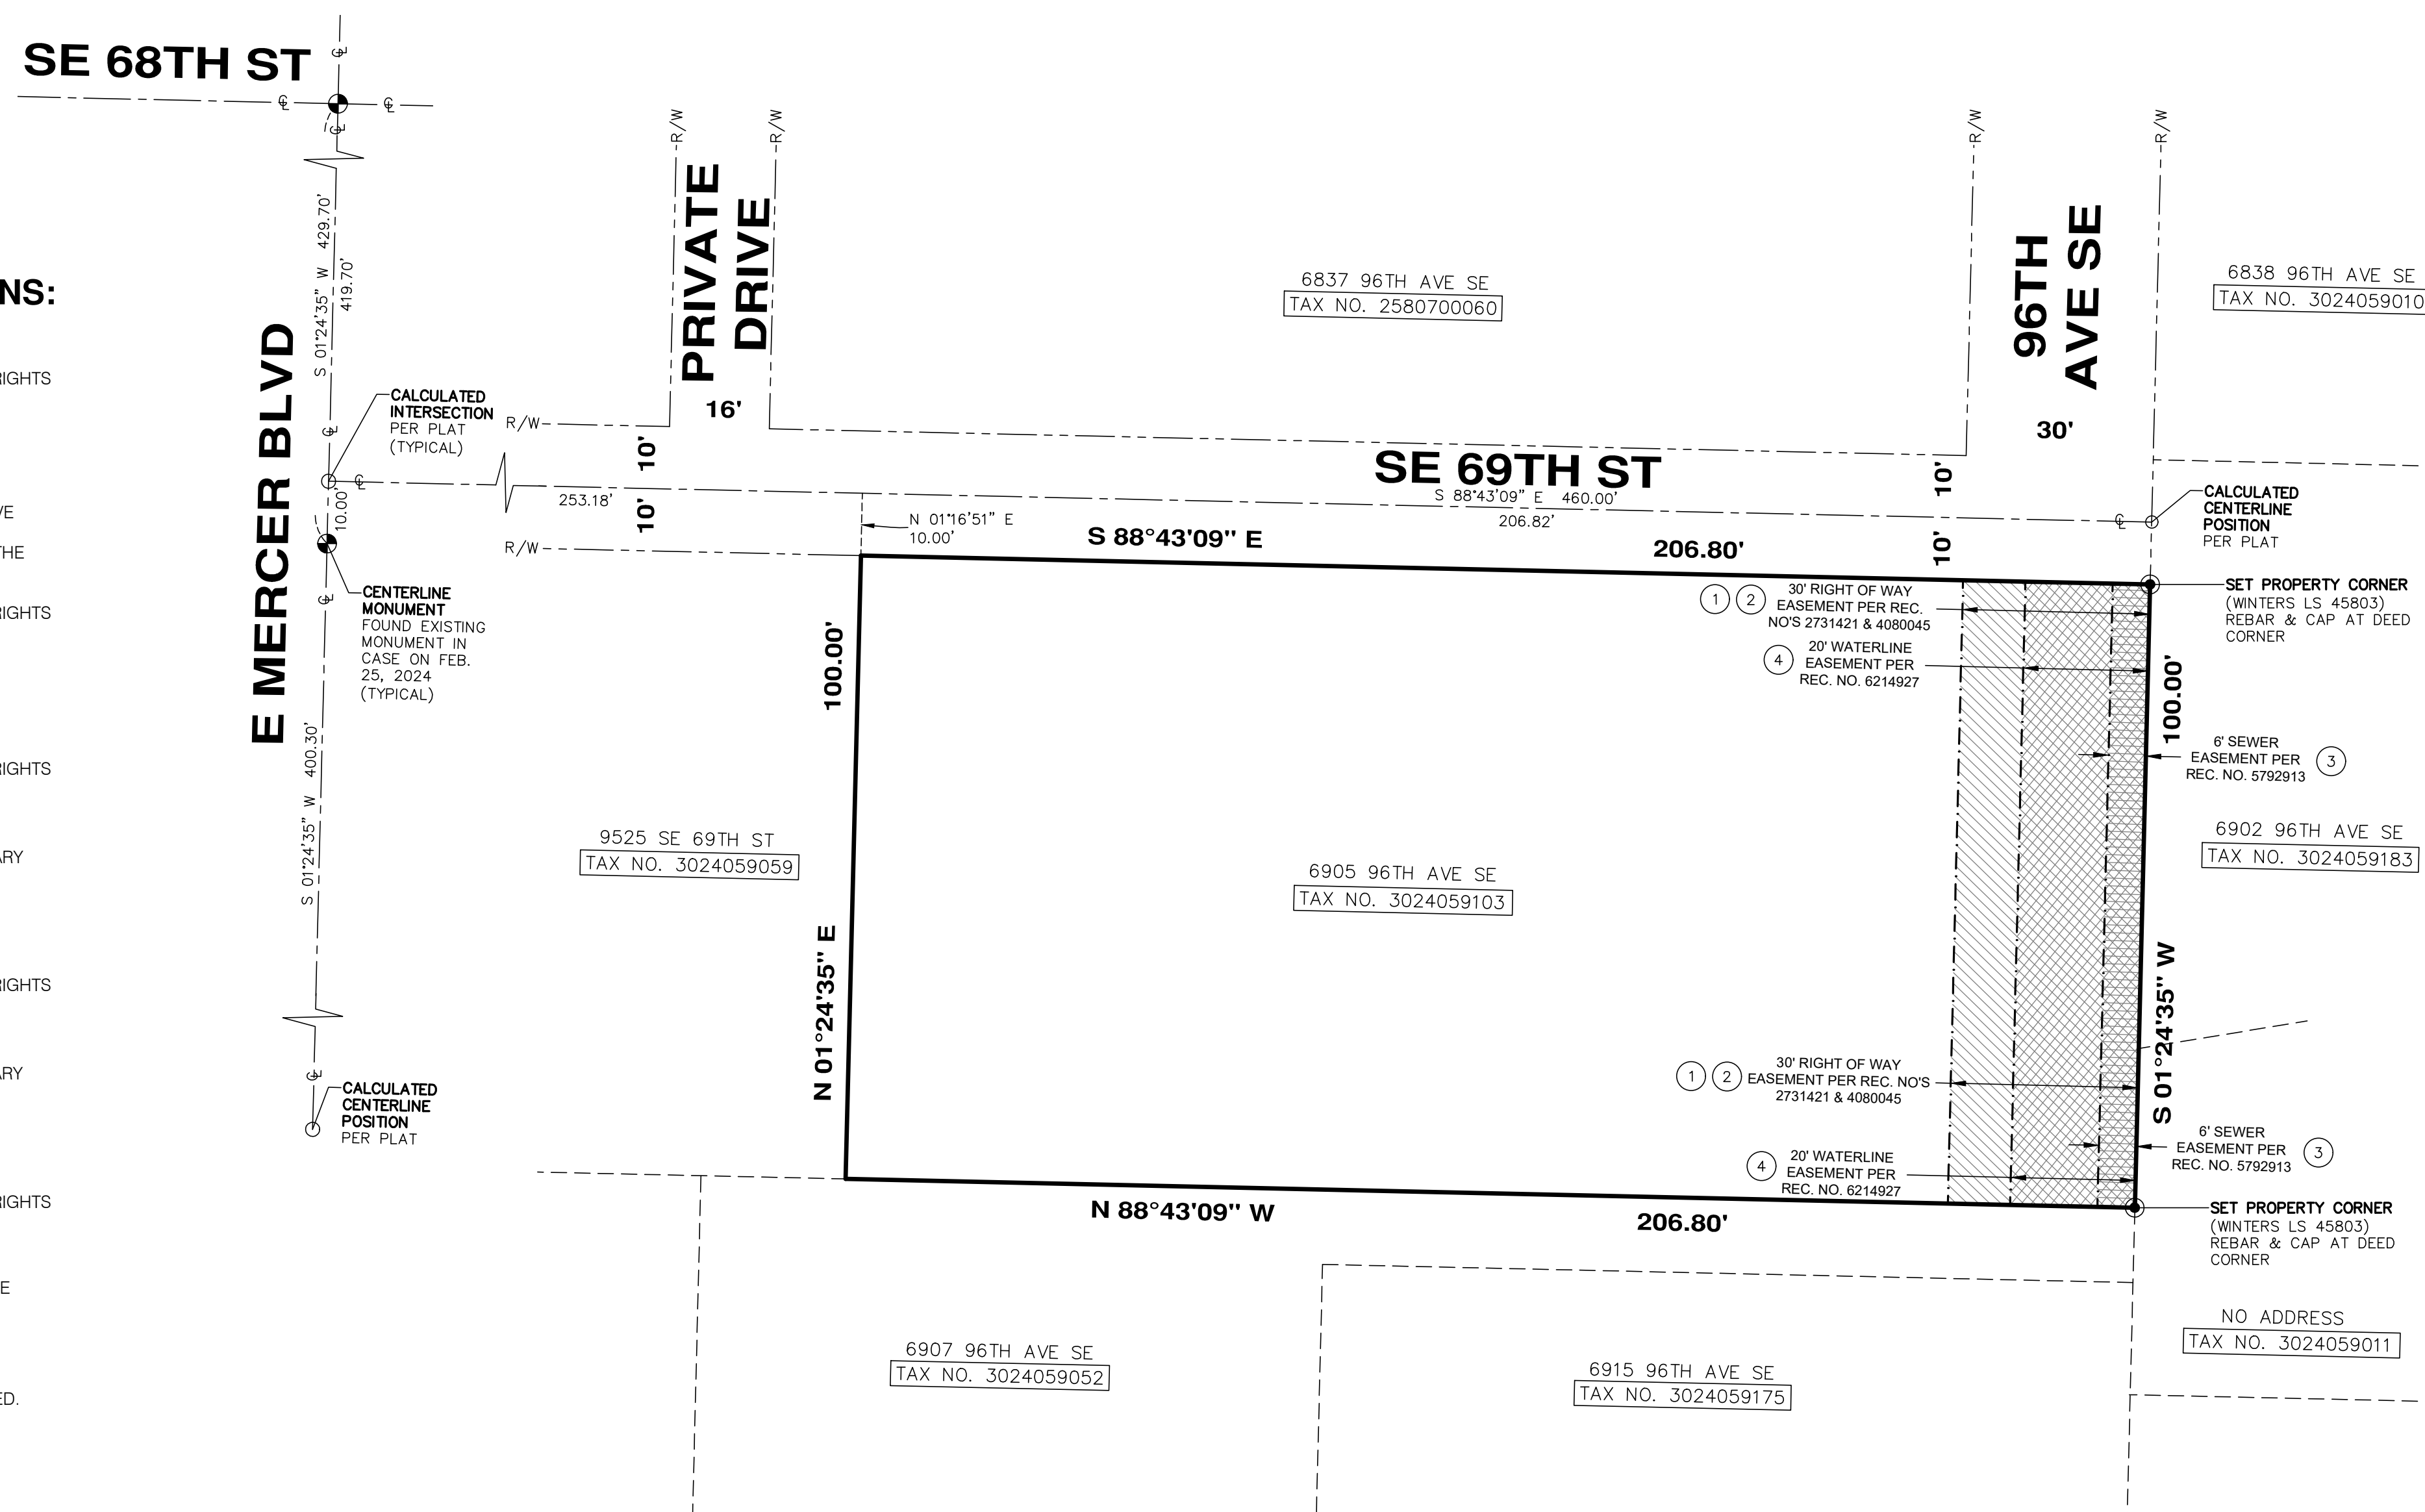

NOTES:

- THIS SURVEY WAS PERFORMED BY FIELD TRAVERSE USING A 10 SECOND "TOTAL STATION". THIS SURVEY MEETS OR EXCEEDS THE STANDARDS FOR LAND BOUNDARY SURVEYS AS SET FORTH IN WAC CHAPTER 332-130-090.
- CONTOUR INTERVAL = 1 FT.
- VERTICAL DATUM = NAVD88, AS PER DIRECT OBSERVATIONS USING GPS EQUIPMENT ON FEBRUARY 23RD, 2023.
- HORIZONTAL DATUM = NAD 83/11 (EPOCH 2010).
- PARCEL AREA = 20,680 FT².
- THIS SURVEY IS RELIANT UPON THE INFORMATION CONTAINED WITHIN CHICAGO TITLE COMPANY OF WASHINGTON, TITLE REPORT NO. 0251005-ETU, DATED DECEMBER 1, 2023.
- TREES AS SHOWN HEREON HAVE BEEN MAPPED TO THE BEST OF OUR ABILITY DURING THE COURSE OF THIS SURVEY. HOWEVER, ALL ONSITE TREES THAT COULD AFFECT PROJECT DEVELOPMENT MAY NOT BE SHOWN. THEREFORE, PRIOR TO DESIGN A CERTIFIED ARBORIST SHOULD BE CONSULTED TO VERIFY THE SPECIFIC GENUS, TRUNK DIAMETER, DRIP LINE, LOCATION AND NUMBER OF QUALIFYING TREES UPON THIS SITE.

DEED DESCRIPTION:

TAX PARCEL NUMBER: 3024059103


THE EAST 200 FEET OF THE SOUTH 100 FEET OF THE NORTH 530 FEET OF THE EAST 430 FEET OF GOVERNMENT LOT 3, SECTION 30, TOWNSHIP 24 NORTH, RANGE 5 EAST, W.M., IN KING COUNTY, WASHINGTON.

TOGETHER WITH THE EAST 6.80 FEET OF THE EAST 100 FEET OF THE WEST 230 FEET OF THE EAST 430 FEET OF THE SOUTH 100 FEET OF THE NORTH 530 FEET OF GOVERNMENT LOT 3, SECTION 30, TOWNSHIP 24 NORTH, RANGE 5 EAST, W.M., KING COUNTY, WASHINGTON.

SITUATE IN THE COUNTY OF KING, STATE OF WASHINGTON.

CONTROL DIAGRAM



SHEET 1 OF 2

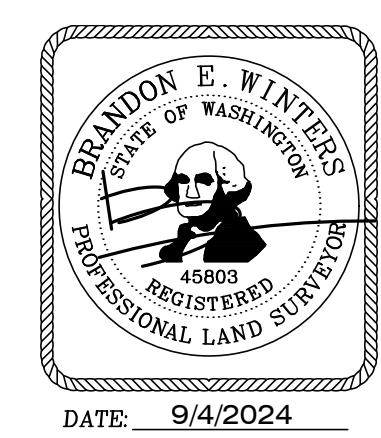

TOPOGRAPHIC SURVEY
6905 96TH AVE SOUTHEAST
MERCER ISLAND, WASHINGTON

CHADWICK WINTERS
 LAND SURVEYING AND MAPPING
 1422 N.W. 85TH ST., SEATTLE, WA 98117
 PHONE: 206.297.0996
 FAX: 206.297.0997
 WEB: WWW.CHADWICKWINTERS.COM

PROJECT #: 24-8081
DRAWING: 24-8081 TOPO
CLIENT: TERRY LONG
DATE: 9/04/2024
DRAWN BY: TTB

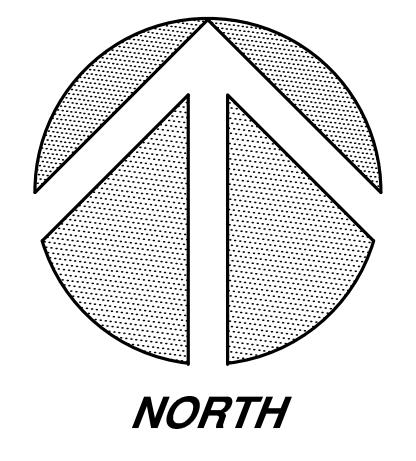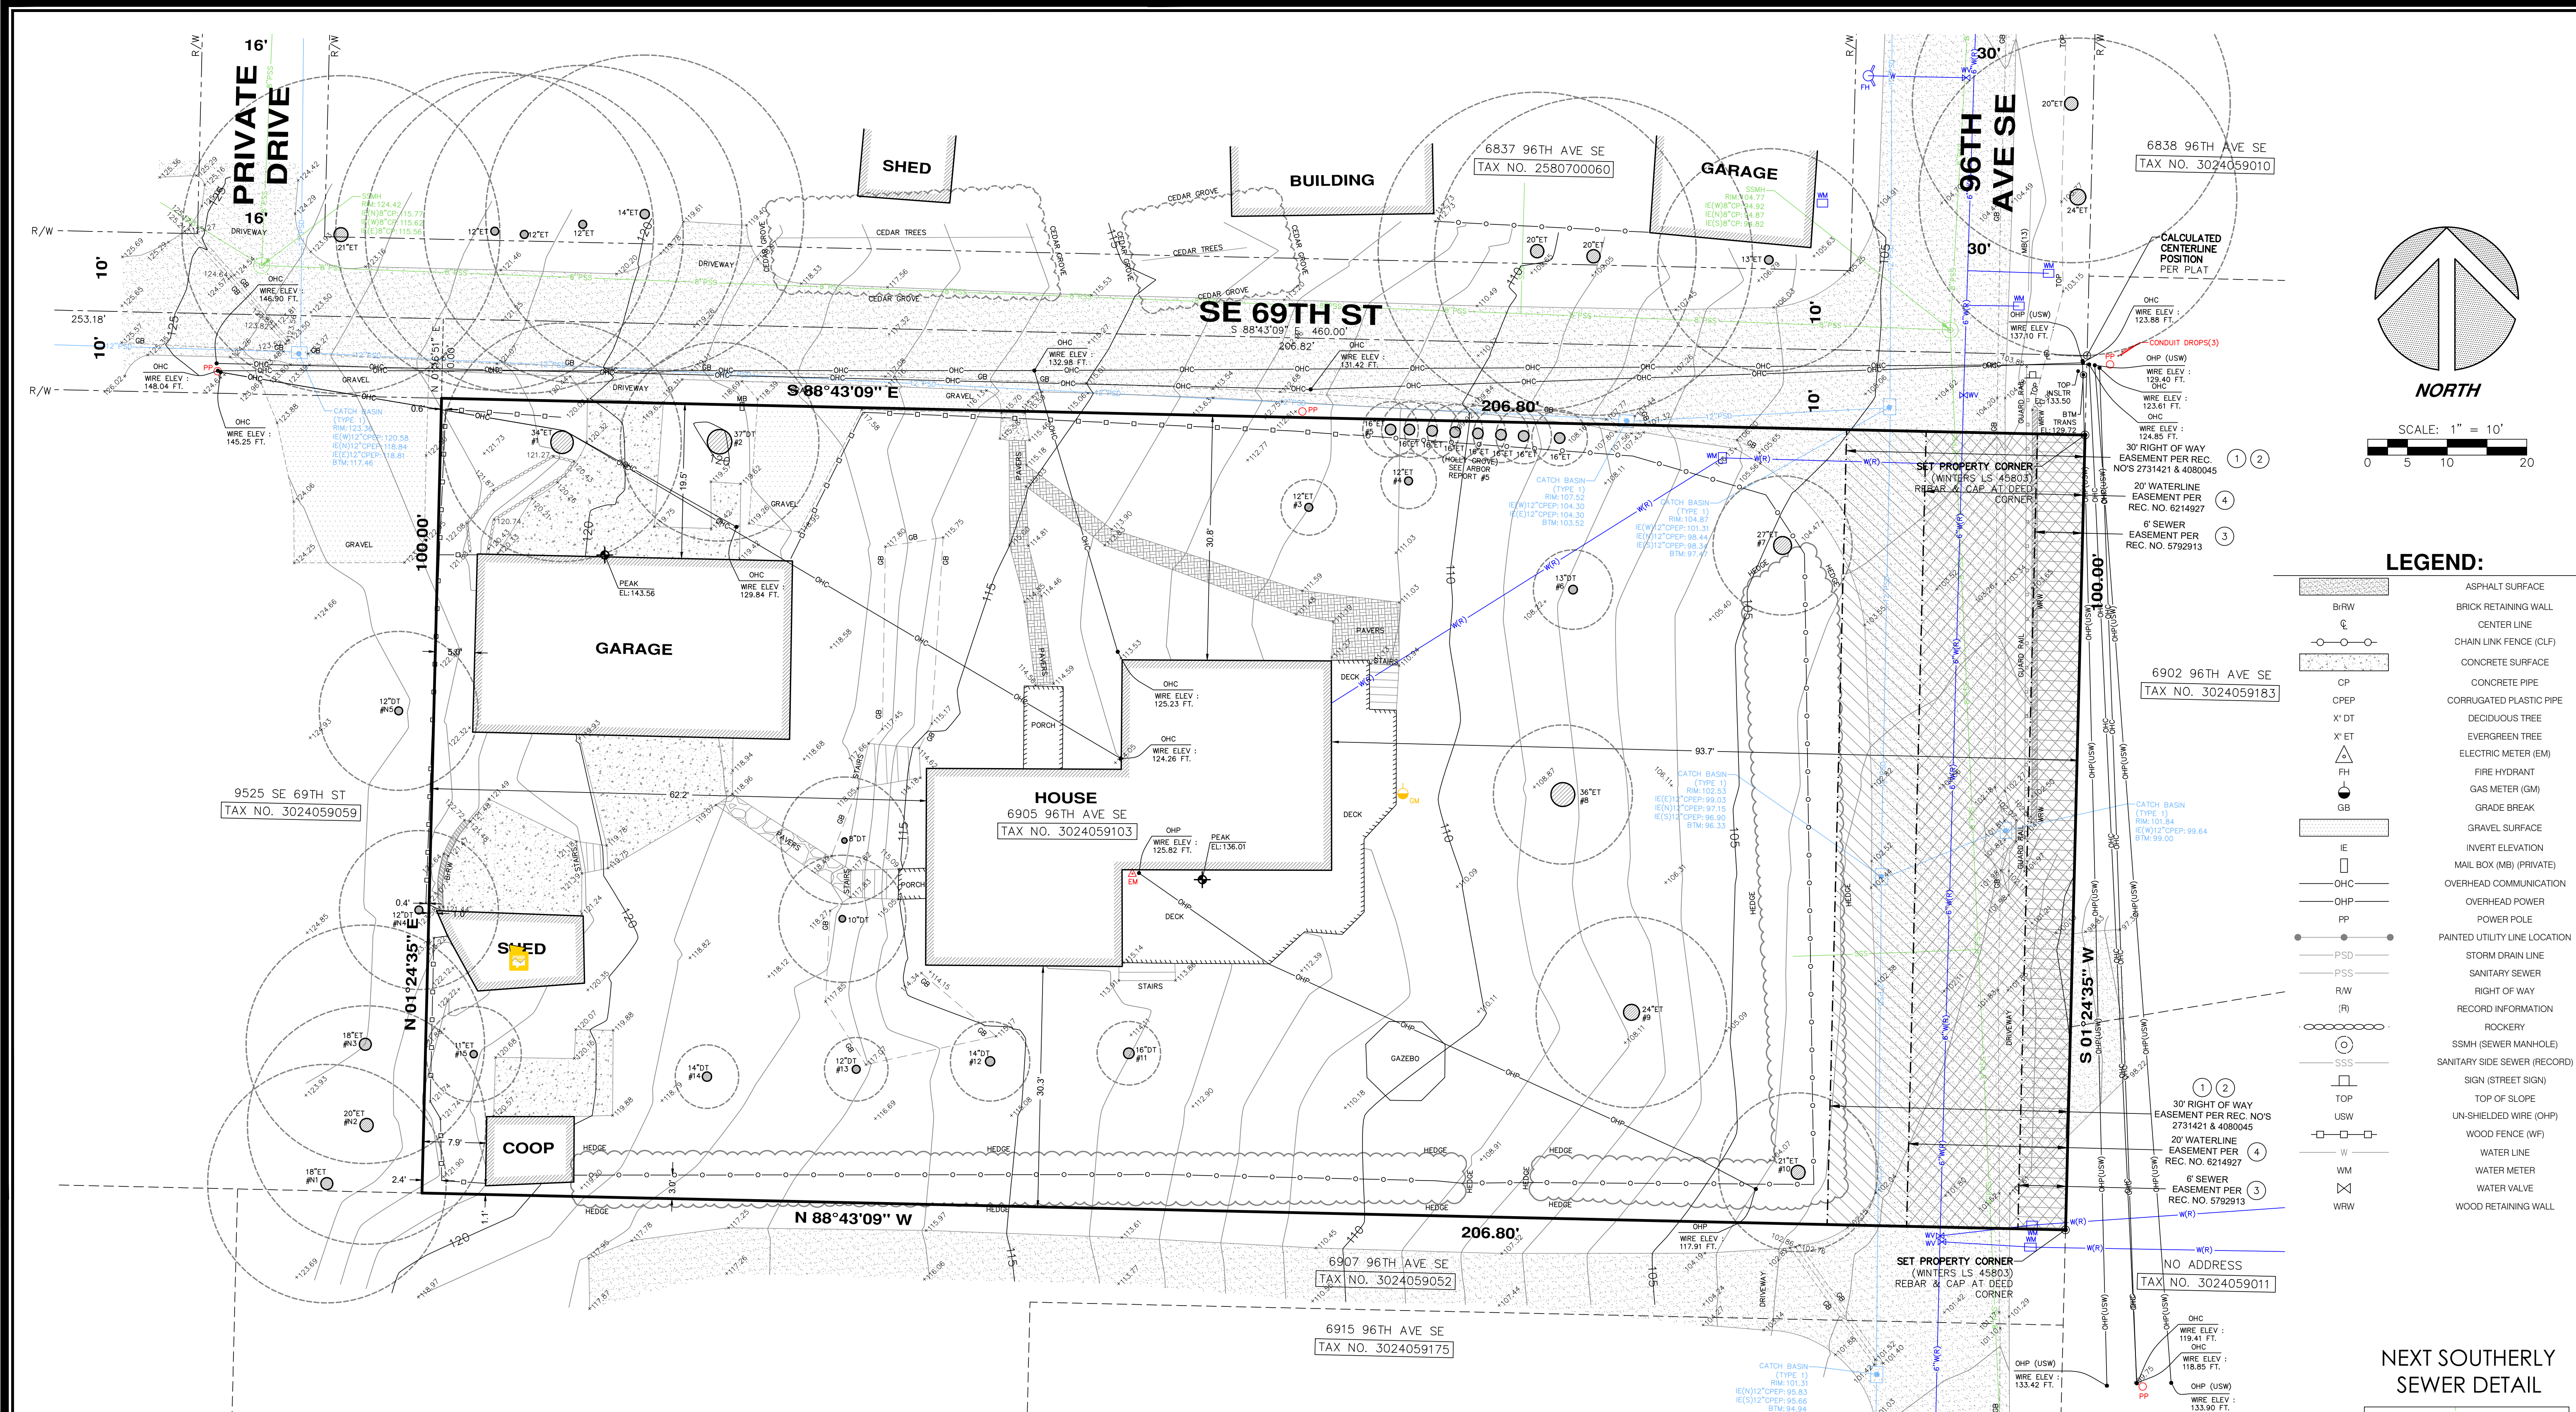

LEGEND:


	ASPHALT SURFACE
	BRICK RETAINING WALL
	CENTER LINE
	CHAIN LINK FENCE (CLF)
	CONCRETE SURFACE
	CONCRETE PIPE
	CORRUGATED PLASTIC PIPE
	DECIDUOUS TREE
	EVERGREEN TREE
	ELECTRIC METER (EM)
	FIRE HYDRANT
	GAS METER (GM)
	GRADE BREAK
	GRAVEL SURFACE
	INVERT ELEVATION
	MAIL BOX (MB) (PRIVATE)
	OVERHEAD COMMUNICATION
	OVERHEAD POWER
	POWER POLE
	PAINTED UTILITY LINE LOCATION
	STORM DRAIN LINE
	SANITARY SEWER
	RIGHT OF WAY
	RECORD INFORMATION
	ROCKERY
	SSMH (SEWER MAN-HOLE)
	SANITARY SIDE SEWER (RECORD)
	SIGN (STREET SIGN)
	TOP OF SLOPE
	UN-SHIELDED WIRE (OHP)
	WOOD FENCE (WF)
	WATER LINE
	WATER METER
	WATER VALVE
	WOOD RETAINING WALL

UNDERGROUND UTILITY NOTE:

UNDERGROUND UTILITY INFORMATION AS SHOWN HEREON IS APPROXIMATE ONLY AND IS BASED UPON OBSERVED GROUND EVIDENCE. THE CITY OF MERCER ISLAND GIS DATABASE AND ALSO AS PER TIES TO ABOVE GROUND STRUCTURES. CHADWICK AND WINTERS ASSUMES NO LIABILITY FOR THE ACCURACY OF THOSE RECORDS & LOCATIONS OR ACCEPTS RESPONSIBILITY FOR UNDERGROUND UTILITIES NOT DISCLOSED IN SAID RECORDS. THE FINAL LOCATION OF EXISTING UNDERGROUND UTILITIES IN AREAS CRITICAL TO DESIGN SHOULD BE ESTABLISHED BY CONTACTING THE UTILITY OWNER OR AGENCY. 1-800-424-5555 SHOULD ALWAYS BE CALLED PRIOR TO CONSTRUCTION.


OVERHEAD POWER LINE NOTE:

WE HAVE DETERMINED TO THE BEST OF OUR ABILITY THE OVERHEAD HIGH VOLTAGE POWER LINE WHICH IS CLOSEST TO THE PROJECT SITE AND HAVE DISPLAYED ITS HORIZONTAL AND VERTICAL LOCATION HEREON. HOWEVER, ADDITIONAL OVERHEAD SERVICE LINES MAY EXIST WHICH ARE NOT OBVIOUS TO US BY FIELD OBSERVATION AND POTENTIALLY IMPACT PROJECT DESIGN. THEREFORE, PRIOR TO DESIGN AND CONSTRUCTION WE RECOMMEND THAT SEATTLE CITY LIGHT BE CONSULTED REGARDING THE POSSIBLE EXISTENCE OF ADDITIONAL SERVICE LINES NOT DISPLAYED HEREON WHICH SHOULD BE CONSIDERED FOR PROJECT DESIGN.

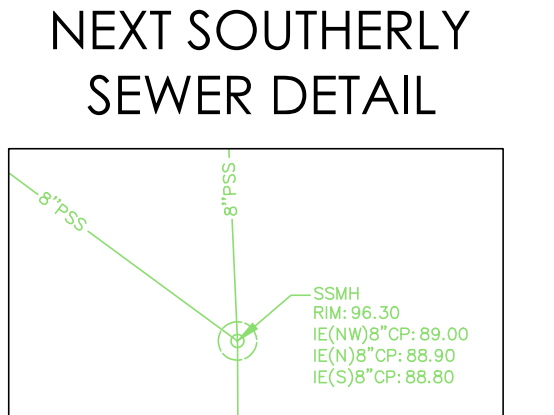

EXISTING CONDITIONS


SHEET 2 OF 2

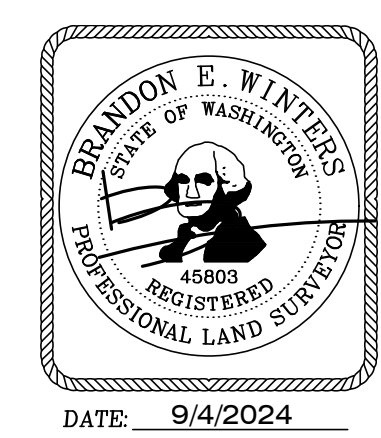

TOPOGRAPHIC SURVEY
6905 96TH AVE SOUTHEAST
MERCER ISLAND, WASHINGTON

CHADWICK WINTERS
 LAND SURVEYING AND MAPPING
 1422 N.W. 85TH ST., SEATTLE, WA 98117
 PHONE: 206.297.0996
 FAX: 206.297.0997
 WEB: WWW.CHADWICKWINTERS.COM

PROJECT #: 24-8081
DRAWING: 24-8081 TOPO
CLIENT: TERRY LONG
DATE: 9/04/2024
DRAWN BY: TTB

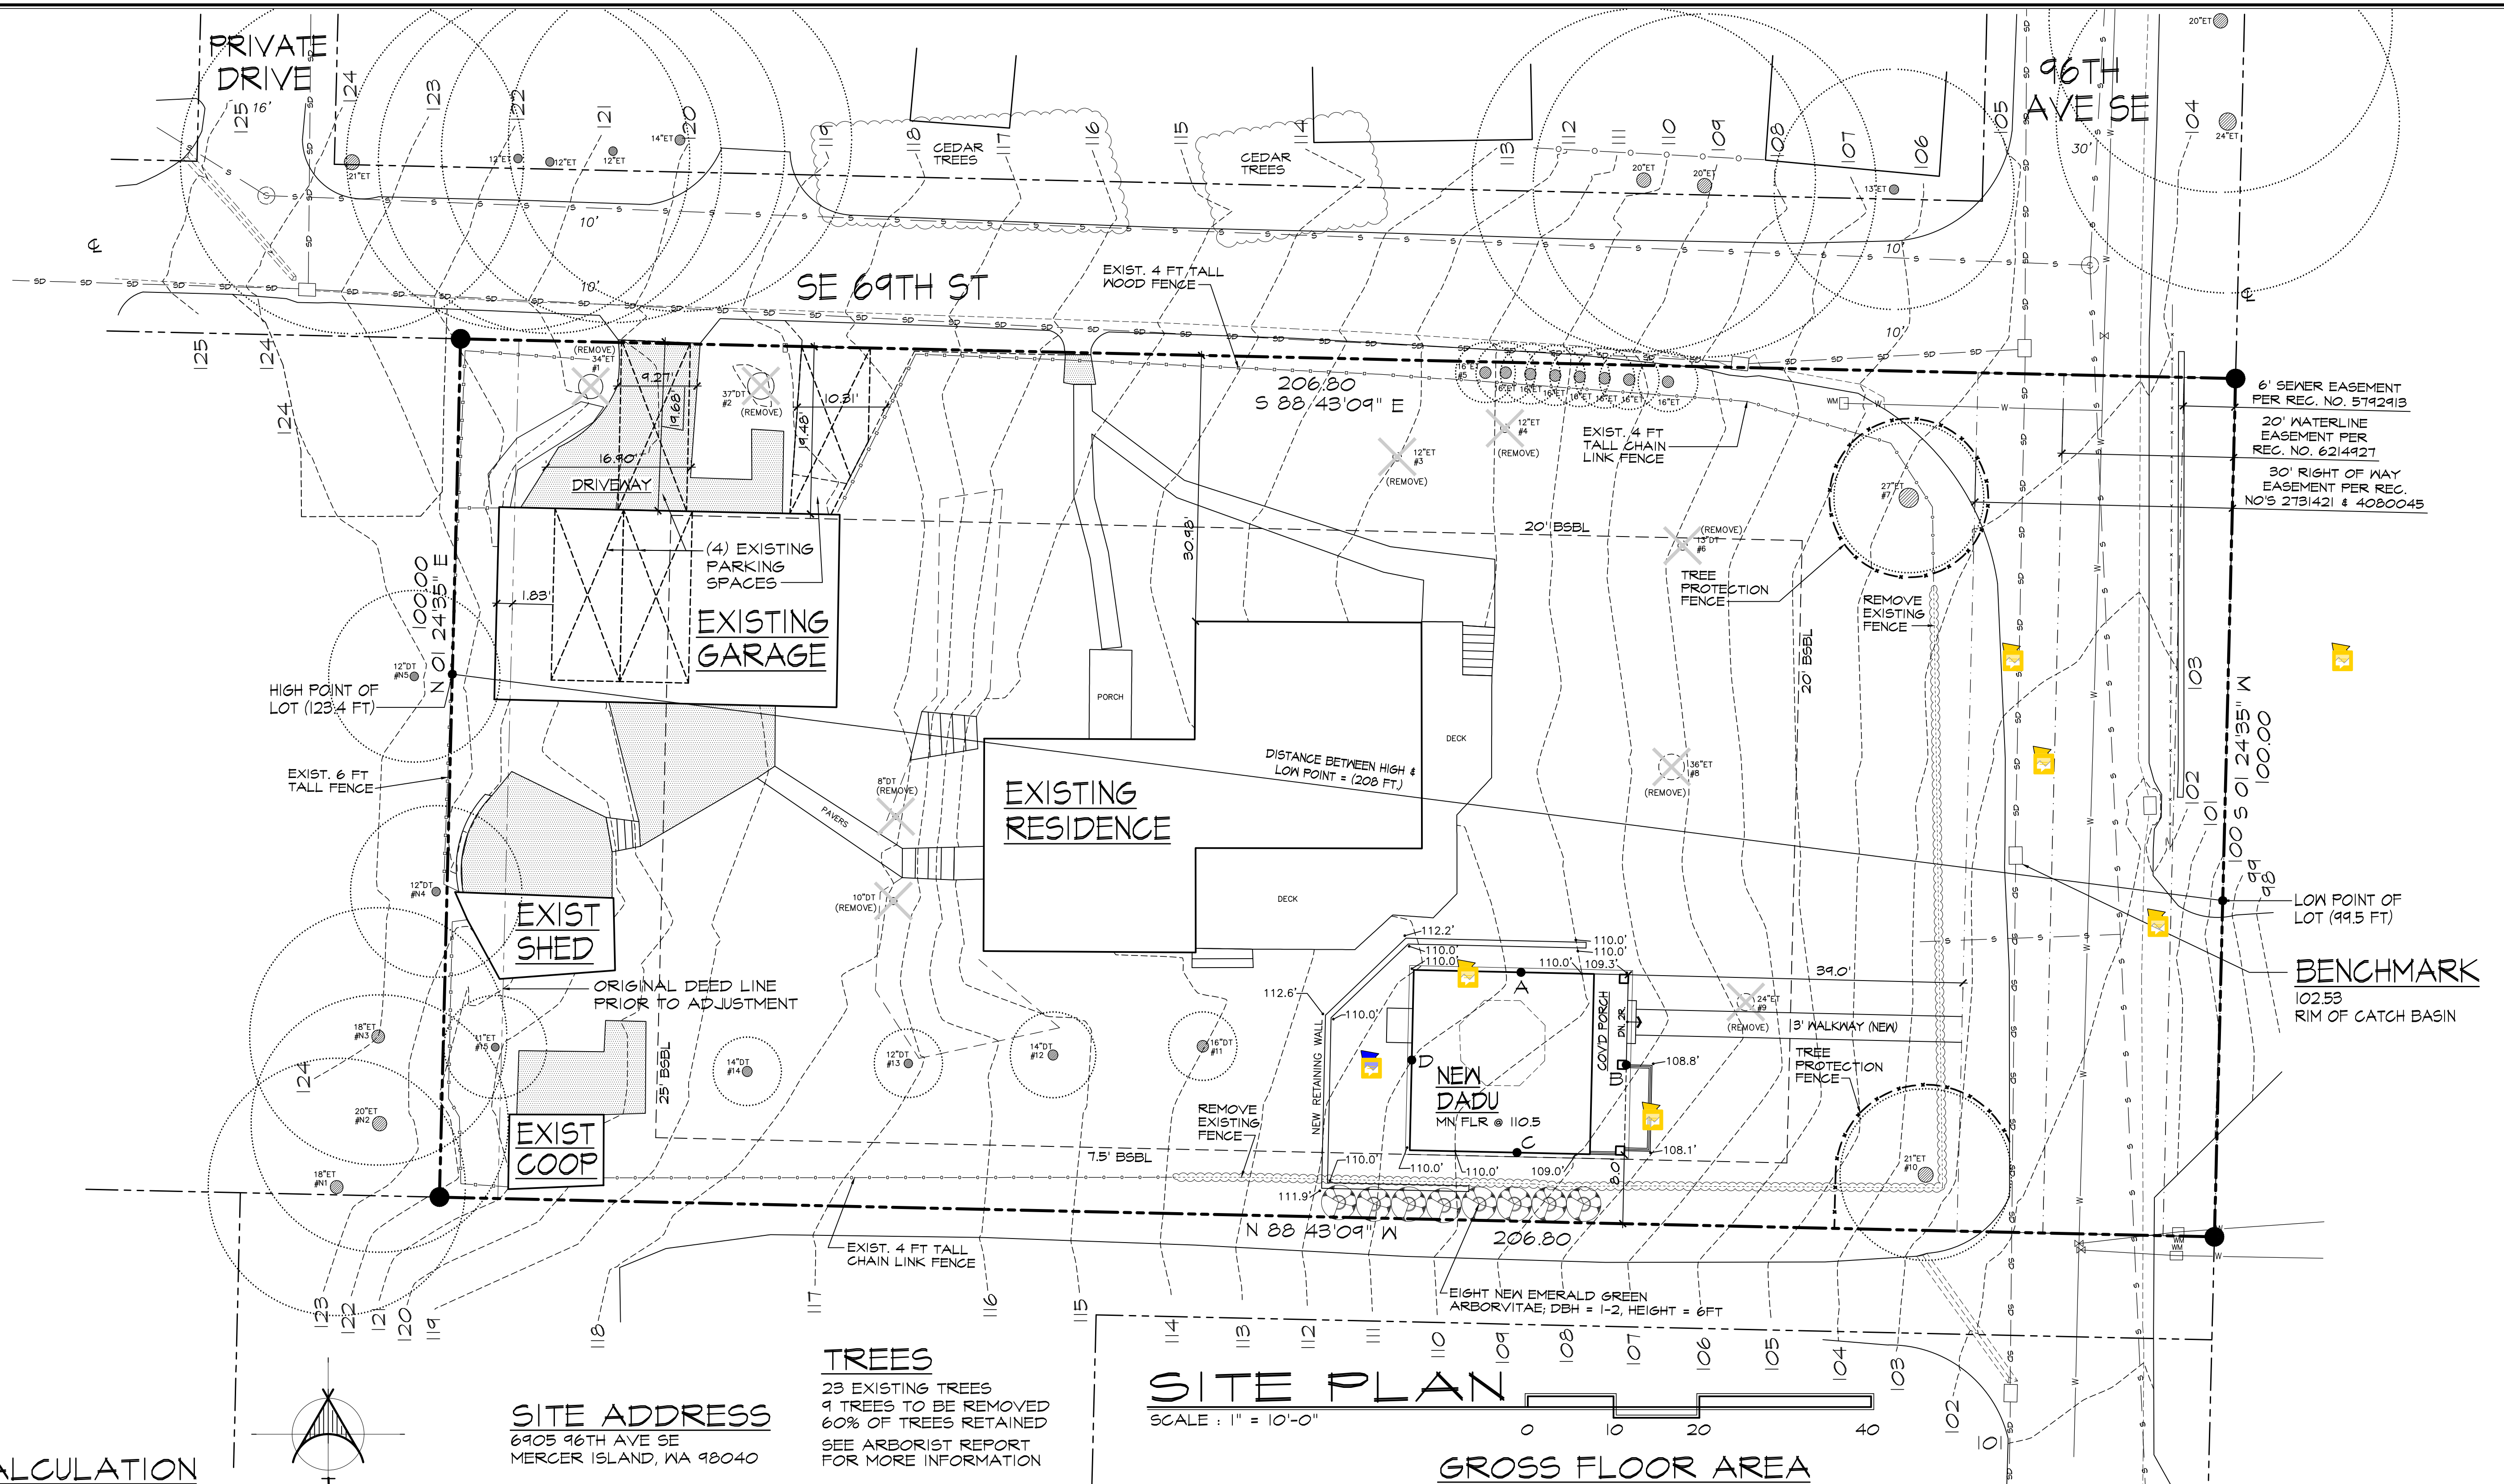

SITE PLAN
 SCALE: 1" = 10'-0"

HEIGHT CALCULATION

MIDPOINT ELEVATION	WALL SEGMENT LENGTH
A = 110.0	a = 25 ft
B = 109.1	b = 21 ft
C = 109.5	c = 25 ft
D = 110.0	d = 21 ft

ABE CALCULATION

$$\frac{(110.0)(25) + (109.1)(21) + (109.5)(25) + (110.0)(21)}{25 + 21 + 25 + 21} = 109.66$$

109.66 AVERAGE BUILDING ELEVATION (ABE)
 +30.00
 139.66 (MAX. HT. ALLOWED)
 133.08 (ACTUAL HEIGHT)
 6.58 (BELOW MAX. HT.)

NOTE: REFER TO ELEVATIONS ON SHEET A7 IN ARCHITECTURAL PLANS FOR HEIGHT CALC. DIMENSIONS

SITE ADDRESS
 6905 96TH AVE SE
 MERCER ISLAND, WA 98040

LOT COVERAGE

20680 S.F.	GROSS LOT AREA
17680 S.F.	NET LOT AREA
7,072 S.F.	ALLOWED LOT COVERAGE AREA
40%	ALLOWED LOT COVERAGE %

EXISTING LOT COVERAGE

1,306 S.F.	HOUSE
842 S.F.	GARAGE
144 S.F.	SHED
93 S.F.	COOP
322 S.F.	DRIVE
2,762 S.F.	TOTAL

NEW LOT COVERAGE

583 S.F.	DADU
3,345 S.F.	TOTAL PROJECT LOT COV'G AREA
18.9%	PROPOSED % LOT COVERAGE AREA

TREES

23 EXISTING TREES
 9 TREES TO BE REMOVED
 60% OF TREES RETAINED
 SEE ARBORIST REPORT FOR MORE INFORMATION

HARDSCAPE CALCULATIONS

20680 S.F.	GROSS LOT AREA
17680 S.F.	NET LOT AREA
3,727 S.F.	AREA BORROWED FROM LOT COVERAGE
5,318 S.F.	ALLOWED HARDSCAPE AREA (9% OF LOT AREA + BORROWED)

NEW HARDSCAPE AREA

1,579 S.F.	EXISTING HARDSCAPE AREA
25 S.F.	PATIO
10 S.F.	BACK SLAB
119 S.F.	WALK
47 S.F.	RETAINING WALL
201 S.F.	TOTAL NEW HARDSCAPE AREA

1,780 S.F. TOTAL PROJECT HARDSCAPE AREA (10% OF LOT)

GROSS FLOOR AREA

1,100 S.F.	MAIN FLOOR
290 S.F.	UPPER FLOOR
1,390 S.F.	TOTAL

EXISTING GARAGE

400 S.F.	MAIN LIVING
680 S.F.	UPPER LIVING
460 S.F.	GARAGE
1,540 S.F.	TOTAL

EXISTING SHED

149 S.F.

EXISTING COOP

93 S.F.

3,172 S.F. TOTAL EXISTING

NEW DADU

441 S.F.	MAIN FLOOR
471 S.F.	UPPER FLOOR
912 S.F.	TOTAL

4,084 S.F. TOTAL EXISTING + NEW

LEGAL DESCRIPTION

TAX PARCEL NUMBER: 3024059103
 THE EAST 200 FEET OF THE SOUTH 100 FEET OF THE NORTH 530 FEET OF THE EAST 430 FEET OF GOVERNMENT LOT 3, SECTION 30, TOWNSHIP 24 NORTH, RANGE 5 EAST, W.M., IN KING COUNTY, WASHINGTON.

TOGETHER WITH THE EAST 6.80 FEET OF THE EAST 100 FEET OF THE WEST 230 FEET OF THE EAST 430 FEET OF THE SOUTH 100 FEET OF THE NORTH 530 FEET OF GOVERNMENT LOT 3, SECTION 30, TOWNSHIP 24 NORTH, RANGE 5 EAST, W.M., KING COUNTY, WASHINGTON

SITUATE IN THE COUNTY OF KING, STATE OF WASHINGTON.

CUT
 13 CU. YDS.
LOT SLOPE
 23.9 FT / 208 FT = 11.49% SLOPE
LOT SIZE
 20,680 S.F.
ZONING
 R8.4

ENERGY CODE

2021 WASHINGTON STATE ENERGY CODE/ IECC (WSEC)
ALL CLIMATE ZONES - TABLE R402.1.3
INSULATION AND FENESTRATION REQUIREMENTS BY COMPONENT ^A

	PRESCRIPTIVE	EFFICIENT BUILDING ENVELOPE OPTION 1.2
FENESTRATION U-FACTOR ^B	0.30	0.25
SKYLIGHT ^B U-FACTOR	0.50	0.50
CEILING R-VALUE ^E	60	60
WOOD FRAME WALL ^{A1} R-VALUE	20+5 OR 13+10	20+5 OR 13+10
FLOOR R-VALUE	30	30
BELOW GRADE WALL ^{C1} R-VALUE	10/15/21 INT + 5TB	10/15/21 INT + 10TB
SLAB ^{D1} R-VALUE & DEPTH	10, 4 FT.	10, ENTIRE SLAB

TABLE R402.1.1 FOOTNOTES
FOR SI: 1 FOOT = 304.8 MM, C1 = CONTINUOUS INSULATION, INT. = INTERMEDIATE FRAMING.

^A R-VALUES ARE MINIMUMS. U-FACTORS AND SHGC ARE MAXIMUMS. WHEN INSULATION IS INSTALLED IN A CAVITY WHICH IS LESS THAN THE LABEL OR DESIGN THICKNESS OF THE INSULATION, THE COMPRESSED R-VALUE OF THE INSULATION FROM APPENDIX TABLE A101.4 SHALL NOT BE LESS THAN THE R-VALUE SPECIFIED IN THE TABLE.

^B THE FENESTRATION U-FACTOR COLUMN EXCLUDES SKYLIGHTS.

^C "10/15/21 +5TB" MEANS R-10 CONTINUOUS INSULATION ON THE EXTERIOR OF THE WALL, OR R-15 CONTINUOUS INSULATION ON THE INTERIOR OF THE WALL, OR R-21 CAVITY INSULATION PLUS A THERMAL BREAK BETWEEN THE SLAB AND THE BASEMENT WALL AT THE INTERIOR OF THE BASEMENT WALL. "10/15/21 +5TB" SHALL BE PERMITTED TO BE MET WITH R-13 CAVITY INSULATION ON THE INTERIOR OF THE BASEMENT WALL PLUS R-5 CONTINUOUS INSULATION ON THE INTERIOR OR EXTERIOR OF THE WALL. "5TB" MEANS R-5 THERMAL BREAK BETWEEN FLOOR SLAB AND BASEMENT WALL.

^D R-10 CONTINUOUS INSULATION IS REQUIRED UNDER HEATED SLAB ON GRADE FLOORS. SEE R402.2.4.1.

^E FOR SINGLE RAFTER- OR JOIST- VAULTED CEILING, THE INSULATION MAY BE REDUCED TO R-30 IF THE FULL INSULATION DEPTH EXTENDS OVER THE TOP PLATE OF THE EXTERIOR WALL.

^F R-15 CONTINUOUS INSULATION INSTALLED OVER AN EXISTING SLAB IS DEEMED TO BE EQUIVALENT TO THE REQUIRED PERIMETER SLAB INSULATION WHEN APPLIED TO EXISTING SLABS COMPLYING WITH SECTION R503.1.1. IF FOAM PLASTIC IS USED, IT SHALL MEET THE REQUIREMENTS FOR THE THERMAL BARRIERS PROTECTING FOAM PLASTICS.

^G FOR LOG STRUCTURES DEVELOPED IN COMPLIANCE WITH STANDARD ICC 400, LOG WALLS SHALL MEET THE REQUIREMENTS FOR CLIMATE ZONE 5 OF ICC 400.

^H INT. (INTERMEDIATE FRAMING) DENOTES FRAMING AND INSULATION AS DESCRIBED IN SECTION A105.2.2 INCLUDING STANDARD FRAMING 16 INCHES ON CENTER, 70 PERCENT OF THE WALL CAVITY INSULATED AND HEADERS INSULATED WITH A MINIMUM OF R-10 INSULATION.

^I THE FIRST VALUE IS CAVITY INSULATION, THE SECOND VALUE IS CONTINUOUS INSULATION. THEREFORE, AS AN EXAMPLE, "R13+10" MEANS R-13 CAVITY INSULATION PLUS R-10 CONTINUOUS INSULATION.

^J A MAXIMUM U-FACTOR OF 0.32 SHALL APPLY TO VERTICAL FENESTRATION PRODUCTS INSTALLED IN BUILDINGS LOCATED ABOVE 4000 FEET IN ELEVATION ABOVE SEA LEVEL, OR IN WINDBORNE DEBRIS REGIONS WHERE PROTECTION OF OPENINGS IS REQUIRED UNDER SECTION R301.2.2 OF THE INTERNATIONAL RESIDENTIAL CODE.

1. A CERTIFICATE COMPLYING WITH 2021 WSEC R403.3 IS REQUIRED TO BE COMPLETED BY THE BUILDER OR APPROVED PARTY AND PERMANENTLY POSTED.
2. AT LEAST ONE THERMOSTAT SHALL BE PROVIDED FOR EACH SEPARATE HEATING AND COOLING SYSTEM.
3. ALL PERMANENTLY INSTALLED LIGHTING FIXTURES, EXCLUDING KITCHEN APPLIANCES, SHALL CONTAIN ONLY HIGH-EFFICIENCY LIGHTING SOURCES.

WHOLE HOUSE VENTILATION

WHOLE HOUSE VENTILATION SYSTEM TO BE DESIGNED PER WSEC AMENDMENTS TO 2021 IRC SECTION M1505.4.4.

SEE "WHOLE HOUSE VENTILATION" ON THE SCHEDULE SHEET FOR SELECTED OPTION.

WHOLE-HOUSE MECHANICAL VENTILATION AIRFLOW RATE PER EQUATION I5-1 (M1505.4.5)

VENTILATION QUALITY ADJUSTMENT PER EQUATION I5-2 (M1505.4.5.1)

IRC TABLE M1505.4.3(2)

INTERMITTENT WHOLE-HOUSE MECHANICAL VENTILATION RATE FACTORS ^{A,B}

RUN TIME PERCENTAGE IN EACH 4-HOUR SEGMENT	50%	66%	75%	100%
FACTOR	2	1.5	1.3	1.0

- A. FOR VENTILATION SYSTEM RUN TIME VALUES BETWEEN THOSE GIVEN, THE FACTORS ARE PERMITTED TO BE DETERMINED BY INTERPOLATION.
- B. EXTRAPOLATION BEYOND THE TABLE IS PROHIBITED.

MECHANICAL

GENERAL

SOLID FUEL BURNING APPLIANCES INCLUDE AIRTIGHT STOVES, FIREPLACE STOVES, ROOM HEATERS, FACTORY BUILT FIREPLACES AND FIREPLACE INSERTS. ALL SOLID FUEL BURNING APPLIANCES SHALL COMPLY WITH THE PROVISIONS OF I.R.C. R1006.6

HEATING

EACH DWELLING UNIT SHALL BE PROVIDED WITH HEATING FACILITIES CAPABLE OF MAINTAINING A TEMPERATURE OF 68 DEGREES FAHRENHEIT AT A HEIGHT OF 3'-0" ABOVE THE FLOOR AND TWO FEET FROM EXTERIOR WALLS IN ALL HABITABLE ROOMS WHEN THE OUTSIDE TEMPERATURE IS AS SET FORTH IN THE 2021 W.S.E.C.

DEFINITION OF BUILDING THERMAL ENVELOPE FROM THE 2021 WASHINGTON STATE ENERGY CODE:

THE BELOW-GRADE WALLS, ABOVE-GRADE WALLS, FLOORS, CEILING, ROOF, AND ANY OTHER BUILDING ELEMENT ASSEMBLIES THAT ENCLOSE CONDITIONED SPACE OR PROVIDES A BOUNDARY BETWEEN CONDITIONED SPACE AND EXEMPT OR UNCONDITIONED SPACE.

1. FUEL BURNING APPLIANCES LOCATED WITHIN THE BUILDING ENVELOPE SHALL OBTAIN AIR FROM OUTDOORS, MEETING THE PROVISIONS OF IRC 6240.1
2. FUEL BURNING APPLIANCES LOCATED OUTSIDE THE BUILDING ENVELOPE SHALL MEET THE PROVISIONS OF CHAPTER 24 OF THE 2021 IRC.
3. DUCTWORK LOCATION SHALL MEET THE PROVISIONS OF CHAPTER 24 OF THE 2021 IRC.
4. COMBUSTION AIR TO MEET THE REQUIREMENTS OF I.R.C. M101.1

ALL WARM AIR FURNACES SHALL BE LISTED AND LABELED BY AN APPROVED AGENCY PER CHAPTER M302 OF THE 2021 IRC.

NO WARM AIR FURNACE SHALL BE INSTALLED IN A ROOM USED OR DESIGNED TO BE USED AS A BEDROOM, BATHROOM, CLOSET OR IN ANY ENCLOSED SPACE WITH ACCESS ONLY THROUGH SUCH ROOM OR SPACE, EXCEPT PER EXCEPTIONS IN IRC 62406.2

LIQUEFIED PETROLEUM GAS BURNING APPLIANCES SHALL NOT BE INSTALLED IN A PIT, BASEMENT OR SIMILAR LOCATION WHERE HEAVIER THAN AIR GASES MIGHT COLLECT. APPLIANCES SO FUELED SHALL NOT BE INSTALLED IN AN ABOVE GRADE UNDER FLOOR SPACE OR BASEMENT UNLESS SUCH LOCATION IS PROVIDED WITH AN APPROVED MEANS FOR REMOVAL OF UNBURNED GAS.

HEATING AND COOLING APPLIANCES LOCATED IN A GARAGE AND WHICH GENERATE A GLOW, SPARK OR FLAME CAPABLE OF IGNITING FLAMMABLE VAPORS SHALL BE INSTALLED WITH THE PILOTS AND BURNERS OR HEATING ELEMENTS AND SWITCHES AT LEAST 18" ABOVE THE FLOOR SURFACE.

FIRE DAMPERS NEED NOT BE INSTALLED IN AIR DUCTS PASSING THROUGH THE WALL, FLOOR OR CEILING SEPARATING A RESIDENCE (R-3 OCCUPANCY) FROM A GARAGE, PROVIDED SUCH DUCTS WITHIN THE GARAGE ARE CONSTRUCTED OF STEEL HAVING A THICKNESS NOT LESS THAN 0.014" (NO. 26 GALVANIZED SHEET GAUGE) AND HAVE NO OPENINGS INTO THE GARAGE.

EVERY APPLIANCE DESIGNED TO BE VENTED SHALL BE CONNECTED TO A VENTING SYSTEM COMPLYING WITH CHAPTER 19 OF THE 2021 IRC.

EVERY FACTORY BUILT CHIMNEY, TYPE L VENT, TYPE B GAS VENT OR TYPE BM GAS VENT SHALL BE INSTALLED IN ACCORDANCE WITH THE TERMS OF ITS LISTING, MANUFACTURERS INSTALLATION INSTRUCTIONS AND THE REQUIREMENTS PER CHAPTER 24 OF THE 2021 IRC.

A TYPE B OR BM GAS VENT SHALL TERMINATE PER CHAPTER 24 OF THE 2021 IRC.

VENT CONNECTORS SHALL BE INSTALLED WITHIN THE SPACE OR AREA IN WHICH THE APPLIANCE IS LOCATED AND SHALL BE CONNECTED TO A CHIMNEY OR VENT IN SUCH A MANNER AS TO MAINTAIN THE CLEARANCE TO COMBUSTIBLES PER SECTION M1603 OF THE 2021 IRC.

HEATING EQUIPMENT

ALL HEATING EQUIPMENT SHALL MEET THE REQUIREMENTS OF THE NATIONAL APPLIANCE ENERGY CONSERVATION ACT (NAECA) AND BE SO LABELED. EQUIPMENT SHALL ALSO COMPLY WITH SECTION M1411 OF THE 2021 IRC

DUCTWORK

1. DUCT SYSTEMS OR FACTORY BUILT AIR DUCTS SHALL BE OF METAL AS SET FORTH BY TABLE I601.1 OF THE 2021 IRC.
2. RECTANGULAR, FLAT, OVAL AND ROUND DUCT JOINTS AND SEAMS SHALL BE AIRTIGHT PER SECTION M1601.4.1 OF THE 2021 IRC.
3. INSTALLATION OF DUCTS SHALL COMPLY WITH SECTION M1601.4 OF THE 2021 IRC.
4. DUCT INSULATION SHALL BE INSTALLED IN ACCORDANCE WITH SECTION M1601.3 OF THE 2021 IRC.
5. FINAL DUCT LEAKAGE AFFIDAVIT IS TO BE PROVIDED TO THE BUILDING INSPECTOR PRIOR TO FINAL INSPECTION. DUCT LEAKAGE AND SEALING REQUIREMENTS IN 2021 W.S.E.C. SECTION R403.3.4 THRU R403.3.6 TO BE MET.
6. DUCTS INSULATED TO A MINIMUM R-8 INSULATION IN UNCONDITIONED SPACES PER W.S.E.C. SECTION R403.3.1

CARPENTRY

GENERAL

ALL FRAMING SHALL COMPLY WITH THE APPLICABLE SECTION(S) OF THE 2021 IRC/IRC. PRESSURE TREATED WOOD REQUIRED IN LOCATIONS LISTED IN IRC R311.

- 2" MINIMUM VERTICAL CLEARANCE BETWEEN WOOD & CONCRETE STEPS, PORCH SLABS, PATIO SLABS & OTHER SIMILAR HORIZONTAL SURFACES EXPOSED TO THE WEATHER.
- 6" MINIMUM CLEARANCE BETWEEN WOOD AND EARTH.
- 8" MINIMUM CLEARANCE BETWEEN UNTREATED JOISTS AND EARTH.
- 12" MINIMUM CLEARANCE BETWEEN FLOOR BEAMS AND EARTH.
- 18" MINIMUM CLEARANCE BETWEEN FLOOR JOISTS AND EARTH.

LOADING

ROOF	15 PSF DEAD LOAD	+	25 PSF LIVE LOAD	=	40 PSF
ROOF w/ SOLAR PANELS	20 PSF DEAD LOAD	+	25 PSF LIVE LOAD	=	40 PSF
FLOOR TRUSSES	15 PSF DEAD LOAD	+	40 PSF LIVE LOAD	=	55 PSF
FLOOR	10 PSF DEAD LOAD	+	40 PSF LIVE LOAD	=	50 PSF
CEILING	5 PSF DEAD LOAD	+	10 PSF LIVE LOAD	=	15 PSF
DECK	10 PSF DEAD LOAD	+	60 PSF LIVE LOAD	=	70 PSF
INTERIOR PARTITION				=	1 PSF
EXTERIOR PARTITION				=	10 PSF

WOOD BEARING OR OR INSTALLED WITHIN 1/2" OF MASONRY OR CONCRETE TO BE TREATED WITH AN APPROVED PRESERVATIVE. SOLID BLOCKING OF NOT LESS THAN 2x THICKNESS SHALL BE PROVIDED AT ENDS AND AT ALL SUPPORT OF JOISTS AND RAFTERS. ANCHOR BOLTS TO BE PER SHEAR WALL SCHEDULE AND FOUNDATION PLAN. 7" MINIMUM EMBEDMENT. ALL METAL FRAMING ANCHORS AND HANGERS SHOWN ON DRAWINGS SHALL BE STRONG TIE CONNECTORS AS MANUFACTURED BY SIMPSON COMPANY.

PROVIDE FIREBLOCKING IN CONCEALED SPACES OF STUD WALLS & PARTITIONS, INCLUDING FURRED SPACES & PARALLEL ROWS OF STUDS OR STAGGERED STUDS AS FOLLOWS.

1. VERTICALLY AT THE CEILING & FLOOR LEVELS.
2. HORIZONTALLY AT INTERVALS NOT EXCEEDING 10 FEET.

PROVIDE FIREBLOCKING AT OTHER LOCATIONS PER 2021 IRC R302.11.

INSULATION & MOISTURE PROTECTION

GENERAL

UNLESS NOTED OTHERWISE, INSULATION SHALL CONFORM TO THE WASHINGTON STATE ENERGY CODES. INSULATION BAFFLES TO MAINTAIN 1" CLEAR SPACE ABOVE INSULATION. BAFFLES TO EXTEND 6" ABOVE BATT INSULATION & 12" ABOVE LOOSE FILL INSULATION. INSULATE BEHIND BATHTUBS, SHOWERS, PARTITIONS AND CORNERS. PROVIDE FACE STAPLED BATTS OR FRICTION FIT FACED BATTS. PROVIDE 4 MIL (0.004") POLYETHYLENE VAPOR BARRIER AT WALLS OR USE CLASS II PRIMER. PROVIDE R-10 INSULATION UNDER ELECTRIC WATER HEATERS.

INFILTRATION CONTROL

1. EXTERIOR JOINTS AROUND WINDOWS AND DOOR FRAMES, OPENINGS BETWEEN WALLS AND FOUNDATIONS, BETWEEN WALLS AND ROOF AND BETWEEN WALL PANELS, OPENINGS AT PENETRATIONS OF UTILITY SERVICES THROUGH WALLS, FLOORS, AND ROOF, AND ALL OTHERS SUCH OPENINGS IN THE BUILDING ENVELOPE, INCLUDING ACCESS PANELS INTO UNHEATED SPACES, SHALL BE SEALED, CAULKED, GASKETED OR WEATHER-STRIPPED TO LIMIT AIR INFILTRATION.
2. ALL EXTERIOR DOORS, OTHER THAN FIRE-RATED DOORS, SHALL BE DESIGNED TO LIMIT AIR INFILTRATION AROUND THEIR PERIMETER WHEN IN A CLOSED POSITION. DOORS BETWEEN RESIDENCE AND GARAGE ARE NOT CONSIDERED "FIRE-RATED" AND MUST MEET THE ABOVE REQUIREMENT.
3. ALL EXTERIOR WINDOWS SHALL BE DESIGNED TO ADMIT AIR INFILTRATION INTO OR FROM THE BUILDING ENVELOPE WHICH SHALL BE SUBSTANTIATED BY TESTING TO STANDARD ASTM E 283-T8. SITE BUILT AND MILLWORK SHOP MADE WOODEN SASH ARE EXEMPT FROM TESTING BUT SHALL BE WEATHER-STRIPPED, CAULKED AND MORE TIGHTLY FITTING.
4. RECESSED LIGHT FIXTURES TO LIMIT AIR LEAKAGE PER W.S.E.C.

PIPING FOR HOT WATER / STEAM SYSTEMS OF PIPING FOR CONTINUOUSLY CIRCULATING HOT WATER SERVICE IS REQUIRED TO BE INSULATED PER THE W.S.E.C. HOT WATER PIPING SHALL BE INSULATED TO A MINIMUM OF R-3 PER W.S.E.C. R403.5.3. MECHANICAL SYSTEM PIPING SHALL BE INSULATED TO A MINIMUM R-6 PER W.S.E.C. R403.4

VAPOR BARRIERS / GROUND COVERS

AN APPROVED VAPOR BARRIER SHALL BE PROPERLY INSTALLED IN ROOF DECKS, IN ENCLOSED RAFTER SPACES FORMED WHERE CEILING ARE APPLIED DIRECTLY TO THE UNDERSIDE OF ROOF RAFTERS, AND AT EXTERIOR WALLS. INSET STAPLED BATTS WITH A FERM RATINGS LESS THAN ONE MAY BE INSTALLED IF THE VAPOR BARRIER IS TO THE WARM SIDE, STAPLES SHALL BE PLACED NOT MORE THAN 8" O.C. AND GAPS BETWEEN THE FACING AND THE FRAMING SHALL NOT EXCEED 1/16"

VAPOR RETARDERS AT WALLS PER IRC R702.7

A GROUND COVER OF 6 MIL (0.006") BLACK POLYETHYLENE OR EQUIVALENT SHALL BE LAID OVER THE GROUND IN ALL CRAWL SPACES. THE GROUND COVER SHALL BE OVERLAPPED ONE FOOT AT EACH JOINT AND SHALL EXTEND TO THE FOUNDATION WALL.

DOORS, WINDOWS AND SKYLIGHTS

GENERAL

THE REQUIRED EGRESS DOOR MAY HAVE A MAXIMUM 7/8" STEP ON THE EXTERIOR SIDE FROM TOP OF THE THRESHOLD TO A MINIMUM 36" DEEP LANDING ON THE EXTERIOR SIDE OF THE DOOR. PROVIDED THE DOOR DOES NOT SWING OVER THE LANDING, PER R311.3.1. OTHER EXTERIOR DOORS MAY HAVE A MAXIMUM (2) 7/8" STEPS TO A MIN. 36" DEEP LANDING. ALL GLAZING SHALL MEET THE REQUIREMENTS OF THE 2021 W.S.E.C. TABLE R402.1.3 UNLESS NOTED OTHERWISE. ALL SKYLIGHTS AND SKYWALLS SHALL HAVE LAMINATED GLASS UNLESS NOTED OTHERWISE. ALL BEDROOM EMERGENCY EGRESS WINDOWS SHALL HAVE A MINIMUM NET CLEAR OPENING OF 5.7 SQUARE FEET. MINIMUM NET CLEAR OPERABLE WIDTH OF 20" AND A MINIMUM NET CLEAR OPENING HEIGHT OF 24", MAXIMUM HEIGHT FROM FLOOR OF 44" MEASURED FROM THE FINISHED FLOOR TO THE BOTTOM OF THE CLEAR OPENING. OPERABLE WINDOWS WITH A SILL OF MORE THAN 12" ABOVE FINISHED THE GRADE OR SURFACE BELOW, TO BE A MINIMUM OF 24" ABOVE ADJACENT FINISHED FLOOR.

SAFETY GLAZING LOCATIONS PER 2021 IRC SECTION R308.4

- R308.4.1 GLAZING IN ALL FIXED AND OPERABLE PANELS OF SWINGING, SLIDING AND BI-FOLD DOORS.
- R308.4.2 GLAZING IN AN INDIVIDUAL FIXED OR OPERABLE PANEL ADJACENT TO A DOOR WHERE THE BOTTOM EDGE IS LESS THAN 60 INCHES ABOVE THE FLOOR & THE GLAZING IS EITHER WITHIN 24 INCHES OF EITHER SIDE OF THE DOOR IN THE PLANE OF THE DOOR IN A CLOSED POSITION OR ON A WALL LESS THAN 180 DEGREES FROM THE PLANE OF THE DOOR IN A CLOSED POSITION & WITHIN 24 INCHES OF THE HINGE SIDE OF AN IN-SWINGING DOOR.
- R308.4.3 GLAZING IN AN INDIVIDUAL FIXED OR OPERABLE PANEL THAT MEETS ALL OF THE FOLLOWING CONDITIONS:
1. THE EXPOSED AREA OF AN INDIVIDUAL PANEL IS LARGER THAN 4 SQUARE FEET;
2. THE BOTTOM EDGE OF THE GLAZING IS LESS THAN 18" ABOVE THE FLOOR;
3. THE TOP EDGE OF THE GLAZING IS MORE THAN 36" ABOVE THE FLOOR; AND
4. ONE OR MORE WALKING SURFACES ARE WITHIN 36" MEASURED HORIZONTALLY AND IN A STRAIGHT LINE, OF THE GLAZING.
- R308.4.4 GLAZING IN GUARDS AND RAILINGS, INCLUDING STRUCTURAL BALUSTER PANELS AND NONSTRUCTURAL IN-FILL PANELS, REGARDLESS OF AREA OR HEIGHT ABOVE A WALKING SURFACE.
- R308.4.5 GLAZING IN WALLS, ENCLOSURES OR FENCES CONTAINING OR ADJACENT TO HOT TUBS, SPAS, WHIRLPOOLS, SAUNAS, STEAM ROOMS, BATHTUBS, SHOWERS AND INDOOR OR OUTDOOR SWIMMING POOLS WHERE THE BOTTOM EXPOSED EDGE OF THE GLAZING IS LESS THAN 60 INCHES MEASURED VERTICALLY ABOVE ANY STANDING OR WALKING SURFACE.
- R308.4.6 GLAZING WHERE THE BOTTOM EXPOSED EDGE OF THE GLAZING IS LESS THAN 36 INCHES (914 MM) ABOVE THE PLANE OF THE ADJACENT WALKING SURFACE OF STAIRWAYS, LANDINGS BETWEEN FLIGHTS OF STAIRS AND RAMPS.
- R308.4.7 GLAZING ADJACENT TO THE LANDING AT THE BOTTOM OF A STAIRWAY WHERE THE GLAZING IS LESS THAN 36 INCHES ABOVE THE LANDING AND WITHIN A 60° HORIZONTAL ARC LESS THAN 180 DEGREES FROM THE BOTTOM TREAD NOSING.

FOR EXCEPTIONS SEE IRC SECTION R308.4

GENERAL

PLANS COMPLY WITH THE 2021 INTERNATIONAL RESIDENTIAL CODE.

CONTRACTOR SHALL VERIFY ALL NOTES, DIMENSIONS AND CONDITIONS PRIOR TO CONSTRUCTION. CONTRACTOR SHALL PROVIDE TEMPORARY BRACINGS AS REQUIRED UNTIL ALL PERMANENT CONNECTIONS HAVE BEEN MADE. IT IS THE CONTRACTORS RESPONSIBILITY TO IDENTIFY ALL DISCREPANCIES TO THE ARCHITECT AT THE TIME THEY ARE NOTED. DIMENSIONS TAKE PRECEDENCE OVER SCALED DRAWINGS.

CODES:

- ALL APPLICABLE CODES AND AUTHORITIES HAVING JURISDICTION SHALL BE FOLLOWED
1. 2021 INTERNATIONAL RESIDENTIAL CODE (IRC) WITH WASHINGTON STATE AMENDMENTS (WSA) EXCEPT CHAPTERS 11 AND 25 THROUGH 42 ARE NOT ADOPTED. APPENDICES F,Q, & U ARE ADOPTED.
 2. 2021 INTERNATIONAL BUILDING CODE (IBC) WITH WASHINGTON STATE AMENDMENTS (WSA)
 3. 2021 INTERNATIONAL MECHANICAL CODE (IMC) WITH WASHINGTON STATE AMENDMENTS (WSA)
 4. 2021 UNIFORM PLUMBING CODE (UPC) WITH WASHINGTON STATE AMENDMENTS.
 5. 2021 INTERNATIONAL FIRE CODE WITH WASHINGTON STATE AMENDMENTS.
 6. 2021 WASHINGTON STATE ENERGY CODE, RESIDENTIAL PROVISIONS (WSEC).

LOCAL JURISDICTION REQUIRES DWELLING UNIT FIRE SPRINKLER SYSTEM PER IRC APPENDIX U YES NO NFPA 13D PLUS (FULL COVERAGE) FIRE SPRINKLER SYSTEM IN COMPLIANCE NFPA



SITE WORK

GENERAL

ALL FOOTINGS TO BEAR ON FIRM, UNDISTURBED EARTH BELOW ORGANIC SURFACE SOILS. ALL BACK FILL MATERIAL SHALL BE THOROUGHLY COMPACTED. FOUNDATION VENTS SHALL NOT INTERFERE WITH THE DIRECT LOAD PATH OF COLUMNS.

GROUND LOAD (PSF)	WIND DESIGN			SEISMIC DESIGN CATEGORY	SUBJECT TO DAMAGE FROM WEATHERING		WINTER DESIGN TEMP	ICE BARRIER UNDER-LAYMENT REQUIRED	FLOOD HAZARDS	AIR FREEZING INDEX	MEAN ANNUAL TEMP		
	SPEED (MPH)	TOPO-GRAPHIC EFFECTS	SPECIAL WIND REGION		WIND-BORNE DEBRIS ZONE	FROST LINE DEPTH						TERMITE	
25	110	YES	NO	NO	D2	MODERATE	12'	SLIGHT TO MODERATE	24°	NO	N/A	11B	59

EQUIVALENT FLUID PRESSURE = 35 P.C.F. (UNRESTRAINED WALLS)
50 P.C.F. (RESTRAINED WALLS)



SHEET INDEX

SHEET #	DESCRIPTION
SITE	
A0	SITE PLAN
ARCHITECTURAL	
A1	COVERSHEET
A2	SCHEDULE SHEET
A3	DETAIL SHEET
A4	FOUNDATION PLAN & MAIN FLOOR PLAN
A5	UPPER FLOOR FRAMING PLAN & UPPER FLOOR PLAN
A6	ROOF FRAMING PLAN + BUILDING SECTIONS
A7	EXTERIOR ELEVATIONS
STRUCTURAL	
S1	LATERAL - GENERAL STRUCTURAL NOTES & SCHEDULES
S2	LATERAL - NOTES, SCHEDULES & DETAILS
S3	LATERAL - CONCRETE DETAILS
S4	LATERAL - WOOD DETAILS
S5	LATERAL - SHEAR WALLS & HARDWARE

CLIENT: LONG DADU
6905 96TH AVE SE
MERCER ISLAND, WA 98040

© ARCHITECTS
NORTHWEST
1-888-272-4100

© ARCHITECTS
NORTHWEST
1-888-272-4100

Project Information
Long DADU
6905 96th AVE SE
Mercer Island, WA 98040

Contact Information

Messages / Comments * RESULT: PASS

UA Reduction = 2.45, Proposed UA is better than baseline by 1.2%

Window area is 20% of floor area

* Results assume your inputs are complete and correct. Results do not constitute an approval. Analysis should be reviewed by your AUI.

ANALYSIS SET UP

What code compliance pathway are you using? U-Factor Compliance Path

Project Building Type? New Construction

Occupancy Type? R3 Single family dwellings and townhouses

Code Version? WSEC 2021

Classification: Small Dwelling Unit - 912 sq. ft.

Baseline Description: Code Baseline - Baseline and proposed window areas are equal.

About Your Selection: Up to 15 sf exempt window and 24 sf exempt door allowable

RESULTS - Comparison of Baseline and Proposed Design **

Component Performance, R-occupancies	Baseline		Proposed Design	
	U*	UA	U	UA
Doors U =	0.300	0.00	0.300	0.00
Overhead Glazing U =	0.500	0.00	0.300	0.00
Vertical Glazing U =	0.300	179.53.7	0.300	179.53.7
Flat/Vaulted Ceilings U =	0.024	525.12.6	0.026	525.12.6
Wall (above grade) U =	0.056	1,671.93.6	0.054	1,671.90.2
Floors over Crawspace U =	0.029	84.2.4	0.029	84.2.4
Slab on Grade F =	0.540	79.42.5	0.540	79.42.5
Below Grade Wall U =	N/A	0.00	N/A	0.00
Below Grade Slab F =	N/A	0.00	N/A	0.00

* Values from Table R402.1.2 (Oct 2023)

Baseline UA Total	204.8
Proposed Credits	5.0
Required Credits	5.0

UA Percent Reduction 1%

UA Reduction 2.5

If the Proposed UA ≤ the Target UA, and the Proposed Credits from Table 406 are ≥ those required in Section R406, then the home meets the WSEC.

** Results assume your inputs are complete and correct. Results do not constitute an approval. Analysis should be reviewed by your AUI.

SIMPLE HEATING SYSTEM SIZE

This heating system sizing is based on the Prescriptive Requirements of the 2021 Washington State Energy Code. This is for heating only. ACCA procedures for sizing cooling systems should be used to determine cooling.

Indoor Design Temperature: 70
Outdoor Design Temperature: 24
Design Temperature Difference: 46
In Indoor - Outdoor Design Temp

Conditioned Floor Area: 912
Conditioned Volume: 8211

Glazing
Sum of UA from Glazing Schedule: 53.7

Attic
R-60 STD: U-Factor 0.025, Area 161, UA 4.03
Other: R-49 ADV: U-Factor 0.020, Area 0, UA 0

Single Rafter or Joist Vaulted Ceilings
R-38: U-Factor 0.026, Area 364, UA 9.46
Other: U-Factor 0, Area 0, UA 0

Above Grade Walls
R-21 INT + R0 (LAP): U-Factor 0.054, Area 1671, UA 90.23
Other: R-21 INT + R-5ci: U-Factor 0.043, Area 0, UA 0

Floors
R-30: U-Factor 0.029, Area 84, UA 2.44
Other: R-38: U-Factor 0.025, Area 0, UA 0

Below Grade Walls
R-21 Interior: U-Factor 0.035, Area 0, UA 0
R-10 Continuous exterior: U-Factor 0.064, Area 0, UA 0
Other: U-Factor 0, Area 0, UA 0

Slab Below Grade
R-10 Thermal break: F-factor 0.5, Length 0, UA 0
Other: R-5 Thermal break: F-factor 0.57, Length 0, UA 0

Slab on Grade
R-10 4' perimeter: F-factor 0.54, Length 78.67, UA 42.48
R-10 Fully insulated: F-factor 0.36, Length 0, UA 0
Other: F-factor 0, Length 0, UA 0

Sum of UA: 202.35

Envelope Heat Load: 9308 Btu / Hour
Sum of UA X Design Temperature Difference

Air Leakage Heat Load: 4079 Btu / Hour
(Volume X 0.6) X Design Outdoor Temp X 0.18)

Building Design Heat Load: 13387 Btu / Hour
Air Leakage + Envelope Heat Loss

Building and Duct Heat Load: 13387 Btu / Hour
Use 1.1 if ducts are located in unconditioned space: Sum of Building Heat Loss X 1.1
Use 1 if ducts are located in conditioned space: Sum of Building Heat Loss X 1

Maximum Heat Equipment Output: 16734 Btu / Hour
Use 1.4 for forced air furnace: Building & Duct Heat Loss x 1.4
Use 1.25 for heat pump: Building & Duct Heat Loss x 1.25

WINDOW, SKYLIGHT & DOOR SCHEDULE

ROOM	TYPE	DESCRIPTION	U-VAL	QTY	WIDTH	HEIGHT	AREA	UA
EXEMPT DOOR AND WINDOW								
SUM OF ALL GLAZING AREAS FROM BELOW: 179								
SUM OF AREA AND UA FOR HEATING SYSTEM SIZING: 53.7								
EXEMPT DOOR AND WINDOW								
SUM OF AREA AND UA FOR HEATING SYSTEM SIZING ONLY: 0.0								
EXTERIOR DOORS (OPaque)								
SUM OF AREA AND UA: 0.0								
AREA WEIGHTED U = UA/AREA: 0.00								
VERTICAL GLAZING								
SUM OF AREA AND UA: 179.02								
AREA WEIGHTED U = UA/AREA: 0.30								
OVERHEAD GLAZING								
SUM OF AREA AND UA: 0.00								
AREA WEIGHTED U = UA/AREA: 0.00								
VERTICAL GLAZING IN UNHEATED SPACES								
SUM OF VERTICAL GLAZING IN UNHEATED SPACES: 0.00								
OVERHEAD GLAZING IN UNHEATED SPACES								
SUM OF OVERHEAD GLAZING IN UNHEATED SPACES: 0.00								

PRESCRIPTIVE ENERGY CODE COMPLIANCE

This project will use the requirements of the Prescriptive Path below and incorporate the minimum values listed. In addition, based on the size of the structure, the appropriate number of additional credits are checked.

ALL CLIMATE ZONES - TABLE R402.1.3

Fenestration U-Factor*	Prescriptive	U-Factor Path	E.B.E. Option 1.2
Skylight U-Factor*	0.30	0.30	0.25
Wood Frame Wall R-Value*	20+5 or 13+10	0.056	20+5 or 13+10
Floor R-Value	30	0.029	38
Below Grade Wall R-Value*	10/15/21 int + 5TB	0.035	10/15/21 int + 5TB
Slab** R-Value & Depth	10, 4 ft	0.540	10, entire slab

See Table R402.1.2 for U-Factor path footnotes.
See Table R402.1.3 footnotes included on Sheet A1.

Each dwelling unit in a residential building shall comply with sufficient options from Table R406.2 & R406.3 so as to achieve the following minimum number of credits:

1. Small Dwelling Unit: 5.0 credits
Dwelling units less than 1500 square feet in conditioned floor area with less than 300 square feet of fenestration area. Additions to existing building that are greater than 500 square feet of heated floor area but less than 1500 square feet.

2. Medium Dwelling Unit: 8.0 credits
All dwelling units that are not included in #1 or #3.

3. Large Dwelling Unit: 9.0 credits
Dwelling units exceeding 5000 square feet of conditioned floor area.

4. Additions 150 square feet to 500 square feet: 2.0 credits

ENERGY CREDIT SUMMARY TABLES

Options	Fuel Normalization Descriptions	Credits	
1	Combustion heating, equipment per Table C403.3.2(5) or (6)	0.0	<input type="checkbox"/>
2	Heat pump with supplemental heating	1.5	<input type="checkbox"/>
3	Electric resistance heat only - forced air or zonal	0.5	<input type="checkbox"/>
4	Heat pump without supplemental heating	3.0	<input checked="" type="checkbox"/>
5	Electric resistance w/ mini-split heat pump or 2kw max capacity	2.0	<input type="checkbox"/>

Options	Energy Credit Option Descriptions	Credits	
1.1	Efficient Building Envelope	0.5	<input type="checkbox"/>
1.2	Efficient Building Envelope	1.0	<input type="checkbox"/>
1.3	Efficient Building Envelope	1.5	<input type="checkbox"/>
1.4	Efficient Building Envelope	2.5	<input type="checkbox"/>
2.1	Air Leakage Control and Efficient Ventilation	1.0	<input type="checkbox"/>
2.2	Air Leakage Control and Efficient Ventilation	1.5	<input type="checkbox"/>
2.3	Air Leakage Control and Efficient Ventilation	2.0	<input type="checkbox"/>
3.1	High Efficiency HVAC	1.0	<input type="checkbox"/>
3.2	High Efficiency HVAC	0.5	<input type="checkbox"/>
3.3	High Efficiency HVAC	0.5	<input type="checkbox"/>
3.4	High Efficiency HVAC	1.5	<input type="checkbox"/>
3.5	High Efficiency HVAC	1.5	<input type="checkbox"/>
3.6	High Efficiency HVAC	1.0	<input type="checkbox"/>
3.7	High Efficiency HVAC	2.0	<input checked="" type="checkbox"/>
3.8	High Efficiency HVAC	1.0	<input type="checkbox"/>
3.9	High Efficiency HVAC	1.5	<input type="checkbox"/>
3.10	High Efficiency HVAC	2.5	<input type="checkbox"/>
3.11	High Efficiency HVAC	0.5	<input type="checkbox"/>
4.1	High Efficiency HVAC Distribution System	0.5	<input type="checkbox"/>
5.1	Efficient Water Heating	0.5	<input type="checkbox"/>
5.2	Efficient Water Heating	0.5	<input type="checkbox"/>
5.3	Efficient Water Heating	0.5	<input type="checkbox"/>
5.4	Efficient Water Heating	1.0	<input type="checkbox"/>
5.5	Efficient Water Heating	1.5	<input type="checkbox"/>
5.6	Efficient Water Heating	2.0	<input type="checkbox"/>
5.7	Efficient Water Heating	2.5	<input type="checkbox"/>
5.8	Efficient Water Heating	2.5	<input type="checkbox"/>
6.1	Renewable Electric Energy (0.5 credits per 600kwh, 4.5 max)	0.0	<input type="checkbox"/>
7.1	Appliance Package	0.5	<input type="checkbox"/>
Total Credits		5.0	

AIR LEAKAGE

Components of the building thermal envelope as listed in TABLE R402.4.1.1 shall be installed per manufacturer's specifications to limit air leakage rate to not exceed 4 air changes per hour (ACH)

AIR LEAKAGE CALCULATION (maximum blower test CFM)	CFM _{50-cfm}	ACTUAL Blower test result
maximum ACH	CFM _{50-cfm} = BLDG VOL (ft³) X 4 ACH / 60 min = 547 cfm	cfm

ROOF VENTILATION

Standard Truss / Scissor Truss Roof Framing Assembly: UPPER ROOF

Roof Area: 525 s.f.
Ventilation Required: 525 s.f. x 144 / 300 = 252 s.i. Req'd

Provides between 40% & 50% of the total required ventilation no more than 3 ft below the ridge or the highest point of the space. Remainder to be installed at eave vents.

Upper Roof Ventilation:
AF50 Roof Jack (10" x 7") = 50.00 s.i. each
Upper Ventilation MINIMUM = 252 s.i. x 0.4 / s.i. of each vent = 3 vents
Upper Ventilation MAXIMUM = 252 s.i. x 0.5 / s.i. of each vent = 3 vents
Provide: 3 -10"x7" roof jacks. Ventilation = 150.00 s.i.
Ventilation area remainder for eave vents = 102.00 s.i. (Req'd vent-Upper vent)

Eave Ventilation:
Birdblocking: (3/2.25" dia holes per bay = 5.96 s.i. per l.f. - 25% reduction = 4.47 s.i. per l.f.
Eave Ventilation Required = 102.00 s.i. / 4.47 s.i. per l.f. = 22.82 l.f.
Provide Minimum: 23 l.f. birdblocking. Ventilation = 102.81 s.i.
Minimum Ventilation Provided = 252.81 s.i. IS GREATER THAN: 252 s.i. Req'd

VAPOR RETARDER

FLOOR	<input type="checkbox"/> 4 MIL POLY	<input type="checkbox"/> FACE STAPLED BACKED BATTS	<input checked="" type="checkbox"/> PLYWOOD W/ EXT. GLUE
WALL	<input type="checkbox"/> 4 MIL POLY	<input type="checkbox"/> FACE STAPLED BACKED BATTS	<input checked="" type="checkbox"/> CLASS II PRIMER
RM JOIST	<input type="checkbox"/> 4 MIL POLY	<input checked="" type="checkbox"/> FOIL-FACE STAPLED BACKED BATTS	<input type="checkbox"/> CLASS II PRIMER
CEILING	<input type="checkbox"/> 4 MIL POLY	<input type="checkbox"/> FACE STAPLED BACKED BATTS	<input checked="" type="checkbox"/> CLASS II PRIMER

NOTE: CLASS II DEFINED AS PERM RATING GREATER THAN 0.1 AND LESS THAN OR EQUAL TO 1.0

WHOLE-HOUSE MECHANICAL VENTILATION (PRESCRIPTIVE)

WHOLE-HOUSE MECHANICAL VENTILATION SYSTEMS SHALL BE DESIGNED IN ACCORDANCE WITH SECTIONS M1505.4.1 THROUGH M1505.4.4 (WASHINGTON STATE AMENDMENTS)

WHOLE-HOUSE VENTILATION USING EXHAUST FANS (M1505.4.1.2)

WHOLE-HOUSE VENTILATION USING SUPPLY FANS (M1505.4.1.3)

WHOLE-HOUSE VENTILATION SYSTEM, BALANCED (M1505.4.1.4)

WHOLE-HOUSE VENTILATION USING AIR HANDLER INTEGRATED SUPPLY (M1505.4.1.5)

MECHANICAL VENTILATION AIRFLOW RATE PER EQUATION 15-1 (M1505.4.3)

39.12 CFM (CONTINUOUS)

VENTILATION QUALITY ADJUSTMENT PER EQUATION 15-2 (M1505.4.3.1)

BALANCED & DISTRIBUTED (1.0 COEFFICIENT)

BALANCED & NOT DISTRIBUTED (1.25 COEFFICIENT)

NOT BALANCED & DISTRIBUTED (1.25 COEFFICIENT)

NOT BALANCED & NOT DISTRIBUTED (1.5 COEFFICIENT)

ADJUSTED MECHANICAL VENTILATION AIRFLOW RATE = 58.68 CFM (CONTINUOUS)

INTERMITTENT OFF OPERATION (M1505.4.3.2)

RUN-TIME % IN EACH 4-HOUR SEGMENT

50 PERCENT

66 PERCENT

75 PERCENT

100 PERCENT

INTERMITTENT FLOW RATE = 76.284 CFM

EXHAUST RATES

WSBC AMENDMENTS TO 2021 IRC SECTION M1505

SYMBOL	LOCATION	MINIMUM FAN REQUIREMENTS
A	Bath, Powder	Minimum 50 cfm intermittent, 20 cfm Continuous (IRC TABLE M1505.4.4(1))
B	Kitchen	INTERMITTENT-OPEN OR ENCLOSED KITCHEN Hood over electric range 65% CE or 160 CFM. Hood over combustion range 80% CE or 250 CFM. CONTINUOUS-ENCLOSED KITCHENS 5 ACH based on kitchen volume.
C	Whole House Fan	Flow rate per WHOLE-HOUSE MECHANICAL VENTILATION schedule

All fans to vent to outside. All other requirements of the 2021 WSEC and the WSBC amendments to the 2021 IRC section M1505 must be met.

ALARM SCHEDULE

2021 IRC SECTIONS R314 & R315

SYMBOL	DESCRIPTION	REQUIREMENTS
SA	Smoke Alarm	*110 V interconnected w/ battery backup. *Installed on each floor, in each sleeping room, and outside each separate sleeping area. Installed not less than 3 ft from the door of a bath which contains a tub or shower unless this prevents placement in a required location. *Listed in accordance with UL 217 and to comply with NFPA 72.
SA/CM	Combination Smoke Alarm & Carbon Monoxide Alarm	*Installed on each floor, outside of each separate sleeping area in the immediate vicinity of the bedrooms, and in a bedroom that contains a gas fireplace in the bedroom or adjacent bathroom. *Smoke alarm requirements per above. *Combination smoke & carbon monoxide alarms listed in accordance with UL 217 & UL 2034.
HD	Heat Detector	*A heat detector or heat alarm to be installed in a central location in the garage and per the manufacturer's instructions. * Heat detector shall be interconnected to an alarm installed in the dwelling unit.


REGISTERED ARCHITECT
9046
ARCHITECTS NORTHWEST
WOODINVILLE, WA 98072
OFFICE: (425) 485-4800
FAX: (425) 487-6585
TOLL FREE: 1-888-272-4100
WWW.ARCHITECTSNW.COM

DESIGNED BY: MBJ DATE: 05/20/23
DRAWN BY: BPS DATE: 1/24/23
PROJECT MANAGER: MARCUS JENKINS
REVISED BY: BPS DATE: 8/15/23


LATERAL BY: ZVELT DATE: 6/25/23
LATERAL JOB NUMBER: 25-120

A2
A7


ANW JOB NUMBER: 250052

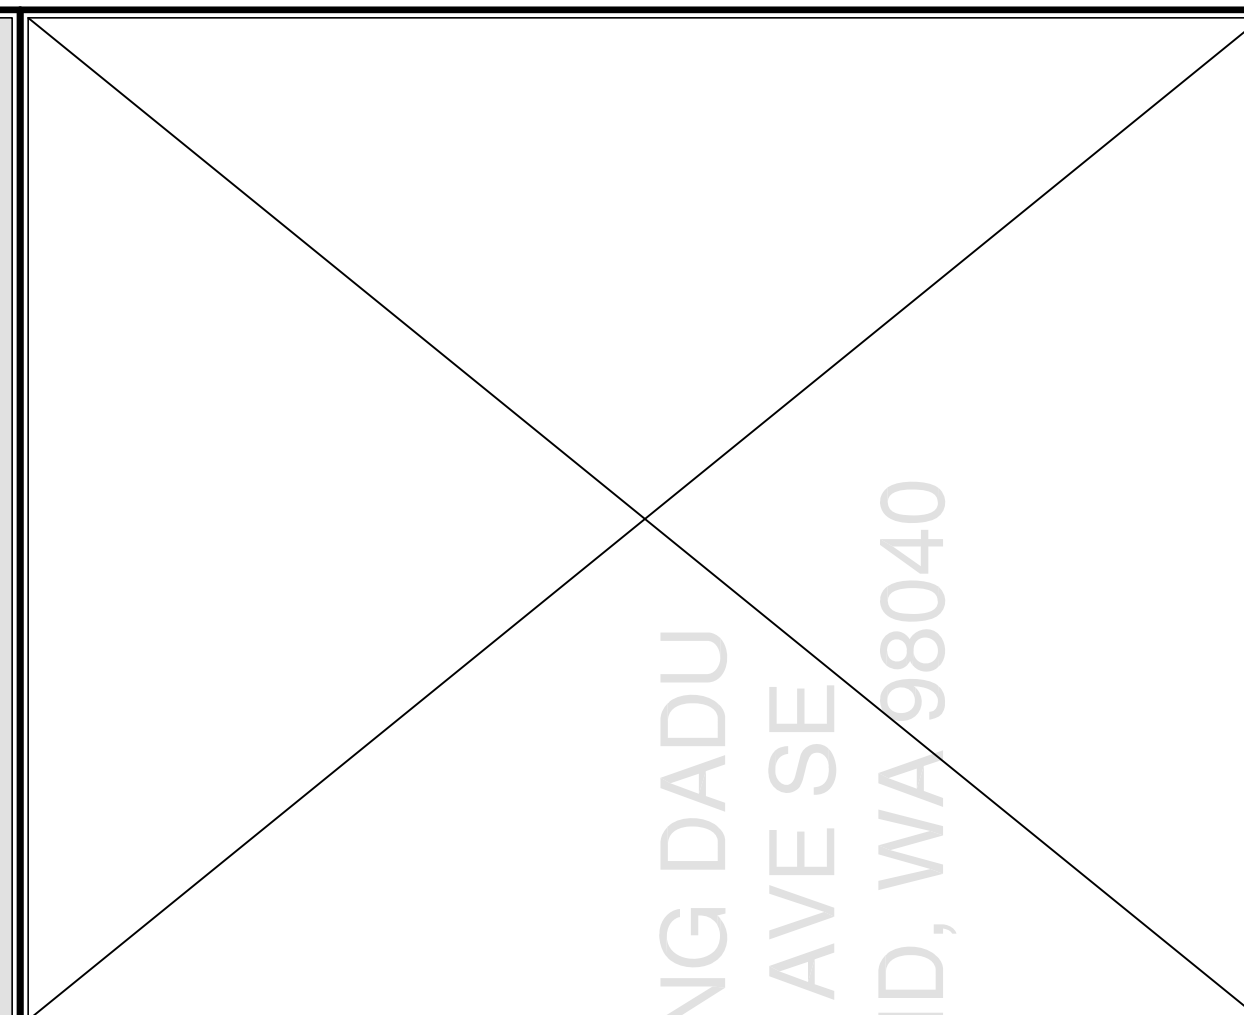


1 NOT USED

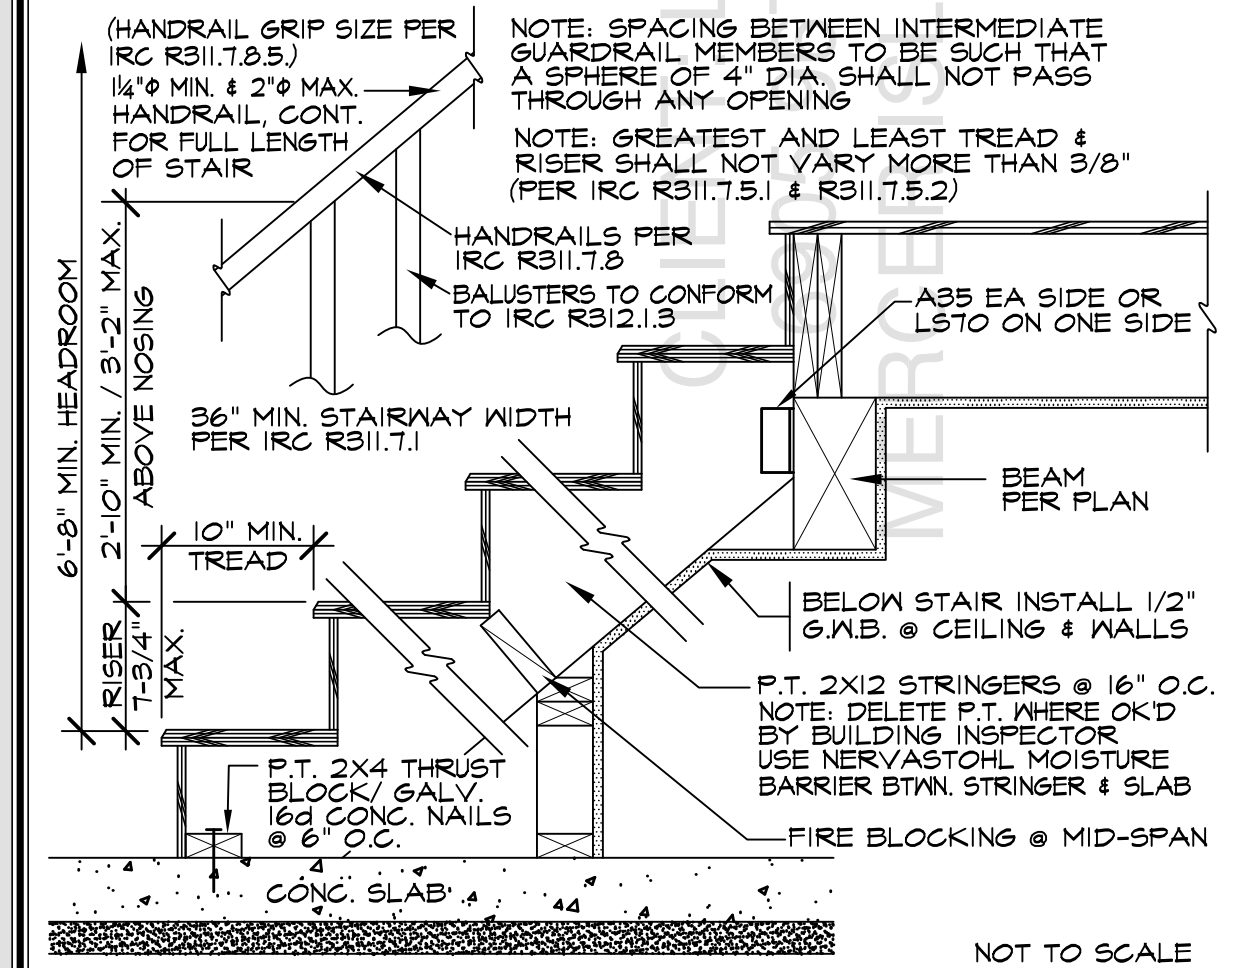


6 INTERIOR STAIR W/ SLAB

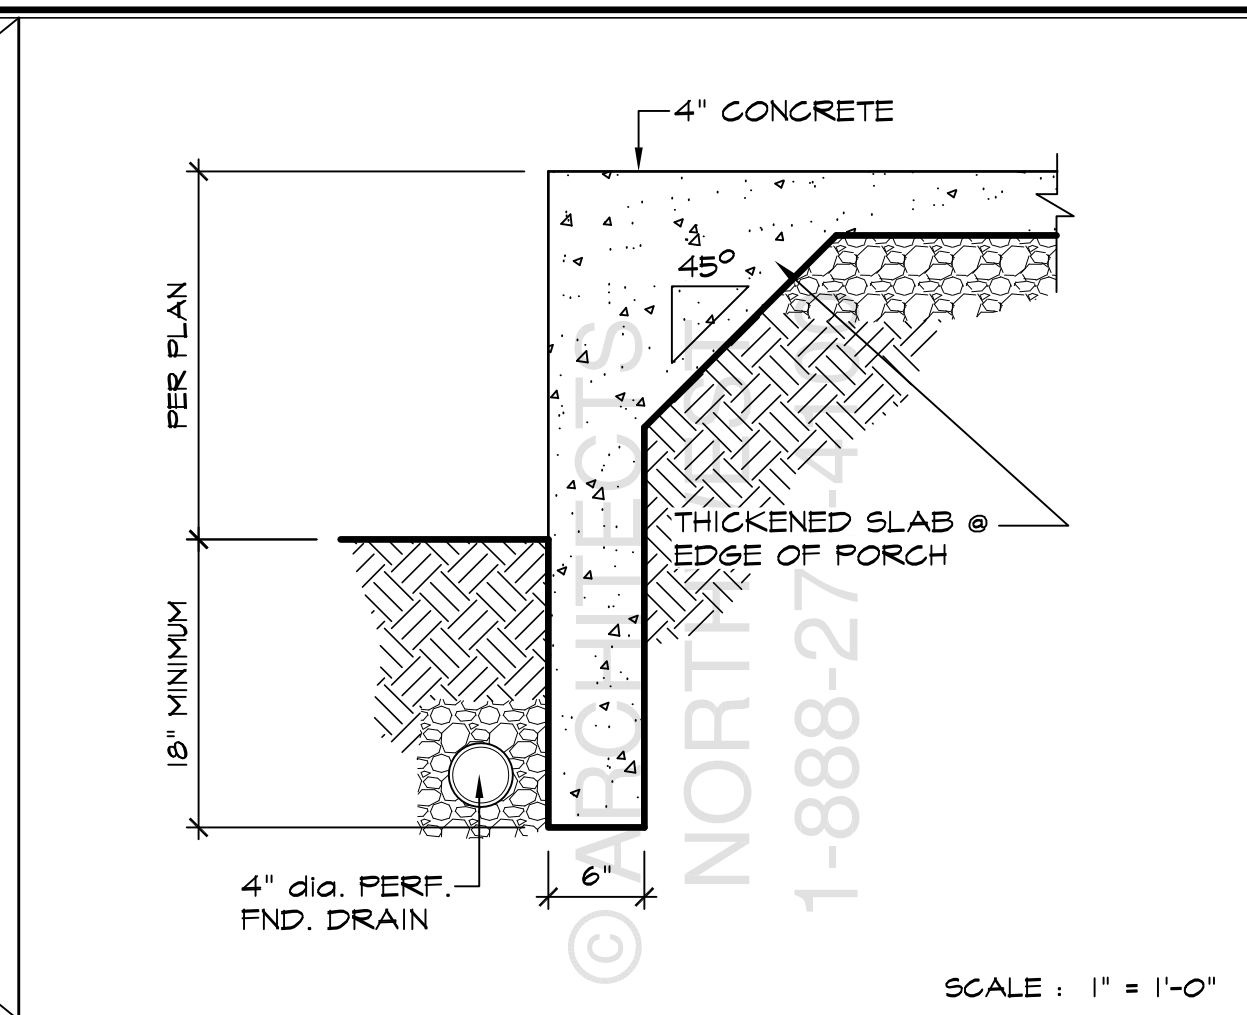


2 FND. WALL PORCH

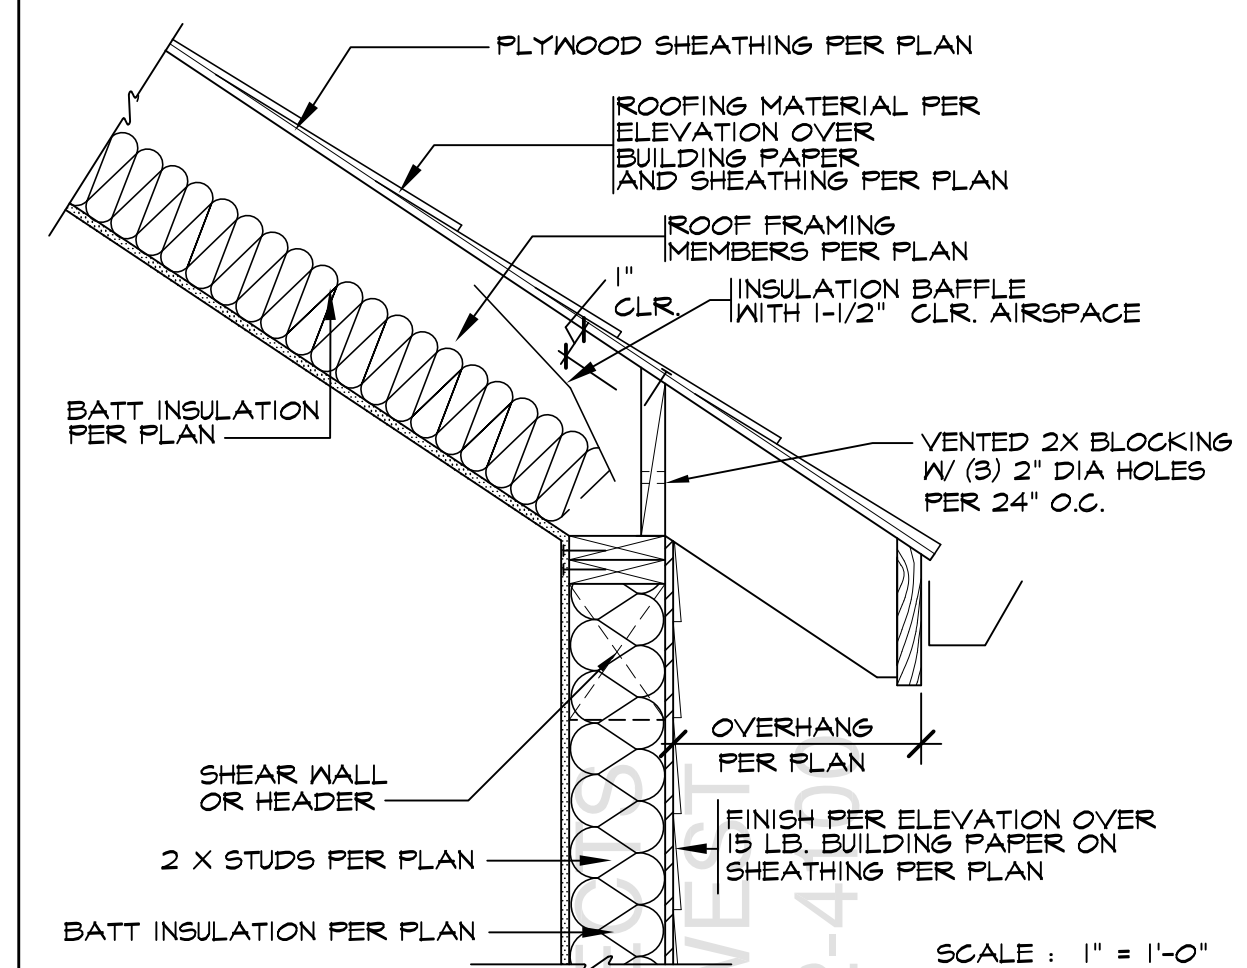


7 VAULTED CEILING & EAVE

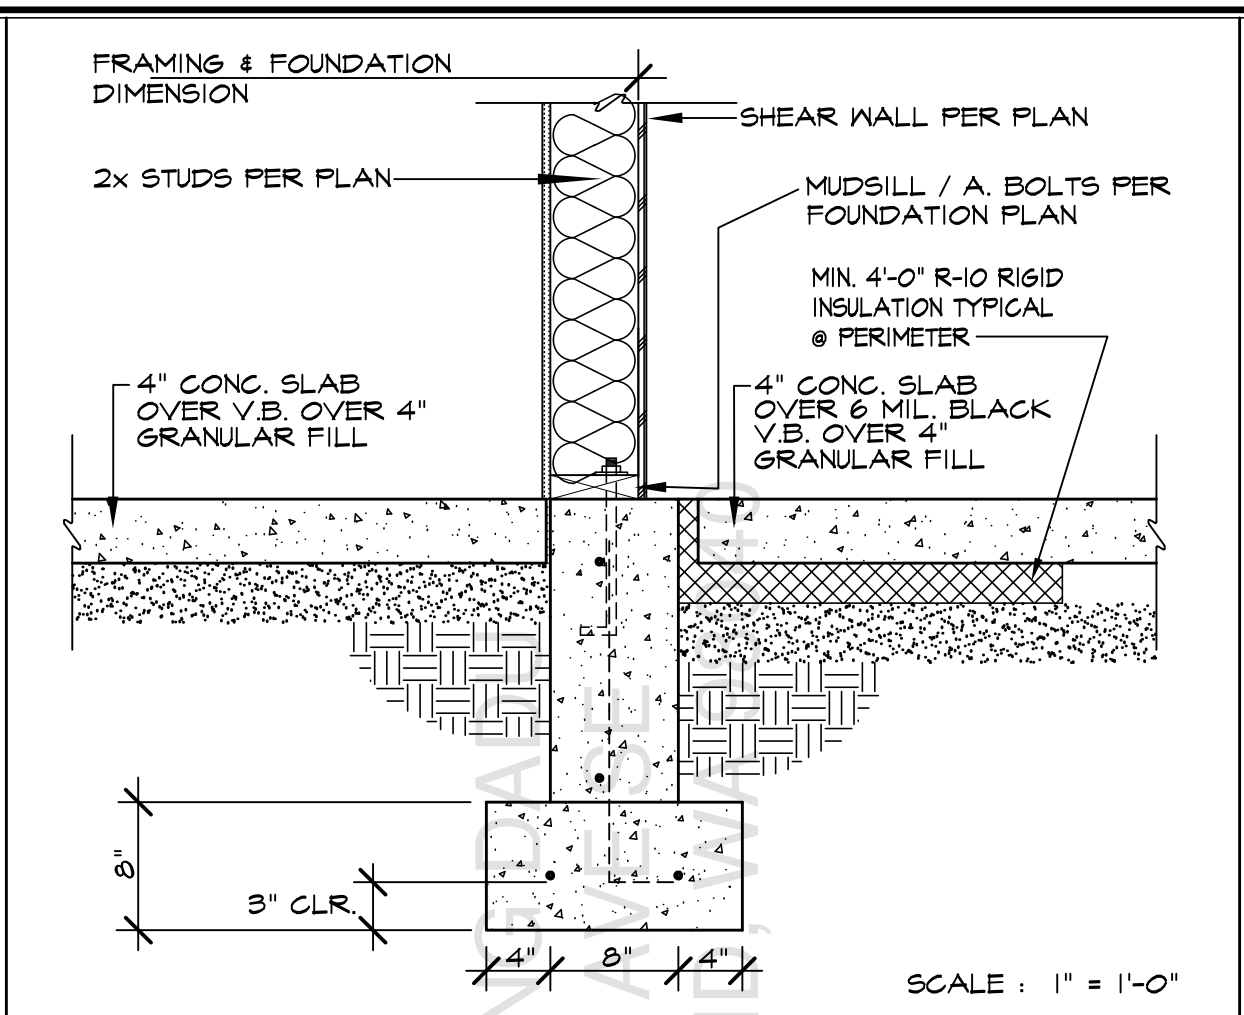


3 8" STEM WALL W/ SLAB

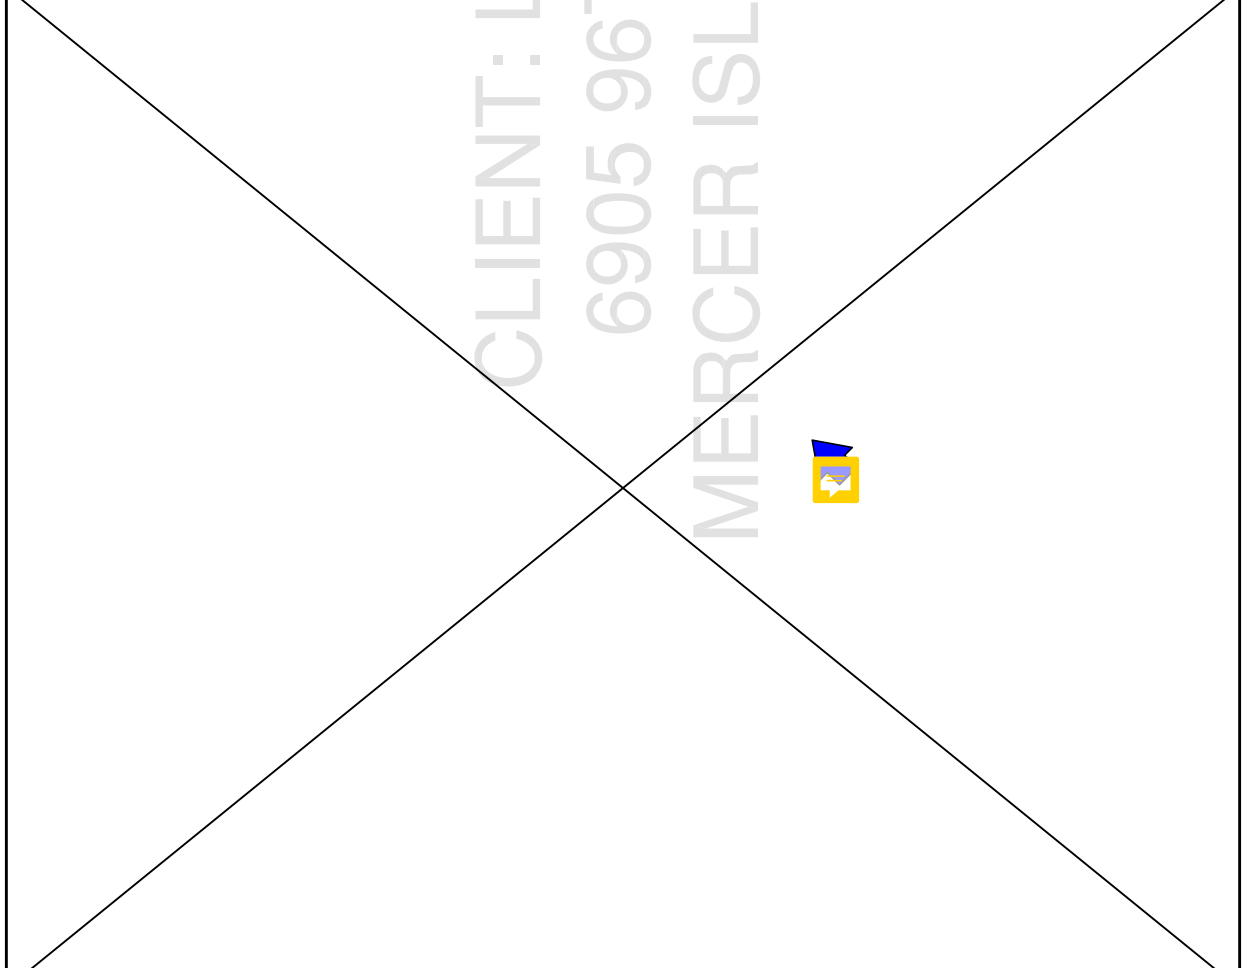


8 NOT USED

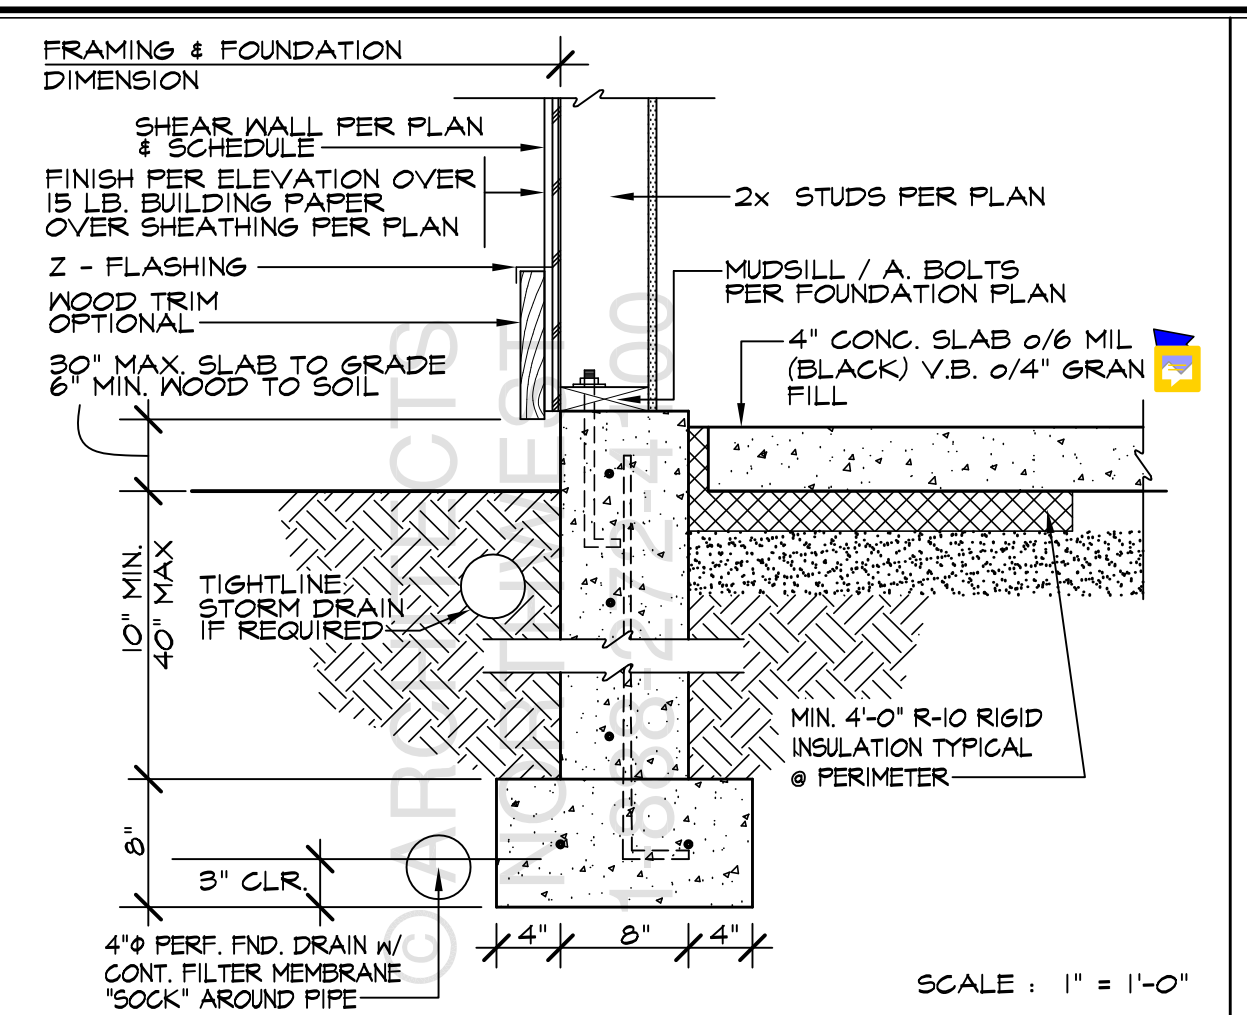


4 8" FND. WALL

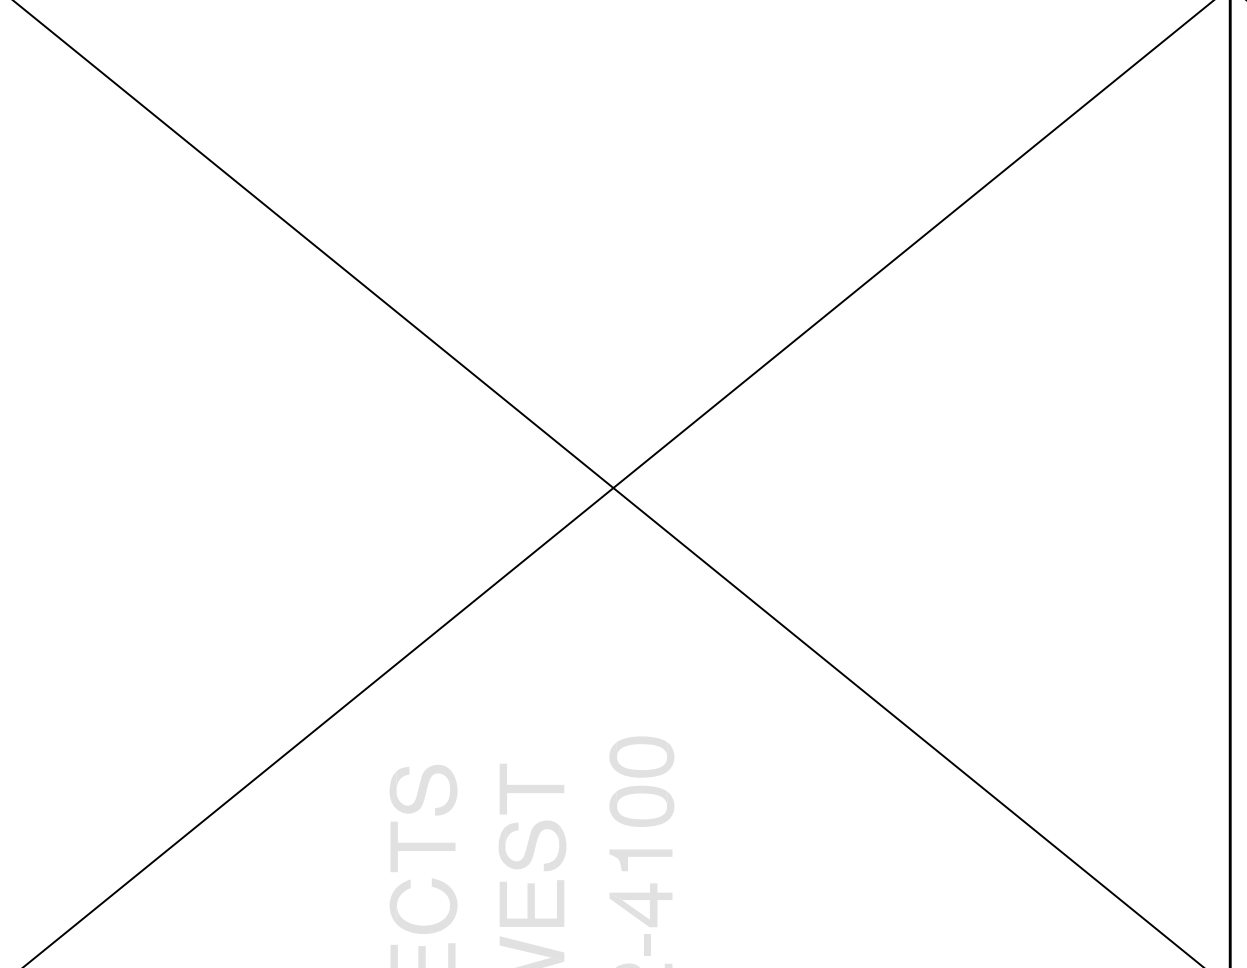


9 NOT USED

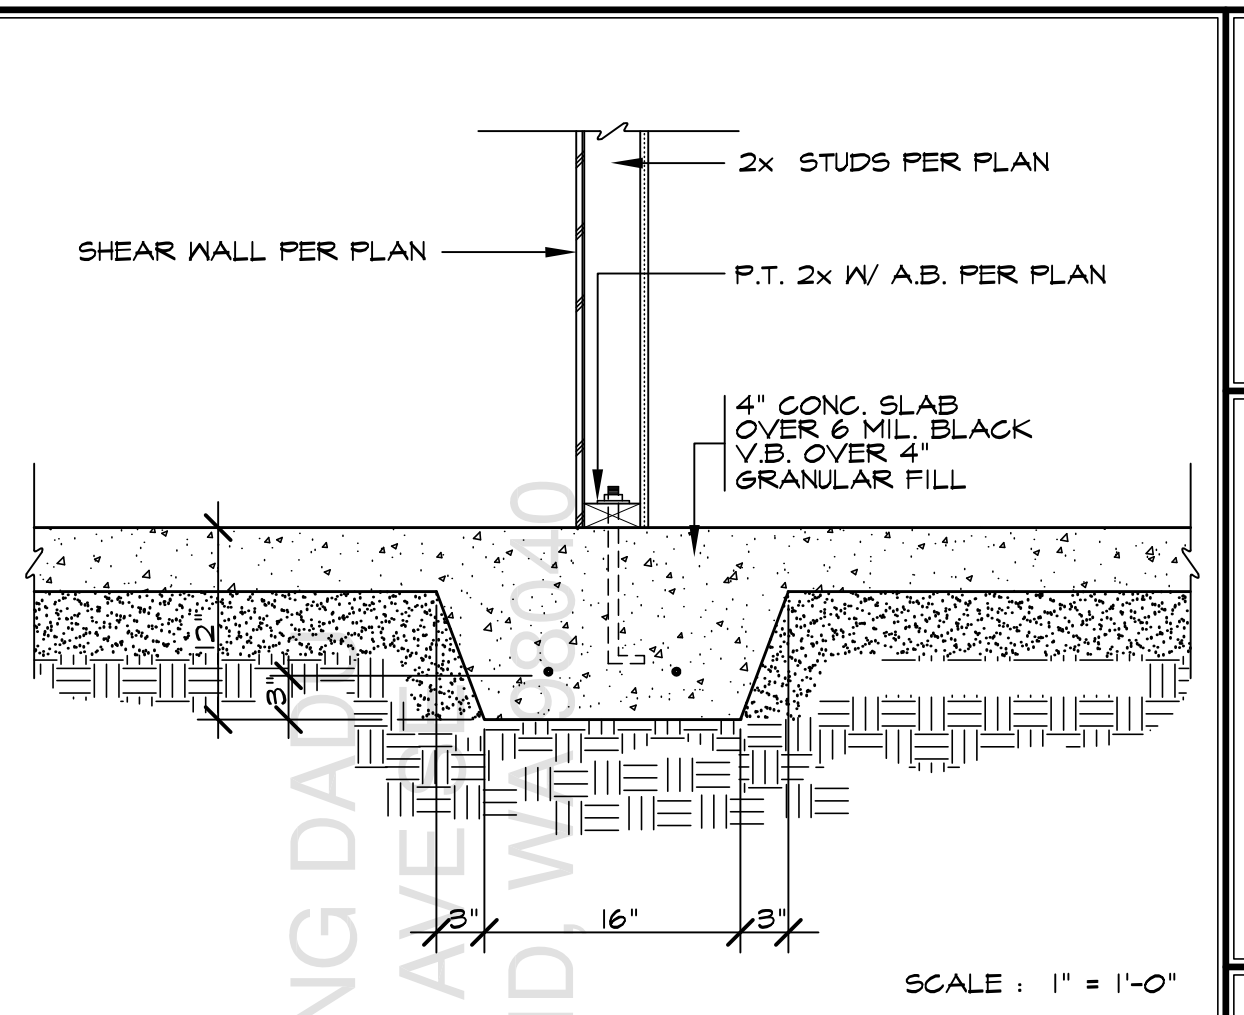


5 THICKENED SLAB

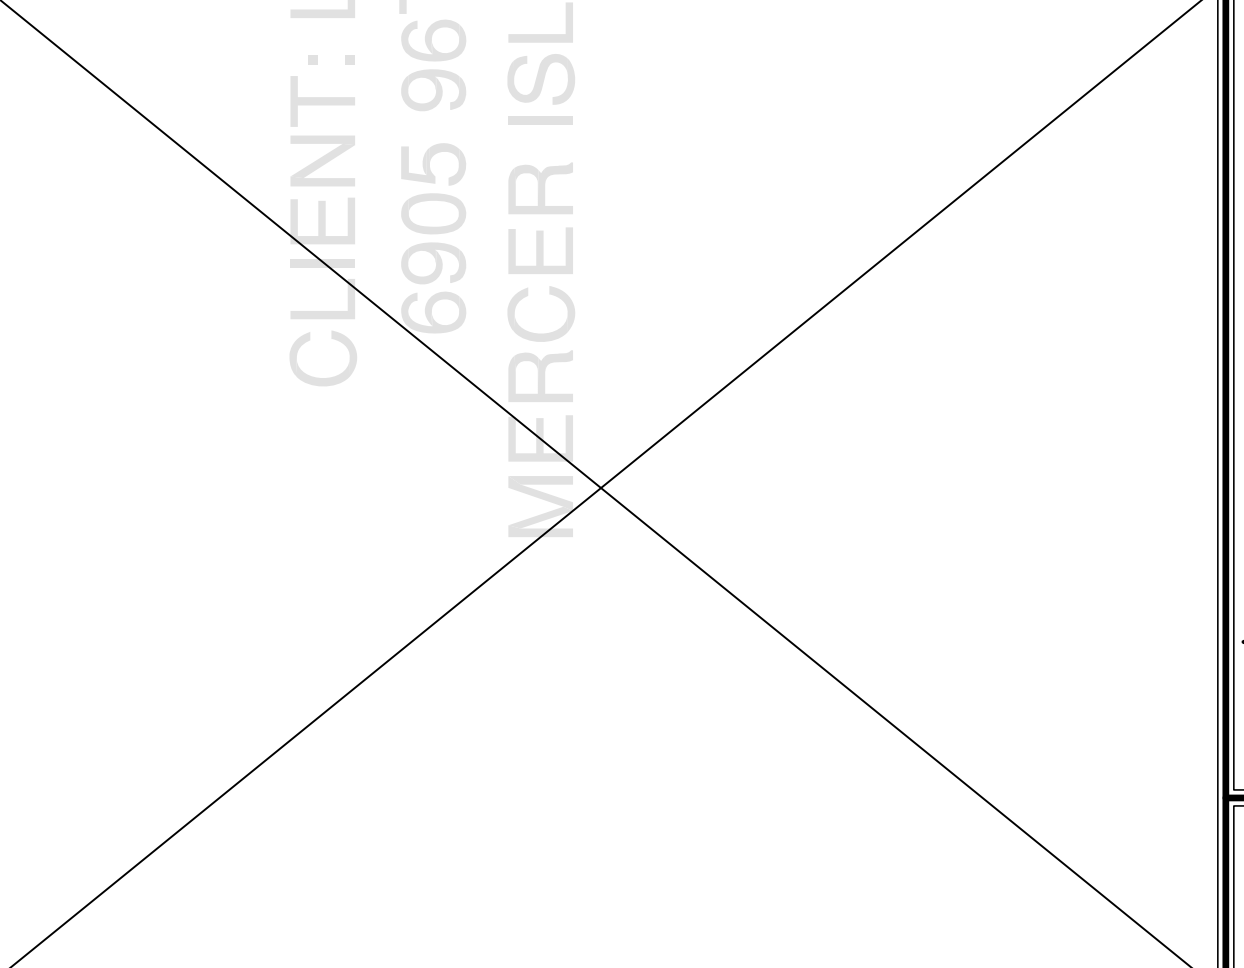


10 NOT USED

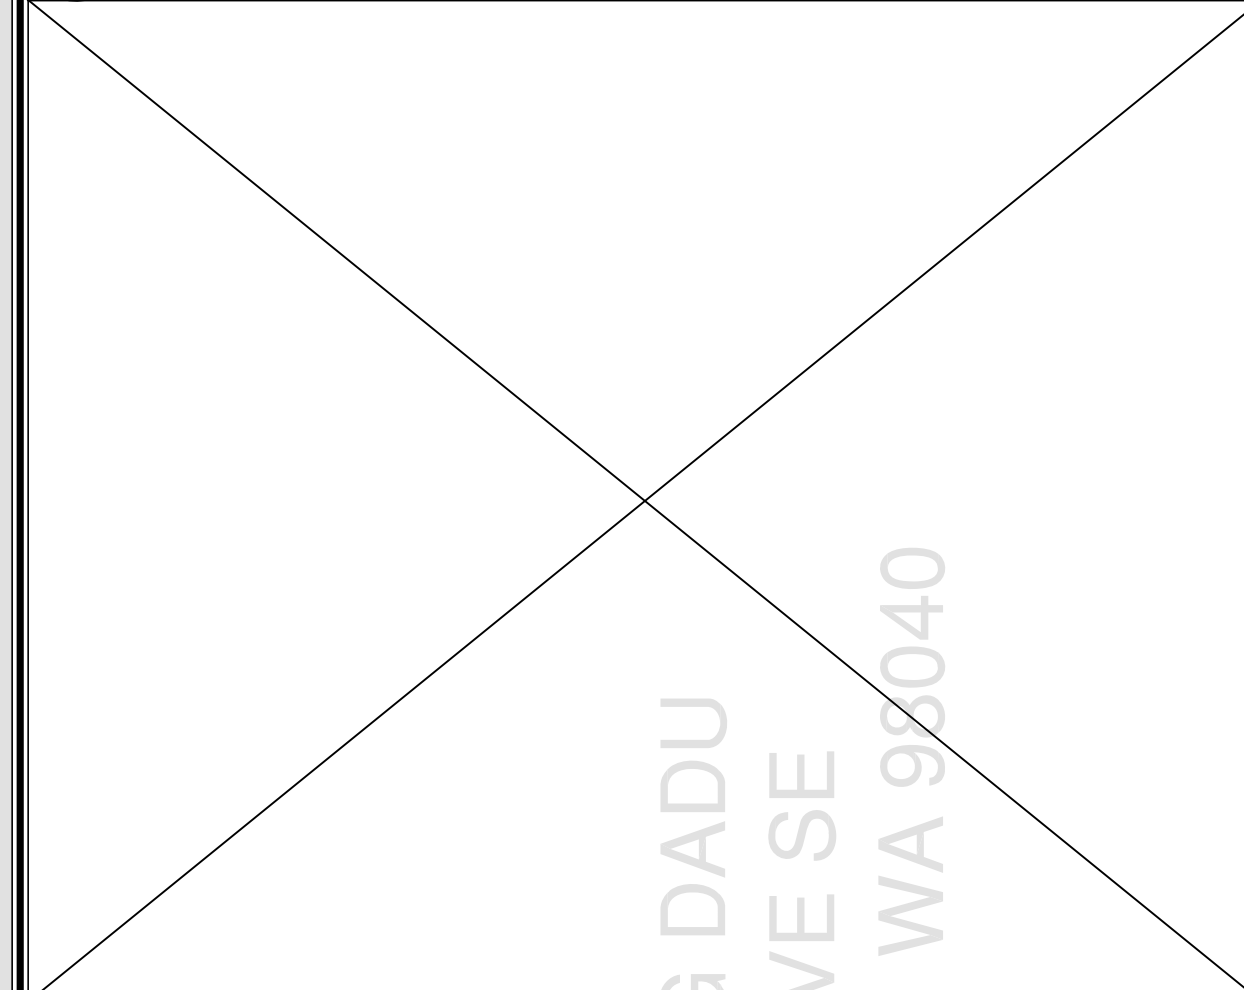


11 NOT USED

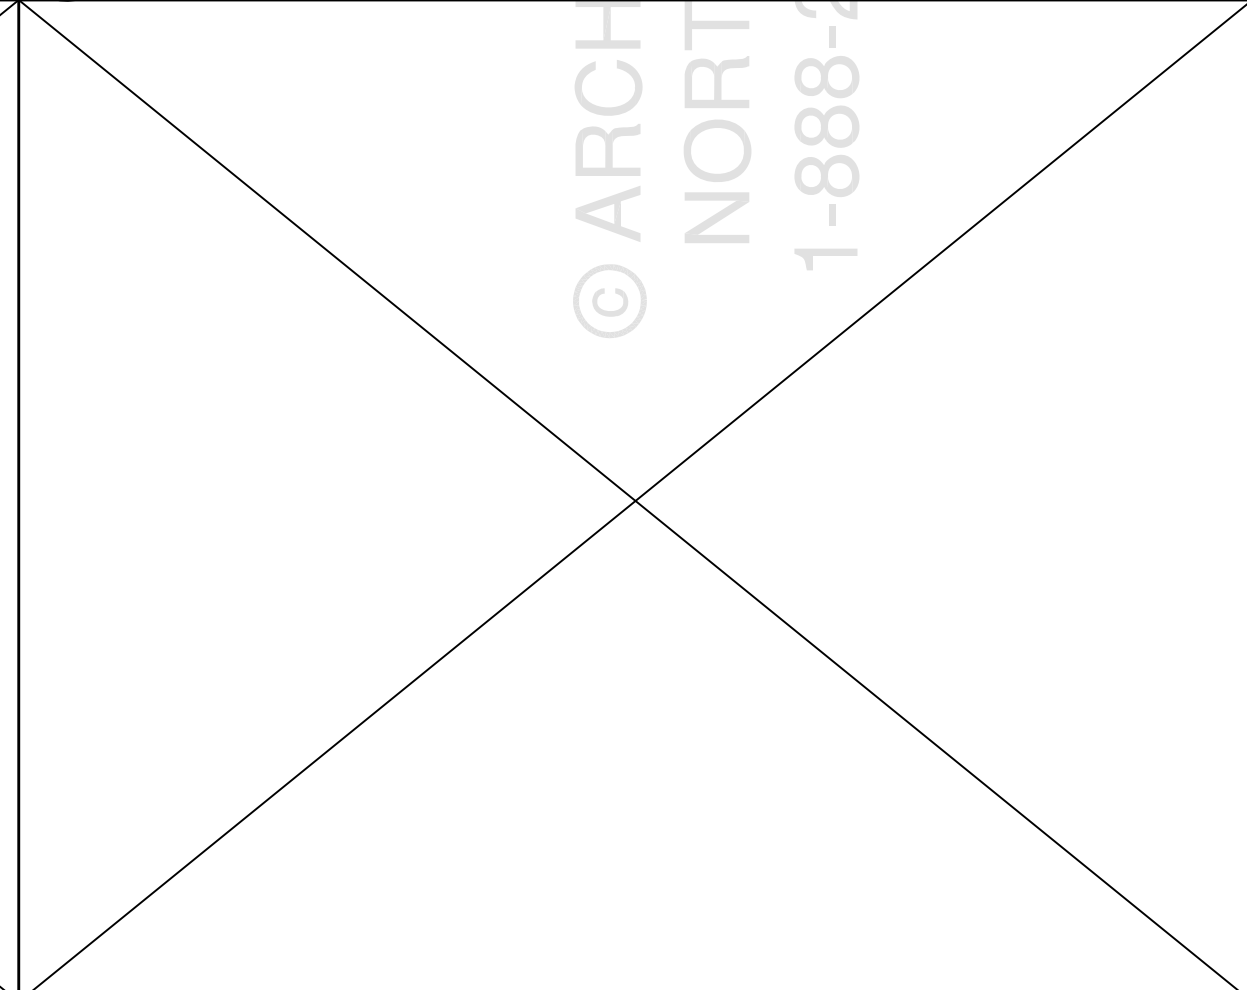


12 NOT USED

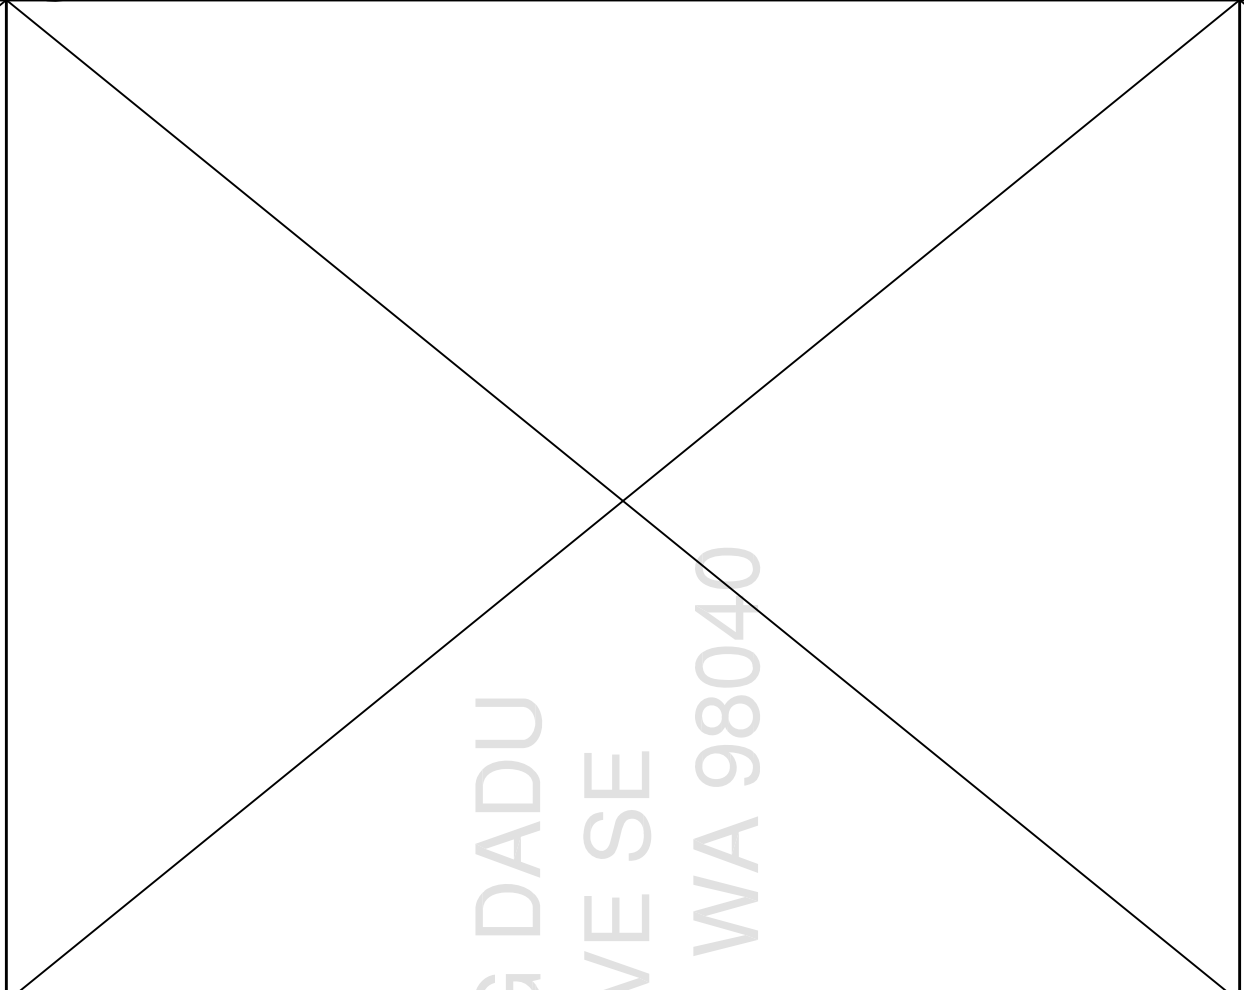


13 NOT USED

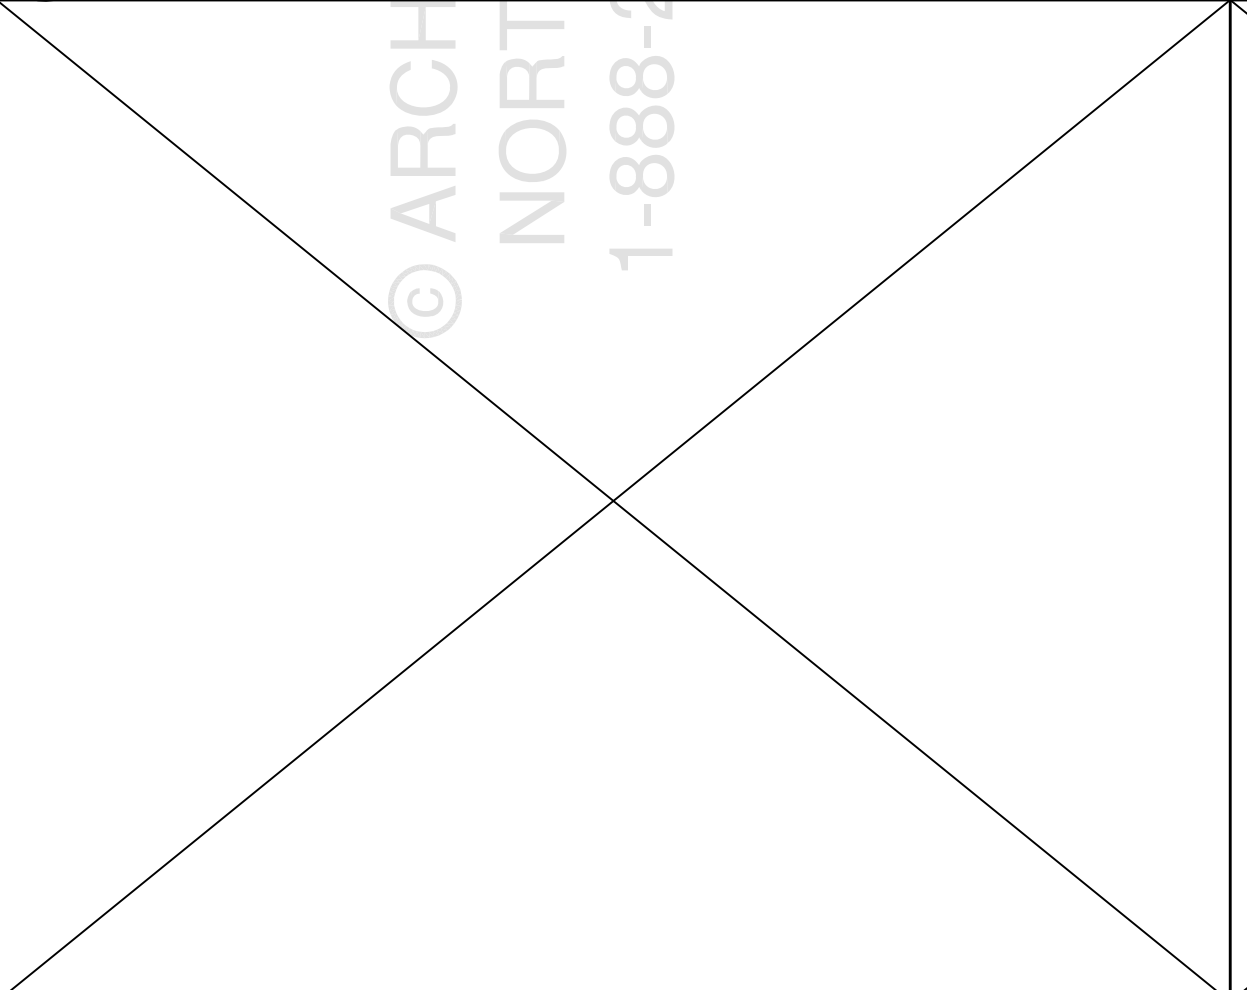


14 NOT USED

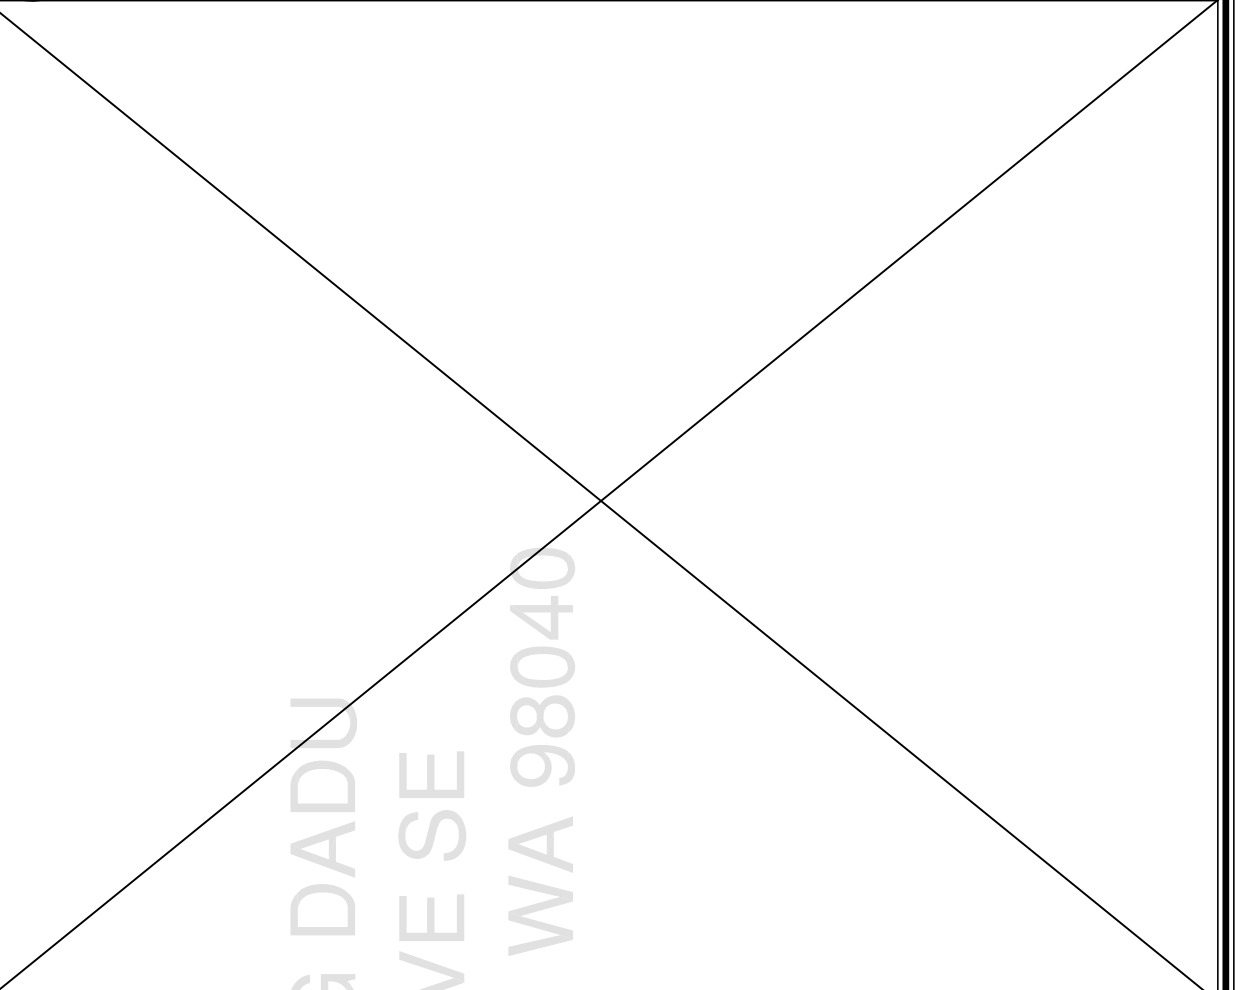


15 NOT USED

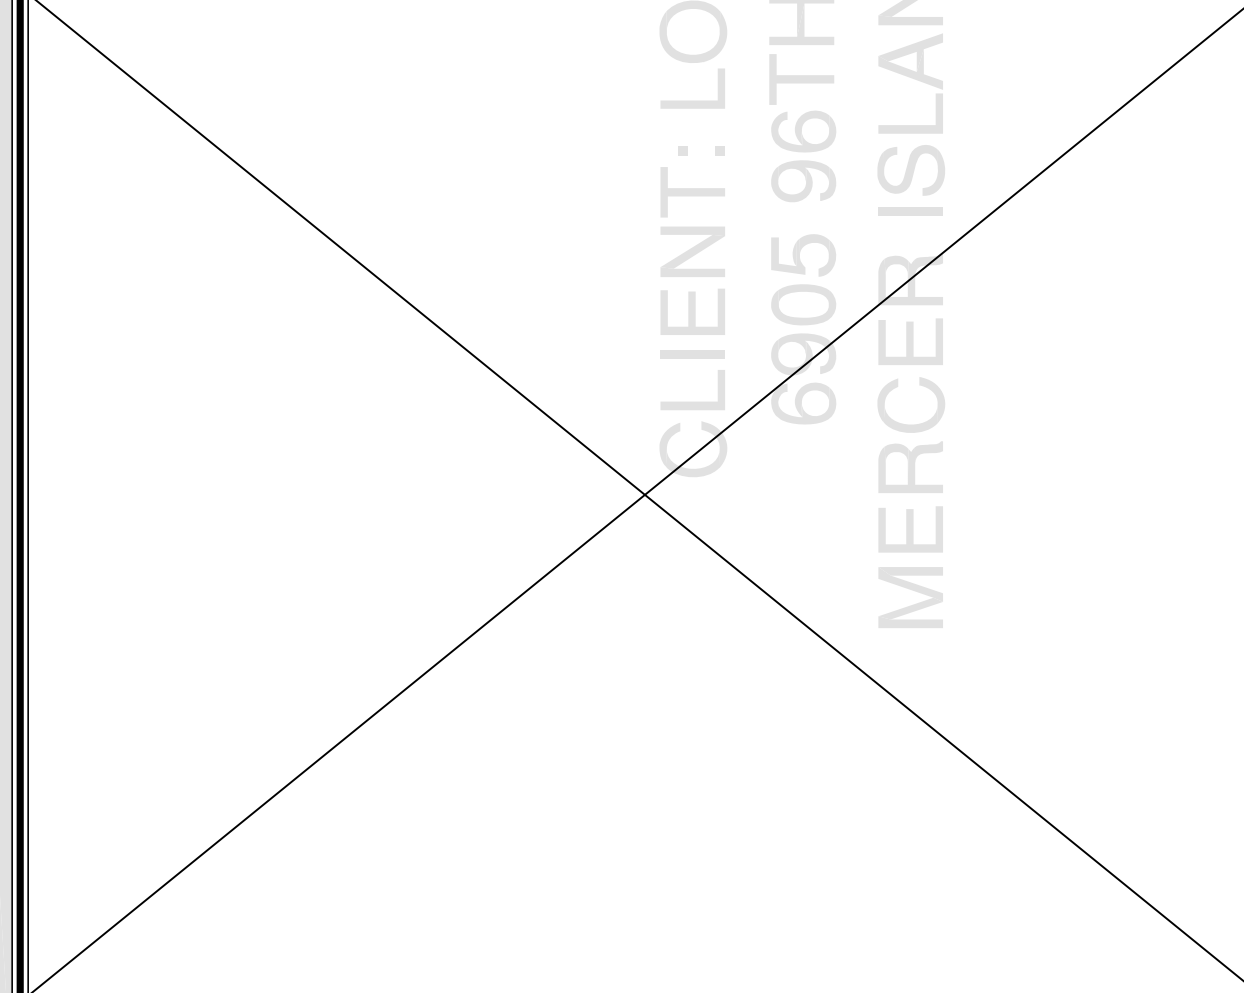


16 NOT USED

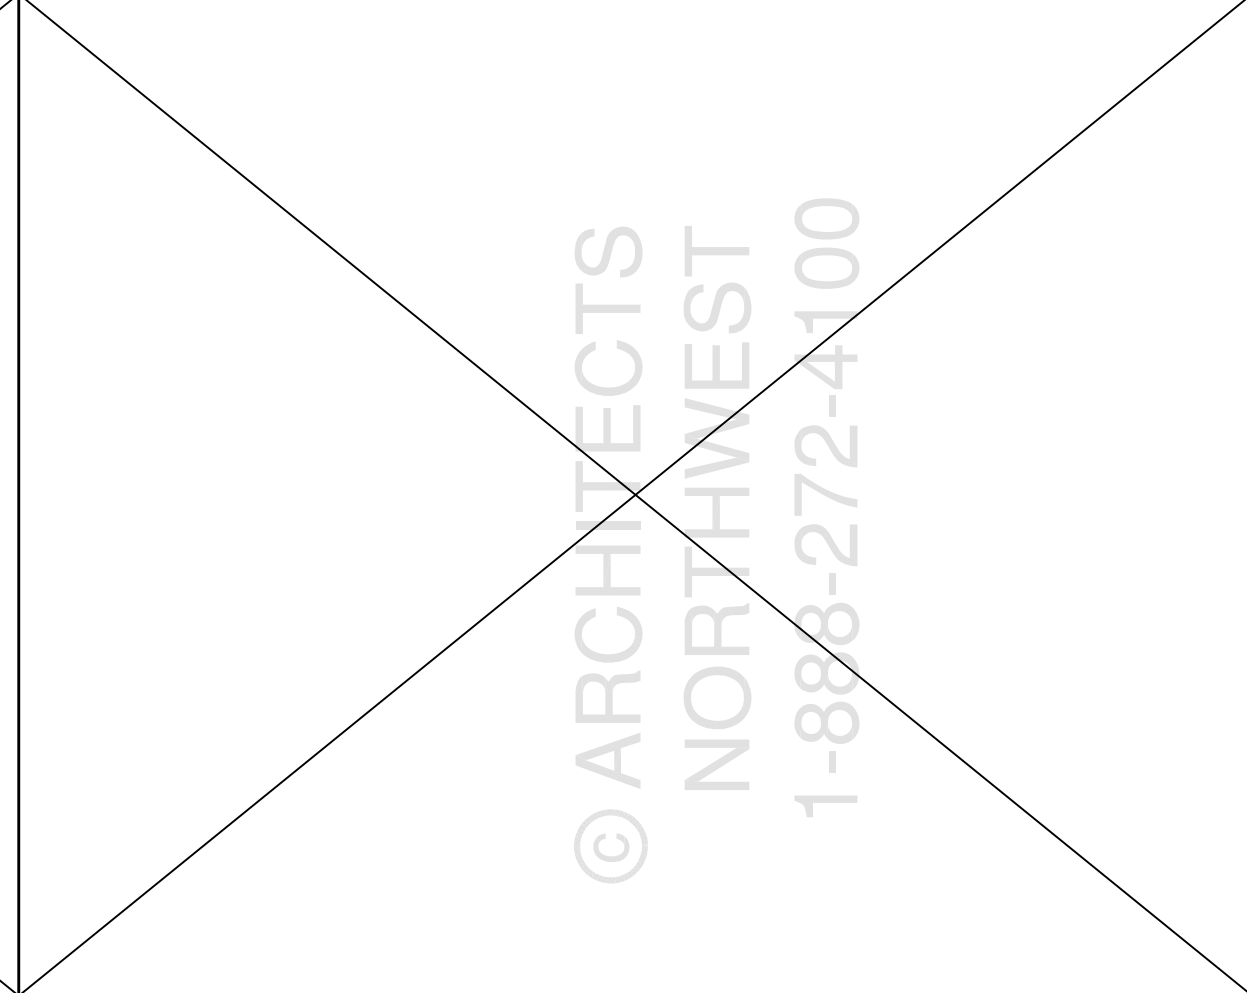


17 NOT USED

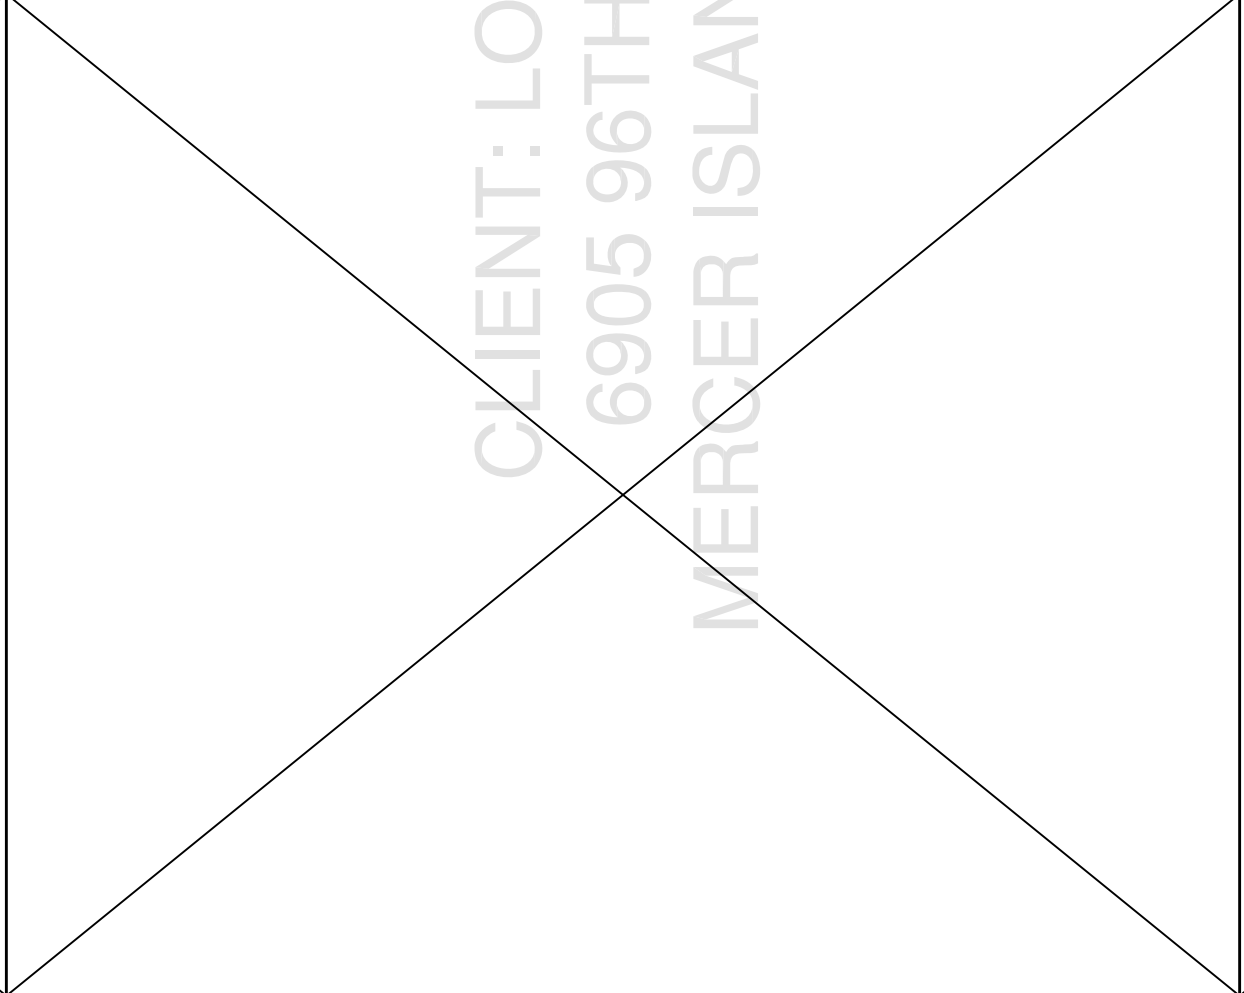

18 NOT USED

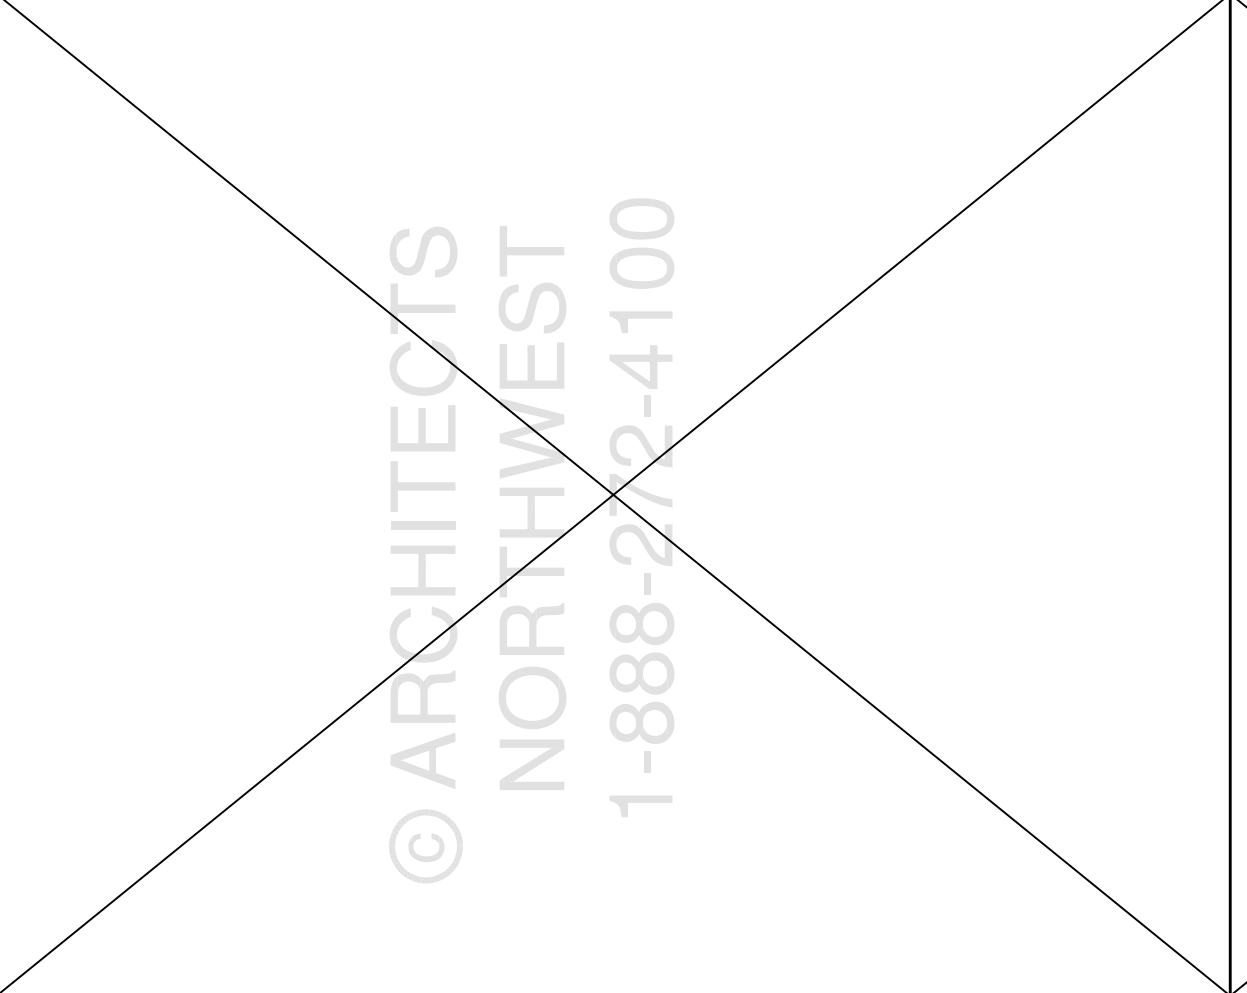

19 NOT USED

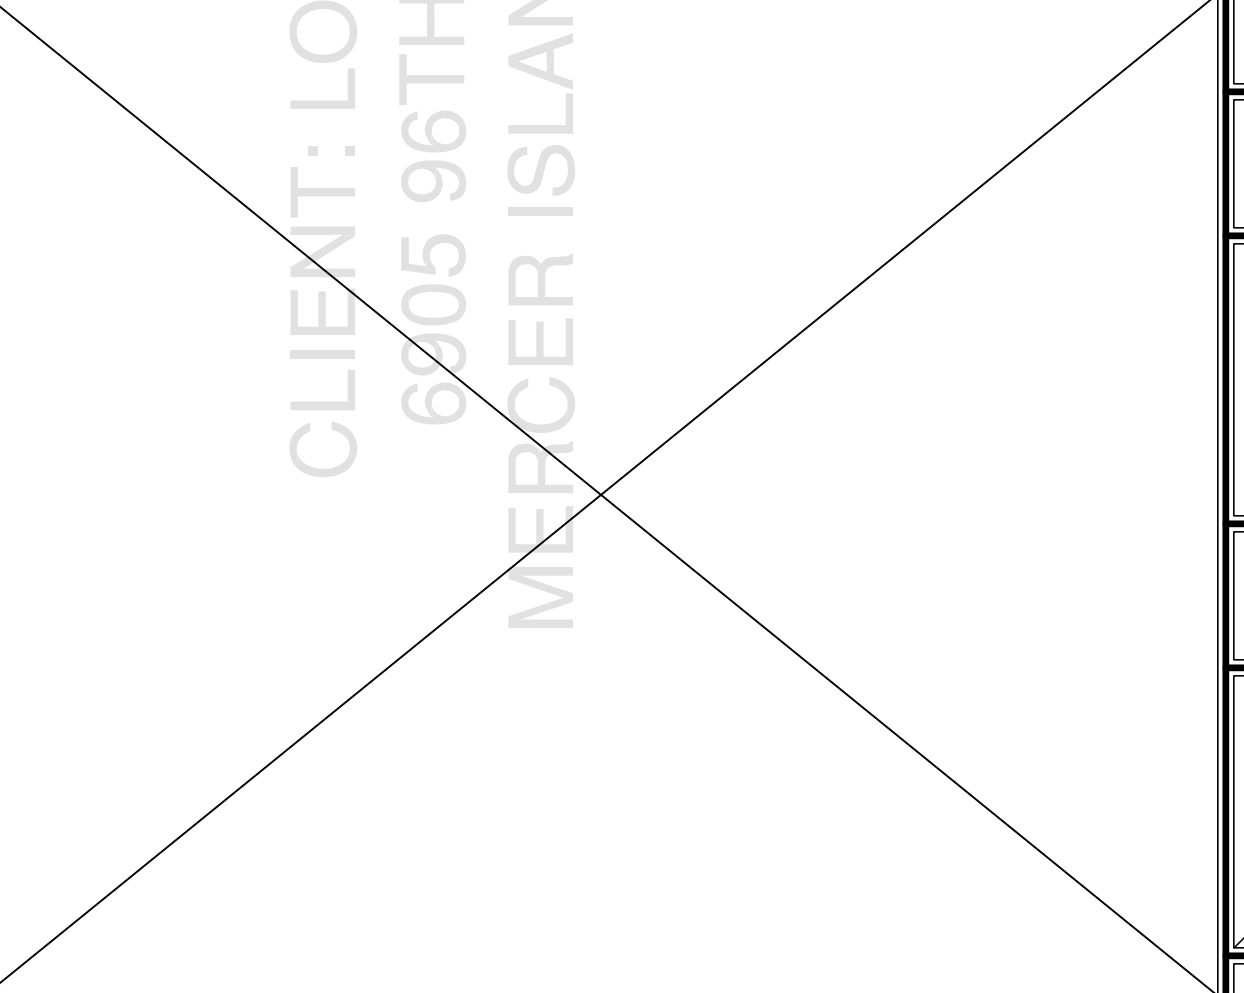

20 NOT USED

REGISTERED ARCHITECT
8/15/25

PAYMENT OF USE FEE IS DUE TO ARCHITECTS NORTHWEST, INC. PRIOR TO CONSTRUCTION FOR THESE PLANS. THESE PLANS ARE COPYRIGHTED IN ACCORDANCE WITH THE ARCHITECTURAL ACT OF 1991. NO PART OF THESE PLANS OR ANY PORTIONS OF THESE PLANS OR METHOD OF ALL OR PORTIONS OF THESE PLANS OR FROM ARCHITECTS NORTHWEST, INC. IS TO BE REPRODUCED, COPIED, REPRODUCED, OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE WRITTEN PERMISSION OF ARCHITECTS NORTHWEST, INC. THE PROPERTY OF ARCHITECTS NORTHWEST, INC.

ARCHITECTS NORTHWEST
18915-142ND AVENUE NE SUITE 100 WOODINVILLE WA 98072
OFFICE: (425) 485-4800 FAX: (425) 487-6568
TOLL FREE: 1-888-272-4100 WWW.ARCHITECTSNW.COM

LONG DADU
PLAN A911A0-0

DESIGNED BY: MBJ 05/2025
DRAWN BY: BPS 7/29/25
PROJECT MANAGER: MARCUS JENKINS
REVISED BY: BPS 8/15/25


LATERAL BY: ZVELT 6/25/25
LATERAL JOB NUMBER: 25-120

A3
A7

ANW JOB NUMBER: 250052


CLIENT: LONG DADU
6905 96TH AVE SE
MERCER ISLAND, WA 98040

© ARCHITECTS NORTHWEST
1-888-272-4100

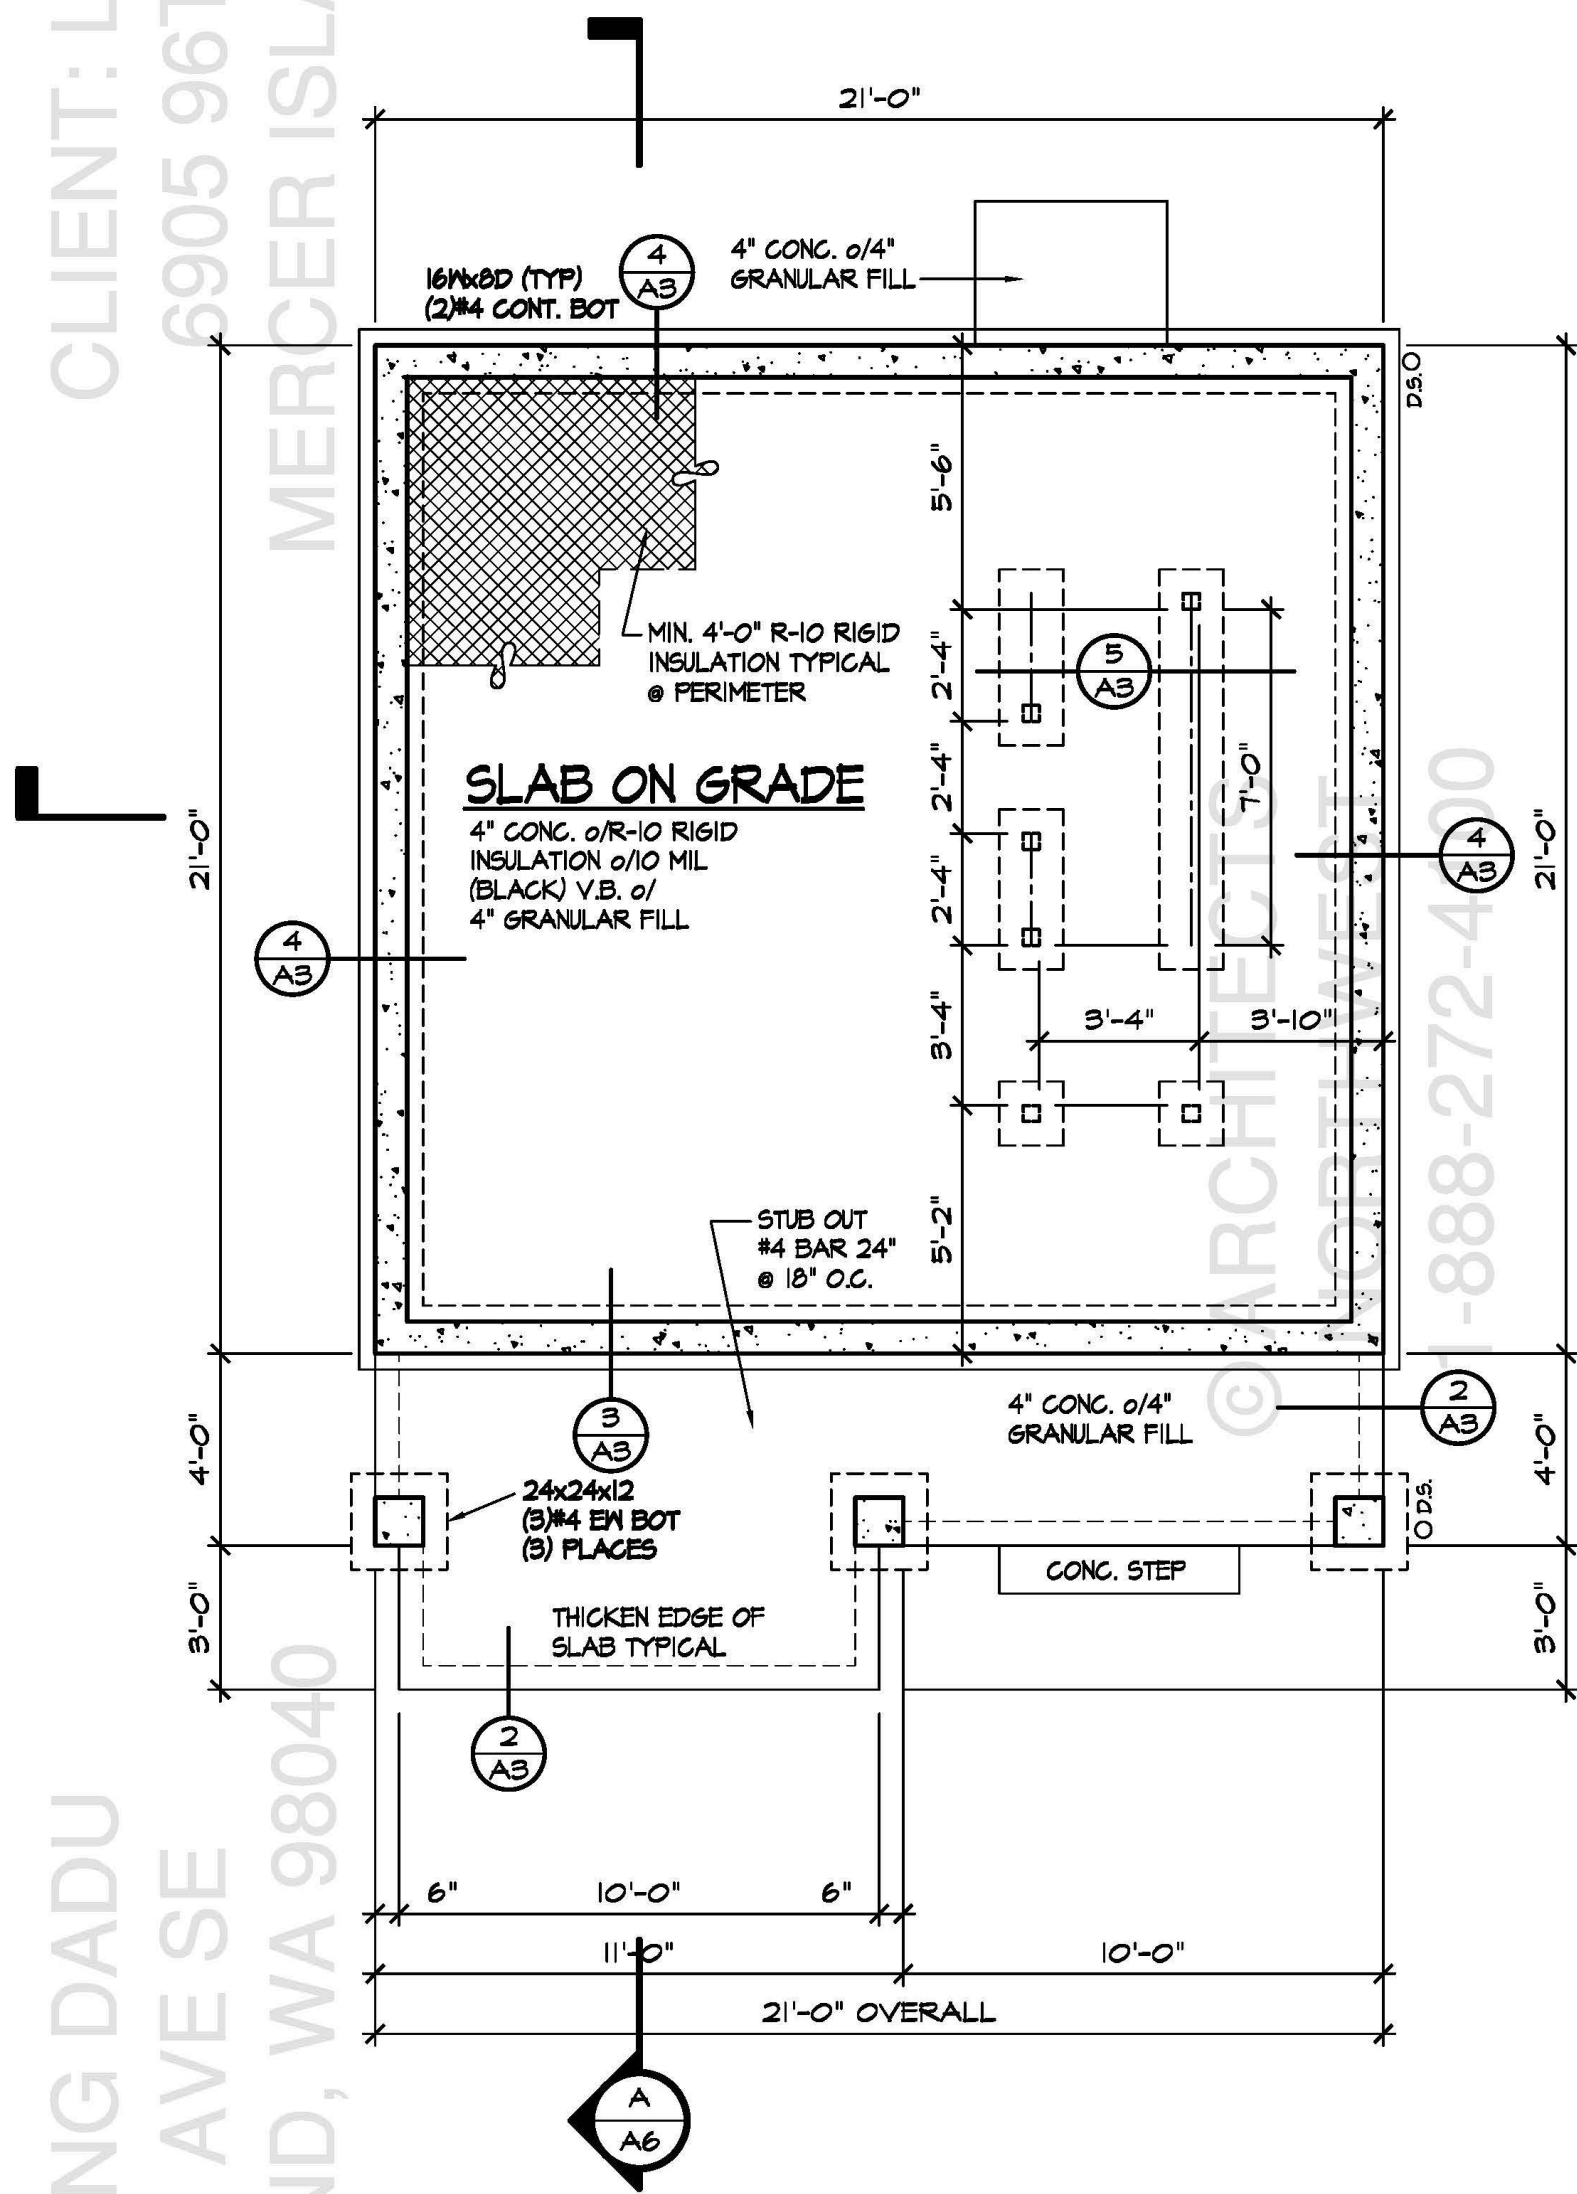

FOUNDATION PLAN

SCALE: 1/4" = 1'-0"

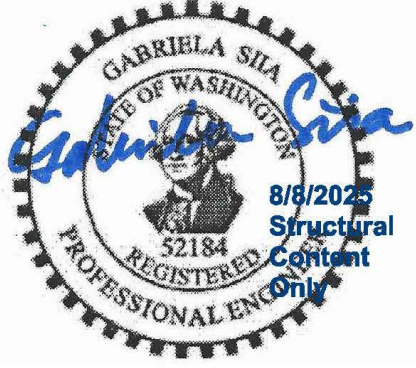

GEOTECHNICAL REPORT TO BE REVIEWED PRIOR TO COMMENCING ANY SITE ACTIVITIES

FOUNDATION NOTES:


1. CONTRACTOR SHALL VERIFY ALL NOTES, DIMENSIONS & CONDITIONS PRIOR TO CONSTRUCTION.
2. ALL FOOTINGS TO REST ON UNDISTURBED SOIL.
3. ALL WOOD IN CONTACT WITH CONCRETE TO BE PRESSURE TREATED.
4. SOFFIT & INSULATE CANTILEVERED AREAS.
5. STEP FOUNDATION PER SITE CONDITIONS.
6. 1500 P.S.F. ASSUMED SOIL BEARING CAPACITY SHALL BE VERIFIED IN FIELD.
7. SEE SHEET A1 FOR ADDITIONAL NOTES.
8. SEE SHEET A2 FOR FOUNDATION VENTILATION CALCULATION.

NOTE: SEE 'S' SHEETS FOR LATERAL INFORMATION & ENGINEERING DETAILS

PROVIDE BITUMINOUS DAMPROOFING FROM TOP OF FTG. TO FIN. GRADE AT BASEMENT WALLS AND CRAWL SPACE WALLS.

CLIENT: LONG DADU
6905 96TH AVE SE
MERCER ISLAND, WA 98040

© ARCHITECTS NORTHWEST
1-888-272-4100

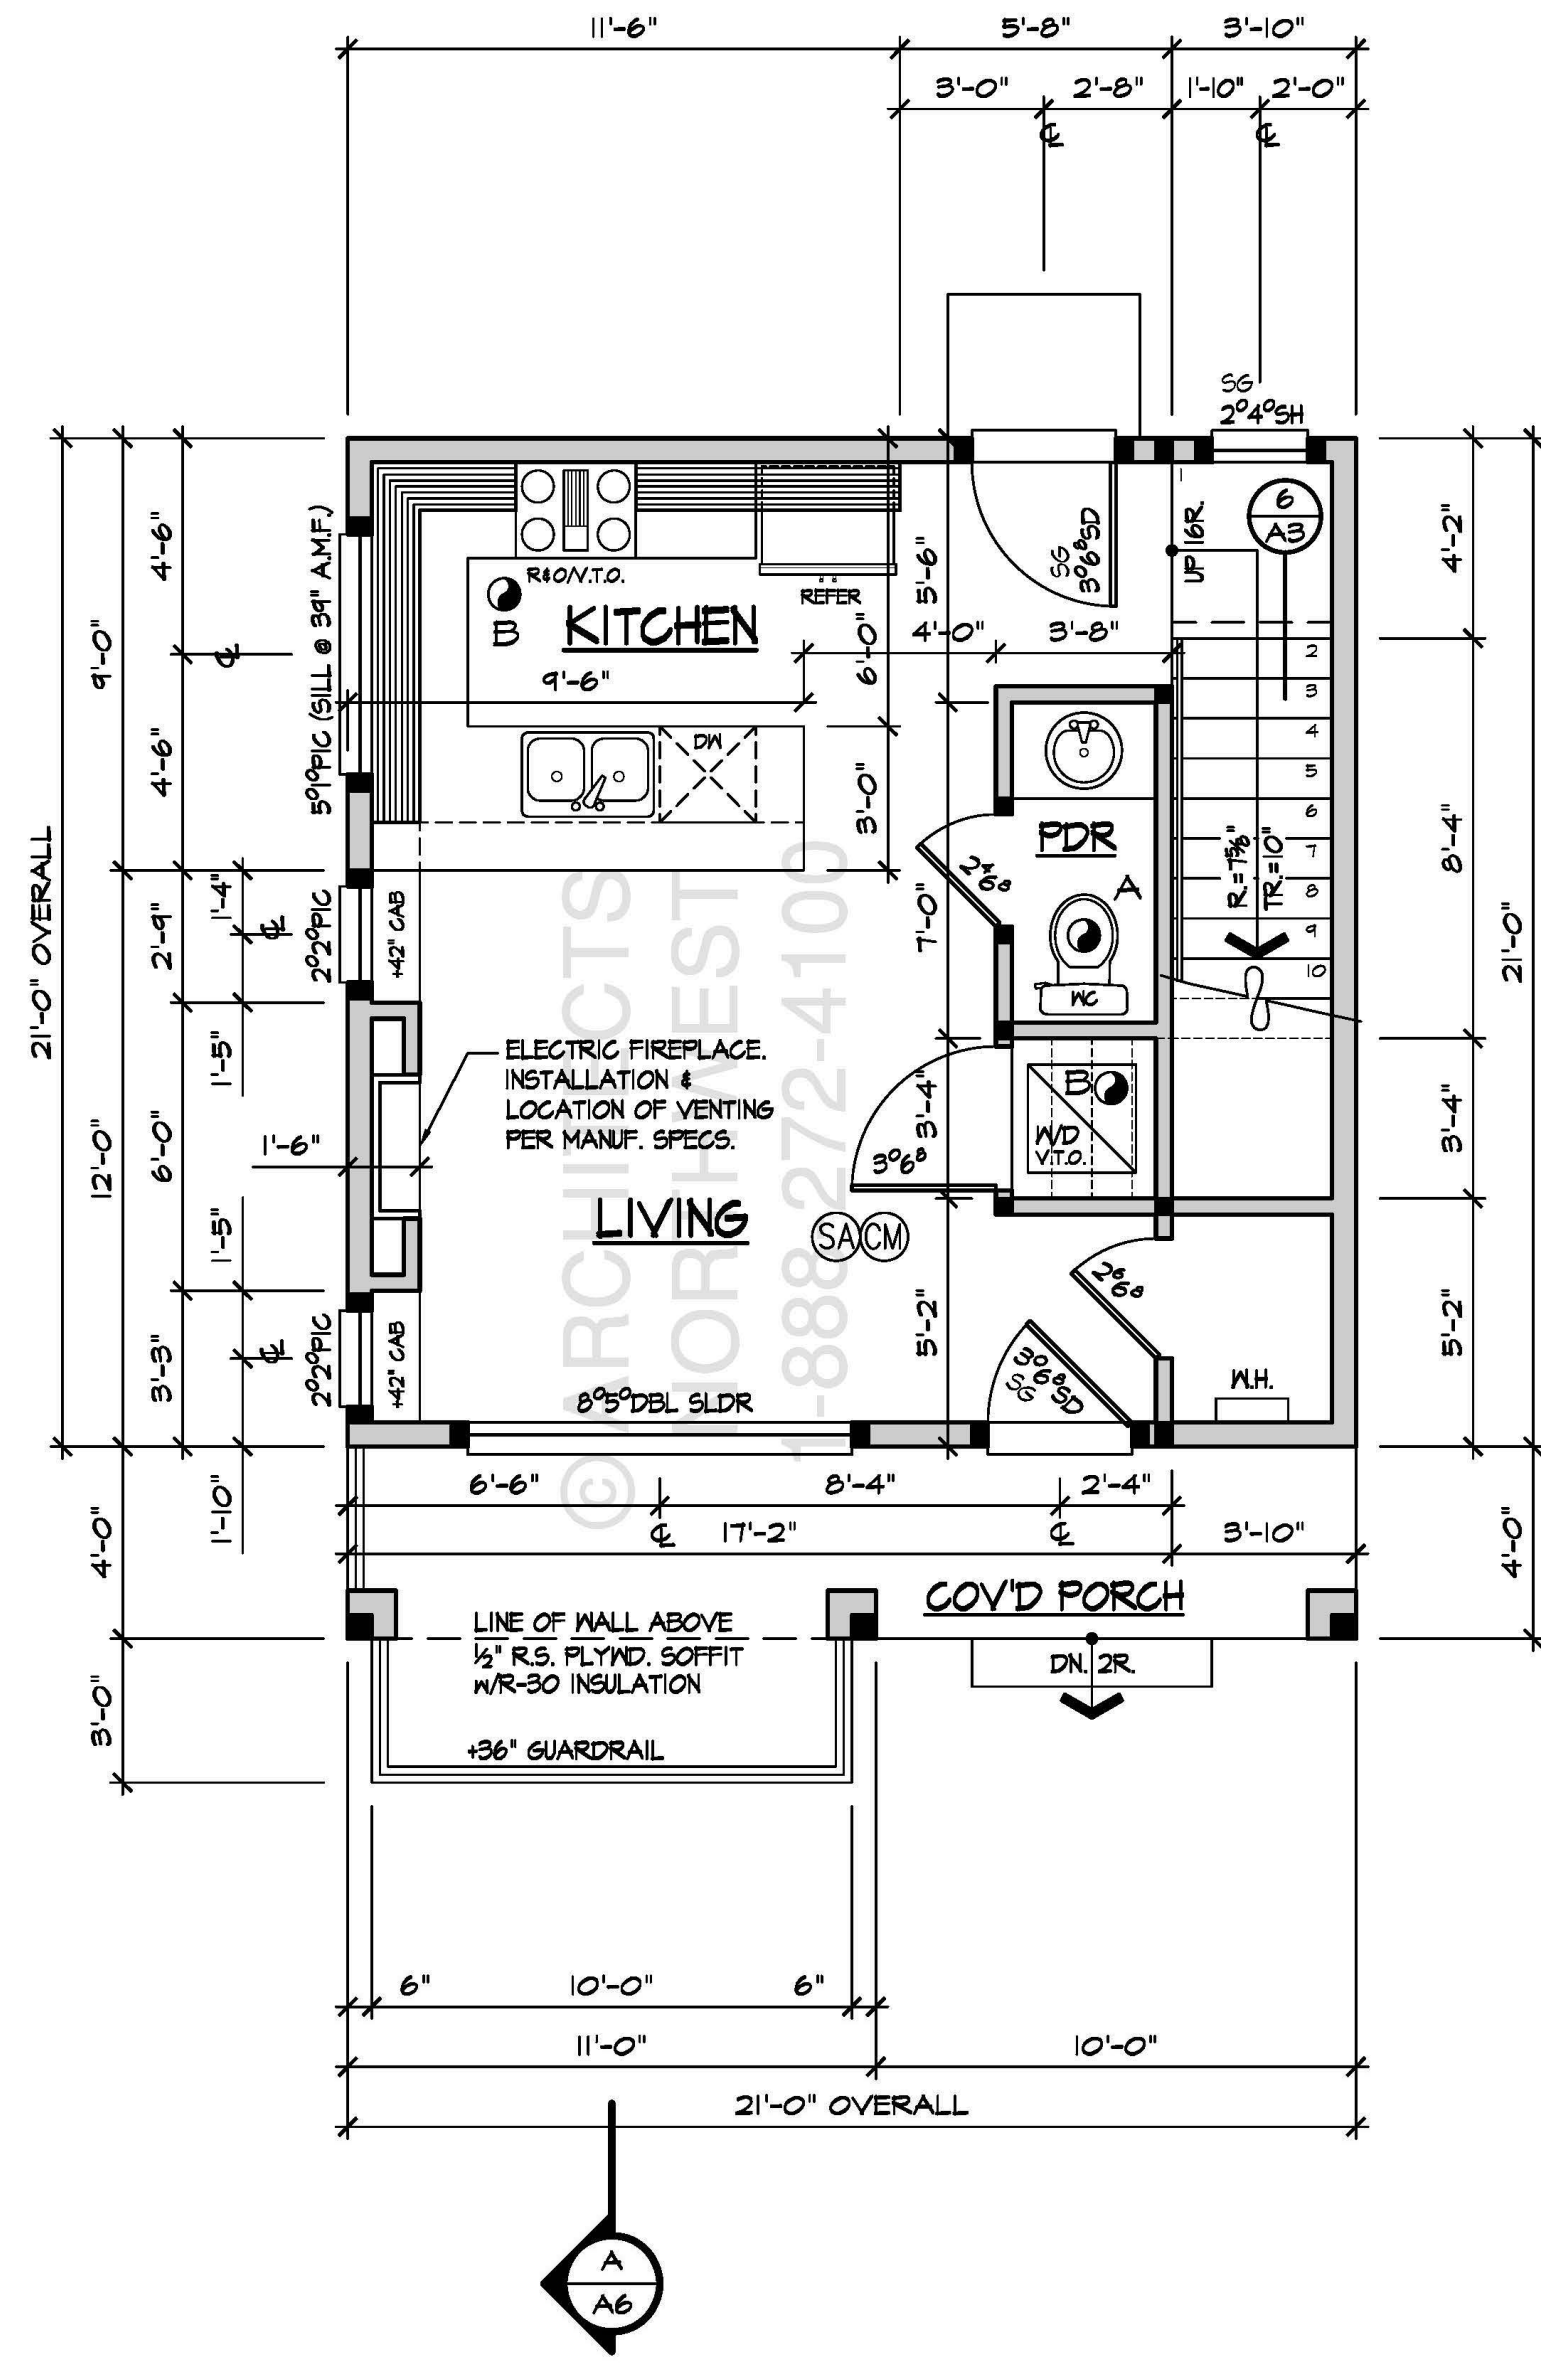

MAIN FLOOR PLAN

SCALE: 1/4" = 1'-0"

CLIENT: LONG DADU
6905 96TH AVE SE
MERCER ISLAND, WA 98040

FLOOR PLAN NOTES:

1. CONTRACTOR SHALL VERIFY ALL NOTES, DIMENSIONS & CONDITIONS PRIOR TO CONSTRUCTION.
2. WINDOWS & DOORS ARE SHOWN & NOTED AS NOMINAL SIZES.
3. EXTERIOR WALLS TO BE 2x6 STUDS @ 16" O.C. U.N.O.
4. ■ INDICATES POINT LOAD
5. SUPPORTED BY (2) STUDS, U.N.O.
6. PROVIDE STAIRWAY ILLUMINATION PER I.R.C. R303.7 & R303.8
7. SEE SHEET A1 FOR ADDITIONAL NOTES.
8. SEE SHEET A2 FOR VENTILATION SCHEDULE.
9. SEE SHEET A2 FOR ALARM SCHEDULE.

NOTE: SEE 'S' SHEETS FOR LATERAL INFORMATION & ENGINEERING DETAILS

AREA SUMMARY	
MAIN FLOOR:	441 S.F.
UPPER FLOOR:	471 S.F.
TOTAL HEATED AREA:	912 S.F.
GARAGE:	N/A
COVERED AREA:	84 S.F.
UNFINISHED AREA:	N/A

LONG DADU

PLAN A911A0-0

ARCHITECTS NORTHWEST

18915-142ND AVENUE NE SUITE 100 WOODINVILLE, WA 98072

OFFICE: (425) 485-4800 FAX: (425) 487-6685

TOLL FREE: 1-888-272-4100 WWW.ARCHITECTSNW.COM

DESIGNED BY: MBJ 05/2025

DRAWN BY: BPS 1/24/25

PROJECT MANAGER: MARCUS JENKINS

REVISED BY: BPS 8/15/25

LATERAL BY: ZVELT 6/25/25

LATERAL JOB NUMBER: 25-120

ANW JOB NUMBER: 250052

REGISTERED ARCHITECT


STATE OF WASHINGTON

8/15/25

CLIENT: LONG DADU
6905 96TH AVE SE
MERCER ISLAND, WA 98040

CLIENT: LONG DADU
6905 96TH AVE SE
MERCER ISLAND, WA 98040

UPPER FLOOR BEAM SCHEDULE				
MEMBER	BM SIZE	SPECIES	CONNECTION	COMMENTS
U01	4x10	DF#2	-	BEAM
U02	4x10	DF#2	-	HEADER
U03	4x10	DF#2	-	HEADER
U04	4x10	DF#2	-	HEADER
U05	4x10	DF#2	-	HEADER
U06	4x10	DF#2	-	HEADER
U07	4x10	DF#2	-	HEADER
U08	4x10	DF#2	-	HEADER
U09	6 x 12	DF#2	-	BEAM
U10	4x10	DF#2	-	HEADER

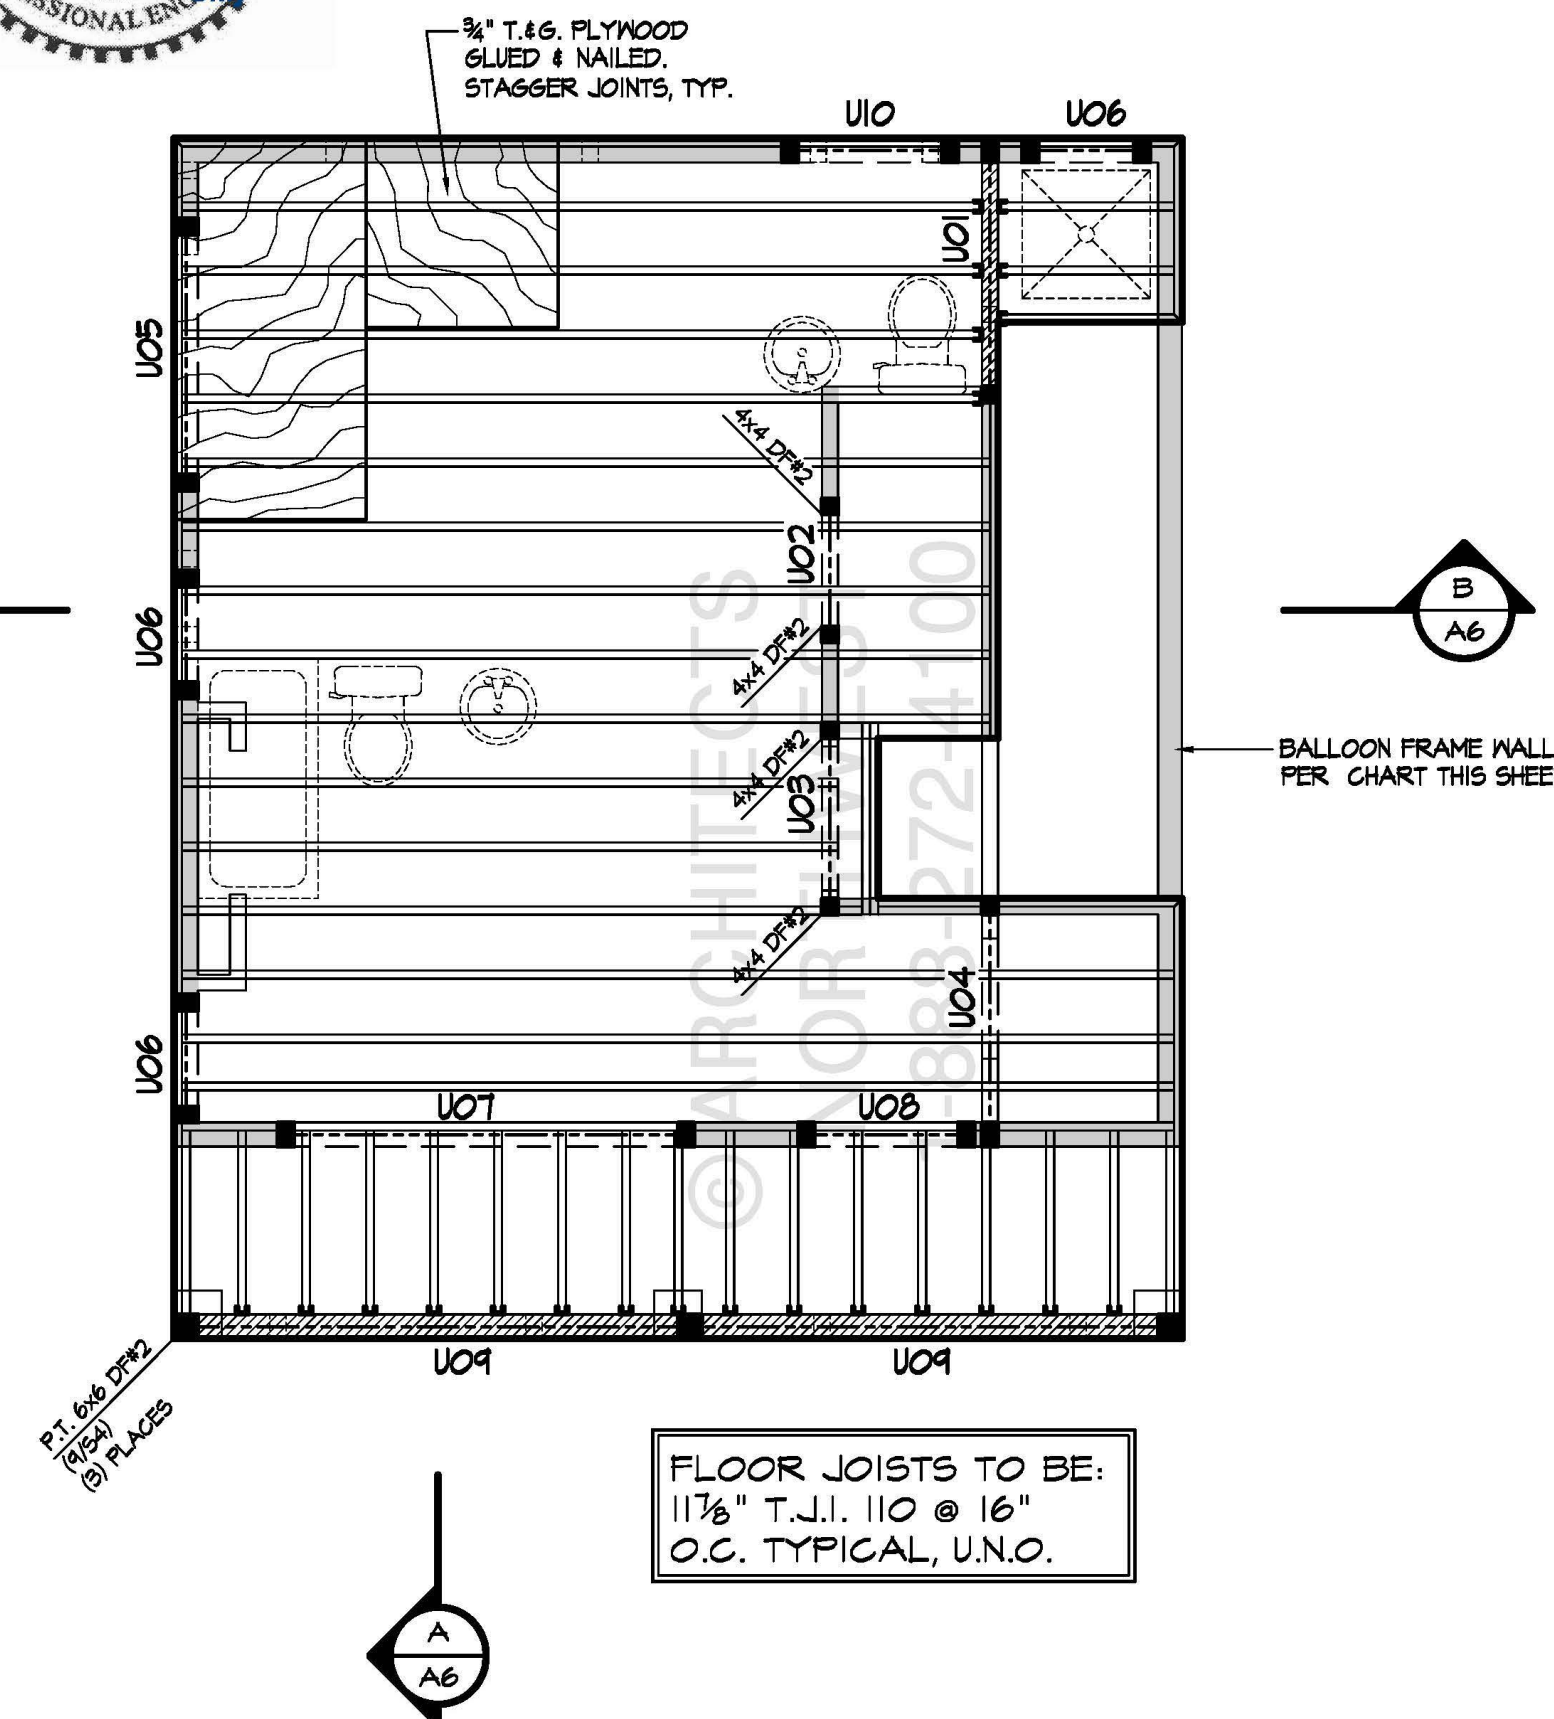

UPPER FLOOR FRAMING PLAN

SCALE: 1/4" = 1'-0"

FLOOR FRAMING NOTES:

- CONTRACTOR SHALL VERIFY ALL NOTES, DIMENSIONS & CONDITIONS PRIOR TO CONSTRUCTION.
- ALL FLOOR JOISTS TO BE 11 3/8" T.J.I. 110 @ 16" ON CENTER UNLESS NOTED OTHERWISE (U.N.O.)
- ALL HEADERS TO BE 4x10 DF#2 W/R-10 RIGID INSULATION @ EXTERIOR WARM WALLS, U.N.O.
- PROVIDE SOLID BLOCKING OVER SUPPORTS.
- PROVIDE FIRE BLOCKING @ ALL PLUMBING PENETRATIONS.
- WINDOW HEADERS @ 6'-0" ABOVE FINISHED FLOOR @ MAIN FLOOR U.N.O.
- BEARING WALLS ARE SHADED.
- PLUMBING AND MECHANICAL FIXTURES ARE DASHED.
- INDICATES POINT LOAD SUPPORTED BY (2) STUDS, U.N.O.
- ALL WOOD IN CONTACT WITH CONCRETE TO BE PRESSURE TREATED.
- SEE SHEET A1 FOR ADDITIONAL NOTES.

NOTE: SEE 'S' SHEETS FOR LATERAL INFORMATION & ENGINEERING DETAILS


BEAM SCHEDULE	
PLAN VIEW	DESCRIPTION
---	DROPPED BEAM DESIGNATED ON FLOOR PLANS
---	DROPPED BEAM DESIGNATED ON FRAMING PLANS
▨	FLUSH AND TOP FLUSH BEAM DESIGNATED ON FRAMING PLANS
▨	UPSET BEAM DESIGNATED ON FRAMING PLANS

NOTE: USE FULL LENGTH STUDS (BALLOON FRAME) PER THIS TABLE

WALL HEIGHT	FRAMING	BLOCKING
10'-0" OR LESS	2x6 @ 16" O.C.	N/A
10'-4" - 12'-6"	2x6 @ 12" O.C.	1/2 POINTS
12'-7" - 15'-0"	(2) 2x6 @ 16" O.C.	1/2 POINTS
15'-1" - 17'-6"	(2) 2x6 @ 12" O.C.	1/3 POINTS
17'-6" - 20'-2"	1 3/4" x 5 1/2" LVL @ 12" O.C.	1/3 POINTS

CLIENT: LONG DADU
6905 96TH AVE SE
MERCER ISLAND, WA 98040

CLIENT: LONG DADU
6905 96TH AVE SE
MERCER ISLAND, WA 98040

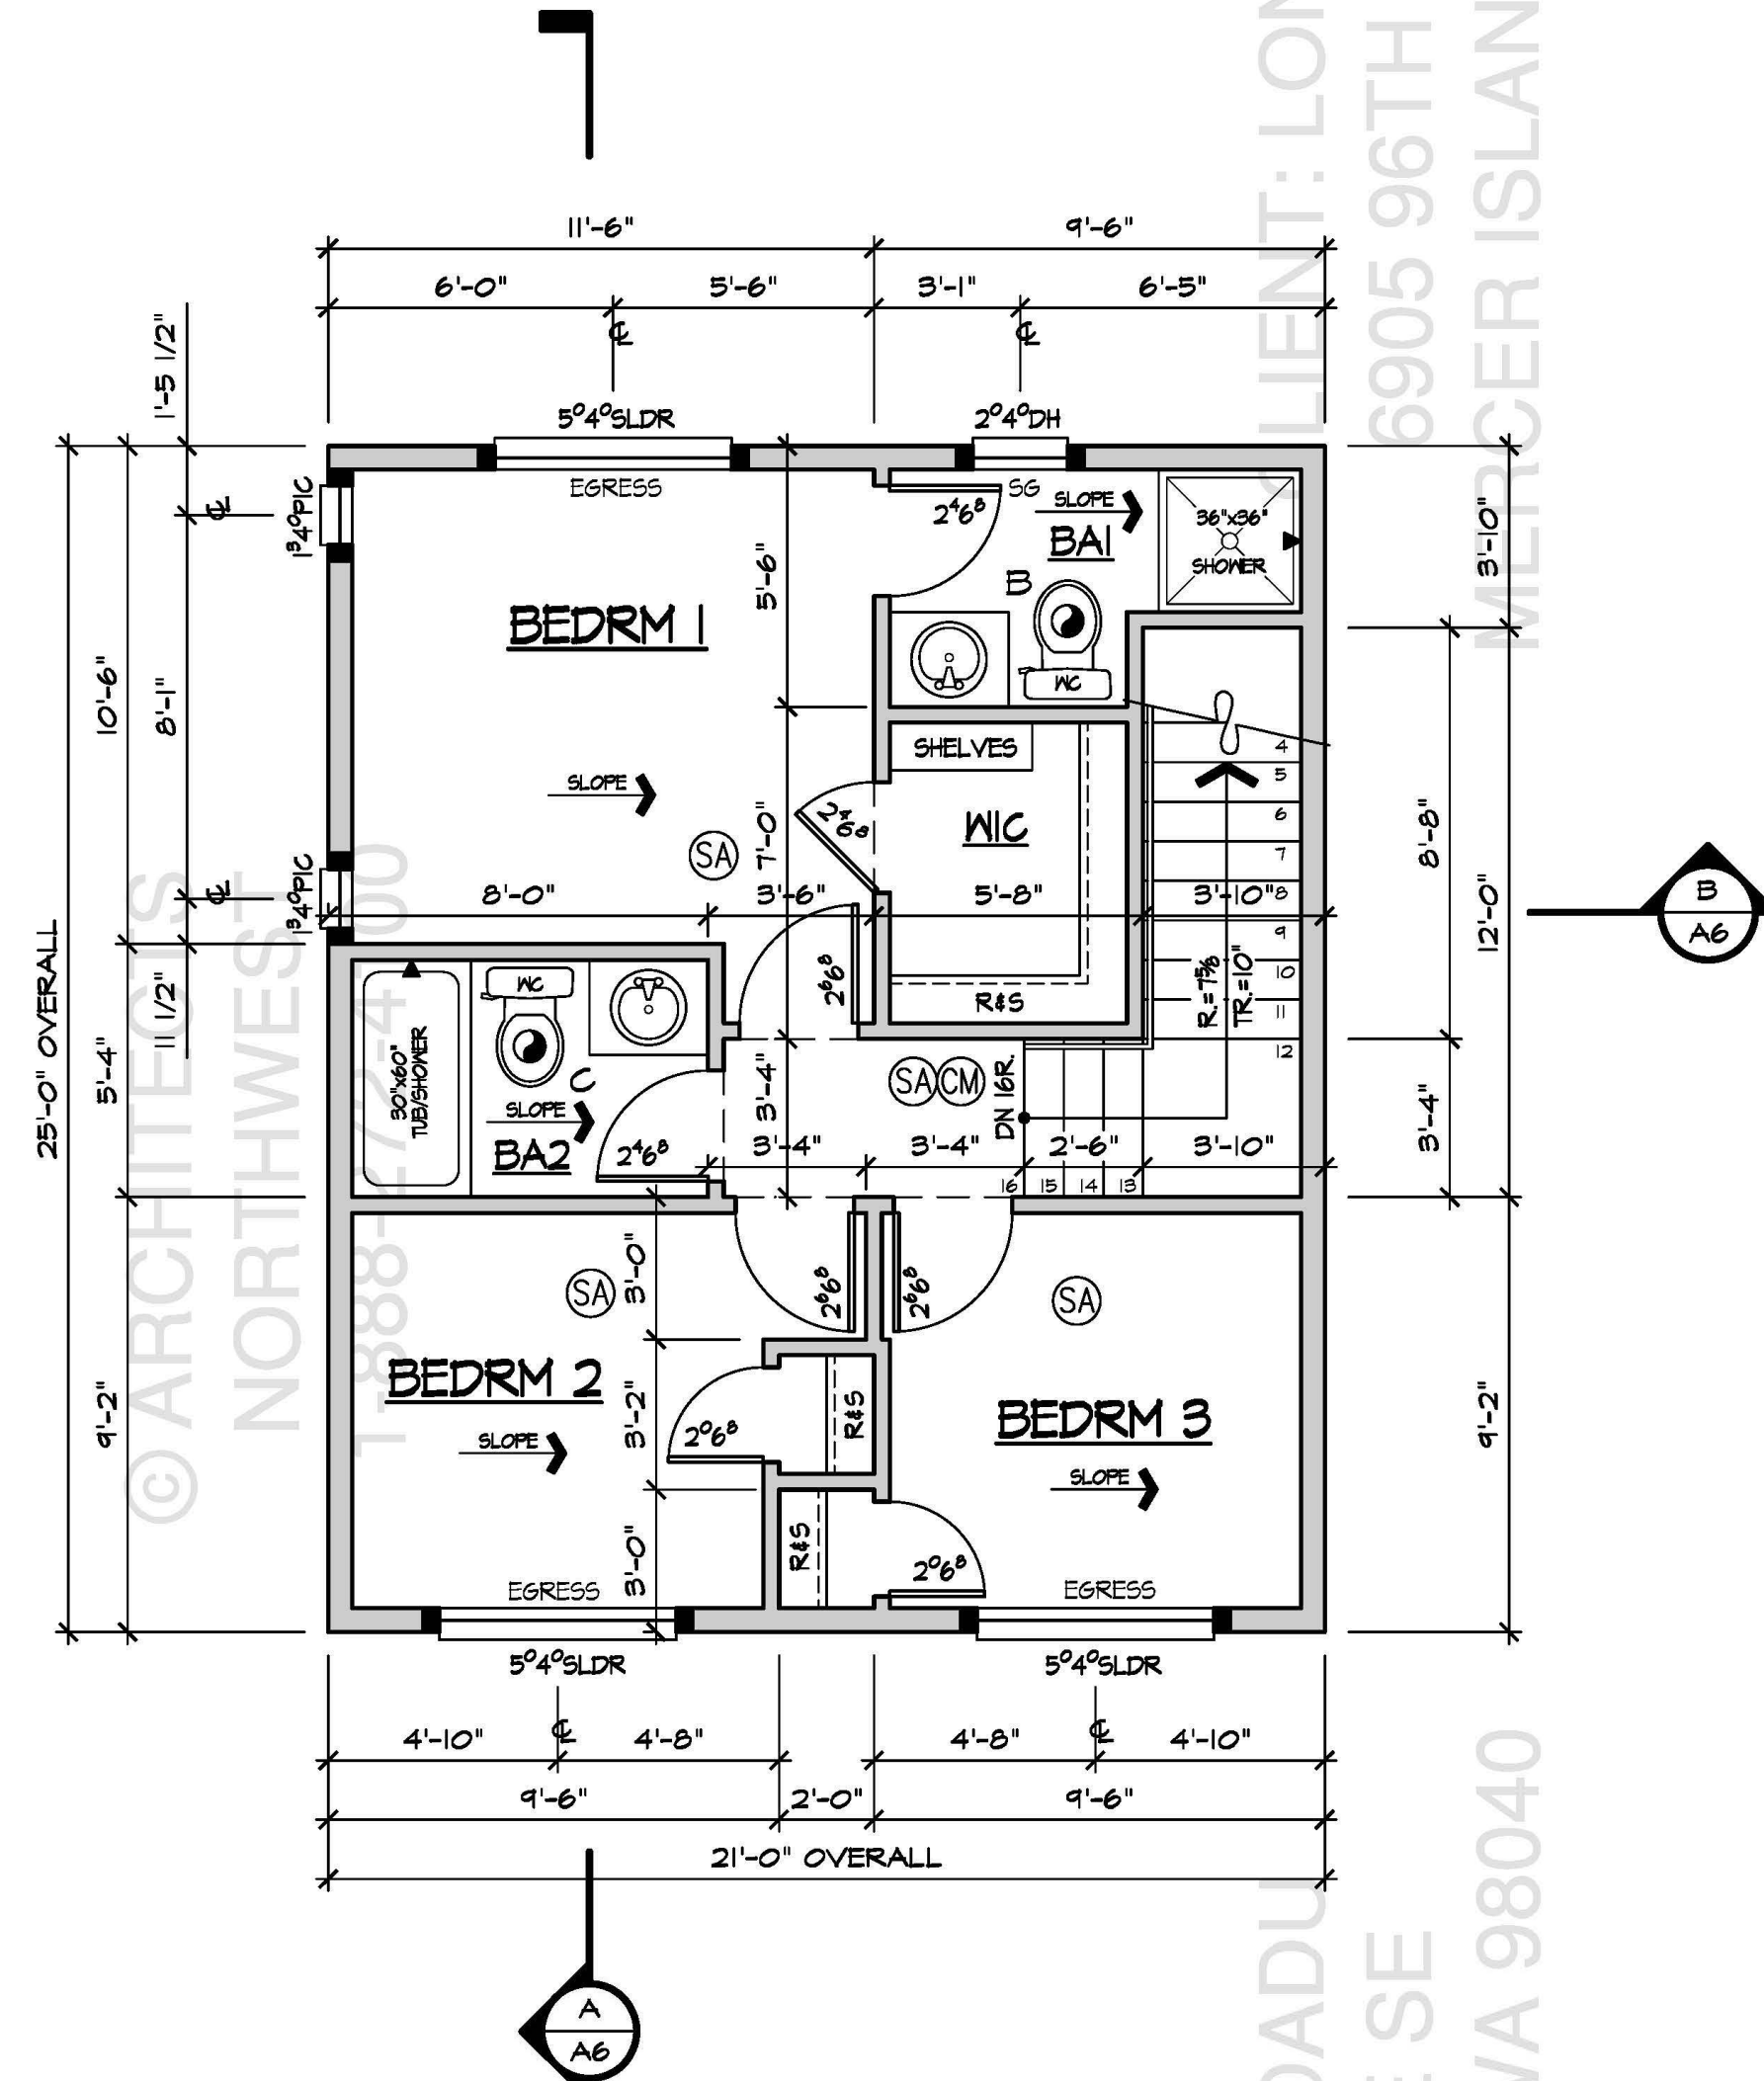

UPPER FLOOR PLAN

SCALE: 1/4" = 1'-0"

ARCHITECTS NORTHWEST
1-888-272-4100

ARCHITECTS NORTHWEST
1-888-272-4100

CLIENT: LONG DADU
6905 96TH AVE SE
MERCER ISLAND, WA 98040

CLIENT: LONG DADU
6905 96TH AVE SE
MERCER ISLAND, WA 98040

FLOOR PLAN NOTES:

- CONTRACTOR SHALL VERIFY ALL NOTES, DIMENSIONS & CONDITIONS PRIOR TO CONSTRUCTION.
- WINDOWS & DOORS ARE SHOWN & NOTED AS NOMINAL SIZES.
- EXTERIOR WALLS TO BE 2x6 STUDS @ 16" O.C. U.N.O.
- INDICATES POINT LOAD SUPPORTED BY (2) STUDS, U.N.O.
- PROVIDE STAIRWAY ILLUMINATION PER I.R.C. R302.7 & R302.8
- SEE SHEET A1 FOR ADDITIONAL NOTES.
- SEE SHEET A2 FOR VENTILATION SCHEDULE.
- SEE SHEET A2 FOR ALARM SCHEDULE.

NOTE: SEE 'S' SHEETS FOR LATERAL INFORMATION & ENGINEERING DETAILS

LONG DADU

PLAN A911A0-0

DESIGNED BY: MBJ 05/2025
DRAWN BY: BPS 7/29/25
PROJECT MANAGER: MARCUS JENKINS
REVISED BY: BPS 8/15/25

LATERAL BY: ZVELT 6/25/25
LATERAL JOB NUMBER: 25-120

A5
A7

ANW JOB NUMBER: 250052

ARCHITECTS NORTHWEST
1815 42ND AVENUE NE SUITE 100 WOODINVILLE, WA 98072
OFFICE: (425) 485-4800 FAX: (425) 487-6585
TOLL FREE: 1-888-272-4100 WWW.ARCHITECTSNW.COM

PAYMENT OF USE FEE IS DUE TO ARCHITECTS NORTHWEST, INC. PRIOR TO CONSTRUCTION FOR THESE PLANS. THESE PLANS ARE COPYRIGHTED IN ACCORDANCE WITH THE COPYRIGHT ACT OF 1976. NO PART OF THIS METHOD OF ALL OR PORTIONS OF THESE PLANS OR FROM ARCHITECTS NORTHWEST, INC. IS STRICTLY PROHIBITED. THESE DRAWINGS AND PLANS SET FORTH THE DESIGN AND CONSTRUCTION OF THE PROJECT AND SHALL REMAIN THE PROPERTY OF ARCHITECTS NORTHWEST, INC.

REGISTERED ARCHITECT
STATE OF WASHINGTON
8/15/25

CLIENT: LONG DADU
6905 96TH AVE SE
MERCER ISLAND, WA 98040


© ARCHITECTS NORTHWEST
1-888-272-4100

© ARCHITECTS NORTHWEST
1-888-272-4100


CLIENT: LONG DADU
6905 96TH AVE SE
MERCER ISLAND, WA 98040

© ARCHITECTS NORTHWEST
1-888-272-4100

© ARCHITECTS NORTHWEST
1-888-272-4100

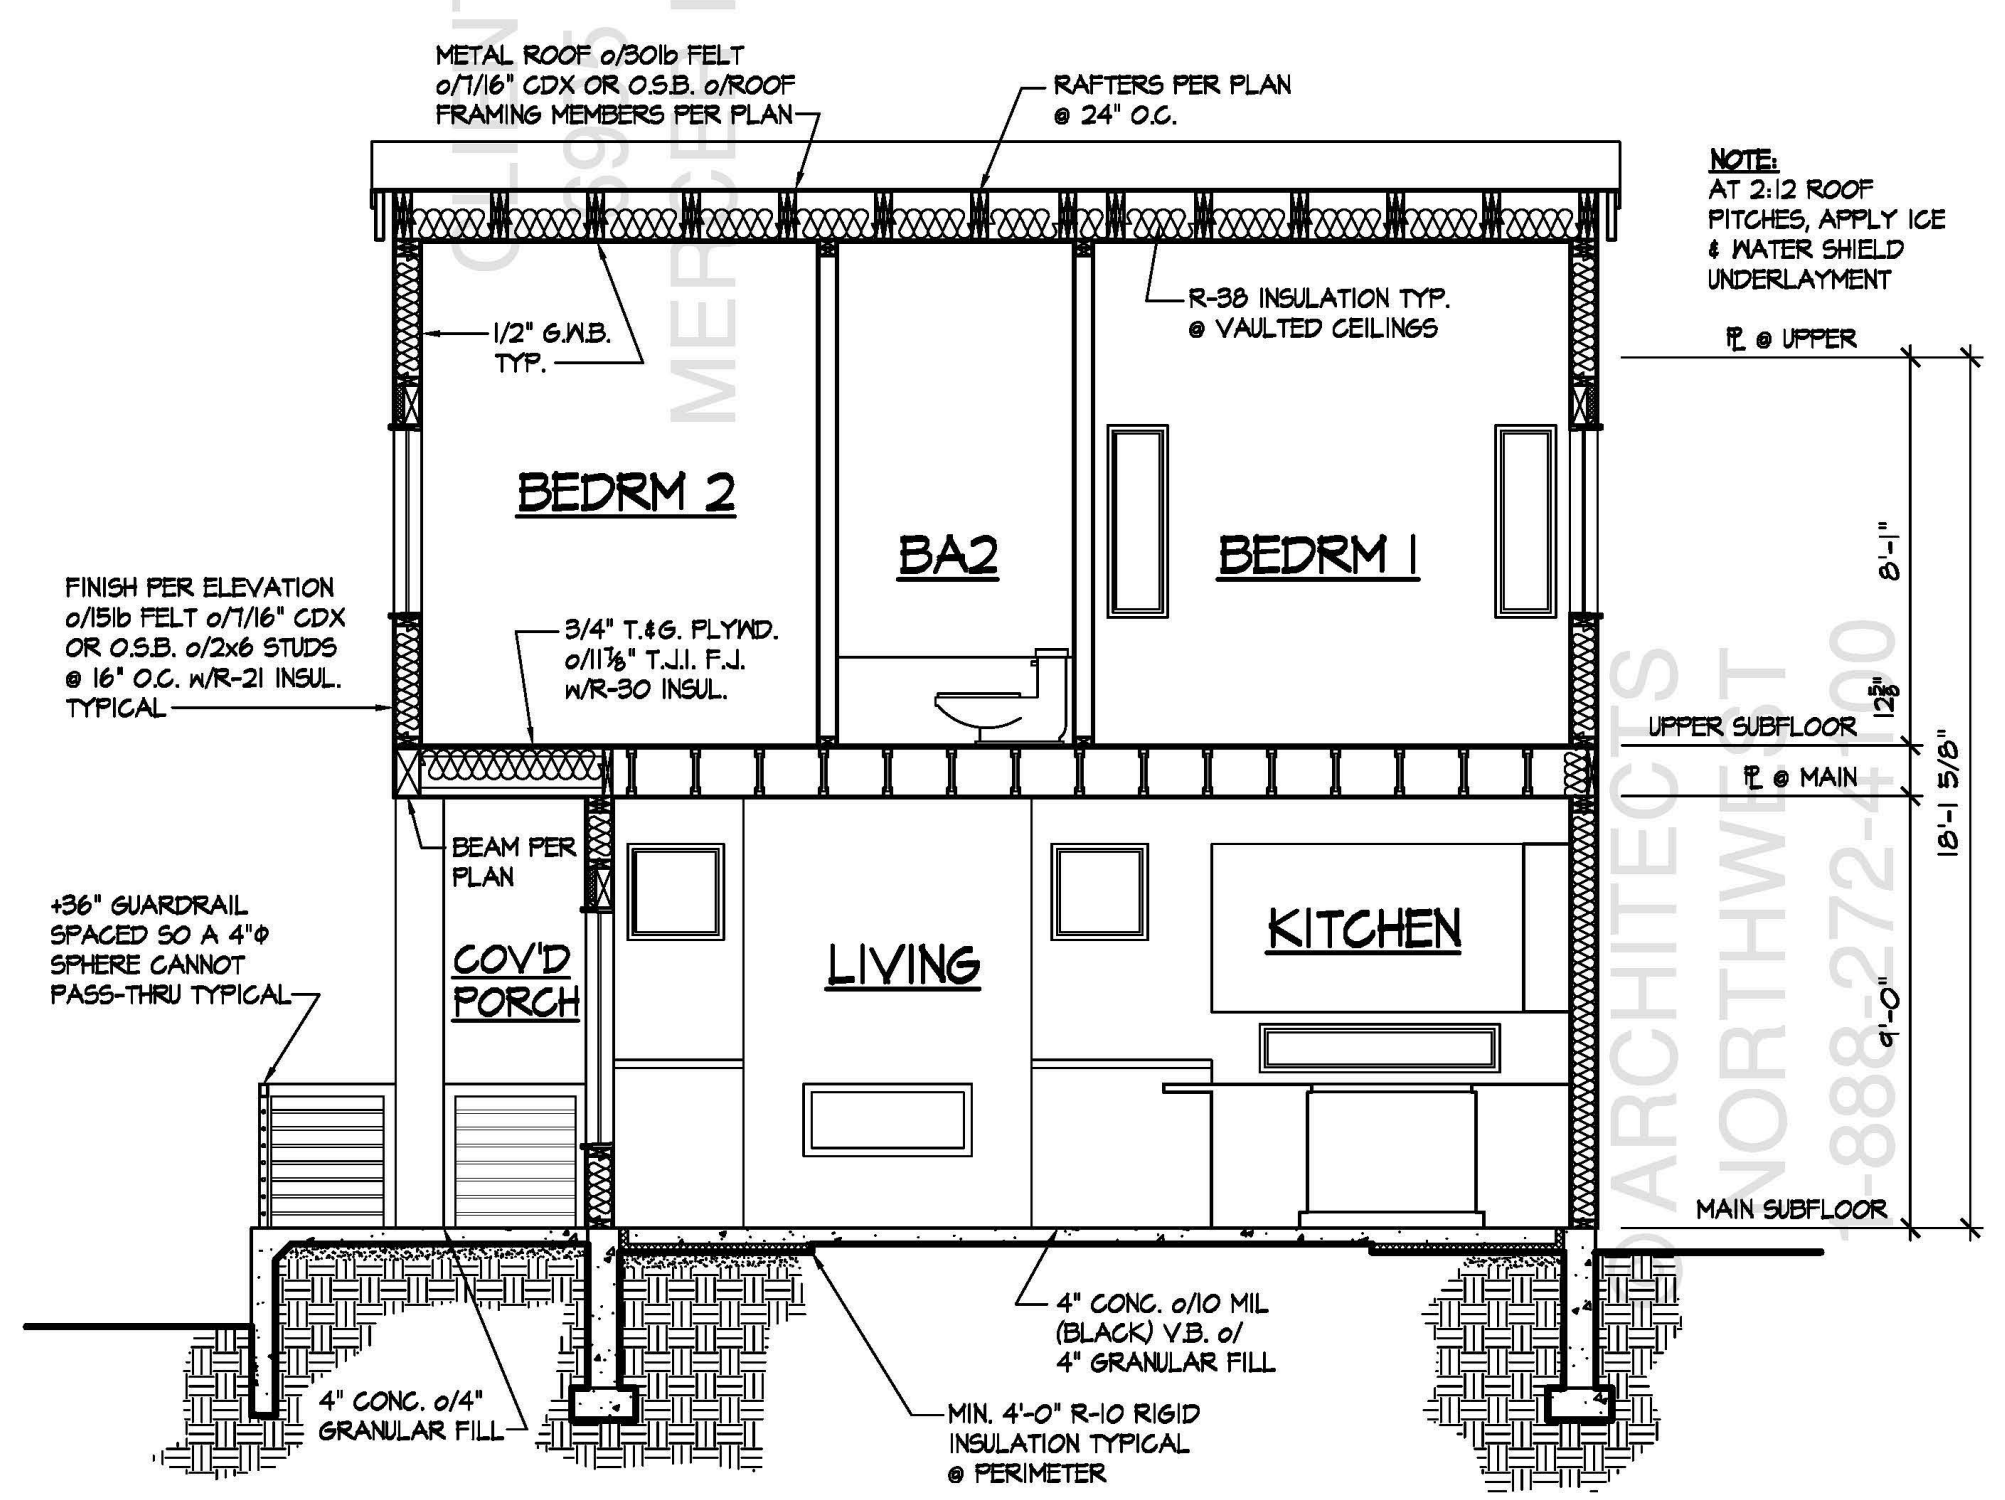


BUILDING SECTION 'A'
SCALE: 1/4" = 1'-0"

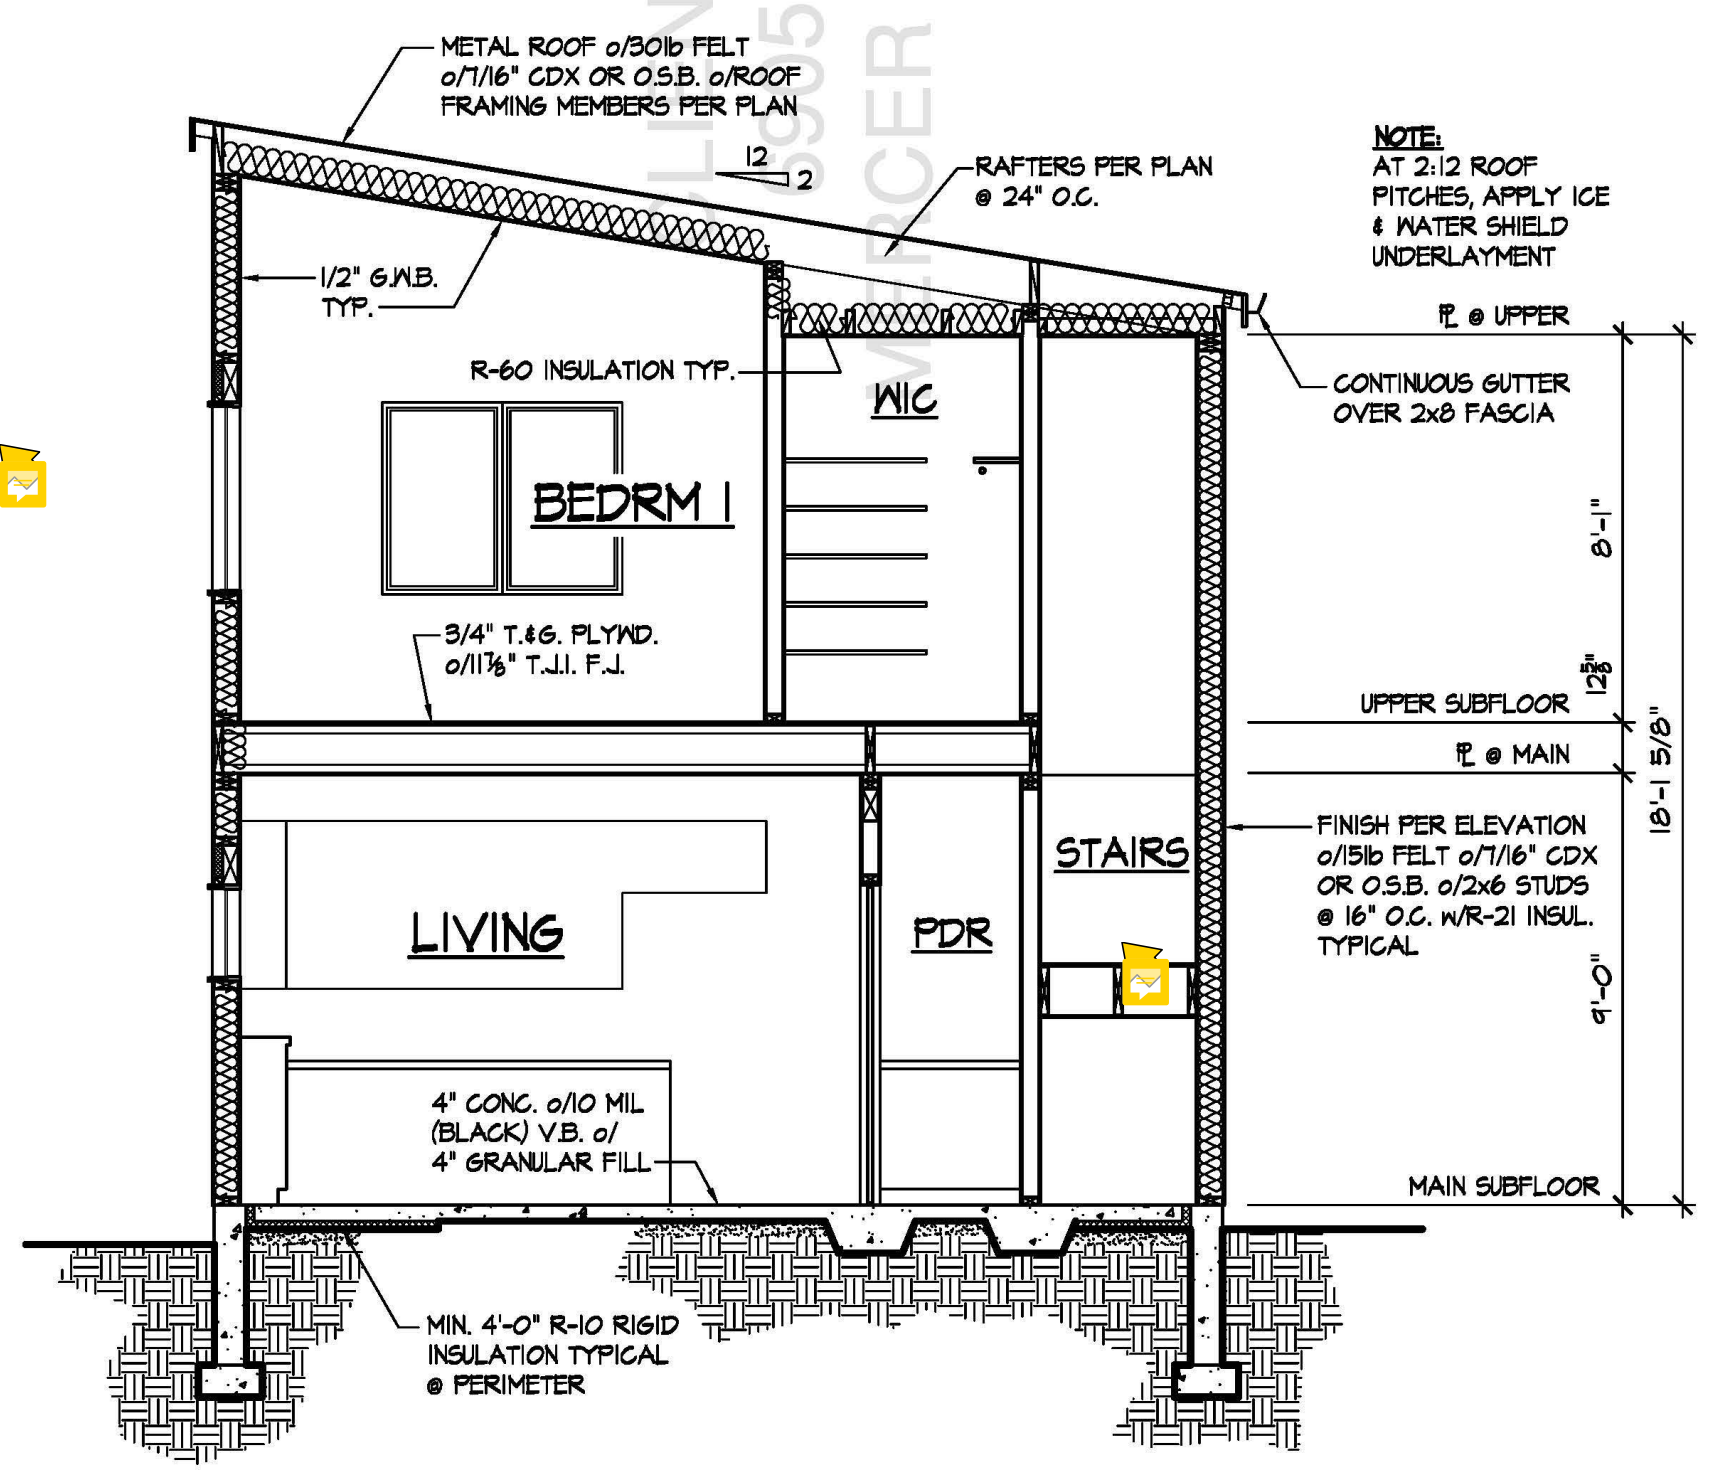

BUILDING SECTION 'B'
SCALE: 1/4" = 1'-0"

ROOF BEAM SCHEDULE

MEMBER	BM SIZE	SPECIES	CONNECTION	COMMENTS
RO1	4 x 10	DF#2	-	HEADER
RO2	4 x 10	DF#2	-	HEADER

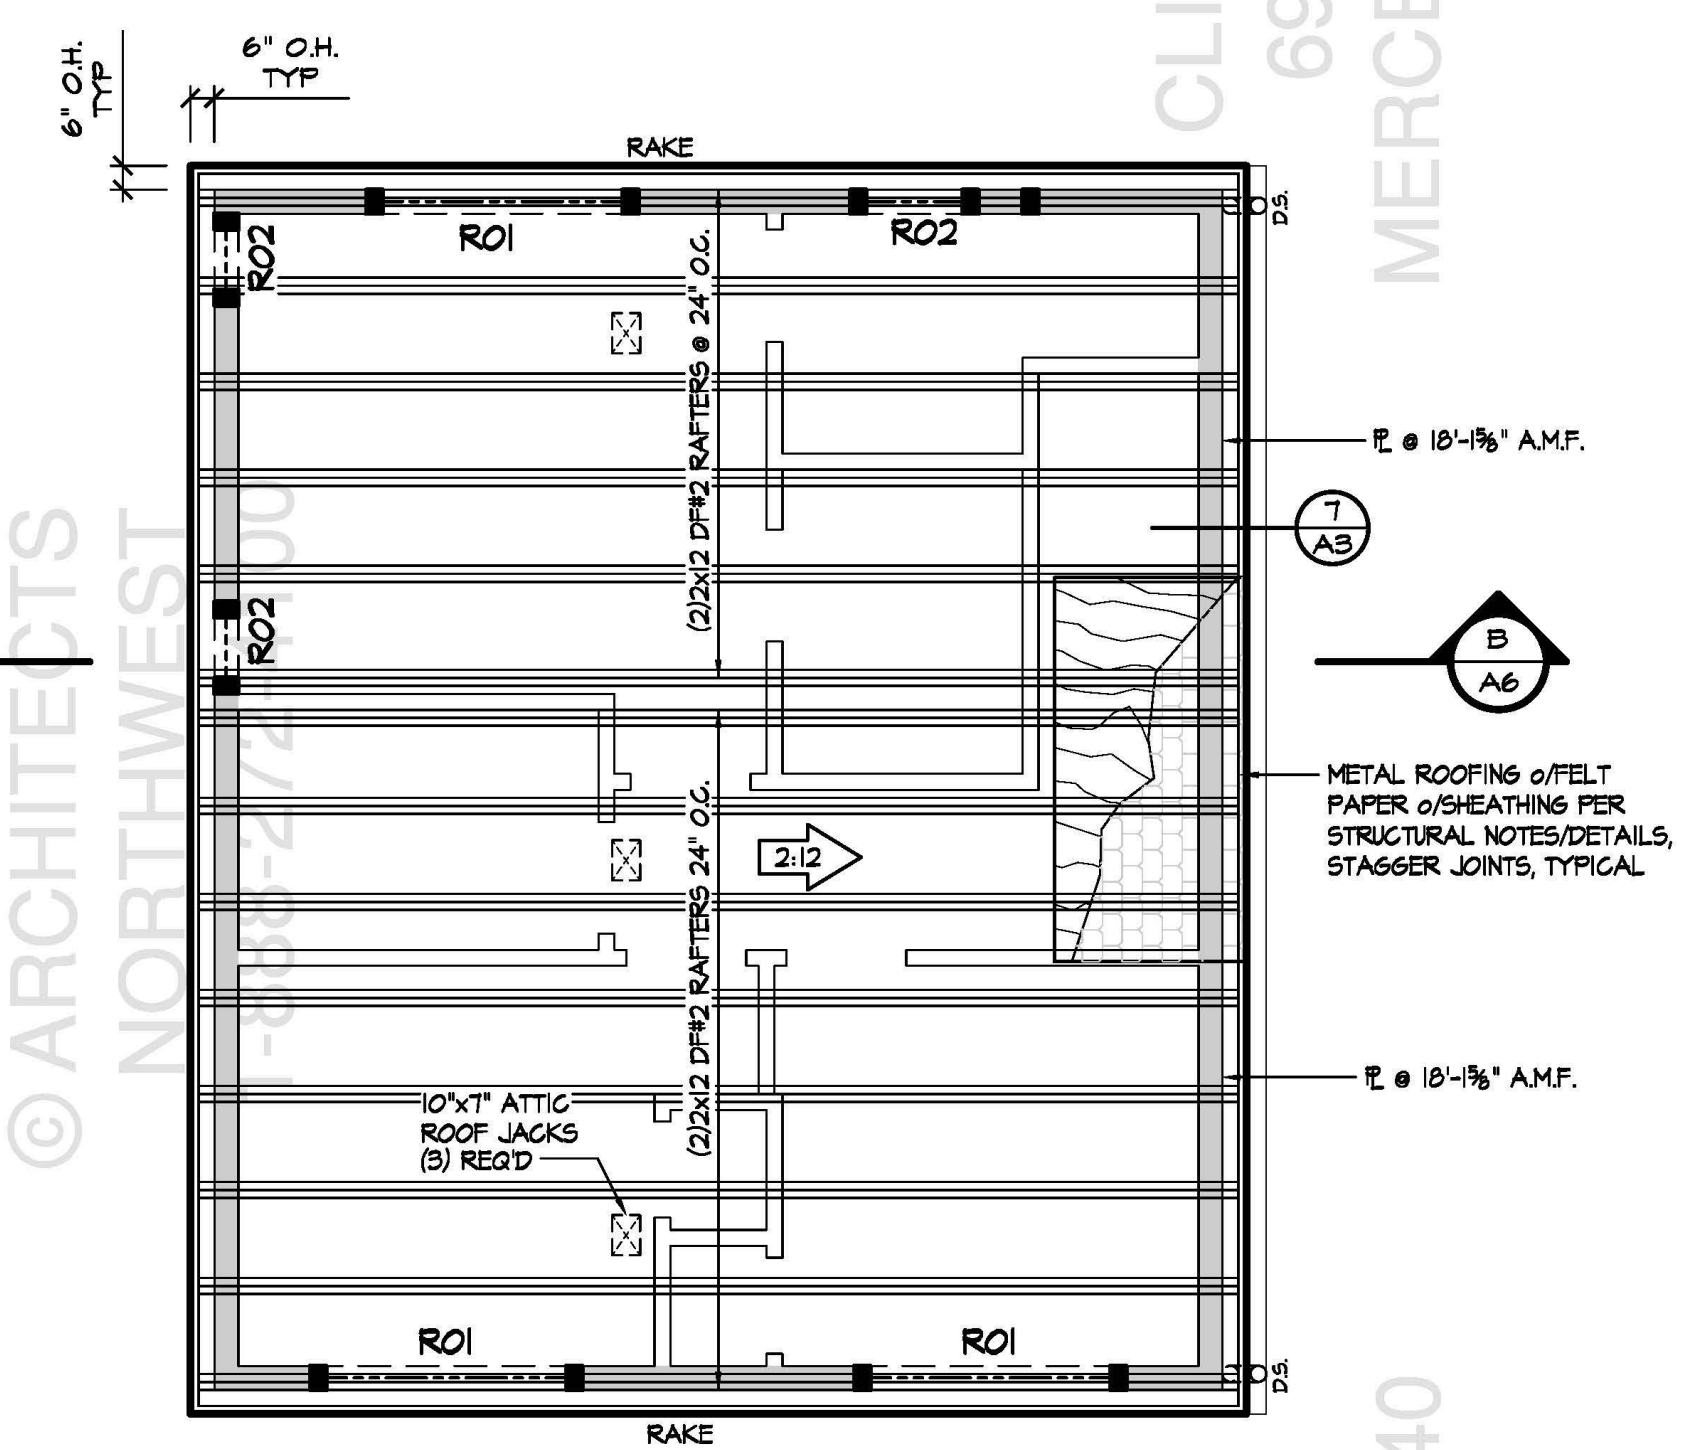


ROOF FRAMING PLAN
SCALE: 1/4" = 1'-0"

ROOF FRAMING NOTES:

- CONTRACTOR SHALL VERIFY ALL NOTES, DIMENSIONS & CONDITIONS PRIOR TO CONSTRUCTION.
- ALL HEADERS TO BE 4x10 DF#2 w/ R-10 RIGID INSULATION @ EXTERIOR WARM WALLS, U.N.O.
- PROVIDE VENTED BLOCKING OVER SUPPORTS.
- BEARING WALLS ARE SHADED.
- WINDOW HEADERS @ 6'-0" ABOVE FINISHED FLOOR @ MAIN FLOOR U.N.O. WINDOW HEADERS @ 6'-0" ABOVE FINISHED FLOOR @ UPPER FLOOR U.N.O.
- ALL TRUSSES:
 - SHALL CARRY MANUFACTURER'S STAMP.
 - SHALL BE INSTALLED & BRACED TO MANUFACTURER'S SPECIFICATIONS.
 - SHALL HAVE DESIGN DETAILS & DRAWINGS ON SITE FOR FRAMING INSPECTION.
 - SHALL NOT BE FIELD ALTERED WITHOUT PRIOR BUILDING DEPARTMENT APPROVAL OF ENGINEERS CALCULATIONS.
 - TRUSS HANGERS SHALL BE SPECIFIED BY THE TRUSS ENGINEER.
- INDICATES POINT LOAD SUPPORTED BY (2) STUDS U.N.O.
- INSTALL SHEAR WALLS &/OR BLOCKING IN ROOF STRUCTURE BEFORE INSTALLING FINISH ROOFING.
- SEE SHEET A1 FOR ADDITIONAL NOTES.
- SEE SHEET A2 FOR ROOF VENTILATION CALCULATION(S).


ROOF UNDERLAYMENT NOTE:
ROOFS WITH PITCHES BETWEEN 2:12 AND 4:12 ARE REQUIRED TO HAVE A DOUBLE UNDERLAYMENT PER IRC 905.2.2.

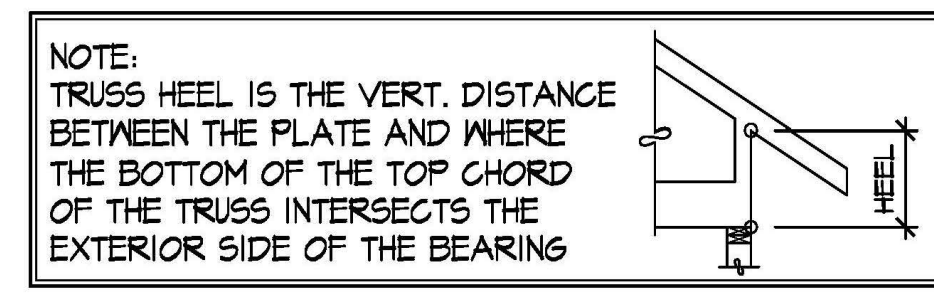

NOTE: SEE 'S' SHEETS FOR LATERAL INFORMATION & ENGINEERING DETAILS

BEAM SCHEDULE

PLAN VIEW	DESCRIPTION
---	DROPPED BEAM DESIGNATED ON FLOOR PLANS.
----	DROPPED BEAM DESIGNATED ON FRAMING PLANS.
	FLUSH AND TOP FLUSH BEAM DESIGNATED ON FRAMING PLANS.
	UPSET BEAM DESIGNATED ON FRAMING PLANS.

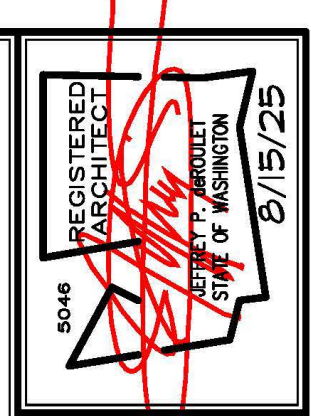


PAYMENT OF USE FEE IS DUE TO ARCHITECTS NORTHWEST, INC. PRIOR TO CONSTRUCTION FOR THESE PLANS. THESE PLANS ARE COPYRIGHTED IN ACCORDANCE WITH THE ARCHITECTURAL ACT OF 1991. REPRODUCTION OF THESE PLANS OR METHOD OF ALL OR PORTIONS OF THESE PLANS OR FROM ANY SOURCE WITHOUT THE WRITTEN CONSENT OF ARCHITECTS NORTHWEST, INC. IS STRICTLY PROHIBITED. THESE DRAWINGS AND PLANS SET FORTH THE DESIGN AND CONSTRUCTION OF THE PROJECT AND SHALL REMAIN THE PROPERTY OF ARCHITECTS NORTHWEST, INC.

ARCHITECTS NORTHWEST
18915-142ND AVENUE NE SUITE 100
WOODINVILLE, WA 98072
OFFICE: (425) 485-4800
FAX: (425) 487-6685
TOLL FREE: 1-888-272-4100
WWW.ARCHITECTSNW.COM


LONG DADU
PLAN A911A0-0

DESIGNED BY: MBJ 05/20/25
DRAWN BY: BPS 1/24/25
PROJECT MANAGER: MARCUS JENKINS
REVISED BY: BPS 8/15/25


LATERAL BY: ZVELT 6/25/25
LATERAL JOB NUMBER: 25-120
A6
A7
ANW JOB NUMBER: 250052

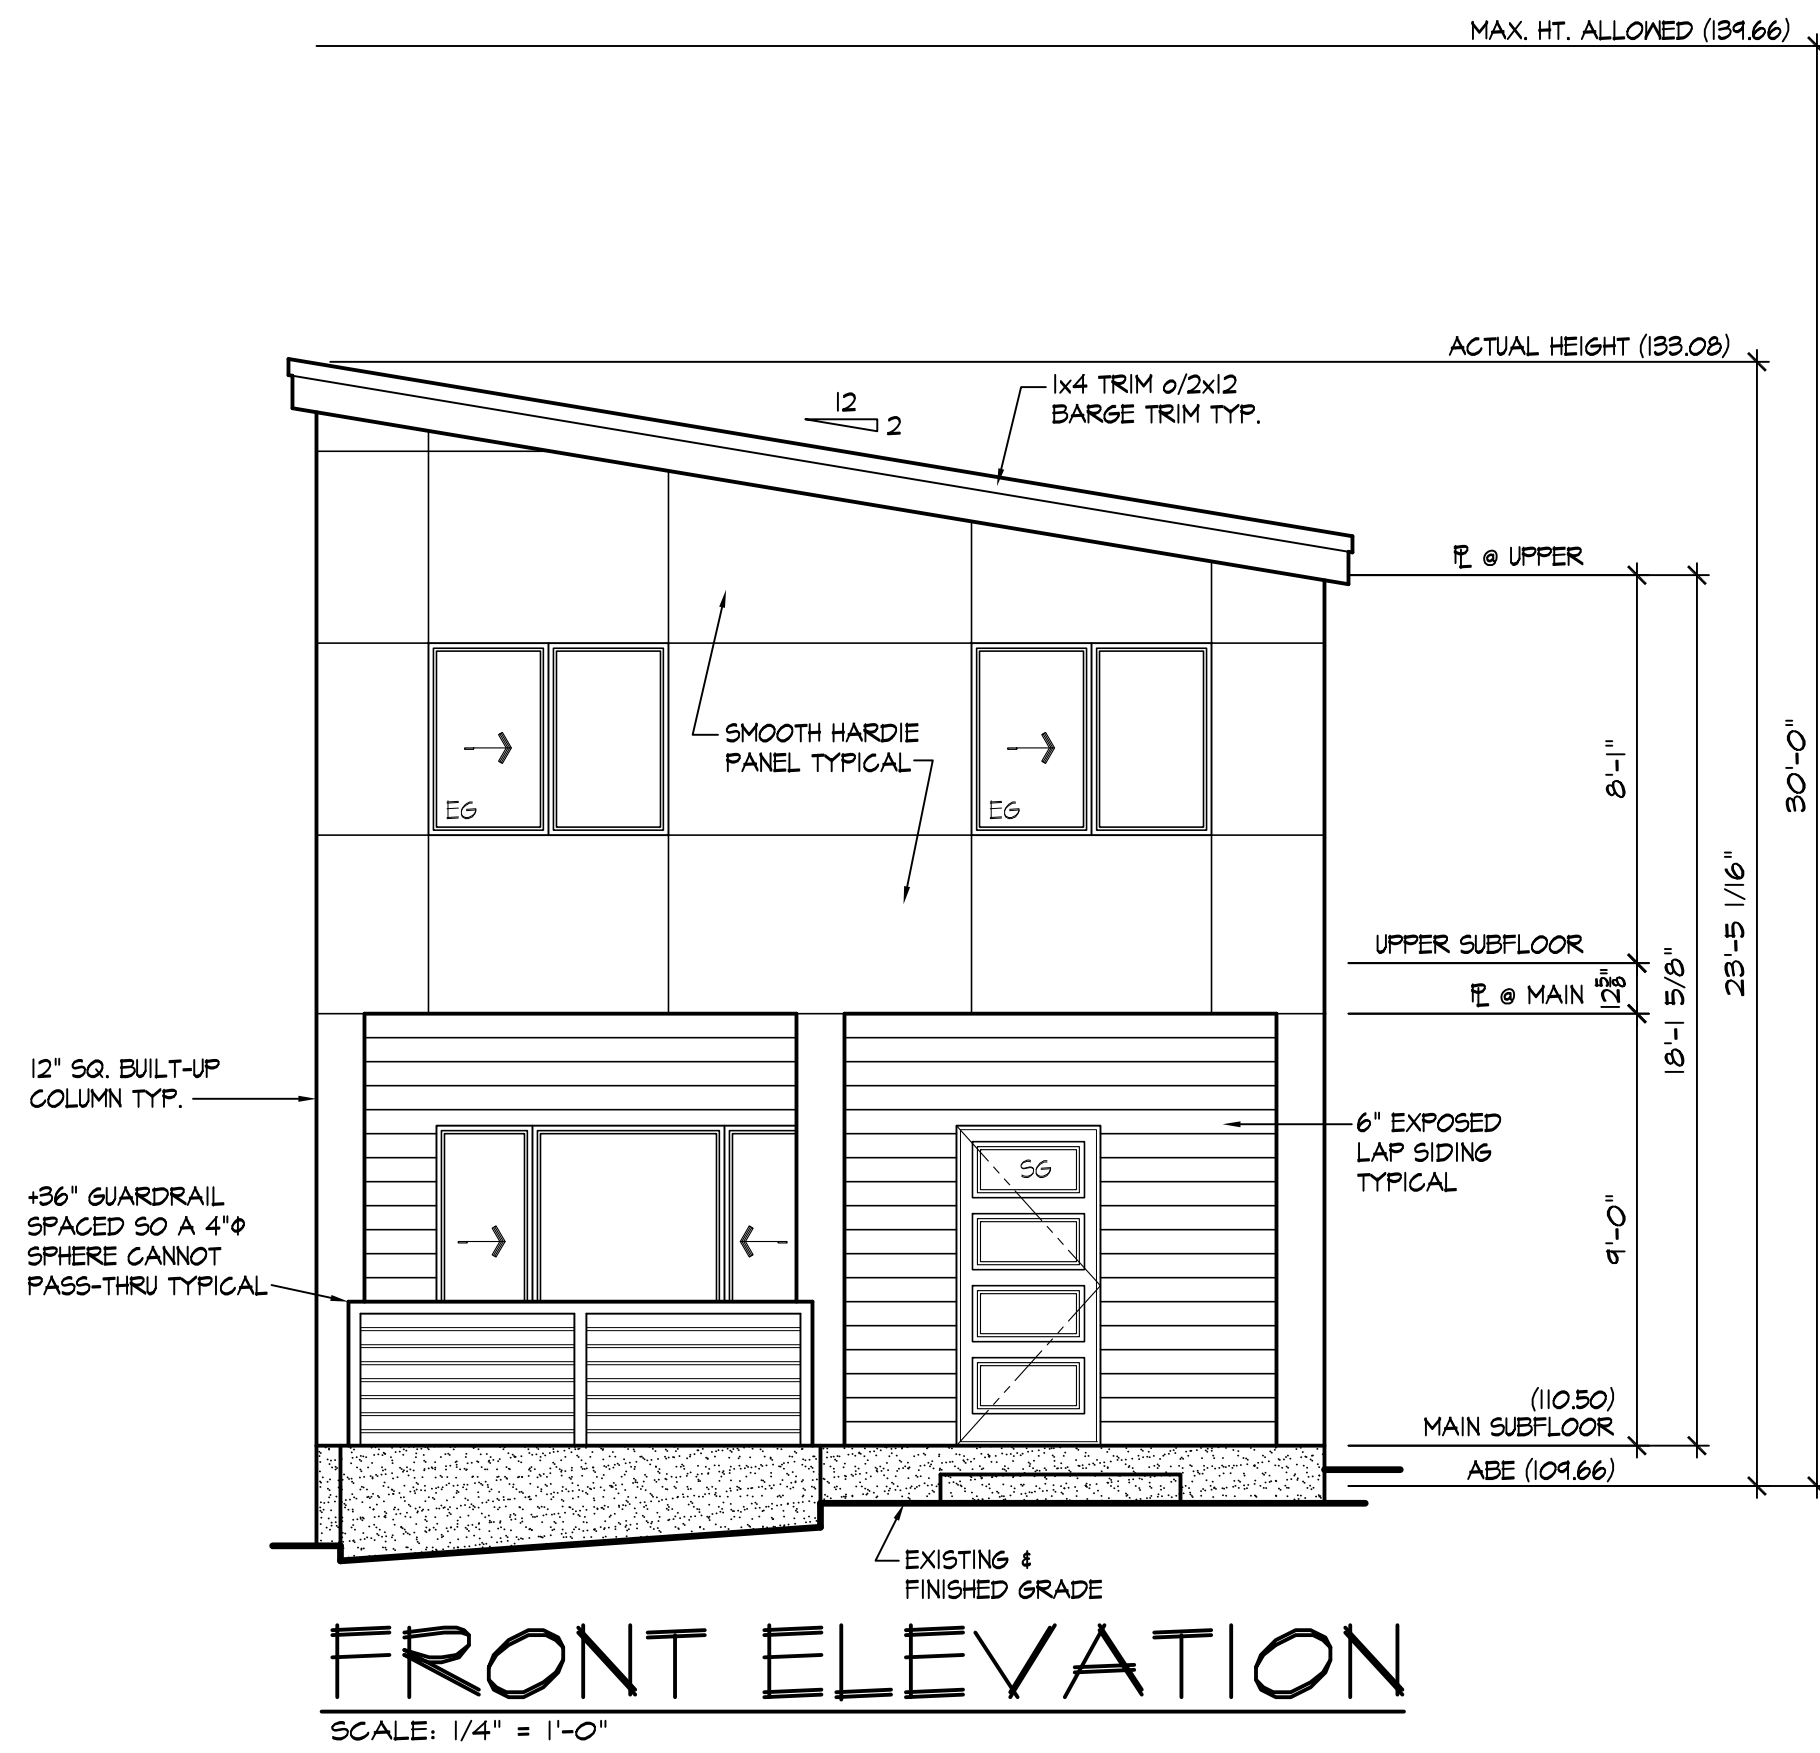


FRONT ELEVATION
SCALE: 1/4" = 1'-0"

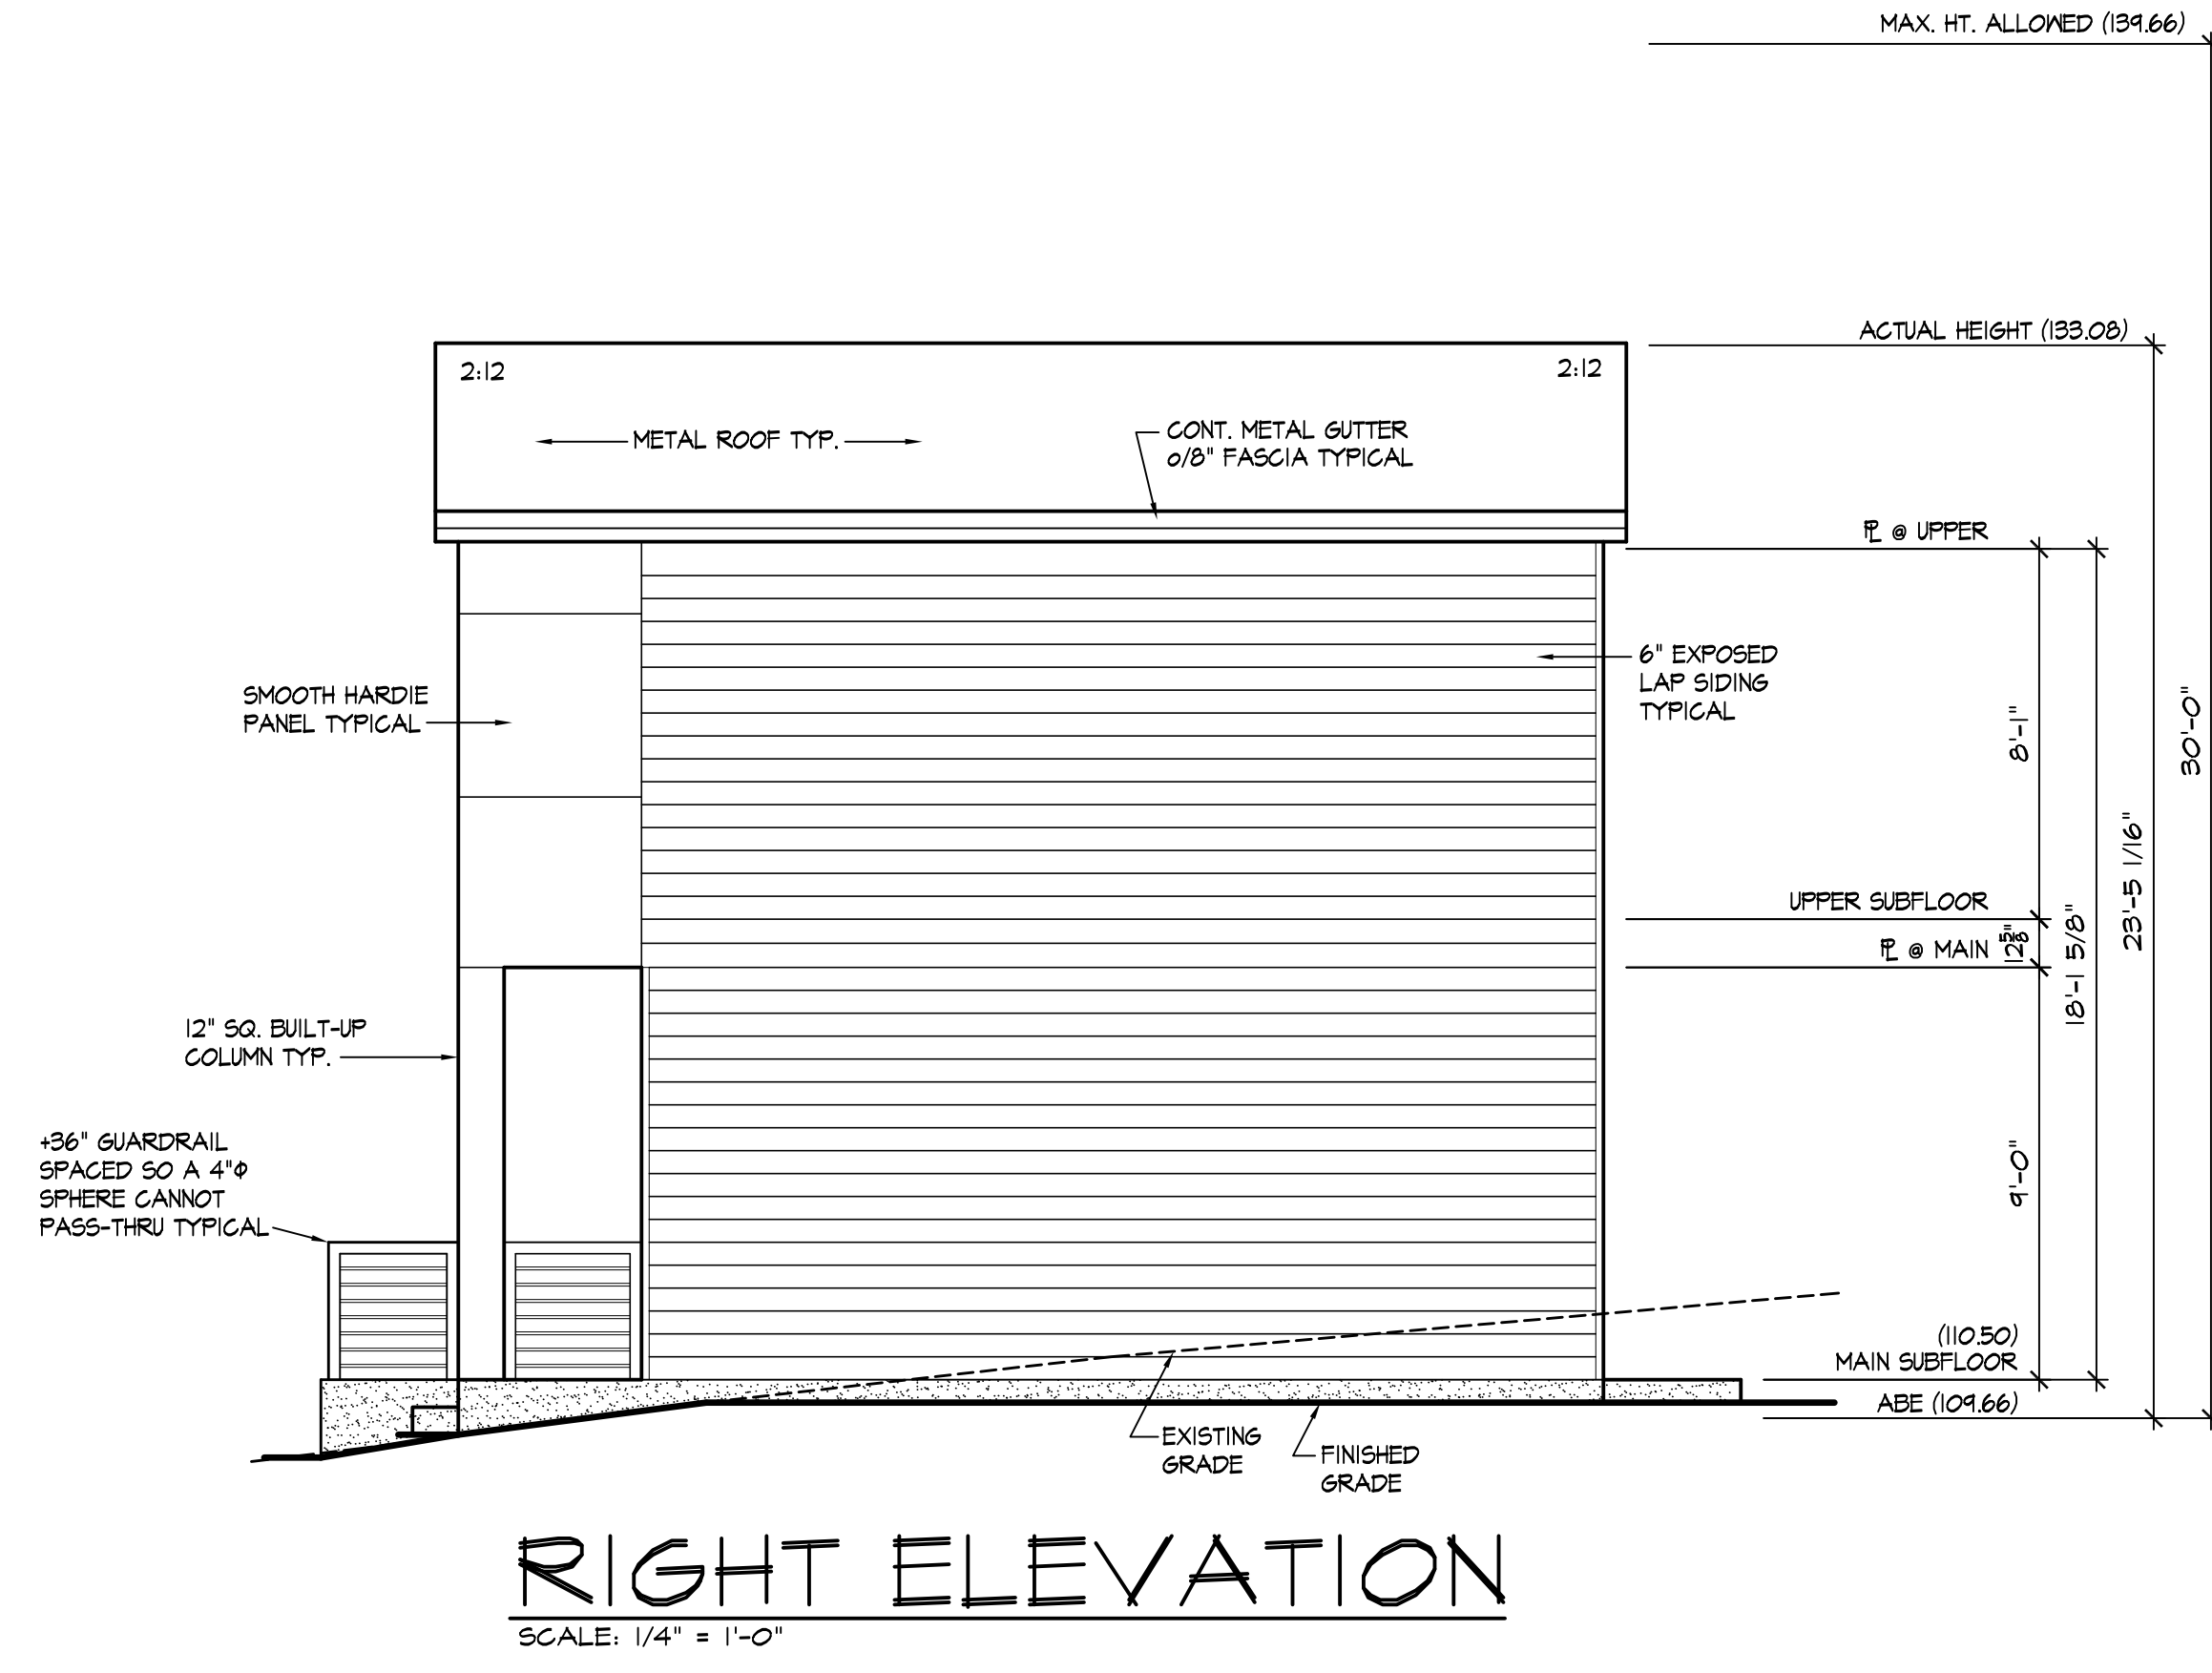

RIGHT ELEVATION
SCALE: 1/4" = 1'-0"

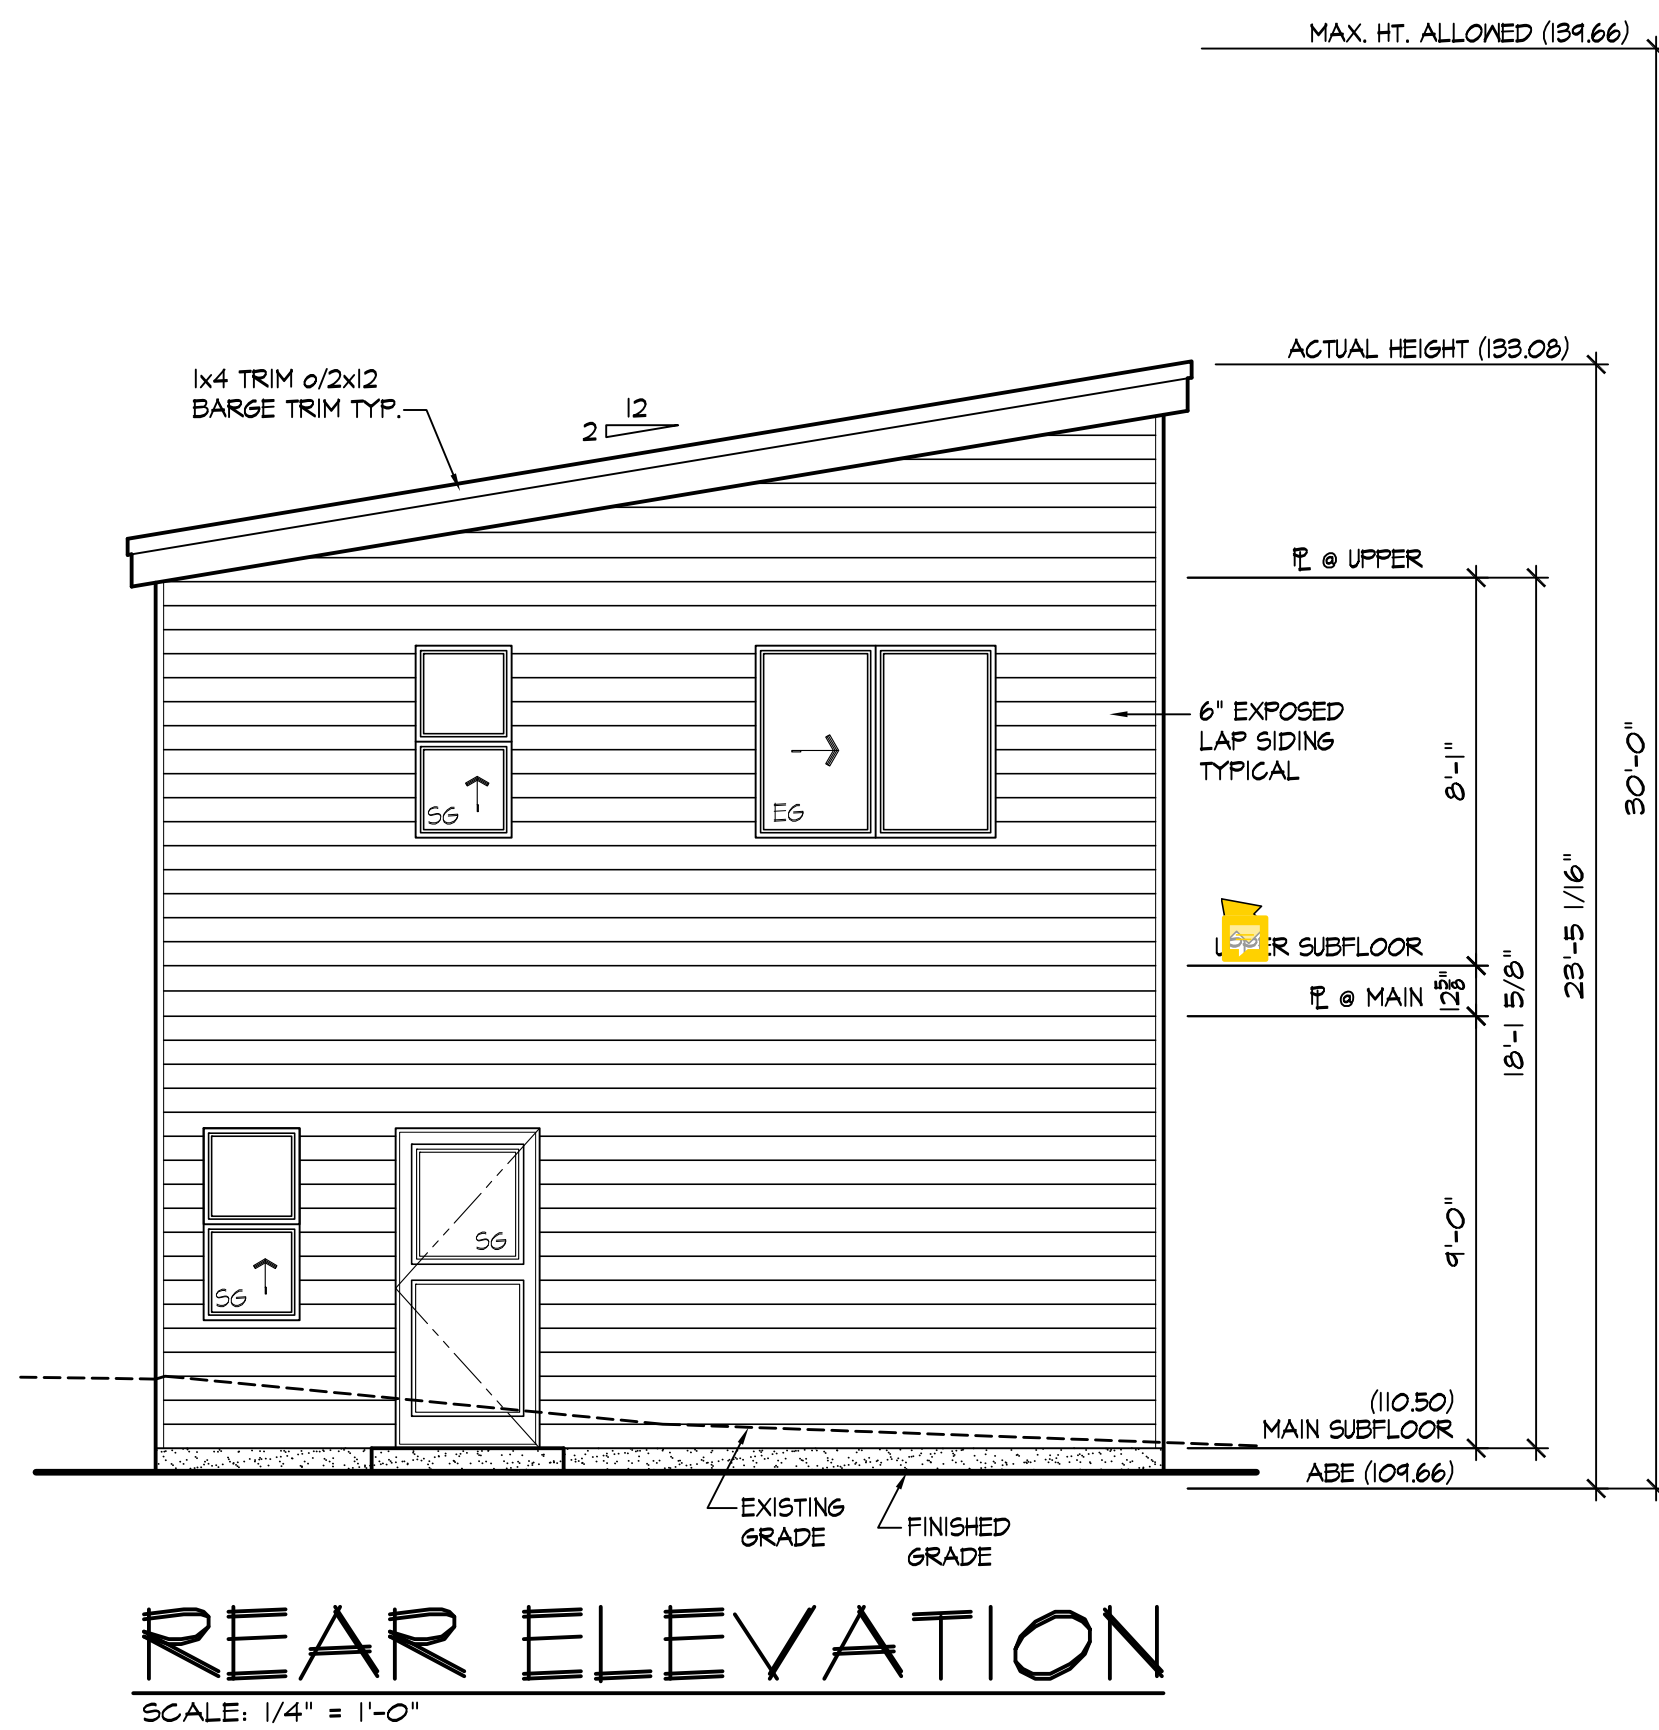

REAR ELEVATION
SCALE: 1/4" = 1'-0"

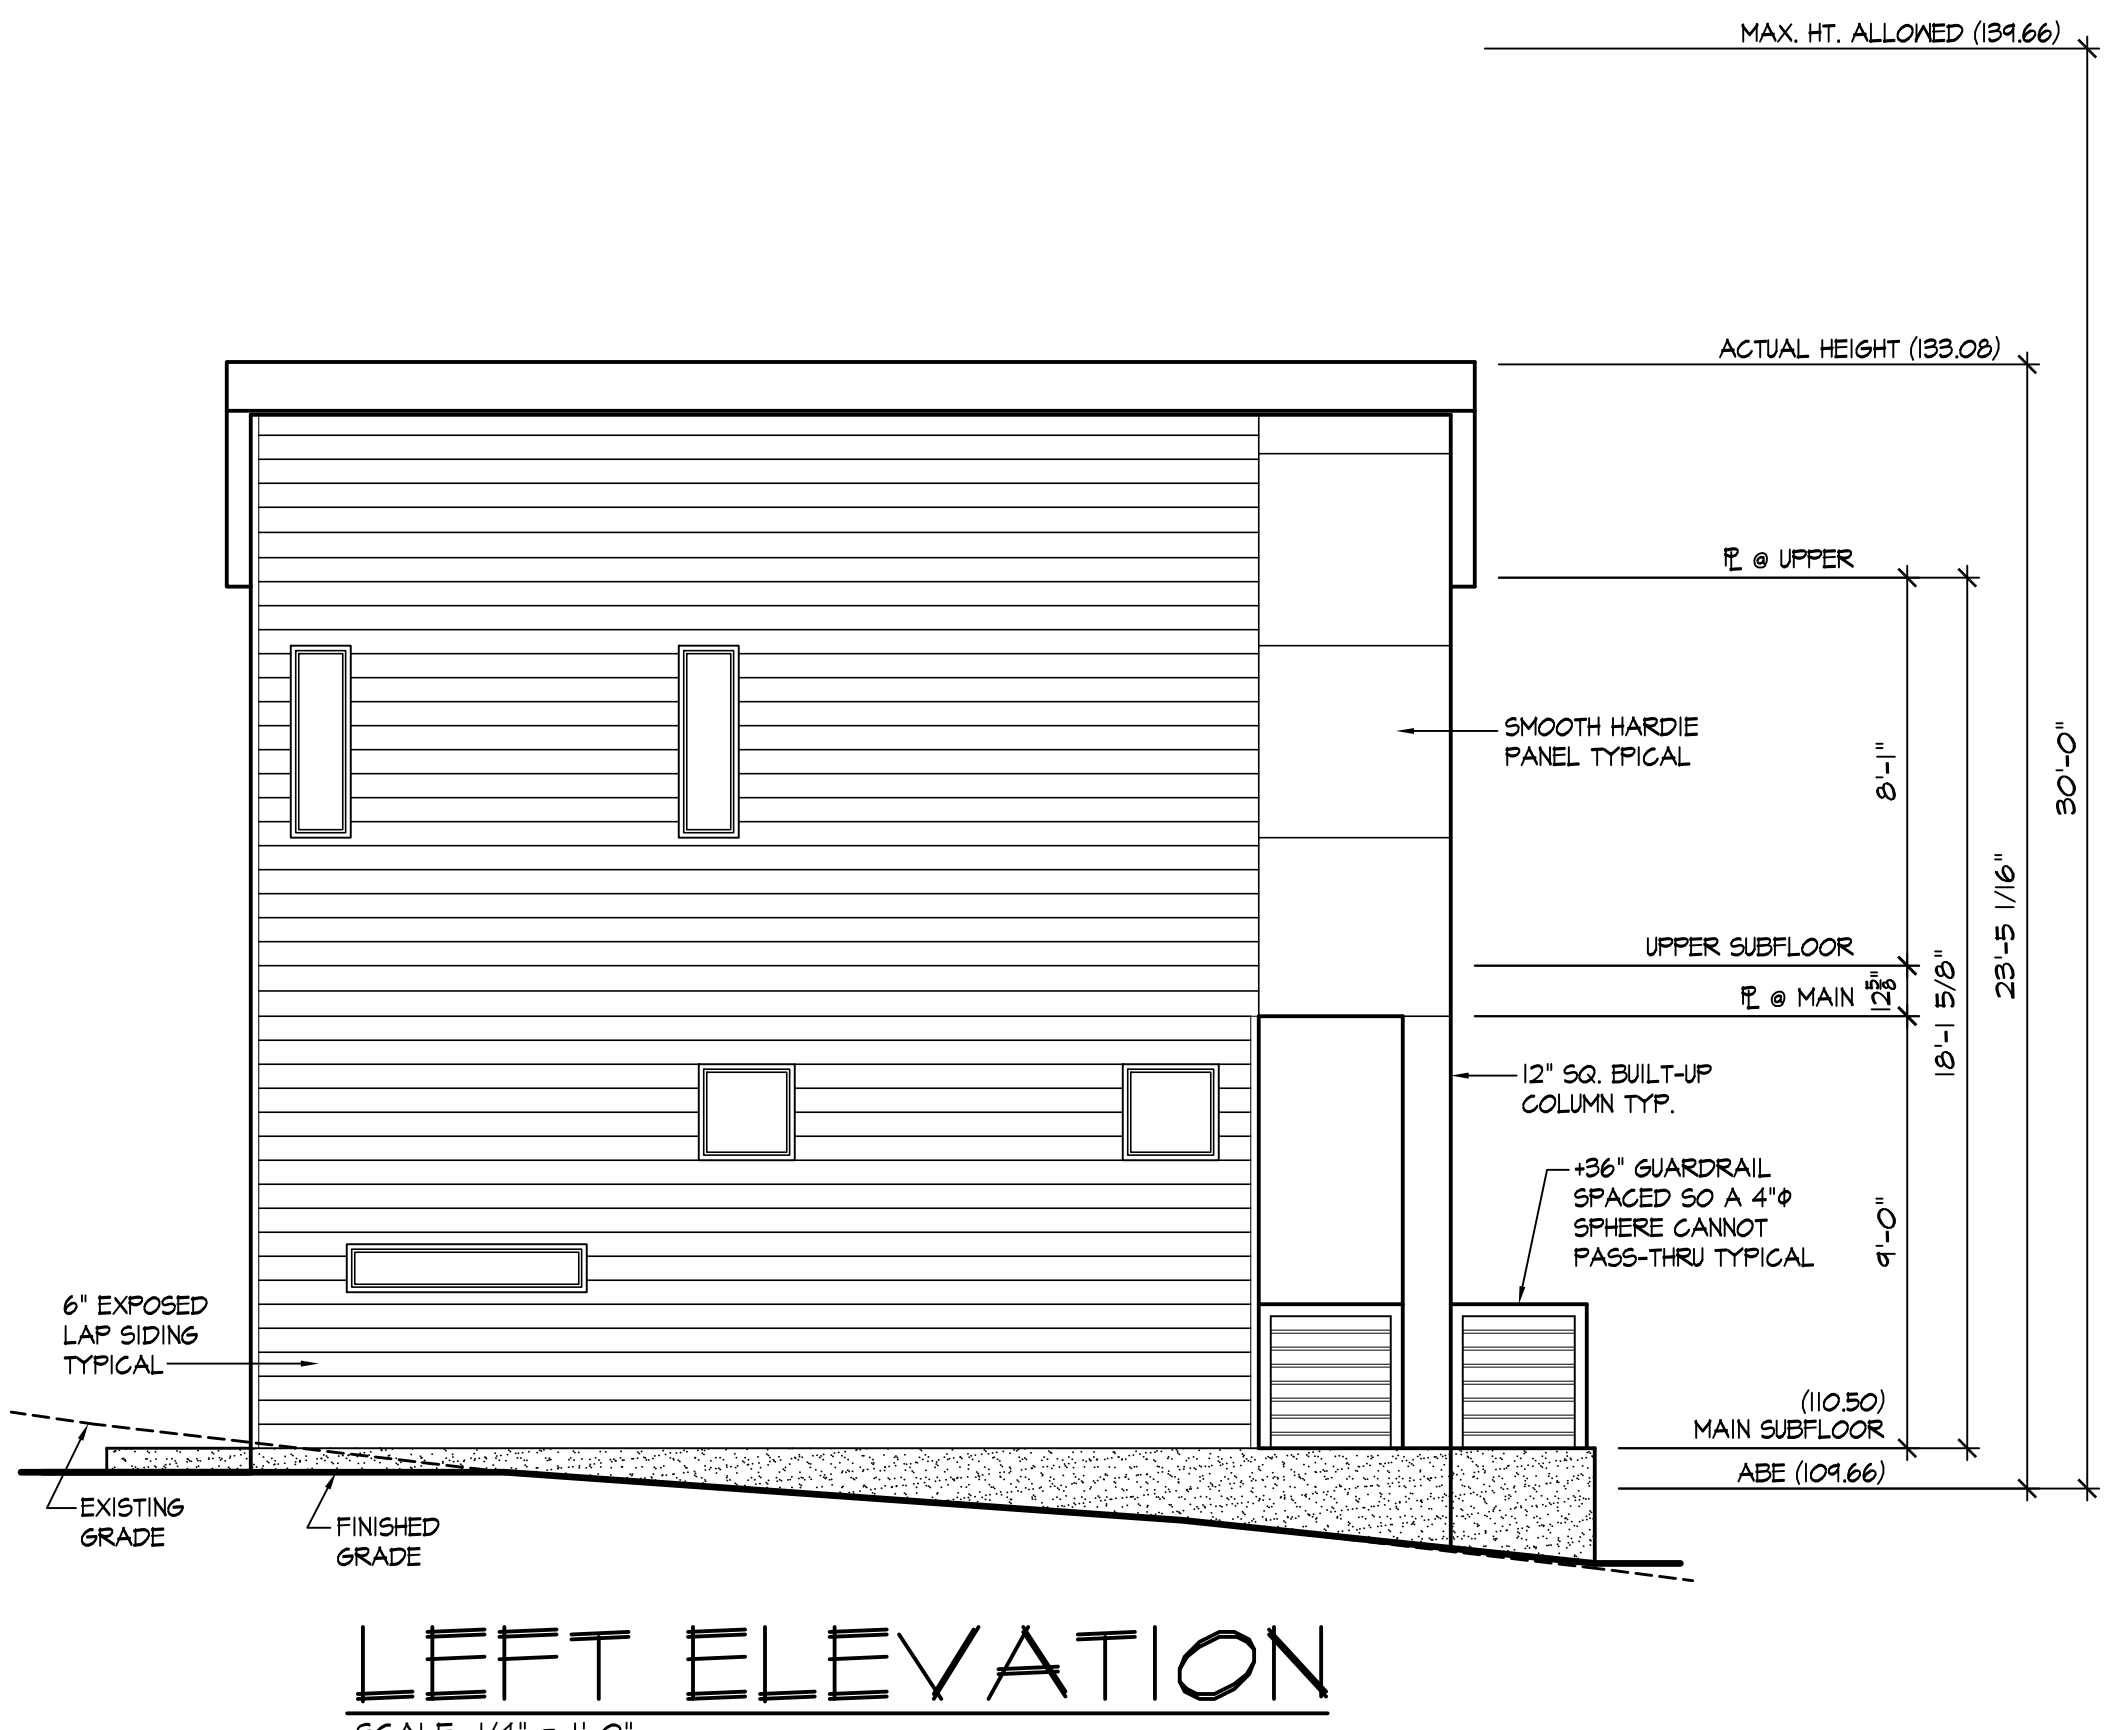

LEFT ELEVATION
SCALE: 1/4" = 1'-0"

- ELEVATION NOTES:**
1. VERIFY SHEAR WALL NAILING & HOLDINGS PER PLAN PRIOR TO INSTALLING SIDING.
 2. MASONRY & WOOD FRAME CHIMNEYS ARE TO BE CONSTRUCTED PER I.R.C. CHAPTER 10.
 3. CAULK ALL EXTERIOR JOINTS & PENETRATIONS.
 4. PROVIDE APPROVED CORROSION RESISTANT FLASHING AT EXTERIOR WALL ENVELOPE PER I.R.C. R103.4
 5. PROVIDE FLASHING AT ROOF PENETRATIONS PER I.R.C. R403.2 & R403.2.1
 6. PROVIDE WEATHER STRIPPING AT ALL EXTERIOR & GARAGE-INTERIOR DOORS.
 7. PROVIDE CONTINUOUS GUTTERS & DOWNSPOUTS @ ALL EAVES, TYP.
 8. ADDRESS OR HOUSE NUMBER TO BE POSTED AND PLAINLY VISIBLE FROM THE STREET FRONTAGE. NUMBERS TO BE MIN. 4" HIGH WITH 1/4" WIDE STROKE & CONTRASTING BACKGROUND.
 9. PROVIDE STAIRWAY ILLUMINATION PER I.R.C. R303.7 & R303.8
 10. SEE SHEET A1 FOR ADDITIONAL NOTES.



PAYMENT OF USE FEE IS DUE TO ARCHITECTS NORTHWEST, INC. PRIOR TO CONSTRUCTION FOR THESE PLANS. THESE PLANS ARE COPYRIGHTED IN ACCORDANCE WITH THE ARCHITECTS ACT OF WASHINGTON. NO METHOD OF ALL OR PORTIONS OF THESE PLANS OR FROM ARCHITECTS NORTHWEST, INC. IS STRICTLY PROHIBITED. THESE DRAWINGS AND PLANS SET FORTH THE DESIGN AND CONSTRUCTION OF THE ABOVE AND SHALL REMAIN THE PROPERTY OF ARCHITECTS NORTHWEST, INC.

ARCHITECTS NORTHWEST
18915-142ND AVENUE NE SUITE 100 WOODINVILLE, WA 98072
OFFICE: (425) 485-4800 FAX: (425) 487-6685
TOLL FREE: 1-888-872-4100 WWW.ARCHITECTSNW.COM

LONG DADU
PLAN A911A0-0

DESIGNED BY: MBL DATE: 05/20/25
DRAWN BY: BPS DATE: 7/29/25
PROJECT MANAGER: MARCUS JENKINS
REVISED BY: BPS DATE: 8/15/25

LATERAL BY: ZVELT DATE: 6/25/25
LATERAL JOB NUMBER: 25-120

A7
A7

ANW JOB NUMBER:
250052

GENERAL STRUCTURAL NOTES (GSN):
GOVERNING CODE: THE "INTERNATIONAL BUILDING CODE" (IBC) 2021 EDITION, AS ADOPTED AND MODIFIED BY THE CITY OF MERCER ISLAND GOVERNS THE DESIGN, CONSTRUCTION, AND ALL MATERIALS WORKMANSHIP OF THIS PROJECT.
THE ENGINEERING SCOPE OF WORK IS LIMITED TO STRUCTURAL GRAVITY AND LATERAL AND FOUNDATION SYSTEM OF A SINGLE FAMILY NEW RESIDENCE. THESE DRAWINGS ARE VALID SOLELY FOR THE ADDRESS LISTED IN THE TITLEBLOCK, AND SHALL NOT BE USED FOR ANY OTHER PROJECTS AT ANY OTHER LOCATION.
REFERENCE STANDARDS: WHERE OTHER STANDARDS ARE NOTED IN THE DRAWINGS, THE LATEST EDITION OF THE MATERIALS REFERENCE STANDARDS SHALL BE USED. THE CONTRACTOR SHALL CONFORM WITH THE SECTIONS REFERRED TO THE IBC AND WITH THE ENTIRE MATERIALS REFERENCE STANDARDS NOTED BELOW.
ARCHITECTURAL DRAWINGS: REFER TO THE ARCHITECTURAL DRAWINGS FOR INFORMATION INCLUDING, BUT NOT LIMITED TO: DIMENSIONS, ELEVATIONS, SLOPES, DOOR AND WINDOW OPENINGS, NON-BEARING WALLS, STAIRS, ELEVATORS, STAIRS, DRAINS, DEPRESSIONS, FINISHES AND OTHER NONSTRUCTURAL ITEMS. FOR EXACT SIZE, NUMBER AND LOCATION OF OPENINGS, SEE THE ARCHITECTURAL, MECHANICAL, ELECTRICAL AND PLUMBING DRAWINGS. FOR FRAMING AT OPENINGS, SEE TYPICAL STRUCTURAL DETAILS. VERIFY ALL SIZES, WEIGHTS AND LOCATIONS OF MECHANICAL AND ELECTRICAL EQUIPMENT, DUCTS, ETC. WITH MECHANICAL AND ELECTRICAL ENGINEERS THROUGH ARCHITECT.
STRUCTURAL DETAILS: THE STRUCTURAL DRAWINGS ARE INTENDED TO SHOW THE GENERAL CHARACTER OF THE PROJECT AND ARE NOT INTENDED TO SHOW ALL DETAILS OF THE WORK. USE ALL DETAIL SHEETS AND ALL SPECIFIC DETAILS REFERENCED IN THE PLAN AS "TYPICAL" WHEREVER THEY APPLY.
NOTE PRIORITIES: NOTES ON THE INDIVIDUAL DRAWINGS SHALL GOVERN OVER THESE GENERAL NOTES.
INSPECTIONS: THE CONTRACTOR IS RESPONSIBLE TO COORDINATE ALL INSPECTIONS REQUIRED. NOTIFY BUILDING DEPARTMENT FOR INSPECTIONS REQUIRED BY LOCAL JURISDICTION AND IN ACCORDANCE WITH CHAPTER 17 PER IBC.
DISCREPANCIES: ANY DISCREPANCY FOUND BETWEEN THE DRAWINGS, NOTES, SPECIFICATIONS, SITE CONDITIONS, AND PLANS SHALL BE REPORTED TO THE ARCHITECT AND ENGINEER WHO SHALL CORRECT THE DISCREPANCY IN WRITING. ANY WORK COMPLETED AFTER DISCOVERY OF THE DISCREPANCY SHALL BE DONE AT THE CONTRACTOR'S RISK. CONTRACTOR/DESIGNER/OWNER IS RESPONSIBLE FOR PROVIDING CORRECT SITE INFORMATION. ALL UNDERGROUND UTILITIES SHALL BE DETERMINED BY THE CONTRACTOR PRIOR TO EXCAVATION OR DRILLING.
SITE VERIFICATION: THE CONTRACTOR SHALL VERIFY ALL DIMENSIONS AND CONDITIONS AT THE SITE PRIOR TO FABRICATION AND/OR CONSTRUCTION. CONFLICTS BETWEEN THE DRAWINGS AND ACTUAL SITE CONDITIONS SHALL BE BROUGHT TO THE ATTENTION OF THE ENGINEER BEFORE PROCEEDING WITH THE WORK. ALL UNDERGROUND UTILITIES SHALL BE DETERMINED BY THE CONTRACTOR PRIOR TO EXCAVATION OR DRILLING.
CONSTRUCTION LOADS: PARTLY ON THE STRUCTURE DURING CONSTRUCTION SHALL NOT EXCEED THE DESIGN LOADS OR THE CAPACITY OF THE PARTIALLY COMPLETED CONSTRUCTION. ALL STRUCTURAL SYSTEMS WHICH ARE TO BE COMPOSED OF COMPONENTS TO BE FIELD ERECTED SHALL BE SUPERVISED BY THE SUPPLIER DURING MANUFACTURING, DELIVERY, HANDLING, STORAGE AND ERECTION IN ACCORDANCE WITH INSTRUCTIONS PREPARED BY THE SUPPLIER. CONTRACTOR SHALL PROVIDE TEMPORARY BRACING FOR STRUCTURE AND STRUCTURAL COMPONENTS UNTIL ALL FINAL CONNECTIONS HAVE BEEN COMPLETED IN ACCORDANCE WITH THE PLANS CONFORM TO ASCE 37-02 "DESIGN LOADS ON STRUCTURES DURING CONSTRUCTION".
ALL STRUCTURAL SYSTEMS WHICH ARE TO BE COMPOSED OF COMPONENTS TO BE FIELD ERECTED SHALL BE SUPERVISED BY THE SUPPLIER DURING MANUFACTURING, DELIVERY, HANDLING, STORAGE, AND ERECTION IN ACCORDANCE WITH INSTRUCTIONS PREPARED BY THE SUPPLIER.
DESIGN CRITERIA:
ROOF LOADS: DEAD LOADS 15 PSF
LIVE LOADS 25 PSF
FLOOR LOADS: DEAD LOADS 12 PSF
LIVE LOADS 40 PSF
SNOW LOAD: GROUND SNOW LOAD = 25 PSF; SNOW EXPOSURE FACTOR $C_e = 1.0$; SNOW IMPORTANCE FACTOR $I_s = 1.0$; THERMAL FACTOR $C_t = 1.0$.
WIND DESIGN: BASIC WIND SPEED (3-SECOND GUST), $V = 110$ MPH; WIND IMPORTANCE FACTOR, $I_w = 1.0$; OCCUPANCY CATEGORY = II; EXPOSURE CATEGORY = C; WIND SPEED-UP FACTOR $K_{zt} = 1.0$;
SEISMIC DESIGN: SEISMIC IMPORTANCE FACTOR $I_e = 1.0$; OCCUPANCY CATEGORY = II; $S_s = 1.451$; $S_1 = 0.502$; SEISMIC DESIGN CATEGORY = D; $S_{ds} = 0.967g$; SEISMIC DESIGN CATEGORY = D; BASIC SEISMIC FORCE RESISTING SYSTEM (BEARING WALL SYSTEMS)
LIGHT-FRAMED WALLS WITH WOOD STRUCTURAL PANELS RATED FOR SHEAR RESISTANCE AND FLEXIBLE DIAPHRAGMS; $C_s = 0.149$; $R = 6.5$; $C_d = 4$; $\Omega = 2.5$; SEISMIC BASE SHEAR = 4.9 KIPS. ANALYSIS PROCEDURE=EQUIVALENT LATERAL FORCE PROCEDURE PER ASCE 7, SEC 12.8
DEFLECTIONS: TOTAL LOAD DEFLECTION LIMIT: L/240
LIVE LOAD DEFLECTION LIMIT: L/360
SUBMITTALS: SHOP DRAWINGS SHALL BE SUBMITTED TO THE ARCHITECT/ENGINEER PRIOR TO ANY FABRICATION OR CONSTRUCTION. THE CONTRACTOR SHALL REVIEW AND PLACE A SHOP DRAWINGS STAMP ON THE SUBMITTAL BEFORE FORWARDING TO THE ENGINEER. SUBMITTALS SHALL BE MADE IN TIME TO PROVIDE A MINIMUM OF ONE WEEK FOR REVIEW BY THE ENGINEER. IF THE SHOP DRAWINGS DIFFER FROM OR ADD TO THE DESIGN OF THE STRUCTURAL DRAWINGS, THEY SHALL BEAR THE SEAL AND SIGNATURE OF THE WASHINGTON STATE REGISTERED PROFESSIONAL ENGINEER WHO IS RESPONSIBLE FOR THE DESIGN.
ALTERNATIVES: PRODUCT OR MANUFACTURER COMPONENTS SPECIFIED IN THESE DRAWINGS ARE USED AS THE BASIS OF DESIGN FOR THIS PROJECT. ALTERNATES FOR SPECIFIED ITEMS MAY BE SUBMITTED TO THE ENGINEER FOR REVIEW. HOWEVER, CONTRACTOR SHALL SUBMIT A CURRENT ICC-ESR/APMO-ER REPORT IDENTIFYING THAT ALTERNATIVE COMPONENT HAS THE SAME OR GREATER LOAD CAPACITY THAN THE SPECIFIED ITEM.
DEFERRED SUBMITTALS (DESIGN-BY-OTHERS): SUBMIT PRODUCT DATA AND PROOF OF ICC APPROVAL FOR FRAMING MEMBERS AND FASTENERS THAT HAVE BEEN PREPARED BY THE SPECIALTY STRUCTURAL ENGINEER (SSE), TRUSS ENGINEER OR THE STATE OF WASHINGTON REGISTERED PROFESSIONAL ENGINEER. DESIGN SHALL BE SUBMITTED TO THE ARCHITECT/DESIGNER AND STRUCTURAL ENGINEER OF RECORD (SER) FOR REVIEW PRIOR TO SUBMISSION TO THE JURISDICTION FOR APPROVAL. THE SSE SHALL SUBMIT TO THE ENGINEER FOR REVIEW CALCULATIONS AND SHOP DRAWINGS THAT ARE STAMPED AND SIGNED BY THE SSE. REVIEW OF THE SSE'S SHOP DRAWINGS IS FOR GENERAL COMPLIANCE WITH DESIGN CRITERIA AND COMPATIBILITY WITH THE DESIGN OF THE PRIMARY STRUCTURE AND DOES NOT RELIEVE THE SSE OF RESPONSIBILITY FOR THAT DESIGN.
ALL NECESSARY BRIDGING, BLOCKING, BLOCKING PANELS, WEB STIFFENERS, AND ADDITIONAL TRUSSES/JOISTS SHALL BE SUPPLIED AS REQUIRED TO SUPPORT MECHANICAL EQUIPMENT AND SHALL BE DETAILED AND FURNISHED BY THE SUPPLIER. PREFABRICATED WOOD TRUSSES SHALL BE DESIGNED FOR A MOVING CONCENTRATED LOAD OF 100 LBS TO ACCOUNT FOR SOLAR PANEL ATTACHMENT LOADS. ADDITIONAL TRUSSES/JOISTS SHALL BE SUPPLIED AS REQUIRED TO SUPPORT MECHANICAL EQUIPMENT TEMPORARY AND PERMANENT BRIDGING SHALL BE INSTALLED IN CONFORMANCE WITH THE MANUFACTURER'S SPECIFICATIONS. DEFLECTION LIMITS SHALL BE AS NOTED UNDER DESIGN LOADS SECTION. THESE ELEMENTS INCLUDE BUT ARE NOT LIMITED TO:
-HANDRAILS & GUARDRAILS
-ENGINEERED WOOD BEAMS
-PREFABRICATED WOOD COMPONENTS-SHEAR WALLS/WOOD PANELS
-TEMPORARY SHORING SYSTEMS
-ARCHED BEAMS/HEADERS, FRAMED BEAMS/HEADERS
-METAL PLATE CONNECTED ROOF TRUSSES (PREFABRICATED ROOF TRUSSES): SHOP DRAWINGS SHALL PROVIDE FOR SHAPES, BEARING POINTS, INTERSECTIONS, HIPS, AND VALLEYS SHOWN ON THE DRAWINGS. THE MANUFACTURER SHALL PROVIDE SPECIAL HIP, VALLEY AND INTERSECTION AREAS (STEP DOWN TRUSSES, JACK TRUSSES AND GIRDER TRUSSES) UNLESS SPECIFICALLY INDICATED ON THE PLANS. PROVIDE ALL TRUSS-TO-TRUSS AND TRUSS-TO-SUPPORT CONNECTION DETAILS, HANGERS, AND REQUIRED CONNECTION MATERIALS. SPECIFY TEMPORARY AND PERMANENT BRACING AND CONNECTIONS ON THE SHOP DRAWINGS. PROVIDE ALL TRUSS REACTIONS OVER 1000# ON SHOP DRAWINGS. NO STORAGE OF TRUSSES IS ALLOWED. FINISH OF THE TRUSS LAYOUT INDICATED ON THE PLANS MAY REQUIRE SUPPORTING STRUCTURAL AND FOUNDATION CHANGES, THEREFORE PRIOR APPROVAL BY THE ARCHITECT/DESIGNER AND STRUCTURAL ENGINEER IS REQUIRED.
SOILS AND FOUNDATIONS: PER GEOTECHNICAL EVALUATION BY COBALT SCIENCES DATED OCTOBER 11, 2024.
REFERENCE STANDARDS: CONFORM TO IBC CHAPTER 18 "SOILS AND FOUNDATIONS."
SITE PREPARATION, EXCAVATIONS AND TEMPORARY EXCAVATIONS, COMPACTION, BACKFILLING, STRUCTURAL FILL, STORMWATER MANAGEMENT, FEASIBILITY, EROSION AND SEDIMENT CONTROL, AND UTILITIES SHALL BE AS STATED IN THE GEOTECHNICAL REPORT ATTACHED TO THE PROJECT.
FOUNDATIONS: UNLESS OTHERWISE SPECIFIED BY A GEOTECHNICAL ENGINEER, EXTEND FOOTINGS TO FIRM AND UNYIELDING NATIVE SOIL OR STRUCTURAL FILL WITH AN ALLOWABLE SOIL BEARING CAPACITY OF 2500 PSF. BOTTOM OF EXTERIOR FOOTINGS SHALL BE 1'-6" MIN BELOW OUTSIDE FINISHED GRADE, UNLESS SPECIFIED BY THE GEOTECH ENGINEER. MAINTAIN A MINIMUM 6" SEPARATION BETWEEN FINISH GRADE & UNTREATED WOOD FRAMING.
EXTERIOR PERIMETER FOOTINGS SHALL BEAR NOT LESS THAN 16 INCHES BELOW ADJACENT FINISHED GRADE, OR SPECIFIED BY THE BUILDING OFFICIAL. INTERIOR FOOTINGS SHALL BEAR NOT LESS THAN 12 INCHES BELOW FINISH FLOOR OR ADJACENT EXTERIOR GRADE, WHICHEVER IS LOWER. FOOTINGS SHALL BE CENTERED BELOW COLUMNS OR WALLS ABOVE, U.N.O.
FOUNDATION STEM WALLS: UNLESS OTHERWISE SPECIFIED BY A GEOTECHNICAL ENGINEER, THE HEIGHT OF THE STEM WALL SHALL BE AS NOTED ON THE DRAWINGS TO FIT THE HOLD-DOWN REQUIREMENTS. MAINTAIN A MINIMUM 6" SEPARATION BETWEEN FINISH GRADE & UNTREATED WOOD FRAMING.
SLAB-ON-GRADE: SEE GEOTECH REPORT.
EXCAVATIONS: SEE GEOTECH REPORT.
BACKFILLING: SEE GEOTECH REPORT.
STRUCTURAL FILL: SEE GEOTECH REPORT.
COMPACTION: SEE GEOTECH REPORT.
GEOTECHNICAL
ALLOWABLE BEARING CAPACITY-STRUCTURAL FILL 2500 PSF (PER GEOTECHNICAL REPORT - BY GEOTECH SCIENCES)
CONSTRUCTION FIELD REVIEW:
AS STATED IN THE GEOTECHNICAL REPORT, COBALT SCIENCES SHOULD BE VALIDATED TO PROVIDE FIELD REVIEW DURING CONSTRUCTION IN ORDER TO VERIFY THAT THE SOIL CONDITIONS ENCOUNTERED ARE CONSISTENT WITH DESIGN ASSUMPTIONS AND RECOMMENDATIONS AS FOLLOWS:
-MONITOR AND TEST STRUCTURAL PLACEMENT AND SOIL COMPACTION
-OBSERVE BEARING CAPACITY AT FOUNDATION LOCATIONS
-OBSERVE SLAB-ON-GRADE PREPARATION
-MONITOR FOUNDATION DRAINAGE PLACEMENT
-OBSERVE EXCAVATION STABILITY

CAST-IN-PLACE CONCRETE
REFERENCE STANDARDS: CONFORM TO:
(1) ACI 318 "BUILDING CODE REQUIREMENTS FOR STRUCTURAL CONCRETE AND COMMENTARY".
(2) IBC CHAPTER 19, CONCRETE.
FIELD REFERENCE: THE CONTRACTOR SHALL KEEP A COPY OF ACI FIELD REFERENCE MANUAL, SP-15, "STANDARD SPECIFICATIONS FOR STRUCTURAL CONCRETE (ACI 301) WITH SELECTED ACI AND ASTM REFERENCES."
CONCRETE SHALL ATTAIN A 28-DAY STRENGTH OF $f'_c=3000$ PSI AND MIX SHALL CONTAIN NOT LESS THAN 6 SACKS OF CEMENT PER CUBIC YARD OF CONCRETE AND SHALL BE PROPORTIONED TO PRODUCE A SLUMP OF 5" OR LESS. ALL CONCRETE WITH SURFACES EXPOSED TO STANDING WATER SHALL BE AIR-ENTRAINED WITH AIR-ENTRAINING AGENT CONFORMING TO ASTM C260, C494, AND C618. TOTAL AIR CONTENT FOR FROST-RESISTANT CONCRETE SHALL BE IN ACCORDANCE WITH ASTM C666.
CONCRETE COVER: CONFORM TO THE FOLLOWING COVER REQUIREMENTS FROM ACI 301, TABLE 3.3.2.3:
CONCRETE CAST AGAINST EARTH 3"
CONCRETE EXPOSED TO EARTH OR WEATHER (#5 & SMALLER) 1-1/2"
CONCRETE EXPOSED TO EARTH OR WEATHER (#6 & LARGER) 2"
BAR IN SLABS AND STEM WALLS 3/4"
CONCRETE REINFORCEMENT
REFERENCE STANDARDS: CONFORM TO:
(1) ACI 301 "STANDARD SPECIFICATIONS FOR STRUCTURAL CONCRETE", SEC 3 "REINFORCEMENT AND REINFORCEMENT SUPPORTS."
(2) ACI SP-66 "ACI DETAILING MANUAL" ANSI/AWS D1.4 "STRUCTURAL WELDING CODE - REINFORCING STEEL."
(3) IBC CHAPTER 19, CONCRETE.
MATERIALS:
REINFORCING BARS ASTM A615, GRADE 60, DEFORMED BARS, $f_y=60000$ PSI.
SMOOTH WELDED WIRE FABRIC ASTM A185
EXCEPTIONS ARE ANY BARS SPECIFICALLY SO NOTED ON THE DRAWINGS. REINFORCING SHALL BE GRADE 40, $f_y=40000$ PSI AND GRADE 60, $f_y=60000$ PSI.
FORMWORK: CONFORM TO ACI 301 SEC 2 "FORMWORK AND FORM ACCESSORIES." REMOVAL OF FORMS SHALL CONFORM TO SEC 2.3.2 EXCEPT STRENGTH INDICATED IN SEC 2.3.2.5 SHALL BE 0.75 f'_c .
MEASURING, MIXING, AND DELIVERY: CONFORM TO ACI 301 SEC 4.3.
HANDLING, PLACING, CONSTRUCTING AND CURING: CONFORM TO ACI 301 SEC 5 AND SEC 3.3.2 "PLACEMENT." PLACING TOLERANCES SHALL CONFORM TO SEC 3.3.2.1 "TOLERANCES."
EMBEDDED ITEMS: POSITION AND SECURE IN PLACE EXPANSION JOINT MATERIAL, ANCHORS AND OTHER STRUCTURAL AND NON-STRUCTURAL EMBEDDED ITEMS BEFORE PLACING CONCRETE. CONTRACTOR SHALL REFER TO MECHANICAL, ELECTRICAL, PLUMBING AND ARCHITECTURAL DRAWINGS AND COORDINATE ALL OTHER EMBEDDED ITEMS.
FABRICATION: CONFORM TO ACI 301, SEC 3.2.2 "FABRICATION", AND ACI SP-66 "ACI DETAILING MANUAL."
WELDING: CONFORM TO AWS D1.4/D1.4M. WELDERS SHALL BE CERTIFIED IN ACCORDANCE WITH (AWS AND WABO) REQUIREMENTS. USE E70 ELECTRODES OF TYPE REQUIRED FOR MATERIALS TO BE WELDED.
SPICES: CONFORM TO ACI 301, SEC 3.3.2.7. REFER TO "LAP SPICE SCHEDULE" OR PLANS FOR TYPICAL SPLICES. THE SPLICES INDICATED ON INDIVIDUAL SHEETS CONTROL OVER THE SCHEDULE. USE CLASS B SPLICES UNLESS OTHERWISE NOTED. MECHANICAL CONNECTIONS MAY BE USED WHEN APPROVED BY THE ENGINEER.
FIELD BENDING: CONFORM TO ACI 301 SEC 3.3.2.8. "FIELD BENDING OR STRAIGHTENING." BAR SIZES #3 THROUGH #5 MAY BE FIELD BENT COLD THE FIRST TIME, PROVIDED REINFORCING BAR TEMPERATURE IS ABOVE 32F. FOR OTHER BAR SIZES REQUIRE PREHEATING BEFORE FIELD BENDING. DO NOT TWIST BARS.
NO BARS PARTIALLY EMBEDDED IN HARDENED CONCRETE SHALL BE FIELD BENT.
CORNER BARS: PROVIDE MATCHING-SIZED "L" CORNER BARS FOR ALL HORIZONTAL WALL AND FOOTING BARS WITH THE APPROPRIATE SPICE LENGTH, UNO.
ANCHORAGE
-EPoxy-GROUTED ITEMS (THREADED RODS OR REINFORCING BAR) SPECIFIED ON THE DRAWINGS SHALL BE INSTALLED USING "SET-36" EPOXY ADHESIVE AS MANUFACTURED BY THE SIMPSON STRONG TIE COMPANY. INSTALL IN STRICT ACCORDANCE WITH ICC-ESREPORT ESR-2508. SUBSTITUTIONS PROPOSED BY THE CONTRACTOR SHALL BE SUBMITTED FOR REVIEW WITH CURRENT ICC REPORTS INDICATING EQUIVALENT OR GREATER LOAD CAPACITIES. SPECIAL INSPECTION OF INSTALLATION IS REQUIRED. RODS SHALL BE ASTM A36, UNO.
-HEAVY DUTY THREADED CONCRETE ANCHORS SPECIFIED ON THE DRAWINGS SHALL BE "TITAN HD SCREW ANCHOR" AS MANUFACTURED BY THE SIMPSON STRONG TIE COMPANY. INSTALL IN STRICT ACCORDANCE WITH ICC-ES REPORT ESR-2713. INCLUDING MINIMUM EMBEDMENT AND EDGE DISTANCE REQUIREMENTS. SUBSTITUTIONS PROPOSED BY THE CONTRACTOR SHALL BE SUBMITTED FOR REVIEW WITH CURRENT ICC REPORTS INDICATING EQUIVALENT OR GREATER LOAD CAPACITIES.
-DRIVE PINS AND OTHER POWDER-ACTUATED FASTENERS SHALL BE LOW VELOCITY TYPE (PDWPL- 300MG, 0.145" DIAMETER, UNO) AS MANUFACTURED BY THE SIMPSON STRONG TIE COMPANY OR AN APPROVED EQUIVALENT IN STRENGTH AND EMBEDMENT. INSTALL IN STRICT ACCORDANCE WITH ICC-ES REPORT ESR-2138. MINIMUM EMBEDMENT IN CONCRETE SHALL BE 1", UNO. MAINTAIN AT LEAST 3" TO NEAREST CONCRETE EDGE.
WOOD FRAMING
REFERENCE STANDARDS: CONFORM TO:
(1) IBC CHAPTER 23 "WOOD",
(2) NDS AND NDS SUPPLEMENT - "NATIONAL DESIGN SPECIFICATION FOR WOOD CONSTRUCTION",
IDENTIFICATION: ALL SAWN LUMBER AND PRE-MANUFACTURED WOOD PRODUCTS SHALL BE IDENTIFIED BY THE GRADE MARK OR A CERTIFICATE OF INSPECTION ISSUED BY THE CERTIFYING AGENCY.
MATERIALS:
SAWN LUMBER: ALL LUMBER SHALL BE KILN-DRIED OR MC-19 AND CONFORM TO GRADING RULES OF WMPA, WCLUB OR NLGA. FINGER JOINTED STUDS ACCEPTABLE AT INTERIOR WALLS ONLY.

MEMBER USE	SIZE	SPECIES	GRADE	MINIMUM BASE VALUE
STUDS, PLATES, MISC	2X, 3X (U.N.O)	HEM-FIR (U.N.O)	No. 2	Fc=575 PSI
JOISTS 2X, 3X	2X6 - 2X12	HEM-FIR	No. 2	Fb=850 PSI
BEAMS	4X8 - 4X12	DOUG-FIR	No. 2	Fb=900 PSI
BEAMS	6X8 - 6X12	DOUG-FIR	No. 2	Fb=875 PSI
POSTS	4X	DOUG-FIR	No. 2	Fc=700 PSI
POSTS	6X, 8X	DOUG-FIR	No. 1	Fc=1000 PSI

GLUED LAMINATED TIMBER: MANUFACTURED LUMBER, PVL, LVL, AND LSL, SHALL BE MANUFACTURED UNDER A PROCESS APPROVED BY THE NATIONAL RESEARCH BOARD. EACH PIECE SHALL BEAR A STAMP OR STAMP NOTING THE NAME AND PLANT NO. OF THE MANUFACTURER, THE GRADE, THE NATIONAL RESEARCH BOARD NUMBER, AND THE QUALITY CONTROL AGENCY. ALL PVL, LVL, AND LSL LUMBER SHALL BE MANUFACTURED IN ACCORDANCE WITH ICC-ESS REPORT ESR-1387 USING DOUGLAS FIR VENEER GLUED WITH A WATERPROOF ADHESIVE MEETING THE REQUIREMENTS OF ASTM D2559 WITH ALL GRAIN PARALLEL WITH THE LENGTH OF THE MEMBER. THE MEMBERS SHALL HAVE THE FOLLOWING MINIMUM PROPERTIES:
GLUED LAMINATED MEMBER BEAMS SHALL NOT BE CAMBERED, UNLESS SHOWN OTHERWISE ON THE PLANS OR SPECIFICATIONS.
CONTRACTOR SHALL MAKE PROVISIONS DURING CONSTRUCTION TO PREVENT THE MOISTURE CONTENT OF INSTALLED BEAMS FROM EXCEEDING 12% EXCESSIVE DEFLECTIONS MAY OCCUR IF MOISTURE CONTENT EXCEEDS THIS VALUE.

MEMBER USE	SIZES	SPECIES	STRESS CLASS	USES	Fb(Psi)	Fv(Psi)
GLB	ALL	DF/DF	24F-1.8E 24F-V4	SIMPLE SPANS	2400	265
	ALL	DF/DF	24F-1.8E 24F-V8	CANTILEVER SPANS	2400	265

PVL (2.2E) Fb=2800 PSI, Fv=290 PSI
LVL (2.0E) Fb=2600 PSI, Fv=285 PSI
LSL (1.55E) Fb=2325 PSI, Fv=310 PSI
PSL COLUMN (1.8E) Fc=2900 PSI,
PLYWOOD SHEATHING: SHALL BE APA-RATED STRUCTURAL SHEATHING GRADE C-D EXTERIOR GLUE OR STRUCTURAL II, EXTERIOR GLUE IN CONFORMANCE WITH THE AMERICAN PLYWOOD ASSOCIATION (APA). ORIENTED STRAND BOARD OF EQUIVALENT THICKNESS, EXPOSURE RATING, AND PANEL INDEX MAY BE USED IN LIEU OF PLYWOOD.
MINIMUM APA RATING


LOCATION	THICKNESS	SPAN RATING	PLYWOOD GRADE	EXPOSURE
ROOF	15/32"	32/16	C-D	1
FLOOR	23/32"	24 OC	STURD-I-FLOOR	1
WALLS	15/32"	32/16	C-D	1

PREFABRICATED PLYWOOD WEB JOIST DESIGN SHOWN ON PLANS IS BASED ON JOISTS MANUFACTURED BY THE TRUSS-JOIST CORPORATION. ALTERNATE PLYWOOD WEB JOIST MANUFACTURED BY THE TRUSS-JOIST CORPORATION, ALTERNATE PLYWOOD WEB JOIST MANUFACTURERS MAY BE USED SUBJECT TO REVIEW AND APPROVAL BY THE ARCHITECT AND STRUCTURAL ENGINEER. JOIST HANGERS AND CONNECTORS SHALL BE "SIMPSON STRONG-TIE" CATALOG C-C-2024-225. ALTERNATE JOIST HANGERS AND OTHER HARDWARE MAY BE SUBSTITUTED FOR ITEMS SHOWN PROVIDED THEY HAVE ICC APPROVAL FOR EQUAL OR GREATER LOAD CAPACITIES. ALL JOIST HANGERS AND OTHER HARDWARE SHALL BE COMPATIBLE IN SIZE WITH PLYWOOD WEB JOIST PROVIDED. ALL 2X JOISTS SHALL BE CONNECTED TO FLUSH BEAMS WITH "1US" SERIES JOIST HANGERS. ALL 1A JOIST SHALL BE CONNECTED TO FLUSH BEAMS WITH "1US" SERIES JOIST HANGERS. ALL DOUBLE-JOIST BEAMS SHALL BE CONNECTED TO FLUSH BEAMS WITH "MU" SERIES JOIST HANGERS. WHERE CONNECTOR STRAPS CONNECT TWO MEMBERS, PLACE 1/2 OF THE NAILS OR BOLTS IN EACH MEMBER. PROVIDE WASHERS UNDER THE HEADS AND NUTS OF ALL BOLTS AND LAG SCREWS BEARING ON WOOD. UNLESS NOTED OTHERWISE ALL NAILS SHALL BE FULL LENGTH COMMON. NAIL STRAPS TO WOOD FRAMING AS LATE AS POSSIBLE IN THE FRAMING PROCESS TO ALLOW THE WOOD TO SHRINK AND THE BUILDING TO SETTLE. ALL SHIMS SHALL BE SEASONED AND DRIED AND THE SAME GRADE (MINIMUM) AS MEMBERS CONNECTED.

NAILS: CONFORM TO IBC SEC 2303.6 UNLESS NOTED ON PLANS, NAIL PER IBC TABLE 2304.10.2. UNLESS NOTED OTHERWISE ALL NAILS SHALL BE COMMON. NAIL SIZES SPECIFIED ON THE DRAWINGS ARE BASED ON THE FOLLOWING SPECIFICATIONS:

SIZE	LENGTH	DIAMETER
8d	2-1/2"	0.131"
10d	3"	0.148"
16d	3-1/2"	0.162"
16d SINKER	3-1/4"	0.148"

NAILING REQUIREMENTS: PROVIDE MINIMUM NAILING IN ACCORDANCE WITH IBC TABLE 2304.10.2 "FASTENING SCHEDULE" EXCEPT AS NOTED ON THE DRAWINGS. NAILING FOR ROOF/FLOOR DIAPHRAGMS/SHEAR WALLS SHALL BE PER DRAWINGS. NAILS SHALL BE DRIVEN FLUSH AND SHALL NOT FRACTURE THE SURFACE OF SHEATHING. IF CONTRACTOR PROPOSES TO USE ALTERNATE NAILS, THEY SHALL SUBMIT NAIL SPECIFICATIONS TO THE STRUCTURAL ENGINEER (PRIOR TO CONSTRUCTION) FOR REVIEW AND APPROVAL.
LAG BOLTS/BOLTS: CONFORM TO ASTM A307.
ALL BOLTS IN WOOD MEMBERS SHALL CONFORM TO ASTM A307. PROVIDE WASHERS UNDER THE HEADS AND NUTS OF ALL BOLTS AND LAG BOLTS BEARING ON WOOD. INSTALLATION OF LAG SCREWS SHALL CONFORM TO THE NATIONAL DESIGN SPECIFICATION FOR WOOD CONSTRUCTION (2021 EDITION) WITH A LEAD BORE HOLE OF 60-70% OF THE SHANK DIAMETER. LEAD HOLES ARE NOT REQUIRED FOR 3/8" AND SMALLER LAG SCREWS. BOLT HOLES SHALL BE A MINIMUM OF 1/32" TO A MAXIMUM OF 1/16" LARGER THAN THE BOLT DIAMETER. HOLES SHALL BE ACCURATELY ALIGNED IN MAIN MEMBERS AND SIDE PLATES/ MEMBERS. BOLTS SHALL NOT BE OVERDRIVEN.
SDS SERIES: WOOD SCREWS CALLED OUT ON PLAN SHALL BE "SIMPSON STRONG-DRIVE" WOOD SCREWS BY SIMPSON COMPANY, AND INSTALLED IN STRICT ACCORDANCE TO ICC-ES REPORT ESR-2236. EQUIVALENT SCREWS BY OTHER MANUFACTURERS MAY BE SUBSTITUTED, PROVIDED THEY HAVE ICC APPROVAL FOR EQUAL OR GREATER LOAD CAPACITIES. LAG SCREWS ARE NOT AN EQUIVALENT SUBSTITUTION.
WOOD HOLD-DOWNS: HOLD-DOWNS SPECIFIED ARE AS MANUFACTURED BY SIMPSON ANCHOR TIE-DOWN CO., INC. ADDITIONAL FRAMING MEMBERS SHALL BE PROVIDED PER THE SYSTEM REQUIREMENTS. ACCEPTABLE EQUIVALENT PRODUCT SUBSTITUTIONS ARE AVAILABLE FROM OTHER MANUFACTURERS WITH ENGINEER APPROVAL.
ENGINEERED WOOD PRODUCTS (I-LEVEL): THE FOLLOWING MATERIALS ARE BASED ON LUMBER MANUFACTURED BY I-LEVEL AND WERE USED FOR THE DESIGN AS SHOWN ON THE PLANS. ALTERNATE PRODUCTS BY OTHER MANUFACTURERS MAY BE SUBSTITUTED PROVIDED THEY HAVE CURRENT ICC APPROVAL FOR EQUIVALENT OR GREATER LOAD AND STIFFNESS PROPERTIES AND ARE REVIEWED AND APPROVED BY THE ENGINEER.
A) LAMINATED VENEER LUMBER (LVL): ICC ES REPORT NO. ER-4979
B) PARALLEL STRAND LUMBER (PSL): ICC ES REPORT NO. ER-4979
C) LAMINATED STRAND LUMBER (LSL): ICC ES REPORT NO. ER-4979
D) JOISTS: ICC ES REPORT NO. ER-4979, ESR-1153.
PRODUCTS SHALL BE TESTED AND EVALUATED IN ACCORDANCE WITH ASTM D5055. THE MANUFACTURER SHALL DESIGN THE JOISTS FOR THE SPANS AND CONDITIONS SHOWN ON THE PLANS. JOISTS SHALL HAVE WOOD CHORDS AND SOLID WOOD WEBS.
STANDARD LIGHT-FRAME CONSTRUCTION: UNLESS NOTED ON THE PLANS, CONSTRUCTION SHALL CONFORM TO IBC 2021 SEC 2308 "CONVENTIONAL LIGHT-FRAME CONSTRUCTION" AND SEC 2304 "GENERAL CONSTRUCTION REQUIREMENTS". THE AITC "TIMBER CONSTRUCTION" AND THE AFAPA "NATIONAL DESIGN SPECIFICATION FOR WOOD CONSTRUCTION" MINIMUM NAILING, UNLESS NOTED OTHERWISE SHALL CONFORM TO TABLE 2304.10.1 OF THE IBC. COORDINATE THE SIZE AND LOCATION OF ALL OPENINGS WITH ARCHITECTURAL AND MECHANICAL DRAWINGS.
WALL FRAMING: UNLESS OTHERWISE NOTED, ALL INTERIOR WALLS SHALL BE 2X4 @ 16"OC AND ALL EXTERIOR WALLS SHALL BE 2X6 @ 16"OC. PROVIDE (2)BUNDLED STUDS MIN AT WALL ENDS AND EACH SIDE OF ALL OPENINGS. UNO. ALL SOLID SAWN LUMBER HEADERS SHALL BE SUPPORTED BY A MINIMUM OF (1)TRIM AND (1)KING STUD AND ALL GLULAM OR ENGINEERED WOOD HEADERS BY (2)TRIM AND (2)KING STUDS. AT FRAMED WALLS, UNO ALL SOLID SAWN LUMBER BEAMS SHALL BE SUPPORTED ON A MINIMUM OF (2) BUNDLED 2X STUDS AND ALL GLULAM OR ENGINEERED WOOD BEAMS ON A MINIMUM OF (3) BUNDLED 2X STUDS. STITCH-NAIL BUNDLED STUDS WITH (2)10 @ 12"OC. UNO, ALL INTERIOR AND EXTERIOR HEADERS SHALL BE 4X10 DF#2. PROVIDE SOLID BLOCKING THRU FLOORS TO SUPPORTS BELOW FOR BEARING WALLS AND POSTS. PROVIDE CONTINUOUS SOLID BLOCKING AT MID-HEIGHT OF ALL STUD WALLS OVER 10'-0" IN HEIGHT. ALL WALLS SHALL HAVE A SINGLE BOTTOM PLATE. END NAIL TOP PLATE AND BOTTOM PLATE TO EACH STUD WITH THREE 10d NAILS. FACE NAIL DOUBLE TOP PLATES WITH 10d AT 12"OC AND LAP MINIMUM 4'-0" AT JOINTS AND PROVIDE TWELVE 10d NAILS AT 4"OC EACH SIDE OF JOINT. AT TOP PLATE INTERSECTIONS PROVIDE THREE 10d FACE NAILS.
ALL STUD WALLS SHALL HAVE THEIR LOWER WOOD FRAMING PLATES ATTACHED TO WOOD FRAMING BELOW WITH TWO ROWS OF 10d NAILS AT 16"OC, OR ATTACHED TO CONCRETE BELOW WITH 5/8" DIAMETER ANCHOR BOLTS AT 4'-0"OC EMBEDDED 7" MINIMUM, UNO. THERE SHALL BE A MINIMUM OF TWO BOLTS PER PLATE SECTION WITH ONE BOLT LOCATED NOT MORE THAN 12" OR LESS THAN 4 1/2" FROM EACH END OF THE PLATE SECTION. INDIVIDUAL MEMBERS OF BUILT-UP POSTS SHALL BE NAILED TO EACH OTHER WITH TWO ROWS OF 10d AT 16"OC, UNLESS NOTED OTHERWISE. GYPSUM WALLBOARD SHALL BE FASTENED TO THE INTERIOR SURFACE OF ALL STUDS AND PLATES WITH #6 x 1-1/4" TYPE S OR M SCREWS AT 8"OC. UNLESS NOTED OTHERWISE, 1/2" (NOMINAL) APA RATED SHEATHING (SPACING RATING 24/0) SHALL BE NAILED TO ALL EXTERIOR SURFACES WITH 8d NAIL AT 6"OC AT PANEL EDGES AND TOP AND BOTTOM PLATES (BLOCK UNSUPPORTED EDGES) AND ALL INTERMEDIATE STUDS AND BLOCKING WITH 8d NAILS AT 12"OC. ALLOW 1/8" SPACING AT ALL PANEL ENDS.
ROOF/FLOOR FRAMING: UNLESS OTHERWISE NOTED, PROVIDE DOUBLE JOISTS/RAFTERS UNDER ALL PARALLEL BEARING PARTITIONS THAT EXTEND OVER MORE THAN HALF THE JOIST LENGTH AND SOLID BLOCKING AT ALL BEARING POINTS. PROVIDE DOUBLE JOISTS AROUND ALL ROOF/FLOOR OPENINGS. TOENAIL JOISTS TO SUPPORTS WITH THREE 10d NAILS. ATTACH TIMBER JOISTS TO FLUSH HEADERS OR BEAMS WITH SIMPSON METAL JOIST HANGERS IN ACCORDANCE WITH NOTES PER PLAN. UNO, MULTI-JOISTS/RAFTERS SHALL BE STITCH-NAILED TOGETHER WITH (2)10d @ 12"OC. TOENAIL RIM JOIST TO TOP PLATE WITH 10d AT 6"OC. PROVIDE ROOF SHEATHING EDGE WITH APPROVED CLIPS CENTERED BETWEEN FRAMING AT UNBLOCKED PLYWOOD EDGES. ALL FLOOR SHEATHING SHALL HAVE TONGUE AND GROOVE JOINTS OR BE SUPPORTED BY SOLID BLOCKING. ALLOW 1/8" SPACING AT ALL PANEL EDGES AND ENDS OF ROOF/FLOOR SHEATHING. ROOF/FLOOR SHEATHING SHALL BE Laid FACE GRAIN PERPENDICULAR TO FRAMING MEMBERS AND NAILED AT 6"OC WITH 8d NAILS TO FRAMED PANEL EDGES, DRUG-STRUTS, AND OVER STUD WALLS AS PER PLAN AND AT 6"OC TO INTERMEDIATE SUPPORTS.
MOISTURE CONTENT: WOOD MATERIAL USED FOR THIS PROJECT SHALL HAVE MAXIMUM MOISTURE CONTENT OF 19% EXCEPT FOR THE PRESSURE-TREATED WOOD SILL PLATE. TRUSSES SHALL BE DESIGNED TO NOT ALLOW LIMITED STORAGE PER IBC TABLE 1607.1. WEBS SHALL CONFIGURED SO THAT ALL OPENINGS ARE SMALLER THAN 24" WIDE X 42" HIGH.
PRESERVATIVE TREATMENT/METAL CONNECTORS: WOOD MATERIALS ARE REQUIRED TO BE "TREATED WOOD" UNDER CERTAIN CONDITIONS IN ACCORDANCE WITH IBC SEC 2304.10.5 "FASTENERS AND CONNECTORS IN CONTACT WITH PRESERVATIVE - TREATED AND FIRE-RETARDANT-TREATED WOOD". CONFORM TO THE APPROPRIATE STANDARDS OF THE AMERICAN WOOD PROTECTION ASSOCIATION (AWPA) FOR SHAWN LUMBER, GLUED LAMINATED TIMBER, ROUND POLES, WOOD PILES AND HARBOR PILES. FOLLOW AMERICAN LUMBER STANDARDS PROCEDURE (ALSC) QUALITY ASSURANCE PROCEDURES. PRODUCTS SHALL BEAR THE APPROPRIATE MARK. PRESSURE TREATED WOOD FOR ABOVE GROUND USE SHALL BE TREATED TO RETENTION OF 0.25 PCF. WOOD IN CONTINUOUS CONTACT WITH FRESH WATER OR SOIL SHALL BE TREATED TO A RETENTION OF 0.40 PCF. SODIUM BORATE (SBX) TREATED WOOD SHALL NOT BE USED WHERE EXPOSED TO WEATHER. FASTENERS AND TIMBER CONNECTORS WITHOUT AMMONIA IN DIRECT CONTACT WITH ACC-A (UP TO A RETENTION LEVEL OF 0.40 PCF), CBA-A (UP TO A RETENTION LEVEL OF 0.41 PCF), CA-B (UP TO A RETENTION LEVEL OF 0.21 PCF), SHALL BE CHLOR ALIBS NOT DIPPED OR CONTAINING HOT-DIP GALVANIZED PER ASTM A653. FASTENERS AND TIMBER CONNECTORS WITH AMMONIA IN DIRECT CONTACT WITH ACC-A (OVER A RETENTION LEVEL OF 0.40 PCF), CBA-A (OVER A RETENTION LEVEL OF 0.41 PCF), CA-B (OVER A RETENTION LEVEL OF 0.21 PCF), OR WITH ACCA TREATED WOOD SHALL BE TYPE 304 OR 316 STAINLESS STEEL.
HOT-DIPPED GALVANIZED METAL HARDWARE AND FASTENERS HAVE A MINIMUM ZINC CONTENT OF AT LEAST 1.85 OZ/SF AND ITS USE IS COORDINATED BY THE CONTRACTOR AND WOOD SUPPLIER FOR THE EXPECTED ENVIRONMENT AND MOISTURE EXPOSURE FOR APPROPRIATE USE BASED ON THE METHOD OF PRESERVATIVE TREATMENT OF THE WOOD.
CONTRACTOR INITIATED STRUCTURAL CHANGES SHALL BE SUBMITTED IN WRITING TO THE ENGINEER FOR APPROVAL PRIOR TO FABRICATION AND CONSTRUCTION.
NOTICES AND HOLES IN WOOD FRAMING:
SAWN LUMBER JOISTS AND RAFTERS: NOTICES AT THE ENDS OF JOISTS SHALL NOT EXCEED 1/4 THE JOIST DEPTH. NOTCHES IN THE TOP OR BOTTOM OF JOISTS SHALL NOT EXCEED 1/6 THE JOIST DEPTH BE LONGER THAN 1/3 THE JOIST DEPTH, OR BE LOCATED IN THE MIDDLE 1/3 OF THE SPAN. HOLES SHALL NOT BE WITHIN 2" OF THE TOP OR BOTTOM OF THE JOIST AND THE DIAMETER SHALL NOT EXCEED 1/3 THE JOIST DEPTH. SPACING BETWEEN HOLES SHALL BE A MINIMUM OF (2) TIMES THE DIAMETER OF THE LARGEST HOLE OR 2" AND SHALL BE LOCATED A MINIMUM OF 2" FROM ANY NOTCH.
EXTERIOR AND BEARING WALLS: WOOD STUDS ARE PERMITTED TO BE NOTCHED TO A DEPTH NOT EXCEEDING 1/4 OF ITS WIDTH. A HOLE NOT GREATER IN DIAMETER THAN 40% OF THE STUD WIDTH IS PERMITTED IN WOOD STUDS. HOLES SHALL NOT BE WITHIN 5/8" TO THE EDGE OF THE STUD.
SPACING BETWEEN HOLES SHALL BE A MINIMUM OF (2) TIMES THE DIAMETER OF THE LARGEST HOLE OR 2" AND SHALL NOT BE LOCATED AT THE SAME SECTION AS A NOTCH.
CUTS, NOTCHES, AND HOLES IN MANUFACTURED LUMBER, PREFABRICATED PLYWOOD WEB JOIST AND PREFABRICATED TRUSSES ARE PROHIBITED EXCEPT WHERE NOTED ON STRUCTURAL PLANS OR PERMITTED BY MANUFACTURER'S RECOMMENDATIONS. THE STRUCTURAL ENGINEER HAS NO OVERALL SUPERVISORY AUTHORITY OR ACTUAL, UNO OR DIRECT RESPONSIBILITY FOR THE SPECIFIC WORKING CONDITIONS AT THE SITE AND/OR FOR ANY HAS NO DUTY TO INSPECT, SUPERVISE, NOTE, CORRECT, OR REPORT ANY HEALTH OR SAFETY DEFICIENCY TO THE OWNER, CONTRACTORS, OR OTHER ENTITIES OR PERSONS AT THE PROJECT SITE.
INSTRUCTIONS TO BIDDERS: UNDER NO CIRCUMSTANCES SHALL THESE DRAWINGS BE "FINAL BID" UNTIL THE PROJECT IS FULLY PERMITTED. ALL PRELIMINARY PRICING EFFORTS MUST BE CONSIDERED TO BE ESTIMATES ONLY AND MUST BE SUBJECT TO NECESSARY CONTINGENCIES, ALTERNATIVES, ETC. AS APPROPRIATE TO ACCOUNT FOR MODIFICATIONS AND ADDITIONS THAT WILL OCCUR TO THE DRAWINGS DURING FINALIZATION OF THE DESIGN AND PERMITTING INCLUDING CLARIFICATIONS FOR ANY MODIFICATIONS, ADDITIONS, OR DELETIONS THAT MAY ARISE DURING THE DESIGN AND CONSTRUCTION OF THE PROJECT.
THE CONTRACTOR IS RESPONSIBLE FOR THE MEANS AND METHODS OF CONSTRUCTION AND ALL JOB RELATED SAFETY STANDARDS AND SILICA-DUST PROTECTION PER OSHA AND WSHA. THE CONTRACTOR IS RESPONSIBLE FOR THE STRENGTH AND STABILITY OF THE STRUCTURE DURING CONSTRUCTION AND SHALL BE RESPONSIBLE FOR THE NECESSARY CONTINGENCIES REQUIRED TO MAINTAIN STABILITY UNTIL THE STRUCTURE IS COMPLETED. THE CONTRACTOR IS RESPONSIBLE TO BE FAMILIAR WITH THE WORK REQUIRED IN THE CONSTRUCTION DOCUMENTS AND THE REQUIREMENTS FOR EXECUTING IT PROPERLY.
CONTRACTOR-INITIATED CHANGES SHALL BE SUBMITTED IN WRITING TO THE ARCHITECT/DESIGNER AND STRUCTURAL ENGINEER FOR APPROVAL PRIOR TO FABRICATION OR CONSTRUCTION. CHANGES SHOWN ON SHOP DRAWINGS ONLY WILL NOT SATISFY THIS REQUIREMENT.

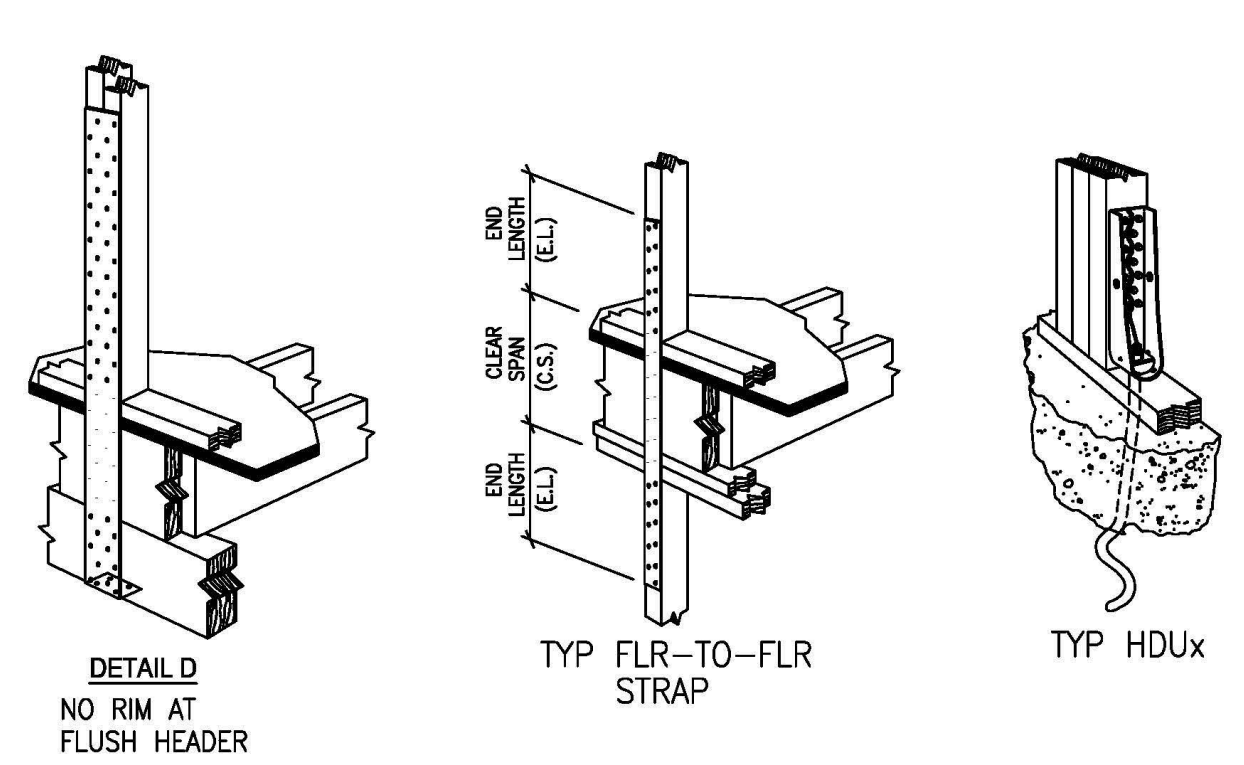

SHEAR WALL HOLDOWN SCHEDULE

MODEL #	ANCHORAGE TYPE	FASTENERS	END STUD REQUIRED	CAPACITY (LBS)
CS16	FLR-TO-FLR STRAP, CS=14"	(26) 8d COMMON	(2)2x STUDS HF#2	1,705
MSTC40	FLR-TO-FLR STRAP, CS=18"	(28) 16d SINKERS	(2)2x STUDS HF#2	2,320
MSTC48B3	FLR-TO-FLR STRAP, CS=18"	(38) 10d SINKERS	(2)2x STUDS HF#2	3,420
MSTC52	FLR-TO-FLR STRAP, CS=18"	(44) 16d SINKERS	(2)2x STUDS HF#2	3,645
MSTC66	FLR-TO-FLR STRAP, CS=18"	(64) 16d SINKERS	(2)2x STUDS HF#2	5,495
MSTC66B3	FLR-TO-FLR STRAP, CS=18"	(38) 10d SINKERS	(2)2x STUDS HF#2	3,875
HDUS	5/8" SSBT20 EMB 21" MIN	(14) 1/4"x2 1/2" SDS WOOD SCREWS	(2)2x STUDS HF#2	4,065

- NOTES:**
1. HOLD-DOWNS SPECIFIED ARE AS MANUFACTURED BY SIMPSON STRONG-TIE CO. INC.; ACCEPTABLE EQUIVALENT PRODUCT SUBSTITUTIONS ARE AVAILABLE FROM OTHER MANUFACTURERS WITH THE ENGINEER APPROVAL.
2. LOCATE ALL HOLD-DOWNS AT ENDS OF ALL SHEAR WALLS & FASTEN TO BUNDLED HEM-FIR END STUDS.
3. BUNDLED END STUDS SHOULD BE STITCH-NAILED TOGETHER USING MINIMUM (2) 16d @ 10"OC, UNO.
4. LOCATE "HDUx" & "HD" HOLD-DOWNS AT CONCRETE FOUNDATION LEVEL.
LOCATE "MST" & "MSTC" STRAPS AT FLOOR-TO-FLOOR CONNECTIONS.
5. ALL HOLD-DOWN ANCHOR BOLTS SHALL BE MIN 4" FROM CONCRETE WALL ENDS.
6. USE "SSBT" FOR 2x SILL PLATES & "SSBL" FOR 3x OR (2)2x SILL PLATES.
7. ADDITIONAL END STUD REQUIRED TO MEET MINIMUM 1/2" EDGE DISTANCE FROM CONCRETE CORNER TO "STB" STRAP. USE "RL" STYLE WITH "STH" WHERE RIM JOIST IS PRESENT.
8. INSTALL ALL HOLD-DOWN HARDWARE PER MANUFACTURER'S INSTRUCTIONS OR RECOMMENDATIONS.
9. STEM WALL HEIGHT TO BE COORDINATED WITH HOLD-DOWN REQUIREMENTS (21" MINIMUM) AND SILL PLATE SIZE.

WOOD-FRAMED DIAPHRAGM NAILING SCHEDULE
FOR HEM-FIR FRAMING MEMBER

LEVEL

LAP SPLICE $f_c'=3000$ PSI $f_y=40000$ PSI				
BAR SIZE	MISCELLANEOUS BARS		TOP BARS	
	Ld	LAP SPLICE	Ld	LAP SPLICE
#3	12"	16"	16"	21"
#4	15"	20"	20"	26"
#5	20"	26"	26"	34"
#6	24"	31"	31"	41"

LAP SPLICE $f_c'=3000$ PSI $f_y=60000$ PSI				
BAR SIZE	MISCELLANEOUS BARS		TOP BARS	
	Ld	LAP SPLICE	Ld	LAP SPLICE
#3	16"	21"	21"	28"
#4	22"	28"	28"	37"
#5	27"	36"	36"	46"
#6	33"	43"	43"	56"

HOOK BARS						
BAR SIZE	DIA	STANDARD 180 DEGREE HOOK			STANDARD 90 DEGREE HOOK	
		D	A OR G	J	D	A OR G
#3	6db	2 1/4"	5"	3"	2 1/4"	6"
#4	6db	3"	6"	4"	3"	8"
#5	6db	3 3/4"	7"	5"	3 3/4"	10"

- NOTES:
- VALUES FOR UNCOATED REINFORCING AND NORMAL WEIGHT CONCRETE WITH CLEAR SPACING > db, CLEAR COVER > db AND MINIMUM STIRRUPS OR TIES THROUGHOUT Ld OR CLEAR SPACING > 2db AND CLEAR COVER > db.
 - DEVELOP ALL REINFORCING IN STRUCTURAL SLABS WITH MINIMUM DEVELOPMENT LENGTH Ld.
 - TOP BAR = HORIZONTAL BAR WITH MORE THAN 12" OF FRESH CONCRETE BELOW OR AS NOTED ON DOCUMENTS AS "TOP BAR".
 - UNO, ALL LAPS SHALL BE MINIMUM CLASS B OR CLASS B (TOP BARS).
 - ALL TABULATED VALUES ARE IN INCHES.

HOLDOWN AT HEADERS					
MSTC48B3	FLR-TO-HDR STRAP (HDR 9 1/4" MIN DEPTH)	(54) 10d COMMON: (12) @ FACE OF HDR, (4) @ BOT OF HDR, (38) @ STUDS	(2)2x STUDS	3,930	3,380
MSTC66B3	FLR-TO-HDR STRAP (HDR 11 1/4" MIN DEPTH)	(56) 10d COMMON: (14) @ FACE OF HDR, (4) @ BOT OF HDR, (38) @ STUDS	(2)2x STUDS	4,440	3,820

SHEATHING PROPERTIES				
LOCATION	THICKNESS	SPAN RATING	PLYWOOD GRADE	EXPOSURE
ROOF	15/32	32/16	C-D	1
FLOOR	23/32 T&G	24 OC	STURD-I FLOOR	1
WALLS	15/32	32/16	C-D	1


COMMON WIRE NAILS PROPERTIES					
PENNY WEIGHT	8d	10d	12d	16d	20d
DIAMETER (IN)	0.131	0.148	0.148	0.162	0.192
LENGTH (IN)	2 1/2	3	3 1/2	3 1/2	4

NOTES:
ALL COMMON WIRE AND BOX NAILS SHALL CONFORM TO NOMINAL SIZES SPECIFIED IN ASTM F1667.

SOLID LUMBER PROPERTIES			
MEMBER SIZE	SIZE	SPECIES	GRADE
WALL STUD, BLOCKING	2X4, 3X4, 2X6, 3X6	HEMLOCK-FIR SPURCE-PINE-FIR	NR 2
SILL PLATE	2X4, 3X4, 2X6, 3X6	P.T. HEMLOCK-FIR	NR 2
TOP PLATES	2X4, 3X4, 2X6, 3X6	HEMLOCK-FIR SPURCE-PINE-FIR	NR 2
POST	4X4, 4X6, 4X8	DOUGLAS FIR-LARCH	NR 2
FLOOR JOIST OR ROOF RAFTER	2X8 THROUGH 2X12	HEMLOCK-FIR SPURCE-PINE-FIR	NR 2
BEAM	4X6 THROUGH 4X12	DOUGLAS FIR-LARCH	NR 2
BEAM	6X6 THROUGH 6X12	DOUGLAS FIR-LARCH	NR 1
POST OR TIMBER	6X6, 6X8	DOUGLAS FIR-LARCH	NR 1
LEDGER	2X AND 3X	DOUGLAS FIR-LARCH	NR 2
LEDGER	4X	DOUGLAS FIR-LARCH	NR 1

GLUELAM TIMBER PROPERTIES				
MEMBER	SIZE	SPECIES	COMB	USES
BEAMS	ALL	DF/DF	24F-V4	SIMPLE SUPPORT
BEAMS	ALL	DF/DF	24F-VB	CONTINUOUS OR WITH CANTILEVER END
COLUMNS	ALL	DF	C-D	POST OR TIMBER MEMBER


- NOTES:
- USE MINIMUM THICKNESS AND MINIMUM APA RATING.
 - ALL WEATHER EXPOSED MEMBERS TO BE PRESSURE TREATED
 - PRESSURE TREATED WOOD INCLUDES PRESERVATIVE AND FIRE TREATED

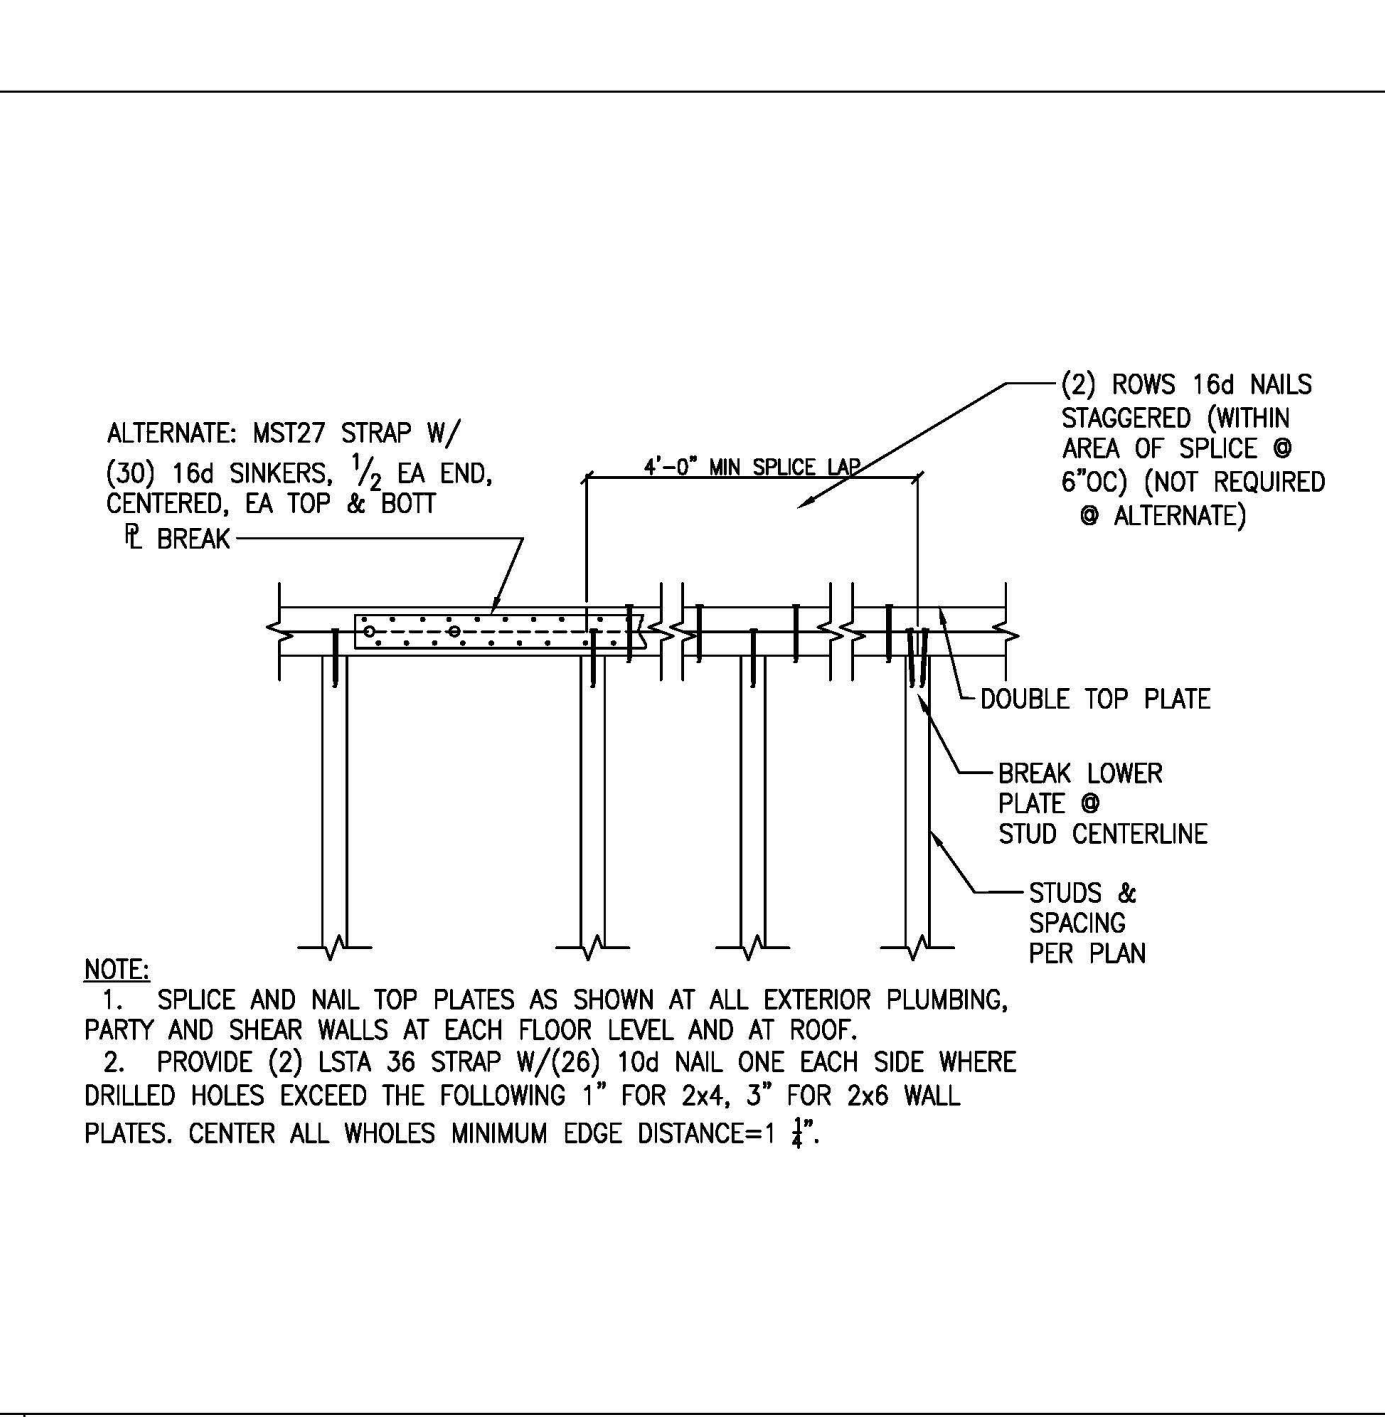

3 TYPICAL PLATE SPLICE DETAIL


- NOTES:
- 15/32" A.P.A. RATED PLYWOOD OR O.S.B. PANELS SHALL BE INSTALLED EITHER HORIZONTALLY OR VERTICALLY.
 - WHERE SHEATHING IS APPLIED ON BOTH SIDES OF WALL, PANEL EDGE JOINTS ON 2x FRAMING SHALL BE STAGGERED SO THAT JOINTS ON OPPOSITE SIDES ARE NOT LOCATED ON THE SAME STUDS.
 - BLOCKING IS REQUIRED AT ALL UNSUPPORTED PANEL EDGES.
 - PROVIDE SHEAR WALL SHEATHING AND NAILING FOR ENTIRE LENGTH OF THE WALLS INDICATED ON THE PLANS, ENDS OF FULL HEIGHT WALLS ARE DESIGNATED BY WINDOWS, OR DOORWAYS OR AS DESIGNATED ON PLANS. HOLDOWN REQUIREMENTS PER PLANS.
 - MINIMUM RIM BOARD OR BLOCKING WIDTH BELOW WALL SHALL BE 1-1/4" TIMBERSTRAND LSL FOR (1) SIDE WALL SHEATHING AND 3-1/2" TIMBERSTRAND LSL FOR (2) SIDES WALL SHEATHING.
 - SHEATHING EDGE NAILING IS REQUIRED AT ALL HOLDOWN POSTS. EDGE NAILING MAY ALSO BE REQUIRED TO EACH STUD USED IN BUILT-UP HOLDOWN POSTS. ADDITIONAL INFORMATION PER HOLDOWN SCHEDULE & DETAILS.
 - INTERMEDIATE FRAMING TO BE 2x MINIMUM MEMBERS. ATTACH SHEATHING TO INTERMEDIATE FRAMING WITH 0.131"x2 1/2" NAILS AT 12"OC WHERE STUDS ARE SPACED AT 16"OC AND 0.131"x2 1/2" NAILS AT 6"OC WHERE STUDS ARE SPACED AT 24"OC. NAILS SHALL BE LOCATED 3/8" MINIMUM FROM PANEL EDGES.
 - "LTPS" SHALL BE ORIENTED LENGTHWISE (HORIZONTAL) AT PLATE TO RIM.
 - BASED ON 0.131"x2 1/2" NAILS USED TO ATTACH FRAMING CLIPS DIRECTLY TO FRAMING, USE 0.131"x2 1/2" NAILS WHERE INSTALLED OVER SHEATHING.
 - SIMPSON "A35" MAY BE USED IN LIEU OF "LTPS".
 - WHERE JOISTS ARE HUNG FROM MUD SILL, USE P.T. 3x RIPPED TO STEM WALL WIDTH W/COUNTER-SUNK ANCHOR BOLTS PER SHEAR WALL SCHEDULE.
 - WHERE 3x FRAMING AND BLOCKING IS REQUIRED PER THE SHEAR WALL SCHEDULE, (2) 2x FRAMING AND BLOCKING MAY BE USED IN LIEU OF 3x NOTED IN THE SCHEDULE.
 - ANCHOR BOLTS SHALL BE PROVIDED WITH HOT-DIPPED GALVANIZED STEEL PLATE WASHERS 3"x3"x0.229"(MIN). THE HOLE IN THE PLATE WASHER MAY BE DIAGONALLY SLOTTED 1 3/8"x1 1/2" PROVIDED A STANDARD CUT WASHER IS PLACED BETWEEN THE PLATE WASHER AND NUT. PLATE WASHER TO EXTEND TO WITHIN 1/2" OF THE EDGE OF THE SILL PLATE ON THE SIDE(S) WITH SHEATHING. WHERE SHEAR WALLS ARE SHEATHED ON BOTH SIDES OF 2x6 WALL FRAMING, USE 4.5"x3"x0.229"(MIN) PLATE WASHERS. EMBED ANCHOR BOLTS 7" MINIMUM INTO THE CONCRETE.
 - PRESSURE TREATED MATERIAL CAN CAUSE EXCESSIVE CORROSION IN THE FASTENERS. PROVIDE HOT-DIPPED GALVANIZED (ELECTRO-PLATING IS NOT ACCEPTABLE) NAILS AND CONNECTOR PLATES (FRAMING ANGLES, ETC.) FOR ALL CONNECTORS IN CONTACT WITH PRESSURE TREATED FRAMING MEMBERS. ADDITIONAL INFORMATION PER STRUCTURAL NOTES.
 - AT ADJOINING PANEL EDGES, (2) 2x STUDS NAILED TOGETHER MAY BE USED IN PLACE OF SINGLE 3x STUD. DOUBLE 2x STUDS SHALL BE CONNECTED TOGETHER BY NAILING THE STUDS TOGETHER WITH 3" LONG NAILS OF THE SAME SPACING AND DIAMETER AS THE PLATE NAILING.
 - WHERE ABUTTING PANELS OR SILL PLATES REQUIRE 3x MINIMUM, NAIL STUDS TO 3x BOTTOM/SILL PLATES WITH (3) 0.148"x3 1/4" TOENAILS.

1 TYPICAL SHEAR WALL INTERSECTIONS

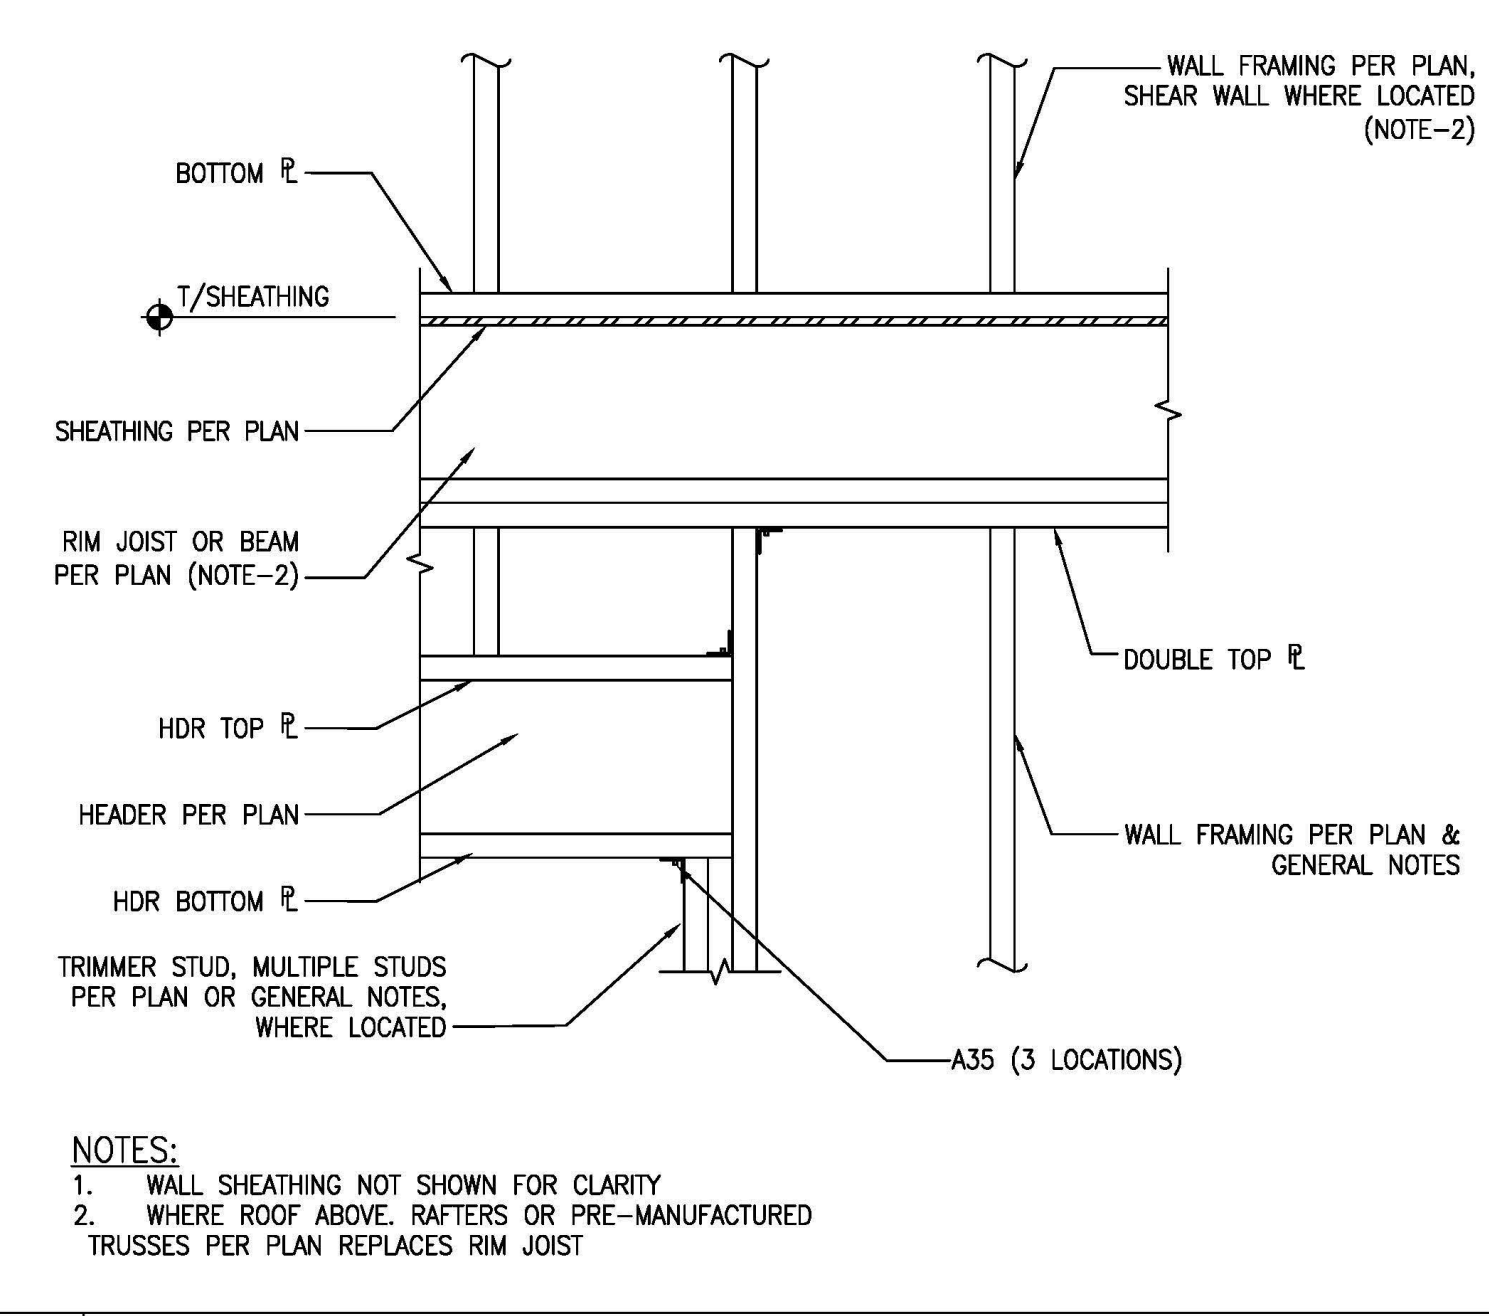

4 TYPICAL HEADER DETAIL

2 TYPICAL HEADER FRAMING FLUSH WITH BOTTOM OF JOIST

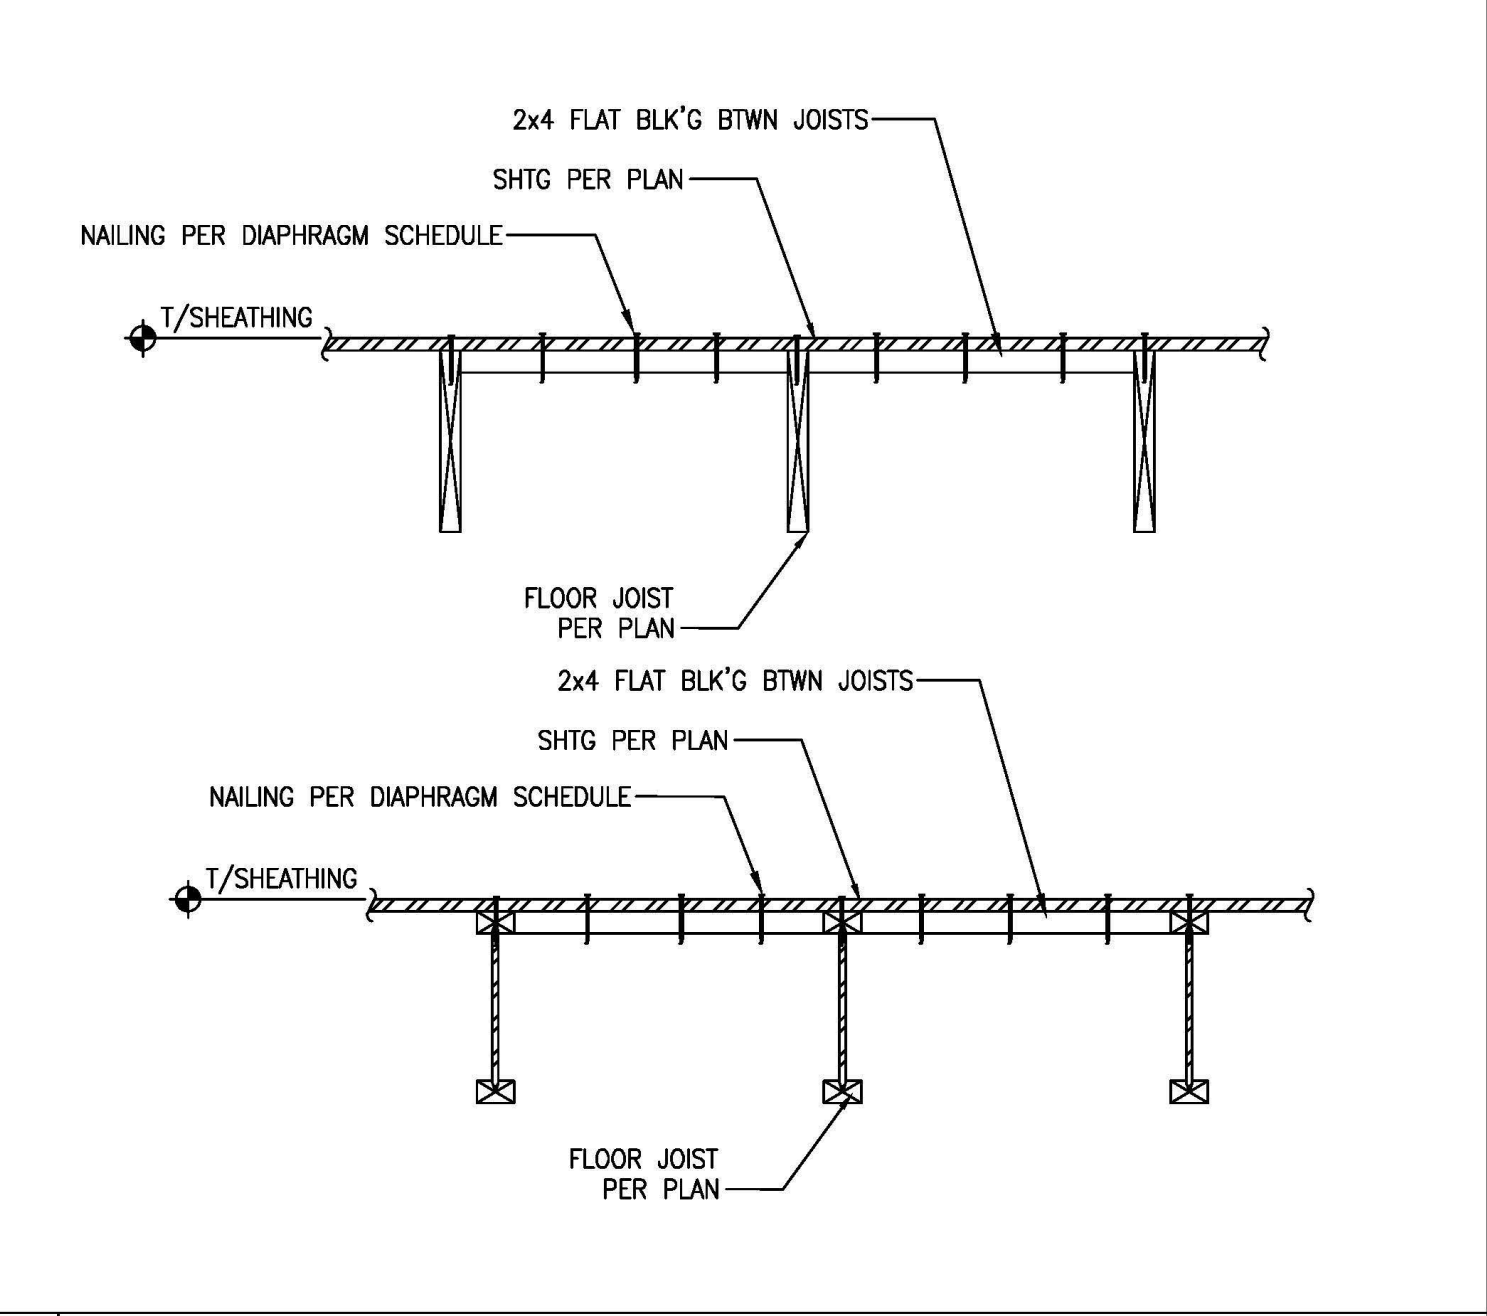


5 TYPICAL BLOCKING BETWEEN FLOOR JOISTS/ROOF TRUSSES

WOOD-FRAMED SHEAR WALL SCHEDULE
FOR HEM-FIR FRAMING W/ 8d COMMON NAILS (2021 IBC) & SIMPSON CATALOG 2024-2025

SW TYPE	WALL SHEATHING APA-RATED	EDGE NAILING	BASE PLATE NAILING	RIM BOARD OR BLOCKING TO WALL BELOW	MINIMUM RIM BOARD THICKNESS	FRAMING AT PANEL EDGES	BLOCKING AT PANEL EDGES	ANCHOR BOLT TO CONCRETE FOUNDATION	SILL PLATE AT FOUNDATION	SHEAR WALL CAPACITY (PLF) (SEISMIC)	SHEAR WALL CAPACITY (PLF) (WIND)
SINGLE-SIDED	SW-1	15/32"	0.131" x 2 1/2" @ 6"OC	0.162" x 3 1/2" @ 5"OC	LTP5 @ 14"OC	1 1/4"	2x	5/8" @ 40"OC 5/8" @ 44"OC	P.T. 2x P.T. 3x	261	365
	SW-2	15/32"	0.131" x 2 1/2" @ 4"OC	0.162" x 3 1/2" @ 4"OC	LTP5 @ 12"OC	1 1/4"	2x 3x or FLAT 2x	5/8" @ 28"OC 5/8" @ 48"OC	P.T. 2x P.T. 3x	380	533
	SW-3	15/32"	0.131" x 2 1/2" STAGGERED	0.162" x 3 1/2" @ 3"OC	LTP5 @ 8"OC	1 1/4"	3x	3x or FLAT 2x	5/8" @ 20"OC 5/8" @ 32"OC	P.T. 2x P.T. 3x	489

NOTE:
READ NOTES FOR SHEAR WALL INFORMATION.

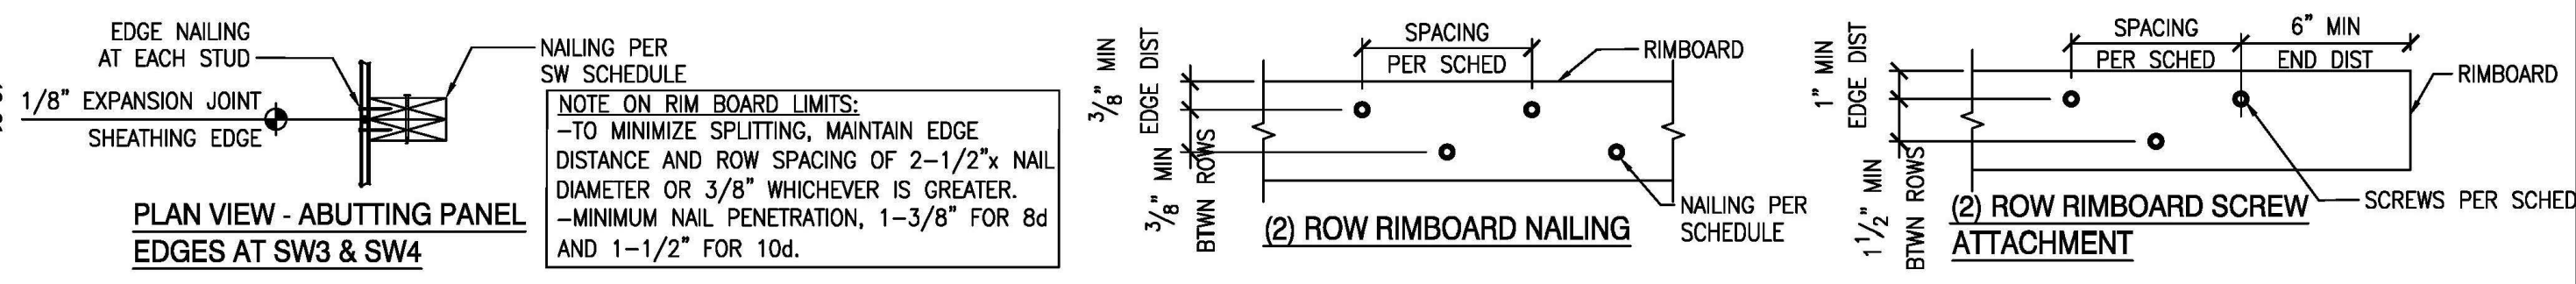

PROJECT #:
25-120


ENGINEERED BY: GS

DATE:
6/25/25

ZVELT
ENGINEERING DESIGN PLLC

STRUCTURAL ENGINEERING

721 4th AVE #794
KIRKLAND, WA 98033
Zvelt.Eng@outlook.com

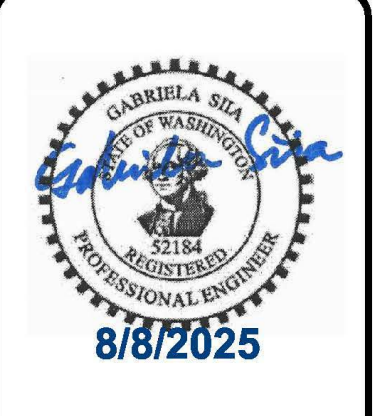

PROJECT NAME:
Long - DADU
6905 96th Ave SE
Mercer Island, WA 98040


IBC 2021

NOTES
SCHEDULES
AND
DETAILS


ANV 250052
LATERAL DETAILS

SHEET NUMBER:


S 2

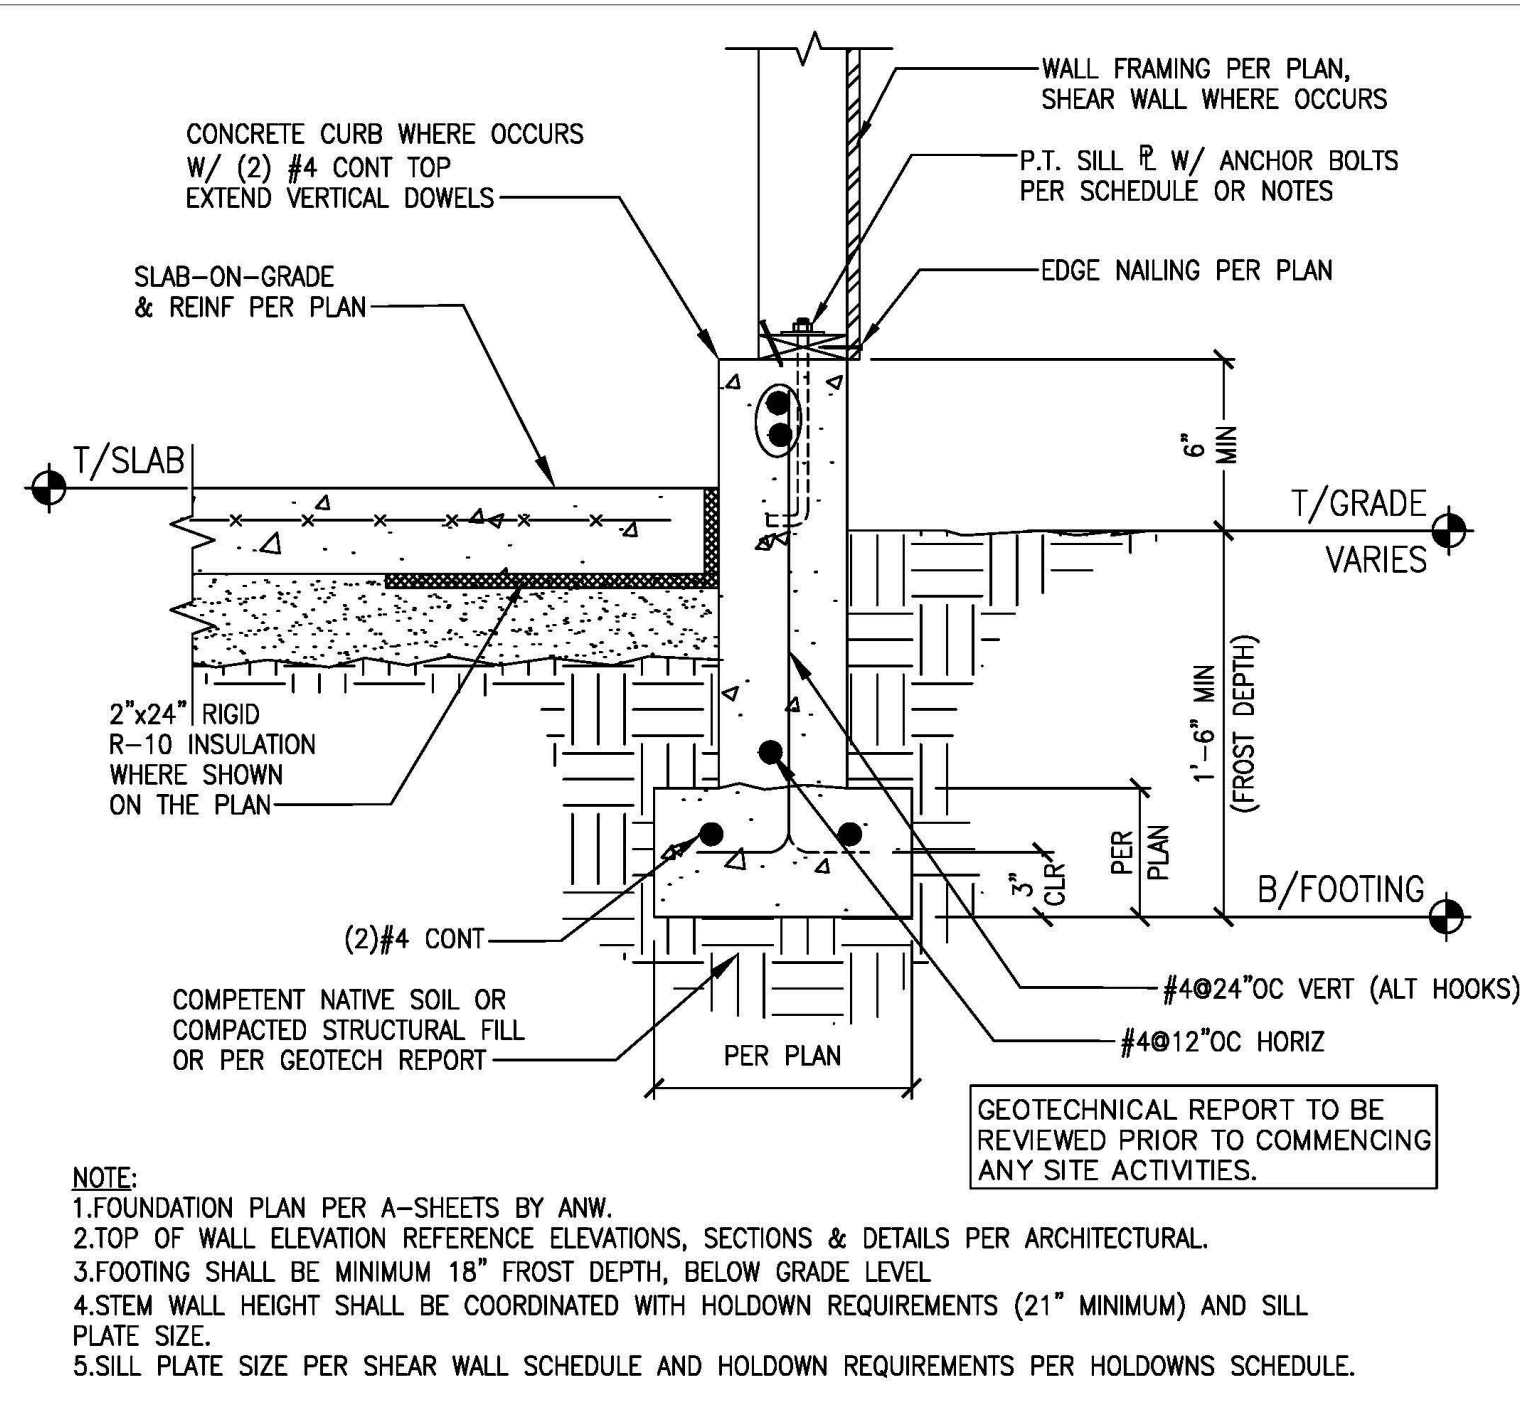


1 TYPICAL EXTERIOR SHEAR WALL WITH SLAB ON GRADE

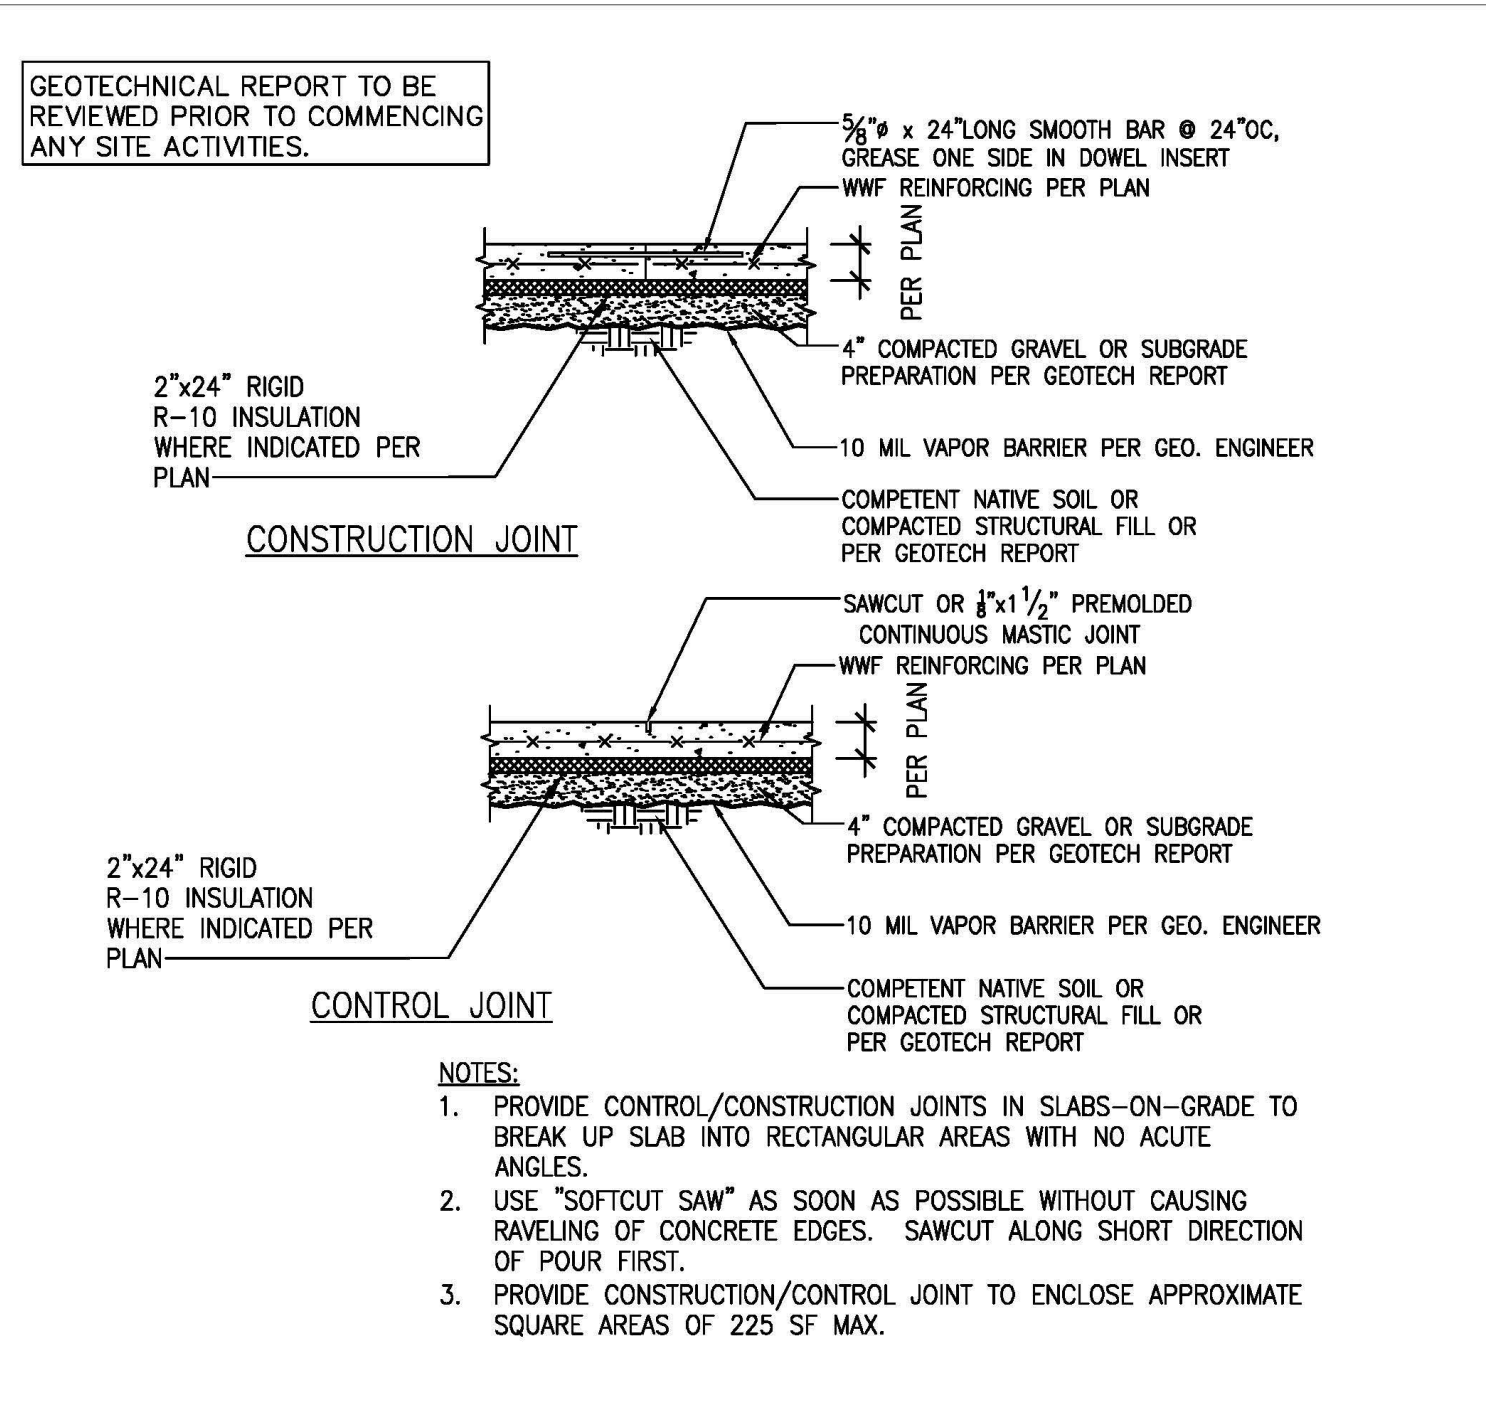


2 TYPICAL SLAB ON GRADE DETAILS

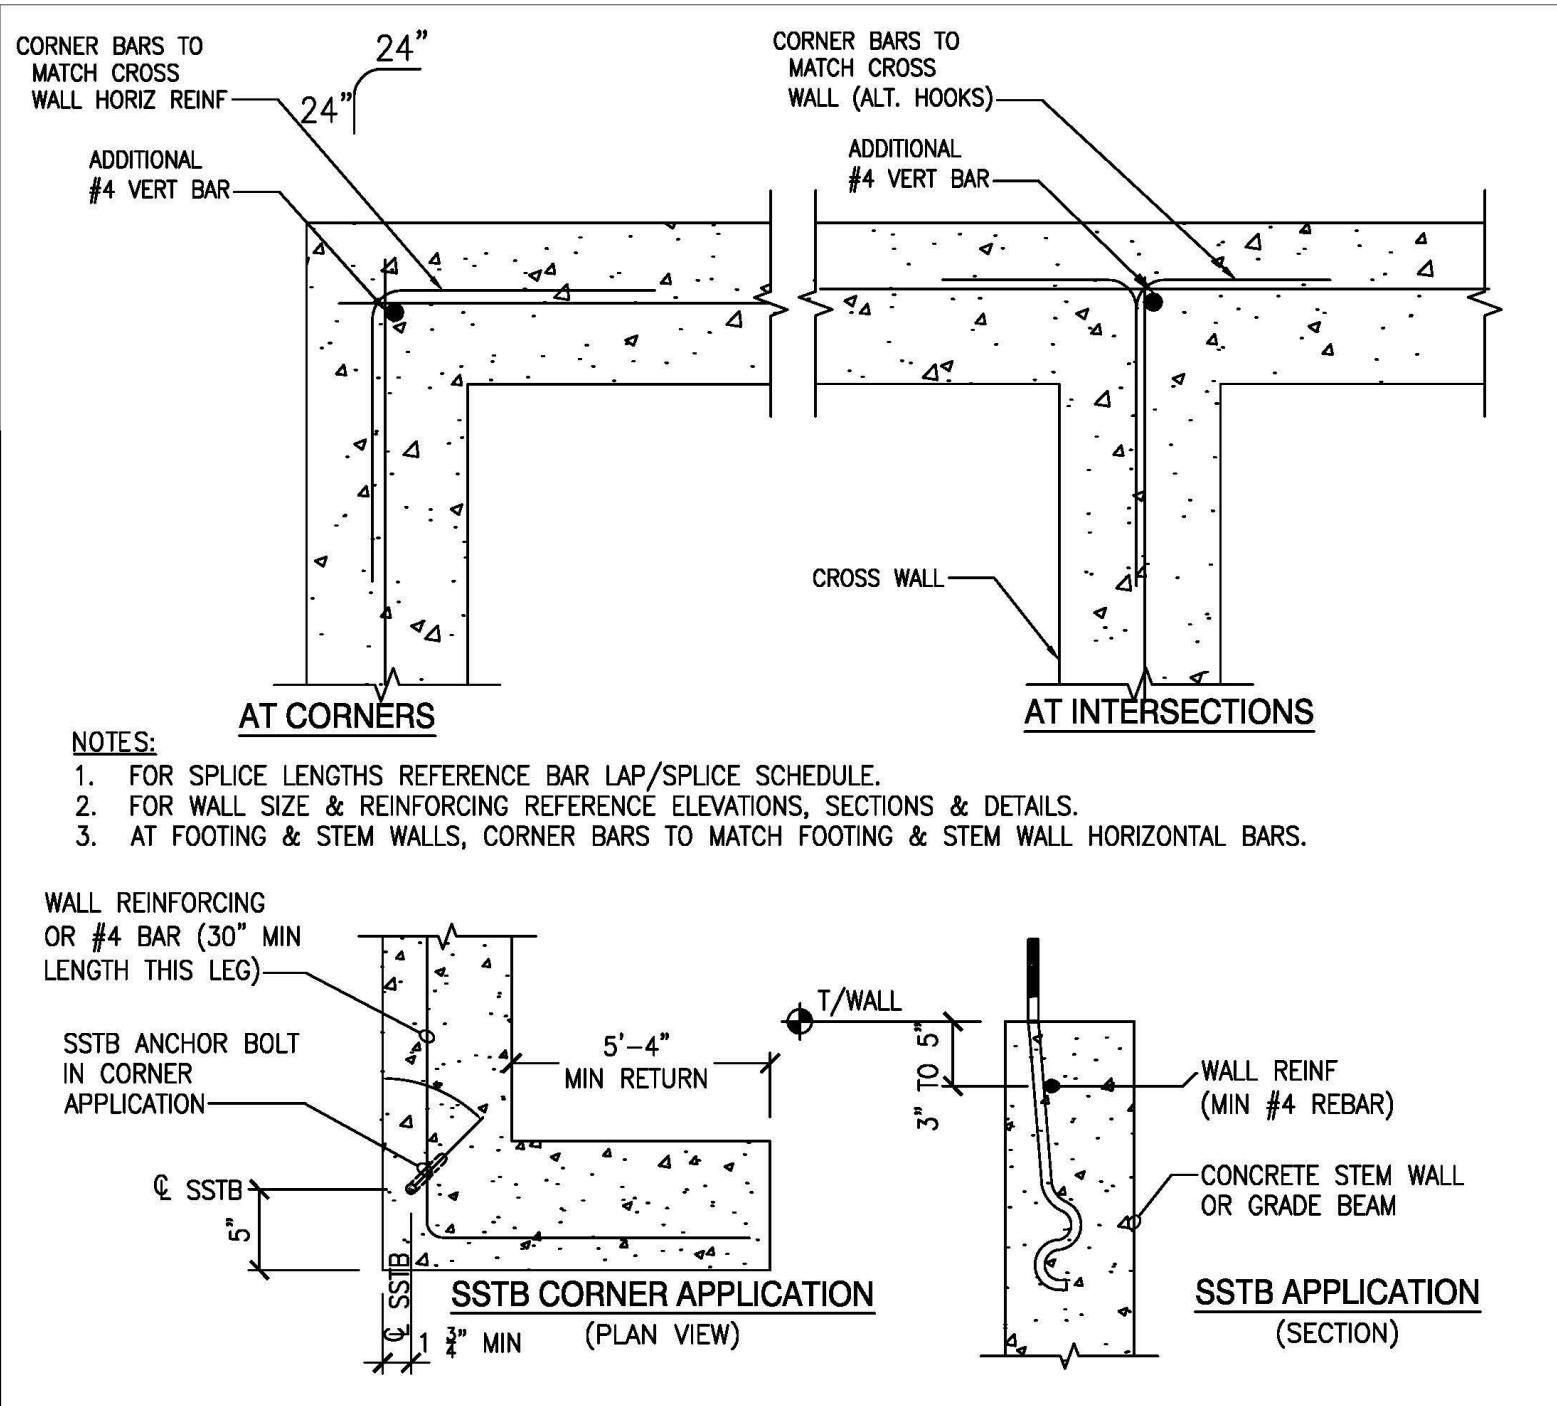


3 TYPICAL CORNERS BARS AT CONCRETE STEM WALLS & FTGs

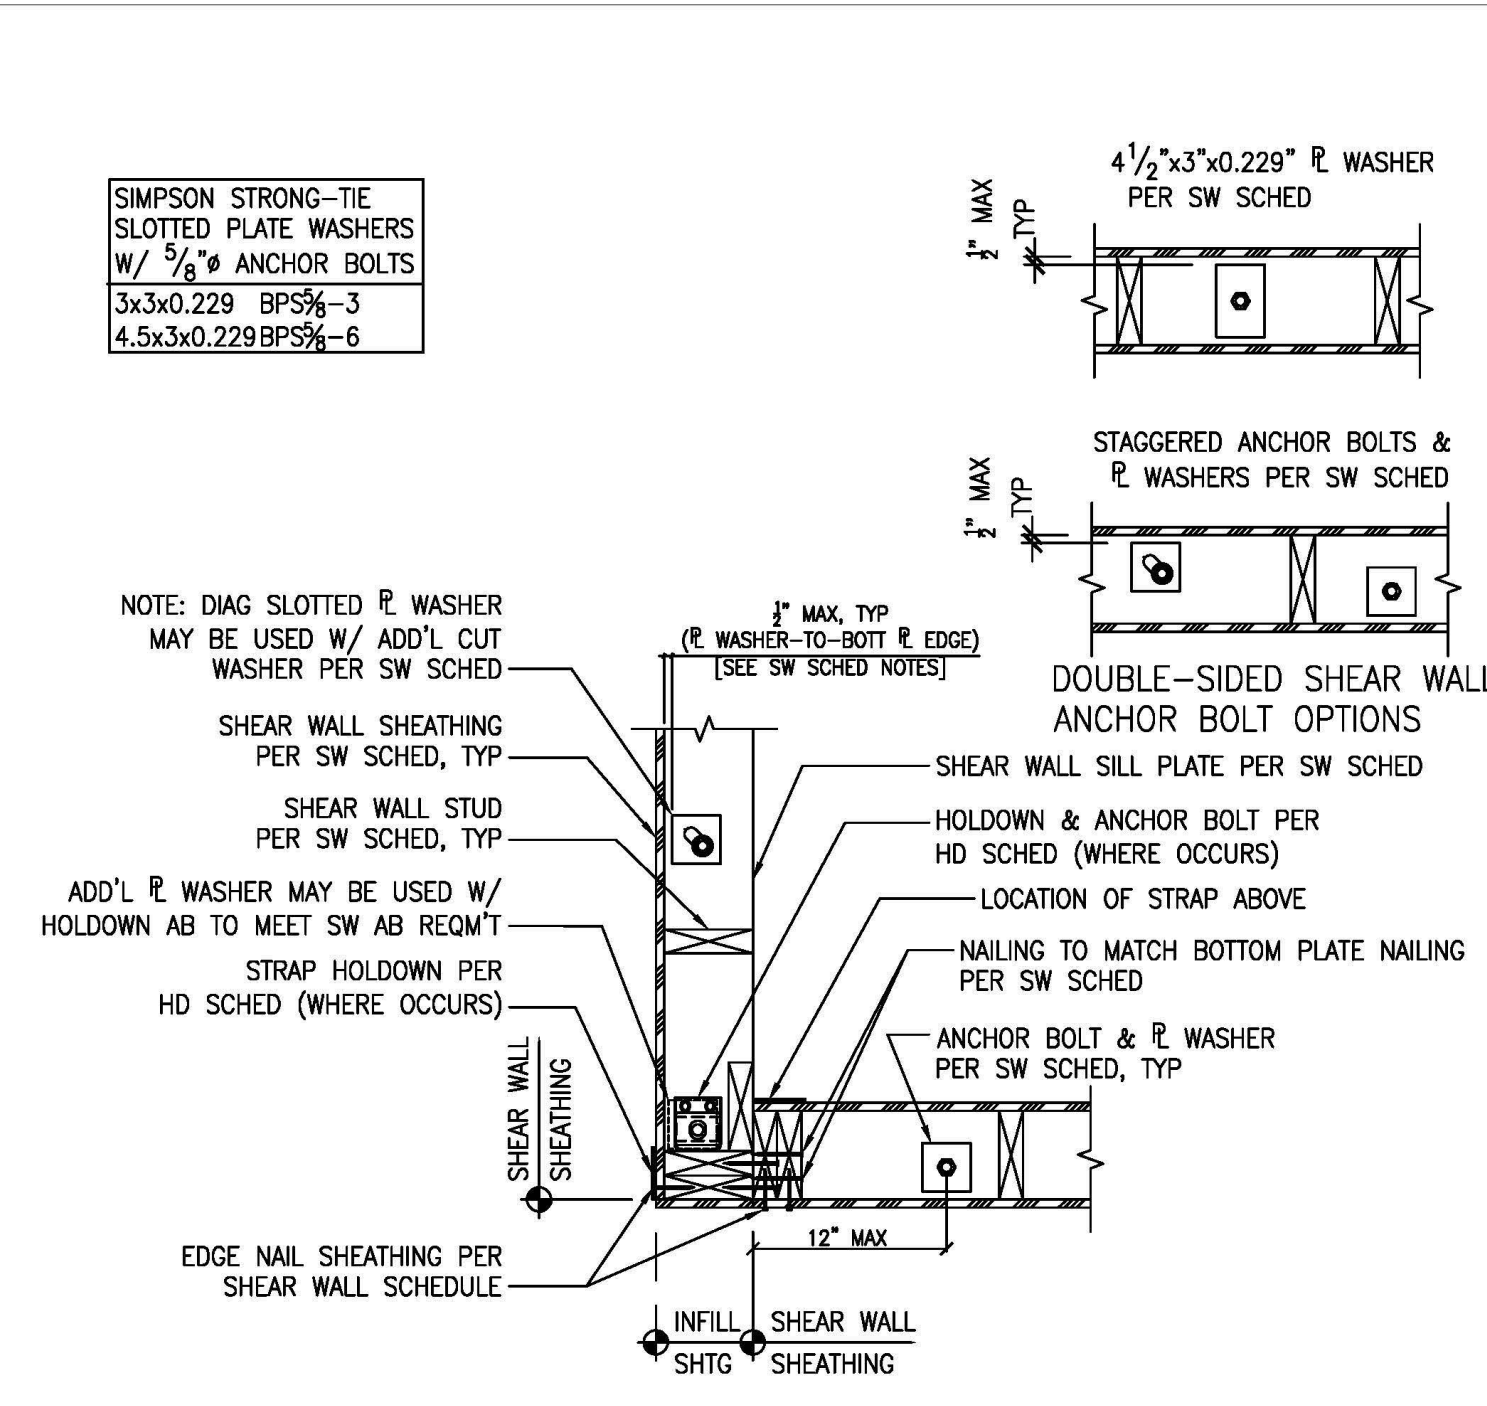


4 TYPICAL PLAN VIEW-CORNER FRAMING AT SHARED HOLDDOWN

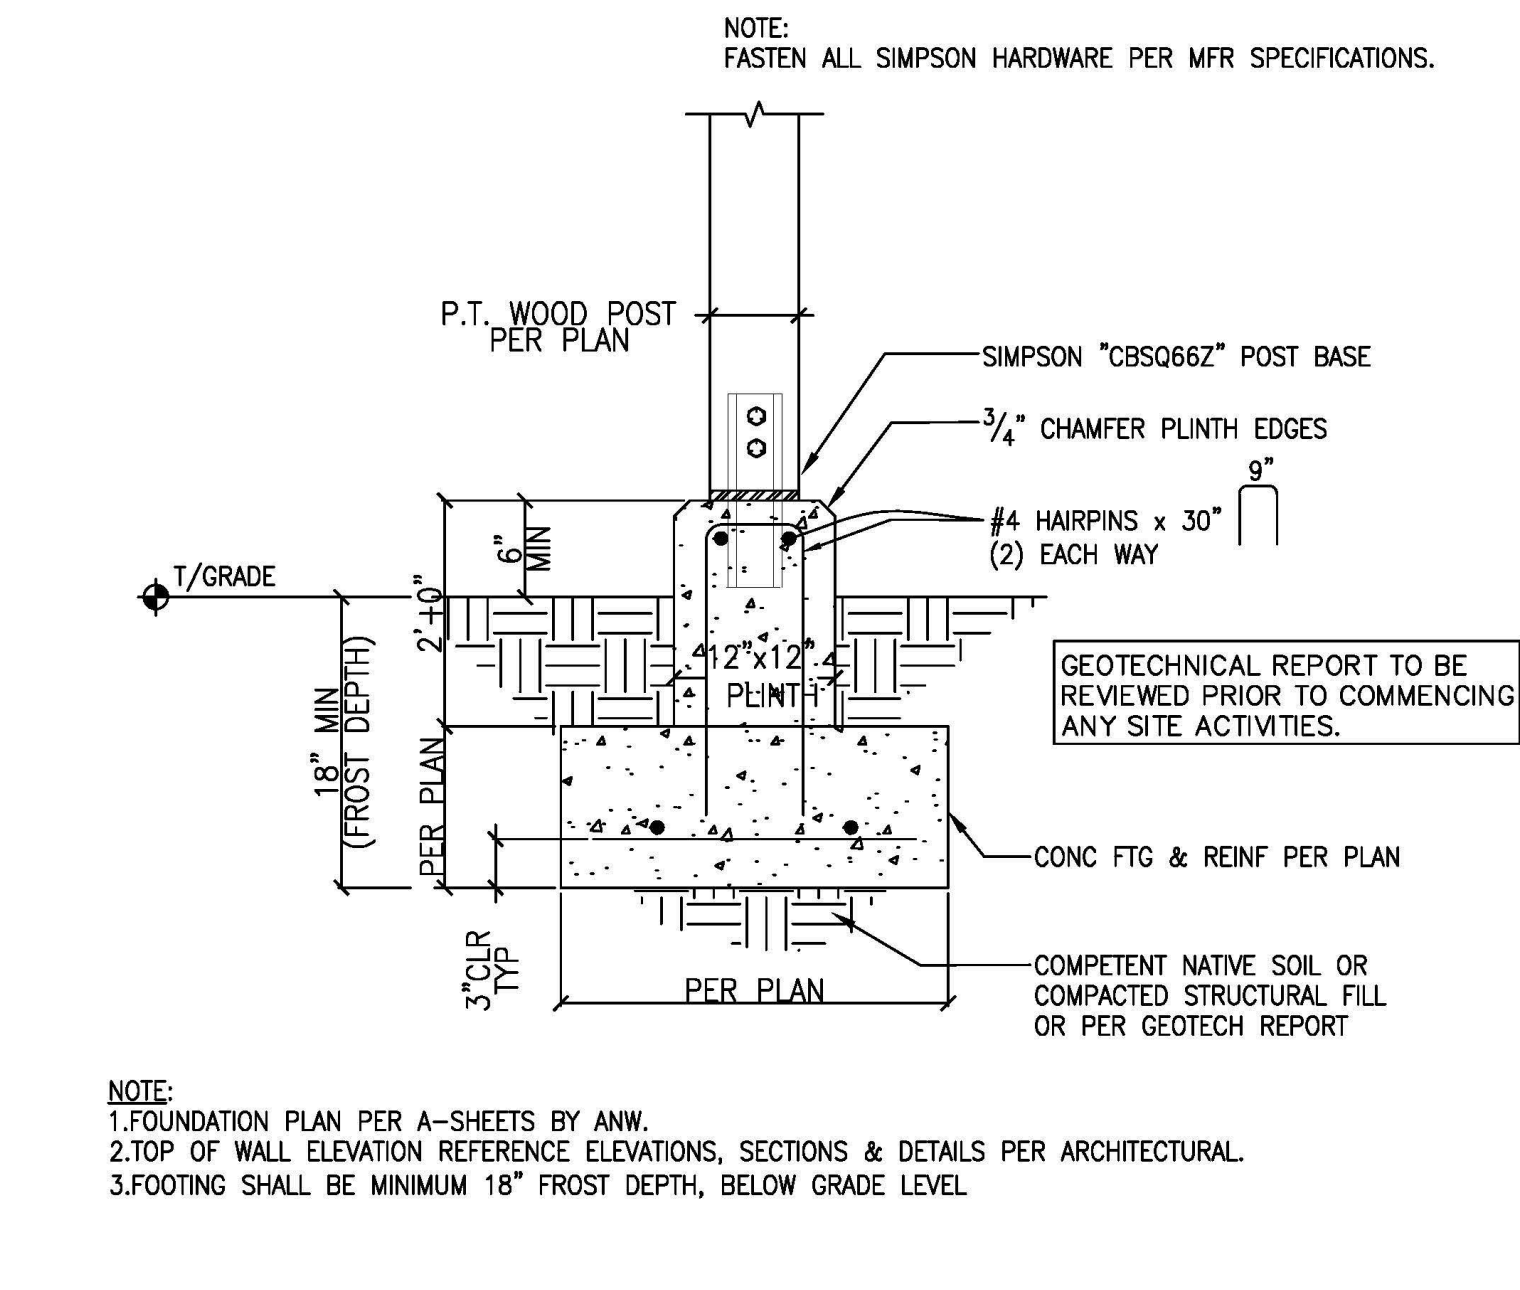


5 TYPICAL POST FOOTING WITH PLINTH

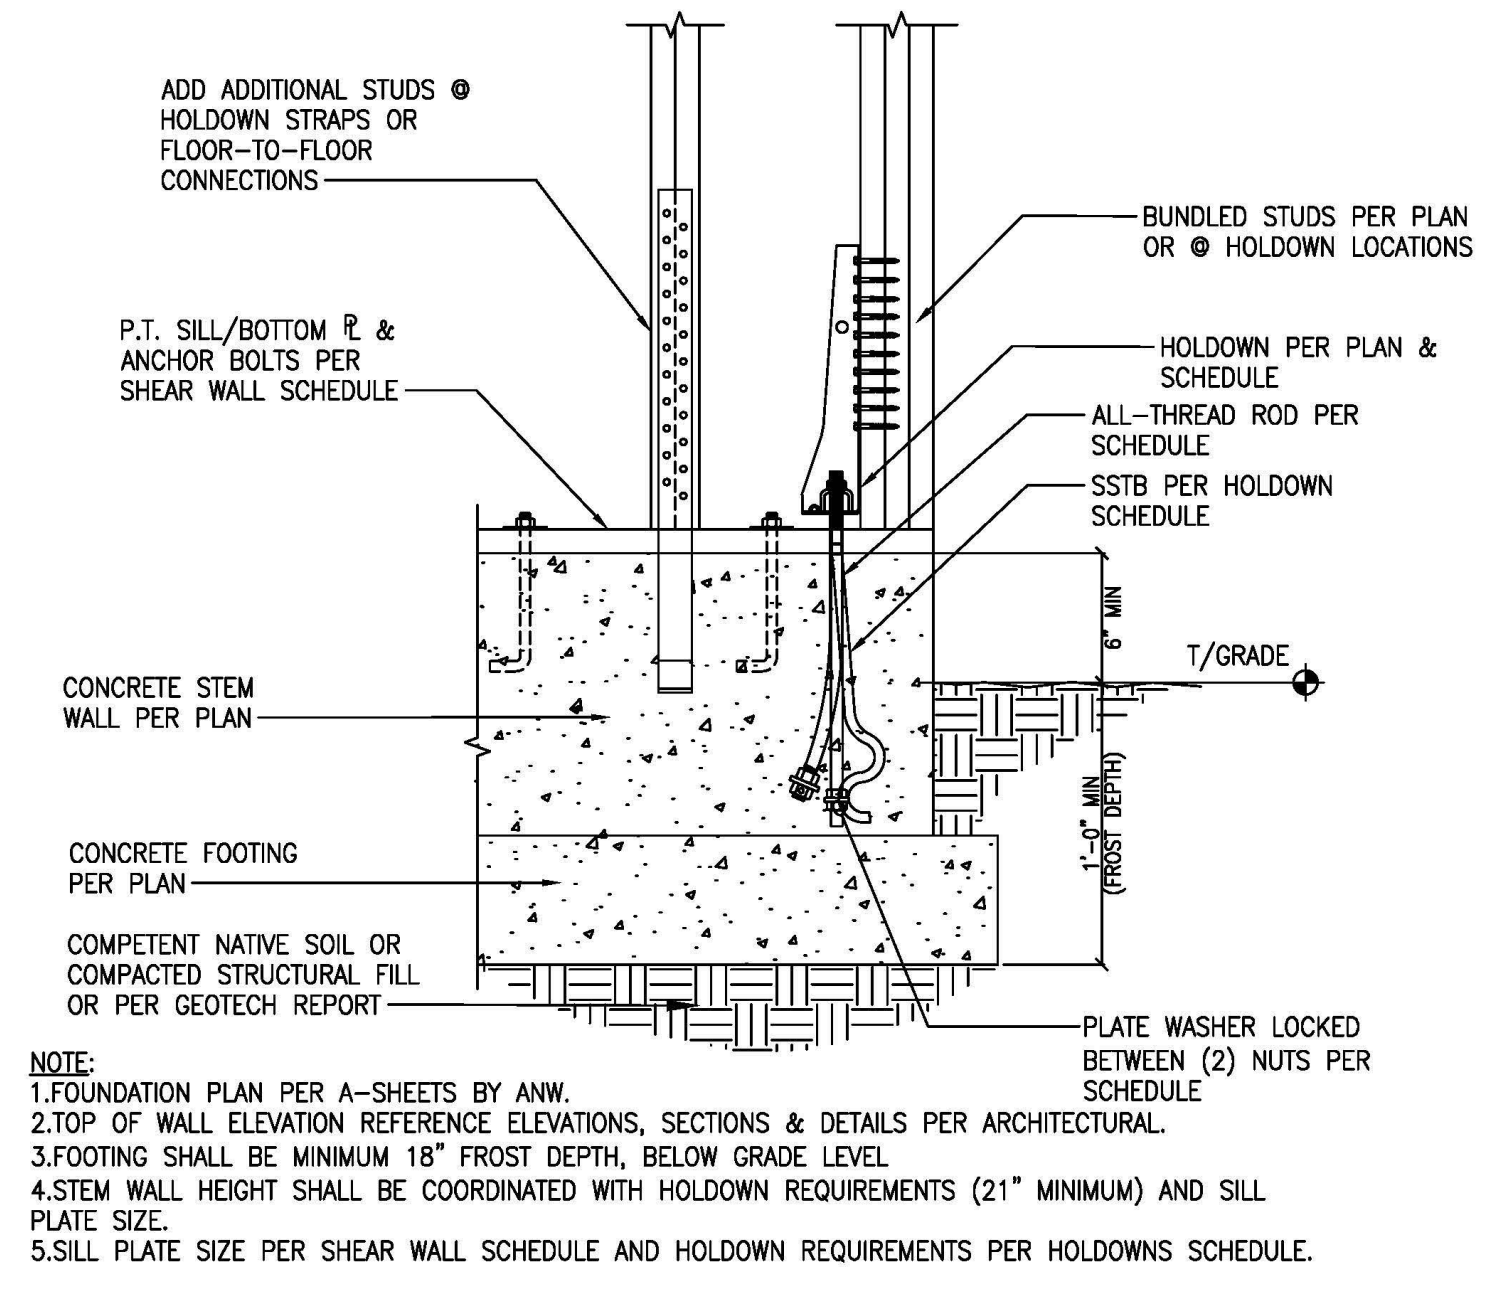


6 TYPICAL SHEAR WALL HOLDDOWN CONNECTION

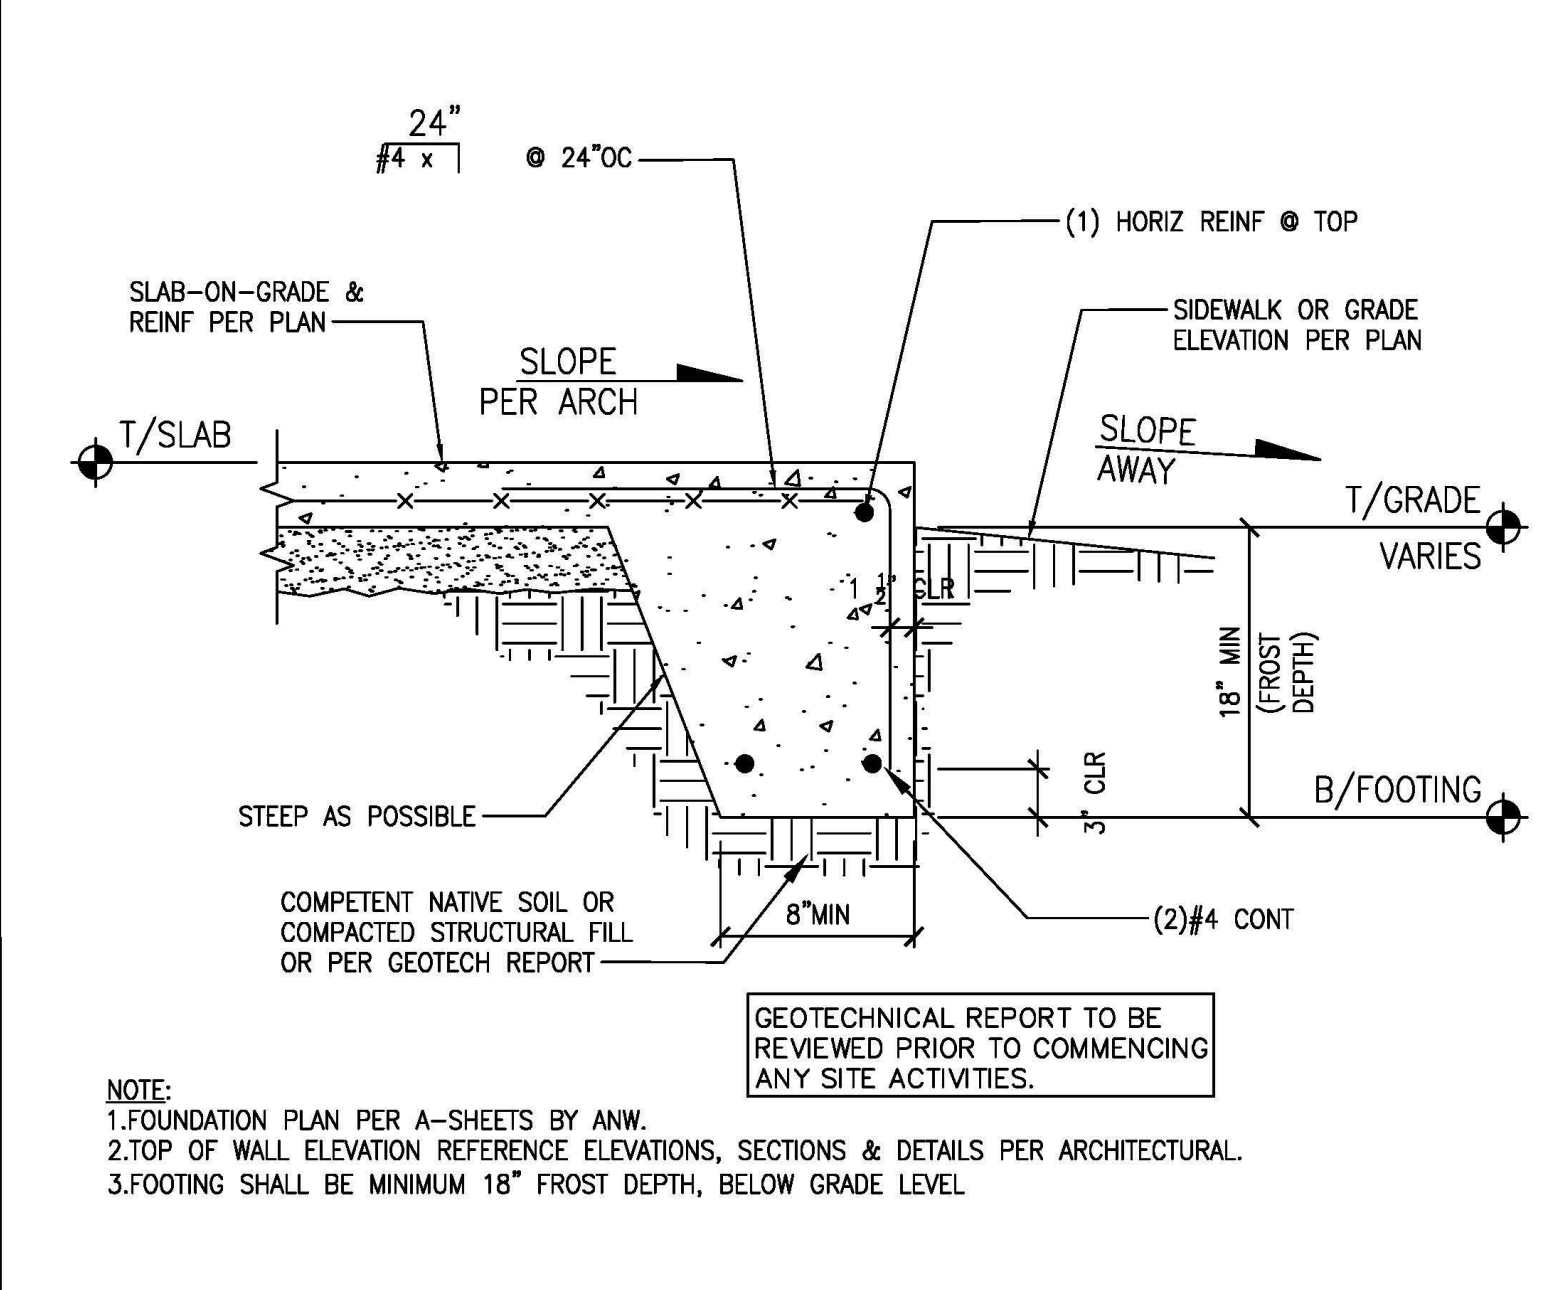


7 TYPICAL THICKENED SLAB EDGE FOOTING AT PATIO

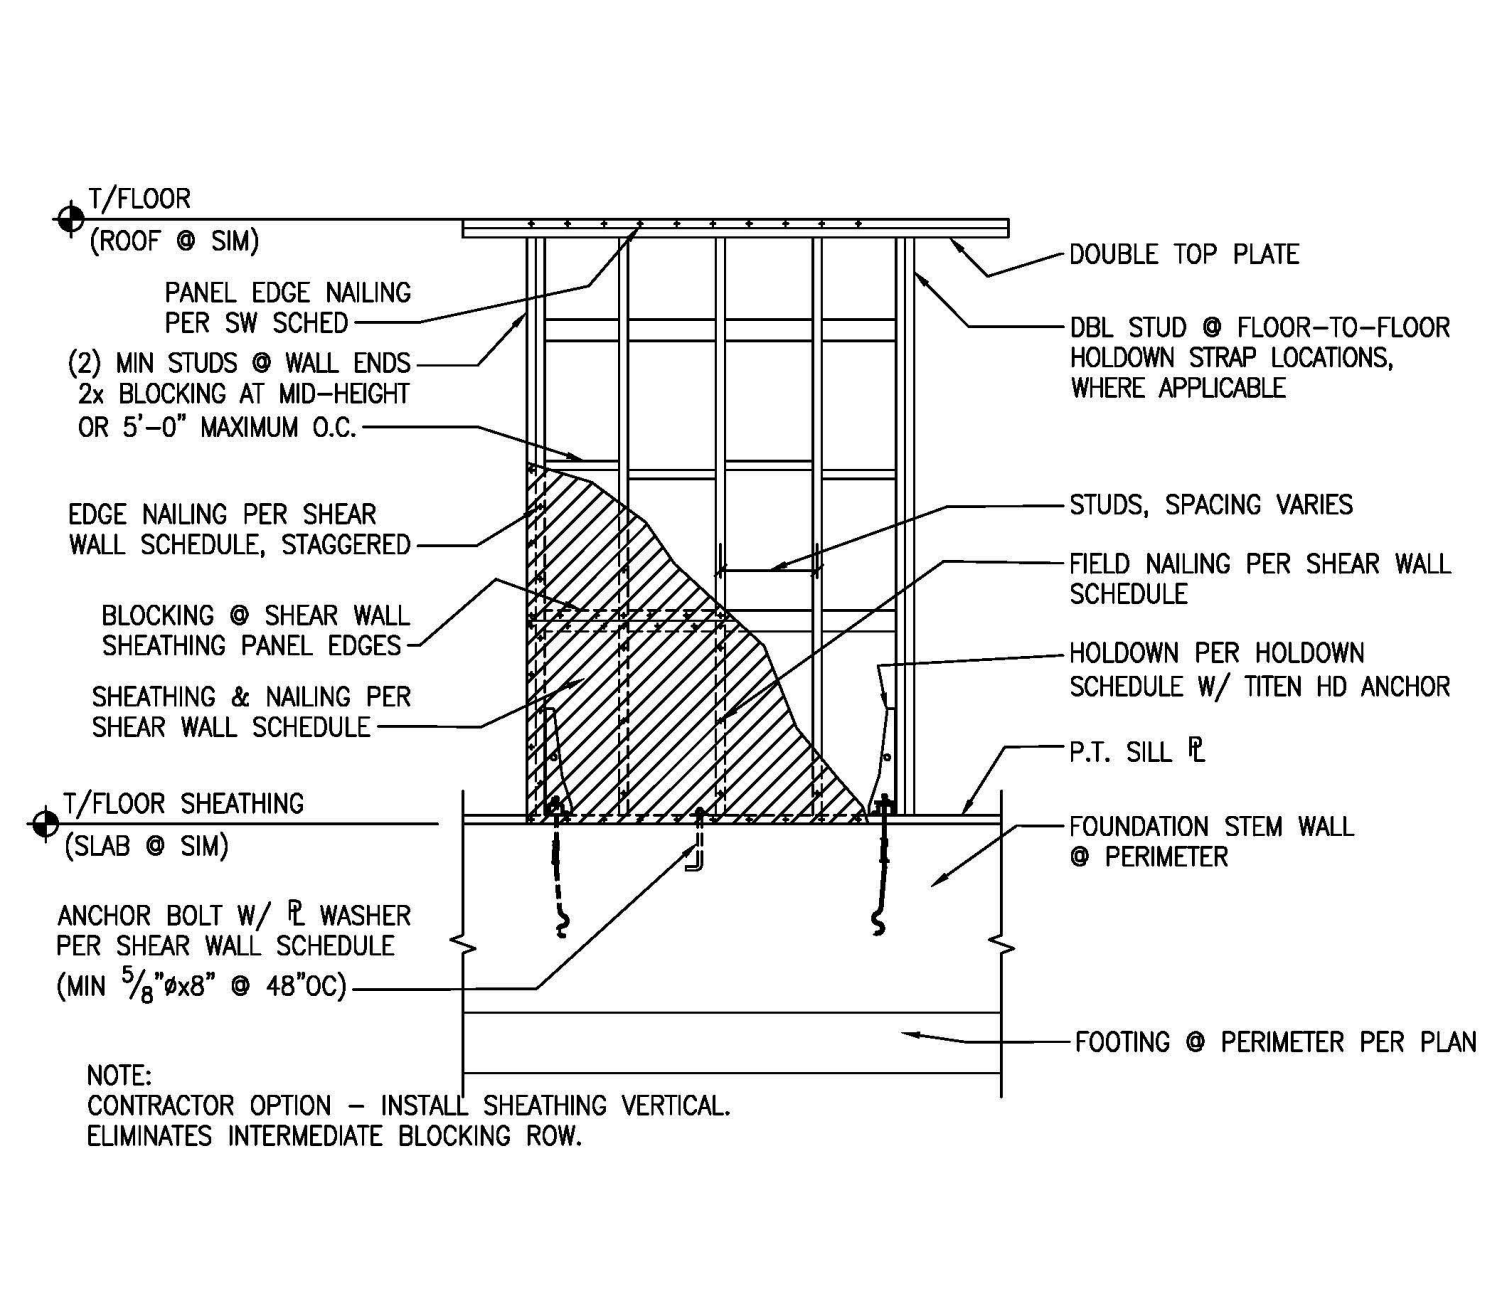


8 TYPICAL SHEAR WALL

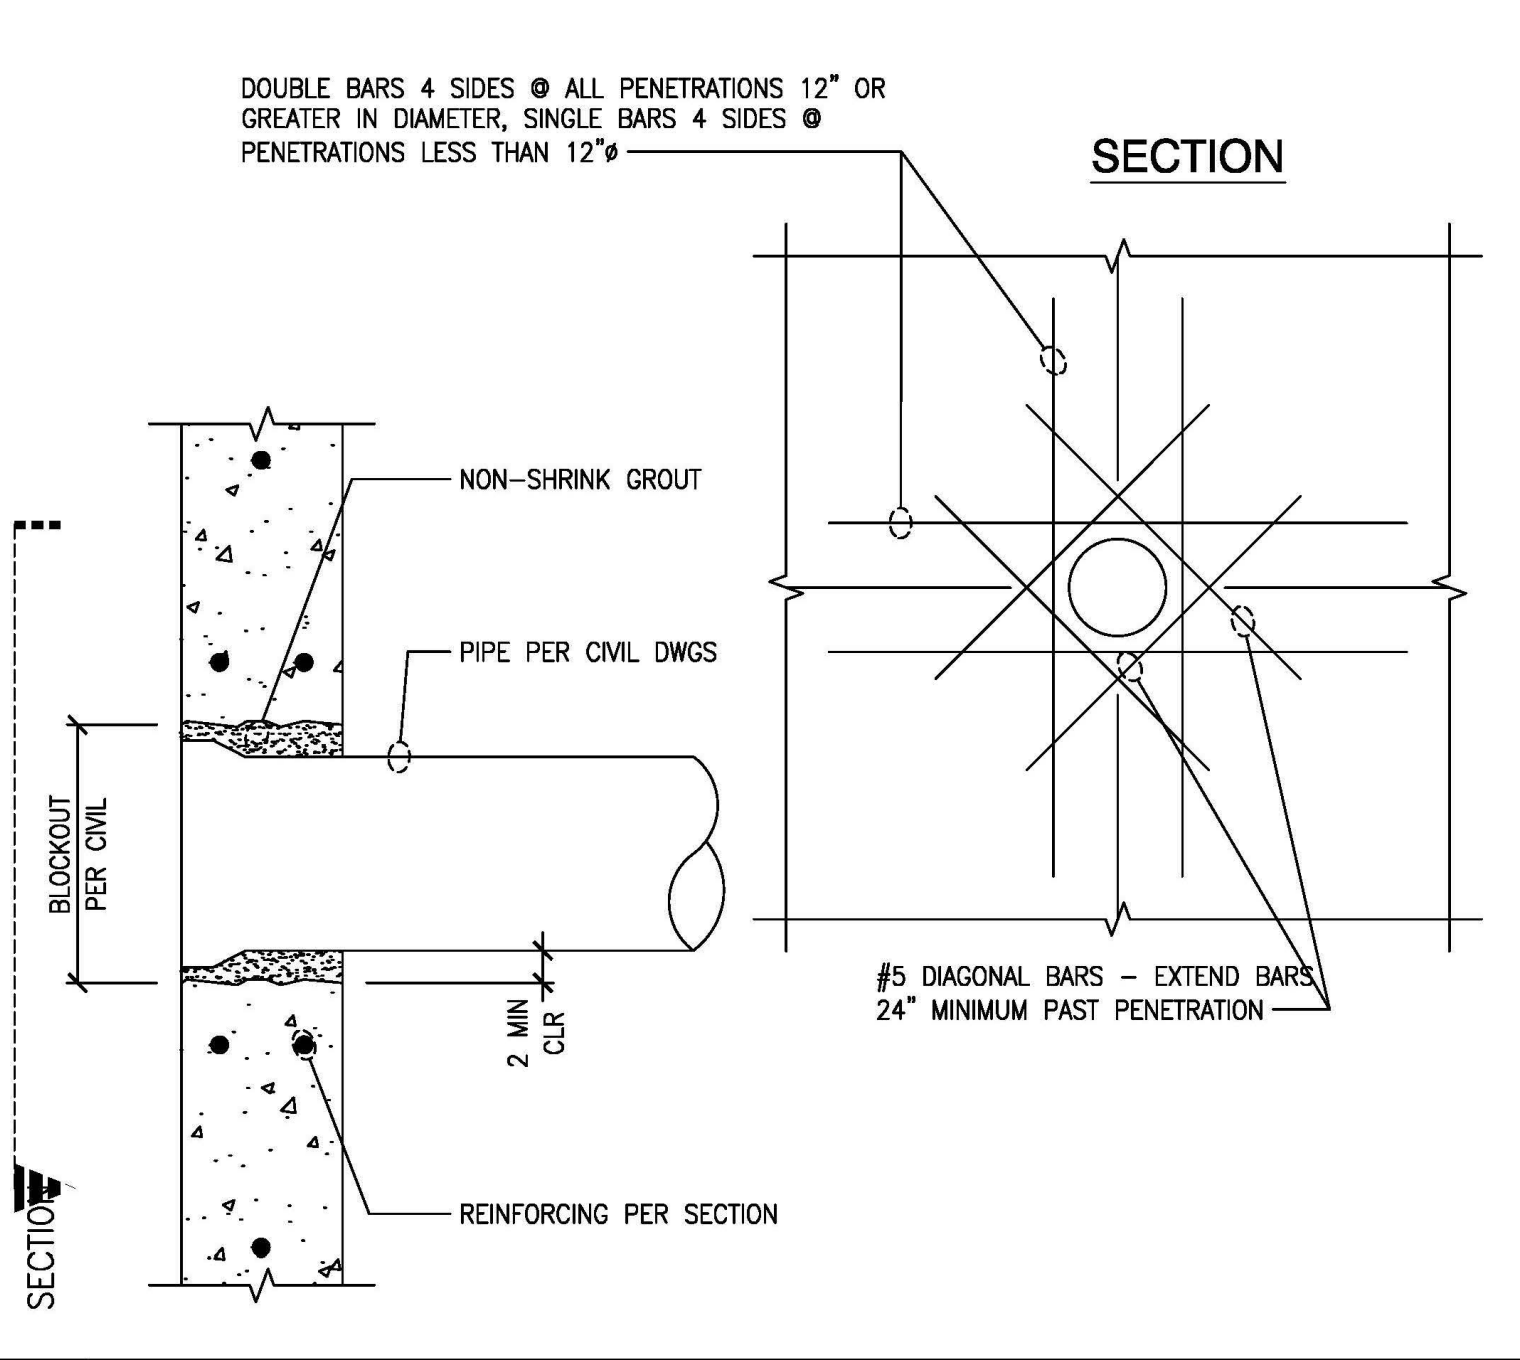


9 TYPICAL REINFORCEMENT AT WALL PENETRATIONS

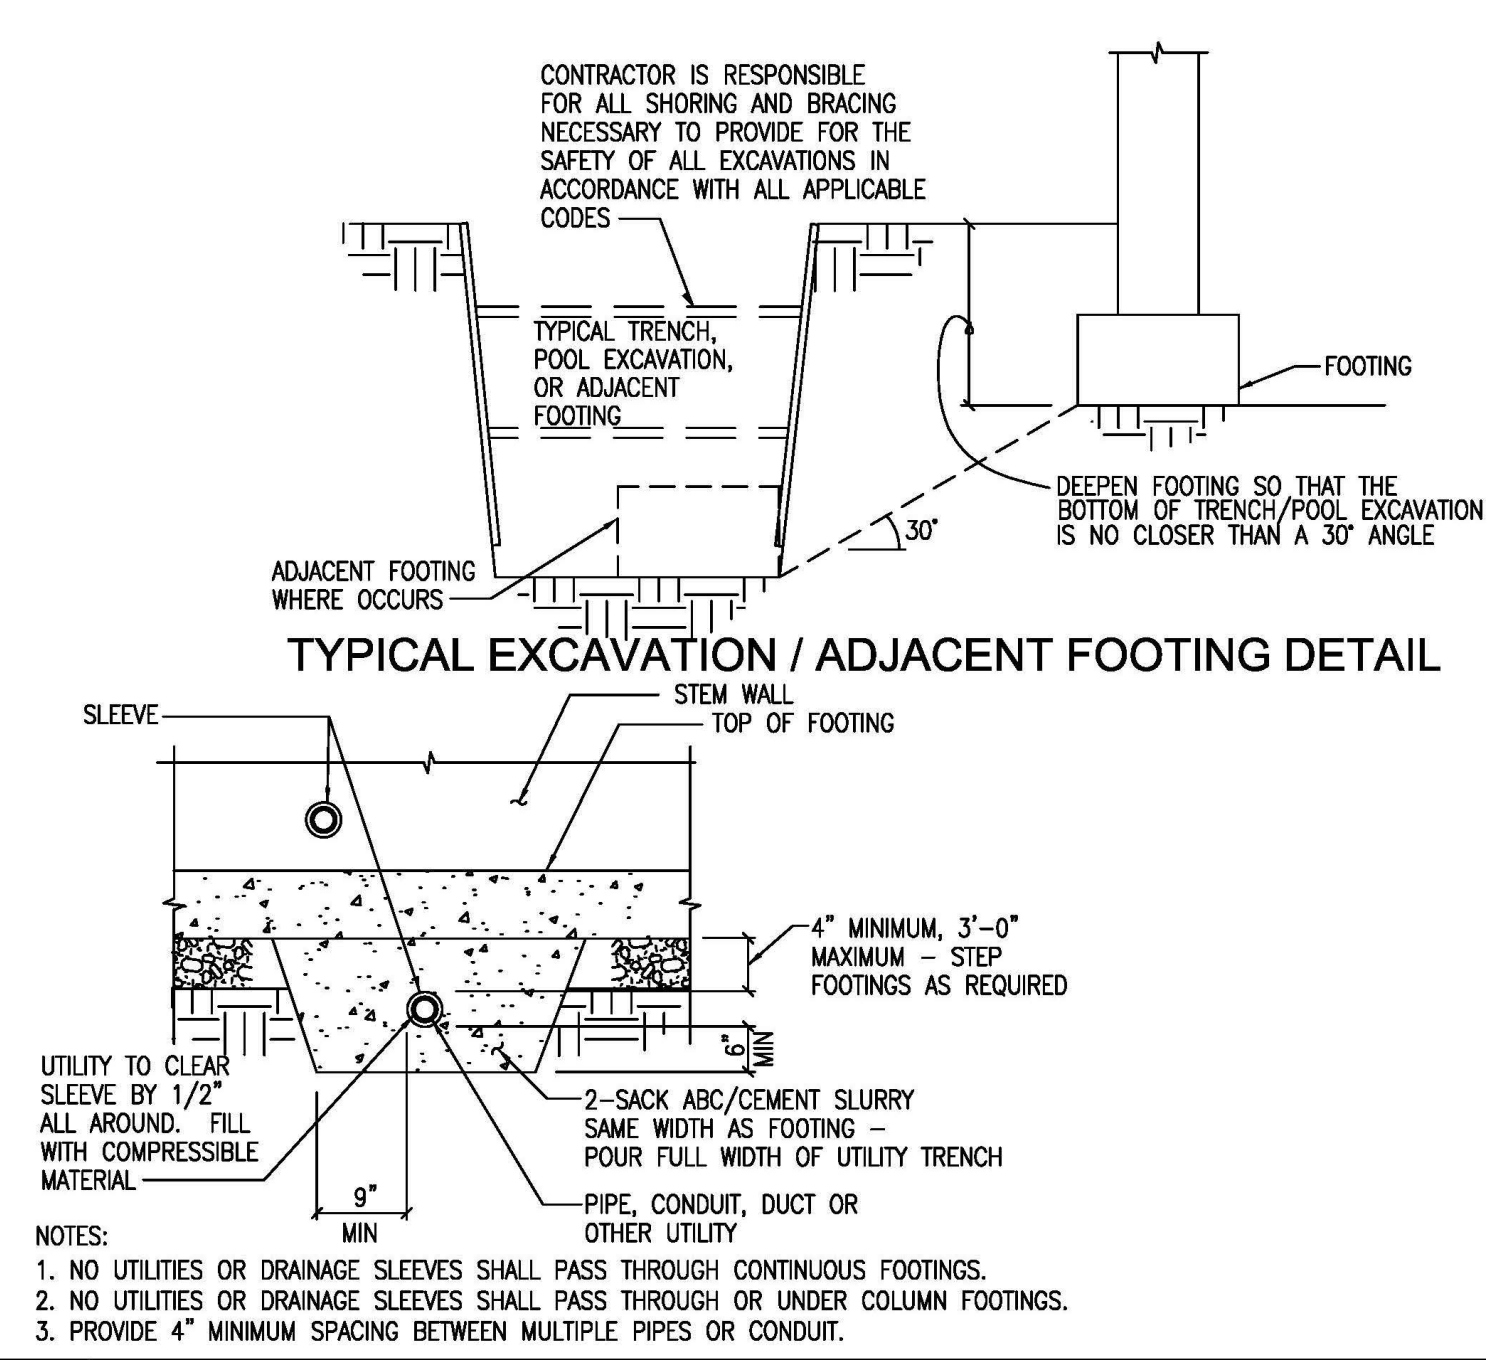

10 TYPICAL UTILITIES THROUGH STEM / UNDER FOOTING

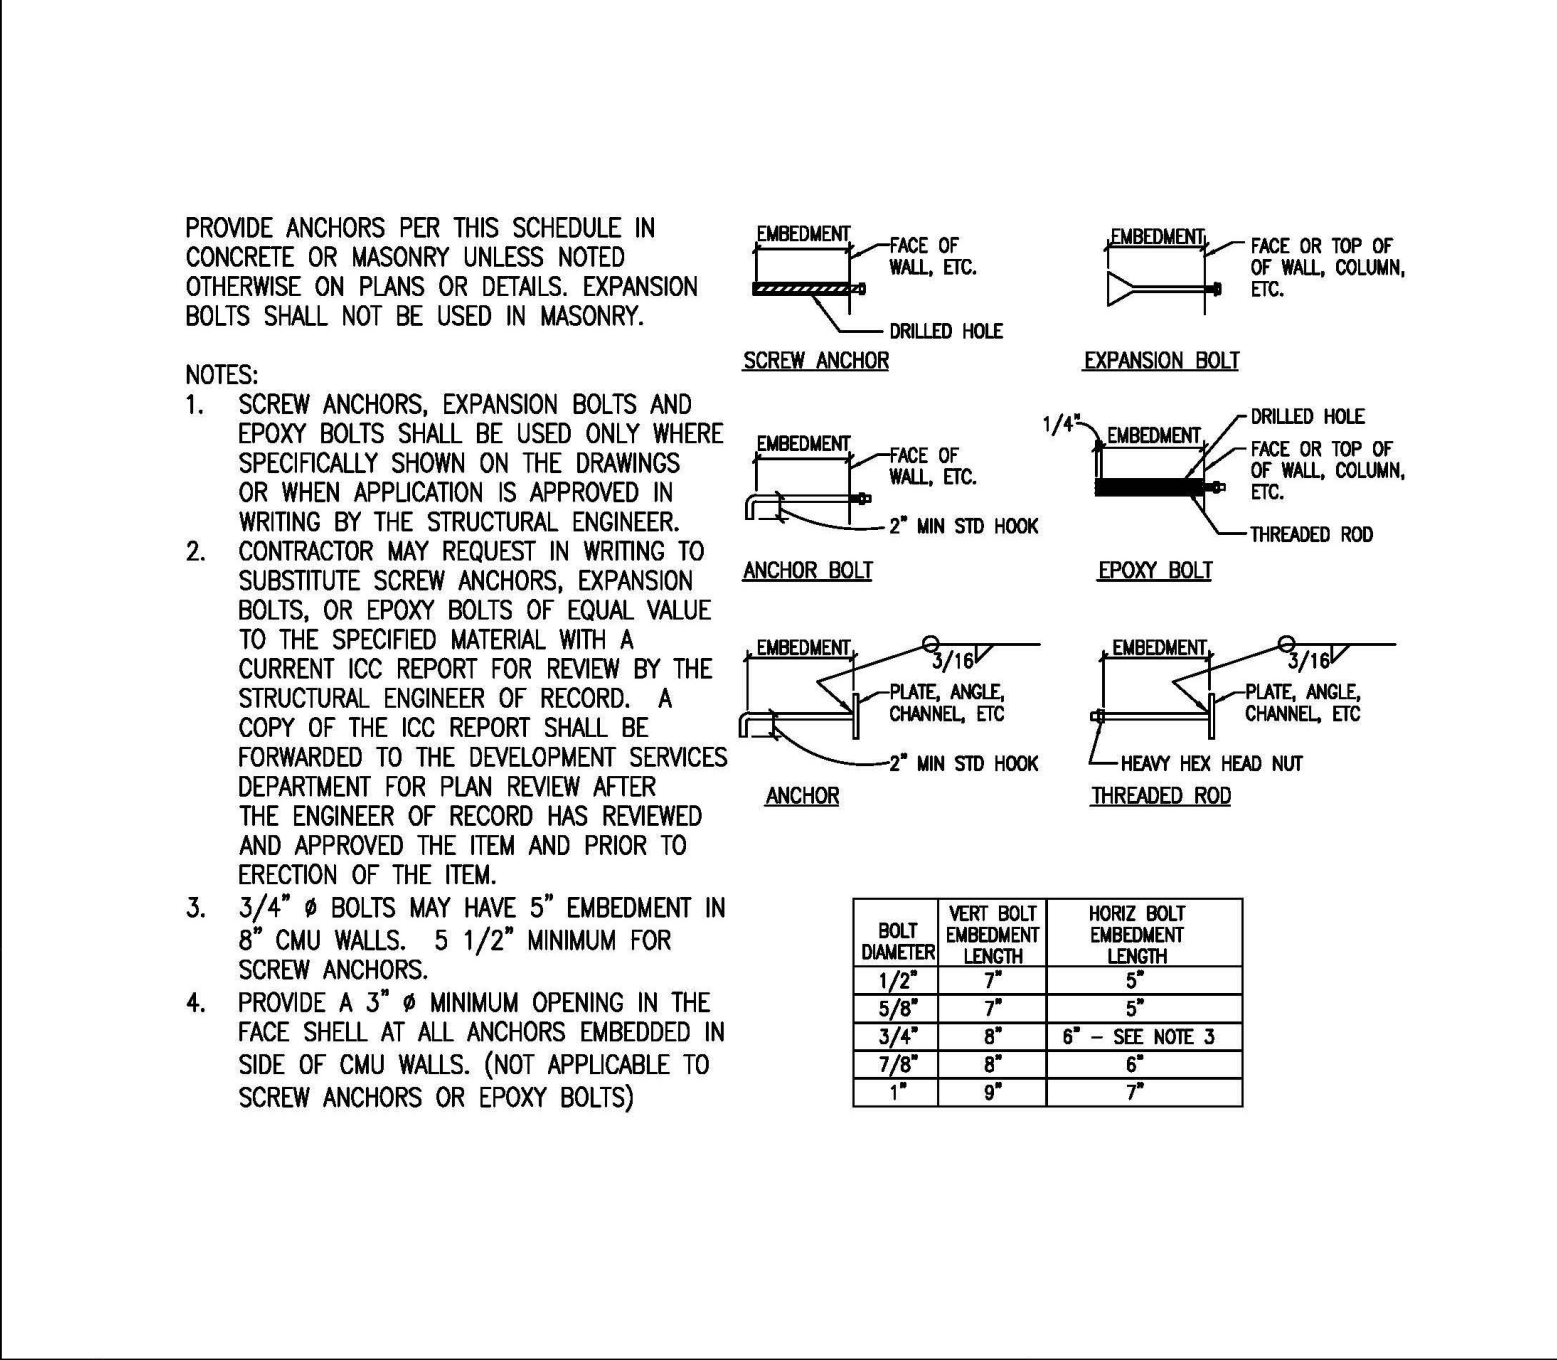

11 CONCRETE-IN-PLACE & POST-INSTALLED ANCHOR SCHEDULE

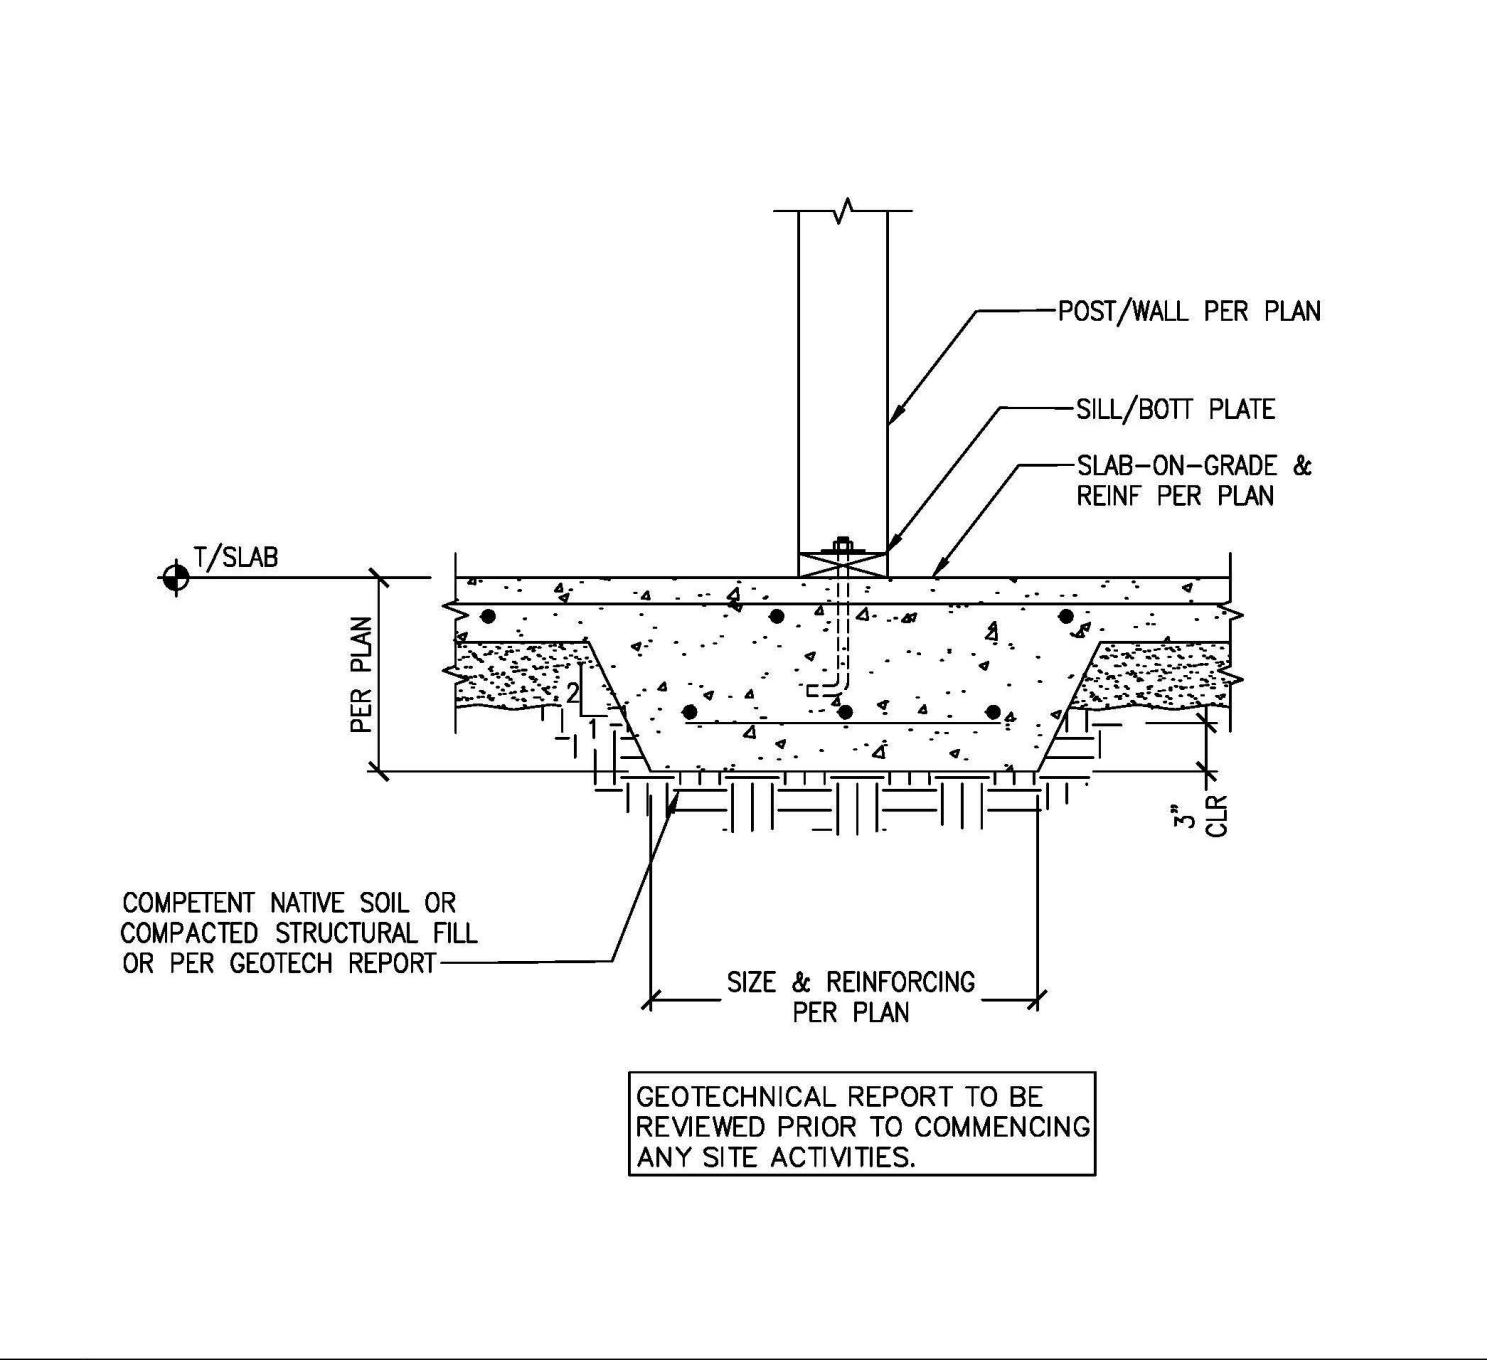

12 TYPICAL INTERIOR THICKENED SLAB FOOTING

PROJECT #: 25-120

ENGINEERED BY: GS

DATE: 6/25/25

ZVELT ENGINEERING DESIGN PLLC

STRUCTURAL ENGINEERING

721 4th AVE #794 KIRKLAND, WA 98033
Zvelt.Eng@outlook.com





PROJECT NAME: Long - DADU 6905 96th Ave SE Mercer Island, WA 98040

IBC 2021

LATERAL DETAILS

ANW 250052 LATERAL DETAILS

SHEET NUMBER: S 3

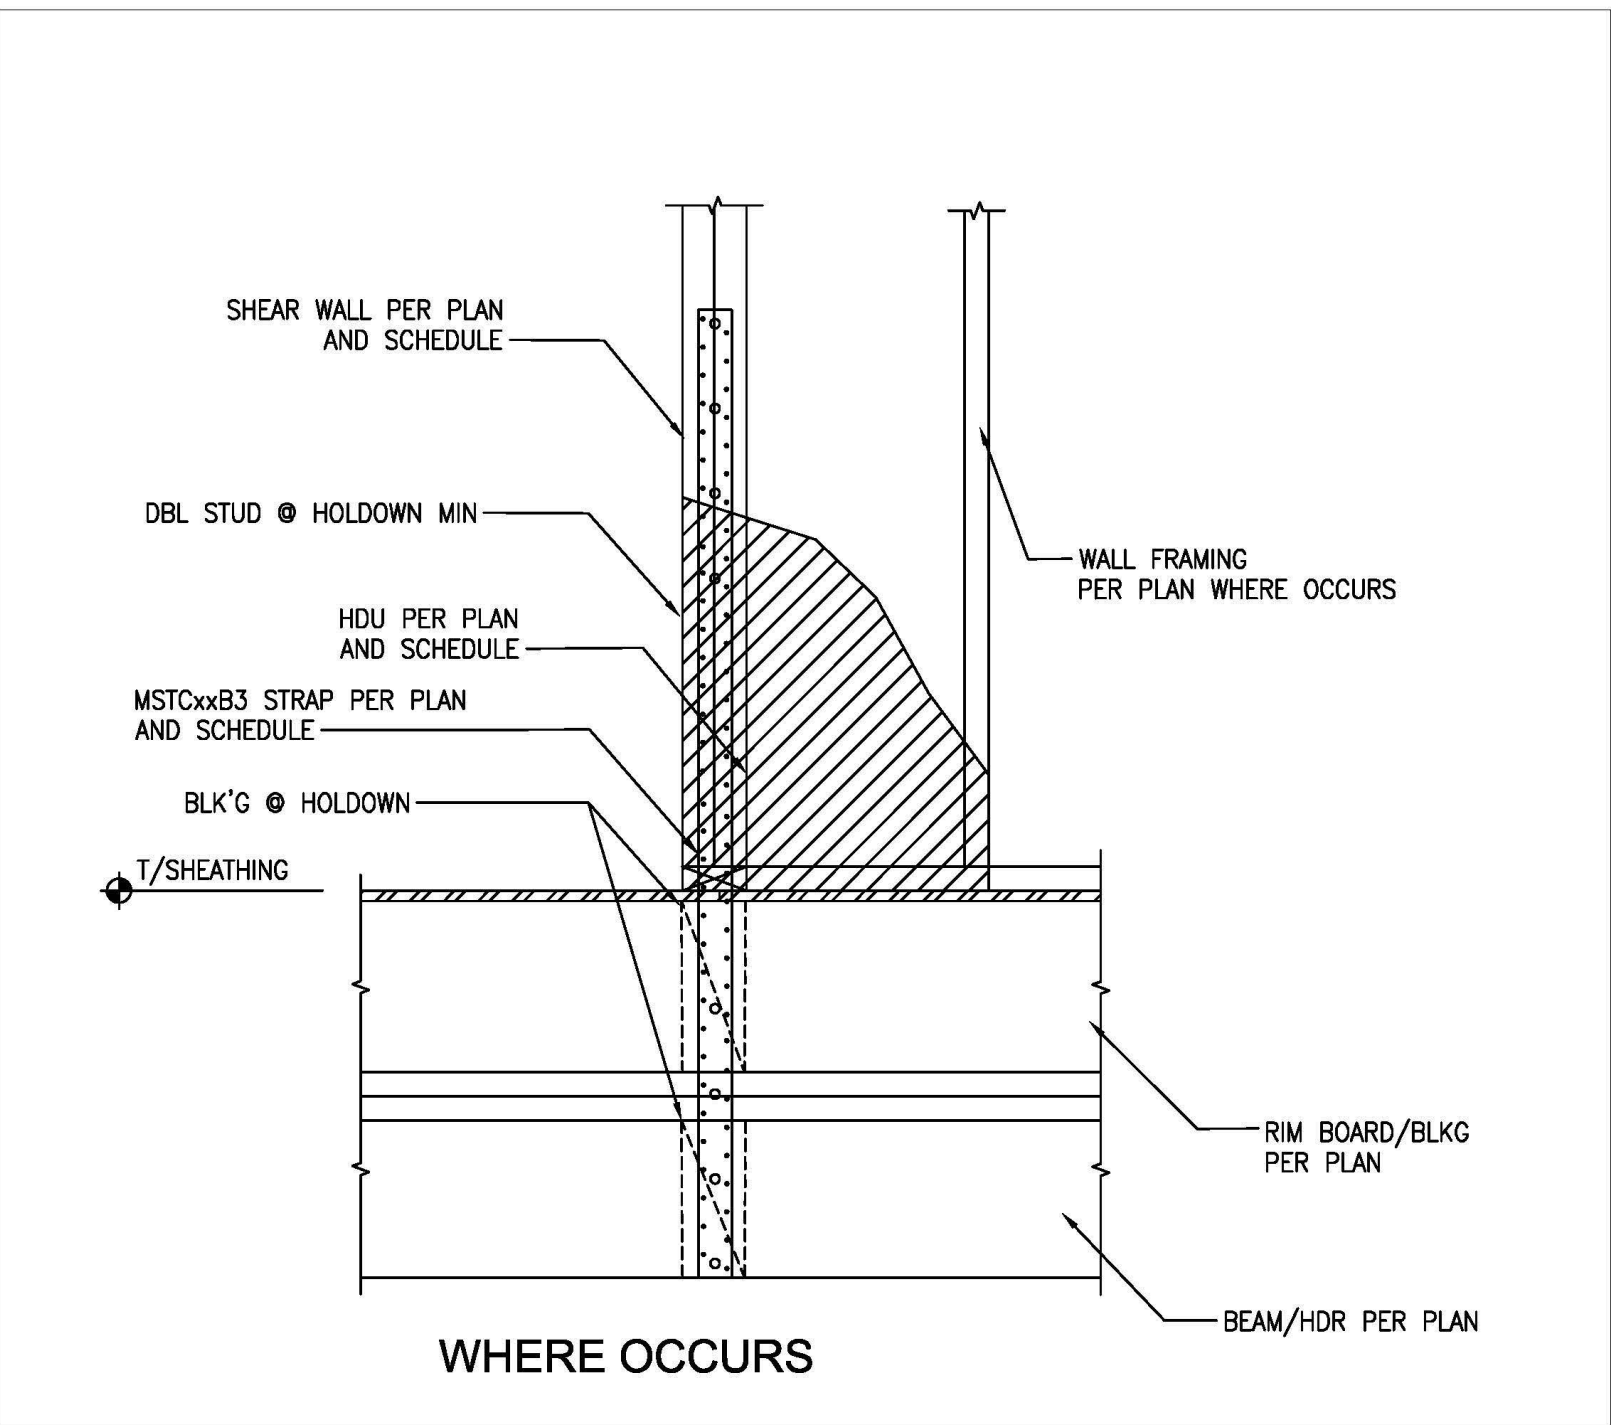
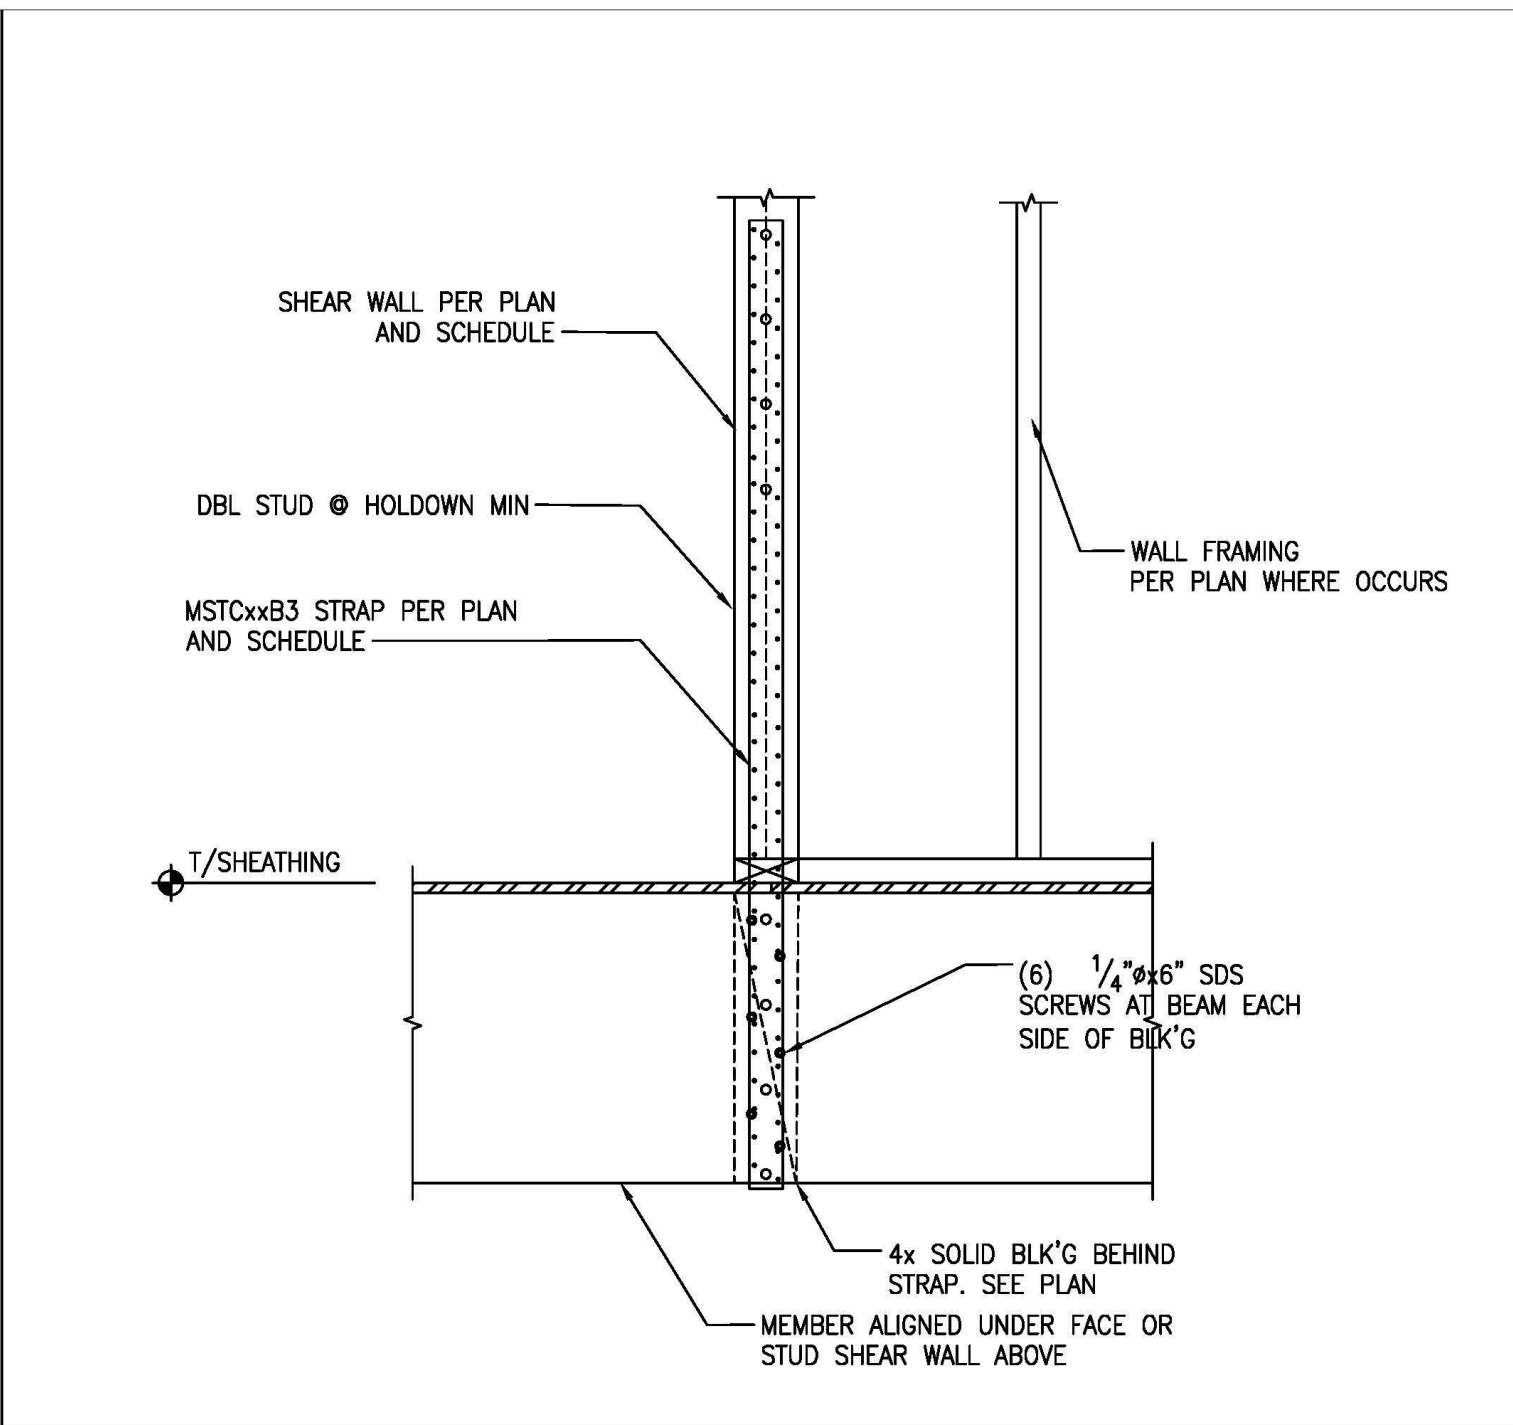
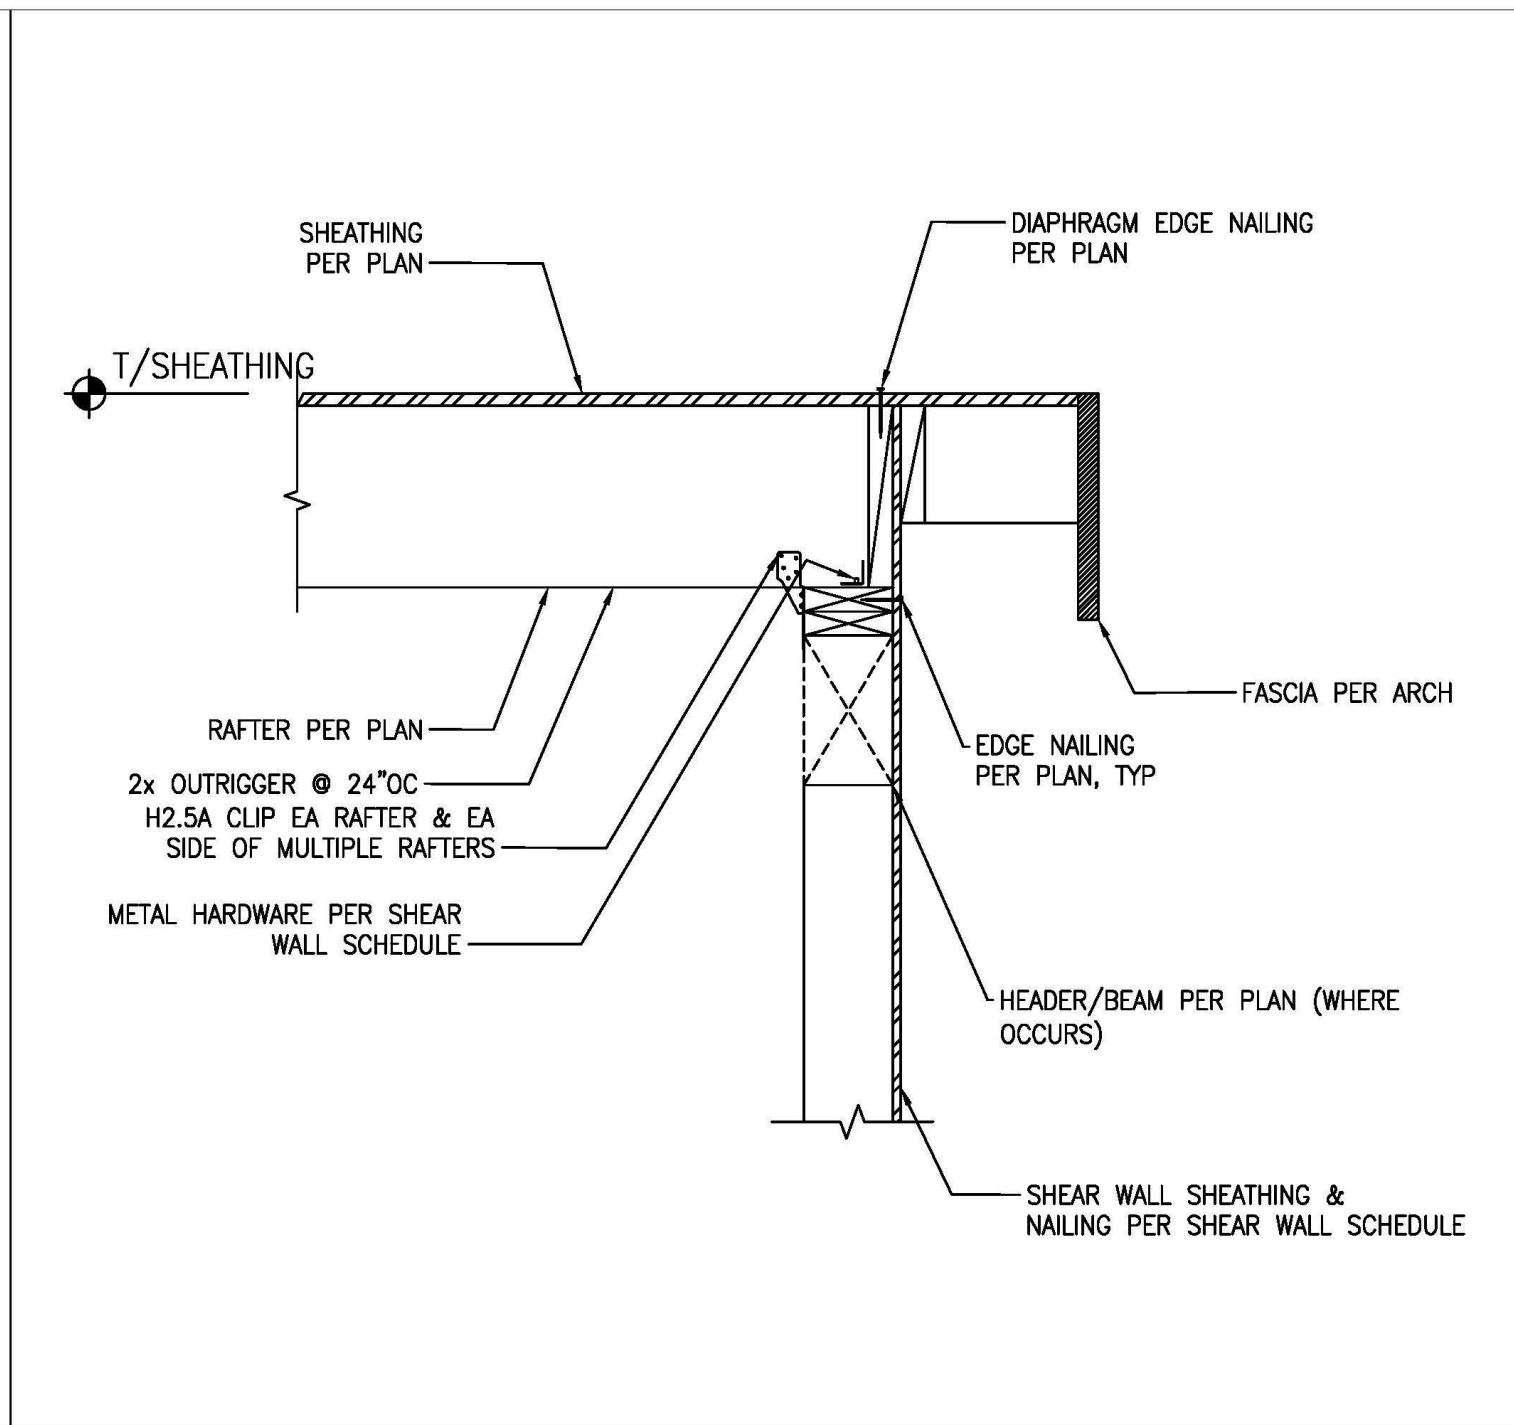
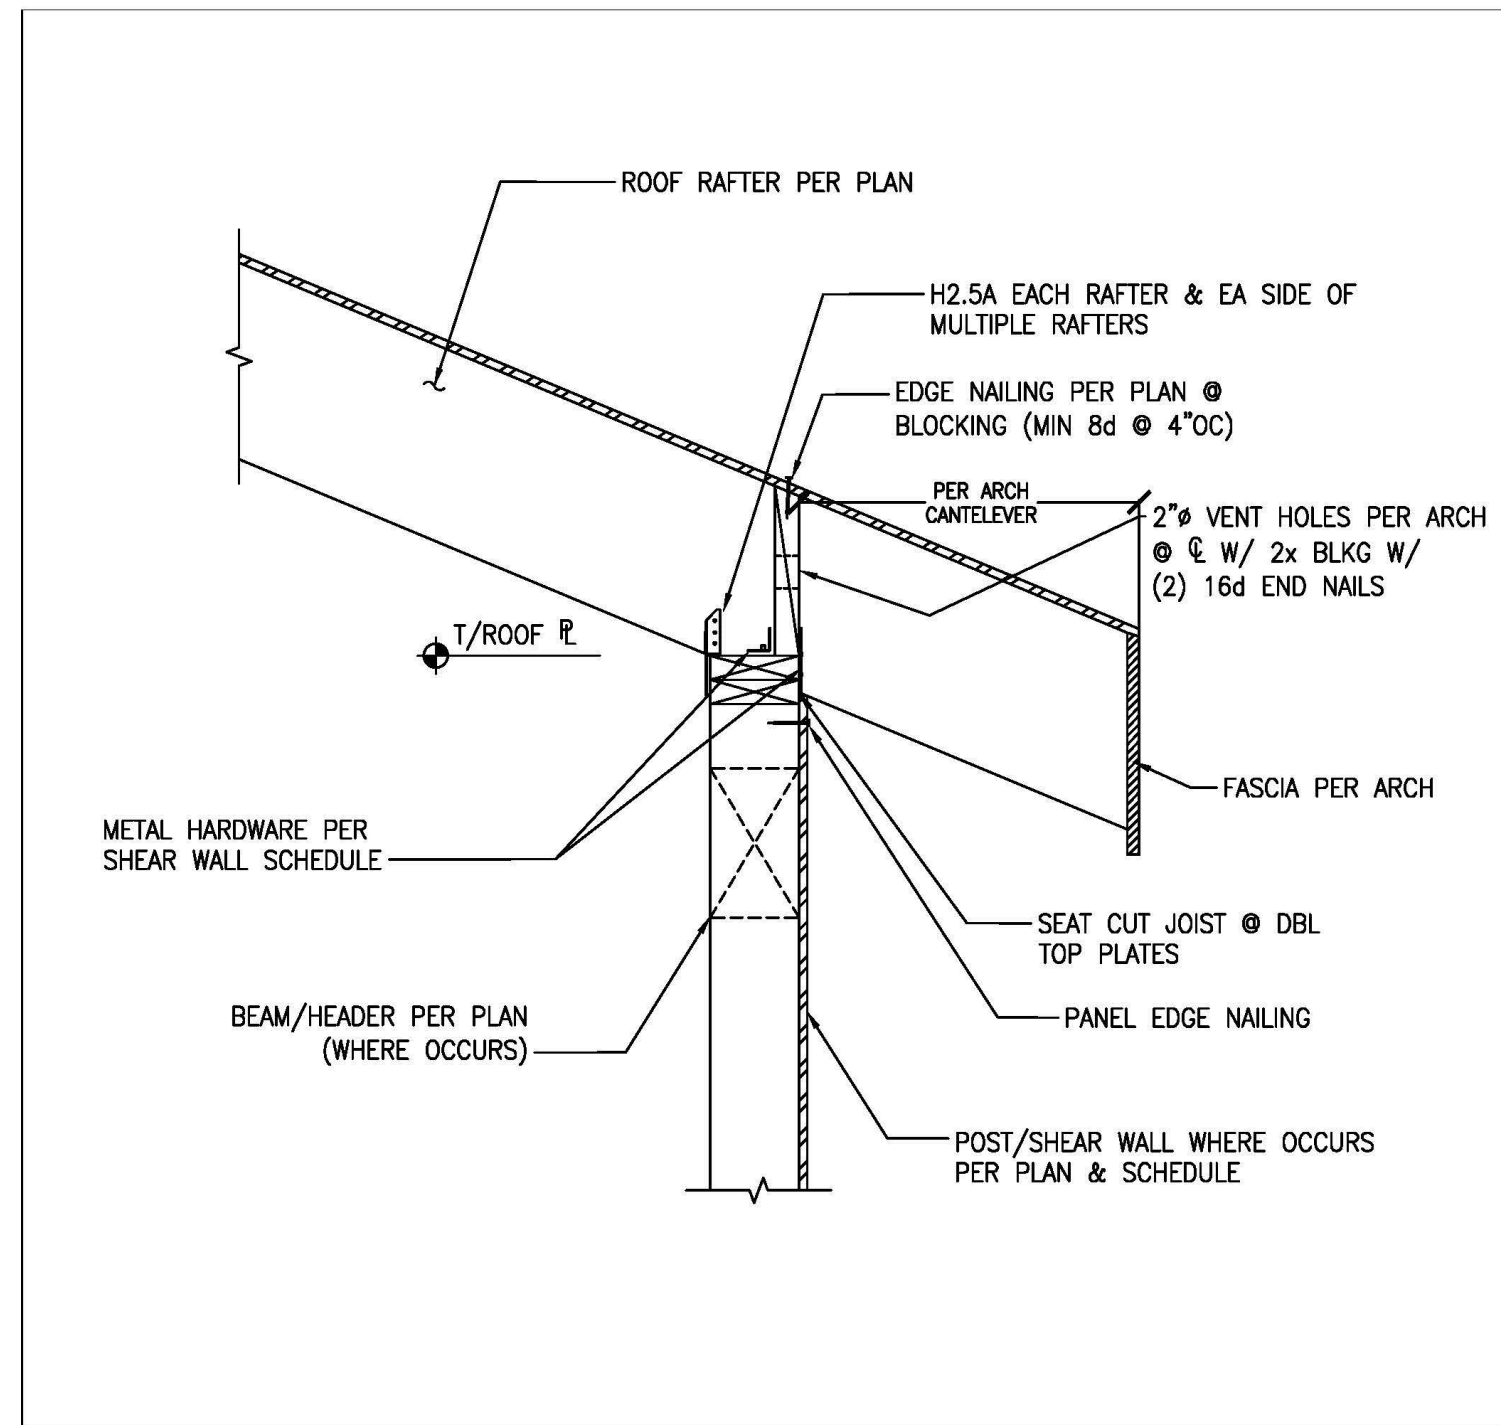


1 TYPICAL RAFTER CONNECTION DETAIL

2 TYPICAL EXT SHEAR WALL PERPENDICULAR TO RAFTERS

3 TYPICAL SHEAR WALL HOLDOWN AT FLOOR MEMBER

4 TYPICAL SHEAR WALL HOLDOWN AT FLOOR MEMBER

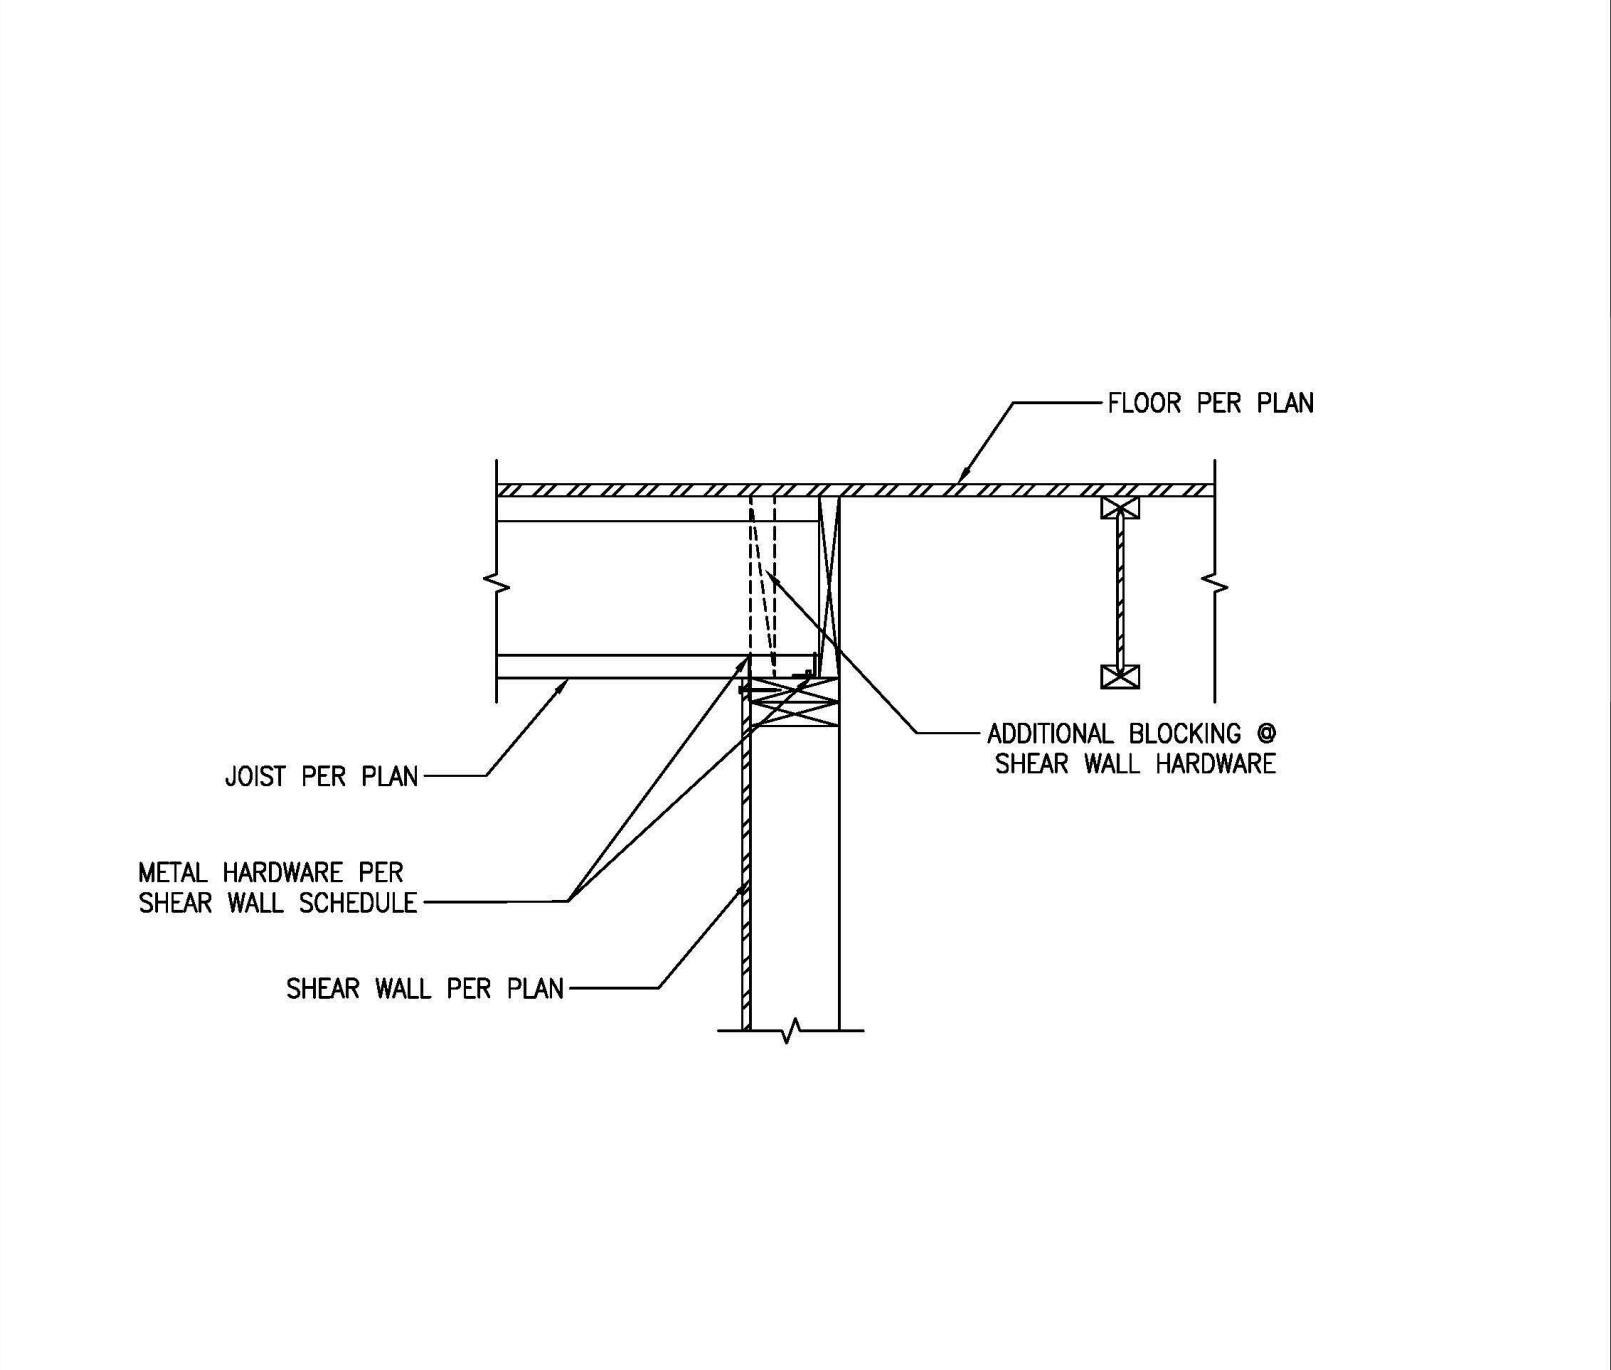
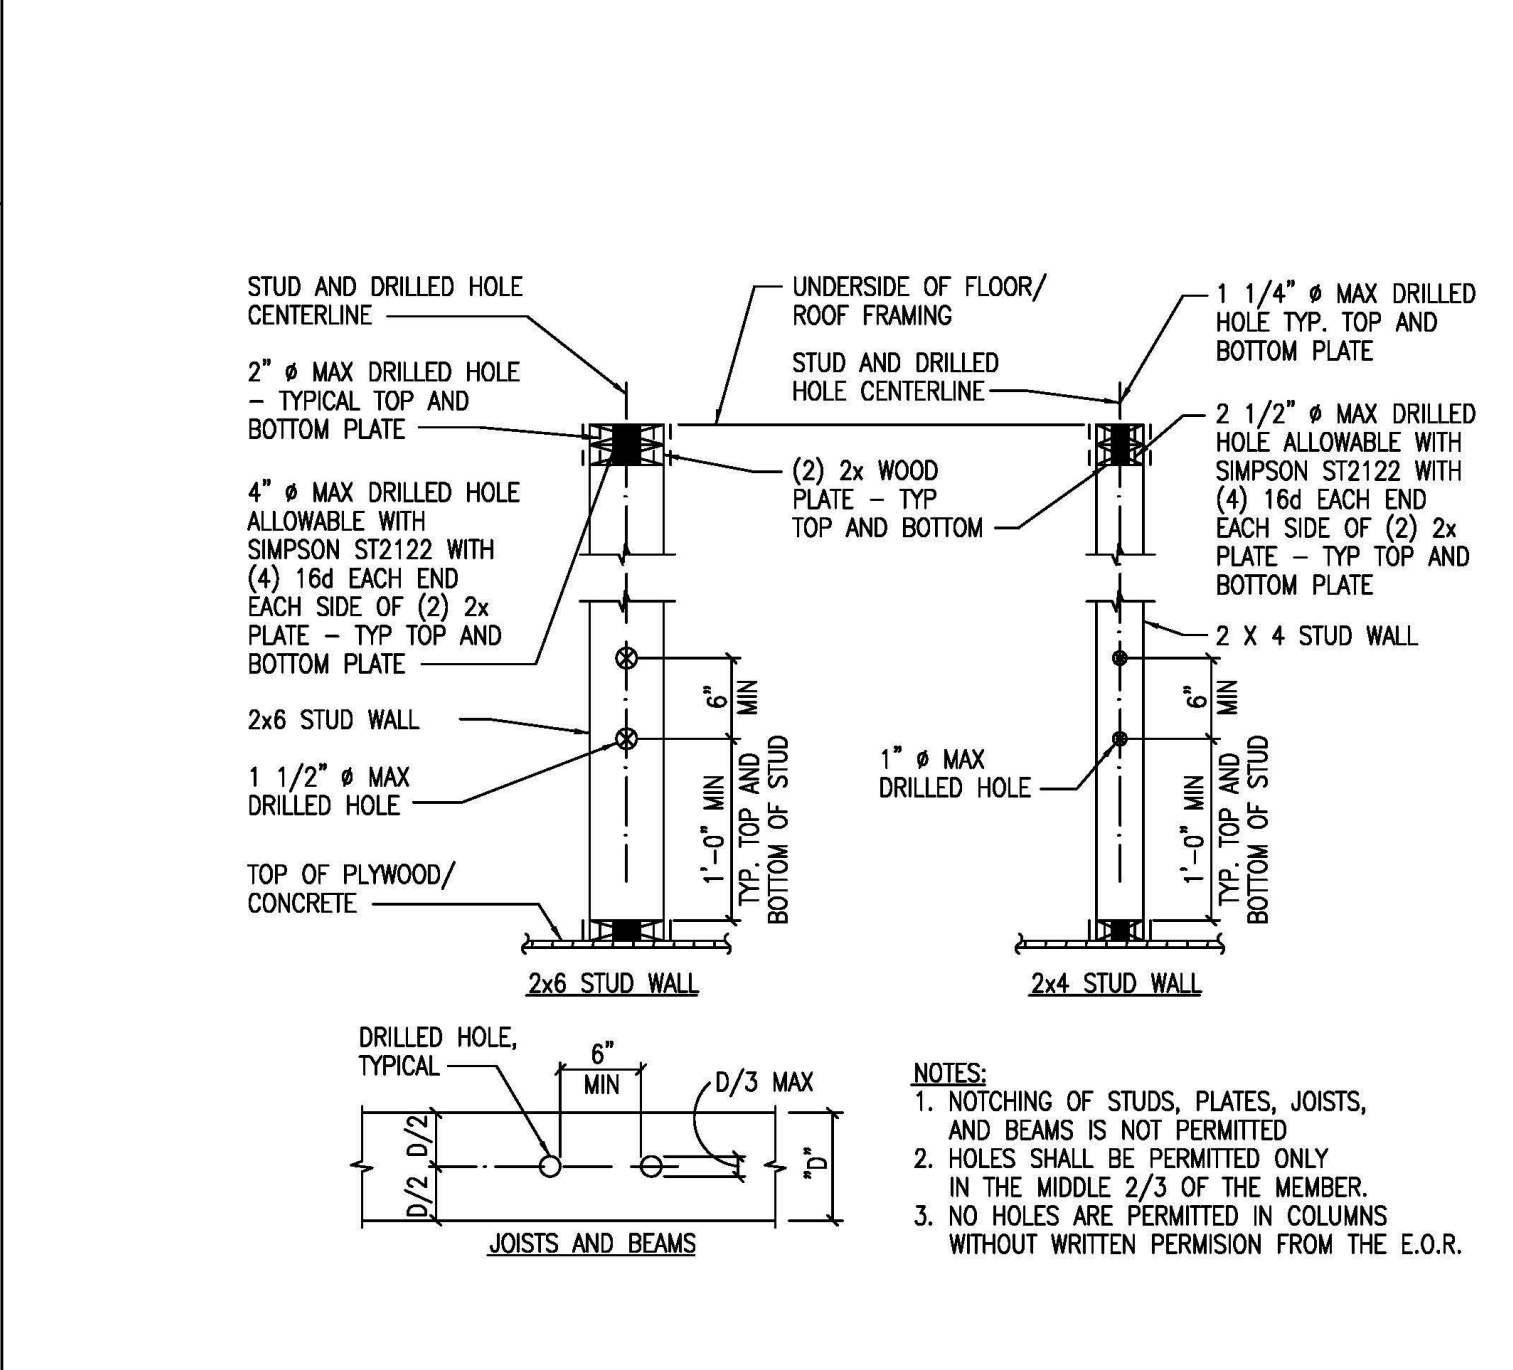
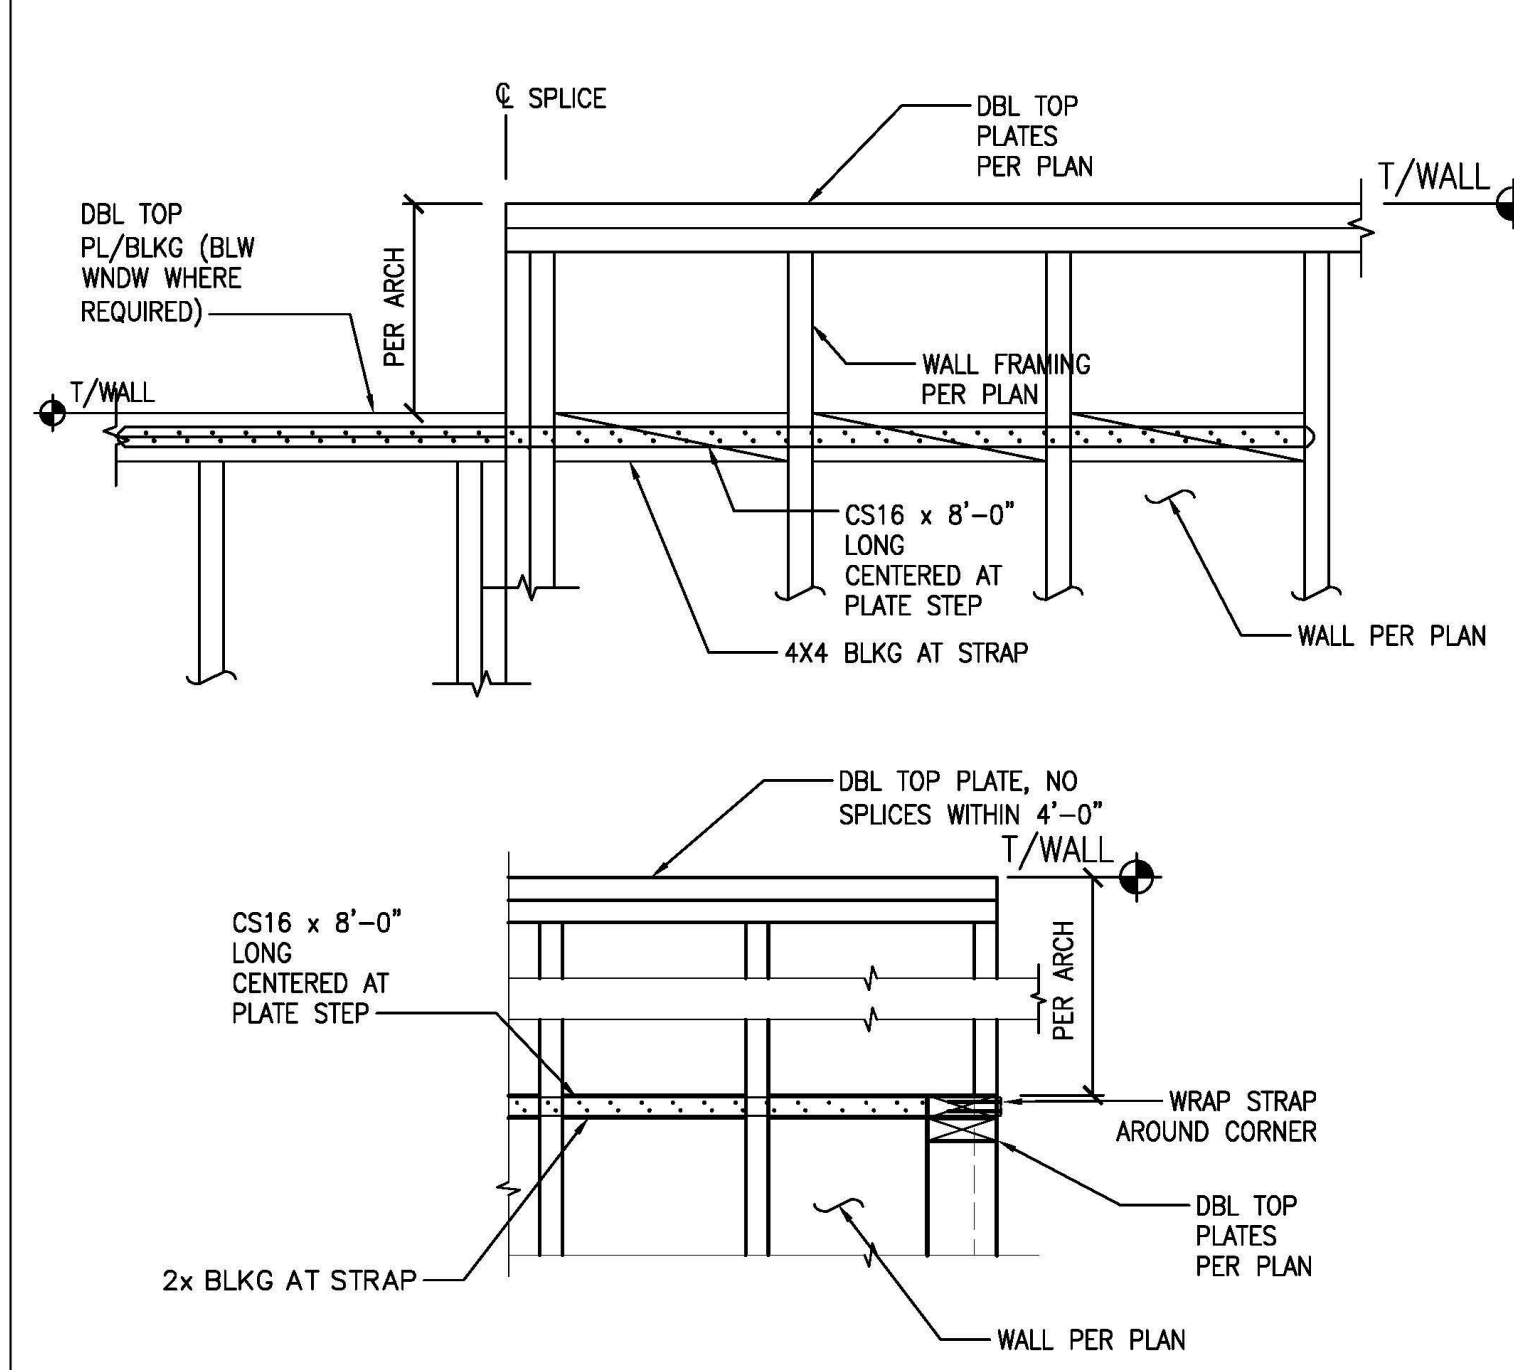
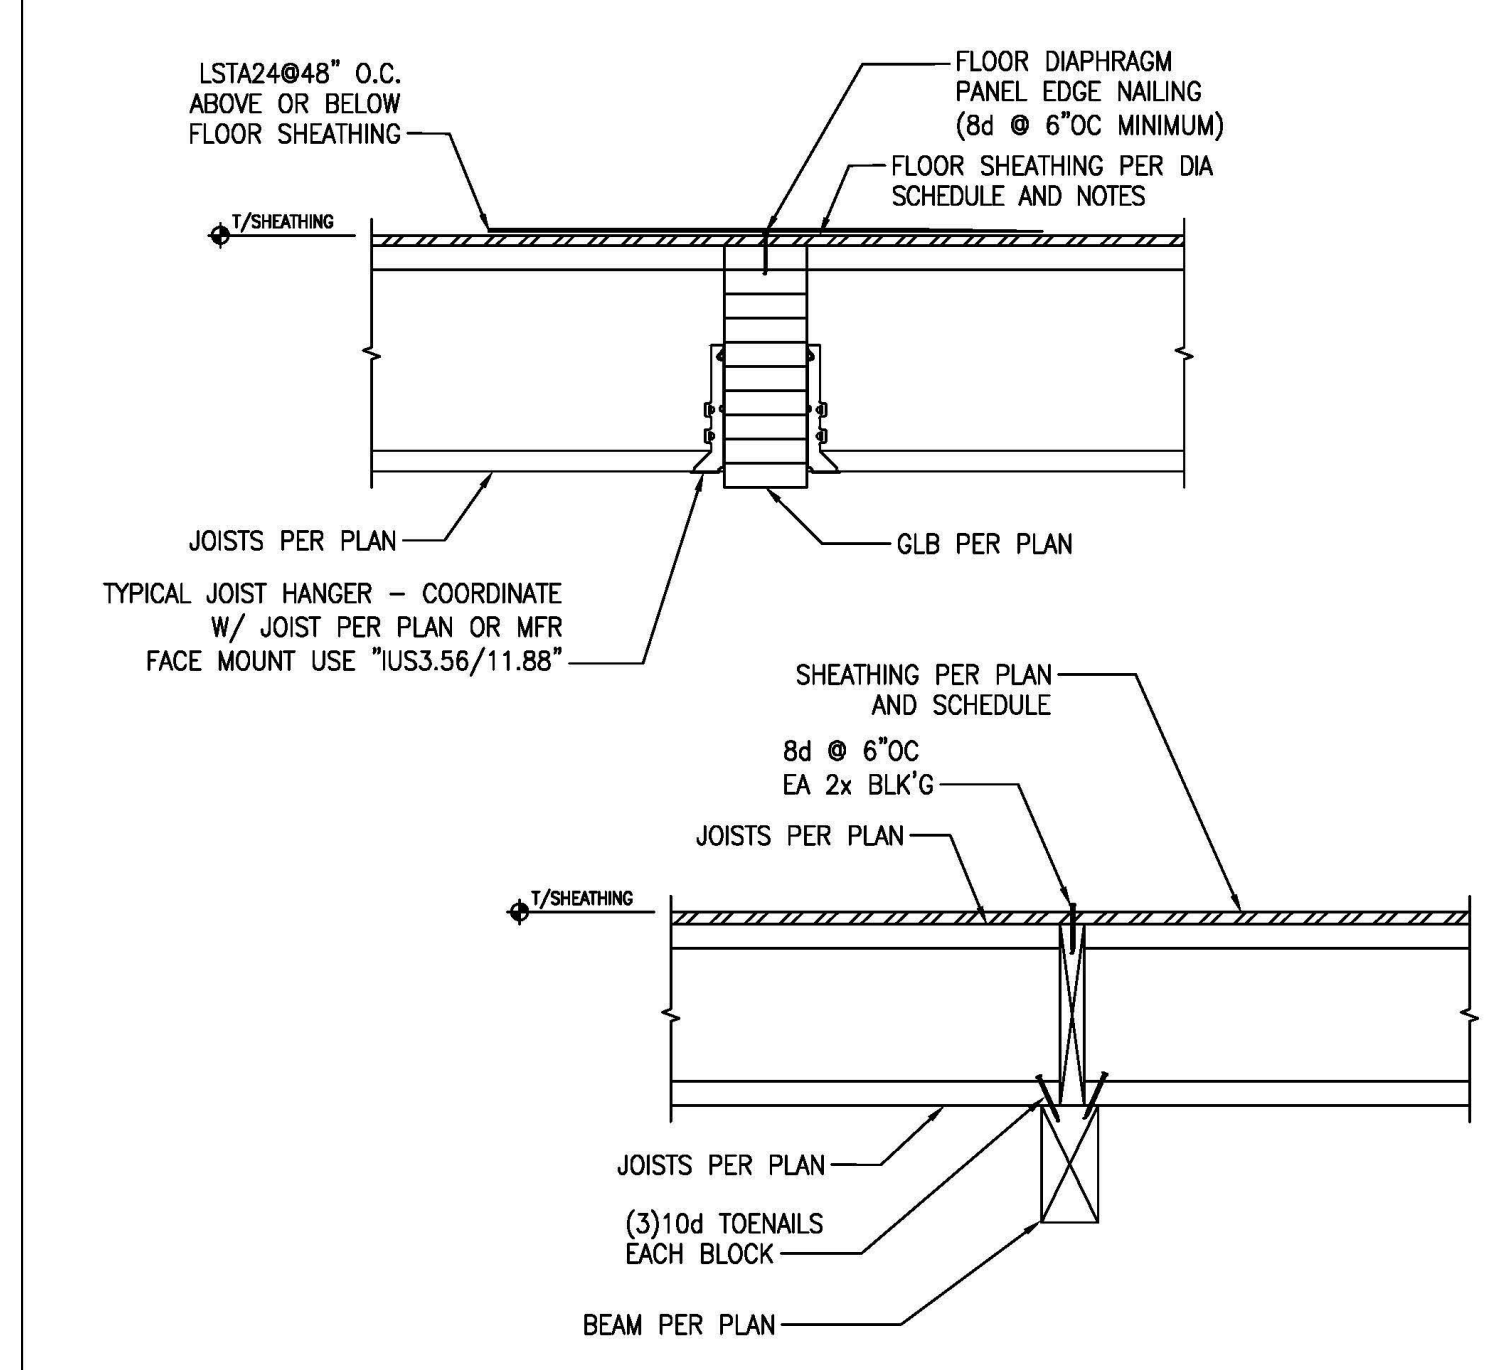


5 TYPICAL FLUSH AND DROPPED BEAM

6 TYPICAL STRAPPING AT DISCONTINUOUS PLATES

7 TYPICAL HOLES IN STUDS - PLATES - JOISTS - BEAMS

8 TYPICAL EXT. SHEAR WALL PERPENDICULAR TO FLOOR JOISTS

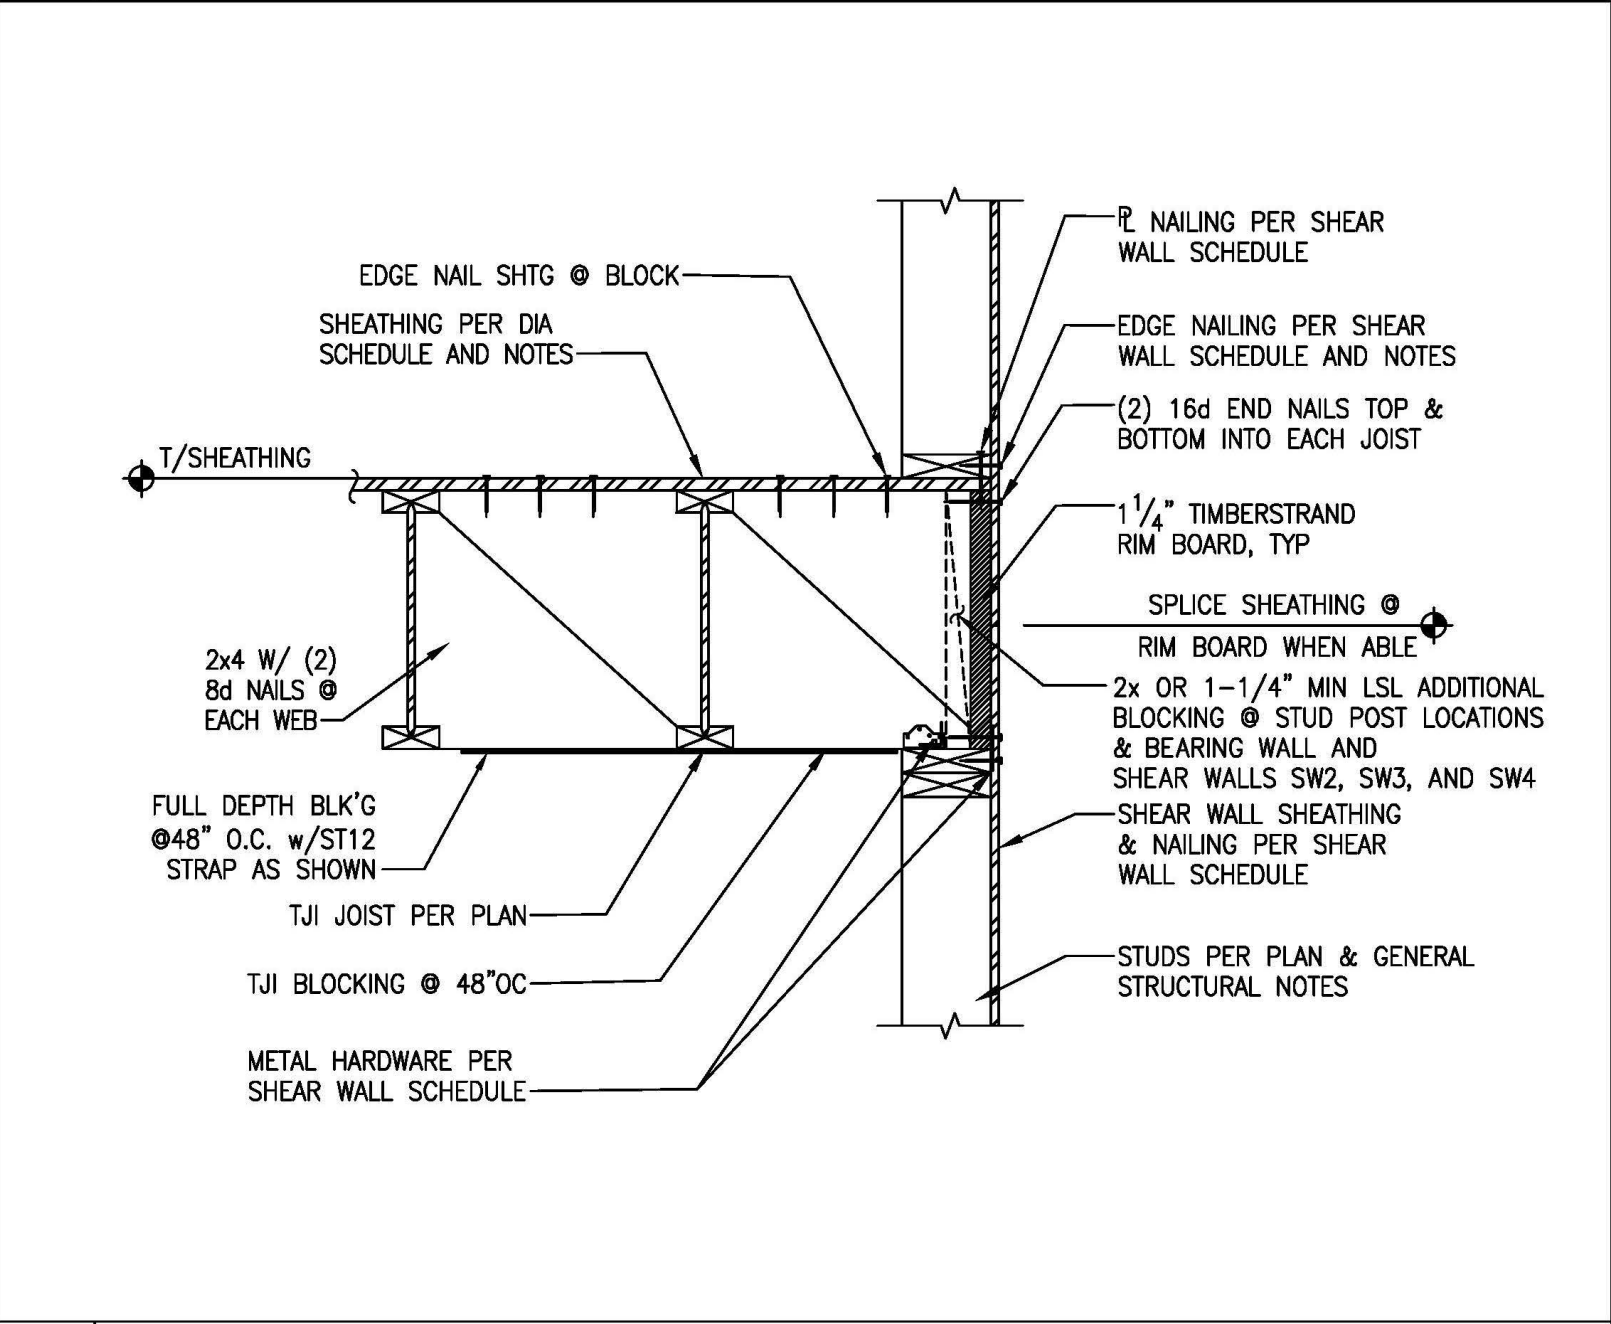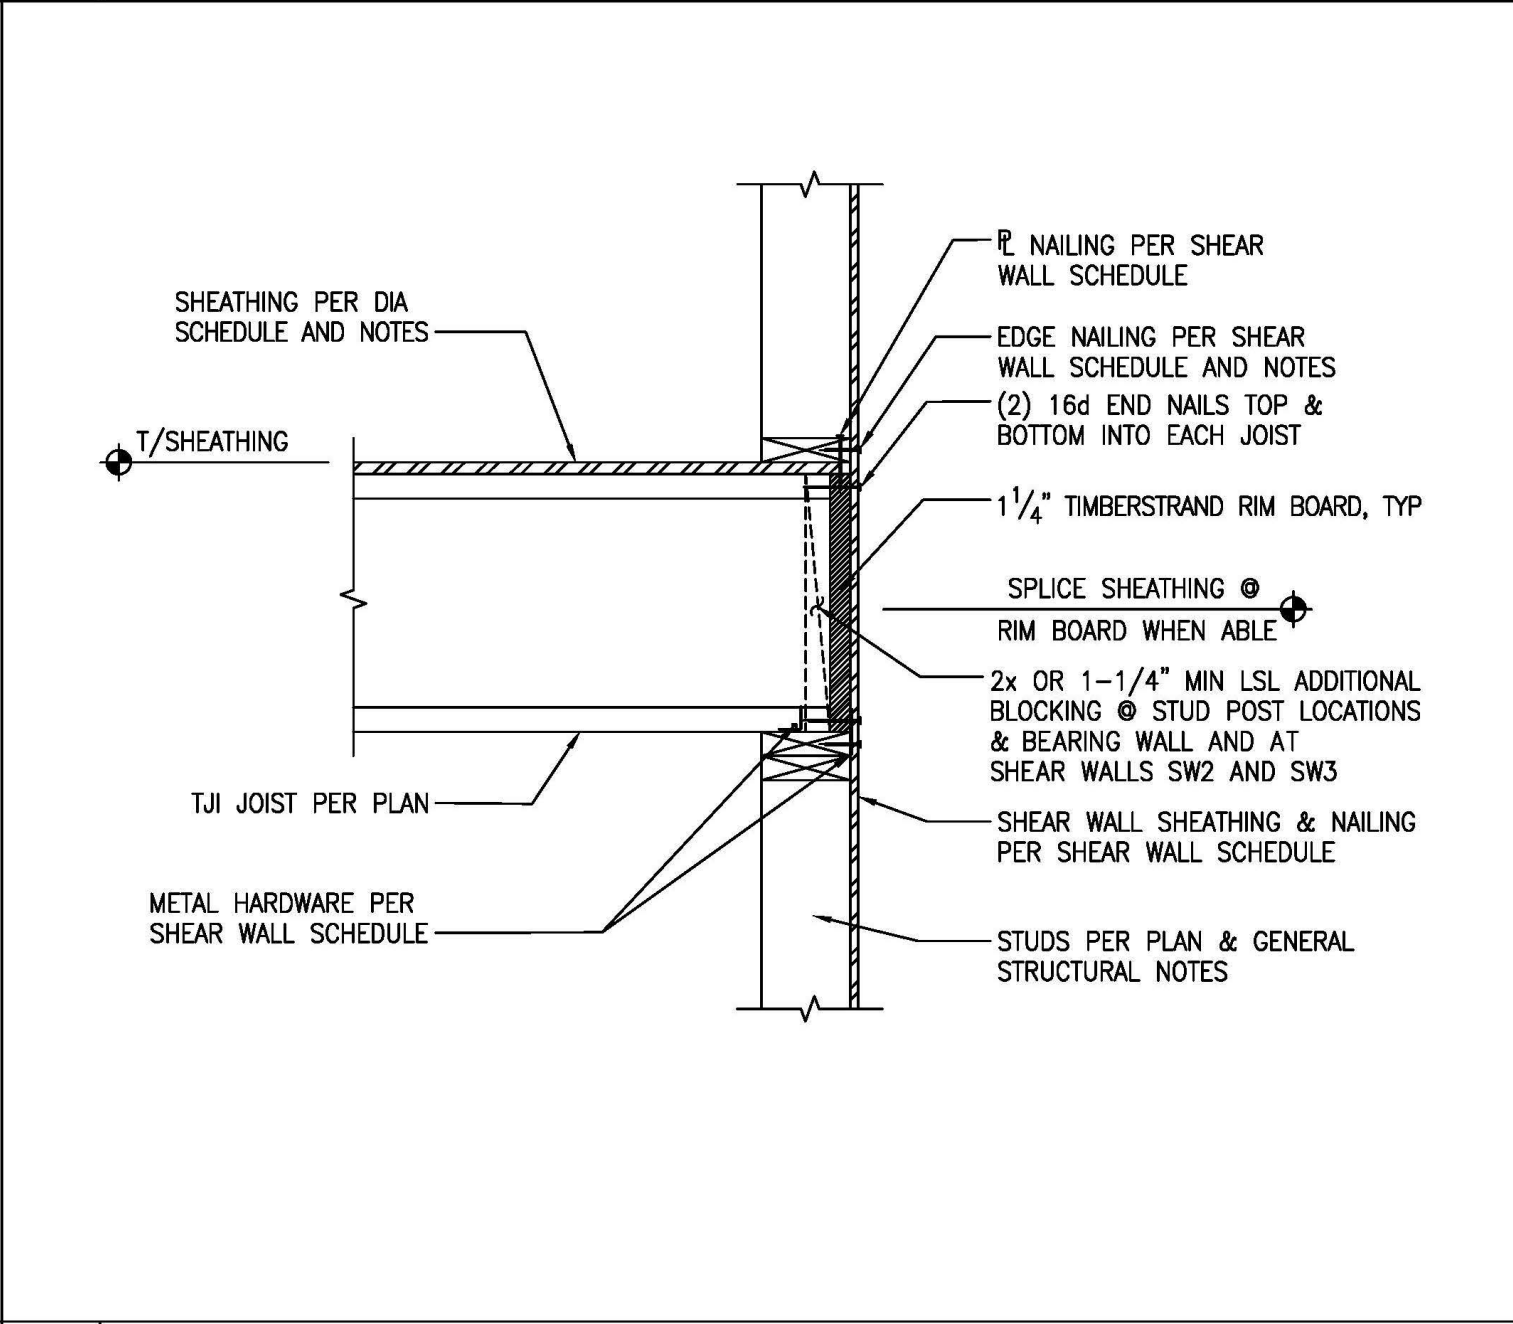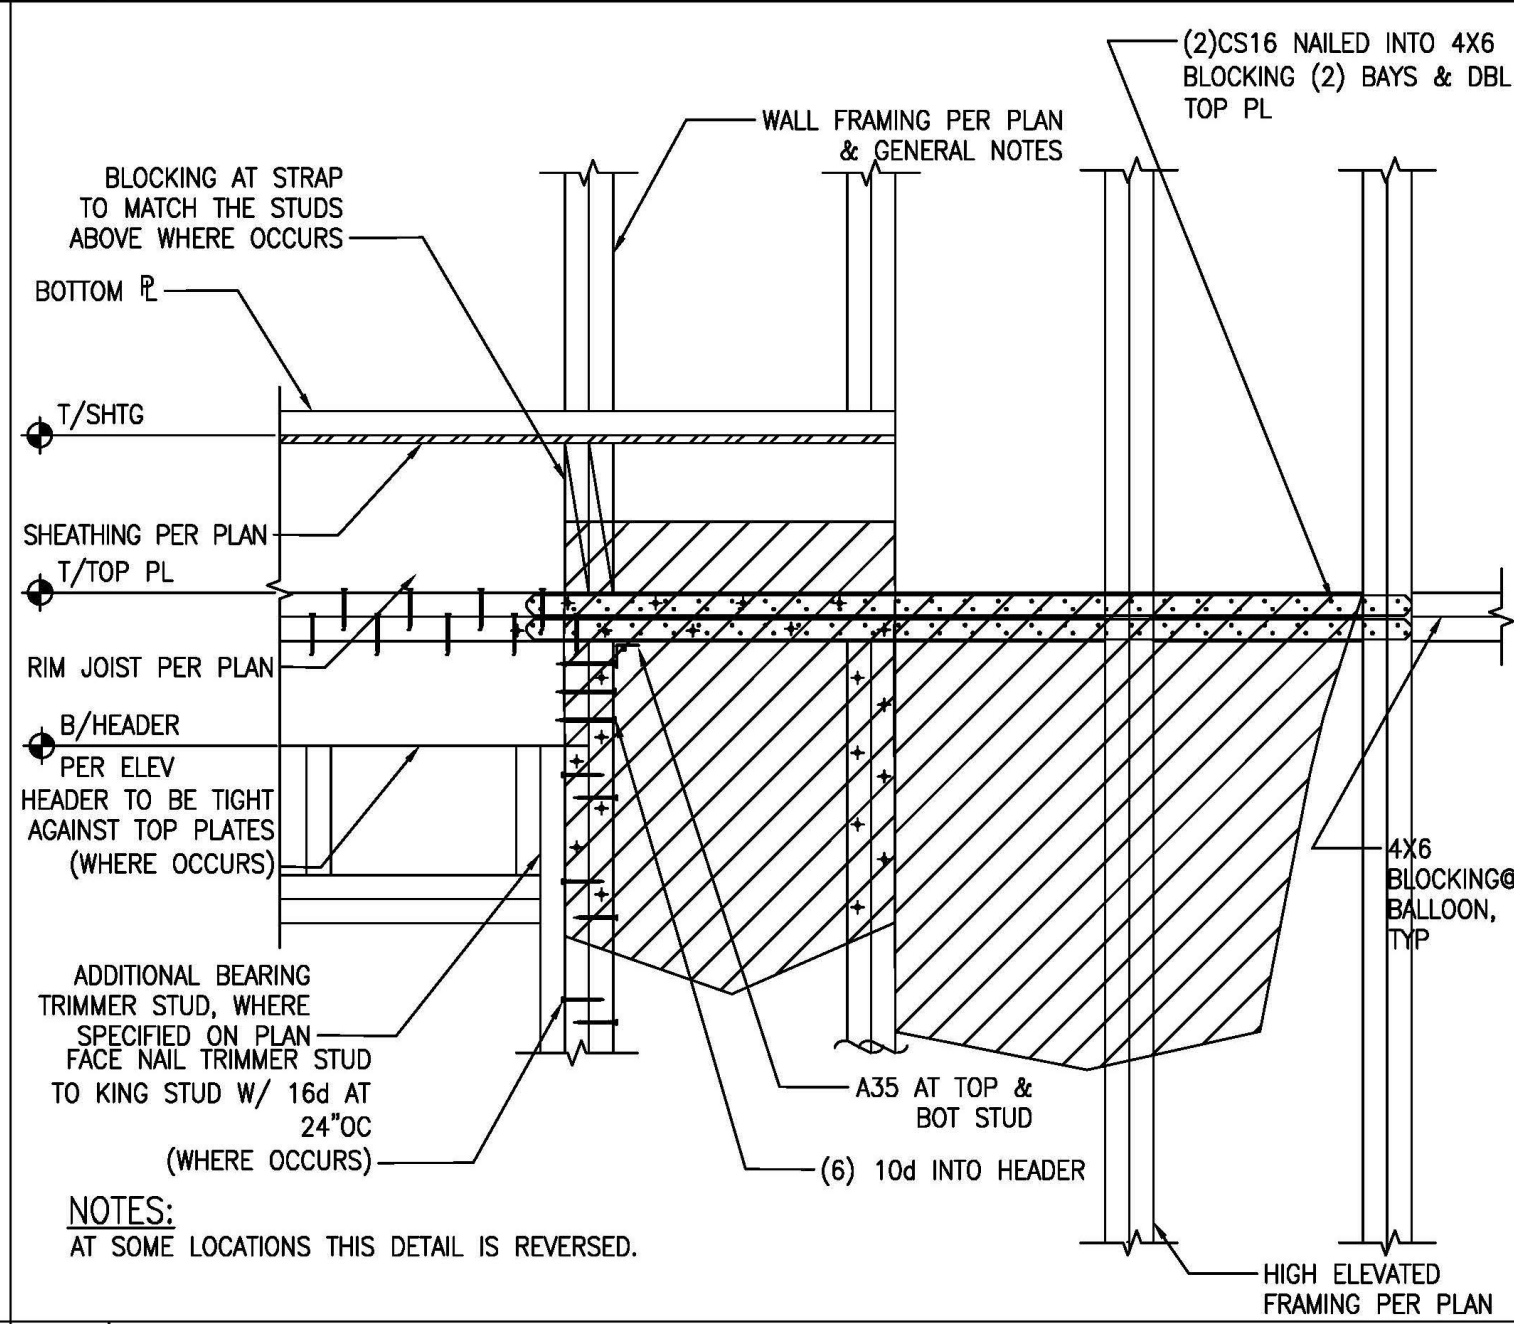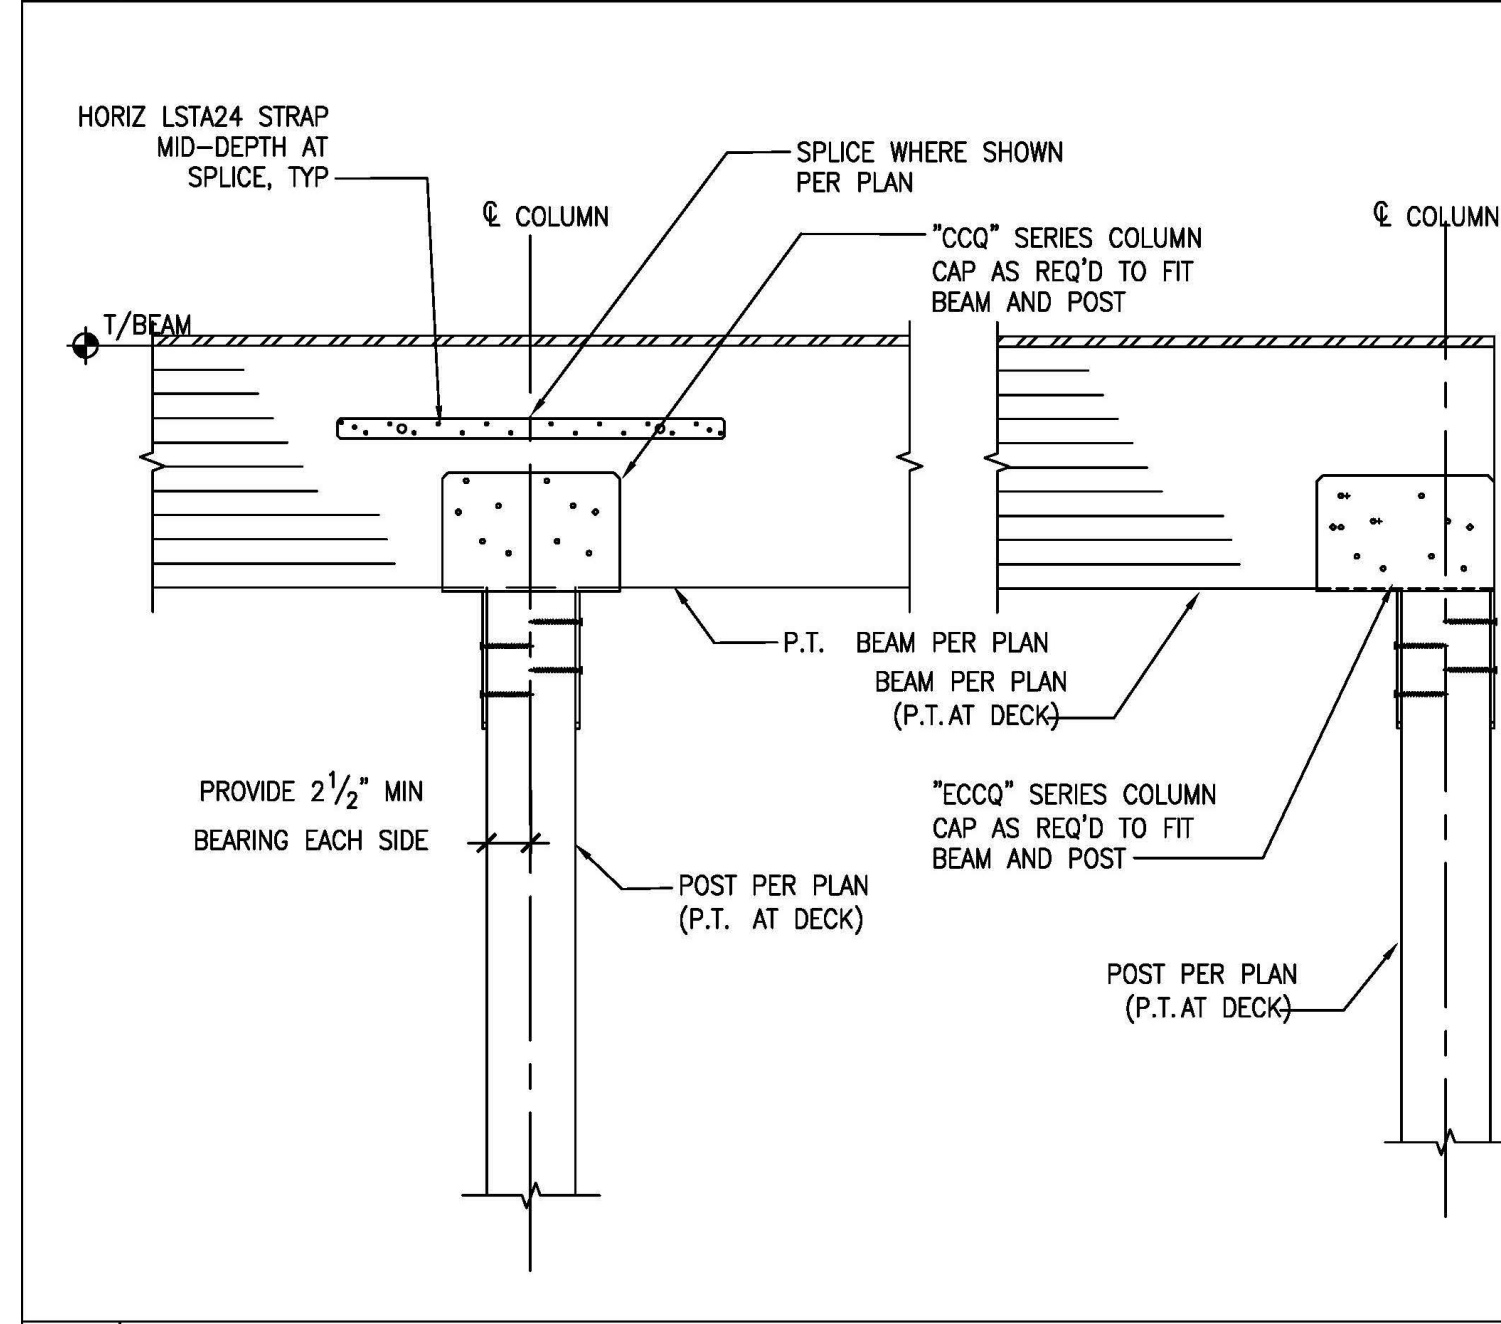

9 TYPICAL COLUMN TO BEAM DETAIL

10 TYP WALL BLK'G/STRAPPING AT TOP PLATE DISCONTINUITY

11 TYPICAL EXTERIOR WALL PERPENDICULAR TO JOISTS

12 TYPICAL EXTERIOR WALL PARALLEL TO TJI JOISTS

PROJECT #:
25-120
ENGINEERED BY: GS
DATE:
6/25/25

ZVELT
ENGINEERING DESIGN PLLC

STRUCTURAL ENGINEERING
721 4th AVE #794
KIRKLAND, WA 98033
Zvelt.Eng@outlook.com



PROJECT NAME:
Long - DADU
6905 96th Ave SE
Mercer Island, WA 98040


IBC 2021

WOOD
LATERAL
DETAILS

ANW 250052
LATERAL DETAILS

SHEET NUMBER:


S 4

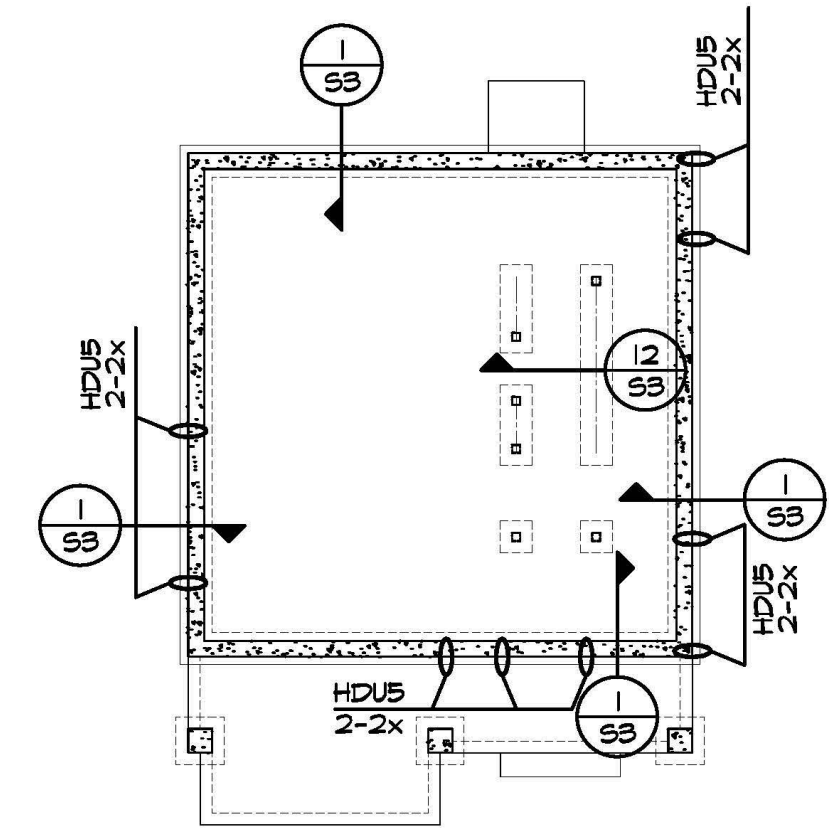

① FOUNDATION (HARDWARE)
SCALE: 1/8" = 1'-0"

FOUNDATION NOTES:


1. VERIFY ALL EXISTING CONDITIONS PRIOR TO FABRICATION & CONSTRUCTION.
2. DO NOT SCALE DRAWINGS. VERIFY ALL DIMENSIONS AND ELEVATIONS WITH THE ARCHITECTURAL DRAWINGS.
3. BOTTOM OF ALL NEW FOOTINGS SHALL BE 18" MIN BELOW LOWEST ADJACENT GRADE UNLESS NOTED OTHERWISE. CENTER INTERIOR FOOTINGS ON WALLS OR COLUMNS.
4. TYPICAL SLAB-ON-GRADE SHALL BE 4" THICK CONCRETE $f_c=2500$ PSI MINIMUM, WITH W/F 6x6-1/2.1x12.1.
5. PROVIDE CONSTRUCTION/CONTROL JOINTS IN 4" THICK SLAB-ON-GRADE TO DIVIDE SLAB INTO RECTANGULAR AREA OF 225 SQUARE FEET OR LESS. AREAS SHALL HAVE MINIMUM ASPECT RATIO OF 2.5:1 AND HAVE NO ACUTE RE-ENTRANT ANGLES.
6. ALL WOOD IN CONTACT WITH WEATHER EXPOSED CONCRETE OR WITHIN 6" OF FINISHED GRADE SHALL BE PRESSURE TREATED.
7. SEE FOOTING SCHEDULE ON SHEET S2.
8. SOIL GEOTECHNICAL EVALUATION WAS PREPARED BY COSALT GEOSCIENCES. SITE PREPARATION, EXCAVATIONS AND TEMPORARY EXCAVATIONS, COMPACTION, BACKFILLING, STRUCTURAL FILL, STORMWATER MANAGEMENT FEASIBILITY, EROSION AND SEDIMENT CONTROL, AND UTILITIES SHALL BE AS STATED IN THE GEOTECHNICAL REPORT ATTACHED TO THE PROJECT.

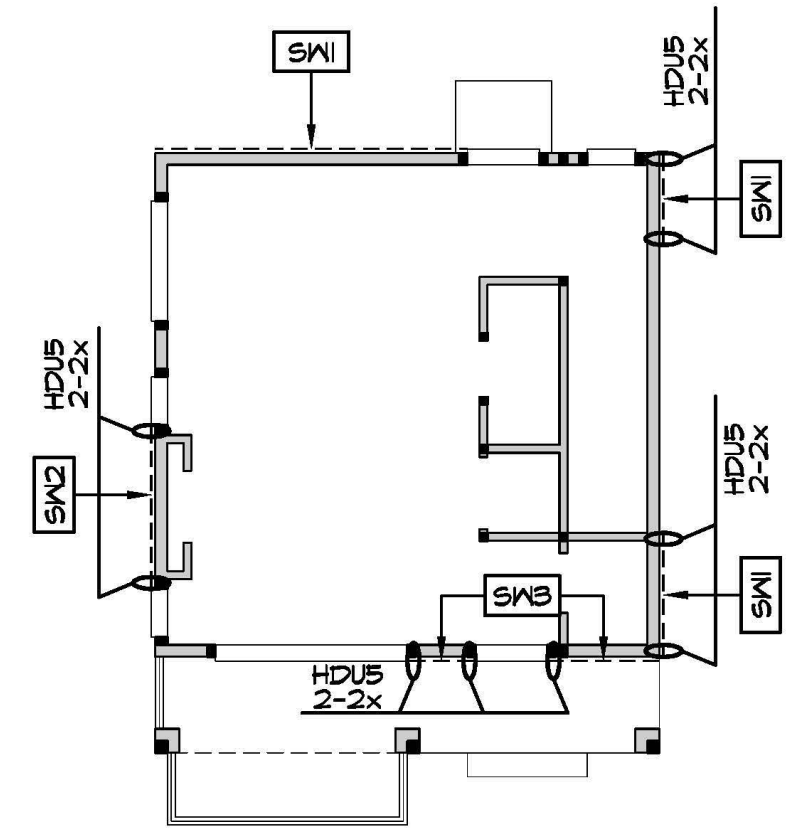


② MAIN FLOOR SHEAR WALLS & HARDWARE
SCALE: 1/8" = 1'-0"

FLOOR PLAN NOTES:

1. VERIFY ALL EXISTING CONDITIONS PRIOR TO FABRICATION & CONSTRUCTION.
2. DO NOT SCALE DRAWINGS. VERIFY ALL DIMENSIONS AND ELEVATIONS WITH THE ARCHITECTURAL DRAWINGS.
3. HD INDICATES A HOLD-DOWN. REFERENCE THE HOLD-DOWN SCHEDULE PLAN S1 FOR HOLD-DOWN REQUIREMENTS AND MINIMUM STUDS/POST. SEE PLAN FOR OTHER STUDS/POST REQUIREMENTS.
4. SWI INDICATES A SHEAR WALL. REFERENCE THE SHEAR WALL SCHEDULE PLAN S2 FOR SHEAR WALL REQUIREMENTS. ALL SHEAR WALLS TO BE CONTINUOUS BETWEEN ROOF SHEATHING AND TOP OF FOUNDATION WALL. SOME SHEAR WALLS REQUIRE 3x FRAMING AT PANEL EDGES. SEE SHEAR WALL SCHEDULE ON STRUCTURAL DETAILS.
5. SHEAR WALL TO BE CONTINUOUS THROUGH INTERSECTION. SEE DET. 1/52.
6. ALL EXTERIOR SHEAR WALLS SHALL BE SW-I, UNLESS NOTED ON THE PLAN.

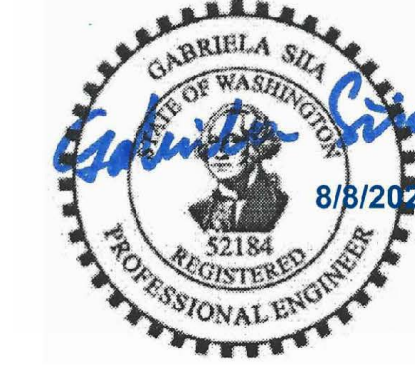

ZVELT ENGINEERING DESIGN, PLLC
Lateral Review
This review is for general conformance to the structural design criteria, red lined mark-ups, concept and contract documents.
By: *gs* Job#: A05/25-120 Date: 8/8/2025

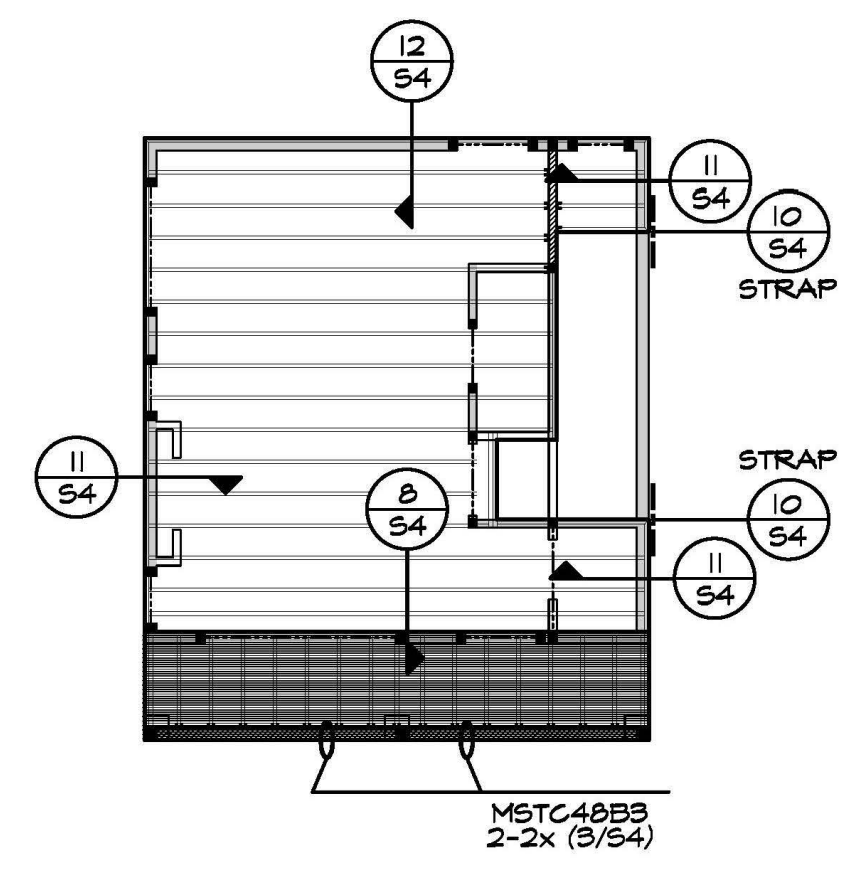


③ UPPER FLOOR FRAMING
SCALE: 1/8" = 1'-0"

BLOCKED DIAPHRAGM (DET 5/52)
FLOOR BLOCKED DIAPHRAGM W/ 3/4" SHTS
0.148"φ x 3" NAILING
10d @ 6" O.C. EDGE
10d @ 12" O.C. FIELD STAGGERED

FLOOR FRAMING NOTES:


1. VERIFY ALL EXISTING CONDITIONS PRIOR TO FABRICATION & CONSTRUCTION.
2. DO NOT SCALE DRAWINGS. VERIFY ALL DIMENSIONS AND ELEVATIONS WITH THE ARCHITECTURAL DRAWINGS.
3. FLOOR SHEATHING THICKNESS AND NAILING SHALL BE 3/4" w/10d @ 12" O.C. ALL FIELD SUPPORTS 10d @ 6" O.C. ALL PANEL EDGES AND 10d @ 6" O.C. AT BOUNDARIES WHERE SHADED PER PLAN. SEE DIAPHRAGM SCHEDULE PLAN S1.
4. SEE GENERAL STRUCTURAL NOTES FOR FLOOR LOADING CONDITIONS.
5. PROVIDE SOLID BLOCKING AT THE LOCATIONS INDICATED PER PLAN.
6. PROVIDE ADDITIONAL L JOIST IN LINE WITH SHEAR WALL WHERE NOTED ON PLAN.
7. ALL POST-BEAM & BM-BM INTERSECTIONS SHALL CONTAIN POSITIVE CONNECTIONS TO RESIST AGAINST UPLIFT AND/OR LATERAL DISPLACEMENT.

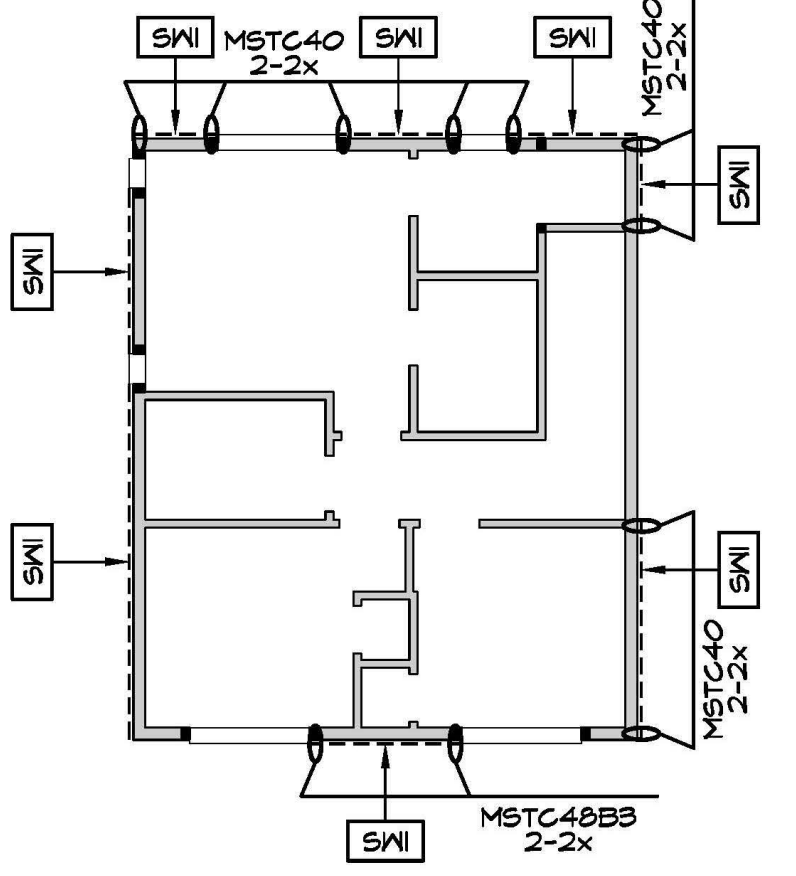

④ UPPER FLOOR SHEAR WALLS & HARDWARE
SCALE: 1/8" = 1'-0"

FLOOR PLAN NOTES:


1. VERIFY ALL EXISTING CONDITIONS PRIOR TO FABRICATION & CONSTRUCTION.
2. DO NOT SCALE DRAWINGS. VERIFY ALL DIMENSIONS AND ELEVATIONS WITH THE ARCHITECTURAL DRAWINGS.
3. HD INDICATES A HOLD-DOWN. REFERENCE THE HOLD-DOWN SCHEDULE PLAN S1 FOR HOLD-DOWN REQUIREMENTS AND MINIMUM STUDS/POST. SEE PLAN FOR OTHER STUDS/POST REQUIREMENTS.
4. SWI INDICATES A SHEAR WALL. REFERENCE THE SHEAR WALL SCHEDULE PLAN S2 FOR SHEAR WALL REQUIREMENTS. ALL SHEAR WALLS TO BE CONTINUOUS BETWEEN ROOF SHEATHING AND TOP OF FOUNDATION WALL. SOME SHEAR WALLS REQUIRE 3x FRAMING AT PANEL EDGES. SEE SHEAR WALL SCHEDULE ON STRUCTURAL DETAILS.
5. SHEAR WALL TO BE CONTINUOUS THROUGH INTERSECTION. SEE DET. 1/52.
6. ALL EXTERIOR SHEAR WALLS SHALL BE SW-I, UNLESS NOTED ON THE PLAN.

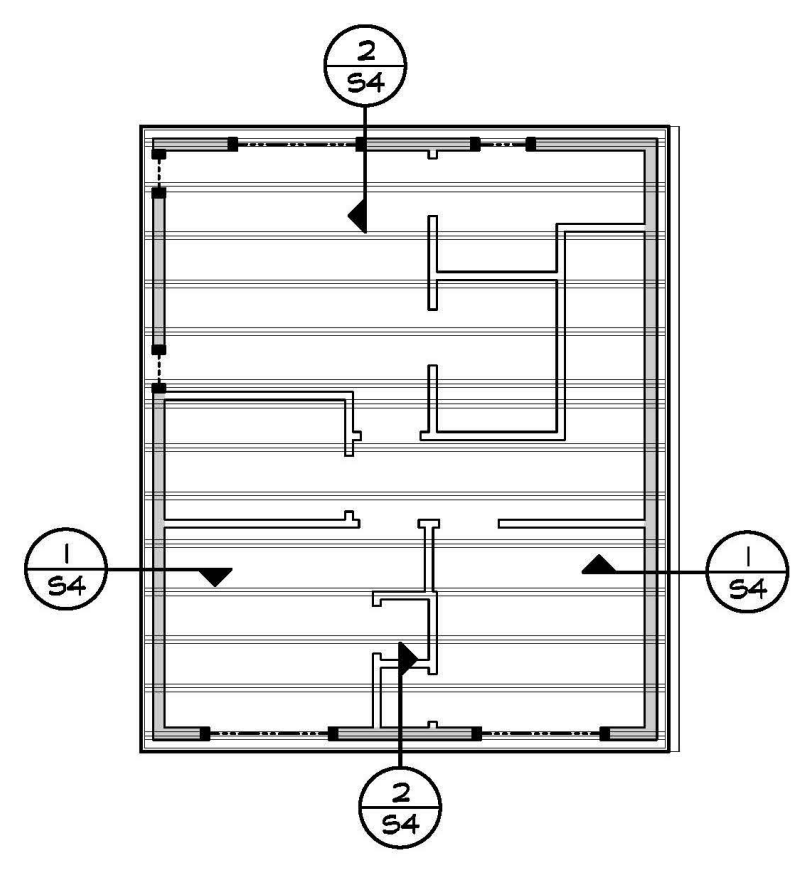

⑤ ROOF FRAMING
SCALE: 1/8" = 1'-0"

ROOF FRAMING NOTES:

1. VERIFY ALL EXISTING CONDITIONS PRIOR TO FABRICATION & CONSTRUCTION.
 2. DO NOT SCALE DRAWINGS. VERIFY ALL DIMENSIONS AND ELEVATIONS WITH THE ARCHITECTURAL DRAWINGS.
 3. ROOF FRAMING SHALL BE MANUFACTURED TRUSSES @ 24" O.C. AS PER PLAN. HANGERS INDICATED ARE PER MANUFACTURER.
 4. ROOF SHEATHING THICKNESS AND NAILING SHALL BE 1/2" NOMINAL w/8d @ 6" O.C. ALL FIELD SUPPORTS AND 8d @ 6" O.C. ALL PANEL EDGES AND 8d @ 6" O.C. @ BOUNDARIES WHERE SHADED ON THE PLAN. SEE DIAPHRAGM SCHEDULE SHEET S1.
 5. SEE GENERAL STRUCTURAL NOTES FOR FLOOR LOADING CONDITIONS.
- ROOF DIAPHRAGM W/ 1/2" SHTS
0.131"φ x 2-1/2" NAILING
8d @ 6" O.C. EDGE
8d @ 6" O.C. FIELD STAGGERED

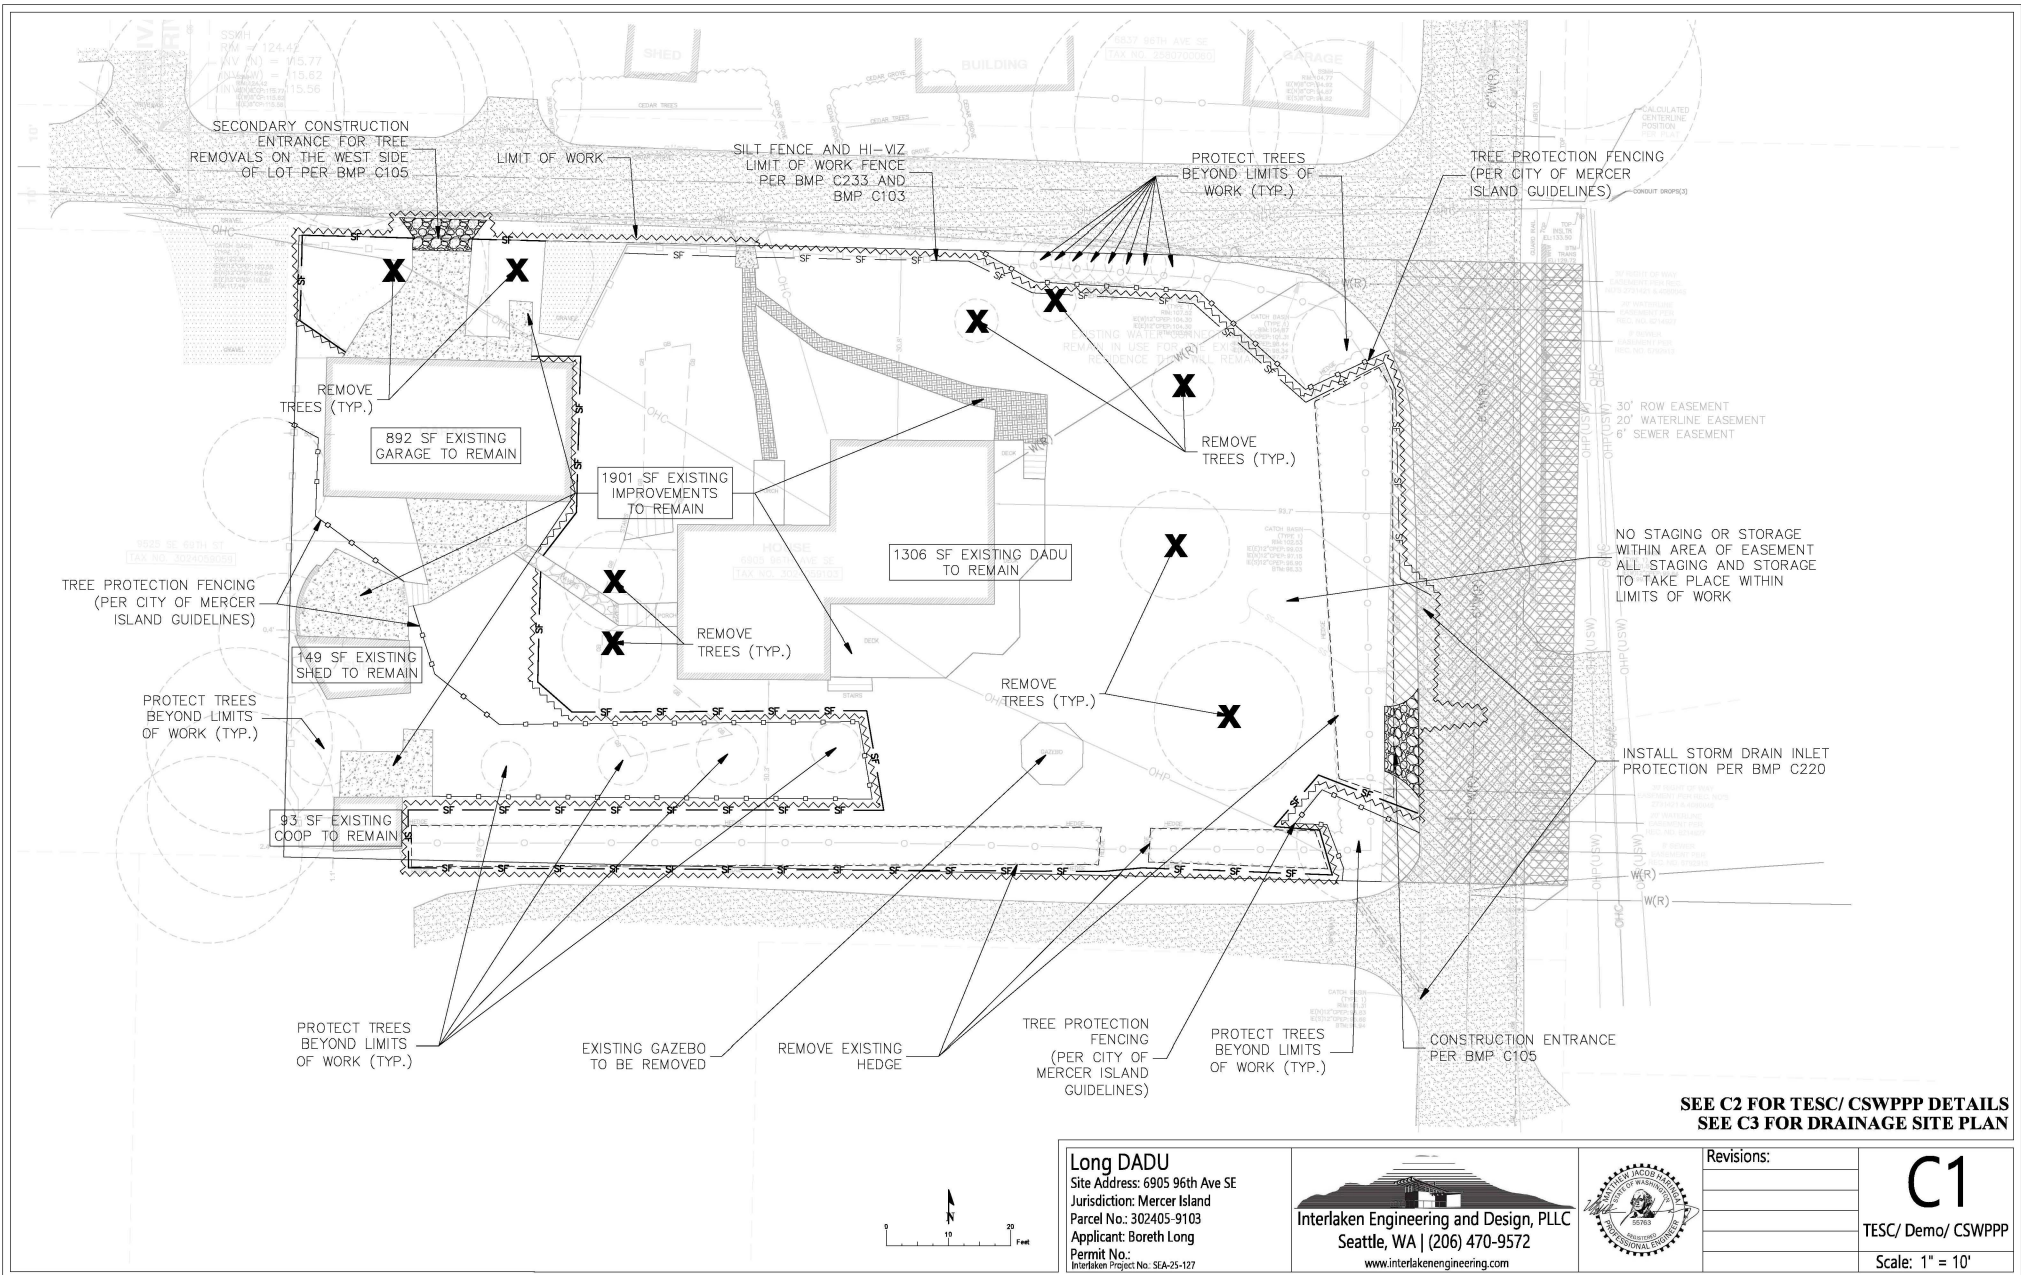

SEE C2 FOR TESC/ CSWPPP DETAILS
SEE C3 FOR DRAINAGE SITE PLAN

Long DADU
 Site Address: 6905 96th Ave SE
 Jurisdiction: Mercer Island
 Parcel No.: 302405-9103
 Applicant: Boreth Long
 Permit No.:
 Interlaken Project No. SEA-25-127


Interlaken Engineering and Design, PLLC
 Seattle, WA | (206) 470-9572
 www.interlakenengineering.com



Revisions:

C1
 TESC/ Demo/ CSWPPP
 Scale: 1" = 10'

Figure II-4.1: Stabilized Construction Access

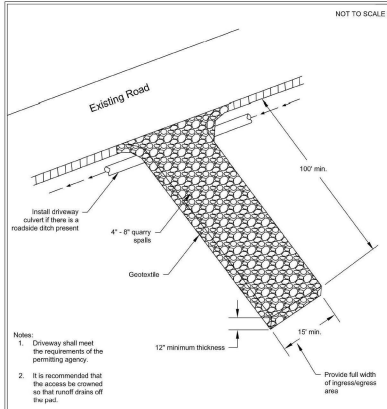


Stabilized Construction Access

DEPARTMENT OF ECOLOGY
State of Washington

Revised June 2018

2024 Stormwater Management Manual for Western Washington
Volume II - Chapter 4 - Page 320

Figure II-4.22: Silt Fence

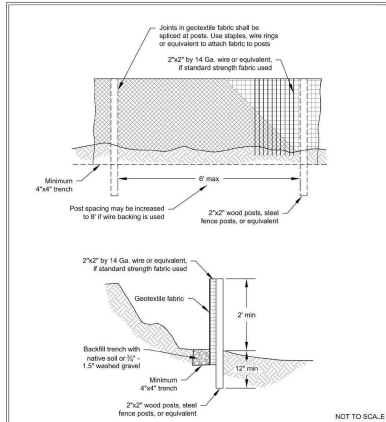


Silt Fence

DEPARTMENT OF ECOLOGY
State of Washington

Revised July 2017

2024 Stormwater Management Manual for Western Washington
Volume II - Chapter 4 - Page 415

Figure II-4.17: Block and Gravel Filter

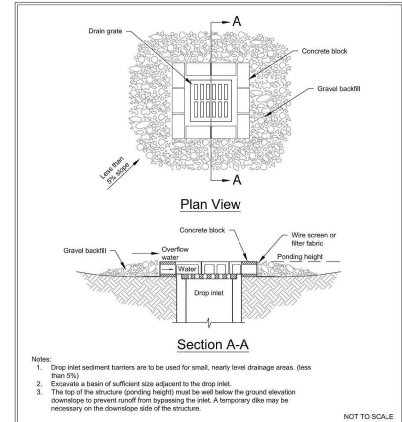

Block and Gravel Filter

DEPARTMENT OF ECOLOGY
State of Washington

Revised June 2018


2024 Stormwater Management Manual for Western Washington
Volume II - Chapter 4 - Page 403

**TREE PROTECTION AREA (TPZ)
KEEP OUT!**


DO NOT REMOVE OR ADJUST THE APPROVED LOCATION OF THIS TREE PROTECTION AREA

Trees enclosed by this fence are protected and are subject to the conditions of the tree permit. Violation of tree conditions may lead to:

1. Correction Notices or Stop Work Orders until compliance is achieved
 2. RE inspection Fees/financial penalties
 3. Arborist reports recommending mitigation
- Notes:
1. No pruning shall be performed unless under the direction of the Project Arborist, including limbing trees up.
 2. No grading, excavation, storage (materials, equipment, vehicles, etc.), or other unpermitted activity shall occur inside the protective fencing.
 3. Penalties for damaging by root damage/compaction or removing a saved tree may be a fine up to three times the value of the tree plus restoration (MICC 19.10.180).
 4. Any work in approved TPZ must be with the permission of the Land Use and Planning Division at landuse.planning@mercer.gov.
 5. 5" course woodchips within the tree protection zone, but not against the tree trunk.

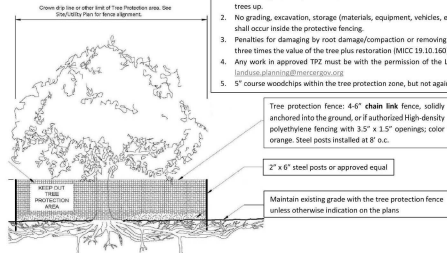

Any Work in the protected area must be with the permission of the Land Use and Planning Division at landuse.planning@mercer.gov.



Long DADU
Site Address: 6905 96th Ave SE
Jurisdiction: Mercer Island
Parcel No.: 302405-9103
Applicant: Boreth Long
Permit No.:
Interlaken Project No. SEA-25-127

Interlaken Engineering and Design, PLLC
Seattle, WA | (206) 470-9572
www.interlakenengineering.com



Revisions:

C2

TESC/ CSWPPP Details

Scale: As Noted

SEE C1 FOR TESC/ DEMO/ CSWPPP

Tree Removal & Replacement Plan

Property Address: 6905 96th Ave SE, Mercer Island, WA 98040

Owner: Boreth Long

Date: November 15, 2025

1. Arborist Report and Existing Tree Inventory

Arborist report was completed by Andrew Raines, a certified arborist with Arborist Solutions. A copied of the arborist report is provided as a separate supporting document and included in Appendix A of this document.

All significant trees on the property are inventoried and included in the arborist report. The location of inventoried trees is accurately incorporated into the topography survey.

The tree inventory in the arborist report includes the following:

- Tree numbering system of all existing large regulated tress on the property
- Tree species
- Tree size (diameter, height, and dripline diameter)
- Brief general health or condition rating of each tree
- Tree status (retained or proposed for removal), and
- Using color code to identify of all significant and exception trees and differentiate between those less than 24 inches and those greater than or equal to 24 inches in diameter.

There is a total of 25 trees on the property include the following category:

- 4 trees with diameter smaller than 10"
- 21 large regulated trees greater than 10", with
 - 2 of 21 trees has a diameter greater than or equal to 36"
 - 5 of 21 trees has a diameter greater than or equal to 24", and
 - 4 of 21 trees is considered exceptional tree per Table MICC 19.16

Note: The tree inventory in the Arborist report also includes five (5) large regulated trees on adjacent property with driplines or critical root zones extending into the property.

A list of trees for each category mentioned above is provided in Mercer Island Tree Inventory & Replacement Submittal Information Form in Appendix B of this document for reference.

Note: A copy of the Tree Inventory and Replacement Submittal Form is provided as a separate supporting document.

2. Trees Removal Plan

Eight (8) large regulated trees on site are proposed for removal. As shown in the completed Mercer Island Tree Inventory & Replacement Submittal Information Form in Appendix B of this document, tree numbers proposed for removal are: 1, 2, 3, 4, 6, 8, 9, and 16. However, in Phase 1 (proposed ADU), only tree 8 and 9 will be removed. The remaining trees will be removed at a later time during phase 2/3 of the project (See project narrative for details).

See provided site plan and arborist report for the location of tree #8 and #9.

Reason for Tree #8 Removal: Hemlock Tree (DBH: 36") is a hazard tree with co-dominant base with included bark and missing structural wood. It is leaning toward the house and has base cavity as confirmed by the certified arborist. Removal is necessary to prevent property damage and safety hazards.

Reason for Tree #9 Removal: Western Red Cedar (DBH: 24") is in the way of the proposed ADU intended for construction path and prevent necessary installation of site improvements (walkway and utilities). Removal is necessary for site improvement and construction of the proposed ADU.

3. Trees Replacement Plan

In Phase 1 (proposed ADU), only tree 8 (DBH: 36") and tree 9 (DBH: 24") will be removed. Therefore, per MICC 19.10.070 – tree replacement, removed trees shall have the following replacement as shown in table below.

Diameter of Removed Tree	Tree Replacement Ratio	Number of Trees Proposed for Removal	Number of Three Required for Replacement Based on Size/Type
Less than 10"	1	0	0
10" up to 24"	2	1	2
Greater than 24" up to 36"	3	0	0
Greater than 36" and any Exceptional Tree	6	1	6
TOTAL TREE REPLACEMENT			8

As indicated in the arborist report and on the site plan, a row of 8 emerald green arborvitae trees (conifers) at least six feet tall will be planted as replacement trees south of the proposed ADU as shown in Figure 1 and Figure 2 below.

By installing these replacement trees at the boarder of the property south of the ADU, these trees won't interface with land improvement and building of the main home (north of the ADU) in near future in Phase 3 of the project, as well as providing needed privacy for the ADU in the future.

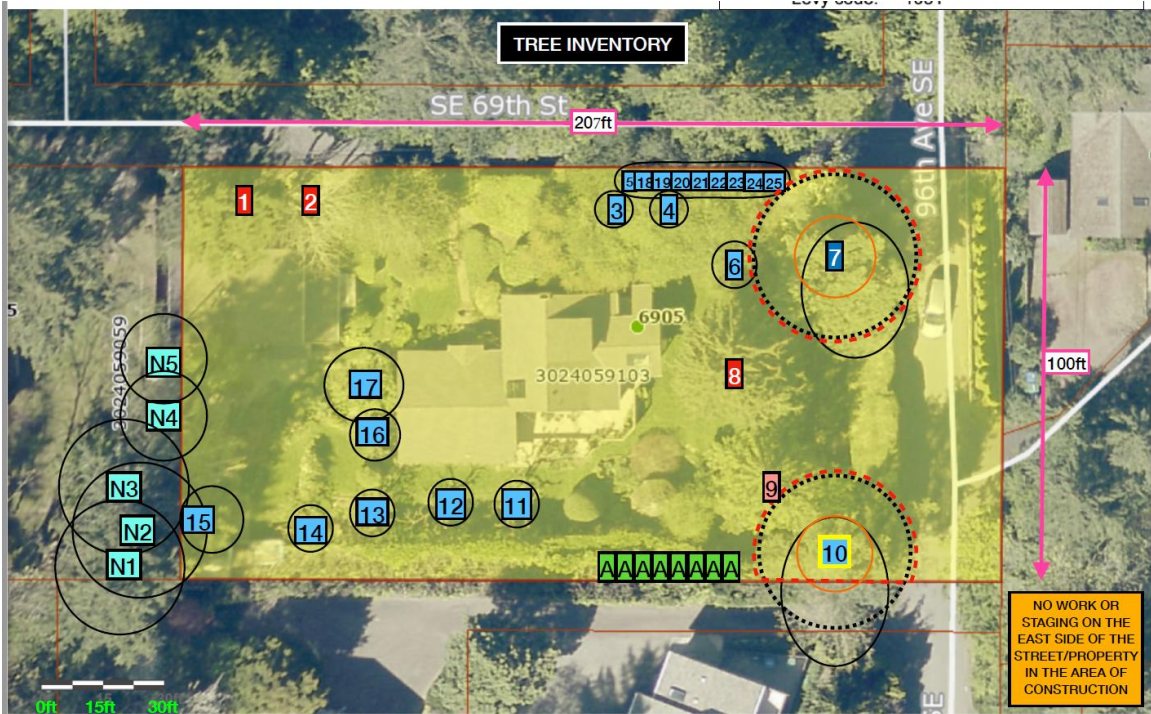


Figure 1: Approximately Location of Replacement Trees (designated with “A”) as shown in the Arborist Report

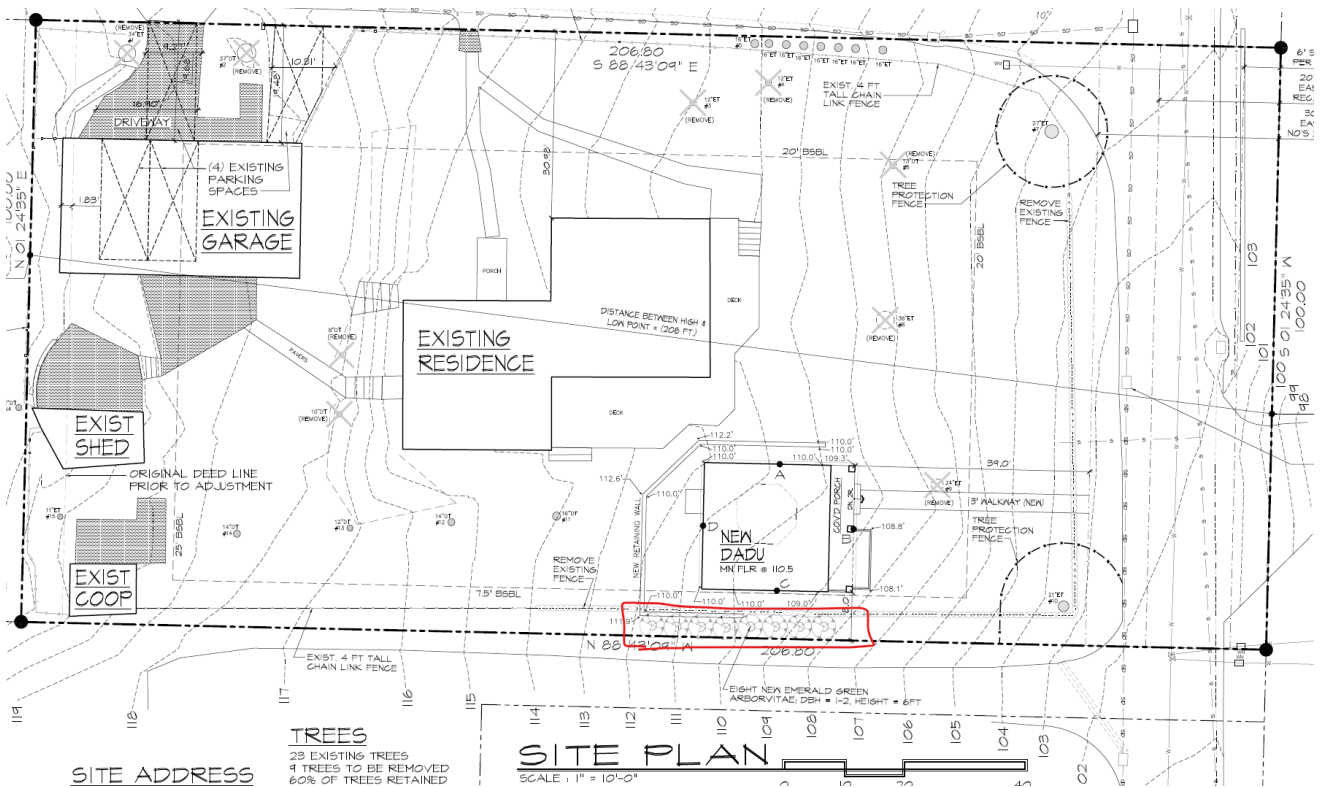


Figure 2: Approximately Location of Replacement Trees as shown on the Site Plan

Planting Replacement Trees Timing:

In the Pacific Northwest and the per MICC 19.10.070 (B)(5), the replacement trees shall be planted in the wet season between October 1 through April 1, following the applicable tree removal or completion of the development work. Assuming, we start construction on April 1, 2026, we should complete the ADU construction by end of 2026. Then we can immediately plant the replacement trees as shown in the site plan.

Note: we understand and will avoid planting trees when the ground is frozen or during hot, dry weather.

4. Support Documents

- Arborist report (in Appendix A herein and as separate supporting document)
- Mercer Island Tree Inventory & Replacement Submittal Information Form (in Appendix B herein and as separate supporting document)
- Site plan showing existing and proposed tree locations (separate document)

5. Owner Certification

I certify that the above information is accurate and that replacement trees will be maintained in healthy condition for at least 5 years after planting. I shall replant any replacement tree that dies, become diseased, or is removed during this five-year time period.

APPENDIX A

ARBORIST SOLUTIONS

Andrew Raines

ISA Certified Arborist

ISA TRAQ Certified

ISA Utility Specialist


PN-7684AU

206-747-5907


Andrew.Raines.Arb@gmail.com



Parcel 3024059103
Present use: Single Family(Res Use/Zone)
Jurisdiction: MERCER ISLAND
Taxpayer name: BORTH LONG & UYEN LE
Address: 6905 96TH AVE SE 98040
Appraised value: [REDACTED]
Lot area: 20,000
Levy code: 1031

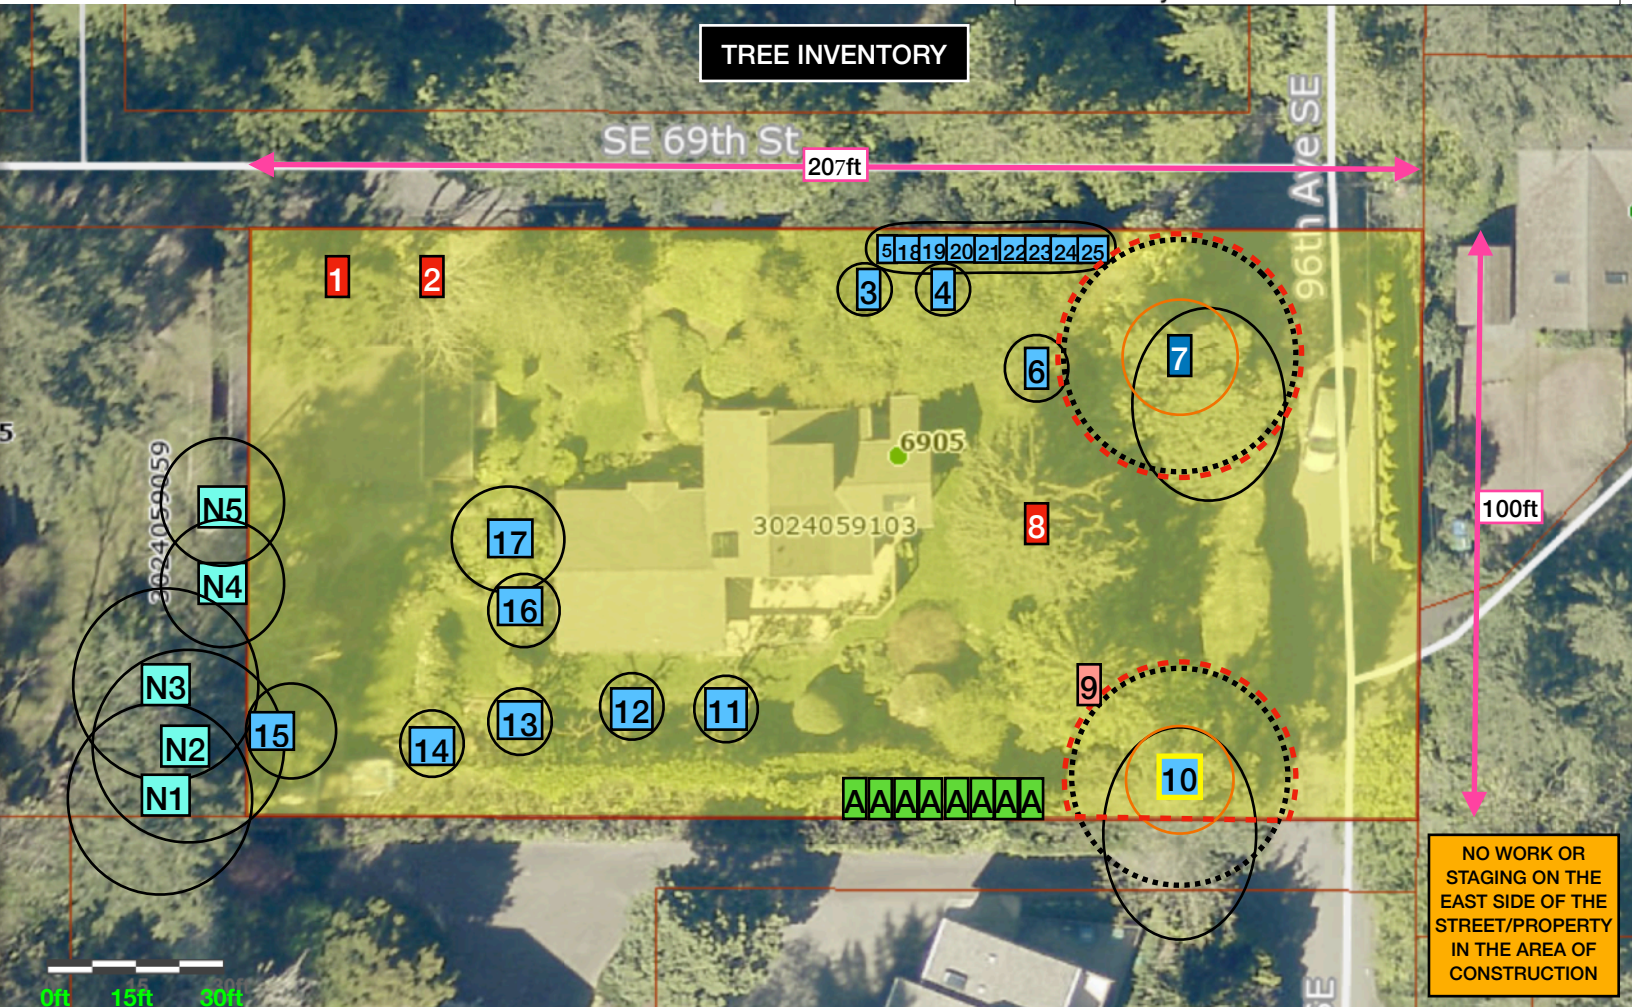

Tree protection fencing shall be installed as the first part of the project to reduce all impacts inside of the CRZ of any protected tree.

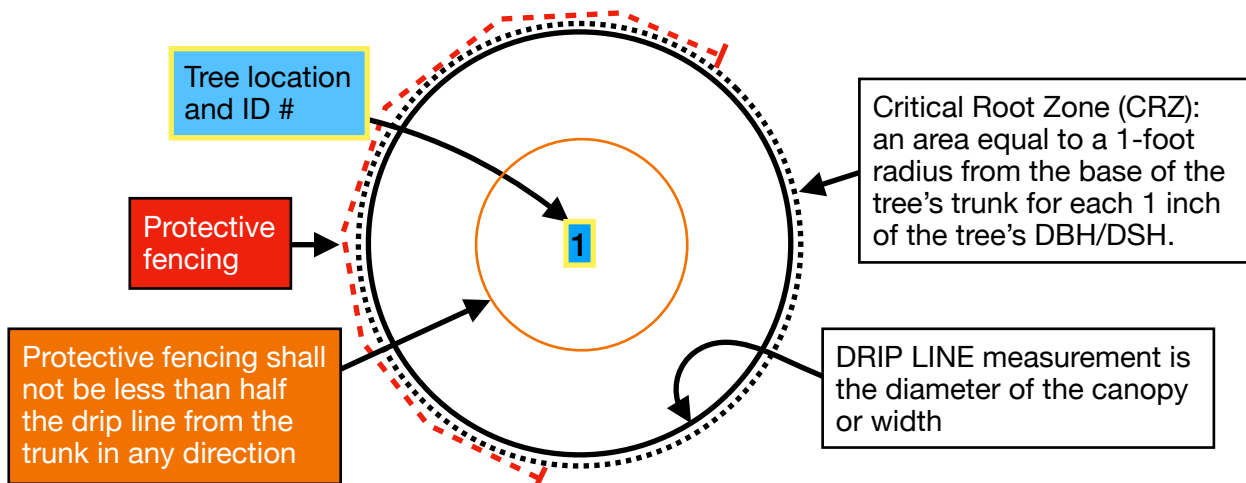

TREE PROTECTION AREA (TPZ)

KEEP OUT!


DO NOT REMOVE OR ADJUST THE APPROVED LOCATION OF THIS TREE PROTECTION AREA

Trees enclosed by this fence are protected and are subject to the conditions of the tree permit. Violation of tree conditions may lead to:

1. Correction Notices or Stop Work Orders until compliance is achieved
2. RE Inspection Fees/financial penalties
3. Arborist reports recommending mitigation

Notes

1. No pruning shall be performed unless under the direction of the Project Arborist. Including limbing trees up.
2. No grading, excavation, storage (materials, equipment, vehicles, etc.), or other unpermitted activity shall occur inside the protective fencing.
3. Penalties for damaging by root damage/compaction or removing a saved tree may be a fine up to three times the value of the tree plus restoration (MICC 19.10.160).
4. Any work in approved TPZ must be with the permission of the Land Use and Planning Division at landuse.planning@mercergov.org
5. 5" course woodchips within the tree protection zone, but not against the tree trunk.

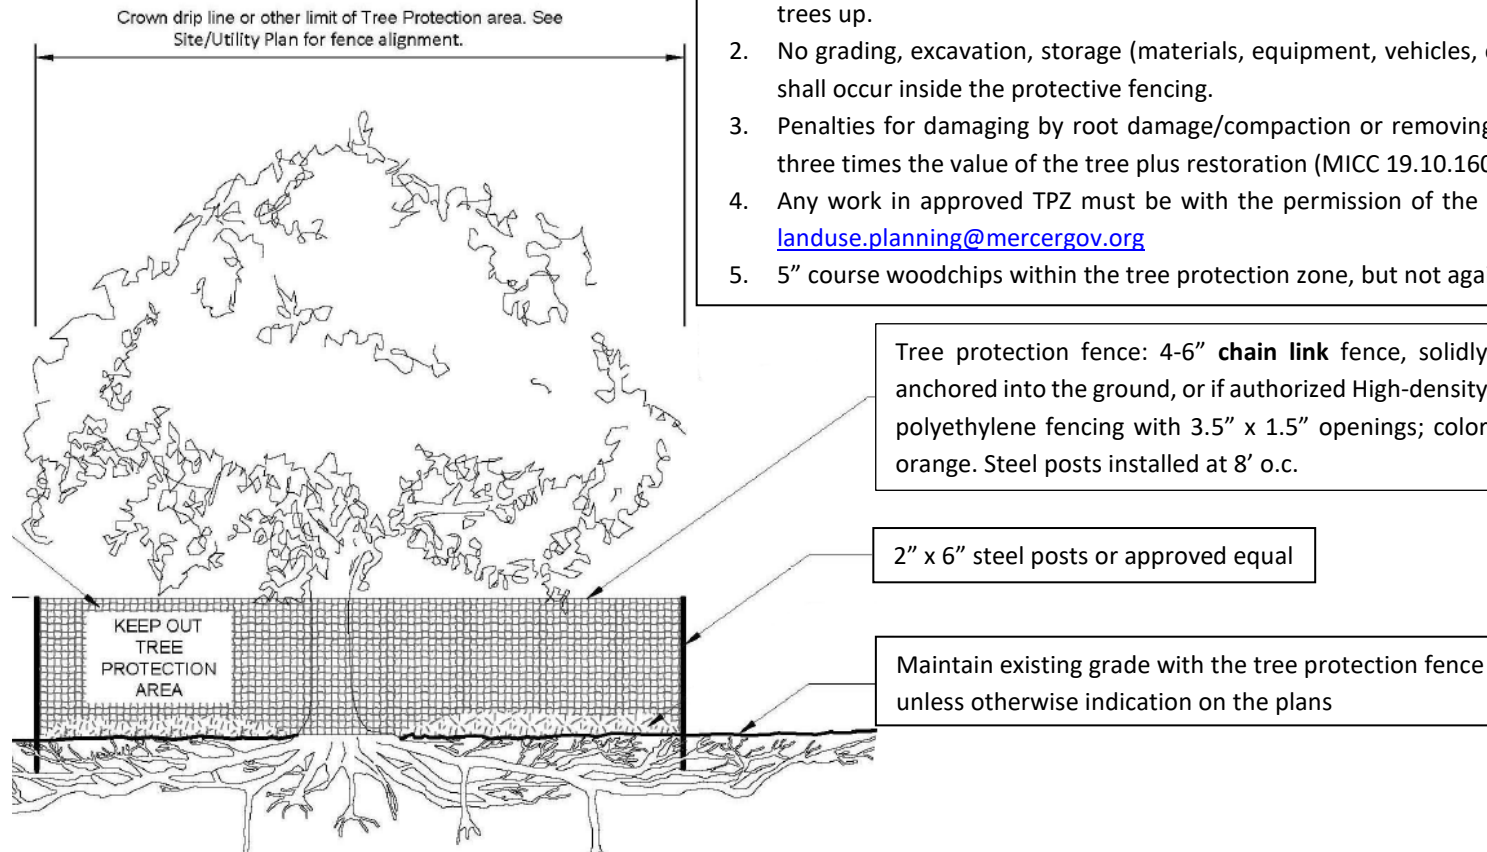




Any Work in the protected area must be with the permission of the Land Use and Planning Division at landuse.planning@mercergov.org

Significant trees	Significant neighbors tree	Significant removal	Replacement trees
Exceptional trees	Exceptional neighbors tree	Exceptional removal	Protected tree= yellow border

TREE #	Species	DBH" DIAMETER	H'	W' DRIPLINE DIAMETER	Condition	Mitigation
1	Douglas fir	34	100	30	Hazard; previously topped at 60ft (internal decay at topped), co-dom tops prone to fail, bark decay	Remove  
2	Bigleaf maple	37	60	25	Hazard; root and base decay, previously failed at 9ft	Remove 
3	Holly	12.5	25	7	-IN A GROVE OF HOLLY	Retain
4	Holly	12	25	7	-IN A GROVE OF HOLLY	Retain
5	Holly	16	25	7	-IN A GROVE OF HOLLY	Retain
6	Birch	13.5	8	10	Internal decay throughout	Retain or remove 
7	Scotts pine	27	65	35	<u>In the area of construction</u> Normal (Dull in color)	<u>Protect and retain</u> CRZ -From trunk to fencing: 27FT -Across/diameter: 56.26FT

Significant trees	Significant neighbors tree	Significant removal	Replacement trees
Exceptional trees	Exceptional neighbors tree	Exceptional removal	Protected tree= yellow border

TREE #	Species	DBH" DIAMETER	H'	W' DRIPLINE DIAMETER	Condition	Mitigation
8	Hemlock	36	95	35	Hazard; co-dominant base with included bark, lead towards house missing structural wood, and base cavity	Remove 
9	Western red cedar	23.75	35	25	In the way of construction: intended front walkway and construction path	Remove
10	Scotts pine	21.5	35	20	<u>In the area of construction</u> Normal (Dull in color)	<u>Protect and retain</u> CRZ -From trunk to fencing: 21.5FT -Across/diameter: 44.79FT
11	Cherry	16	10	8	Mostly dead with internal decay throughout -REDUCED/ROUDNED	Retain or remove 
12	Plum	14.5	15	10	Mostly dead with internal decay throughout and fungus present -REDUCED/ROUDNED	Retain or remove 
13	Apple	12	10	8	Normal -REDUCED/ROUDNED	Retain
14	Apple	14	8	8	Normal -REDUCED/ROUDNED	Retain

Significant trees	Significant neighbors tree	Significant removal	Replacement trees
Exceptional trees	Exceptional neighbors tree	Exceptional removal	Protected tree= yellow border

TREE #	Species	DBH" DIAMETER	H'	W' DRIPLINE DIAMETER	Condition	Mitigation
15	Douglas fir	11	50	12	Normal -REDUCED/ROUDNED	Retain
16	Green apple	10	15	15	Normal	Retain
17	Green apple	8	20	15	Normal	Retain
18	Holly (grove/row)	14	20	5	Barrier trees- all the same size	Retain
19	Holly (grove/row)	14	20	5	Barrier trees- all the same size	Retain
20	Holly (grove/row)	14.5	20	5	Barrier trees- all the same size	Retain
21	Holly (grove/row)	12	20	5	Barrier trees- all the same size	Retain
22	Holly (grove/row)	12	20	5	Barrier trees- all the same size	Retain
23	Holly (grove/row)	9	20	5	Barrier trees- all the same size	Retain
24	Holly (grove/row)	8	20	5	Barrier trees- all the same size	Retain
25	Holly (grove/row)	8.5	20	5	Barrier trees- all the same size	Retain
N1	Douglas fir	18	120	30	Neighbors tree Canopy= NORMAL	Retain
N2	Douglas fir	20	120	30	Neighbors tree Canopy= NORMAL	Retain
N3	Douglas fir	18	80	30	Neighbors tree Canopy= NORMAL	Retain
N4	Birch	12	40	20	Neighbors tree Canopy= DISEASED	Retain
N5	Birch	12	40	20	Neighbors tree Canopy= DISEASED	Retain
A	Emerald green arborvitae	1-2	6	-	Replacement trees: after construction and between Nov-April.	Plant

Replacement trees: Row of 8 Emerald green arborvitae were selected with the goal of that they will provide privacy for the DADU. Also, by installing them on the border of the property, these trees won't interfere with the building of the main home (north of DADU) in the near future in Phase 3 of the project.

When to plant replacement trees: In the Pacific Northwest, this is generally between November and April. Avoid planting trees when the ground is frozen or during hot, dry weather. This species shouldn't need

maintenance and nothing should be planted that needs it. Trees shall be replaced after all construction is finished.

Inventory and survey: All the significant trees I inventoried I add to my map as accurate as possible. The location of the surveyed trees also seem to be accurate.

Area of disturbance: tree protection shall be added to tree 10. As long as protective fencing stays in place there are no concerns for impact. If the project involved disturbance in this area its recommended to airspace in the CRZ/dripline. From there we can assess how to mitigate.

MERCER ISLAND TREE INVENTORY & REPLACEMENT

SUBMITTAL INFORMATION FORM: This form looks to be accurate and matches the arborist report and calculations.

CITY OF MERCER ISLAND

COMMUNITY PLANNING & DEVELOPMENT

9611 SE 36TH STREET | MERCER ISLAND, WA 98040

PHONE: 206.275.7605 | www.mercergov.org



MERCER ISLAND TREE INVENTORY & REPLACEMENT SUBMITTAL INFORMATION

PROJECT INFORMATION

Property Owner
Name: _____

Site Address or
Parcel Number: _____

Project Contact
Name: _____

Contact Email
Address: _____

Contact Phone
Number: _____

EXCEPTIONAL TREES

Exceptional Trees- means a tree or group of trees that because of its unique historical, ecological or aesthetic value constitutes an important community resource. A tree that is rare or exceptional by virtue of its size, species, condition, cultural/historical importance, age, and/or contribution as part of a tree grove. Trees with a diameter of more than 36 inches, or with a diameter that is equal to or greater than the diameter listed in the Exceptional Tree Table shown in MICC 19.16 under Tree, Exceptional.

List the total number of trees for each category and the tree identification numbers from the arborist report.

Number of trees 36" or greater _____

List tree numbers: _____

Number of trees 24" or greater (including 36" or greater) _____

List tree numbers: _____

Number of trees from Exceptional Tree Table (MICC 19.16) _____

List tree numbers: _____

LARGE REGULATED TREES

Large Regulated Trees- means any tree with a diameter of 10 inches or more, and any tree that meets the definition of an Exceptional Tree.

Number of Large Regulated Trees on site _____ (A)

List tree numbers: _____

Number of Large Regulated Trees on site proposed for removal _____ (B)

List tree numbers: _____

Percentage of trees to be retained ((A-B)/Ax100) note: must be at least 30% _____ 61.9 %

RIGHT OF WAY TREES

Right of Way Trees- means a tree that is located in the street right of way adjacent to the project property.

Number of Large Regulated Trees in right of way _____

List tree numbers: _____

Number of Large Regulated Trees in right of way proposed for removal _____

List tree numbers: _____

Reason for removal: _____

TREE REPLACEMENT

Tree replacement- removed trees must be replaced based on the ratio in the table below. Replacement trees shall be conifers at least six feet tall and or deciduous at least one and one-half inches in diameter at base.

Diameter of Removed Tree (measured 4.5' above ground)	Tree replacement Ratio	Number of Trees Proposed for Removal	Number of Tree Required for Replacement Based on Size/Type
Less than 10"*	1		
10" up to 24"	2		
Greater than 24" up to 36"	3		
Greater than 36" and any Exceptional Tree	6		
TOTAL TREE REPLACEMENTS			

****no replacement tree is needed if the tree fits all of the following;
Less than 10 inches in diameter, not an exceptional tree, and not a replacement tree from another tree permit.

*****Note: In Phase 1 (proposed ADU), only tree 8 (36") and tree 9 (24") will be removed. Therefore, the total tree replacements in Phase 1 is 6+2 = 8 trees. The remaining will be removed at a later time during phase 2/3. (see project narrative for details)***