



STRUCTURAL CALCULATIONS

Cheshire Upper Lot Residence

PROJECT LOCATION

7615 E Mercer Way
Mercer Island, WA

BY
KEVIN J. HAIAR, P.E.

MERRELL DESIGN SERVICES PLLC
SPOKANE, WA



REV 1: 3/28/25
CLARIFIED SEISMIC
CRITERIA & LATERAL
DESIGN

REV 2: 6/10/25
SITE RETAINING WALL
DESIGN ADDED

DATE
12/15/24

**TABLE R301.2(1)
CLIMATIC AND GEOGRAPHIC DESIGN
CRITERIA**

| ROOF SNOW LOAD ^a (psf) | WIND DESIGN | | | | SEISMIC DESIGN CATEGORY | SUBJECT TO DAMAGE FROM | | | OUTDOOR DESIGN TEMP (F) - Heat/Cool | ICE BARRIER UNDERLAYMENT REQUIRED | FLOOD HAZARD ^o | AIR FREEZING INDEX | MEAN ANNUAL TEMP |
|-----------------------------------|--------------------------|----------------------------------|-----------------------|-----------------------|----------------------------|---------------------------|----------------------------|--------------------------------|-------------------------------------|-----------------------------------|---------------------------|--------------------|------------------|
| | Speed ^b (mph) | Topographic effects ^c | Special wind region | Windborne debris zone | | Weathering ^d | Frost line depth | Termite | | | | | |
| 25 | 110 | Yes | No | No | D2 | Moderate | 12" | Slight to Moderate | 83/24 | No | N.A. | 113 | 53 |
| MANUAL J DESIGN CRITERIA | | | | | | | | | | | | | |
| Elevation | | Latitude | Winter heating | Summer cooling | Altitude correction factor | Indoor design temperature | Design temperature cooling | Heating temperature difference | | | | | |
| 338 feet | | 47°34'39" | 72°F max | 75°F min | 0.99 | 72°F | 75°F | 48°F | | | | | |
| Cooling temperature difference | | Wind velocity heating | Wind velocity cooling | Coincident wet bulb | Daily range | Winter humidity | Summer humidity | | | | | | |
| 8°F | | N.A. | N.A. | 66 | Medium | 75% | 68% | | | | | | |

- a. This is the minimum roof snow load. When using this snow load it will be left to the engineer's judgment whether to consider drift or sliding snow. However, rain on snow surcharge of 5 psf must be considered for roof slopes less than 5 degrees.
- b. The 110 mph Ultimate Design Wind Speed (3-second gust) as adopted by the 2018 IRC/ASCE 7-10 (or if using the IBC for structural design, the 98 mph Basic Design Wind Speed as adopted by the 2018 IBC/ASCE 7-16 may be used).
- c. Wind exposure category and Topographic effects (Wind Speed-up Kzt factor) shall be determined on a site-specific basis by the Engineer of Record (components and cladding need not consider topographic effects unless otherwise determined by the engineer of record).
- d. Weathering may require a higher strength concrete or grade of masonry than necessary to satisfy the structural requirements of this code. The grade of masonry units shall be determined from ASTM C 34, C 55, C 62, C 73, C 90, C 129, C 145, C 216 or C 652.
- e. The City of Mercer Island participates in the National Flood Insurance Program (NFIP); Regular Program (No Special Flood Hazard Area). Further NFIP participation information: CID 530083, Initial FHBM Identified 06/28/74, Initial FIRM Identified 05/16/95, Current Effective Map Date (NSFHA), Reg-Emer Date 06/30/97, 53033C0654G effective 8/19/2020.

WIND EXPOSURE CATEGORIES & WIND SPEED-UP FACTORS (ICC Section 1609 & ASCE 7-05 Chapter 6)

It is the responsibility of the Owner (or their Design Professional) to review site conditions and determine the K_{zt} factor to be utilized for each specific project. The K_{zt} factors and wind exposure categories indicated on this map are the minimum values accepted by the City of Mercer Island without requiring the design professional to submit additional calculations and supporting topographic documentation (to verify the values utilized in their wind load determination).


Please note – The K_{zt} values indicated on this map are approximations based upon periodic calculations of representative samplings around Mercer Island. These values are intended for City of Mercer Island's plan review purposes only.

WIND EXPOSURE CATEGORIES:

Wind Exposure
Category



Exposure 'C' (1500 feet from Lake)



Exposure 'B' (all other areas)

WIND SPEED-UP (TOPOGRAPHIC EFFECT) - K_{zt} Factor :

K_{zt} Factor



$K_{zt} = 1.0$




$K_{zt} = 1.3$



$K_{zt} = 1.6$



$K_{zt} = 1.9$

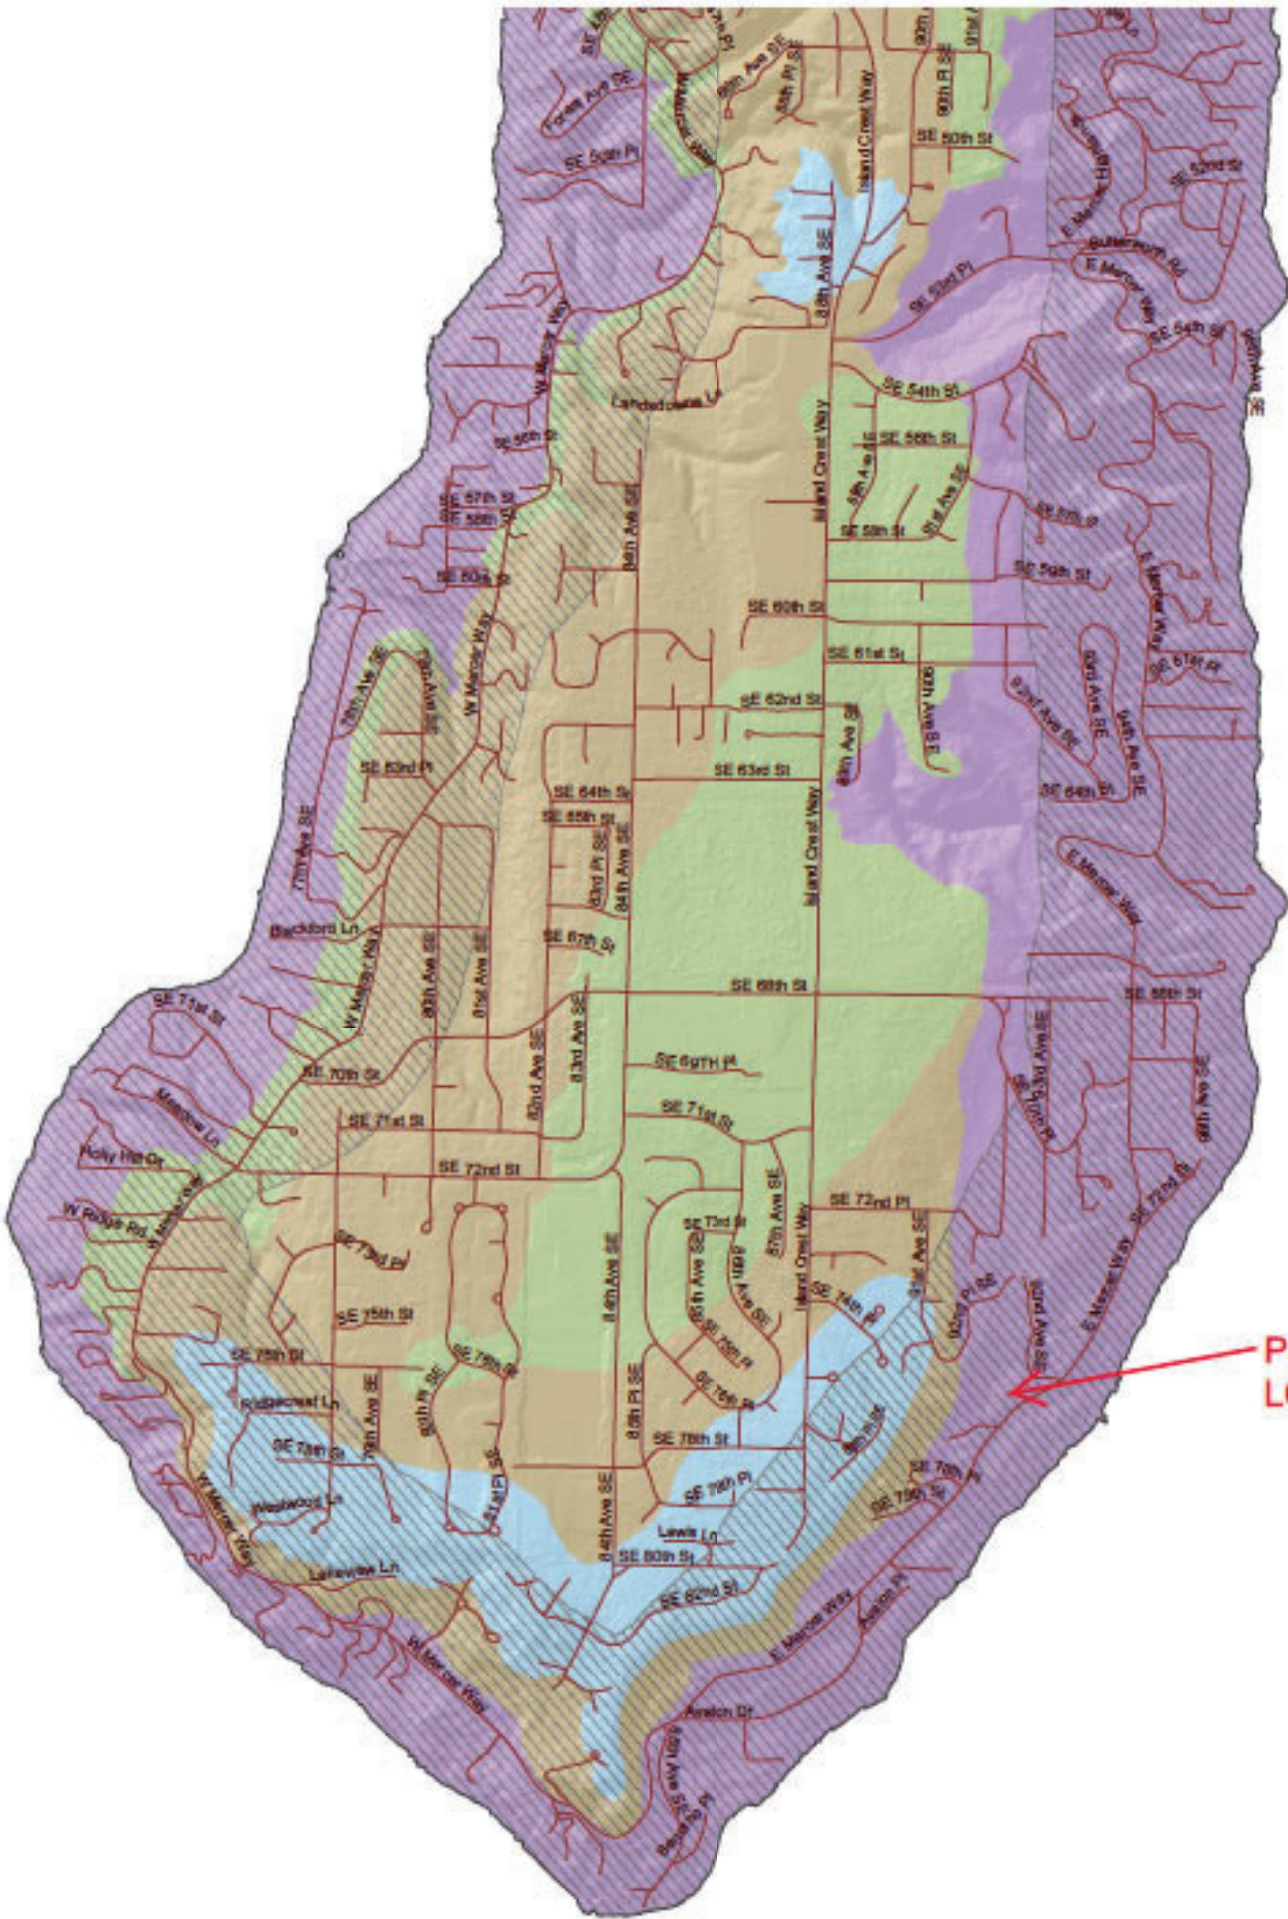

PROJECT
LOCATION

Summary

The project involves a new custom two-story home with attached garage located on Mercer Island, WA. The footprint is about 74 ft x 50 ft and includes single slope roofs with large overhangs. The framing will consist of conventional wood framing with concrete footings based on a geotech recommendations.

Design Codes

2021 International Building Code
ASCE/SEI 7-22
ACI 318 Concrete 2019
2024 NDS Wood

REV 1

Design Criteria

Roof Snow + 5psf Rain on Snow Load: 30 psf
 Wind Speed: 110 mph
 Wind Exposure: C
 Seismic Design Category: D
 Seismic S_s: 1.63
 Seismic S₁: 0.62
 Allowable Soil Bearing: 2000 psf
 (Earth Solutions NW
 Geotech Report)

REPORT SUMMARY

Site Information

| | |
|----------------|---|
| Address: | 7615 E Mercer Way, Mercer Island, Washington, 98040 |
| Elevation: | 147 ft (NAVD 88) |
| Lat: | 47.534526 |
| Long: | -122.216267 |
| Standard: | ASCE/SEI 7-22 |
| Risk Category: | II |
| Soil Class: | DE |

Seismic Data

| | |
|-------------------------|------|
| S _s | 1.63 |
| S ₁ | 0.62 |
| S _{MS} | 1.67 |
| S _{M1} | 1.61 |
| S _{DS} | 1.11 |
| S _{D1} | 1.07 |
| T _L | 6 |
| PGA _M | 0.7 |
| V _{S30} | 185 |
| Seismic Design Category | D |

Gravity Loads

| <u>Roof Dead Loads:</u> | <u>Weight (psf)</u> |
|-------------------------|---------------------|
| Roofing | 1.0 |
| Decking | 2.0 |
| Roof Joists/Trusses | 3.0 |
| Insulation | 1.0 |
| Gyp Ceiling | 2.5 |
| Mech/Elec | 3.5 |
| Misc. | 2.0 |

Total Roof Dead Load **15.0**

| <u>Roof Live Loads:</u> | <u>Weight (psf)</u> |
|-------------------------|---------------------|
| Roof Live Load | 20.0 |
| Snow Load + Rain | 30.0 |

| <u>Ext. Wall Dead Loads:</u> | <u>Weight (psf)</u> |
|------------------------------|---------------------|
| 6" studs | 1.8 |
| Sheathing, 15/32" | 1.5 |
| Insulation | 1.2 |
| Ext finish (siding) | 5 |
| Misc | 2.5 |

Total Wall Load **12**

| <u>Floor Dead Loads:</u> | <u>Weight (psf)</u> |
|--------------------------|---------------------|
| Flooring | 1.5 |
| Gypcrete/overlay (1.5") | 0.0 |
| Joists | 3.0 |
| Gyp Ceiling | 2.5 |
| Mech/Elec | 3.5 |
| Misc. | 4.5 |

Total Floor Dead Load **15.0**


| <u>Floor Live Loads:</u> | <u>Weight (psf)</u> |
|--------------------------|---------------------|
| Residential | 40 |

| Interior Strip Footings - 15ft trib | Load (PLF) |
|-------------------------------------|------------|
| Dead | 450 |
| Live | 600 |
| Snow | 450 |


Allowable Bearing, 2000 psf **2000**

Minimum footing width, ft **1**

USE MINIMUM 1'-4" WIDE BY 12" DEEP CONT FTG AT INTERIOR AND EXTERIOR STRIP FOOTINGS

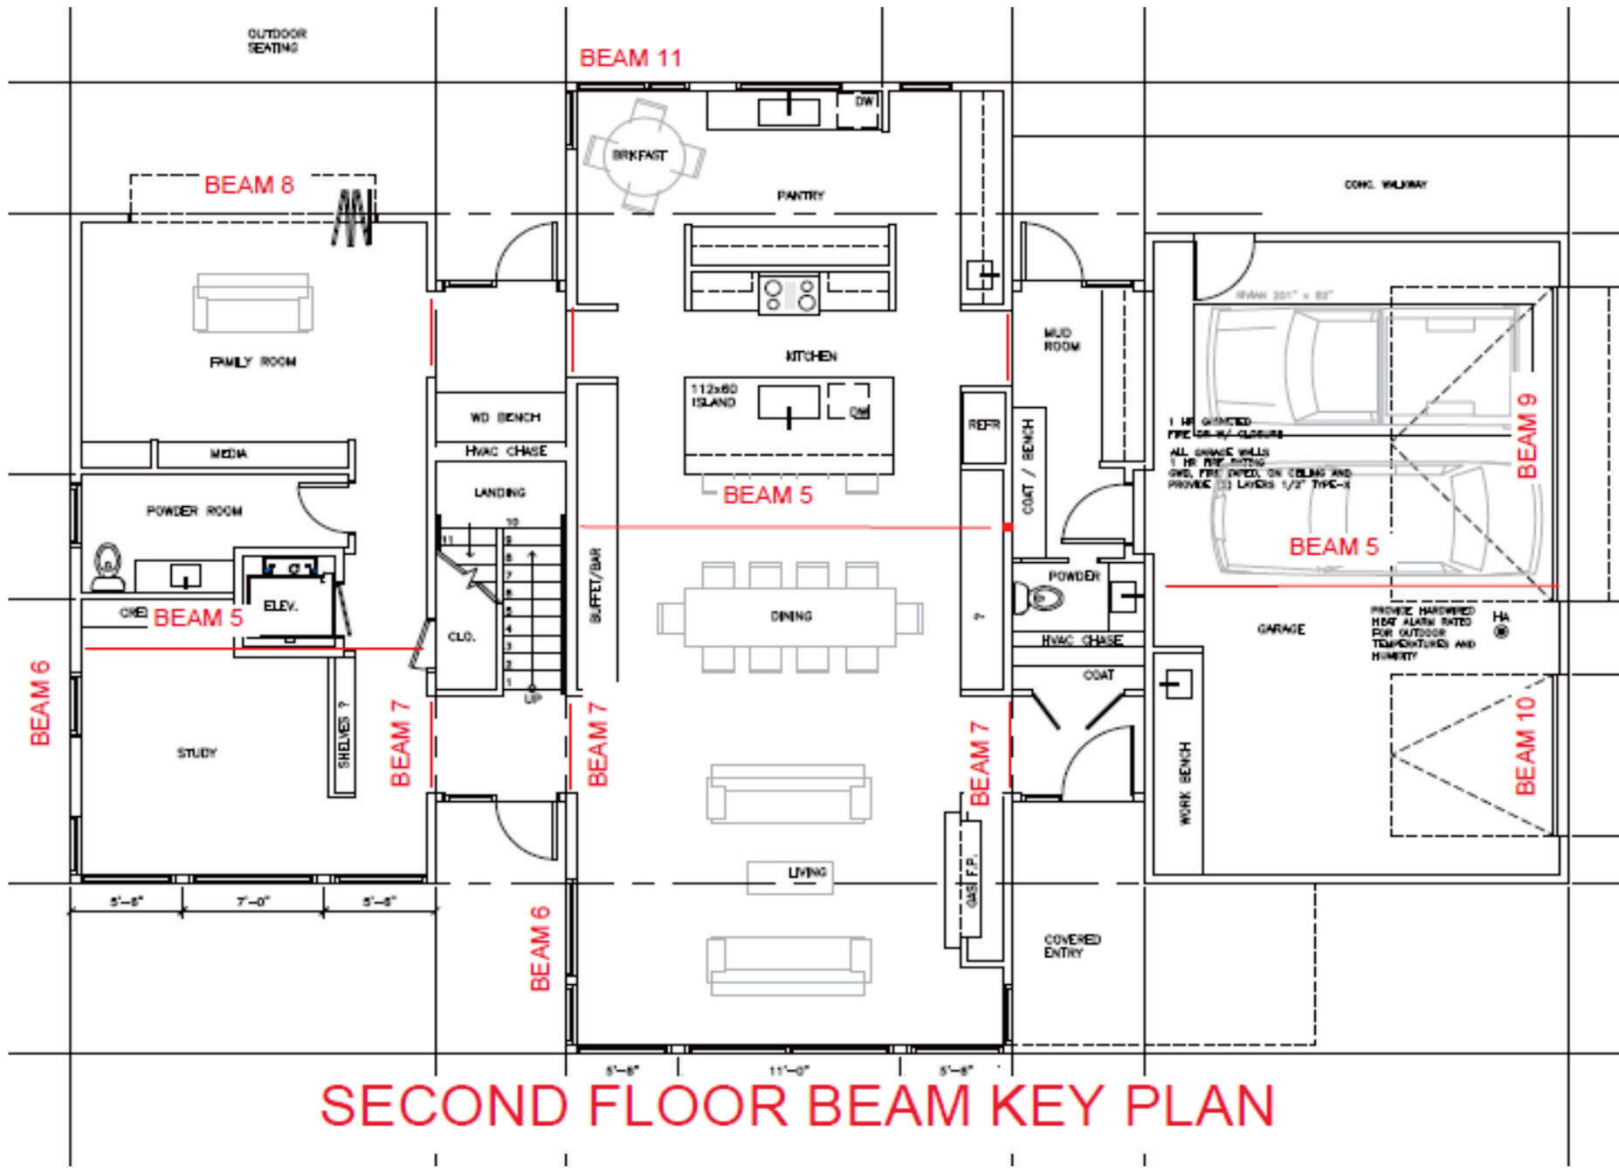

SECOND FLOOR BEAM KEY PLAN

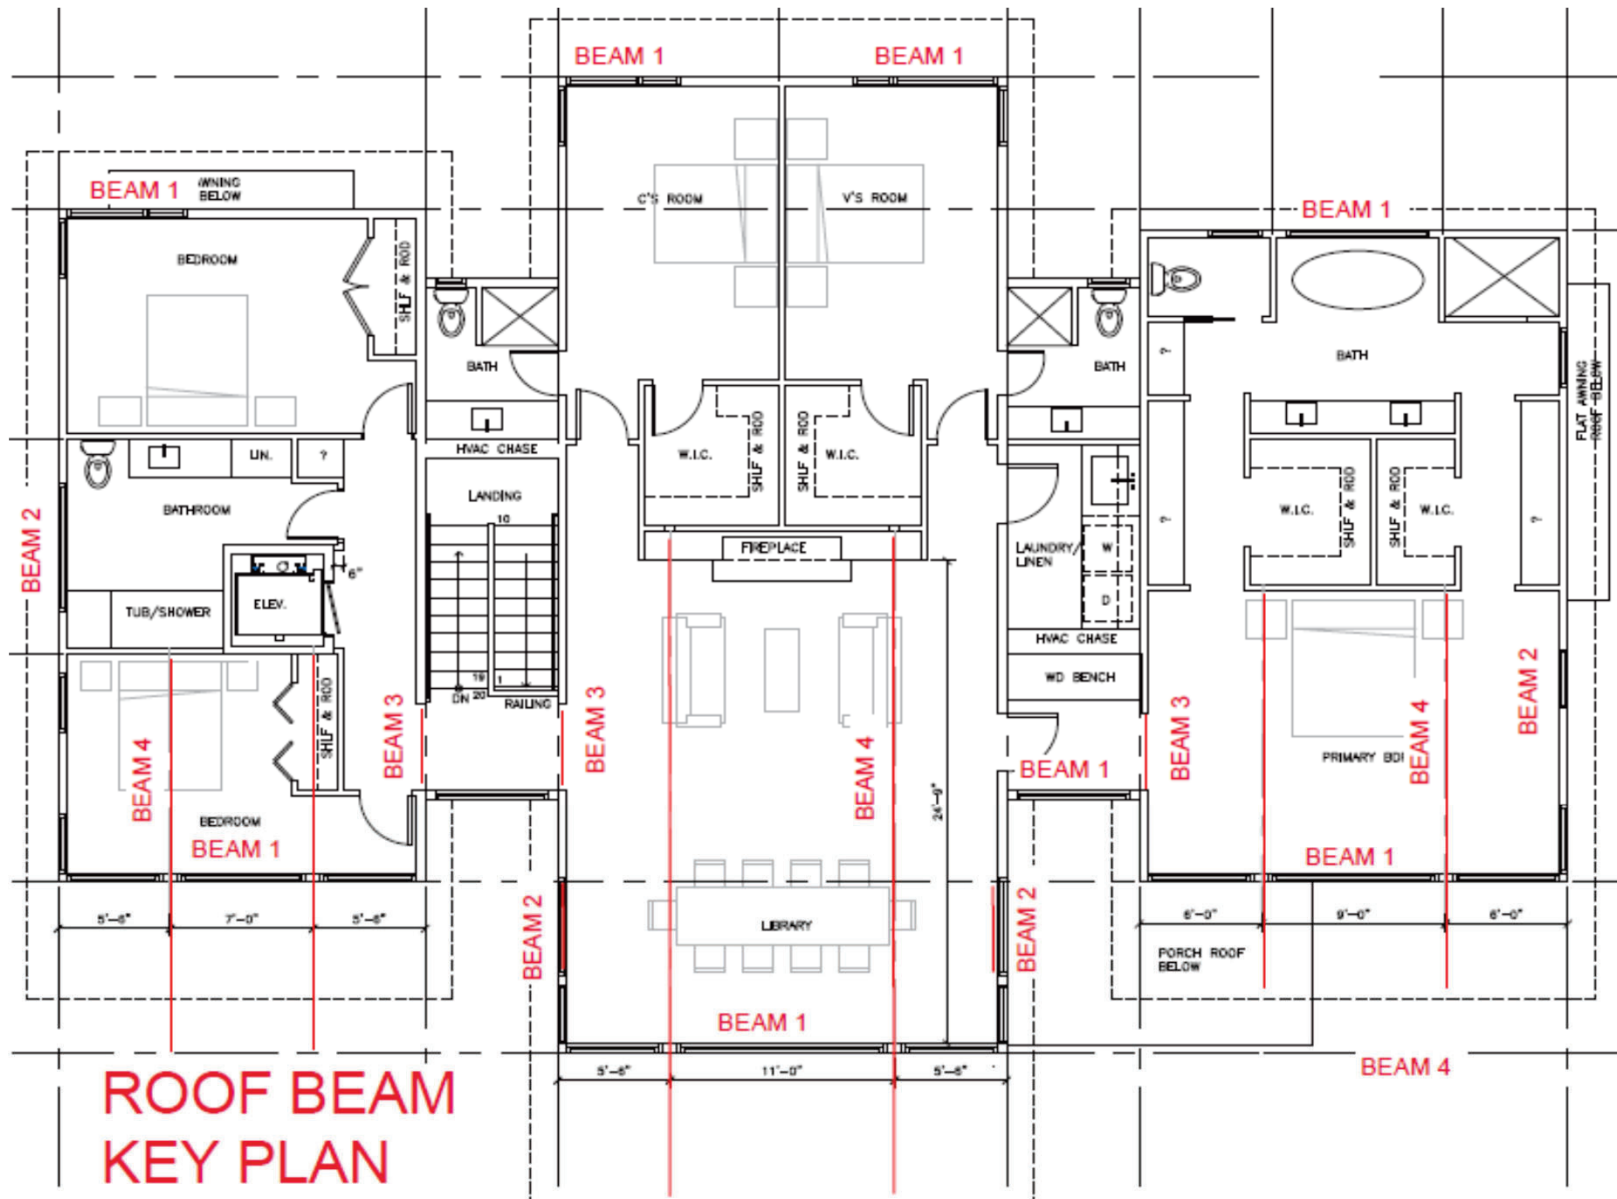

Roof & Second Floor Framing Beams

| BM # | Description | location | Span ft | Roof Trib ft | R DL PLF | Roof S PLF | Roof Live PLF | Floor Trib ft | FL Live PSF | FL Dead PLF | FL Live PLF | Beam Size |
|-------|--------------------|-----------|------------|-----------------|-------------|---------------|------------------|------------------|----------------|----------------|----------------|-----------------|
| BM 1 | Rf Ext Non Brg Hdr | Roof | 6 | 2 | 30 | 60 | 40 | 0 | 0 | 0 | 0 | (2) 2x10 DFL #2 |
| Bm 2 | Rf Ext Brg Hdr | Roof | 7 | 12 | 180 | 360 | 240 | 0 | 0 | 0 | 0 | (2) 2x10 DFL #2 |
| BM 3 | Int Brg Hdr | Roof | 5 | 14.5 | 217.5 | 435 | 290 | 0 | 0 | 0 | 0 | (2) 2x10 DFL #2 |
| BM 4 | Roof Girders | Roof | 27 | 8.5 | 127.5 | 255 | 170 | | 40 | 0 | 0 | GL 6.75x24 |
| BM 5 | Second Flr Tfr Bms | 2nd Floor | 22 | Conc | 1.7k | 3.3k | 2.2k | 1.33 | 40 | 20 | 53 | GL 6.75x15 |
| BM 6 | Ext Brg Hdr | 2nd Floor | 6 | 9 | 135 | 270 | 180 | 9 | 40 | 135 | 360 | (2) 2x10 DFL #2 |
| BM 7 | Int Brg Hdr | 2nd Floor | 6 | 14 | 210 | 420 | 280 | 14 | 40 | 210 | 560 | (2) 2x10 DFL #2 |
| BM 8 | Folding Door hdr | 2nd Floor | 12 | 2 | 30 | 60 | 40 | 2 | 40 | 30 | 80 | GL 5.5x10.5 |
| BM 9 | Large Gar Hdr | 2nd Floor | 16.5 | 12 | 180 | 360 | 240 | 10.5 | 40 | 158 | 420 | GL 5.5x13.5 |
| BM 10 | Short Gar Hdr | 2nd Floor | 8.5 | 12 | 180 | 360 | 240 | 10.5 | 40 | 158 | 420 | GL 5.5x9 |
| BM 11 | Ext Non Brg Hdr | 2nd Floor | 5 | 5 | 75 | 150 | 100 | 5 | 40 | 75 | 200 | (2) 2x10 DFL #2 |

| BM # | Description | location | BM Reaction (left) | | | | BM Reaction (right) | | | | Post Size | Ftg Size (2000psf) (ft) |
|-------|--------------------|-----------|--------------------|------------|-----------|------------|---------------------|------------|-----------|------------|-----------|----------------------------|
| | | | DL k | FL LL k | Snow k | Total k | DL k | FL LL k | Snow k | Total k | | |
| BM 1 | Rf Ext Non Brg Hdr | Roof | 0.5 | 0.0 | 0.5 | 1.0 | 0.5 | 0.0 | 0.5 | 1.0 | (2) studs | 0.7 |
| Bm 2 | Rf Ext Brg Hdr | Roof | 0.6 | | 1.3 | 1.9 | 0.6 | 0.0 | 1.3 | 1.9 | (2) studs | 1.0 |
| BM 3 | Int Brg Hdr | Roof | 0.5 | | 1.1 | 1.6 | 0.5 | 0.0 | 1.1 | 1.6 | (2) studs | 0.9 |
| BM 4 | Roof Girders | Roof | 1.7 | | 3.3 | 5.0 | 3.0 | | 6.1 | 9.1 | (3) studs | 1.3 |
| BM 5 | Second Flr Tfr Bms | 2nd Floor | 1.7 | | 3.3 | 5.0 | 1.7 | 0.0 | 3.3 | 5.0 | (2) studs | 1.3 |
| BM 6 | Ext Brg Hdr | 2nd Floor | 0.4 | 1.0 | 0.8 | 1.8 | 0.4 | 1.0 | 0.8 | 1.8 | (2) studs | 0.9 |
| BM 7 | Int Brg Hdr | 2nd Floor | 0.5 | 1.7 | 1.3 | 2.8 | 0.5 | 2.0 | 1.3 | 2.8 | (2) studs | 1.2 |
| BM 8 | Folding Door hdr | 2nd Floor | 0.2 | 1.0 | 0.4 | 1.3 | 0.2 | 2.0 | 0.4 | 1.3 | (2) studs | 0.8 |
| BM 9 | Large Gar Hdr | 2nd Floor | 2.8 | 3.5 | 3.0 | 7.7 | 2.8 | 2.0 | 3.0 | 7.7 | (2) studs | 1.3 |
| BM 10 | Short Gar Hdr | 2nd Floor | 1.5 | 1.8 | 1.5 | 4.0 | 1.5 | 3.0 | 1.5 | 4.0 | (2) studs | 1.3 |
| BM 11 | Ext Non Brg Hdr | 2nd Floor | 0.4 | 0.5 | 0.4 | 1.1 | 0.4 | 3.0 | 0.4 | 1.1 | (2) studs | 0.7 |

NOTES:

1. SEE ENERCALC OUTPUT SHEETS FOR BEAM DESIGNS
2. TOTAL LOAD INCLUDES LOAD CASES D+L, $D=0.75*L+0.75*S$

Wood Beam

Project File: cheshire framing 20241204.ec6

LIC# : KW-06011847, Build:20.23.08.30

Merrell Design Services PLLC

(c) ENERCALC INC 1983-2023

DESCRIPTION: Beam 1 Rf non brg hdr


CODE REFERENCES

Calculations per NDS 2018, IBC 2018, CBC 2019, ASCE 7-16

Load Combination Set : IBC 2021

Material Properties

| | | | | |
|--|-----------|----------|----------------------------------|----------|
| Analysis Method : Allowable Stress Design | Fb + | 900 psi | <i>E : Modulus of Elasticity</i> | |
| Load Combination : IBC 2021 | Fb - | 900 psi | Ebend- xx | 1600ksi |
| | Fc - Prll | 1350 psi | Eminbend - xx | 580ksi |
| Wood Species : Douglas Fir-Larch | Fc - Perp | 625 psi | | |
| Wood Grade : No.2 | Fv | 180 psi | | |
| | Ft | 575 psi | Density | 31.21pcf |
| Beam Bracing : Beam is Fully Braced against lateral-torsional buckling | | | | |

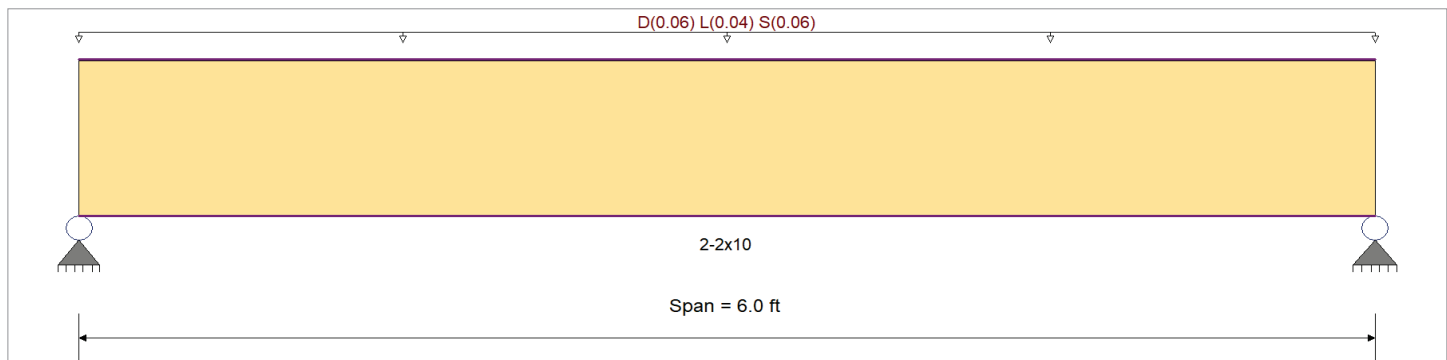

Applied Loads

Service loads entered. Load Factors will be applied for calculations.

Beam self weight calculated and added to loading

Uniform Load : D = 0.030, L = 0.020, S = 0.030 ksf, Tributary Width = 2.0 ft

DESIGN SUMMARY

Design OK

| | | | |
|-----------------------------------|-------------------------------------|------------------------------|------------------|
| Maximum Bending Stress Ratio = | 0.156 1 | Maximum Shear Stress Ratio = | 0.082 : 1 |
| Section used for this span | 2-2x10 | Section used for this span | 2-2x10 |
| fb: Actual = | 177.99psi | fv: Actual = | 17.03 psi |
| F'b = | 1,138.50psi | F'v = | 207.00 psi |
| Load Combination | +D+0.750L+0.750S | Load Combination | +D+0.750L+0.750S |
| Location of maximum on span | = 3.000ft | Location of maximum on span | = 0.000ft |
| Span # where maximum occurs | = Span # 1 | Span # where maximum occurs | = Span # 1 |
| Maximum Deflection | | | |
| Max Downward Transient Deflection | 0.006 in Ratio = 12952 >=360 | Span: 1 : S Only | |
| Max Upward Transient Deflection | 0 in Ratio = 0 <360 | n/a | |
| Max Downward Total Deflection | 0.013 in Ratio = 5511 >=240 | Span: 1 : +D+0.750L+0.750S | |
| Max Upward Total Deflection | 0 in Ratio = 0 <240 | n/a | |

Maximum Forces & Stresses for Load Combinations

| Load Combination | Segment Length | Span # | Max Stress Ratios | | | | | | | | | | Moment Values | | | Shear Values | | | |
|------------------|-----------------|--------|-------------------|-------|------|------|----------------|------|----------------|-----------------|----------------|----------------|---------------|-------|---------|--------------|------|-----|-----|
| | | | M | V | CD | CM | C _t | CLx | C _F | C _{fu} | C _i | C _r | M | fb | F'b | V | fv | F'v | |
| D Only | Length = 6.0 ft | 1 | 0.094 | 0.049 | 0.90 | 1.00 | 1.00 | 1.00 | 1.100 | 1.00 | 1.00 | 1.00 | 0.30 | 83.3 | 891.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| +D+L | Length = 6.0 ft | 1 | 0.135 | 0.071 | 1.00 | 1.00 | 1.00 | 1.00 | 1.100 | 1.00 | 1.00 | 1.00 | 0.48 | 133.8 | 990.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| +D+S | Length = 6.0 ft | 1 | 0.140 | 0.073 | 1.15 | 1.00 | 1.00 | 1.00 | 1.100 | 1.00 | 1.00 | 1.00 | 0.57 | 159.1 | 1,138.5 | 0.0 | 0.00 | 0.0 | 0.0 |
| +D+0.750L | Length = 6.0 ft | 1 | 0.098 | 0.052 | 1.25 | 1.00 | 1.00 | 1.00 | 1.100 | 1.00 | 1.00 | 1.00 | 0.43 | 121.2 | 1,237.5 | 0.0 | 0.00 | 0.0 | 0.0 |
| +D+0.750L+0.750S | Length = 6.0 ft | 1 | 0.156 | 0.082 | 1.15 | 1.00 | 1.00 | 1.00 | 1.100 | 1.00 | 1.00 | 1.00 | 0.63 | 178.0 | 1,138.5 | 0.0 | 0.00 | 0.0 | 0.0 |



Wood Beam

Project File: cheshire framing 20241204.ec6

LIC# : KW-06011847, Build:20.23.08.30

Merrell Design Services PLLC

(c) ENERCALC INC 1983-2023

DESCRIPTION: Beam 1 Rf non brg hdr

Maximum Forces & Stresses for Load Combinations

| Load Combination | Segment Length | Span # | Max Stress Ratios | | | | | | | | | | Moment Values | | | Shear Values | | |
|------------------|----------------|--------|-------------------|-------|------|------|----------------|------|----------------|-----------------|----------------|----------------|---------------|------|----------------|--------------|----------------|----------------|
| | | | M | V | CD | CM | C _t | CLx | C _F | C _{fu} | C _i | C _r | M | fb | F ^b | V | f _v | F ^v |
| +0.60D | | | | | | 1.00 | 1.00 | 1.00 | 1.100 | 1.00 | 1.00 | 1.00 | | | 0.0 | 0.00 | 0.0 | 0.0 |
| Length = 6.0 ft | 1 | | 0.032 | 0.017 | 1.60 | 1.00 | 1.00 | 1.00 | 1.100 | 1.00 | 1.00 | 1.00 | 0.18 | 50.0 | 1,584.0 | 0.09 | 4.8 | 288.0 |

Overall Maximum Deflections

| Load Combination | Span | Max. "-" Defl | Location in Span | Load Combination | Max. "+" Defl | Location in Span |
|------------------|------|---------------|------------------|------------------|---------------|------------------|
| +D+0.750L+0.750S | 1 | 0.0131 | 3.022 | | 0.0000 | 0.000 |

Vertical Reactions

Support notation : Far left is #1

Values in KIPS

| Load Combination | Support 1 | Support 2 |
|-------------------------------------|-----------|-----------|
| Max Upward from all Load Conditions | 0.423 | 0.423 |
| Max Upward from Load Combinations | 0.423 | 0.423 |
| Max Upward from Load Cases | 0.198 | 0.198 |
| D Only | 0.198 | 0.198 |
| +D+L | 0.318 | 0.318 |
| +D+S | 0.378 | 0.378 |
| +D+0.750L | 0.288 | 0.288 |
| +D+0.750L+0.750S | 0.423 | 0.423 |
| +0.60D | 0.119 | 0.119 |
| L Only | 0.120 | 0.120 |
| S Only | 0.180 | 0.180 |

Wood Beam

Project File: cheshire framing 20241204.ec6

LIC# : KW-06011847, Build:20.23.08.30

Merrell Design Services PLLC

(c) ENERCALC INC 1983-2023

DESCRIPTION: Beam 2 Roof Ext Brg Hdr


CODE REFERENCES

Calculations per NDS 2018, IBC 2018, CBC 2019, ASCE 7-16

Load Combination Set : IBC 2021

Material Properties

| | | | | |
|--|-----------|-------------|----------------------------------|------------|
| Analysis Method : Allowable Stress Design | Fb + | 900.0 psi | <i>E : Modulus of Elasticity</i> | |
| Load Combination : IBC 2021 | Fb - | 900.0 psi | Ebend- xx | 1,600.0ksi |
| | Fc - Prll | 1,350.0 psi | Eminbend - xx | 580.0ksi |
| Wood Species : Douglas Fir-Larch | Fc - Perp | 625.0 psi | | |
| Wood Grade : No.2 | Fv | 180.0 psi | | |
| | Ft | 575.0 psi | Density | 31.210pcf |
| Beam Bracing : Beam is Fully Braced against lateral-torsional buckling | | | | |

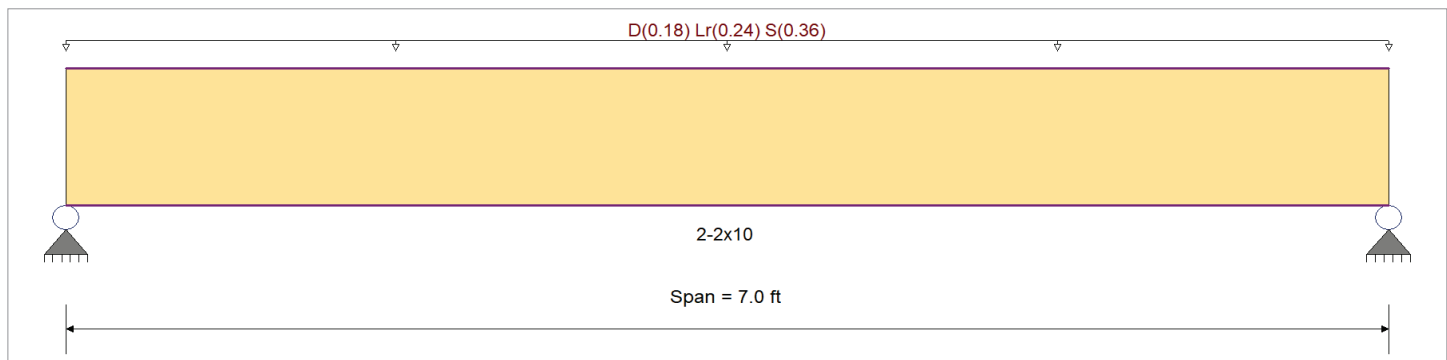

Applied Loads

Service loads entered. Load Factors will be applied for calculations.

Beam self weight NOT internally calculated and added

Uniform Load : D = 0.0150, Lr = 0.020, S = 0.030 ksf, Tributary Width = 12.0 ft

DESIGN SUMMARY

Design OK

| | | | |
|-----------------------------------|------------------|------------------------------|------------------|
| Maximum Bending Stress Ratio = | 0.815 : 1 | Maximum Shear Stress Ratio = | 0.385 : 1 |
| Section used for this span | 2-2x10 | Section used for this span | 2-2x10 |
| fb: Actual = | 927.74psi | fv: Actual = | 79.79 psi |
| F'b = | 1,138.50psi | F'v = | 207.00 psi |
| Load Combination | +D+S | Load Combination | +D+S |
| Location of maximum on span | 3.500ft | Location of maximum on span | 6.234 ft |
| Span # where maximum occurs | Span # 1 | Span # where maximum occurs | Span # 1 |
| Maximum Deflection | | | |
| Max Downward Transient Deflection | 0.062 in Ratio = | 1359 >=360 | Span: 1 : S Only |
| Max Upward Transient Deflection | 0 in Ratio = | 0 <360 | n/a |
| Max Downward Total Deflection | 0.093 in Ratio = | 906 >=240 | Span: 1 : +D+S |
| Max Upward Total Deflection | 0 in Ratio = | 0 <240 | n/a |

Maximum Forces & Stresses for Load Combinations

| Load Combination | Segment Length | Span # | Max Stress Ratios | | | | | | | | | | Moment Values | | | Shear Values | | | |
|------------------|-----------------|--------|-------------------|-------|------|------|----------------|------|----------------|-----------------|----------------|----------------|---------------|-------|---------|--------------|------|-----|-----|
| | | | M | V | CD | CM | C _t | CLx | C _F | C _{fu} | C _i | C _r | M | fb | F'b | V | fv | F'v | |
| D Only | Length = 7.0 ft | 1 | 0.347 | 0.164 | 0.90 | 1.00 | 1.00 | 1.00 | 1.100 | 1.00 | 1.00 | 1.00 | 1.10 | 309.2 | 891.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| +D+Lr | Length = 7.0 ft | 1 | 0.583 | 0.276 | 1.25 | 1.00 | 1.00 | 1.00 | 1.100 | 1.00 | 1.00 | 1.00 | 2.57 | 721.6 | 1,237.5 | 0.0 | 0.00 | 0.0 | 0.0 |
| +D+S | Length = 7.0 ft | 1 | 0.815 | 0.385 | 1.15 | 1.00 | 1.00 | 1.00 | 1.100 | 1.00 | 1.00 | 1.00 | 3.31 | 927.7 | 1,138.5 | 0.0 | 0.00 | 0.0 | 0.0 |
| +D+0.750Lr | Length = 7.0 ft | 1 | 0.500 | 0.236 | 1.25 | 1.00 | 1.00 | 1.00 | 1.100 | 1.00 | 1.00 | 1.00 | 2.21 | 618.5 | 1,237.5 | 0.0 | 0.00 | 0.0 | 0.0 |
| +D+0.750S | Length = 7.0 ft | 1 | 0.679 | 0.321 | 1.15 | 1.00 | 1.00 | 1.00 | 1.100 | 1.00 | 1.00 | 1.00 | 2.76 | 773.1 | 1,138.5 | 0.0 | 0.00 | 0.0 | 0.0 |



Merrell Design Services
Practical Structural Solutions

Project Title: Cheshire Upper Lot
 Engineer: KJH
 Project ID: 23-067
 Project Descr: Two-Story Residence Fdns & Framing

Wood Beam

Project File: cheshire framing 20241204.ec6

LIC# : KW-06011847, Build:20.23.08.30

Merrell Design Services PLLC

(c) ENERCALC INC 1983-2023

DESCRIPTION: Beam 2 Roof Ext Brg Hdr

Maximum Forces & Stresses for Load Combinations

| Load Combination | Segment Length | Span # | Max Stress Ratios | | | | | | | | | | Moment Values | | | Shear Values | | |
|------------------|----------------|--------|-------------------|-------|------|------|----------------|------|----------------|-----------------|----------------|----------------|---------------|-------|----------------|--------------|----------------|----------------|
| | | | M | V | CD | CM | C _t | CLx | C _F | C _{fu} | C _i | C _r | M | fb | F ^b | V | f _v | F ^v |
| +0.60D | | | | | | 1.00 | 1.00 | 1.00 | 1.100 | 1.00 | 1.00 | 1.00 | | | 0.0 | 0.00 | 0.0 | 0.0 |
| Length = 7.0 ft | 1 | | 0.117 | 0.055 | 1.60 | 1.00 | 1.00 | 1.00 | 1.100 | 1.00 | 1.00 | 1.00 | 0.66 | 185.5 | 1,584.0 | 0.30 | 16.0 | 288.0 |

Overall Maximum Deflections

| Load Combination | Span | Max. "-" Defl | Location in Span | Load Combination | Max. "+" Defl | Location in Span |
|------------------|------|---------------|------------------|------------------|---------------|------------------|
| +D+S | 1 | 0.0927 | 3.526 | | 0.0000 | 0.000 |

Vertical Reactions

Support notation : Far left is #1

Values in KIPS

| Load Combination | Support 1 | Support 2 |
|-------------------------------------|-----------|-----------|
| Max Upward from all Load Conditions | 1.890 | 1.890 |
| Max Upward from Load Combinations | 1.890 | 1.890 |
| Max Upward from Load Cases | 1.260 | 1.260 |
| D Only | 0.630 | 0.630 |
| +D+Lr | 1.470 | 1.470 |
| +D+S | 1.890 | 1.890 |
| +D+0.750Lr | 1.260 | 1.260 |
| +D+0.750S | 1.575 | 1.575 |
| +0.60D | 0.378 | 0.378 |
| Lr Only | 0.840 | 0.840 |
| S Only | 1.260 | 1.260 |

Wood Beam

Project File: cheshire framing 20241204.ec6

LIC# : KW-06011847, Build:20.23.08.30

Merrell Design Services PLLC

(c) ENERCALC INC 1983-2023

DESCRIPTION: Beam 3 Int Brg Hdr


CODE REFERENCES

Calculations per NDS 2018, IBC 2018, CBC 2019, ASCE 7-16

Load Combination Set : IBC 2021

Material Properties

| | | | | |
|--|-----------|----------|---------------------------|----------|
| Analysis Method : Allowable Stress Design | Fb + | 900 psi | E : Modulus of Elasticity | |
| Load Combination : IBC 2021 | Fb - | 900 psi | Ebend- xx | 1600ksi |
| | Fc - Prll | 1350 psi | Eminbend - xx | 580ksi |
| Wood Species : Douglas Fir-Larch | Fc - Perp | 625 psi | | |
| Wood Grade : No.2 | Fv | 180 psi | | |
| | Ft | 575 psi | Density | 31.21pcf |
| Beam Bracing : Beam is Fully Braced against lateral-torsional buckling | | | | |

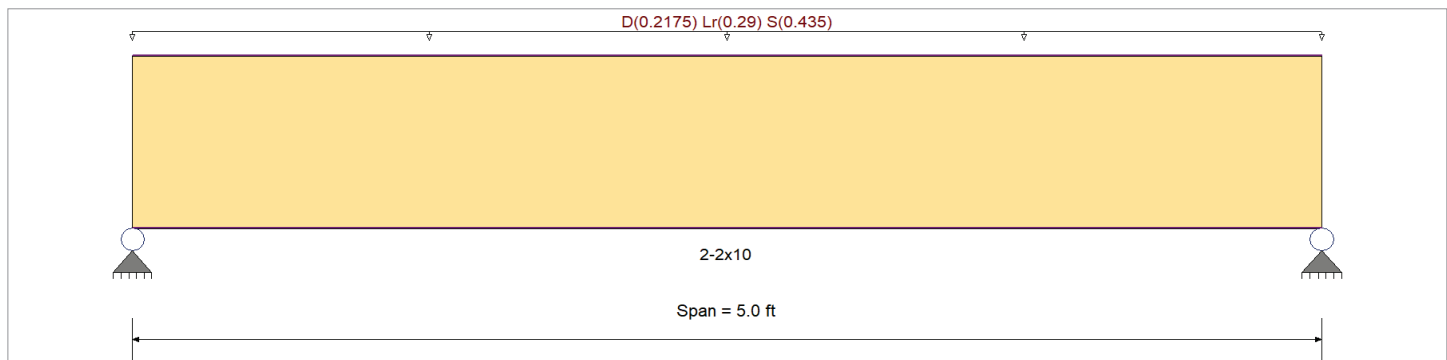

Applied Loads

Service loads entered. Load Factors will be applied for calculations.

Beam self weight NOT internally calculated and added

Uniform Load : D = 0.0150, Lr = 0.020, S = 0.030 ksf, Tributary Width = 14.50 ft

DESIGN SUMMARY

Design OK

| | | | |
|-----------------------------------|------------------|------------------------------|------------------|
| Maximum Bending Stress Ratio = | 0.502 1 | Maximum Shear Stress Ratio = | 0.295 : 1 |
| Section used for this span | 2-2x10 | Section used for this span | 2-2x10 |
| fb: Actual = | 571.95psi | fv: Actual = | 61.14 psi |
| F'b = | 1,138.50psi | F'v = | 207.00 psi |
| Load Combination | +D+S | Load Combination | +D+S |
| Location of maximum on span | = 2.500ft | Location of maximum on span | = 0.000ft |
| Span # where maximum occurs | = Span # 1 | Span # where maximum occurs | = Span # 1 |
| Maximum Deflection | | | |
| Max Downward Transient Deflection | 0.019 in Ratio = | 3087 >=360 | Span: 1 : S Only |
| Max Upward Transient Deflection | 0 in Ratio = | 0 <360 | n/a |
| Max Downward Total Deflection | 0.029 in Ratio = | 2058 >=240 | Span: 1 : +D+S |
| Max Upward Total Deflection | 0 in Ratio = | 0 <240 | n/a |

Maximum Forces & Stresses for Load Combinations

| Load Combination | Segment Length | Span # | Max Stress Ratios | | | | | | | | | | Moment Values | | | Shear Values | | | |
|------------------|-----------------|--------|-------------------|-------|------|------|----------------|------|----------------|-----------------|----------------|----------------|---------------|-------|---------|--------------|------|-----|-----|
| | | | M | V | CD | CM | C _t | CLx | C _F | C _{fu} | C _i | C _r | M | fb | F'b | V | fv | F'v | |
| D Only | Length = 5.0 ft | 1 | 0.214 | 0.126 | 0.90 | 1.00 | 1.00 | 1.00 | 1.100 | 1.00 | 1.00 | 1.00 | 0.68 | 190.7 | 891.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| +D+Lr | Length = 5.0 ft | 1 | 0.359 | 0.211 | 1.25 | 1.00 | 1.00 | 1.00 | 1.100 | 1.00 | 1.00 | 1.00 | 1.59 | 444.9 | 1,237.5 | 0.0 | 0.00 | 0.0 | 0.0 |
| +D+S | Length = 5.0 ft | 1 | 0.502 | 0.295 | 1.15 | 1.00 | 1.00 | 1.00 | 1.100 | 1.00 | 1.00 | 1.00 | 2.04 | 572.0 | 1,138.5 | 0.0 | 0.00 | 0.0 | 0.0 |
| +D+0.750Lr | Length = 5.0 ft | 1 | 0.308 | 0.181 | 1.25 | 1.00 | 1.00 | 1.00 | 1.100 | 1.00 | 1.00 | 1.00 | 1.36 | 381.3 | 1,237.5 | 0.0 | 0.00 | 0.0 | 0.0 |
| +D+0.750S | Length = 5.0 ft | 1 | 0.419 | 0.246 | 1.15 | 1.00 | 1.00 | 1.00 | 1.100 | 1.00 | 1.00 | 1.00 | 1.70 | 476.6 | 1,138.5 | 0.0 | 0.00 | 0.0 | 0.0 |



Merrell Design Services
Practical Structural Solutions

Project Title: Cheshire Upper Lot
 Engineer: KJH
 Project ID: 23-067
 Project Descr: Two-Story Residence Fdns & Framing

Wood Beam

Project File: cheshire framing 20241204.ec6

LIC# : KW-06011847, Build:20.23.08.30

Merrell Design Services PLLC

(c) ENERCALC INC 1983-2023

DESCRIPTION: Beam 3 Int Brg Hdr

Maximum Forces & Stresses for Load Combinations

| Load Combination | Segment Length | Span # | Max Stress Ratios | | | | | | | | | | Moment Values | | | Shear Values | | |
|------------------|----------------|--------|-------------------|-------|------|------|----------------|------|----------------|-----------------|----------------|----------------|---------------|-------|----------------|--------------|----------------|----------------|
| | | | M | V | CD | CM | C _t | CLx | C _F | C _{fu} | C _i | C _r | M | fb | F ^b | V | f _v | F ^v |
| +0.60D | | | | | | 1.00 | 1.00 | 1.00 | 1.100 | 1.00 | 1.00 | 1.00 | | | 0.0 | 0.00 | 0.0 | 0.0 |
| Length = 5.0 ft | 1 | | 0.072 | 0.042 | 1.60 | 1.00 | 1.00 | 1.00 | 1.100 | 1.00 | 1.00 | 1.00 | 0.41 | 114.4 | 1,584.0 | 0.23 | 12.2 | 288.0 |

Overall Maximum Deflections

| Load Combination | Span | Max. "-" Defl | Location in Span | Load Combination | Max. "+" Defl | Location in Span |
|------------------|------|---------------|------------------|------------------|---------------|------------------|
| +D+S | 1 | 0.0292 | 2.518 | | 0.0000 | 0.000 |

Vertical Reactions

Support notation : Far left is #1

Values in KIPS

| Load Combination | Support 1 | Support 2 |
|-------------------------------------|-----------|-----------|
| Max Upward from all Load Conditions | 1.631 | 1.631 |
| Max Upward from Load Combinations | 1.631 | 1.631 |
| Max Upward from Load Cases | 1.088 | 1.088 |
| D Only | 0.544 | 0.544 |
| +D+Lr | 1.269 | 1.269 |
| +D+S | 1.631 | 1.631 |
| +D+0.750Lr | 1.088 | 1.088 |
| +D+0.750S | 1.359 | 1.359 |
| +0.60D | 0.326 | 0.326 |
| Lr Only | 0.725 | 0.725 |
| S Only | 1.088 | 1.088 |

Wood Beam

Project File: cheshire framing 20241204.ec6

LIC#: KW-06011847, Build:20.23.08.30

Merrell Design Services PLLC

(c) ENERCALC INC 1983-2023

DESCRIPTION: Beam 4 Roof Grdrs

CODE REFERENCES

Calculations per NDS 2018, IBC 2018, CBC 2019, ASCE 7-16

Load Combination Set : IBC 2021


Material Properties

Analysis Method : Allowable Stress Design
 Load Combination : IBC 2021

Wood Species : DF/DF
 Wood Grade : 24F-V8

| | | | |
|-----------|-------------|----------------------------------|------------|
| Fb + | 2,400.0 psi | <i>E : Modulus of Elasticity</i> | |
| Fb - | 2,400.0 psi | Ebend- xx | 1,800.0ksi |
| Fc - Prll | 1,650.0 psi | Eminbend - xx | 950.0ksi |
| Fc - Perp | 650.0 psi | Ebend- yy | 1,600.0ksi |
| Fv | 265.0 psi | Eminbend - yy | 850.0ksi |
| Ft | 1,100.0 psi | Density | 31.210pcf |

Beam Bracing : Beam is Fully Braced against lateral-torsional buckling

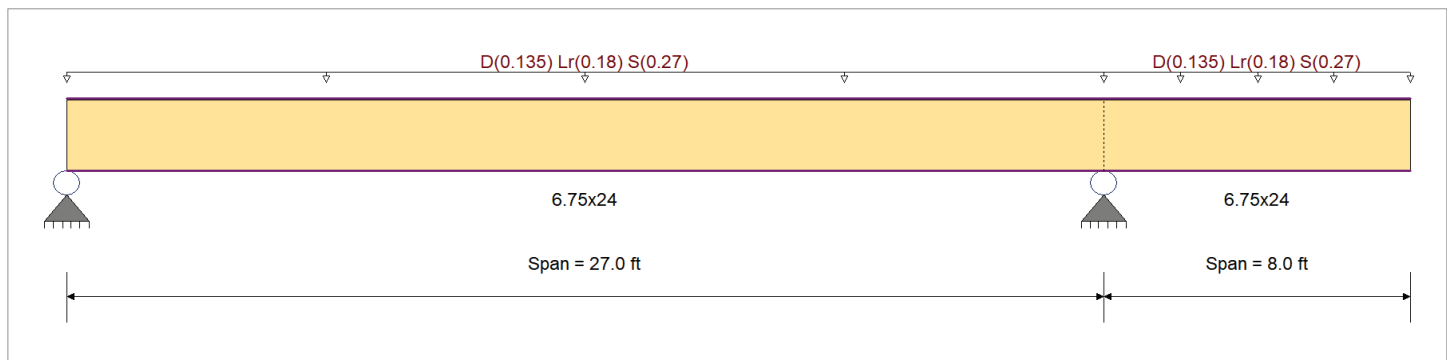

Applied Loads

Service loads entered. Load Factors will be applied for calculations.

Beam self weight NOT internally calculated and added

Load for Span Number 1

Uniform Load : D = 0.0150, Lr = 0.020, S = 0.030 ksf, Tributary Width = 9.0 ft

Load for Span Number 2

Uniform Load : D = 0.0150, Lr = 0.020, S = 0.030 ksf, Tributary Width = 9.0 ft

DESIGN SUMMARY

Design OK

| | | | | | |
|-----------------------------------|-----------|------------------|-----------------------------|------------------|------------------|
| Maximum Bending Stress Ratio | = | 0.233 : 1 | Maximum Shear Stress Ratio | = | 0.157 : 1 |
| Section used for this span | = | 6.75x24 | Section used for this span | = | 6.75x24 |
| fb: Actual | = | 568.69psi | fv: Actual | = | 47.72 psi |
| F'b | = | 2,443.04psi | F'v | = | 304.75 psi |
| Load Combination | = | +D+S | Load Combination | = | +D+S |
| Location of maximum on span | = | 12.369ft | Location of maximum on span | = | 25.039 ft |
| Span # where maximum occurs | = | Span # 1 | Span # where maximum occurs | = | Span # 1 |
| Maximum Deflection | | | | | |
| Max Downward Transient Deflection | 0.184 in | Ratio = | 1760 >=360 | Span: 1 : S Only | |
| Max Upward Transient Deflection | -0.125 in | Ratio = | 1536 >=360 | Span: 2 : S Only | |
| Max Downward Total Deflection | 0.276 in | Ratio = | 1173 >=240 | Span: 1 : +D+S | |
| Max Upward Total Deflection | -0.187 in | Ratio = | 1024 >=240 | Span: 2 : +D+S | |

Maximum Forces & Stresses for Load Combinations

| Load Combination | Segment Length | Span # | Max Stress Ratios | | | | | | | | | Moment Values | | | Shear Values | | | | |
|------------------|------------------|----------|-------------------|-------|------|------|----------------|------|----------------|-----------------|----------------|----------------|-------|-------|--------------|------|------|-------|-------|
| | | | M | V | CD | CM | C _t | CLx | C _v | C _{fu} | C _i | C _r | M | fb | F'b | V | fv | F'v | |
| D Only | | | | | | | | | | | | | | | | | | | |
| | Length = 27.0 ft | 1 | 0.099 | 0.067 | 0.90 | 1.00 | 1.00 | 1.00 | 0.885 | 1.00 | 1.00 | 1.00 | 10.24 | 189.6 | 1,911.9 | 0.0 | 0.00 | 0.0 | 0.0 |
| | Length = 8.0 ft | 2 | 0.037 | 0.067 | 0.90 | 1.00 | 1.00 | 1.00 | 1.000 | 1.00 | 1.00 | 1.00 | 4.32 | 80.0 | 2,159.2 | 0.81 | 15.9 | 238.5 | 238.5 |
| +D+Lr | | | | | | | | | | | | | | | | | | | |
| | Length = 27.0 ft | 1 | 0.167 | 0.112 | 1.25 | 1.00 | 1.00 | 1.00 | 0.885 | 1.00 | 1.00 | 1.00 | 23.89 | 442.3 | 2,655.5 | 4.01 | 37.1 | 331.3 | 331.3 |
| | Length = 8.0 ft | 2 | 0.062 | 0.112 | 1.25 | 1.00 | 1.00 | 1.00 | 1.000 | 1.00 | 1.00 | 1.00 | 10.08 | 186.7 | 2,999.0 | 1.90 | 37.1 | 331.3 | 331.3 |
| +D+S | | | | | | | | | | | | | | | | | | | |
| | Length = 27.0 ft | 1 | 0.233 | 0.157 | 1.15 | 1.00 | 1.00 | 1.00 | 0.885 | 1.00 | 1.00 | 1.00 | 30.71 | 568.7 | 2,443.0 | 5.15 | 47.7 | 304.8 | 304.8 |

Wood Beam

Project File: cheshire framing 20241204.ec6

LIC# : KW-06011847, Build:20.23.08.30

Merrell Design Services PLLC

(c) ENERCALC INC 1983-2023

DESCRIPTION: Beam 4 Roof Grdrs

Maximum Forces & Stresses for Load Combinations

| Load Combination | Segment Length | Span # | Max Stress Ratios | | | | | | | | | | Moment Values | | | Shear Values | | |
|------------------|------------------|--------|-------------------|-------|------|------|----------------|------|----------------|-----------------|----------------|----------------|---------------|-------|----------------|--------------|------|----------------|
| | | | M | V | CD | CM | C _t | CLx | C _v | C _{fu} | C _i | C _r | M | fb | F ^b | V | fv | F ^v |
| +D+0.750Lr | Length = 8.0 ft | 2 | 0.087 | 0.157 | 1.15 | 1.00 | 1.00 | 1.00 | 1.000 | 1.00 | 1.00 | 1.00 | 12.96 | 240.0 | 2,759.0 | 2.44 | 47.7 | 304.8 |
| | | | | | | | | | | | | | | | 0.0 | 0.00 | 0.0 | 0.0 |
| +D+0.750S | Length = 27.0 ft | 1 | 0.143 | 0.096 | 1.25 | 1.00 | 1.00 | 1.00 | 0.885 | 1.00 | 1.00 | 1.00 | 20.47 | 379.1 | 2,655.5 | 3.44 | 31.8 | 331.3 |
| | Length = 8.0 ft | 2 | 0.053 | 0.096 | 1.25 | 1.00 | 1.00 | 1.00 | 1.000 | 1.00 | 1.00 | 1.00 | 8.64 | 160.0 | 2,999.0 | 1.63 | 31.8 | 331.3 |
| +0.60D | | | | | | | | | | | | | | | 0.0 | 0.00 | 0.0 | 0.0 |
| | Length = 27.0 ft | 1 | 0.194 | 0.130 | 1.15 | 1.00 | 1.00 | 1.00 | 0.885 | 1.00 | 1.00 | 1.00 | 25.59 | 473.9 | 2,443.0 | 4.29 | 39.8 | 304.8 |
| | Length = 8.0 ft | 2 | 0.072 | 0.130 | 1.15 | 1.00 | 1.00 | 1.00 | 1.000 | 1.00 | 1.00 | 1.00 | 10.80 | 200.0 | 2,759.0 | 2.04 | 39.8 | 304.8 |
| | | | | | | | | | | | | | | | 0.0 | 0.00 | 0.0 | 0.0 |
| | Length = 27.0 ft | 1 | 0.033 | 0.023 | 1.60 | 1.00 | 1.00 | 1.00 | 0.885 | 1.00 | 1.00 | 1.00 | 6.14 | 113.7 | 3,399.0 | 1.03 | 9.5 | 424.0 |
| | Length = 8.0 ft | 2 | 0.013 | 0.023 | 1.60 | 1.00 | 1.00 | 1.00 | 1.000 | 1.00 | 1.00 | 1.00 | 2.59 | 48.0 | 3,838.7 | 0.49 | 9.5 | 424.0 |

Overall Maximum Deflections

| Load Combination | Span | Max. "-" Defl | Location in Span | Load Combination | Max. "+" Defl | Location in Span |
|------------------|------|---------------|------------------|------------------|---------------|------------------|
| +D+S | 1 | 0.2761 | 13.123 | +D+S | 0.0000 | 0.000 |
| | 2 | 0.0000 | 13.123 | | -0.1873 | 8.000 |

Vertical Reactions

Support notation : Far left is #1

Values in KIPS

| Load Combination | Support 1 | Support 2 | Support 3 |
|-------------------------------------|-----------|-----------|-----------|
| Max Upward from all Load Conditions | 4.988 | 9.188 | |
| Max Upward from Load Combinations | 4.988 | 9.188 | |
| Max Upward from Load Cases | 3.325 | 6.125 | |
| D Only | 1.663 | 3.063 | |
| +D+Lr | 3.879 | 7.146 | |
| +D+S | 4.988 | 9.188 | |
| +D+0.750Lr | 3.325 | 6.125 | |
| +D+0.750S | 4.156 | 7.656 | |
| +0.60D | 0.998 | 1.838 | |
| Lr Only | 2.217 | 4.083 | |
| S Only | 3.325 | 6.125 | |

Wood Beam

Project File: cheshire framing 20241204.ec6

LIC#: KW-06011847, Build:20.23.08.30

Merrell Design Services PLLC

(c) ENERCALC INC 1983-2023

DESCRIPTION: Beam 5 2nd Flr Tfr Bms

CODE REFERENCES

Calculations per NDS 2018, IBC 2018, CBC 2019, ASCE 7-16

Load Combination Set : IBC 2021


Material Properties

Analysis Method : Allowable Stress Design
 Load Combination : IBC 2021

Wood Species : DF/DF
 Wood Grade : 24F-V4

| | | <i>E : Modulus of Elasticity</i> | |
|-----------|-------------|----------------------------------|------------|
| Fb + | 2,400.0 psi | Ebend- xx | 1,800.0ksi |
| Fb - | 1,850.0 psi | Eminbend - xx | 950.0ksi |
| Fc - Prll | 1,650.0 psi | Ebend- yy | 1,600.0ksi |
| Fc - Perp | 650.0 psi | Eminbend - yy | 850.0ksi |
| Fv | 265.0 psi | Density | 31.210pcf |
| Ft | 1,100.0 psi | | |

Beam Bracing : Beam is Fully Braced against lateral-torsional buckling

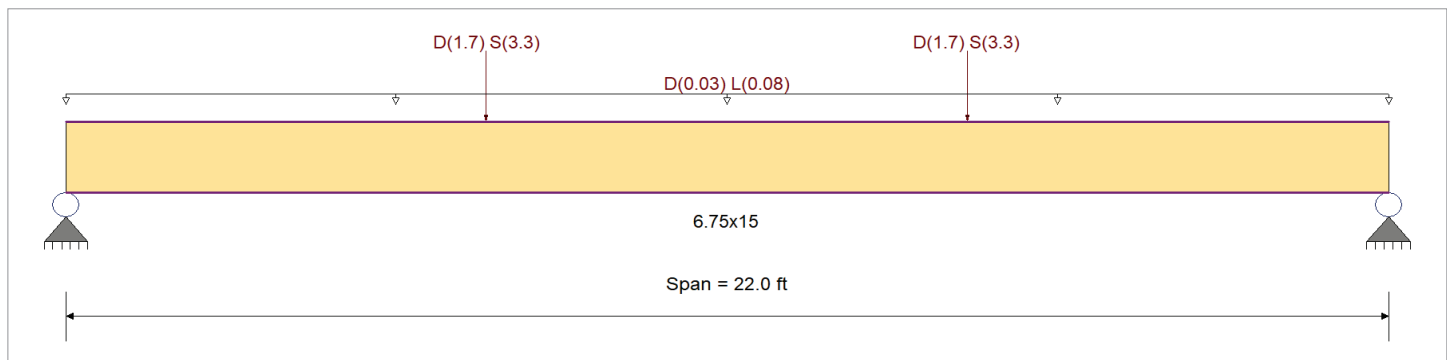

Applied Loads

Service loads entered. Load Factors will be applied for calculations.

Beam self weight NOT internally calculated and added

Point Load : D = 1.70, S = 3.30 k @ 7.0 ft

Point Load : D = 1.70, S = 3.30 k @ 15.0 ft

Uniform Load : D = 0.0150, L = 0.040 ksf, Tributary Width = 2.0 ft

DESIGN SUMMARY

Design OK

| | | | | | |
|------------------------------|---|------------------|-----------------------------|---|------------------|
| Maximum Bending Stress Ratio | = | 0.668 < 1 | Maximum Shear Stress Ratio | = | 0.257 < 1 |
| Section used for this span | | 6.75x15 | Section used for this span | | 6.75x15 |
| fb: Actual | = | 1,745.30psi | fv: Actual | = | 78.43 psi |
| F'b | = | 2,613.59psi | F'v | = | 304.75 psi |
| Load Combination | | +D+S | Load Combination | | +D+S |
| Location of maximum on span | = | 11.000ft | Location of maximum on span | = | 20.796 ft |
| Span # where maximum occurs | = | Span # 1 | Span # where maximum occurs | = | Span # 1 |

Maximum Deflection

| | | | | |
|-----------------------------------|----------|---------|------------------|------------------|
| Max Downward Transient Deflection | 0.615 in | Ratio = | 429 >=360 | Span: 1 : S Only |
| Max Upward Transient Deflection | 0 in | Ratio = | 0 <360 | n/a |
| Max Downward Total Deflection | 0.978 in | Ratio = | 269 >=240 | Span: 1 : +D+S |
| Max Upward Total Deflection | 0 in | Ratio = | 0 <240 | n/a |

Maximum Forces & Stresses for Load Combinations

| Load Combination | Segment Length | Span # | Max Stress Ratios | | | | | | | | | | Moment Values | | | Shear Values | | | | | |
|------------------|----------------|--------|-------------------|------|------|------|----------------|-------|----------------|-----------------|----------------|----------------|---------------|---------|------|--------------|-------|-----|--|--|--|
| | | | M | V | CD | CM | C _t | CLx | C _v | C _{fu} | C _i | C _r | M | fb | F'b | V | fv | F'v | | | |
| D Only | | | | | | | | | | | | | | | | | | | | | |
| Length = 22.0 ft | 1 | 0.318 | 0.124 | 0.90 | 1.00 | 1.00 | 1.00 | 0.947 | 1.00 | 1.00 | 1.00 | 13.72 | 650.2 | 2,045.4 | 1.99 | 29.5 | 238.5 | | | | |
| +D+L | | | | | | | | | | | | | | | | | | | | | |
| Length = 22.0 ft | 1 | 0.387 | 0.155 | 1.00 | 1.00 | 1.00 | 1.00 | 0.947 | 1.00 | 1.00 | 1.00 | 18.56 | 879.6 | 2,272.7 | 2.78 | 41.1 | 265.0 | | | | |
| +D+S | | | | | | | | | | | | | | | | | | | | | |
| Length = 22.0 ft | 1 | 0.668 | 0.257 | 1.15 | 1.00 | 1.00 | 1.00 | 0.947 | 1.00 | 1.00 | 1.00 | 36.82 | 1,745.3 | 2,613.6 | 5.29 | 78.4 | 304.8 | | | | |
| +D+0.750L | | | | | | | | | | | | | | | | | | | | | |
| Length = 22.0 ft | 1 | 0.289 | 0.115 | 1.25 | 1.00 | 1.00 | 1.00 | 0.947 | 1.00 | 1.00 | 1.00 | 17.35 | 822.3 | 2,840.9 | 2.58 | 38.2 | 331.3 | | | | |
| +D+0.750L+0.750S | | | | | | | | | | | | | | | | | | | | | |
| Length = 22.0 ft | 1 | | | | 1.00 | 1.00 | 1.00 | 0.947 | 1.00 | 1.00 | 1.00 | | | 0.0 | 0.00 | 0.0 | 0.0 | | | | |



Merrell Design Services
Practical Structural Solutions

Project Title: Cheshire Upper Lot
 Engineer: KJH
 Project ID: 23-067
 Project Descr: Two-Story Residence Fdns & Framing

Wood Beam

Project File: cheshire framing 20241204.ec6

LIC# : KW-06011847, Build:20.23.08.30

Merrell Design Services PLLC

(c) ENERCALC INC 1983-2023

DESCRIPTION: Beam 5 2nd Flr Tfr Bms

Maximum Forces & Stresses for Load Combinations

| Load Combination | Segment Length | Span # | Max Stress Ratios | | | | | | | | | | Moment Values | | | Shear Values | | |
|------------------|----------------|--------|-------------------|------|------|------|----------------|-------|----------------|-----------------|----------------|----------------|---------------|---------|----------------|--------------|----------------|----------------|
| | | | M | V | CD | CM | C _t | CLx | C _v | C _{fu} | C _i | C _r | M | fb | F ^b | V | f _v | F ^v |
| Length = 22.0 ft | 1 | 0.629 | 0.246 | 1.15 | 1.00 | 1.00 | 1.00 | 0.947 | 1.00 | 1.00 | 1.00 | 34.67 | 1,643.6 | 2,613.6 | 5.06 | 74.9 | 304.8 | |
| +0.60D | | | | | | | | | | | | | | 0.0 | 0.00 | 0.0 | 0.0 | |
| Length = 22.0 ft | 1 | 0.107 | 0.042 | 1.60 | 1.00 | 1.00 | 1.00 | 0.947 | 1.00 | 1.00 | 1.00 | 8.23 | 390.1 | 3,636.3 | 1.20 | 17.7 | 424.0 | |

Overall Maximum Deflections

| Load Combination | Span | Max. "-" Defl | Location in Span | Load Combination | Max. "+" Defl | Location in Span |
|------------------|------|---------------|------------------|------------------|---------------|------------------|
| +D+S | 1 | 0.9781 | 11.080 | | 0.0000 | 0.000 |

Vertical Reactions

Support notation : Far left is #1

Values in KIPS

| Load Combination | Support 1 | Support 2 |
|-------------------------------------|-----------|-----------|
| Max Upward from all Load Conditions | 5.330 | 5.330 |
| Max Upward from Load Combinations | 5.330 | 5.330 |
| Max Upward from Load Cases | 3.300 | 3.300 |
| D Only | 2.030 | 2.030 |
| +D+L | 2.910 | 2.910 |
| +D+S | 5.330 | 5.330 |
| +D+0.750L | 2.690 | 2.690 |
| +D+0.750L+0.750S | 5.165 | 5.165 |
| +0.60D | 1.218 | 1.218 |
| L Only | 0.880 | 0.880 |
| S Only | 3.300 | 3.300 |

Wood Beam

Project File: cheshire framing 20241204.ec6

LIC# : KW-06011847, Build:20.23.08.30

Merrell Design Services PLLC

(c) ENERCALC INC 1983-2023

DESCRIPTION: Beam 6 Ext Brg Hdr


CODE REFERENCES

Calculations per NDS 2018, IBC 2018, CBC 2019, ASCE 7-16

Load Combination Set : IBC 2021

Material Properties

| | | | | |
|--|-----------|-------------|----------------------------------|------------|
| Analysis Method : Allowable Stress Design | Fb + | 900.0 psi | <i>E : Modulus of Elasticity</i> | |
| Load Combination : IBC 2021 | Fb - | 900.0 psi | Ebend- xx | 1,600.0ksi |
| | Fc - Prll | 1,350.0 psi | Eminbend - xx | 580.0ksi |
| Wood Species : Douglas Fir-Larch | Fc - Perp | 625.0 psi | | |
| Wood Grade : No.2 | Fv | 180.0 psi | | |
| | Ft | 575.0 psi | Density | 31.210pcf |
| Beam Bracing : Beam is Fully Braced against lateral-torsional buckling | | | | |

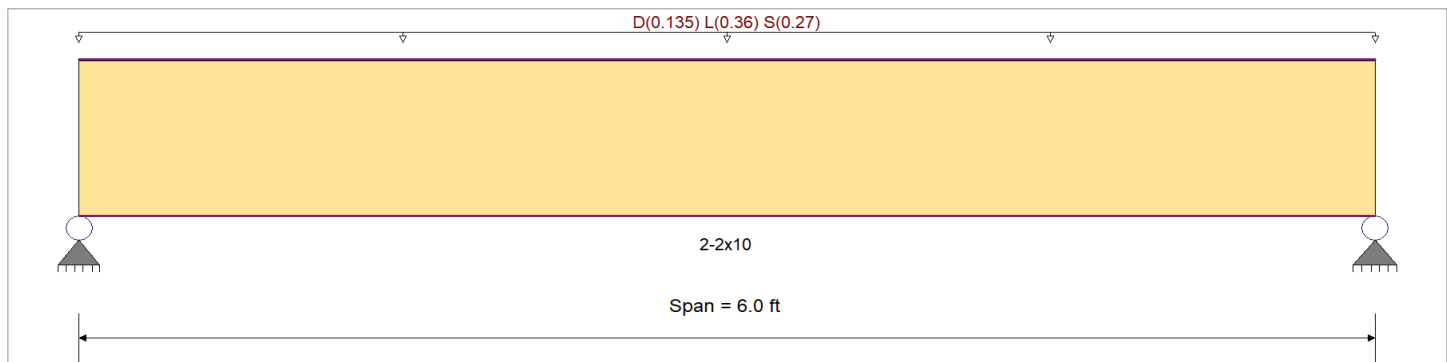

Applied Loads

Service loads entered. Load Factors will be applied for calculations.

Beam self weight NOT internally calculated and added

Uniform Load : D = 0.0150, L = 0.040, S = 0.030 ksf, Tributary Width = 9.0 ft

DESIGN SUMMARY

Design OK

| | | | |
|-----------------------------------|------------------|------------------------------|----------------------------|
| Maximum Bending Stress Ratio = | 0.674 : 1 | Maximum Shear Stress Ratio = | 0.354 : 1 |
| Section used for this span | 2-2x10 | Section used for this span | 2-2x10 |
| fb: Actual = | 766.81 psi | fv: Actual = | 73.35 psi |
| F'b = | 1,138.50 psi | F'v = | 207.00 psi |
| Load Combination | +D+0.750L+0.750S | Load Combination | +D+0.750L+0.750S |
| Location of maximum on span | = 3.000ft | Location of maximum on span | = 0.000ft |
| Span # where maximum occurs | = Span # 1 | Span # where maximum occurs | = Span # 1 |
| Maximum Deflection | | | |
| Max Downward Transient Deflection | 0.033 in Ratio = | 2158 >=360 | Span: 1 : L Only |
| Max Upward Transient Deflection | 0 in Ratio = | 0 <360 | n/a |
| Max Downward Total Deflection | 0.056 in Ratio = | 1279 >=240 | Span: 1 : +D+0.750L+0.750S |
| Max Upward Total Deflection | 0 in Ratio = | 0 <240 | n/a |

Maximum Forces & Stresses for Load Combinations

| Load Combination | Segment Length | Span # | Max Stress Ratios | | | | | | | | | | Moment Values | | | Shear Values | | | |
|------------------|-----------------|--------|-------------------|-------|------|------|----------------|------|----------------|-----------------|----------------|----------------|---------------|-------|---------|--------------|------|-------|-----|
| | | | M | V | CD | CM | C _t | CLx | C _F | C _{fu} | C _i | C _r | M | fb | F'b | V | fv | F'v | |
| D Only | Length = 6.0 ft | 1 | 0.191 | 0.101 | 0.90 | 1.00 | 1.00 | 1.00 | 1.100 | 1.00 | 1.00 | 1.00 | 0.61 | 170.4 | 891.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| +D+L | Length = 6.0 ft | 1 | 0.631 | 0.332 | 1.00 | 1.00 | 1.00 | 1.00 | 1.100 | 1.00 | 1.00 | 1.00 | 2.23 | 624.8 | 990.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| +D+S | Length = 6.0 ft | 1 | 0.449 | 0.236 | 1.15 | 1.00 | 1.00 | 1.00 | 1.100 | 1.00 | 1.00 | 1.00 | 1.82 | 511.2 | 1,138.5 | 0.0 | 0.00 | 0.0 | 0.0 |
| +D+0.750L | Length = 6.0 ft | 1 | 0.413 | 0.217 | 1.25 | 1.00 | 1.00 | 1.00 | 1.100 | 1.00 | 1.00 | 1.00 | 1.82 | 511.2 | 1,237.5 | 0.0 | 0.00 | 0.0 | 0.0 |
| +D+0.750L+0.750S | Length = 6.0 ft | 1 | 0.674 | 0.354 | 1.15 | 1.00 | 1.00 | 1.00 | 1.100 | 1.00 | 1.00 | 1.00 | 2.73 | 766.8 | 1,138.5 | 1.36 | 73.3 | 207.0 | |



Merrell Design Services
Practical Structural Solutions

Project Title: Cheshire Upper Lot
 Engineer: KJH
 Project ID: 23-067
 Project Descr: Two-Story Residence Fdns & Framing

Wood Beam

Project File: cheshire framing 20241204.ec6

LIC# : KW-06011847, Build:20.23.08.30

Merrell Design Services PLLC

(c) ENERCALC INC 1983-2023

DESCRIPTION: Beam 6 Ext Brg Hdr

Maximum Forces & Stresses for Load Combinations

| Load Combination | Segment Length | Span # | Max Stress Ratios | | | | | | | | | | Moment Values | | | Shear Values | | |
|------------------|----------------|--------|-------------------|-------|------|------|----------------|------|----------------|-----------------|----------------|----------------|---------------|-------|----------------|--------------|----------------|----------------|
| | | | M | V | CD | CM | C _t | CLx | C _F | C _{fu} | C _i | C _r | M | fb | F ^b | V | f _v | F ^v |
| +0.60D | | | | | | 1.00 | 1.00 | 1.00 | 1.100 | 1.00 | 1.00 | 1.00 | | | 0.0 | 0.00 | 0.0 | 0.0 |
| Length = 6.0 ft | 1 | | 0.065 | 0.034 | 1.60 | 1.00 | 1.00 | 1.00 | 1.100 | 1.00 | 1.00 | 1.00 | 0.36 | 102.2 | 1,584.0 | 0.18 | 9.8 | 288.0 |

Overall Maximum Deflections

| Load Combination | Span | Max. "-" Defl | Location in Span | Load Combination | Max. "+" Defl | Location in Span |
|------------------|------|---------------|------------------|------------------|---------------|------------------|
| +D+0.750L+0.750S | 1 | 0.0563 | 3.022 | | 0.0000 | 0.000 |

Vertical Reactions

Support notation : Far left is #1

Values in KIPS

| Load Combination | Support 1 | Support 2 |
|-------------------------------------|-----------|-----------|
| Max Upward from all Load Conditions | 1.823 | 1.823 |
| Max Upward from Load Combinations | 1.823 | 1.823 |
| Max Upward from Load Cases | 1.080 | 1.080 |
| D Only | 0.405 | 0.405 |
| +D+L | 1.485 | 1.485 |
| +D+S | 1.215 | 1.215 |
| +D+0.750L | 1.215 | 1.215 |
| +D+0.750L+0.750S | 1.823 | 1.823 |
| +0.60D | 0.243 | 0.243 |
| L Only | 1.080 | 1.080 |
| S Only | 0.810 | 0.810 |

Wood Beam

Project File: cheshire framing 20241204.ec6

LIC# : KW-06011847, Build:20.23.08.30

Merrell Design Services PLLC

(c) ENERCALC INC 1983-2023

DESCRIPTION: Beam 7 Int Brg Hdr


CODE REFERENCES

Calculations per NDS 2018, IBC 2018, CBC 2019, ASCE 7-16

Load Combination Set : IBC 2021

Material Properties

| | | | |
|--|-----------|-------------|-----------------------------------|
| Analysis Method : Allowable Stress Design | Fb + | 900.0 psi | E : Modulus of Elasticity |
| Load Combination : IBC 2021 | Fb - | 900.0 psi | Ebend- xx |
| | Fc - Prll | 1,350.0 psi | Eminbend - xx |
| Wood Species : Douglas Fir-Larch | Fc - Perp | 625.0 psi | |
| Wood Grade : No.2 | Fv | 180.0 psi | |
| | Ft | 575.0 psi | Density |
| Beam Bracing : Beam is Fully Braced against lateral-torsional buckling | | | Repetitive Member Stress Increase |

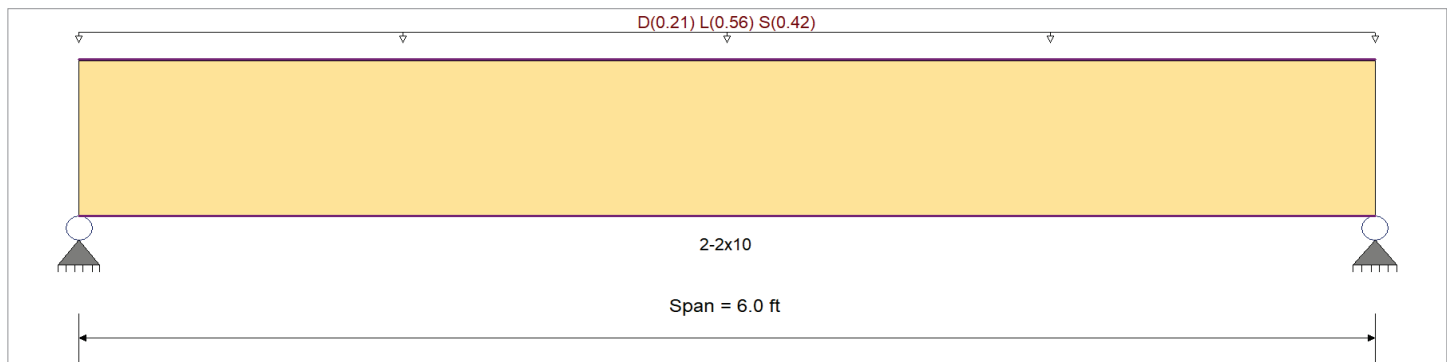

Applied Loads

Service loads entered. Load Factors will be applied for calculations.

Beam self weight NOT internally calculated and added

Uniform Load : D = 0.0150, L = 0.040, S = 0.030 ksf, Tributary Width = 14.0 ft

DESIGN SUMMARY

Design OK

| | | | |
|-----------------------------------|------------------|-------------------------------|----------------------------|
| Maximum Bending Stress Ratio = | 0.911 : 1 | Maximum Shear Stress Ratio = | 0.551 : 1 |
| Section used for this span | 2-2x10 | Section used for this span | 2-2x10 |
| fb: Actual = | 1,192.81 psi | fv: Actual = | 114.09 psi |
| F'b = | 1,309.28 psi | F'v = | 207.00 psi |
| Load Combination | +D+0.750L+0.750S | Load Combination | +D+0.750L+0.750S |
| Location of maximum on span = | 3.000ft | Location of maximum on span = | 0.000ft |
| Span # where maximum occurs = | Span # 1 | Span # where maximum occurs = | Span # 1 |
| Maximum Deflection | | | |
| Max Downward Transient Deflection | 0.052 in Ratio = | 1387 >=360 | Span: 1 : L Only |
| Max Upward Transient Deflection | 0 in Ratio = | 0 <360 | n/a |
| Max Downward Total Deflection | 0.088 in Ratio = | 822 >=240 | Span: 1 : +D+0.750L+0.750S |
| Max Upward Total Deflection | 0 in Ratio = | 0 <240 | n/a |

Maximum Forces & Stresses for Load Combinations

| Load Combination | Segment Length | Span # | Max Stress Ratios | | | | | | | | | | Moment Values | | | Shear Values | | | |
|------------------|-----------------|--------|-------------------|-------|------|------|----------------|------|----------------|-----------------|----------------|----------------|---------------|---------|---------|--------------|-------|-------|-----|
| | | | M | V | CD | CM | C _t | CLx | C _F | C _{fu} | C _i | C _r | M | fb | F'b | V | fv | F'v | |
| D Only | Length = 6.0 ft | 1 | 0.259 | 0.157 | 0.90 | 1.00 | 1.00 | 1.00 | 1.100 | 1.00 | 1.00 | 1.15 | 0.95 | 265.1 | 1,024.7 | 0.0 | 0.00 | 0.0 | 0.0 |
| +D+L | Length = 6.0 ft | 1 | 0.854 | 0.516 | 1.00 | 1.00 | 1.00 | 1.00 | 1.100 | 1.00 | 1.00 | 1.15 | 3.47 | 971.9 | 1,138.5 | 0.0 | 0.00 | 0.0 | 0.0 |
| +D+S | Length = 6.0 ft | 1 | 0.607 | 0.367 | 1.15 | 1.00 | 1.00 | 1.00 | 1.100 | 1.00 | 1.00 | 1.15 | 2.84 | 795.2 | 1,309.3 | 0.0 | 0.00 | 0.0 | 0.0 |
| +D+0.750L | Length = 6.0 ft | 1 | 0.559 | 0.338 | 1.25 | 1.00 | 1.00 | 1.00 | 1.100 | 1.00 | 1.00 | 1.15 | 2.84 | 795.2 | 1,423.1 | 0.0 | 0.00 | 0.0 | 0.0 |
| +D+0.750L+0.750S | Length = 6.0 ft | 1 | 0.911 | 0.551 | 1.15 | 1.00 | 1.00 | 1.00 | 1.100 | 1.00 | 1.00 | 1.15 | 4.25 | 1,192.8 | 1,309.3 | 2.11 | 114.1 | 207.0 | |



Merrell Design Services
Practical Structural Solutions

Project Title: Cheshire Upper Lot
 Engineer: KJH
 Project ID: 23-067
 Project Descr: Two-Story Residence Fdns & Framing

Wood Beam

Project File: cheshire framing 20241204.ec6

LIC# : KW-06011847, Build:20.23.08.30

Merrell Design Services PLLC

(c) ENERCALC INC 1983-2023

DESCRIPTION: Beam 7 Int Brg Hdr

Maximum Forces & Stresses for Load Combinations

| Load Combination | Segment Length | Span # | Max Stress Ratios | | | | | | | | | | Moment Values | | | Shear Values | | |
|------------------|----------------|--------|-------------------|-------|------|------|----------------|------|----------------|-----------------|----------------|----------------|---------------|-------|----------------|--------------|----------------|----------------|
| | | | M | V | CD | CM | C _t | CLx | C _F | C _{fu} | C _i | C _r | M | fb | F ^b | V | f _v | F ^v |
| +0.60D | | | | | | 1.00 | 1.00 | 1.00 | 1.100 | 1.00 | 1.00 | 1.15 | | | 0.0 | 0.00 | 0.0 | 0.0 |
| Length = 6.0 ft | 1 | | 0.087 | 0.053 | 1.60 | 1.00 | 1.00 | 1.00 | 1.100 | 1.00 | 1.00 | 1.15 | 0.57 | 159.0 | 1,821.6 | 0.28 | 15.2 | 288.0 |

Overall Maximum Deflections

| Load Combination | Span | Max. "-" Defl | Location in Span | Load Combination | Max. "+" Defl | Location in Span |
|------------------|------|---------------|------------------|------------------|---------------|------------------|
| +D+0.750L+0.750S | 1 | 0.0876 | 3.022 | | 0.0000 | 0.000 |

Vertical Reactions

Support notation : Far left is #1

Values in KIPS

| Load Combination | Support 1 | Support 2 |
|-------------------------------------|-----------|-----------|
| Max Upward from all Load Conditions | 2.835 | 2.835 |
| Max Upward from Load Combinations | 2.835 | 2.835 |
| Max Upward from Load Cases | 1.680 | 1.680 |
| D Only | 0.630 | 0.630 |
| +D+L | 2.310 | 2.310 |
| +D+S | 1.890 | 1.890 |
| +D+0.750L | 1.890 | 1.890 |
| +D+0.750L+0.750S | 2.835 | 2.835 |
| +0.60D | 0.378 | 0.378 |
| L Only | 1.680 | 1.680 |
| S Only | 1.260 | 1.260 |

Wood Beam

Project File: cheshire framing 20241204.ec6

LIC#: KW-06011847, Build:20.23.08.30

Merrell Design Services PLLC

(c) ENERCALC INC 1983-2023


DESCRIPTION: Beam 8 Folding Door

CODE REFERENCES

Calculations per NDS 2018, IBC 2018, CBC 2019, ASCE 7-16
 Load Combination Set : IBC 2021

Material Properties

| | | | | |
|--|-----------|----------|----------------------------------|-----------|
| Analysis Method : Allowable Stress Design | Fb + | 2400 psi | <i>E : Modulus of Elasticity</i> | |
| Load Combination : IBC 2021 | Fb - | 1850 psi | Ebend- xx | 1800ksi |
| | Fc - Prll | 1650 psi | Eminbend - xx | 950ksi |
| Wood Species : DF/DF | Fc - Perp | 650 psi | Ebend- yy | 1600ksi |
| Wood Grade : 24F-V4 | Fv | 265 psi | Eminbend - yy | 850ksi |
| | Ft | 1100 psi | Density | 31.21 pcf |
| Beam Bracing : Beam is Fully Braced against lateral-torsional buckling | | | | |

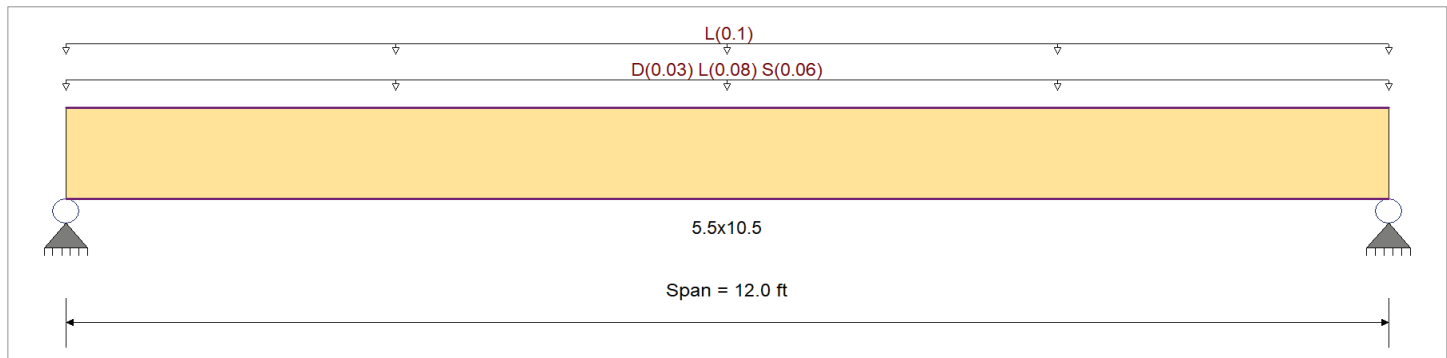

Applied Loads

Service loads entered. Load Factors will be applied for calculations.

Beam self weight NOT internally calculated and added
 Uniform Load : D = 0.0150, L = 0.040, S = 0.030 ksf, Tributary Width = 2.0 ft
 Uniform Load : L = 0.10, Tributary Width = 1.0 ft

DESIGN SUMMARY

Design OK

| | | | | | |
|-----------------------------------|----------|------------------|-----------------------------|------------------|------------------|
| Maximum Bending Stress Ratio | = | 0.187 : 1 | Maximum Shear Stress Ratio | = | 0.106 : 1 |
| Section used for this span | | 5.5x10.5 | Section used for this span | | 5.5x10.5 |
| fb: Actual | = | 448.83psi | fv: Actual | = | 28.19 psi |
| F'b | = | 2,400.00psi | F'v | = | 265.00 psi |
| Load Combination | | +D+L | Load Combination | | +D+L |
| Location of maximum on span | = | 6.000ft | Location of maximum on span | = | 0.000 ft |
| Span # where maximum occurs | = | Span # 1 | Span # where maximum occurs | = | Span # 1 |
| Maximum Deflection | | | | | |
| Max Downward Transient Deflection | 0.088 in | Ratio = | 1628 >=360 | Span: 1 : L Only | |
| Max Upward Transient Deflection | 0 in | Ratio = | 0 <360 | n/a | |
| Max Downward Total Deflection | 0.103 in | Ratio = | 1395 >=240 | Span: 1 : +D+L | |
| Max Upward Total Deflection | 0 in | Ratio = | 0 <240 | n/a | |

Maximum Forces & Stresses for Load Combinations

| Load Combination | Segment Length | Span # | Max Stress Ratios | | | | | | | | | | Moment Values | | | Shear Values | | | | |
|------------------|----------------|--------|-------------------|------|------|------|----------------|------|----------------|-----------------|----------------|----------------|---------------|------|-------|--------------|---------|------|-------|-------|
| | | | M | V | CD | CM | C _t | CLx | C _v | C _{fu} | C _i | C _r | M | fb | F'b | V | fv | F'v | | |
| D Only | | | | | | | | | | | | | | | | | | | | |
| Length = 12.0 ft | 1 | 0.030 | 0.017 | 0.90 | 1.00 | 1.00 | 1.00 | 1.00 | 1.00 | 1.00 | 1.00 | 1.00 | 1.00 | 1.00 | 0.54 | 64.1 | 2,160.0 | 0.16 | 4.0 | 238.5 |
| +D+L | | | | | | | | | | | | | | | | | | | | |
| Length = 12.0 ft | 1 | 0.187 | 0.106 | 1.00 | 1.00 | 1.00 | 1.00 | 1.00 | 1.00 | 1.00 | 1.00 | 1.00 | 1.00 | 1.00 | 3.78 | 448.8 | 2,400.0 | 1.09 | 28.2 | 265.0 |
| +D+S | | | | | | | | | | | | | | | | | | | | |
| Length = 12.0 ft | 1 | 0.070 | 0.040 | 1.15 | 1.00 | 1.00 | 1.00 | 1.00 | 1.00 | 1.00 | 1.00 | 1.00 | 1.00 | 1.62 | 192.4 | 2,760.0 | 0.47 | 12.1 | 304.8 | |
| +D+0.750L | | | | | | | | | | | | | | | | | | | | |
| Length = 12.0 ft | 1 | 0.118 | 0.067 | 1.25 | 1.00 | 1.00 | 1.00 | 1.00 | 1.00 | 1.00 | 1.00 | 1.00 | 1.00 | 2.97 | 352.7 | 3,000.0 | 0.85 | 22.1 | 331.3 | |
| +D+0.750L+0.750S | | | | | | | | | | | | | | | | | | | | |
| Length = 12.0 ft | 1 | | | | 1.00 | 1.00 | 1.00 | 1.00 | 1.00 | 1.00 | 1.00 | 1.00 | 1.00 | | | 0.0 | 0.00 | 0.0 | 0.0 | 0.0 |



Merrell Design Services
Practical Structural Solutions

Project Title: Cheshire Upper Lot
 Engineer: KJH
 Project ID: 23-067
 Project Descr: Two-Story Residence Fdns & Framing

Wood Beam

Project File: cheshire framing 20241204.ec6

LIC# : KW-06011847, Build:20.23.08.30

Merrell Design Services PLLC

(c) ENERCALC INC 1983-2023

DESCRIPTION: Beam 8 Folding Door

Maximum Forces & Stresses for Load Combinations

| Load Combination | Segment Length | Span # | Max Stress Ratios | | | | | | | | | | Moment Values | | | Shear Values | | |
|------------------|----------------|--------|-------------------|-------|------|------|----------------|------|----------------|-----------------|----------------|----------------|---------------|-------|----------------|--------------|----------------|----------------|
| | | | M | V | CD | CM | C _t | CLx | C _v | C _{fu} | C _i | C _r | M | fb | F ^b | V | f _v | F ^v |
| Length = 12.0 ft | 1 | 1 | 0.163 | 0.092 | 1.15 | 1.00 | 1.00 | 1.00 | 1.000 | 1.00 | 1.00 | 1.00 | 3.78 | 448.8 | 2,760.0 | 1.09 | 28.2 | 304.8 |
| +0.60D | | | | | | | | | | | | | | | | 0.0 | 0.00 | 0.0 |
| Length = 12.0 ft | 1 | 1 | 0.010 | 0.006 | 1.60 | 1.00 | 1.00 | 1.00 | 1.000 | 1.00 | 1.00 | 1.00 | 0.32 | 38.5 | 3,840.0 | 0.09 | 2.4 | 424.0 |

Overall Maximum Deflections

| Load Combination | Span | Max. "-" Defl | Location in Span | Load Combination | Max. "+" Defl | Location in Span |
|------------------|------|---------------|------------------|------------------|---------------|------------------|
| +D+0.750L+0.750S | 1 | 0.1032 | 6.044 | | 0.0000 | 0.000 |

Vertical Reactions

Support notation : Far left is #1

Values in KIPS

| Load Combination | Support 1 | Support 2 |
|-------------------------------------|-----------|-----------|
| Max Upward from all Load Conditions | 1.260 | 1.260 |
| Max Upward from Load Combinations | 1.260 | 1.260 |
| Max Upward from Load Cases | 1.080 | 1.080 |
| D Only | 0.180 | 0.180 |
| +D+L | 1.260 | 1.260 |
| +D+S | 0.540 | 0.540 |
| +D+0.750L | 0.990 | 0.990 |
| +D+0.750L+0.750S | 1.260 | 1.260 |
| +0.60D | 0.108 | 0.108 |
| L Only | 1.080 | 1.080 |
| S Only | 0.360 | 0.360 |

Wood Beam

Project File: cheshire framing 20241204.ec6

LIC#: KW-06011847, Build:20.23.08.30

Merrell Design Services PLLC

(c) ENERCALC INC 1983-2023


DESCRIPTION: Beam 9 Large Gar Hdr

CODE REFERENCES

Calculations per NDS 2018, IBC 2018, CBC 2019, ASCE 7-16
 Load Combination Set : IBC 2021

Material Properties

| | | | | |
|---|-----------|-------------|----------------------------------|------------|
| Analysis Method : Allowable Stress Design | Fb + | 2,400.0 psi | <i>E : Modulus of Elasticity</i> | |
| Load Combination : IBC 2021 | Fb - | 1,850.0 psi | Ebend- xx | 1,800.0ksi |
| Wood Species : DF/DF | Fc - Prll | 1,650.0 psi | Eminbend - xx | 950.0ksi |
| Wood Grade : 24F-V4 | Fc - Perp | 650.0 psi | Ebend- yy | 1,600.0ksi |
| Beam Bracing : Completely Unbraced | Fv | 265.0 psi | Eminbend - yy | 850.0ksi |
| | Ft | 1,100.0 psi | Density | 31.210pcf |

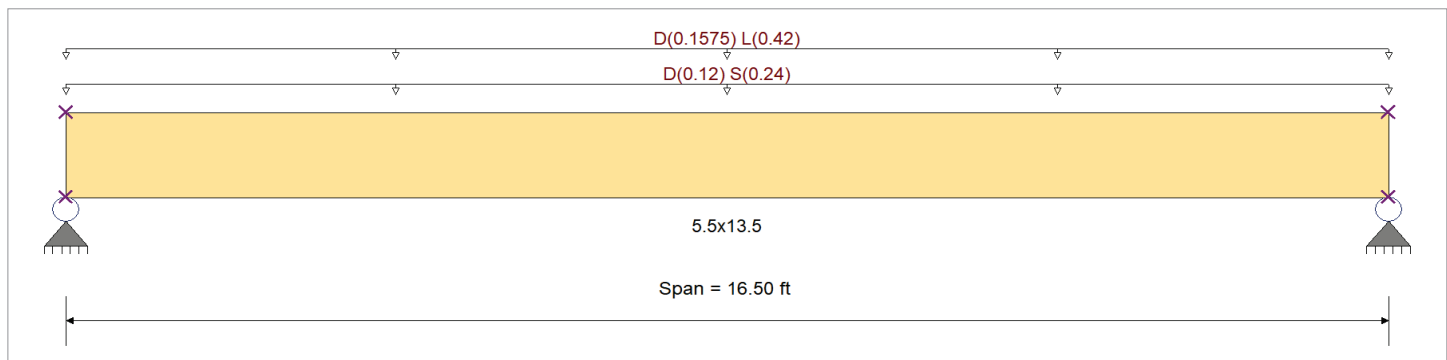

Applied Loads

Service loads entered. Load Factors will be applied for calculations.

Beam self weight NOT internally calculated and added
 Uniform Load : D = 0.0150, S = 0.030 ksf, Tributary Width = 8.0 ft
 Uniform Load : D = 0.0150, L = 0.040 ksf, Tributary Width = 10.50 ft

DESIGN SUMMARY

Design OK

| | | | | | |
|-----------------------------------|----------|------------------|-----------------------------|----------------------------|------------------|
| Maximum Bending Stress Ratio | = | 0.723 : 1 | Maximum Shear Stress Ratio | = | 0.381 : 1 |
| Section used for this span | | 5.5x13.5 | Section used for this span | | 5.5x13.5 |
| fb: Actual | = | 1,705.00psi | fv: Actual | = | 100.98 psi |
| F'b | = | 2,358.71psi | F'v | = | 265.00 psi |
| Load Combination | | +D+L | Load Combination | | +D+L |
| Location of maximum on span | = | 8.250ft | Location of maximum on span | = | 0.000ft |
| Span # where maximum occurs | = | Span # 1 | Span # where maximum occurs | = | Span # 1 |
| Maximum Deflection | | | | | |
| Max Downward Transient Deflection | 0.347 in | Ratio = | 570 >=360 | Span: 1 : L Only | |
| Max Upward Transient Deflection | 0 in | Ratio = | 0 <360 | n/a | |
| Max Downward Total Deflection | 0.638 in | Ratio = | 310 >=240 | Span: 1 : +D+0.750L+0.750S | |
| Max Upward Total Deflection | 0 in | Ratio = | 0 <240 | n/a | |

Maximum Forces & Stresses for Load Combinations

| Load Combination | Segment Length | Span # | Max Stress Ratios | | | | | | | | | | Moment Values | | | Shear Values | | | |
|------------------|-------------------|--------|-------------------|-------|------|------|----------------|------|----------------|-----------------|----------------|----------------|---------------|---------|---------|--------------|-------|-------|-----|
| | | | M | V | CD | CM | C _t | CLx | C _v | C _{fu} | C _i | C _r | M | fb | F'b | V | fv | F'v | |
| D Only | Length = 16.50 ft | 1 | 0.319 | 0.168 | 0.90 | 1.00 | 1.00 | 0.98 | 1.000 | 1.00 | 1.00 | 1.00 | 9.44 | 678.3 | 2,127.5 | 0.0 | 0.00 | 0.0 | 0.0 |
| +D+L | Length = 16.50 ft | 1 | 0.723 | 0.381 | 1.00 | 1.00 | 1.00 | 0.98 | 1.000 | 1.00 | 1.00 | 1.00 | 23.74 | 1,705.0 | 2,358.7 | 5.00 | 101.0 | 265.0 | 0.0 |
| +D+S | Length = 16.50 ft | 1 | 0.468 | 0.246 | 1.15 | 1.00 | 1.00 | 0.98 | 1.000 | 1.00 | 1.00 | 1.00 | 17.61 | 1,265.0 | 2,702.9 | 3.71 | 74.9 | 304.8 | 0.0 |
| +D+0.750L | Length = 16.50 ft | 1 | 0.494 | 0.259 | 1.25 | 1.00 | 1.00 | 0.98 | 1.000 | 1.00 | 1.00 | 1.00 | 20.16 | 1,448.3 | 2,930.4 | 4.25 | 85.8 | 331.3 | 0.0 |
| +D+0.750L+0.750S | Length = 16.50 ft | 1 | | | | 1.00 | 1.00 | 0.98 | 1.000 | 1.00 | 1.00 | 1.00 | | | 0.0 | 0.00 | 0.0 | 0.0 | 0.0 |



Merrell Design Services
Practical Structural Solutions

Project Title: Cheshire Upper Lot
 Engineer: KJH
 Project ID: 23-067
 Project Descr: Two-Story Residence Fdns & Framing

Wood Beam

Project File: cheshire framing 20241204.ec6

LIC# : KW-06011847, Build:20.23.08.30

Merrell Design Services PLLC

(c) ENERCALC INC 1983-2023

DESCRIPTION: Beam 9 Large Gar Hdr

Maximum Forces & Stresses for Load Combinations

| Load Combination | Segment Length | Span # | Max Stress Ratios | | | | | | | | | | Moment Values | | | Shear Values | | |
|-------------------|----------------|--------|-------------------|-------|------|------|----------------|------|----------------|-----------------|----------------|----------------|---------------|---------|----------------|--------------|----------------|----------------|
| | | | M | V | CD | CM | C _t | CLx | C _v | C _{fu} | C _i | C _r | M | fb | F ^b | V | f _v | F ^v |
| Length = 16.50 ft | 1 | 1 | 0.699 | 0.367 | 1.15 | 1.00 | 1.00 | 0.98 | 1.000 | 1.00 | 1.00 | 1.00 | 26.29 | 1,888.3 | 2,702.9 | 5.54 | 111.8 | 304.8 |
| +0.60D | | | | | | | | | | | | | | | | 0.0 | 0.00 | 0.0 |
| Length = 16.50 ft | 1 | 1 | 0.110 | 0.057 | 1.60 | 1.00 | 1.00 | 0.97 | 1.000 | 1.00 | 1.00 | 1.00 | 5.67 | 407.0 | 3,712.0 | 1.19 | 24.1 | 424.0 |
| | | | | | | | | | | | | | | | | | | |

Overall Maximum Deflections

| Load Combination | Span | Max. "-" Defl | Location in Span | Load Combination | Max. "+" Defl | Location in Span |
|------------------|------|---------------|------------------|------------------|---------------|------------------|
| +D+0.750L+0.750S | 1 | 0.6384 | 8.310 | | 0.0000 | 0.000 |

Vertical Reactions

Support notation : Far left is #1

Values in KIPS

| Load Combination | Support 1 | Support 2 |
|-------------------------------------|-----------|-----------|
| Max Upward from all Load Conditions | 6.373 | 6.373 |
| Max Upward from Load Combinations | 6.373 | 6.373 |
| Max Upward from Load Cases | 3.465 | 3.465 |
| D Only | 2.289 | 2.289 |
| +D+L | 5.754 | 5.754 |
| +D+S | 4.269 | 4.269 |
| +D+0.750L | 4.888 | 4.888 |
| +D+0.750L+0.750S | 6.373 | 6.373 |
| +0.60D | 1.374 | 1.374 |
| L Only | 3.465 | 3.465 |
| S Only | 1.980 | 1.980 |

Wood Beam

Project File: cheshire framing 20241204.ec6

LIC#: KW-06011847, Build:20.23.08.30

Merrell Design Services PLLC

(c) ENERCALC INC 1983-2023


DESCRIPTION: Beam 10 Short Gar Hdr

CODE REFERENCES

Calculations per NDS 2018, IBC 2018, CBC 2019, ASCE 7-16
 Load Combination Set : IBC 2021

Material Properties

| | | | | |
|---|-----------|-------------|----------------------------------|------------|
| Analysis Method : Allowable Stress Design | Fb + | 2,400.0 psi | <i>E : Modulus of Elasticity</i> | |
| Load Combination : IBC 2021 | Fb - | 1,850.0 psi | Ebend- xx | 1,800.0ksi |
| Wood Species : DF/DF | Fc - Prll | 1,650.0 psi | Eminbend - xx | 950.0ksi |
| Wood Grade : 24F-V4 | Fc - Perp | 650.0 psi | Ebend- yy | 1,600.0ksi |
| Beam Bracing : Completely Unbraced | Fv | 265.0 psi | Eminbend - yy | 850.0ksi |
| | Ft | 1,100.0 psi | Density | 31.210pcf |

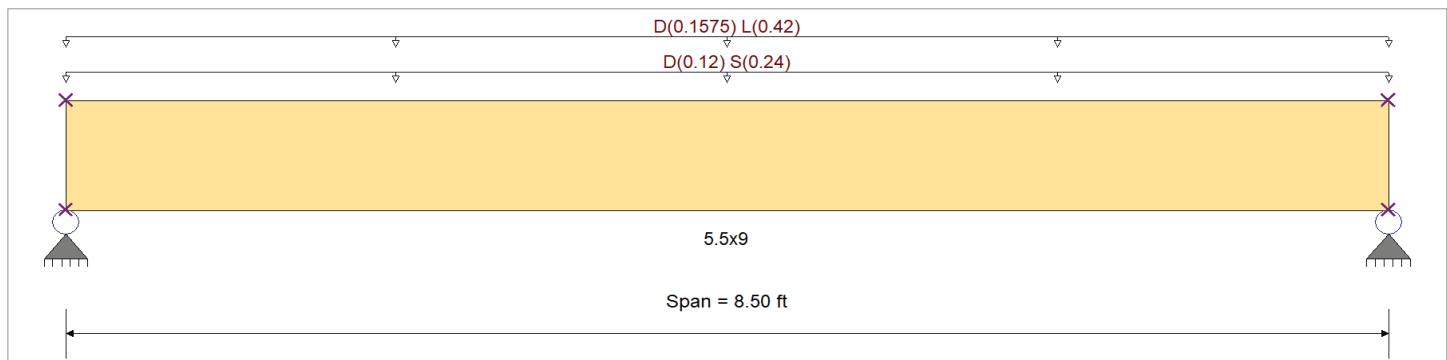

Applied Loads

Service loads entered. Load Factors will be applied for calculations.

Beam self weight NOT internally calculated and added
 Uniform Load : D = 0.0150, S = 0.030 ksf, Tributary Width = 8.0 ft
 Uniform Load : D = 0.0150, L = 0.040 ksf, Tributary Width = 10.50 ft

DESIGN SUMMARY

Design OK

| | | | |
|-----------------------------------|------------------|-------------------------------|----------------------------|
| Maximum Bending Stress Ratio = | 0.426 1 | Maximum Shear Stress Ratio = | 0.280 : 1 |
| Section used for this span | 5.5x9 | Section used for this span | 5.5x9 |
| fb: Actual = | 1,018.07psi | fv: Actual = | 74.09 psi |
| F'b = | 2,387.78psi | F'v = | 265.00 psi |
| Load Combination | +D+L | Load Combination | +D+L |
| Location of maximum on span = | 4.250ft | Location of maximum on span = | 0.000ft |
| Span # where maximum occurs = | Span # 1 | Span # where maximum occurs = | Span # 1 |
| Maximum Deflection | | | |
| Max Downward Transient Deflection | 0.083 in Ratio = | 1236 >=360 | Span: 1 : L Only |
| Max Upward Transient Deflection | 0 in Ratio = | 0 <360 | n/a |
| Max Downward Total Deflection | 0.152 in Ratio = | 672 >=240 | Span: 1 : +D+0.750L+0.750S |
| Max Upward Total Deflection | 0 in Ratio = | 0 <240 | n/a |

Maximum Forces & Stresses for Load Combinations

| Load Combination | Segment Length | Span # | Max Stress Ratios | | | | | | | | | | Moment Values | | | Shear Values | | | |
|------------------|------------------|--------|-------------------|-------|------|------|----------------|------|----------------|-----------------|----------------|----------------|---------------|---------|---------|--------------|------|-------|-----|
| | | | M | V | CD | CM | C _t | CLx | C _v | C _{fu} | C _i | C _r | M | fb | F'b | V | fv | F'v | |
| D Only | Length = 8.50 ft | 1 | 0.188 | 0.124 | 0.90 | 1.00 | 1.00 | 1.00 | 1.000 | 1.00 | 1.00 | 1.00 | 2.51 | 405.0 | 2,150.2 | 0.0 | 0.00 | 0.0 | 0.0 |
| +D+L | Length = 8.50 ft | 1 | 0.426 | 0.280 | 1.00 | 1.00 | 1.00 | 0.99 | 1.000 | 1.00 | 1.00 | 1.00 | 6.30 | 1,018.1 | 2,387.8 | 2.45 | 74.1 | 265.0 | 0.0 |
| +D+S | Length = 8.50 ft | 1 | 0.275 | 0.180 | 1.15 | 1.00 | 1.00 | 0.99 | 1.000 | 1.00 | 1.00 | 1.00 | 4.67 | 755.3 | 2,743.6 | 1.81 | 55.0 | 304.8 | 0.0 |
| +D+0.750L | Length = 8.50 ft | 1 | 0.290 | 0.190 | 1.25 | 1.00 | 1.00 | 0.99 | 1.000 | 1.00 | 1.00 | 1.00 | 5.35 | 864.8 | 2,980.5 | 2.08 | 62.9 | 331.3 | 0.0 |
| +D+0.750L+0.750S | Length = 8.50 ft | 1 | 0.290 | 0.190 | 1.25 | 1.00 | 1.00 | 0.99 | 1.000 | 1.00 | 1.00 | 1.00 | 5.35 | 864.8 | 2,980.5 | 2.08 | 62.9 | 331.3 | 0.0 |



Merrell Design Services
Practical Structural Solutions

Project Title: Cheshire Upper Lot
 Engineer: KJH
 Project ID: 23-067
 Project Descr: Two-Story Residence Fdns & Framing

Wood Beam

Project File: cheshire framing 20241204.ec6

LIC# : KW-06011847, Build:20.23.08.30

Merrell Design Services PLLC

(c) ENERCALC INC 1983-2023

DESCRIPTION: Beam 10 Short Gar Hdr

Maximum Forces & Stresses for Load Combinations

| Load Combination | Segment Length | Span # | Max Stress Ratios | | | | | | | | | | Moment Values | | | Shear Values | | |
|------------------|----------------|--------|-------------------|-------|------|------|----------------|------|----------------|-----------------|----------------|----------------|---------------|---------|----------------|--------------|----------------|----------------|
| | | | M | V | CD | CM | C _t | CLx | C _v | C _{fu} | C _i | C _r | M | fb | F ^b | V | f _v | F ^v |
| Length = 8.50 ft | 1 | 1 | 0.411 | 0.269 | 1.15 | 1.00 | 1.00 | 0.99 | 1.000 | 1.00 | 1.00 | 1.00 | 6.98 | 1,127.5 | 2,743.6 | 2.71 | 82.1 | 304.8 |
| +0.60D | | | | | | | | | | | | | | | | 0.0 | 0.00 | 0.0 |
| Length = 8.50 ft | 1 | 1 | 0.064 | 0.042 | 1.60 | 1.00 | 1.00 | 0.99 | 1.000 | 1.00 | 1.00 | 1.00 | 1.50 | 243.0 | 3,806.9 | 0.58 | 17.7 | 424.0 |

Overall Maximum Deflections

| Load Combination | Span | Max. "-" Defl | Location in Span | Load Combination | Max. "+" Defl | Location in Span |
|------------------|------|---------------|------------------|------------------|---------------|------------------|
| +D+0.750L+0.750S | 1 | 0.1517 | 4.281 | | 0.0000 | 0.000 |

Vertical Reactions

Support notation : Far left is #1

Values in KIPS

| Load Combination | Support 1 | Support 2 |
|-------------------------------------|-----------|-----------|
| Max Upward from all Load Conditions | 3.283 | 3.283 |
| Max Upward from Load Combinations | 3.283 | 3.283 |
| Max Upward from Load Cases | 1.785 | 1.785 |
| D Only | 1.179 | 1.179 |
| +D+L | 2.964 | 2.964 |
| +D+S | 2.199 | 2.199 |
| +D+0.750L | 2.518 | 2.518 |
| +D+0.750L+0.750S | 3.283 | 3.283 |
| +0.60D | 0.708 | 0.708 |
| L Only | 1.785 | 1.785 |
| S Only | 1.020 | 1.020 |

Wood Beam

Project File: cheshire framing 20241204.ec6

LIC# : KW-06011847, Build:20.23.08.30

Merrell Design Services PLLC

(c) ENERCALC INC 1983-2023

DESCRIPTION: Beam 11 Ext Non Brg Hdr

CODE REFERENCES

Calculations per NDS 2018, IBC 2018, CBC 2019, ASCE 7-16

Load Combination Set : IBC 2021


Material Properties

Analysis Method : Allowable Stress Design
 Load Combination : IBC 2021

Wood Species : Douglas Fir-Larch
 Wood Grade : No.2

Beam Bracing : Beam is Fully Braced against lateral-torsional buckling

| | | | |
|-----------|-------------|----------------------------------|------------|
| Fb + | 900.0 psi | <i>E</i> : Modulus of Elasticity | |
| Fb - | 900.0 psi | Ebend- xx | 1,600.0ksi |
| Fc - Prll | 1,350.0 psi | Eminbend - xx | 580.0ksi |
| Fc - Perp | 625.0 psi | | |
| Fv | 180.0 psi | | |
| Ft | 575.0 psi | Density | 31.210pcf |

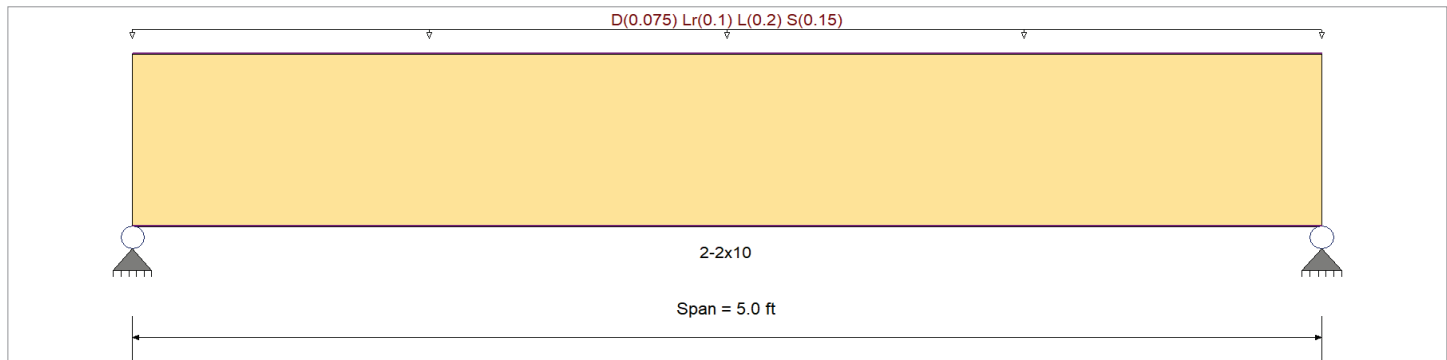

Applied Loads

Service loads entered. Load Factors will be applied for calculations.

Beam self weight NOT internally calculated and added

Uniform Load : D = 0.0150, Lr = 0.020, L = 0.040, S = 0.030 ksf, Tributary Width = 5.0 ft

DESIGN SUMMARY

Design OK

| | | | | | |
|------------------------------|---|------------------|-----------------------------|---|------------------|
| Maximum Bending Stress Ratio | = | 0.260 < 1 | Maximum Shear Stress Ratio | = | 0.153 < 1 |
| Section used for this span | | 2-2x10 | Section used for this span | | 2-2x10 |
| fb: Actual | = | 295.84psi | fv: Actual | = | 31.63 psi |
| F'b | = | 1,138.50psi | F'v | = | 207.00 psi |
| Load Combination | = | +D+0.750L+0.750S | Load Combination | = | +D+0.750L+0.750S |
| Location of maximum on span | = | 2.500ft | Location of maximum on span | = | 0.000ft |
| Span # where maximum occurs | = | Span # 1 | Span # where maximum occurs | = | Span # 1 |

Maximum Deflection

| | | | | |
|-----------------------------------|----------|---------|-------------------|----------------------------|
| Max Downward Transient Deflection | 0.009 in | Ratio = | 6714 >=360 | Span: 1 : L Only |
| Max Upward Transient Deflection | 0 in | Ratio = | 0 <360 | n/a |
| Max Downward Total Deflection | 0.015 in | Ratio = | 3978 >=240 | Span: 1 : +D+0.750L+0.750S |
| Max Upward Total Deflection | 0 in | Ratio = | 0 <240 | n/a |

Maximum Forces & Stresses for Load Combinations

| Load Combination | Segment Length | Span # | Max Stress Ratios | | | | | | | | | | Moment Values | | | Shear Values | | | | |
|-------------------|-----------------|--------|-------------------|-------|------|------|----------------|------|----------------|-----------------|----------------|----------------|---------------|-------|---------|--------------|------|-----|-----|-------|
| | | | M | V | CD | CM | C _t | CLx | C _F | C _{fu} | C _i | C _r | M | fb | F'b | V | fv | F'v | | |
| D Only | Length = 5.0 ft | 1 | 0.074 | 0.043 | 0.90 | 1.00 | 1.00 | 1.00 | 1.100 | 1.00 | 1.00 | 1.00 | 0.23 | 65.7 | 891.0 | 0.00 | 0.00 | 0.0 | 0.0 | 162.0 |
| +D+L | Length = 5.0 ft | 1 | 0.243 | 0.143 | 1.00 | 1.00 | 1.00 | 1.00 | 1.100 | 1.00 | 1.00 | 1.00 | 0.86 | 241.1 | 990.0 | 0.00 | 0.00 | 0.0 | 0.0 | 180.0 |
| +D+Lr | Length = 5.0 ft | 1 | 0.124 | 0.073 | 1.25 | 1.00 | 1.00 | 1.00 | 1.100 | 1.00 | 1.00 | 1.00 | 0.55 | 153.4 | 1,237.5 | 0.30 | 0.00 | 0.0 | 0.0 | 225.0 |
| +D+S | Length = 5.0 ft | 1 | 0.173 | 0.102 | 1.15 | 1.00 | 1.00 | 1.00 | 1.100 | 1.00 | 1.00 | 1.00 | 0.70 | 197.2 | 1,138.5 | 0.39 | 0.00 | 0.0 | 0.0 | 207.0 |
| +D+0.750Lr+0.750L | Length = 5.0 ft | 1 | 0.212 | 0.125 | 1.25 | 1.00 | 1.00 | 1.00 | 1.100 | 1.00 | 1.00 | 1.00 | 0.94 | 263.0 | 1,237.5 | 0.52 | 0.00 | 0.0 | 0.0 | 225.0 |



Merrell Design Services
Practical Structural Solutions

Project Title: Cheshire Upper Lot
 Engineer: KJH
 Project ID: 23-067
 Project Descr: Two-Story Residence Fdns & Framing

Wood Beam

Project File: cheshire framing 20241204.ec6

LIC# : KW-06011847, Build:20.23.08.30

Merrell Design Services PLLC

(c) ENERCALC INC 1983-2023

DESCRIPTION: Beam 11 Ext Non Brg Hdr

Maximum Forces & Stresses for Load Combinations

| Load Combination | Segment Length | Span # | Max Stress Ratios | | | | | | | | | | Moment Values | | | Shear Values | | |
|------------------|----------------|--------|-------------------|-------|------|------|----------------|------|----------------|-----------------|----------------|----------------|---------------|-------|----------------|--------------|----------------|----------------|
| | | | M | V | CD | CM | C _t | CLx | C _F | C _{fu} | C _i | C _r | M | fb | F ^b | V | f _v | F ^v |
| +D+0.750L+0.750S | | | | | | 1.00 | 1.00 | 1.00 | 1.100 | 1.00 | 1.00 | 1.00 | | | 0.0 | 0.00 | 0.0 | 0.0 |
| Length = 5.0 ft | 1 | | 0.260 | 0.153 | 1.15 | 1.00 | 1.00 | 1.00 | 1.100 | 1.00 | 1.00 | 1.00 | 1.05 | 295.8 | 1,138.5 | 0.59 | 31.6 | 207.0 |
| +0.60D | | | | | | 1.00 | 1.00 | 1.00 | 1.100 | 1.00 | 1.00 | 1.00 | | | 0.0 | 0.00 | 0.0 | 0.0 |
| Length = 5.0 ft | 1 | | 0.025 | 0.015 | 1.60 | 1.00 | 1.00 | 1.00 | 1.100 | 1.00 | 1.00 | 1.00 | 0.14 | 39.4 | 1,584.0 | 0.08 | 4.2 | 288.0 |

Overall Maximum Deflections

| Load Combination | Span | Max. "-" Defl | Location in Span | Load Combination | Max. "+" Defl | Location in Span |
|------------------|------|---------------|------------------|------------------|---------------|------------------|
| +D+0.750L+0.750S | 1 | 0.0151 | 2.518 | | 0.0000 | 0.000 |

Vertical Reactions

Support notation : Far left is #1

Values in KIPS

| Load Combination | Support 1 | Support 2 |
|-------------------------------------|-----------|-----------|
| Max Upward from all Load Conditions | 0.844 | 0.844 |
| Max Upward from Load Combinations | 0.844 | 0.844 |
| Max Upward from Load Cases | 0.500 | 0.500 |
| D Only | 0.188 | 0.188 |
| +D+L | 0.688 | 0.688 |
| +D+Lr | 0.438 | 0.438 |
| +D+S | 0.563 | 0.563 |
| +D+0.750Lr+0.750L | 0.750 | 0.750 |
| +D+0.750L+0.750S | 0.844 | 0.844 |
| +0.60D | 0.113 | 0.113 |
| Lr Only | 0.250 | 0.250 |
| L Only | 0.500 | 0.500 |
| S Only | 0.375 | 0.375 |

General Footing

Project File: cheshire framing 20241204.ec6

LIC#: KW-06011847, Build:20.23.08.30

Merrell Design Services PLLC

(c) ENERCALC INC 1983-2023

DESCRIPTION: Roof Girder Footings

Code References

Calculations per ACI 318-14, IBC 2018, CBC 2019, ASCE 7-16

Load Combinations Used : IBC 2021

General Information

Material Properties

| | | |
|---|---|-------------|
| f _c : Concrete 28 day strength | = | 2.50 ksi |
| f _y : Rebar Yield | = | 60.0 ksi |
| E _c : Concrete Elastic Modulus | = | 3,122.0 ksi |
| Concrete Density | = | 145.0 pcf |
| φ Values Flexure | = | 0.90 |
| Shear | = | 0.750 |

Soil Design Values

| | | |
|---------------------------------------|---|-----------|
| Allowable Soil Bearing | = | 2.0 ksf |
| Soil Density | = | 110.0 pcf |
| Increase Bearing By Footing Weight | = | No |
| Soil Passive Resistance (for Sliding) | = | 250.0 pcf |
| Soil/Concrete Friction Coeff. | = | 0.30 |

Analysis Settings

| | | |
|--|---|----------|
| Min Steel % Bending Reinf. | = | |
| Min Allow % Temp Reinf. | = | 0.000180 |
| Min. Overturning Safety Factor | = | 1.0 : 1 |
| Min. Sliding Safety Factor | = | 1.0 : 1 |
| Add Ftg Wt for Soil Pressure | : | Yes |
| Use ftg wt for stability, moments & shears | : | Yes |
| Add Pedestal Wt for Soil Pressure | : | No |
| Use Pedestal wt for stability, mom & shear | : | No |

Increases based on footing depth

| | | |
|--|---|-----------|
| Footing base depth below soil surface | = | ft |
| Allow press. increase per foot of depth when footing base is below | = | ksf ft |

Increases based on footing plan dimension


| | | |
|---|---|-----------|
| Allowable pressure increase per foot of depth when max. length or width is greater than | = | ksf ft |
|---|---|-----------|

Dimensions

| | | |
|-----------------------------|---|----------|
| Width parallel to X-X Axis | = | 1.330 ft |
| Length parallel to Z-Z Axis | = | 5.0 ft |
| Footing Thickness | = | 12.0 in |

Pedestal dimensions...

| | | |
|--|---|---------|
| px : parallel to X-X Axis | = | 6.0 in |
| pz : parallel to Z-Z Axis | = | 60.0 in |
| Height | = | 12.0 in |
| Rebar Centerline to Edge of Concrete... at Bottom of footing | = | 3.0 in |


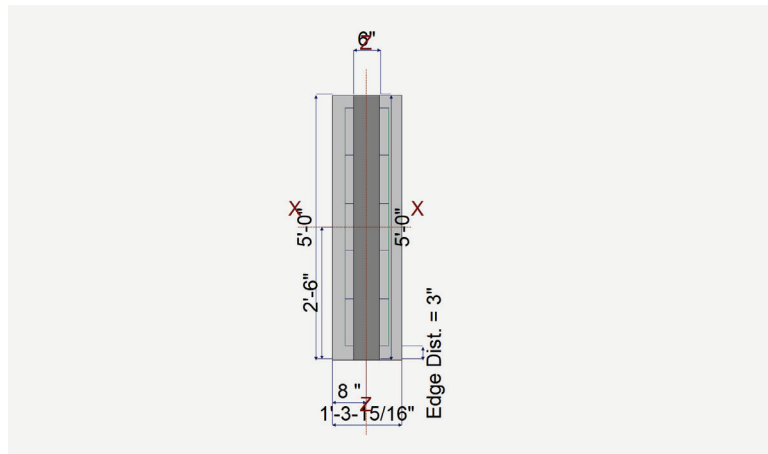


Reinforcing

| | | |
|---------------------------|---|-----|
| Bars parallel to X-X Axis | = | |
| Number of Bars | = | 6 |
| Reinforcing Bar Size | = | # 4 |
| Bars parallel to Z-Z Axis | = | |
| Number of Bars | = | 2 |
| Reinforcing Bar Size | = | # 5 |

Bandwidth Distribution Check (ACI 15.4.4.2)

| | | |
|---------------------------------------|---|---------------------|
| Direction Requiring Closer Separation | | Bars along X-X Axis |
| # Bars required within zone | = | 42.0 % |
| # Bars required on each side of zone | = | 58.0 % |

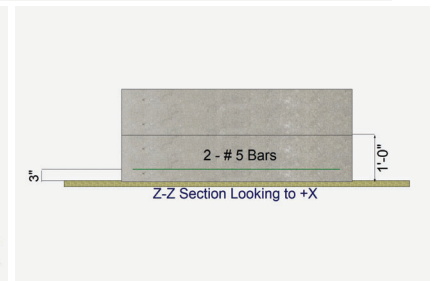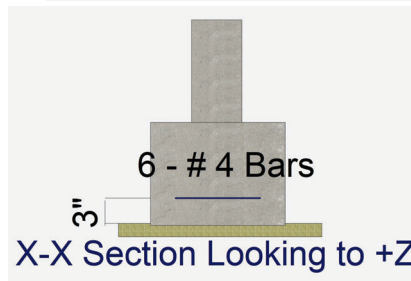

Applied Loads

| | D | L _r | L | S | W | E | H |
|-----------------|---|----------------|---|---|------|---|------|
| P : Column Load | = | 3.0 | | | 6.10 | | k |
| OB : Overburden | = | | | | | | ksf |
| M-xx | = | | | | | | k-ft |
| M-zz | = | | | | | | k-ft |
| V-x | = | | | | | | k |
| V-z | = | | | | | | k |

General Footing

Project File: cheshire framing 20241204.ec6

LIC#: KW-06011847, Build:20.23.08.30

Merrell Design Services PLLC

(c) ENERCALC INC 1983-2023

DESCRIPTION: Roof Girder Footings

DESIGN SUMMARY

Design OK

| | Min. Ratio | Item | Applied | Capacity | Governing Load Combination |
|------|------------|------------------|----------------|---------------|----------------------------|
| PASS | 0.7565 | Soil Bearing | 1.513 ksf | 2.0 ksf | +D+S about Z-Z axis |
| PASS | n/a | Overturing - X-X | 0.0 k-ft | 0.0 k-ft | No Overturing |
| PASS | n/a | Overturing - Z-Z | 0.0 k-ft | 0.0 k-ft | No Overturing |
| PASS | n/a | Sliding - X-X | 0.0 k | 0.0 k | No Sliding |
| PASS | n/a | Sliding - Z-Z | 0.0 k | 0.0 k | No Sliding |
| PASS | n/a | Uplift | 0.0 k | 0.0 k | No Uplift |
| PASS | 0.01837 | Z Flexure (+X) | 0.1730 k-ft/ft | 9.415 k-ft/ft | +1.20D+1.60S |
| PASS | 0.01837 | Z Flexure (-X) | 0.1730 k-ft/ft | 9.415 k-ft/ft | +1.20D+1.60S |
| PASS | 0.0 | X Flexure (+Z) | 0.0 k-ft/ft | 0.0 k-ft/ft | No Moment |
| PASS | 0.0 | X Flexure (-Z) | 0.0 k-ft/ft | 0.0 k-ft/ft | No Moment |
| PASS | n/a | 1-way Shear (+X) | 0.0 psi | 75.0 psi | n/a |
| PASS | 0.0 | 1-way Shear (-X) | 0.0 psi | 0.0 psi | n/a |
| PASS | n/a | 1-way Shear (+Z) | 0.0 psi | 75.0 psi | n/a |
| PASS | n/a | 1-way Shear (-Z) | 0.0 psi | 75.0 psi | n/a |
| PASS | n/a | 2-way Punching | 0.0 psi | 75.0 psi | +1.40D |

Detailed Results

Soil Bearing

| Rotation Axis & Load Combination... | Gross Allowable | Xeccc | Zeccc (in) | Actual Soil Bearing Stress @ Location | | | | Actual / Allow Ratio |
|-------------------------------------|-----------------|-------|------------|---------------------------------------|---------|----------|-----------|----------------------|
| | | | | Bottom, -Z | Top, +Z | Left, -X | Right, +X | |
| X-X, D Only | 2.0 | n/a | 0.0 | 0.5961 | 0.5961 | n/a | n/a | 0.298 |
| X-X, +D+S | 2.0 | n/a | 0.0 | 1.513 | 1.513 | n/a | n/a | 0.757 |
| X-X, +D+0.750S | 2.0 | n/a | 0.0 | 1.284 | 1.284 | n/a | n/a | 0.642 |
| X-X, +0.60D | 2.0 | n/a | 0.0 | 0.3577 | 0.3577 | n/a | n/a | 0.179 |
| Z-Z, D Only | 2.0 | 0.0 | n/a | n/a | n/a | 0.5961 | 0.5961 | 0.298 |
| Z-Z, +D+S | 2.0 | 0.0 | n/a | n/a | n/a | 1.513 | 1.513 | 0.757 |
| Z-Z, +D+0.750S | 2.0 | 0.0 | n/a | n/a | n/a | 1.284 | 1.284 | 0.642 |
| Z-Z, +0.60D | 2.0 | 0.0 | n/a | n/a | n/a | 0.3577 | 0.3577 | 0.179 |

Overturing Stability

| Rotation Axis & Load Combination... | Overturing Moment | Resisting Moment | Stability Ratio | Status |
|-------------------------------------|-------------------|------------------|-----------------|--------|
| Footing Has NO Overturing | | | | |

All units k

Sliding Stability

| Force Application Axis Load Combination... | Sliding Force | Resisting Force | Stability Ratio | Status |
|--|---------------|-----------------|-----------------|--------|
| Footing Has NO Sliding | | | | |

Footing Flexure

| Flexure Axis & Load Combination | Mu k-ft | Side | Tension Surface | As Req'd in^2 | Gvrn. As in^2 | Actual As in^2 | Phi*Mn k-ft | Status |
|---------------------------------|---------|------|-----------------|---------------|---------------|----------------|-------------|--------|
| X-X, +1.40D | 0.0 | +Z | Top | 0.02592 | AsMin | 0.4662 | 17.729 | OK |
| X-X, +1.40D | 0.0 | -Z | Top | 0.02592 | AsMin | 0.4662 | 17.729 | OK |
| X-X, +1.20D | 0.0 | +Z | Top | 0.02592 | AsMin | 0.4662 | 17.729 | OK |
| X-X, +1.20D | 0.0 | -Z | Top | 0.02592 | AsMin | 0.4662 | 17.729 | OK |
| X-X, +1.20D+0.50S | 0.0 | +Z | Top | 0.02592 | AsMin | 0.4662 | 17.729 | OK |
| X-X, +1.20D+0.50S | 0.0 | -Z | Top | 0.02592 | AsMin | 0.4662 | 17.729 | OK |
| X-X, +1.20D+1.60S | 0.0 | +Z | Top | 0.02592 | AsMin | 0.4662 | 17.729 | OK |
| X-X, +1.20D+1.60S | 0.0 | -Z | Top | 0.02592 | AsMin | 0.4662 | 17.729 | OK |
| X-X, +1.20D+0.70S | 0.0 | +Z | Top | 0.02592 | AsMin | 0.4662 | 17.729 | OK |
| X-X, +1.20D+0.70S | 0.0 | -Z | Top | 0.02592 | AsMin | 0.4662 | 17.729 | OK |
| X-X, +0.90D | 0.0 | +Z | Top | 0.02592 | AsMin | 0.4662 | 17.729 | OK |
| X-X, +0.90D | 0.0 | -Z | Top | 0.02592 | AsMin | 0.4662 | 17.729 | OK |
| Z-Z, +1.40D | 0.05439 | -X | Bottom | 0.02592 | AsMin | 0.240 | 9.415 | OK |

General Footing

Project File: cheshire framing 20241204.ec6

LIC# : KW-06011847, Build:20.23.08.30

Merrell Design Services PLLC

(c) ENERCALC INC 1983-2023

DESCRIPTION: Roof Girder Footings

Footing Flexure

| Flexure Axis & Load Combination | Mu k-ft | Side | Tension Surface | As Req'd in ² | Gvrn. As in ² | Actual As in ² | Phi*Mn k-ft | Status |
|---------------------------------|------------|------|--------------------|-----------------------------|-----------------------------|------------------------------|----------------|--------|
| Z-Z, +1.40D | 0.05439 | +X | Bottom | 0.02592 | AsMin | 0.240 | 9.415 | OK |
| Z-Z, +1.20D | 0.04662 | -X | Bottom | 0.02592 | AsMin | 0.240 | 9.415 | OK |
| Z-Z, +1.20D | 0.04662 | +X | Bottom | 0.02592 | AsMin | 0.240 | 9.415 | OK |
| Z-Z, +1.20D+0.50S | 0.08611 | -X | Bottom | 0.02592 | AsMin | 0.240 | 9.415 | OK |
| Z-Z, +1.20D+0.50S | 0.08611 | +X | Bottom | 0.02592 | AsMin | 0.240 | 9.415 | OK |
| Z-Z, +1.20D+1.60S | 0.1730 | -X | Bottom | 0.02592 | AsMin | 0.240 | 9.415 | OK |
| Z-Z, +1.20D+1.60S | 0.1730 | +X | Bottom | 0.02592 | AsMin | 0.240 | 9.415 | OK |
| Z-Z, +1.20D+0.70S | 0.1019 | -X | Bottom | 0.02592 | AsMin | 0.240 | 9.415 | OK |
| Z-Z, +1.20D+0.70S | 0.1019 | +X | Bottom | 0.02592 | AsMin | 0.240 | 9.415 | OK |
| Z-Z, +0.90D | 0.03496 | -X | Bottom | 0.02592 | AsMin | 0.240 | 9.415 | OK |
| Z-Z, +0.90D | 0.03496 | +X | Bottom | 0.02592 | AsMin | 0.240 | 9.415 | OK |

One Way Shear

| Load Combination... | Vu @ -X | Vu @ +X | Vu @ -Z | Vu @ +Z | Vu:Max | Phi Vn | Vu / Phi*Vn | Status |
|---------------------|----------|----------|----------|----------|----------|-----------|-------------|--------|
| +1.40D | 0.00 psi | 0.00 psi | 0.00 psi | 0.00 psi | 0.00 psi | 75.00 psi | 0.00 | OK |
| +1.20D | 0.00 psi | 0.00 psi | 0.00 psi | 0.00 psi | 0.00 psi | 75.00 psi | 0.00 | OK |
| +1.20D+0.50S | 0.00 psi | 0.00 psi | 0.00 psi | 0.00 psi | 0.00 psi | 75.00 psi | 0.00 | OK |
| +1.20D+1.60S | 0.00 psi | 0.00 psi | 0.00 psi | 0.00 psi | 0.00 psi | 75.00 psi | 0.00 | OK |
| +1.20D+0.70S | 0.00 psi | 0.00 psi | 0.00 psi | 0.00 psi | 0.00 psi | 75.00 psi | 0.00 | OK |
| +0.90D | 0.00 psi | 0.00 psi | 0.00 psi | 0.00 psi | 0.00 psi | 75.00 psi | 0.00 | OK |

Two-Way "Punching" Shear

| Load Combination... | Vu | Phi*Vn | Vu / Phi*Vn | Status |
|---------------------|----------|----------|-------------|--------|
| +1.40D | 0.00 psi | 90.00psi | 0 | OK |
| +1.20D | 0.00 psi | 90.00psi | 0 | OK |
| +1.20D+0.50S | 0.00 psi | 90.00psi | 0 | OK |
| +1.20D+1.60S | 0.00 psi | 90.00psi | 0 | OK |
| +1.20D+0.70S | 0.00 psi | 90.00psi | 0 | OK |
| +0.90D | 0.00 psi | 90.00psi | 0 | OK |

All units k

Wall Footing

Project File: cheshire framing 20241204.ec6

LIC# : KW-06011847, Build:20.23.08.30

Merrell Design Services PLLC

(c) ENERCALC INC 1983-2023

DESCRIPTION: TYPICAL STRIP FOOTINGS (INTERIOR & EXTERIOR)

Code References

Calculations per ACI 318-14, IBC 2018, CBC 2019, ASCE 7-16

Load Combinations Used : IBC 2021

General Information

Material Properties

| | | |
|-----------------------------------|---|-------------|
| f'_c : Concrete 28 day strength | = | 2.50 ksi |
| f_y : Rebar Yield | = | 60.0 ksi |
| E_c : Concrete Elastic Modulus | = | 3,122.0 ksi |
| Concrete Density | = | 145.0 pcf |
| ϕ Values Flexure | = | 0.90 |
| Shear | = | 0.750 |

Analysis Settings

| | | |
|---------------------------------|---|----------|
| Min Steel % Bending Reinf. | = | |
| Min Allow % Temp Reinf. | = | 0.000140 |
| Min. Overturning Safety Factor | = | 1.0 : 1 |
| Min. Sliding Safety Factor | = | 1.0 : 1 |
| AutoCalc Footing Weight as DL : | = | Yes |

Soil Design Values

| | | |
|---------------------------------------|---|-----------|
| Allowable Soil Bearing | = | 2.0 ksf |
| Increase Bearing By Footing Weight | = | No |
| Soil Passive Resistance (for Sliding) | = | 250.0 pcf |
| Soil/Concrete Friction Coeff. | = | 0.30 |

Increases based on footing Depth

| | | |
|---|---|-----------|
| Reference Depth below Surface | = | ft |
| Allow. Pressure Increase per foot of depth when base footing is below | = | ksf ft |

Increases based on footing Width

| | | |
|---|---|-----------|
| Allow. Pressure Increase per foot of width when footing is wider than | = | ksf ft |
|---|---|-----------|

Adjusted Allowable Bearing Pressure


= 2.0 ksf

Dimensions

| | | |
|---|---|---------|
| Footing Width | = | 1.33 ft |
| Wall Thickness | = | 6.0 in |
| Wall center offset from center of footing | = | 0 in |

Reinforcing

| | | | | | |
|--|---|---------|----------------------|---|-------|
| Footing Thickness | = | 12.0 in | Bars along X-X Axis | = | |
| Rebar Centerline to Edge of Concrete... at Bottom of footing = | = | 3.0 in | Bar spacing | = | 18.00 |
| | | | Reinforcing Bar Size | = | # 4 |

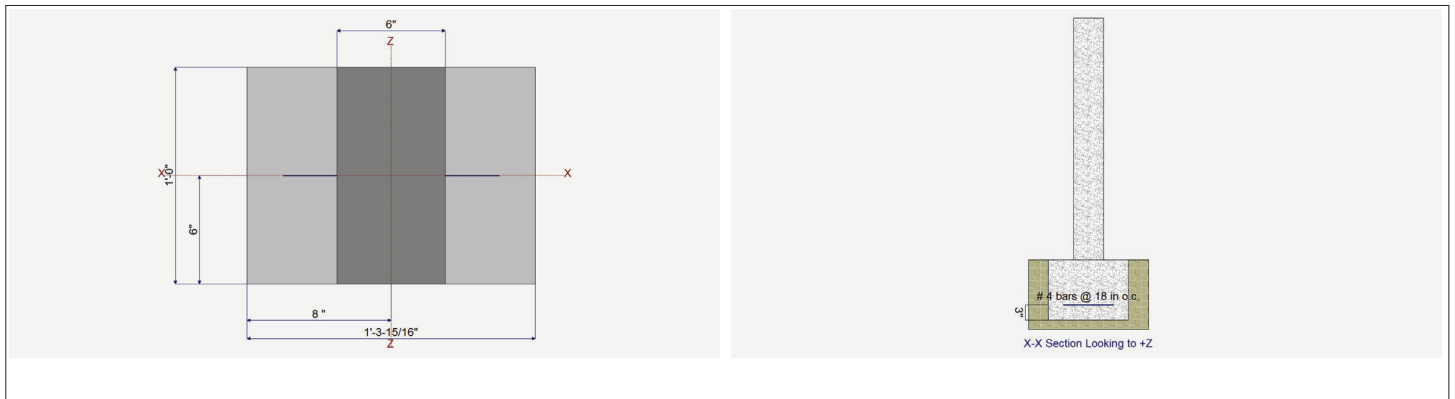

Applied Loads

| | D | Lr | L | S | W | E | H |
|-----------------|---|-------|-------------------------|------|-------|---|------|
| P : Column Load | = | 0.450 | | 0.60 | 0.450 | | k |
| OB : Overburden | = | | | | | | ksf |
| V-x | = | | | | | | k |
| M-zz | = | | | | | | k-ft |
| Vx applied | = | | in above top of footing | | | | |

Wall Footing

Project File: cheshire framing 20241204.ec6

LIC# : KW-06011847, Build:20.23.08.30

Merrell Design Services PLLC

(c) ENERCALC INC 1983-2023

DESCRIPTION: TYPICAL STRIP FOOTINGS (INTERIOR & EXTERIOR)

DESIGN SUMMARY

Design OK

| Factor of Safety | Item | Applied | Capacity | Governing Load Combination | |
|------------------|------|------------------|----------|----------------------------|---------------|
| PASS | n/a | Overturing - Z-Z | 0.0 k-ft | 0.0 k-ft | No Overturing |
| PASS | n/a | Sliding - X-X | 0.0 k | 0.0 k | No Sliding |
| PASS | n/a | Uplift | 0.0 k | 0.0 k | No Uplift |

| Utilization Ratio | Item | Applied | Capacity | Governing Load Combination | |
|-------------------|----------|------------------|--------------|----------------------------|--------------------|
| PASS | 0.5377 | Soil Bearing | 1.075 ksf | 2.0 ksf | +D+0.750L+0.750S |
| PASS | 0.02387 | Z Flexure (+X) | 0.1267 k-ft | 5.306 k-ft | +1.20D+1.60L+0.50S |
| PASS | 0.007060 | Z Flexure (-X) | 0.03746 k-ft | 5.306 k-ft | +0.90D |
| PASS | n/a | 1-way Shear (+X) | 0.0 psi | 75.0 psi | n/a |
| PASS | 0.0 | 1-way Shear (-X) | 0.0 psi | 0.0 psi | n/a |

Detailed Results

Soil Bearing

| Rotation Axis & Load Combination... | Gross Allowable | Xecc | Actual Soil Bearing Stress | | Actual / Allowable Ratio |
|-------------------------------------|-----------------|--------|----------------------------|------------|--------------------------|
| | | | -X | +X | |
| , D Only | 2.0 ksf | 0.0 in | 0.4833 ksf | 0.4833 ksf | 0.242 |
| , +D+L | 2.0 ksf | 0.0 in | 0.9345 ksf | 0.9345 ksf | 0.467 |
| , +D+S | 2.0 ksf | 0.0 in | 0.8217 ksf | 0.8217 ksf | 0.411 |
| , +D+0.750L | 2.0 ksf | 0.0 in | 0.8217 ksf | 0.8217 ksf | 0.411 |
| , +D+0.750L+0.750S | 2.0 ksf | 0.0 in | 1.075 ksf | 1.075 ksf | 0.538 |
| , +0.60D | 2.0 ksf | 0.0 in | 0.290 ksf | 0.290 ksf | 0.145 |

Units : k-ft

Overturing Stability

| Rotation Axis & Load Combination... | Overturing Moment | Resisting Moment | Stability Ratio | Status |
|-------------------------------------|-------------------|------------------|-----------------|--------|
| Footing Has NO Overturing | | | | |

Sliding Stability

| Force Application Axis Load Combination... | Sliding Force | Resisting Force | Sliding SafetyRatio | Status |
|--|---------------|-----------------|---------------------|--------|
| Footing Has NO Sliding | | | | |

Footing Flexure

| Flexure Axis & Load Combination | Mu k-ft | Which Side ? | Tension @ Bot. or Top ? | As Req'd in^2 | Gvrn. As in^2 | Actual As in^2 | Phi*Mn k-ft | Status |
|---------------------------------|---------|--------------|-------------------------|---------------|---------------|----------------|-------------|--------|
| , +1.40D | 0.05827 | -X | Bottom | 0.0202 | Min Temp % | 0.1333 | 5.306 | OK |
| , +1.40D | 0.05827 | +X | Bottom | 0.0202 | Min Temp % | 0.1333 | 5.306 | OK |
| , +1.20D+1.60L | 0.1121 | -X | Bottom | 0.0202 | Min Temp % | 0.1333 | 5.306 | OK |
| , +1.20D+1.60L | 0.1121 | +X | Bottom | 0.0202 | Min Temp % | 0.1333 | 5.306 | OK |
| , +1.20D+1.60L+0.50S | 0.1267 | -X | Bottom | 0.0202 | Min Temp % | 0.1333 | 5.306 | OK |
| , +1.20D+1.60L+0.50S | 0.1267 | +X | Bottom | 0.0202 | Min Temp % | 0.1333 | 5.306 | OK |
| , +1.20D+0.50L | 0.06937 | -X | Bottom | 0.0202 | Min Temp % | 0.1333 | 5.306 | OK |
| , +1.20D+0.50L | 0.06937 | +X | Bottom | 0.0202 | Min Temp % | 0.1333 | 5.306 | OK |
| , +1.20D | 0.04995 | -X | Bottom | 0.0202 | Min Temp % | 0.1333 | 5.306 | OK |
| , +1.20D | 0.04995 | +X | Bottom | 0.0202 | Min Temp % | 0.1333 | 5.306 | OK |
| , +1.20D+0.50L+1.60S | 0.116 | -X | Bottom | 0.0202 | Min Temp % | 0.1333 | 5.306 | OK |
| , +1.20D+0.50L+1.60S | 0.116 | +X | Bottom | 0.0202 | Min Temp % | 0.1333 | 5.306 | OK |
| , +1.20D+1.60S | 0.09656 | -X | Bottom | 0.0202 | Min Temp % | 0.1333 | 5.306 | OK |
| , +1.20D+1.60S | 0.09656 | +X | Bottom | 0.0202 | Min Temp % | 0.1333 | 5.306 | OK |
| , +1.20D+0.50L+0.50S | 0.08394 | -X | Bottom | 0.0202 | Min Temp % | 0.1333 | 5.306 | OK |
| , +1.20D+0.50L+0.50S | 0.08394 | +X | Bottom | 0.0202 | Min Temp % | 0.1333 | 5.306 | OK |
| , +1.20D+0.50L+0.70S | 0.08977 | -X | Bottom | 0.0202 | Min Temp % | 0.1333 | 5.306 | OK |
| , +1.20D+0.50L+0.70S | 0.08977 | +X | Bottom | 0.0202 | Min Temp % | 0.1333 | 5.306 | OK |
| , +0.90D | 0.03746 | -X | Bottom | 0.0202 | Min Temp % | 0.1333 | 5.306 | OK |
| , +0.90D | 0.03746 | +X | Bottom | 0.0202 | Min Temp % | 0.1333 | 5.306 | OK |

Units : k

One Way Shear

| Load Combination... | Vu @ -X | Vu @ +X | Vu:Max | Phi Vn | Vu / Phi*Vn | Status |
|---------------------|---------|---------|--------|--------|-------------|--------|
| +1.40D | 0 psi | 0 psi | 0 psi | 75 psi | 0 | OK |
| +1.20D+1.60L | 0 psi | 0 psi | 0 psi | 75 psi | 0 | OK |
| +1.20D+1.60L+0.50S | 0 psi | 0 psi | 0 psi | 75 psi | 0 | OK |



Merrell Design Services
Practical Structural Solutions

Project Title: Cheshire Upper Lot
 Engineer: KJH
 Project ID: 23-067
 Project Descr: Two-Story Residence Fdns & Framing

Wall Footing

Project File: cheshire framing 20241204.ec6

LIC# : KW-06011847, Build:20.23.08.30

Merrell Design Services PLLC

(c) ENERCALC INC 1983-2023

DESCRIPTION: TYPICAL STRIP FOOTINGS (INTERIOR & EXTERIOR)

One Way Shear

Units : k

| Load Combination... | Vu @ -X | Vu @ +X | Vu:Max | Phi Vn | Vu / Phi*Vn | Status |
|---------------------|---------|---------|--------|--------|-------------|--------|
| +1.20D+0.50L | 0 psi | 0 psi | 0 psi | 75 psi | 0 | OK |
| +1.20D | 0 psi | 0 psi | 0 psi | 75 psi | 0 | OK |
| +1.20D+0.50L+1.60S | 0 psi | 0 psi | 0 psi | 75 psi | 0 | OK |
| +1.20D+1.60S | 0 psi | 0 psi | 0 psi | 75 psi | 0 | OK |
| +1.20D+0.50L+0.50S | 0 psi | 0 psi | 0 psi | 75 psi | 0 | OK |
| +1.20D+0.50L+0.70S | 0 psi | 0 psi | 0 psi | 75 psi | 0 | OK |
| +0.90D | 0 psi | 0 psi | 0 psi | 75 psi | 0 | OK |



Project Title: Mercer Island Custom Home
 Engineer: KJH
 Project ID: 21-045
 Project Descr: Framing and Foundations

Printed: 9 AUG 2021, 12:36AM

ASCE 7-16 Wind Forces Chpt 28, Pt2 & Chpt 30, Pt2

Software copyright ENERCALC, INC. 1983-2020, Build:12.20.8.24
 Merrell Design Services PLLC

Lic. #: KW-06011847

DESCRIPTIO Wind forces - Mercer Island

General Design Values

Calculations per ASCE 7-16

| | |
|---|---|
| V : Basic Wind Speed per Sect 26.5-1 or 2 | 110.0 mph |
| User specified minimum design pressu | 10.0 psf |
| Occupancy per Table 1.5-1 | II All Buildings and other structures except those listed |
| Exposure Category per 26.7 | Exposure C |
| Topographic Factor Kzt per 26.8 | 1.00 |

Main Force Resisting System Valu

Component & Cladding Values

| | | | |
|------------------------|----------------|---|---------------------|
| MRH : Mean Roof Height | 30.0 ft | Effective Wind Area of Component & Clad | 10.0 ft^2 |
| Roof Slope Angle | 0 to 5 degrees | Roof pitch for cladding pressu | Flat/Hip/Gable Roof |
| | | LHD : Least Horizontal Dimension | 40.0 ft |
| | | a = max (0.04 * LHD, 3, min(0.10 * LHD, 0.4*MRH)) | 4.00 ft |

Lambda MWFRS: per Figure 26. 1.40

Lambda Component & Cladding : per Figur 1.40

Design Wind Pressures

Horizontal Pressures . . .

| | | | |
|-----------|------------|-----------|------------|
| Zone: A = | 26.88 psf | Zone: C = | 17.78 psf |
| Zone: B = | -14.00 psf | Zone: D = | -10.00 psf |

Vertical Pressures . . .

| | | | |
|-----------|------------|-----------|------------|
| Zone: E = | -32.34 psf | Zone: G = | -22.40 psf |
| Zone: F = | -18.34 psf | Zone: H = | -14.14 psf |

Overhangs . . .

| | | | |
|-------------|------------|-------------|------------|
| Zone: Eoh = | -45.22 psf | Zone: Goh = | -35.42 psf |
|-------------|------------|-------------|------------|

ASCE 7-16 Section 28.5.4 Minimum Design Wind Loads requires that the load effects of the design wind pressures from Section 28.5.3 shall not be less than a minimum load defined by assuming the pressures, ps, for zones A and C equal to +16 psf, Zones B and D equal to +8 psf, while assuming ps for Zones E, F, G, and H are equal to 0 psf.

Component & Cladding Design Wind Press

*Design Wind Pressure = Lambda * Kzt * Ps30 pe.*

| Roof Pressures | Positive | Negative | Overhang Pressures | Negative |
|----------------|----------|-------------|--------------------|-------------|
| Zone 1 | 12.460 | -48.580 psf | Zone 1 | *** psf |
| Zone 1' | 12.460 | -27.860 psf | Zone 1' | *** psf |
| Zone 2 | 12.460 | -63.980 psf | Zone 2 | -53.900 psf |
| Zone 2e | *** | *** psf | Zone 2e | *** psf |
| Zone 2n | *** | *** psf | Zone 2n | *** psf |
| Zone 2r | *** | *** psf | Zone 2r | *** psf |
| Zone 3 | 12.460 | -87.220 psf | Zone 3 | -73.080 psf |
| Zone 3e | *** | *** psf | Zone 3e | *** psf |
| Zone 3r | *** | *** psf | Zone 3r | *** psf |

Wall Pressures

| | | |
|---------------|-----|---------|
| Wall Zone 4 : | *** | *** psf |
| Wall Zone 5 : | *** | *** psf |

*** : There is no value in Figure 30.4-1 Tabular Values

ASCE 7-16 Seismic Base Shear

Project File: cheshire framing 20241204.ec6

LIC#: KW-06011847, Build:20.23.08.30

Merrell Design Services PLLC

(c) ENERCALC INC 1983-2023

DESCRIPTION: Seismic Base Shear Analysis

Specific Description: Cheshire #2

Risk Category

Calculations per ASCE 7-16

Risk Category of Building or Other Structure: "II": All Buildings and other structures except those listed as Category I, III, and IV *SCE 7-16, Page 4, Table 1.5-1*

Seismic Importance Factor = 1 *ASCE 7-16, Page 5, Table 1.5-2*

USER DEFINED Ground Motion

ASCE 7-16 11.4.2

Max. Ground Motions, 5% Damping

$$S_S = 1.630 \text{ g, 0.2 sec response}$$

$$S_1 = 0.620 \text{ g, 1.0 sec response}$$

For the closest datapoint grid location . . .

$$\text{Latitude} = 0.000 \text{ deg North}$$

$$\text{Longitude} = 0.000 \text{ deg West}$$

Site Class, Site Coeff. and Design Category

Classification: "D": Shear Wave Velocity 600 to 1,200 ft/sec = **D** (Based on Testing) *ASCE 7-16 Table 20.3-1*

Site Coefficients F_a & F_v $F_a = 1.00$ *ASCE 7-16 Table 11.4-1 & 11.4-2*
(using straight-line interpolation from table val) $F_v = 1.70$

Maximum Considered Earthquake Accelerat $S_{MS} = F_a * S_s = 1.630$ *ASCE 7-16 Eq. 11.4-1*
 $S_{M1} = F_v * S_1 = 1.054$ *ASCE 7-16 Eq. 11.4-2*

Design Spectral Acceleration $S_{DS} = S_{MS}^{*2/3} = 1.087$ *ASCE 7-16 Eq. 11.4-3*
 $S_{D1} = S_{M1}^{*2/3} = 0.703$ *ASCE 7-16 Eq. 11.4-4*

Seismic Design Category = **D** *ISCE 7-16 Table 11.6-1 & -2*

Resisting System

ASCE 7-16 Table 12.2-1

Basic Seismic Force Resisting System . . .

Bearing Wall Systems

15.Light-frame (wood) walls sheathed w/wood structural panels rated for shear resistance.

Response Modification Coefficient "I" = 6.50

Building height Limits :

System Overstrength Factor "Wo" = 3.00

Category "A & B" Limit: No Limit

Deflection Amplification Factor "Cd" = 4.00

Category "C" Limit: No Limit

Category "D" Limit: Limit = 65

Category "E" Limit: Limit = 65

Category "F" Limit: Limit = 65

NOTE! See ASCE 7-16 for all applicable footnc

Lateral Force Procedure

ASCE 7-16 Section 12.8.2

Equivalent Lateral Force Procedure

The "Equivalent Lateral Force Procedure" is being used according to the provisions of ASCE 7-16 12.8

Determine Building Period

Use ASCE 12.8-7

Structure Type for Building Period CalculzAll Other Structural Systems

"Ct" value = 0.020 "hn": Height from base to highest leve 20.0 ft

"x" value = 0.75

"Ta" Approximate fundamental period using Eq. 12.8-7: $T_a = C_t * (h_n \wedge x) = 0.189 \text{ sec}$

"TL": Long-period transition period per ASCE 7-16 Maps 22-14 -> 22-17 6.000 sec

Building Period "Ta" Calculated from Approximate Method sel= 0.189

"Cs" Response Coefficient

ASCE 7-16 Section 12.8.1.1

S_{DS} : Short Period Design Spectral Response = 1.087 From Eq. 12.8-2, Preliminary Cs = 0.167

"R": Response Modification Factor = 6.50 From Eq. 12.8-3 & 12.8-4, Cs need not excee = 0.572

"I": Seismic Importance Factor = 1 From Eq. 12.8-5 & 12.8-6, Cs not be less than = 0.048

Cs : Seismic Response Coefficient = 0.1672

ASCE 7-16 Seismic Base Shear

Project File: cheshire framing 20241204.ec6

LIC# : KW-06011847, Build:20.23.08.30

Merrell Design Services PLLC

(c) ENERCALC INC 1983-2023

DESCRIPTION: Seismic Base Shear Analysis

Seismic Base Shear

ASCE 7-16 Section 12.8.1

$$C_s = 0.1672 \text{ from 12.8.1.1}$$

$$W \text{ (see Sum } W_i \text{ below)} = 118.20 \text{ k}$$

$$\text{Seismic Base Shear } V = C_s * W = 19.76 \text{ k}$$

Vertical Distribution of Seismic Forces

ASCE 7-16 Section 12.8.3

"k" : hx exponent based on $T_a = 1.00$

Table of building Weights by Floor Level...

| Level # | Wi : Weight | Hi : Height | (Wi * Hi^k) | Cvx | Fx=Cvx * V | Sum Story Shear | Sum Story Moment |
|----------|-------------|---------------|---------------|--------------------|------------|-----------------|------------------|
| 2 | 52.00 | 22.00 | 1,144.00 | 0.6110 | 12.07 | 12.07 | 0.00 |
| 1 | 66.20 | 11.00 | 728.20 | 0.3890 | 7.69 | 19.76 | 132.82 |
| Sum Wi = | 118.20 k | Sum Wi * Hi = | 1,872.20 k-ft | Total Base Shear = | 19.76 k | Base Moment = | 350.2 k-ft |

Diaphragm Forces : Seismic Design Category "B" to "F"

ASCE 7-16 12.10.1.1

| Level # | Wi | Fi | Sum Fi | Sum Wi | Fpx : Calcd | Fpx : Min | Fpx : Max | Fpx | Dsgn. Force |
|---------|-------|-------|--------|--------|-------------|-----------|-----------|-------|-------------|
| 2 | 52.00 | 12.07 | 12.07 | 52.00 | 12.07 | 11.30 | 22.60 | 12.07 | 12.07 |
| 1 | 66.20 | 7.69 | 19.76 | 118.20 | 11.07 | 14.39 | 28.77 | 14.39 | 14.39 |

Wpx Weight at level of diaphragm and other structure elements attached to it.

Fi Design Lateral Force applied at the level.

Sum Fi Sum of "Lat. Force" of current level plus all levels above

MIN Req'd Force @ Level . . . $0.20 * S_{DS} * I * W_{px}$

MAX Req'd Force @ Level . . . $0.40 * S_{DS} * I * W_{px}$

Fpx : Design Force @ Level . $W_{px} * \text{SUM}(x \rightarrow n) Fi / \text{SUM}(x \rightarrow n) wi$, x = Current level, n = Top Level

Lateral Force Distribution

Main Wind Force (ult): 23.9 psf (zone c) (See Enercalc)
 Main Wind Force (service): 14.34 psf (zone c)
 Bldg Width 50 ft
 Bldg Length 78 ft
 1st Flr Width 50 ft
 2nd Flr Length 78 ft

Seismic Mass

Roof 51996 lbs
 2nd 66252 lbs
 Cs 0.1672 (See Enercalc)

Transverse Loads Longitudinal Loads

| Level | Seismic Weight | Seismic Force | Service Level Forces | Wind Trib ht | Svc Lvl EQ Unit Forces Trans | Service Wind Loads Trans | Svc Lvl EQ Unit Forces Long | Service Wind Loads Long | Floor ht |
|-------|----------------|---------------|----------------------|--------------|------------------------------|--------------------------|-----------------------------|-------------------------|----------|
| | (k) | (k) | (k) | ft | lbs/ft | lbs/ft | lbs/ft | lbs/ft | ft |
| Roof | 51996 | 12.07 | 8.45 | 6.5 | 108 | 93 | 169 | 93 | 11 |
| 2nd | 66252 | 7.69 | 5.38 | 11 | 69 | 158 | 108 | 158 | 11 |

Total 19.76 13.83

Wind loads control transverse forces Transverse Wind Total 19.6 k

Seismic loads control longitudinal forces Longitudinal Seismic Total 13.8 k

Transverse Direction Shear Walls

| Grid | Roof Trib width (ft) | Roof (lbs) | Lenh of SW (ft) | 2nd floor walls (lb/ft) | SW Type | DL Resistance lbs/ft | HD force lbs | HD Type | 1st Trib width (sq ft) | 1st Floor (lbs) | Lenh of SW (ft) | 1st Floor walls (lb/ft) | SW Type | DL Resistance lbs/ft | HD force lbs | HD Type |
|------|----------------------|------------|-----------------|-------------------------|---------|----------------------|--------------|---------|------------------------|-----------------|-----------------|-------------------------|---------|----------------------|--------------|---------|
| 1 | 9 | 839 | 13 | 65 | W6 | 178 | 0 | NA | 9 | 2259 | 13 | 174 | W6 | 356 | 0 | NA |
| 2 | 12 | 1119 | 18 | 62 | G7 | 187 | 0 | NA | 12 | 3011 | 18 | 167 | 2G4 | 374 | 0 | NA |
| 3 | 14 | 1305 | 28.5 | 46 | G7 | 205 | 0 | NA | 14 | 3513 | 28.5 | 123 | 2G4 | 410 | 0 | NA |
| 4 | 14 | 1305 | 24.5 | 53 | G7 | 205 | 0 | NA | 14 | 3513 | 24.5 | 143 | 2G4 | 410 | 0 | NA |
| 5 | 12 | 1119 | 24.5 | 46 | G7 | 187 | 0 | NA | 12 | 3011 | 24.5 | 123 | 2G4 | 374 | 0 | NA |
| 6 | 9 | 839 | 6.5 | 129 | W6 | 178 | 524 | MSTI48 | 9 | 2259 | 6.5 | 347 | W4 | 356 | 4255 | HDU5 |

Longitudinal Direction Shear Walls

| Grid | Roof Trib width (ft) | Roof (lbs) | Lenh of SW (ft) | 2nd floor walls (lb/ft) | SW Type | DL Resistance lbs/ft | HD force lbs | HD Type | 1st Trib width (sq ft) | 1st Floor (lbs) | Lenh of SW (ft) | 1st Floor walls (lb/ft) | SW Type | DL Resistance lbs/ft | HD force lbs | HD Type |
|------|----------------------|------------|-----------------|-------------------------|---------|----------------------|--------------|---------|------------------------|-----------------|-----------------|-------------------------|---------|----------------------|--------------|---------|
| A/B | 14 | 2366 | 13.87 | 171 | W6 | 106 | 1140 | MSTI48 | 14 | 3873 | 13.87 | 450 | W3 | 203 | 0 | NA |
| B.3 | 11 | 1859 | 7 | 266 | W6 | 106 | 2549 | MSTI48 | 11 | 3043 | 8 | 613 | W2 | 203 | 5026 | HDU5 |
| B.7 | 11 | 1859 | 7 | 266 | W6 | 106 | 2549 | MSTI48 | 11 | 3043 | 8 | 613 | W2 | 203 | 5026 | HDU5 |
| C/D | 14 | 2366 | (6) Cant Cols | NA | Cant C | 106 | NA | NA | 14 | 3873 | 28.67 | 218 | W6 | 203 | 0 | NA |

REV 1



Merrell Design Services

Practical Structural Solutions

Project Title: Cheshire Upper Lot
Engineer: KJH
Project ID: 23-067
Project Descr: Two-Story Residence Fdns & Framing

Cantilevered Retaining Wall

Project File: cheshire framing 20250609.ec6

LIC# : KW-06020507, Build:20.24.03.04

Quanta Infrastructure Solutions Group

(c) ENERCALC INC 1983-2023

DESCRIPTION: Site Retaining Walls

Code Reference


Calculations per IBC 2018 1807.3, CBC 2019, ASCE 7-16

Criteria

| | | |
|-------------------------------------|---|----------|
| Retained Height | = | 5.00 ft |
| Wall height above soil | = | 0.50 ft |
| Slope Behind Wall | = | 0.00 |
| Height of Soil over Toe | = | 12.00 in |
| Water table above bottom of footing | = | 0.0 ft |

Soil Data

| | | |
|--|---|--------------|
| Allow Soil Bearing | = | 2,000.0 psf |
| Coulomb Soil Pressure calculation | | |
| Soil Friction Angle | = | 30.0 deg |
| Active Pressure: | | |
| Ka*Gamma (horiz) | = | 29.6 psf/ft |
| Passive Pressure:Kp*Gar | = | 552.8 psf/ft |
| Soil Density, Heel | = | 115.00 pcf |
| Soil Density, Toe | = | 115.00 pcf |
| Footing Soil Friction | = | 0.300 |
| Soil height to ignore for passive pressure | | |
| | = | 12.00 in |

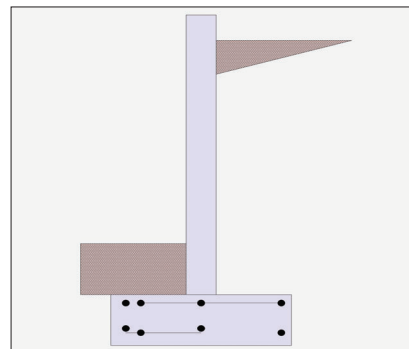

Surcharge Loads

| | | |
|--------------------------------------|---|----------|
| Surcharge Over Heel | = | 49.0 psf |
| Used To Resist Sliding & Overturning | | |
| Surcharge Over Toe | = | 0.0 |
| Used for Sliding & Overturning | | |

Axial Load Applied to Stem

| | | |
|-------------------------|---|---------|
| Axial Dead Load | = | 0.0 lbs |
| Axial Live Load | = | 0.0 lbs |
| Axial Load Eccentricity | = | 0.0 in |

Earth Pressure Seismic Load

| | | |
|-----------------------------------|---|---------|
| Method | : | Uniform |
| Multiplier Used | = | 8.000 |
| (Multiplier used on soil density) | | |

Lateral Load Applied to Stem

| | | |
|----------------------|---|-----------------------------|
| Lateral Load | = | 0.0 #/ft |
| ...Height to Top | = | 0.00 ft |
| ...Height to Bottom | = | 0.00 ft |
| Load Type | = | Wind (W) (Service Level) |
| Wind on Exposed Stem | = | 0.0 psf (Strength Level) |

| | | |
|-----------------------|---|---------|
| Uniform Seismic Force | = | 48.000 |
| Total Seismic Force | = | 288.000 |

Adjacent Footing Load

| | | |
|---------------------------------------|---|----------------|
| Adjacent Footing Load | = | 0.0 lbs |
| Footing Width | = | 0.00 ft |
| Eccentricity | = | 0.00 in |
| Wall to Ftg CL Dist | = | 0.00 ft |
| Footing Type | = | Spread Footing |
| Base Above/Below Soil at Back of Wall | = | 0.0 ft |
| Poisson's Ratio | = | 0.300 |



Merrell Design Services

Practical Structural Solutions

Project Title: Cheshire Upper Lot
 Engineer: KJH
 Project ID: 23-067
 Project Descr: Two-Story Residence Fdns & Framing

Cantilevered Retaining Wall

Project File: cheshire framing 20250609.ec6

LIC# : KW-06020507, Build:20.24.03.04

Quanta Infrastructure Solutions Group

(c) ENERCALC INC 1983-2023

DESCRIPTION: Site Retaining Walls

Design Summary

Wall Stability Ratios

| | | | |
|-----------------------------------|---|-----------|----|
| Overturning | = | 1.71 | OK |
| Sliding | = | 1.69 | OK |
| Global Stability | = | 2.25 | |
| | | | |
| Total Bearing Load | = | 2,094 lbs | |
| ...resultant ecc. | = | 9.01 in | |
| Eccentricity outside middle third | | | |
| Soil Pressure @ Toe | = | 1,589 psf | OK |
| Soil Pressure @ Heel | = | 0 psf | OK |
| Allowable | = | 2,000 psf | |
| Soil Pressure Less Than Allowable | | | |
| ACI Factored @ Toe | = | 2,224 psf | |
| ACI Factored @ Heel | = | 0 psf | |
| Footing Shear @ Toe | = | 8.5 psi | OK |
| Footing Shear @ Hee | = | 9.3 psi | OK |
| Allowable | = | 75.0 psi | |

Sliding Calcs

| | | | |
|--------------------------|---|-----------|----|
| Lateral Sliding Force | = | 810.0 lbs | |
| less 100% Passive Force | = | 829.2 lbs | |
| less 100% Friction Force | = | 535.9 lbs | |
| Added Force Req'd | = | 0.0 lbs | OK |
| ...for 1.5 Stability | = | 0.0 lbs | OK |

Vertical component of active lateral soil pressure IS NOT considered in the calculation of soil bearing

Load Factors

| | |
|---------------|-------|
| Building Code | |
| Dead Load | 1.200 |
| Live Load | 1.600 |
| Earth, H | 1.600 |
| Wind, W | 1.600 |
| Seismic, E | 1.000 |

Stem Construction

Design Height Above Ftc

| | | |
|--------------------------|---------|----------|
| ft = | Stem OK | 0.00 |
| Wall Material Above "Ht" | = | Concrete |
| Design Method | = | SD |
| Thickness | = | 6.00 |
| Rebar Size | = | # 4 |
| Rebar Spacing | = | 12.00 |
| Rebar Placed at | = | Center |

Design Data

| | | |
|---------------|---|-------|
| fb/FB + fa/Fa | = | 0.739 |
|---------------|---|-------|

Total Force @ Section

| | | |
|----------------|-------|-------|
| Service Level | lbs = | |
| Strength Level | lbs = | 932.8 |

Moment....Actual

| | | |
|----------------|--------|---------|
| Service Level | ft-# = | |
| Strength Level | ft-# = | 1,838.8 |

| | | |
|---------------------|---|---------|
| Moment....Allowable | = | 2,487.6 |
|---------------------|---|---------|

Shear....Actual

| | | |
|----------------|-------|------|
| Service Level | psi = | |
| Strength Level | psi = | 25.9 |

| | | |
|---------------------|-------|------|
| Shear.....Allowable | psi = | 75.0 |
|---------------------|-------|------|

| | | |
|----------------|-------|--|
| Anet (Masonry) | in2 = | |
|----------------|-------|--|

| | | |
|-------------|-------|------|
| Wall Weight | psf = | 75.0 |
|-------------|-------|------|

| | | |
|-----------------|------|------|
| Rebar Depth 'd' | in = | 3.00 |
|-----------------|------|------|

Masonry Data

| | | |
|-----------------------|-------|-----|
| f'm | psi = | |
| Fs | psi = | |
| Solid Grouting | = | |
| Modular Ratio 'n' | = | |
| Equiv. Solid Thick. | = | |
| Masonry Block Type | = | |
| Masonry Design Method | = | ASD |

Concrete Data

| | | |
|-----|-------|----------|
| f'c | psi = | 2,500.0 |
| Fy | psi = | 60,000.0 |



Merrell Design Services

Practical Structural Solutions

Project Title: Cheshire Upper Lot
 Engineer: KJH
 Project ID: 23-067
 Project Descr: Two-Story Residence Fdns & Framing

Cantilevered Retaining Wall

Project File: cheshire framing 20250609.ec6

LIC# : KW-06020507, Build:20.24.03.04

Quanta Infrastructure Solutions Group

(c) ENERCALC INC 1983-2023

DESCRIPTION: Site Retaining Walls

Concrete Stem Rebar Area Details

| Bottom Stem | Vertical Reinforcing | Horizontal Reinforcing | |
|--------------------------------|----------------------|--|--------------|
| As (based on applied moment) : | 0.1524 in2/ft | | |
| (4/3) * As : | 0.2032 in2/ft | Min Stem T&S Reinf Area 0.792 in2 | |
| 200bd/fy : 200(12)(3)/60000 : | 0.12 in2/ft | Min Stem T&S Reinf Area per ft of stem Height : 0.144 in2/ft | |
| 0.0018bh : 0.0018(12)(6) : | 0.1296 in2/ft | Horizontal Reinforcing Options : | |
| | ===== | <u>One layer of :</u> <u>Two layers of :</u> | |
| Required Area : | 0.1524 in2/ft | #4@ 16.67 in | #4@ 33.33 in |
| Provided Area : | 0.2 in2/ft | #5@ 25.83 in | #5@ 51.67 in |
| Maximum Area : | 0.4064 in2/ft | #6@ 36.67 in | #6@ 73.33 in |

Footing Data

| | | |
|---------------------|---|----------|
| Toe Width | = | 1.25 ft |
| Heel Width | = | 1.75 |
| Total Footing Width | = | 3.00 |
| Footing Thickness | = | 12.00 in |

f_c = 2,500 psi F_y = 60,000 psi
 Footing Concrete Density = 150.00 pcf
 Min. As % = 0.0018
 Cover @ Top 2.00 @ Btm.= 3.00 in

Footing Design Results

| | Toe | Heel | |
|--------------------------------|------------------|--------|--------|
| Factored Pressure | = 2,224 | 0 | psf |
| Mu' : Upward | = 1,416 | 20 | ft-# |
| Mu' : Downward | = 248 | 741 | ft-# |
| Mu: Design | = 1,167 | 721 | ft-# |
| phiMn | = 7,663 | 10,944 | ft-# |
| Actual 1-Way Shear | = 8.46 | 9.32 | psi |
| Allow 1-Way Shear | = 75.00 | 75.00 | psi |
| Toe Reinforcing | = # 4 @ 12.00 in | | |
| Heel Reinforcing | = # 5 @ 14.35 in | | |
| Key Reinforcing | = None Spec'd | | |
| Footing Torsion, Tu | = | 0.00 | ft-lbs |
| Footing Allow. Torsion, phi Tu | = | 0.00 | ft-lbs |

If torsion exceeds allowable, provide supplemental design for footing torsion.

Other Acceptable Sizes & Spacings

Toe: #4@ 9.25 in, #5@ 14.35 in, #6@ 20.37 in, #7@ 27.77 in, #8@ 36.57 in, #9@ 46.29 in, #10@ 58.79 in

Heel: #4@ 9.25 in, #5@ 14.35 in, #6@ 20.37 in, #7@ 27.77 in, #8@ 36.57 in, #9@ 46.29 in, #10@ 58.79 in

Key: No key defined

Min footing T&S reinf Area 0.78 in2
 Min footing T&S reinf Area per foot 0.26 in2 /ft

If one layer of horizontal bars:

#4@ 9.26 in
 #5@ 14.35 in
 #6@ 20.37 in

If two layers of horizontal bars:

#4@ 18.52 in
 #5@ 28.70 in
 #6@ 40.74 in



Merrell Design Services

Practical Structural Solutions

Project Title: Cheshire Upper Lot
 Engineer: KJH
 Project ID: 23-067
 Project Descr: Two-Story Residence Fdns & Framing

Cantilevered Retaining Wall

Project File: cheshire framing 20250609.ec6

LIC# : KW-06020507, Build:20.24.03.04

Quanta Infrastructure Solutions Group

(c) ENERCALC INC 1983-2023

DESCRIPTION: Site Retaining Walls

Summary of Overturning & Resisting Forces & Moments

| Item |OVERTURNING..... | | | |RESISTING..... | | |
|---|-----------------------|---------------|----------------|-------------------------------|---------------------|--------------|----------------|
| | Force lbs | Distance ft | Moment ft-# | | Force lbs | Distance ft | Moment ft-# |
| HL Act Pres (ab water tbl) | 532.7 | 2.00 | 1,065.5 | Soil Over HL (ab. water tbl) | 718.8 | 2.38 | 1,707.0 |
| HL Act Pres (be water tbl) | | | | Soil Over HL (bel. water tbl) | | 2.38 | 1,707.0 |
| Hydrostatic Force | | | | Water Table | | | |
| Buoyant Force = | | | | Sloped Soil Over Hee = | | | |
| Surcharge over Heel = | 75.7 | 3.00 | 227.0 | Surcharge Over Heel = | 61.3 | 2.38 | 145.5 |
| Surcharge Over Toe = | | | | Adjacent Footing Load = | | | |
| Adjacent Footing Load = | | | | Axial Dead Load on Stem = | | | |
| Added Lateral Load = | | | | * Axial Live Load on Stem = | | | |
| Load @ Stem Above Soil = | | | | Soil Over Toe = | 143.8 | 0.63 | 89.8 |
| Seismic Earth Load = | 201.6 | 3.00 | 604.8 | Surcharge Over Toe = | | | |
| = | | | | Stem Weight(s) = | 412.5 | 1.50 | 618.8 |
| Total = | 810.0 | O.T.M. | 1,897.3 | Earth @ Stem Transitions = | | | |
| | | | | Footing Weight = | 450.0 | 1.50 | 675.0 |
| | | | | Key Weight = | | | |
| | | | | Vert. Component = | | | |
| Resisting/Overturning Ratio | | = | 1.71 | Total = | 1,786.3 lbs | R.M.= | 3,236.1 |
| Vertical Loads used for Soil Pressure = | | 2,093.8 lbs | | | | | |

* Axial live load NOT included in total displayed, or used for overturning resistance, but is included for soil pressure calculation.

If seismic is included, the OTM and sliding ratios may be 1.1 per section 1807.2.3 of IBC.

Vertical component of active lateral soil pressure IS NOT considered in the calculation of Sliding Resistance.

Vertical component of active lateral soil pressure IS NOT considered in the calculation of Overturning Resistance.

Tilt

Horizontal Deflection at Top of Wall due to settlement of soil

(Deflection due to wall bending not considered)

| | |
|--|-----------|
| Soil Spring Reaction Modulus | 250.0 pci |
| Horizontal Defl @ Top of Wall (approximate only) | 0.081 in |



Merrell Design Services

Practical Structural Solutions

Project Title: Cheshire Upper Lot
Engineer: KJH
Project ID: 23-067
Project Descr: Two-Story Residence Fdns & Framing

Cantilevered Retaining Wall

Project File: cheshire framing 20250609.ec6

LIC# : KW-06020507, Build:20.24.03.04

Quanta Infrastructure Solutions Group

(c) ENERCALC INC 1983-2023

DESCRIPTION: Site Retaining Walls

Rebar Lap & Embedment Lengths Information

Stem Design Segment: Bottom

Stem Design Height: 0.00 ft above top of footing

| | |
|---|----------------------------|
| Lap Splice length for #4 bar specified in this stem design segment (25.4.2.3a) = | 18.72 in |
| Development length for #4 bar specified in this stem design segment = | 14.40 in |
| Hooked embedment length into footing for #4 bar specified in this stem design segment = | 6.40 in |
| As Provided = | 0.2000 in ² /ft |
| As Required = | 0.1524 in ² /ft |



Merrell Design Services

Practical Structural Solutions

Project Title: Cheshire Upper Lot
Engineer: KJH
Project ID: 23-067
Project Descr: Two-Story Residence Fdns & Framing

Cantilevered Retaining Wall


Project File: cheshire framing 20250609.ec6

LIC# : KW-06020507, Build:20.24.03.04

Quanta Infrastructure Solutions Group

(c) ENERCALC INC 1983-2023

DESCRIPTION: Site Retaining Walls

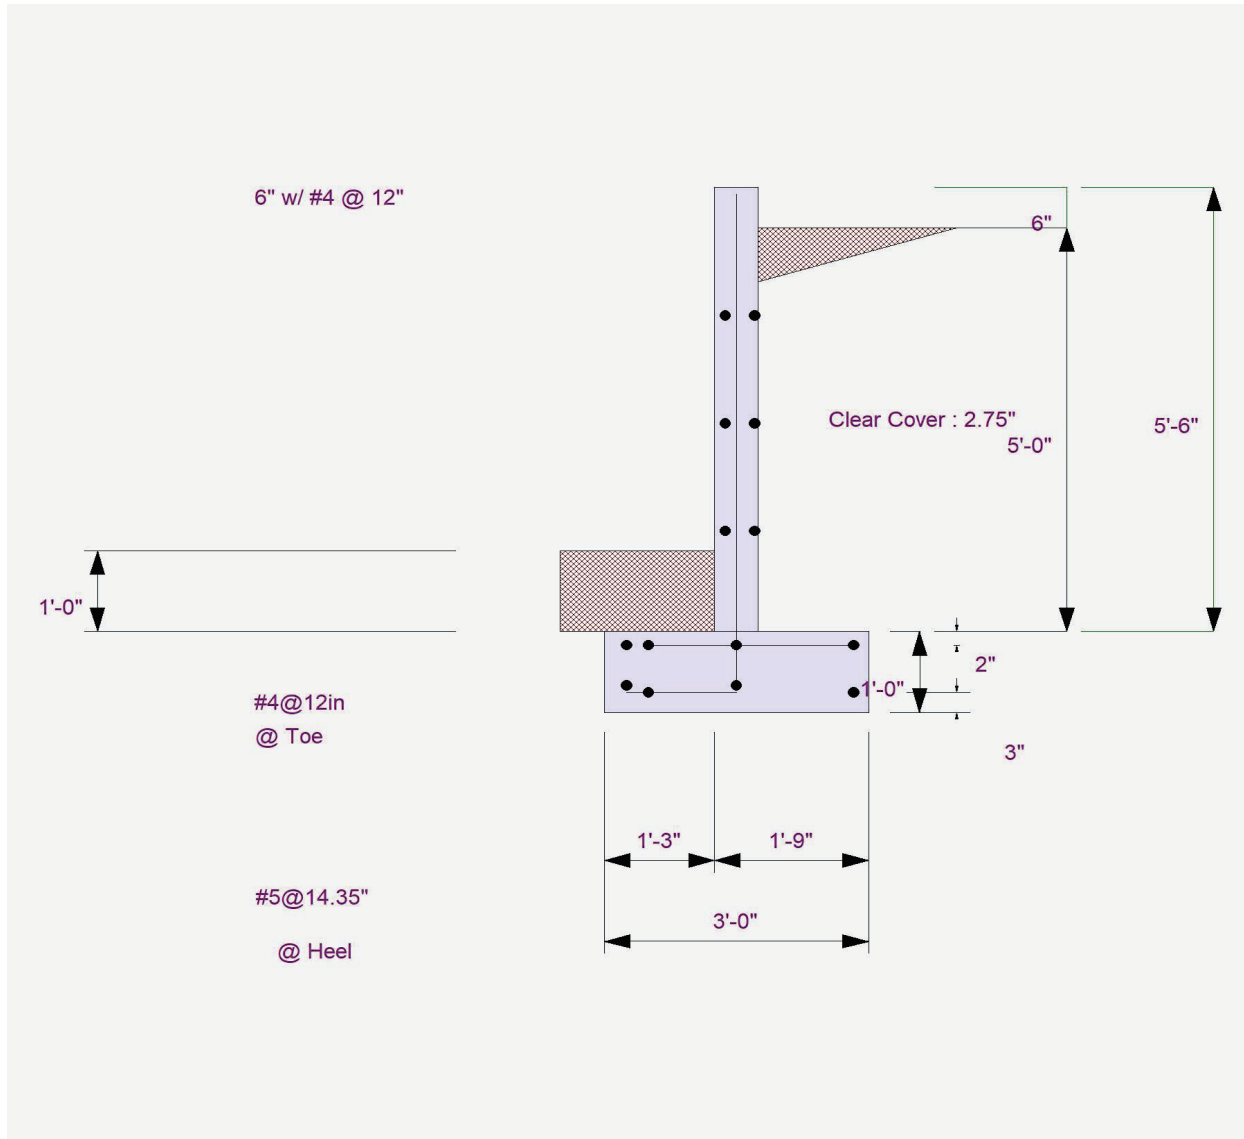



Merrell Design Services

Practical Structural Solutions

Project Title: Cheshire Upper Lot
Engineer: KJH
Project ID: 23-067
Project Descr: Two-Story Residence Fdns & Framing

Cantilevered Retaining Wall

Project File: cheshire framing 20250609.ec6

LIC# : KW-06020507, Build:20.24.03.04

Quanta Infrastructure Solutions Group

(c) ENERCALC INC 1983-2023

DESCRIPTION: Site Retaining Walls

