




COLUMBIA BANK

WA0061
7803 SE 27TH ST.
MERCER ISLAND WA 98040

	SIGN PART #	SQUARE FOOT
A	CB-CL-L-WHT-FM-18	12.2 SQ. FT.
	SIGN PART #	SQUARE FOOT
B/C	CB-CL-L-BLK-RW-18	12.2 SQ. FT.

COLUMBIA BANK WA0061
7803 SE 27TH STREET
MERCER ISLAND WA 98040

ZONE: TC
PARCEL# 5315101245

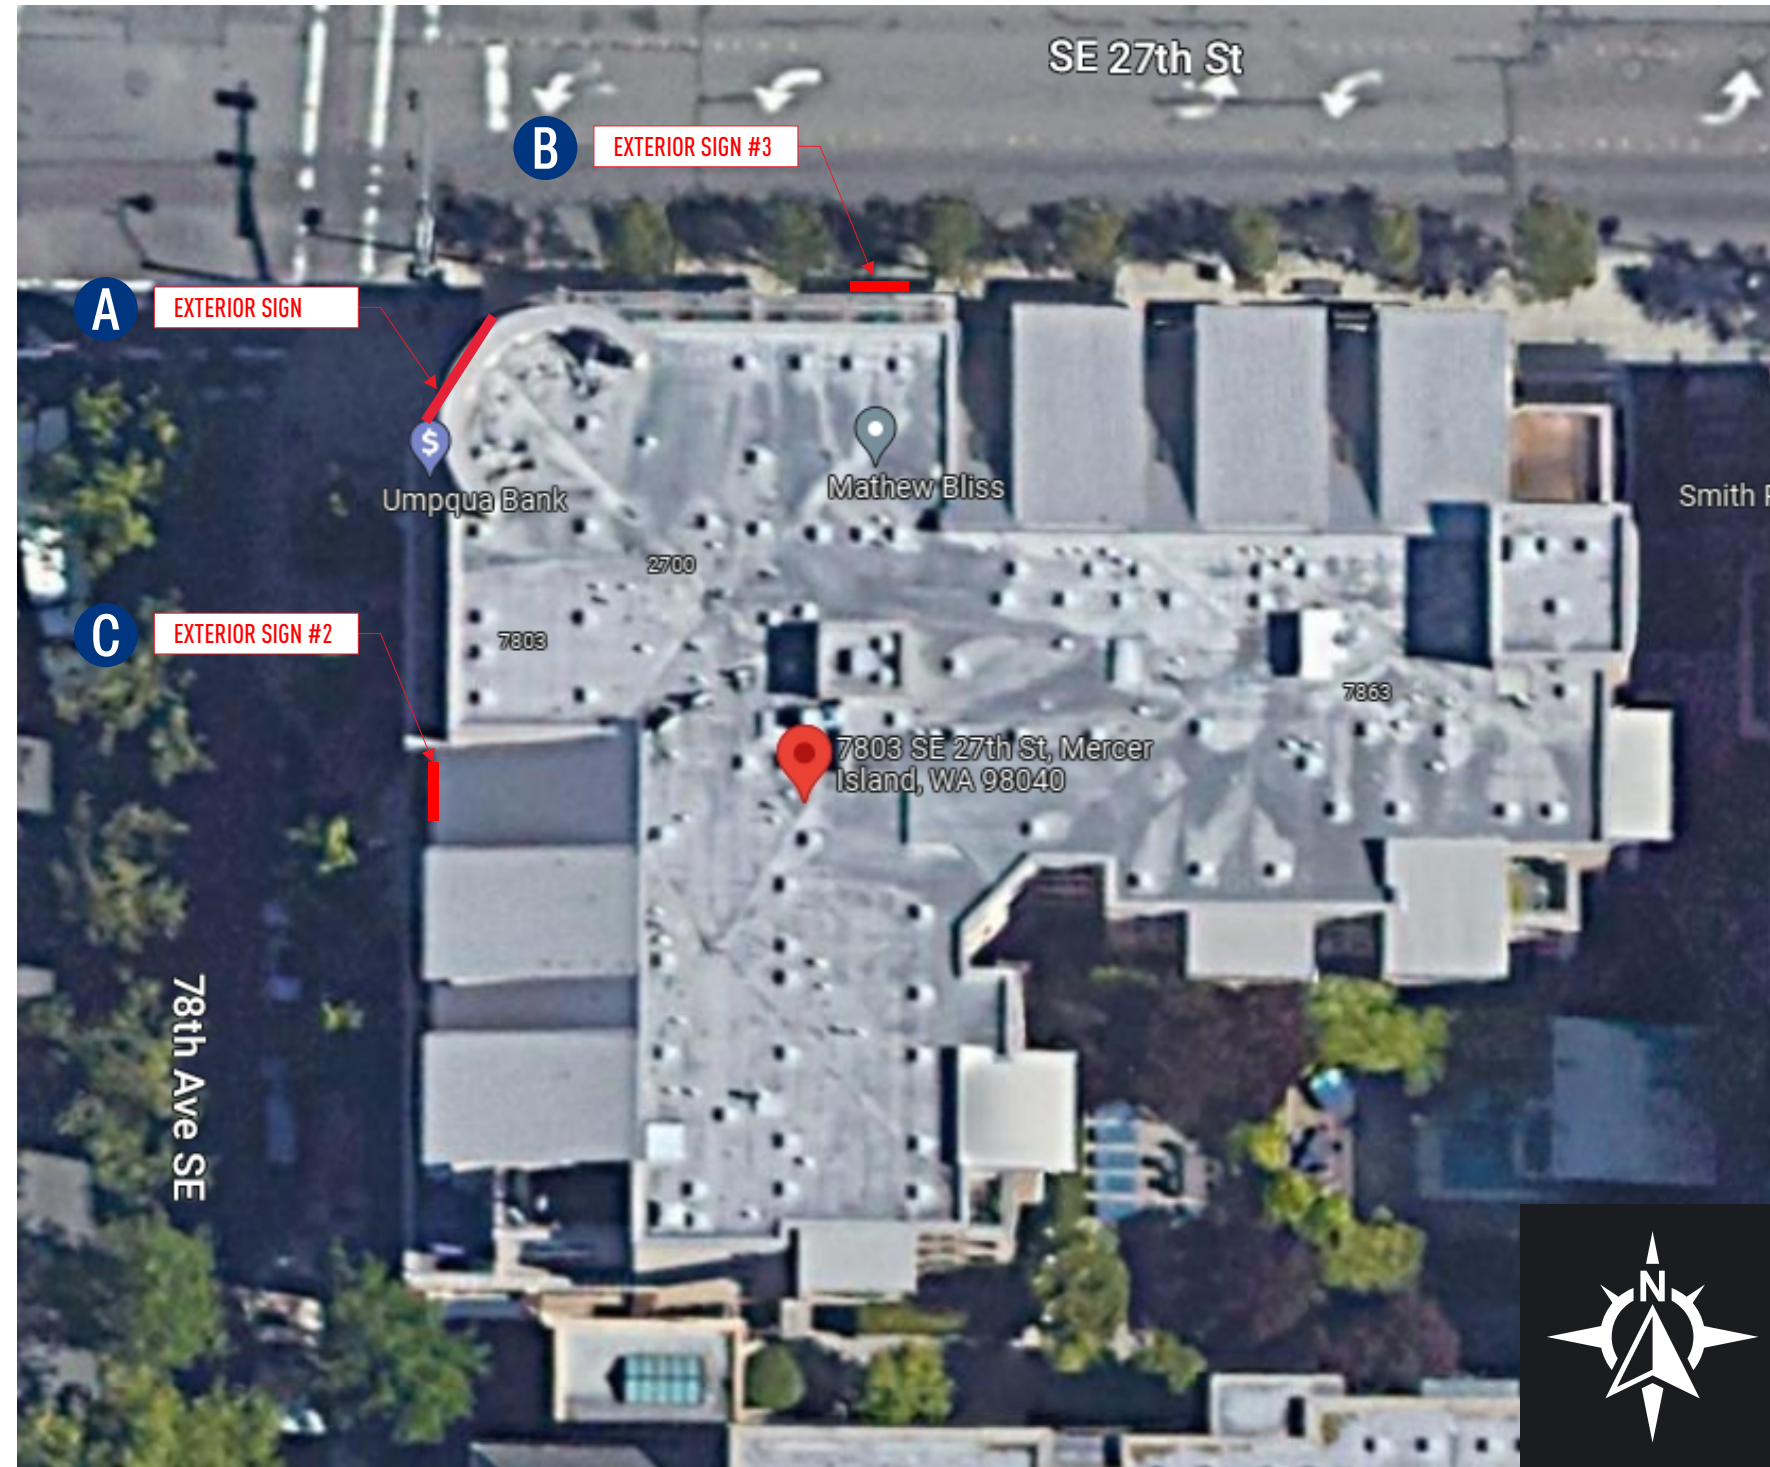

SITE PLAN WITH SIGNAGE

NOT TO SCALE

HEATH NORTHWEST

Distinctive Electrical Advertising Since 1967

TACOMA

5209 122nd Street East
Tacoma WA, 98446
253-495-7091
heathnorthwest.com



COLUMBIA BANK

CLIENT:
COLUMBIA BANK WA0061
7803 SE 27TH STREET
MERCER ISLAND WA 98040

PROPOSED DESIGN

ACCOUNT EXECUTIVE:
MICHELLE PRYNNE

PROJECT MANAGER
CHRISTINA ROBBINS

DESIGNER:
KJN

DATE:
5/9/25

HEATH NORTHWEST IS A UL
RECOGNIZED MANUFACTURER



© 2023 by Heath Northwest

These plans are the exclusive property of Heath Northwest, Inc. the original work of its design team. They are submitted to your company for the sole purpose of your consideration of whether to purchase these plans or to purchase from Heath Northwest a sign manufactured according to these plans. Distribution or exhibition of these plans to anyone other than employees of your company, or use of these plans to construct a sign similar to the one embodied herein, is expressly forbidden. In the event that such exhibition occurs, Heath Northwest expects to be reimbursed 15% of the total project value in compensation for time and effort entailed in creating these plans.

L73 Grounding and Bonding Statement for each permanently connected sign the following statement or equivalent "This sign is intended to be installed in the accordance with the requirements of Article 600 of the National Electrical Code and/or other applicable local codes. This includes proper grounding and bonding of the sign" should be either directly marked on the sign or label attached to the sign, included in the installation instructions, or provided on a separate sheet or tag shipped with the sign. The location of the disconnect switch after installation shall comply with Article 600.6 (A) (1) of the National Electrical code.

APPROVAL:
ACCOUNT EXECUTIVE

CLIENT

LANDLORD

DESIGN NUMBER:
25-0616-R2

REVISION NUMBER:
R2 06/04/25 KJN

PAGE # 1 OF 10